

NOTE: SITE PLAN IS SHOWN FOR  
DIAGRAMMATIC PURPOSES ONLY. REFER TO  
CIVIL DRAWINGS FOR MORE INFORMATION.

A0.1

#1 CHURCH OF CHRIST  
1802 PASCO STREET TALLAHASSEE, FL 32301


ARCHITECTURAL SITE PLAN



**CONN + ARCHITECTS**


1960-C Crawford Boulevard | Tallahassee, Florida 32308

www.CONNArchitects.com | Lic. No. AA C01662

01/26/2026
ALG
20-194

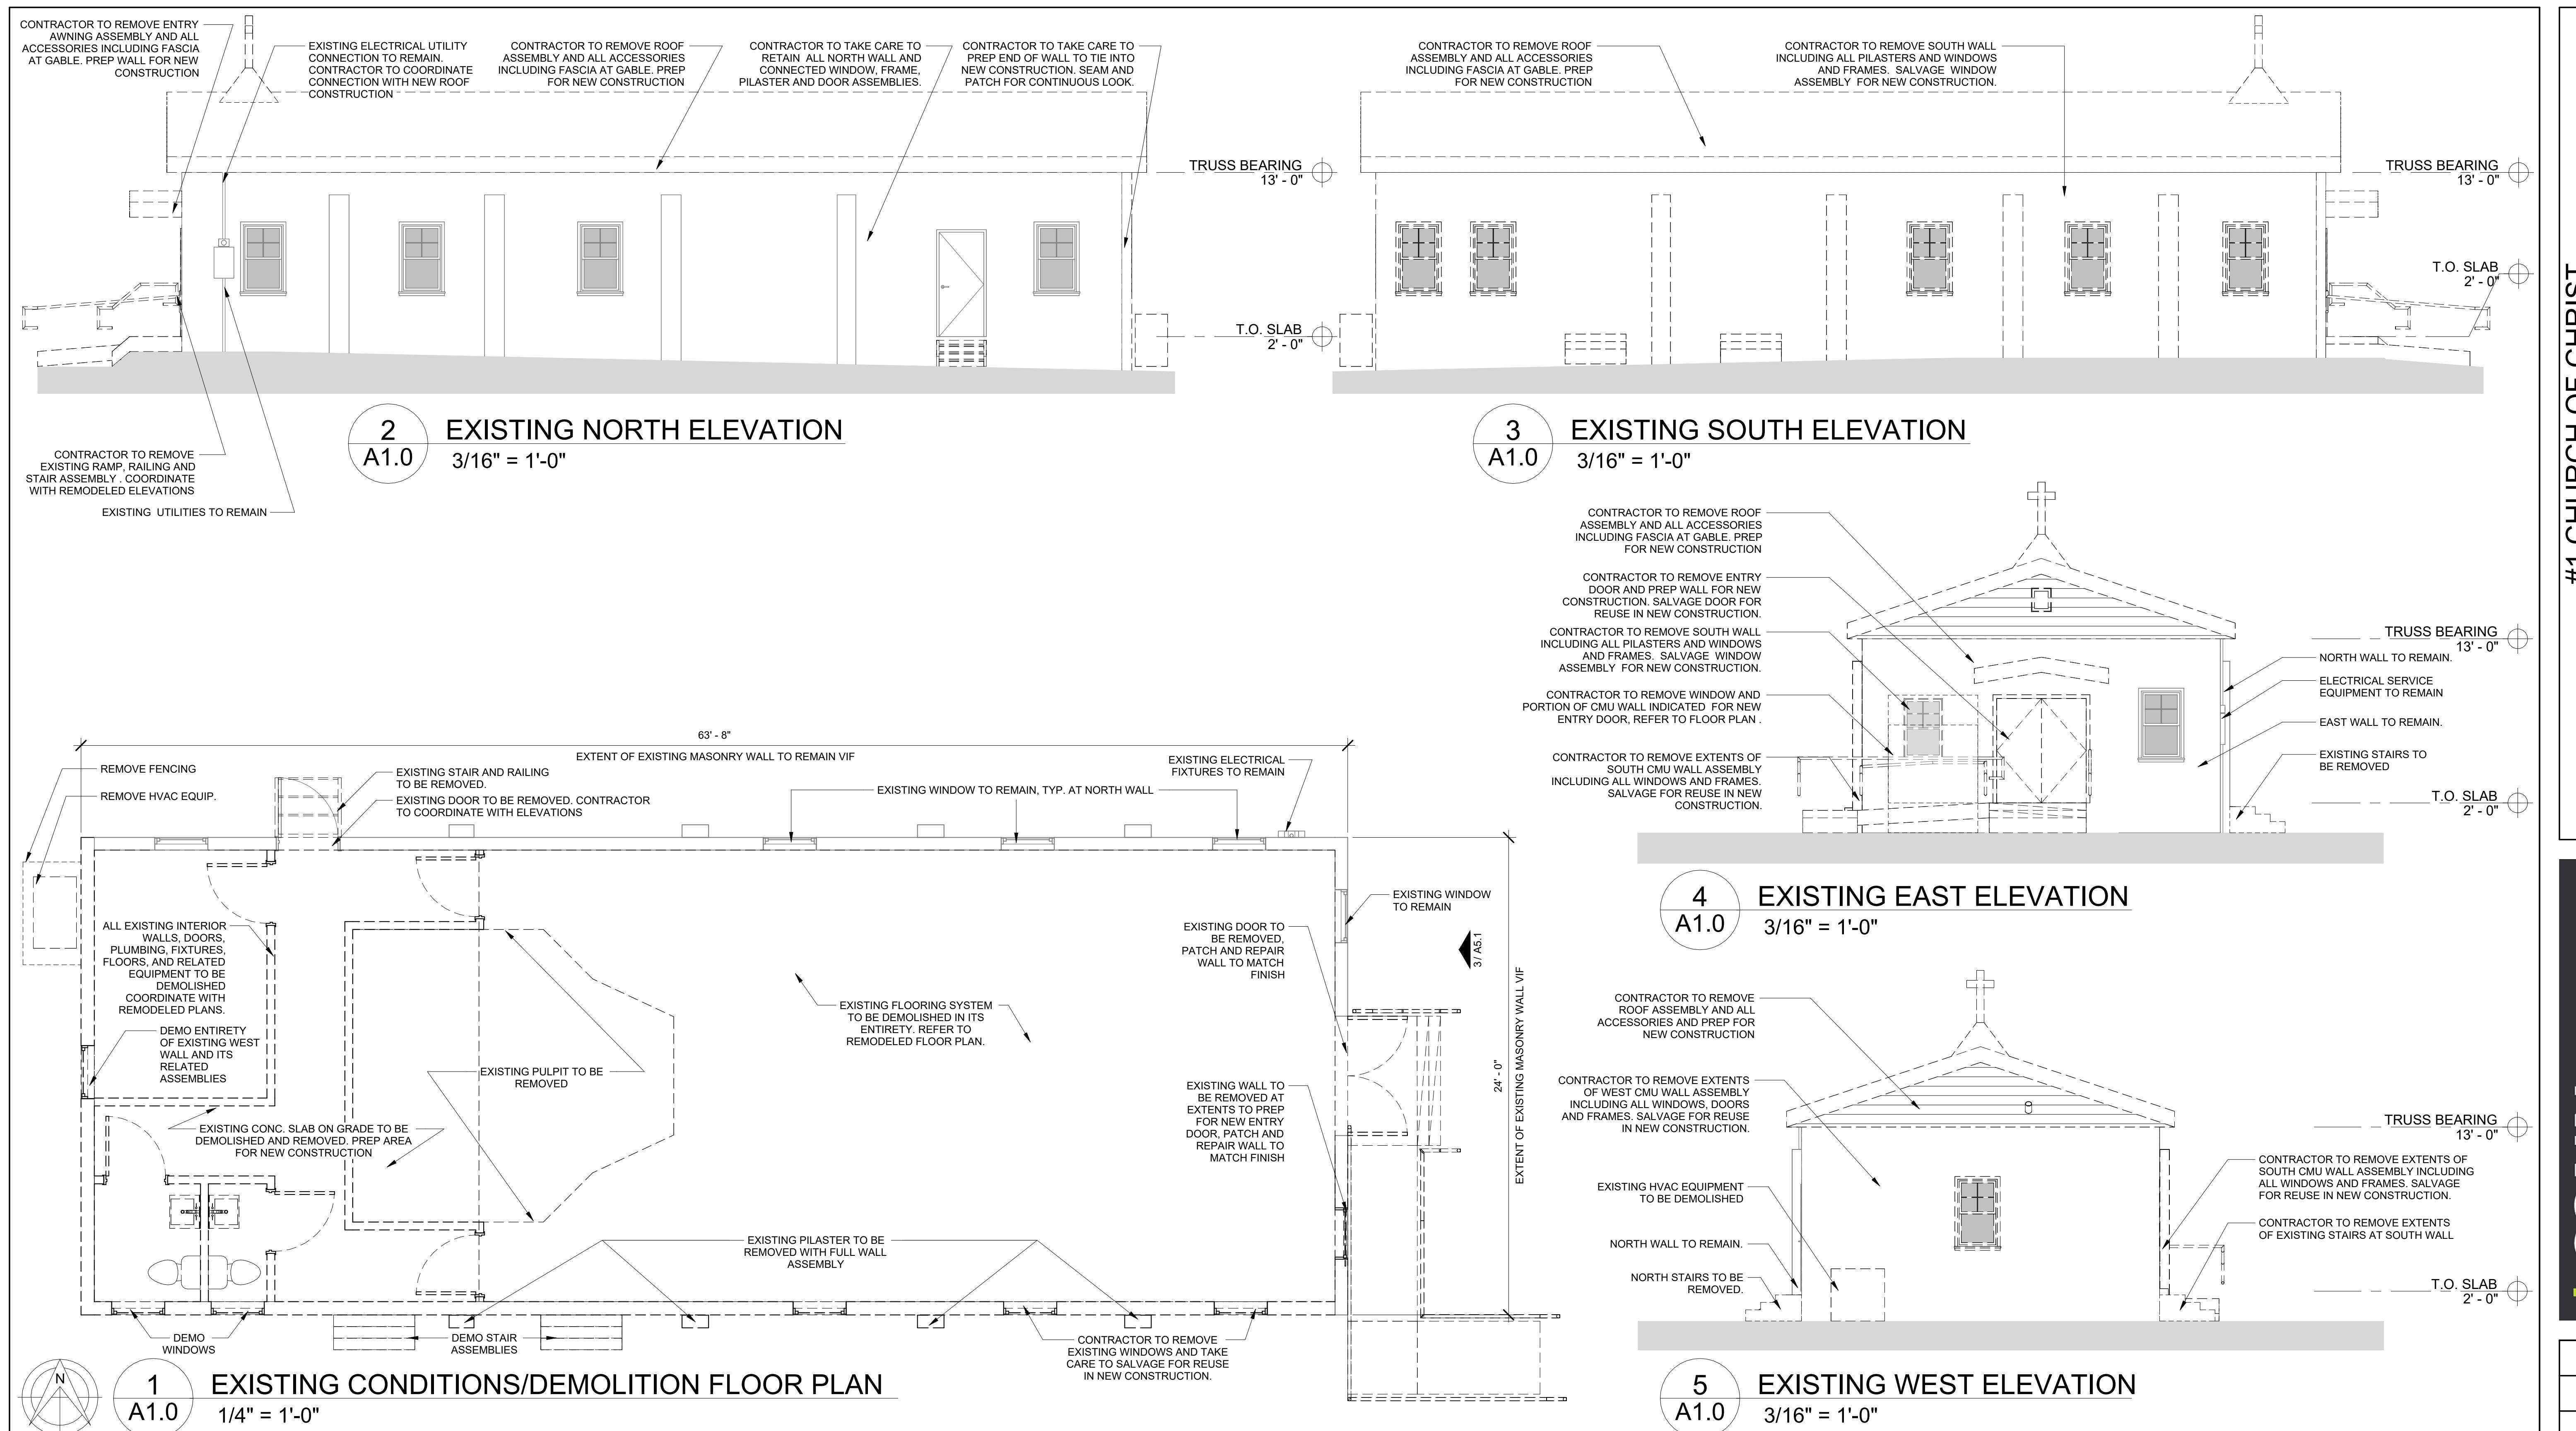

GENERAL NOTES	DEMOLITION NOTES	SYMBOLS LEGEND
<p><b>EXISTING CONDITIONS AS SHOWN ARE BASED ON FIELD MEASUREMENTS AND MAY VARY FROM ACTUAL FIELD CONDITIONS. ACTUAL FIELD CONDITIONS SHALL GOVERN.</b></p> <p><b>PRIOR TO BIDDING, ALL SUB-CONTRACTORS ARE RESPONSIBLE FOR FIELD VERIFYING EXISTING CONDITIONS TO DETERMINE THE SCOPE OF WORK NECESSARY TO ACHIEVE THE PROPOSED CONDITIONS AS SHOWN ON THE PLANS.</b></p> <p><b>CONTRACTOR(S) SHALL VERIFY ALL EXISTING CONDITIONS PRIOR TO COMMENCEMENT OF WORK. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.</b></p>	<p>NOTE - THE CONTRACTOR AND ALL SUBCONTRACTORS SHALL VERIFY ALL DIMENSIONS AND CONDITIONS AT THE SITE. AND NOTIFY THE ARCHITECT OF DISCREPANCIES.</p> <p>LIMITS OF ALTERATION WORK - ALTERATION WORK ZONE LIMITS ARE ESTABLISHED ON THE DRAWINGS. ALL ALTERATION WORK CONTRACTORS AND TRADES COORDINATE THEIR WORK WITH ONE ANOTHER WITHIN THE ESTABLISHED LIMITS.</p> <p>SEQUENCE OF ALTERATION WORK - IN THE EVENT THAT ANY SPECIAL SEQUENCING OF THE WORK IS REQUIRED BY OWNER, THE CONTRACTOR SHALL ARRANGE A CONFERENCE WITH THE OWNER FOR THE PURPOSE OF ESTABLISHING ANY SPECIAL SCHEDULING BEFORE ANY SUCH WORK IS BEGUN.</p> <p>PROTECTIONS: PROVIDE ANY SPECIAL BARRICADING AND MAINTAIN ANY REQUIRED LIGHTS AND DIRECTIONAL SIGNS AND OTHER PROTECTIONS NEAR AND ABOUT THE SITE OF ALTERATION AS MAY BE REQUIRED BY LOCAL AUTHORITIES HAVING JURISDICTION AND BY ANY OTHER NECESSARY MEANS PROTECT ANY SURROUNDING SITES, STRUCTURES, PROPERTIES, AND UTILITIES. MAINTAIN ALL SAFETY MEASURES UNTIL REMOVAL IS DIRECTED BY OWNER'S REPRESENTATIVE OF ARCHITECT. INDEFINITE UNDERGROUND UTILITIES OR OTHER SERVICES AS MAY BE UNCOVERED SHALL NOT BE DISTURBED BUT BROUGHT TO THE ARCHITECT'S ATTENTION FOR DIRECTION AS TO HOW TO PROCEED.</p> <p>TEMPORARY SHORING - PROVIDE ANY TEMPORARY SHORING, CRIBBING OR UNDERPINNING AS MAY BE REQUIRED OR DIRECTED BY THE ARCHITECT AT ANY TIME AND IN ANY PORTION OF THE ALTERATION WORK FOR THE DURATION OF SUCH WORK.</p> <p>GENERAL CUTTING AND PATCHING - PERFORM ANY AND ALL CUTTING AND PATCHING AND GENERAL RESTORING AS MAY BE OCCASIONED BY THE ALTERATION WORK.</p> <p>SPECIAL PERMITS - SECURE ANY AND ALL PERMITS TO DEMOLISH AND RENOVATE AS MAY BE REQUIRED BY LOCAL AUTHORITIES HAVING JURISDICTION OVER SUCH WORK.</p> <p>DISCONNECT AND SEAL ANY UTILITIES SERVING STRUCTURES TO BE DEMOLISHED.</p>	<p>1. SEE WALLS SECTIONS AND BUILDING SECTIONS AS PER TAG IDENTIFIED LOCATIONS FOR BUILDING MATERIAL INFORMATION.</p>  <p>2. SEE FINISH SCHEDULE AND INTERIOR ELEVATIONS FOR FINISHES AND FINISH REQUIREMENT.</p>  <p>3. SEE ENLARGED PLAN AS PER TAG IDENTIFIED LOCATIONS FOR BUILDING PLAN INFORMATION.</p>  <p>4. SEE DOOR SCHEDULE FOR ALL DOOR RELATED INFORMATION.</p>  <p>5. SEE WINDOW INFORMATION AND ELEVATIONS FOR ALL WINDOW RELATED INFORMATION.</p>  <p>6. SEE WALL TYPE LEGEND FOR WALL ASSEMBLY INFORMATION AS PER TAG IDENTIFIED LOCATIONS.</p> 

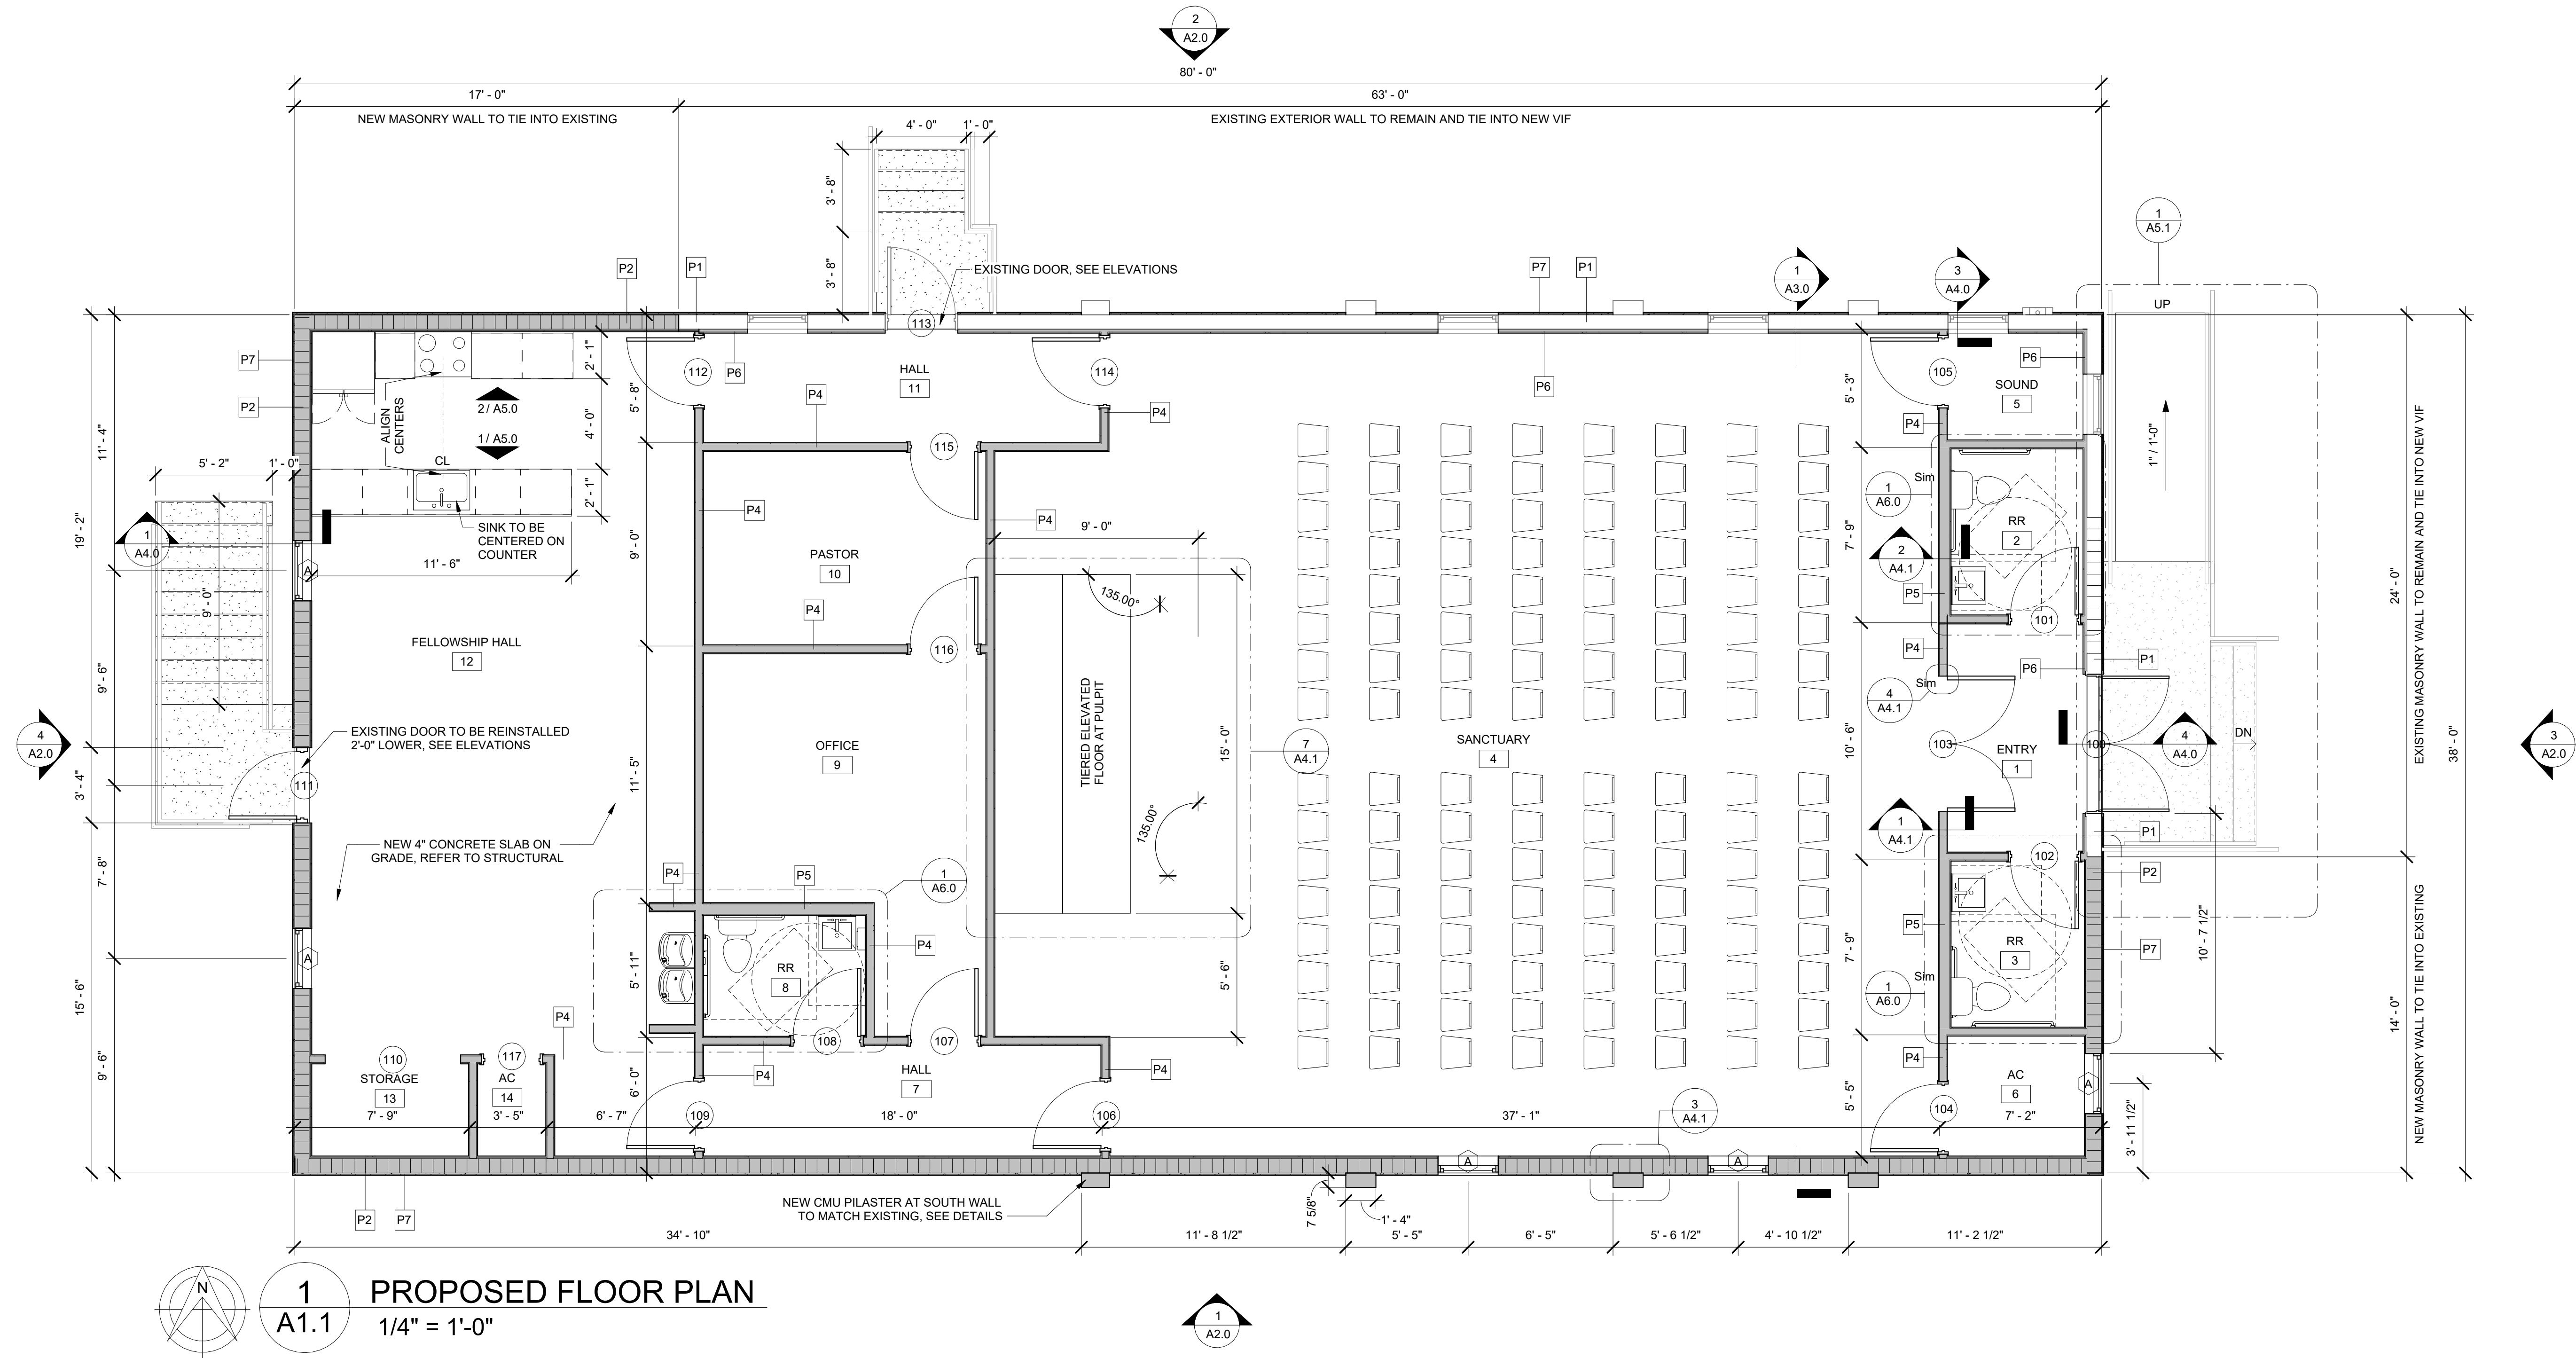

## GENERAL NOTES

1. ALL CONSTRUCTION SHALL BE AS PER CODES STATED ON THE COVER SHEET.
2. ALL DIMENSIONS ARE TO FACE OF STUD UNLESS INDICATED OTHERWISE.
3. THE ELEVATION OF FLOOR SURFACES ON BOTH SIDES OF ALL DOORS SHALL NOT VARY MORE THAN 1/2". THE ELEVATION SHALL BE MAINTAINED ON BOTH SIDES OF A DOORWAY FOR A DISTANCE AT LEAST EQUAL TO THE WIDEST LEAF.
4. ALL EQUIPMENT TO BE INSTALLED AS PER THE MANUFACTURER'S WRITTEN INSTRUCTIONS. CONTRACTOR SHALL INSTALL BLOCKING IN WALL AS REQUIRED TO SUPPORT EQUIPMENT BEING MOUNTED ON WALLS.
5. REFER TO MECHANICAL DRAWINGS FOR ALL MECHANICAL INFORMATION.
6. REFER TO PLUMBING DRAWINGS FOR ALL PLUMBING INFORMATION.
7. REFER TO ELECTRICAL DRAWINGS FOR ALL ELECTRICAL INFORMATION.
8. ALL EGRESS DOORS TO MAINTAIN MINIMUM 18" AT PULL SIDE.

## WALL LEGEND

SHEET.		P1	8" x 8" x 16" CMU. EXTERIOR FINISH PER WALL SECTIONS AND ELEVATIONS.
SE.		P2	NEW WALL- 8" x 8" x 16" CMU W/5/8" GYP ON 1X FURRING STRIPS ON INTERIOR SIDE. EXTERIOR FINISH PER WALL SECTIONS AND ELEVATIONS TO MATCH EXISTING WALL.
SHALL NOT H SIDES OF		P3	NEW FRAMED WALL - 2X6 PT WOOD STUDS AT 16" O.C. SHEATHING PER STRUCTURAL AND FIBER CEMENT LAP SIDING ON BOTH SIDES.
TTEN EQUIRED		P4	NEW FRAMED WALL - 2X4 WOOD STUDS AT 16" O.C. WITH G.W.B. ON BOTH SIDES. SEE SECTIONS AND WALL DETAILS.
ON.		P5	NEW FRAMED WALL - 2X6 WOOD STUDS AT 16" O.C. WITH G.W.B. ON BOTH SIDES. SEE SECTIONS AND WALL DETAILS.
N.		P6	NEW FRAMED WALL - 2X4 PT WOOD STUDS AT 24" O.C. 5/8" G.W.B. 1 SIDE. SEE SECTIONS AND WALL DETAILS.
		P7	NEW THIN BRICK VENEER APPLIED WITH MORTAR AND LATHE PER MANUFACTURER'S SPECIFICATIONS

## SYMBOLS LEGEND


1. SEE WALL SECTIONS AND BUILDING SECTIONS PER TAG IDENTIFIED LOCATIONS FOR BUILDING MATERIAL INFORMATION.
2. SEE FINISH SCHEDULE AND INTERIOR ELEVATIONS FOR FINISHES AND FINISH REQUIREMENT.
3. SEE ENLARGED PLAN AS PER TAG IDENTIFIED LOCATIONS FOR BUILDING PLAN INFORMATION.
4. SEE DOOR SCHEDULE FOR ALL DOOR RELATED INFORMATION.
5. SEE WINDOW INFORMATION AND ELEVATIONS FOR ALL WINDOW RELATED INFORMATION.
6. SEE WALL TYPE LEGEND FOR WALL ASSEMBLY INFORMATION AS PER TAG IDENTIFIED LOCATIONS.

01/26/2026


---

20-194

## A1.1



1  
A1.2 PROPOSED REFLECTED CEILING PLAN  
1/4" = 1'-0"

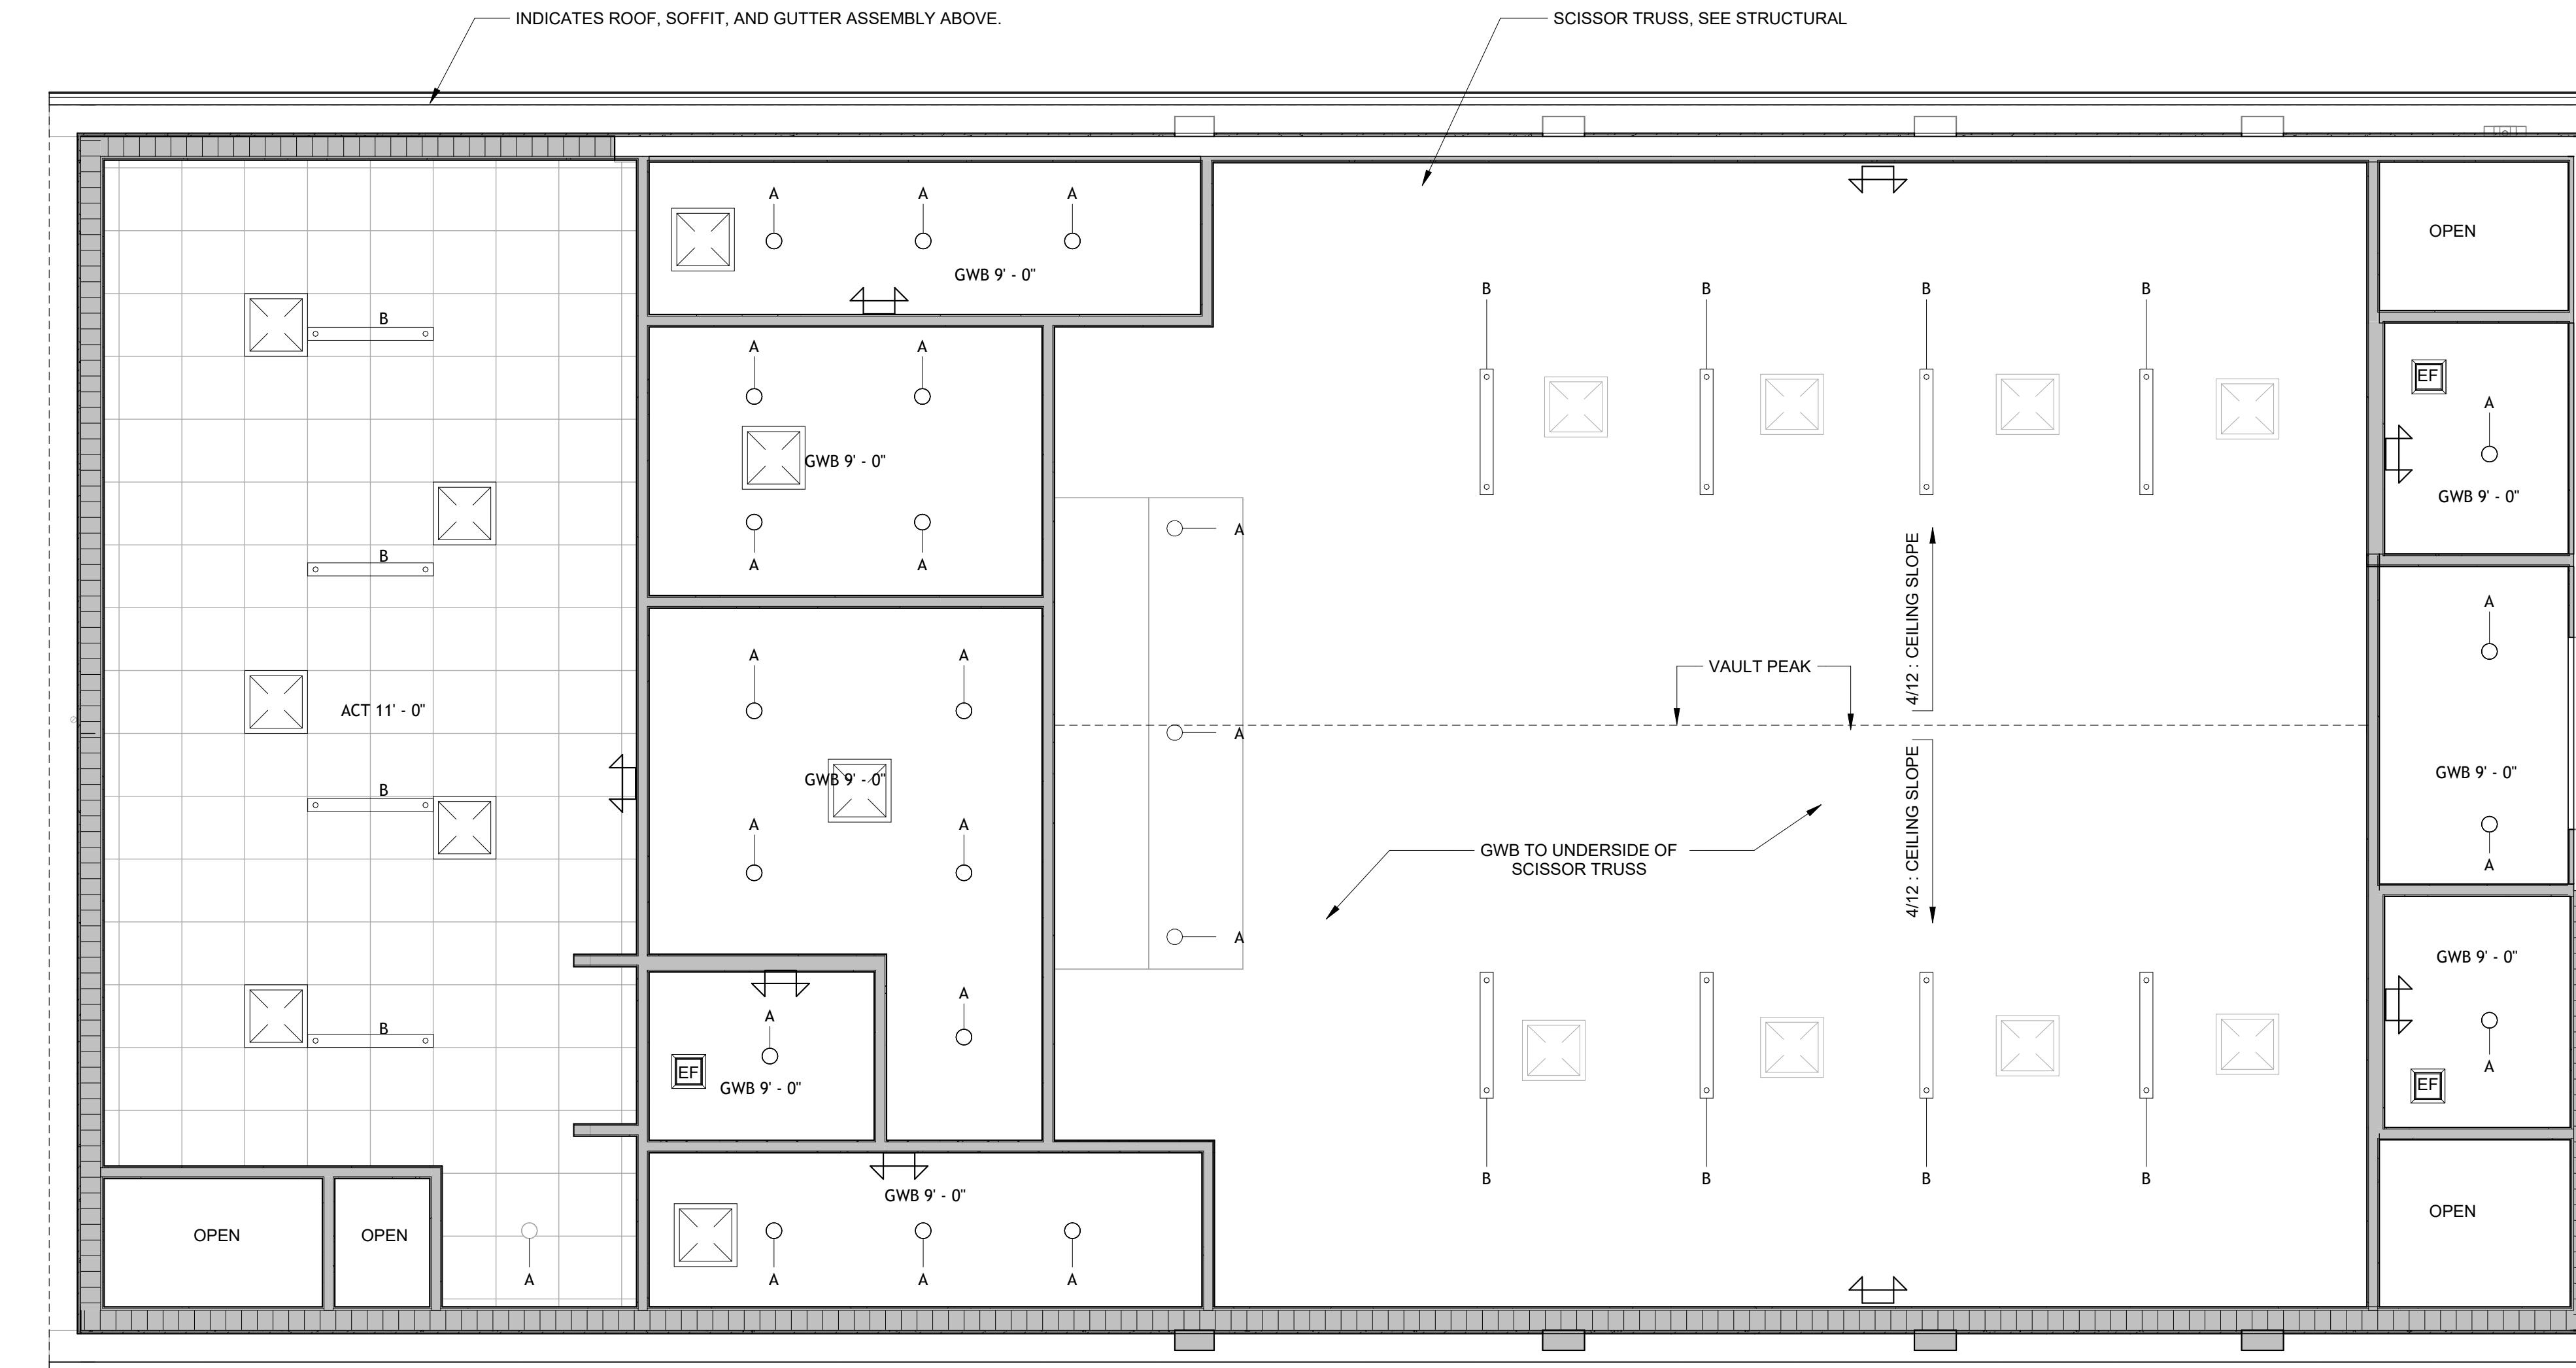

#### GENERAL NOTES

- ALL CONSTRUCTION SHALL BE AS PER CODES STATED ON THE COVER SHEET.
- ALL DIMENSIONS ARE TO FACE OF STUD UNLESS INDICATED OTHERWISE.
- THE ELEVATION OF FLOOR SURFACES ON BOTH SIDES OF ALL DOORS SHALL NOT VARY MORE THAN 1/2". THE ELEVATION SHALL BE MAINTAINED ON BOTH SIDES OF A DOORWAY FOR A DISTANCE AT LEAST EQUAL TO THE WIDEST LEAF.
- ALL EQUIPMENT TO BE INSTALLED AS PER THE MANUFACTURER'S WRITTEN INSTRUCTIONS. CONTRACTOR SHALL INSTALL BLOCKING IN WALL AS REQUIRED TO SUPPORT EQUIPMENT BEING MOUNTED ON WALLS.
- REFER TO MECHANICAL DRAWINGS FOR ALL MECHANICAL INFORMATION.
- REFER TO PLUMBING DRAWINGS FOR ALL PLUMBING INFORMATION.
- REFER TO ELECTRICAL DRAWINGS FOR ALL ELECTRICAL INFORMATION.
- ALL EGRESS DOORS TO MAINTAIN MINIMUM 18" AT PULL SIDE.

#### CEILING PLAN LEGEND

○	A. RECESSED CAN FIXTURE
—○—	B. SUSPENDED LINEAR PENDANT LED FIXTURE
—○—	C. EXTERIOR WALL SCONCE
□	EF. EXHAUST FAN
△	EMERGENCY LIGHTING
□	EXIT SIGN
□	EXIT SIGN
□	SUPPLY DIFFUSER
□	RETURN DIFFUSER

01/26/2026
ALG
20-194
A1.2


#1 CHURCH OF CHRIST  
1802 PASCO STREET TALLAHASSEE, FL 32301

**CONN + ARCHITECTS**


1950-C Crawford Boulevard | Tallahassee, Florida 32308

www.CONNarchitects.com | Lic. No. AA-C01662

PROPOSED REFLECTED CEILING PLAN



1  
A1.3 ROOF PLAN  
1/4" = 1'-0"

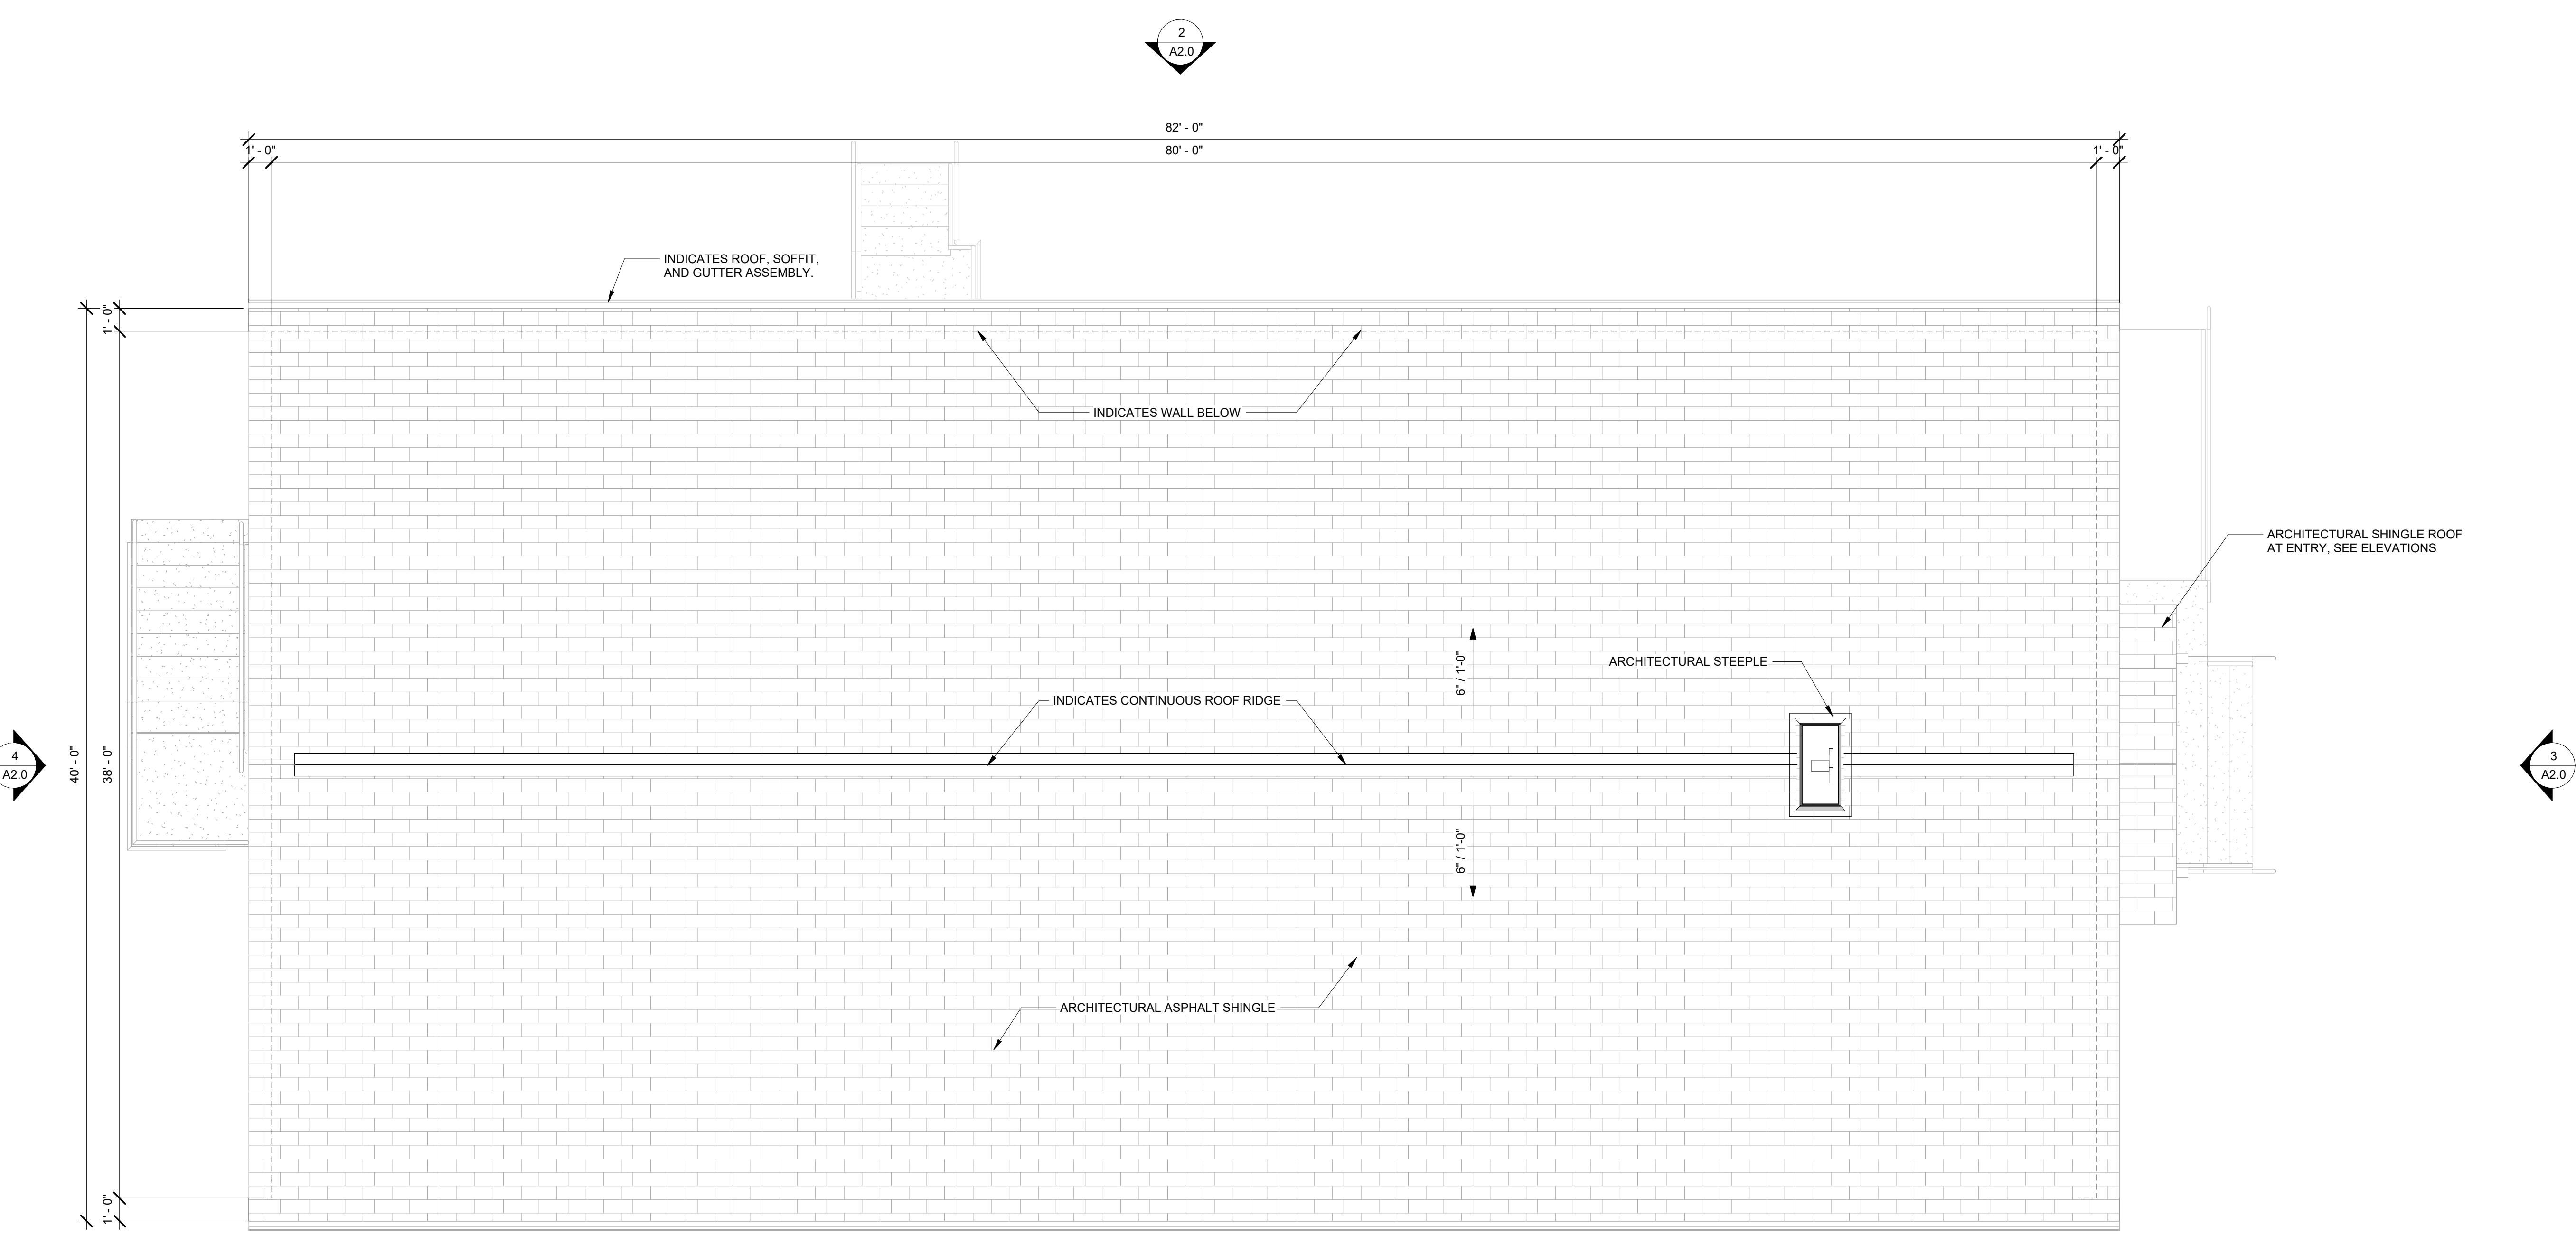

#### GENERAL ROOF NOTES

1. DIMENSIONS NOTED ON ROOF PLANS ARE MEASURED HORIZONTALLY, NOT ALONG SLOPE OF ROOF. COORDINATE DIMENSIONS WITH FLOOR PLAN.
2. COORDINATE EXHAUST FAN AND VTR QUANTITY AND LOCATIONS WITH MECHANICAL AND PLUMBING DRAWINGS.
3. ROOF PENETRATIONS SHALL BE TIED AS ALLOWABLE BY CODE TO REDUCE THE NUMBER OF PENETRATIONS, VTR, AND EXHAUST PENETRATIONS SHALL BE A MINIMUM OF 4'-0" FROM EDGE OF ROOF (TYP.)
4. PROVIDE AND MAINTAIN A WARRANTY AGAINST DEFECTS IN MATERIAL AND WORKMANSHIP INCLUDING WEATHER-TIGHTNESS. THE WEATHER TIGHTNESS WARRANTY SHALL INCLUDE ROOF, RIDGE FLASHING, ETC. MEETING THE WIND DESIGN SPEED FOR THE PROJECT LOCATION.
5. PROVIDE ALL COMPONENTS FOR A COMPLETE ROOF SYSTEM AND FLASHING SYSTEM, EVEN IF NOT SPECIFICALLY NOTED TO PROVIDE COMPLETE WATER-TIGHTNESS CONDITION.
6. A SEPARATE ROOFING PERMIT SHALL BE REQUIRED PRIOR TO ANY ROOF COVERING MATERIAL BEING INSTALLED.
7. BASIC WIND SPEED PER FBC: 120 MPH (3-SECOND GUST) PER ASCE-7.
8. COORDINATE WITH STRUCTURAL / WIND LOAD ANALYSIS.
9. IF APPLICABLE, SIZE AND INSTALL GUTTERS AND DOWNSPOUTS PER SMACNA GUIDELINES. LOCATE DOWNSPOUTS AS INDICATED IN DRAWINGS AND NOTIFY ARCHITECT IF ANY CONFLICTS OCCUR.
10. VERIFY ALL DIMENSIONED WITH FINAL TRUSS DRAWINGS.
11. CONTRACTOR TO LOCATE ALL ROOF PENETRATIONS OF MAIN ROOF.

#### ROOF VENT CALCULATIONS

REQUIRED NET FREE AREA (1/300) (PER FBC-B 1203.2)

MAIN STRUCTURE VENTING

REQUIRED VENTING: 3040/300 = 10.10 SF  
UPPER VENTS (50%): 5.05 SF  
EAVE VENTS (50%): 5.05 SF

PROVIDED:


UPPER: 74" @ 18 SqIn = 1332/144 = 9.25 SF > 5.05 SF  
EAVE: (2 x 78") @ 9 SqIn = 1404/144 = 9.75 SF > 5.05 SF

NOTE:  
RIDGE VENT IS 18 SQ. IN. OF NET FREE VENTILATION AREA PER FOOT. EAVE VENT IS 9 SQ. IN. OF NET FREE VENTILATION AREA PER FOOT. CONFIRM NET FREE AREAS WITH ACTUAL PRODUCTS USED AND ADJUST QUANTITY / LENGTHS AS REQUIRED TO MEET MINIMUM VENTILATION REQUIREMENTS.

01/26/2026	ALG
20-194	
	A1.3

#1 CHURCH OF CHRIST  
1802 PASCO STREET TALLAHASSEE, FL 32301

EXTERIOR ELEVATIONS

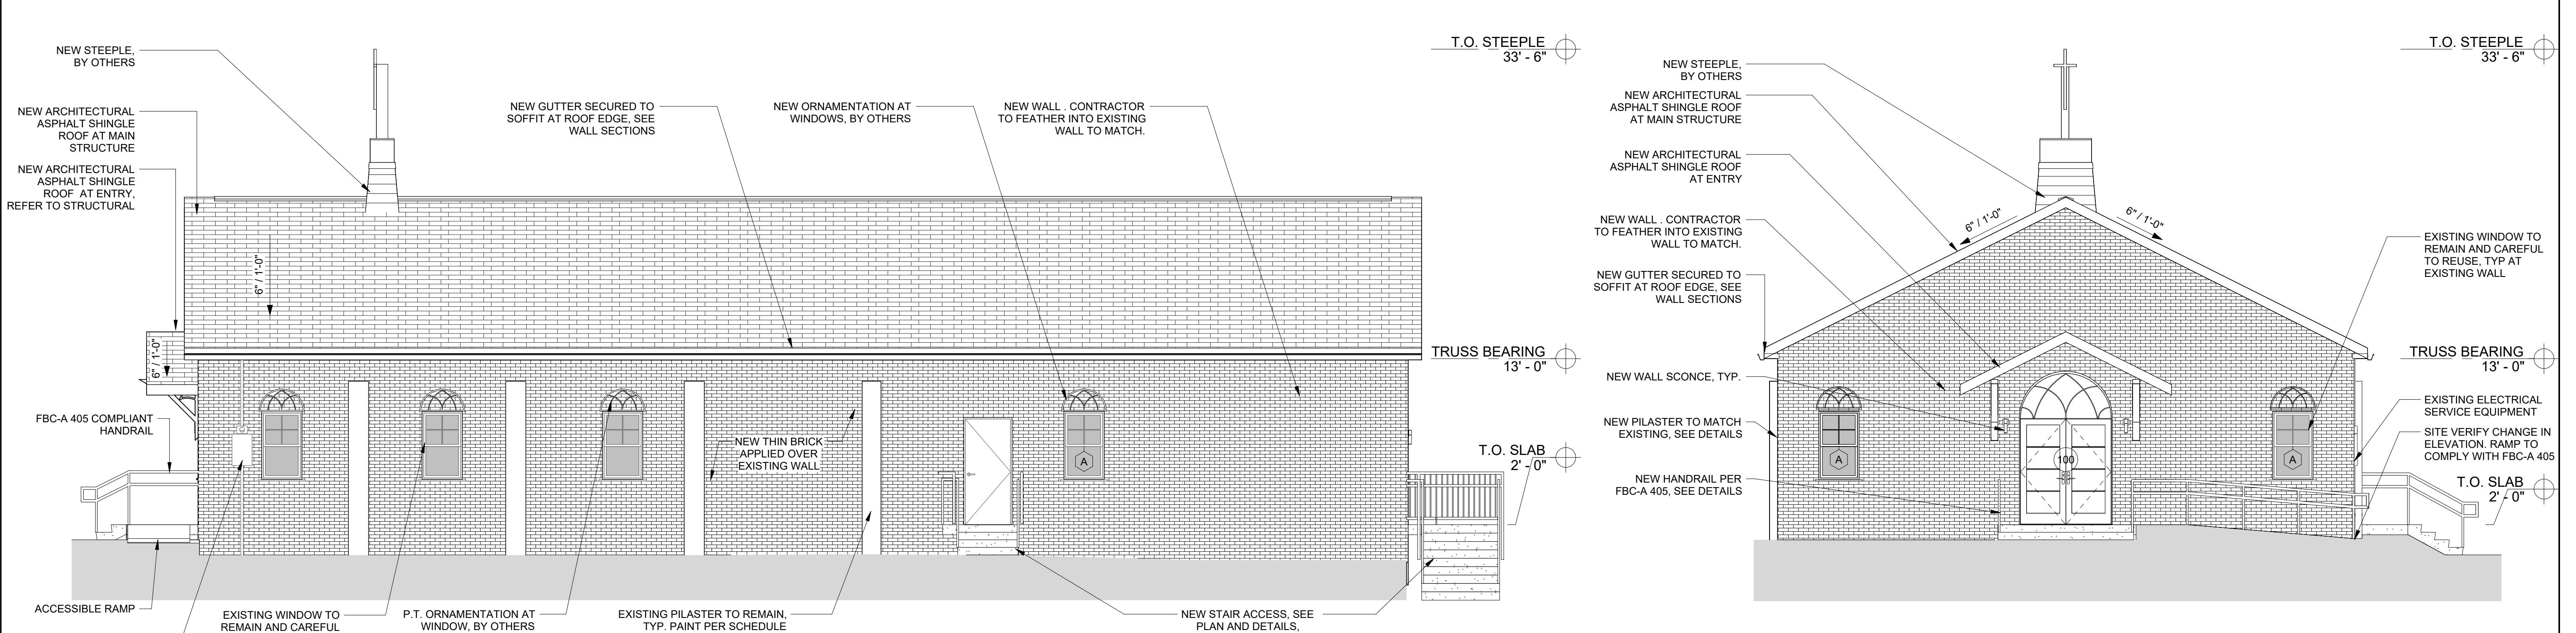

**CONN + ARCHITECTS**


1960-C Crawford Boulevard | Tallahassee, Florida 32308  
www.CONNarchitects.com | Lic. No. AA C01662


01/26/2026

ALG

20-194

A2.0

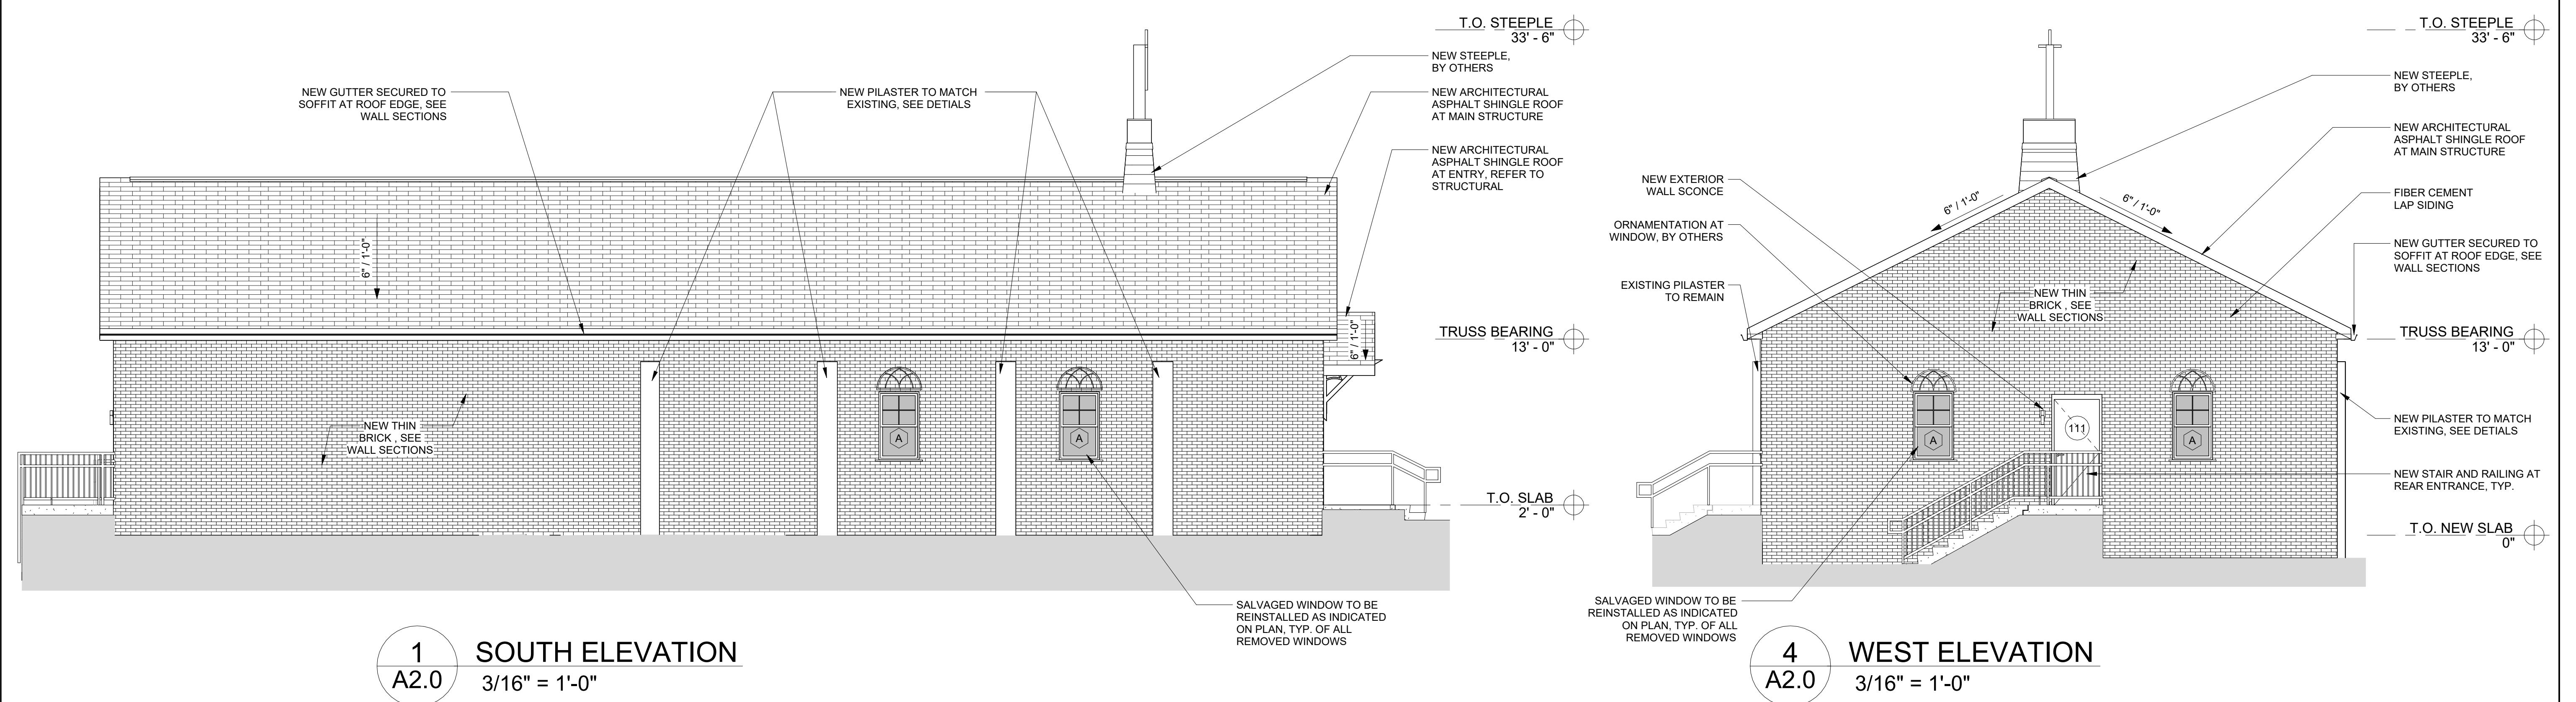

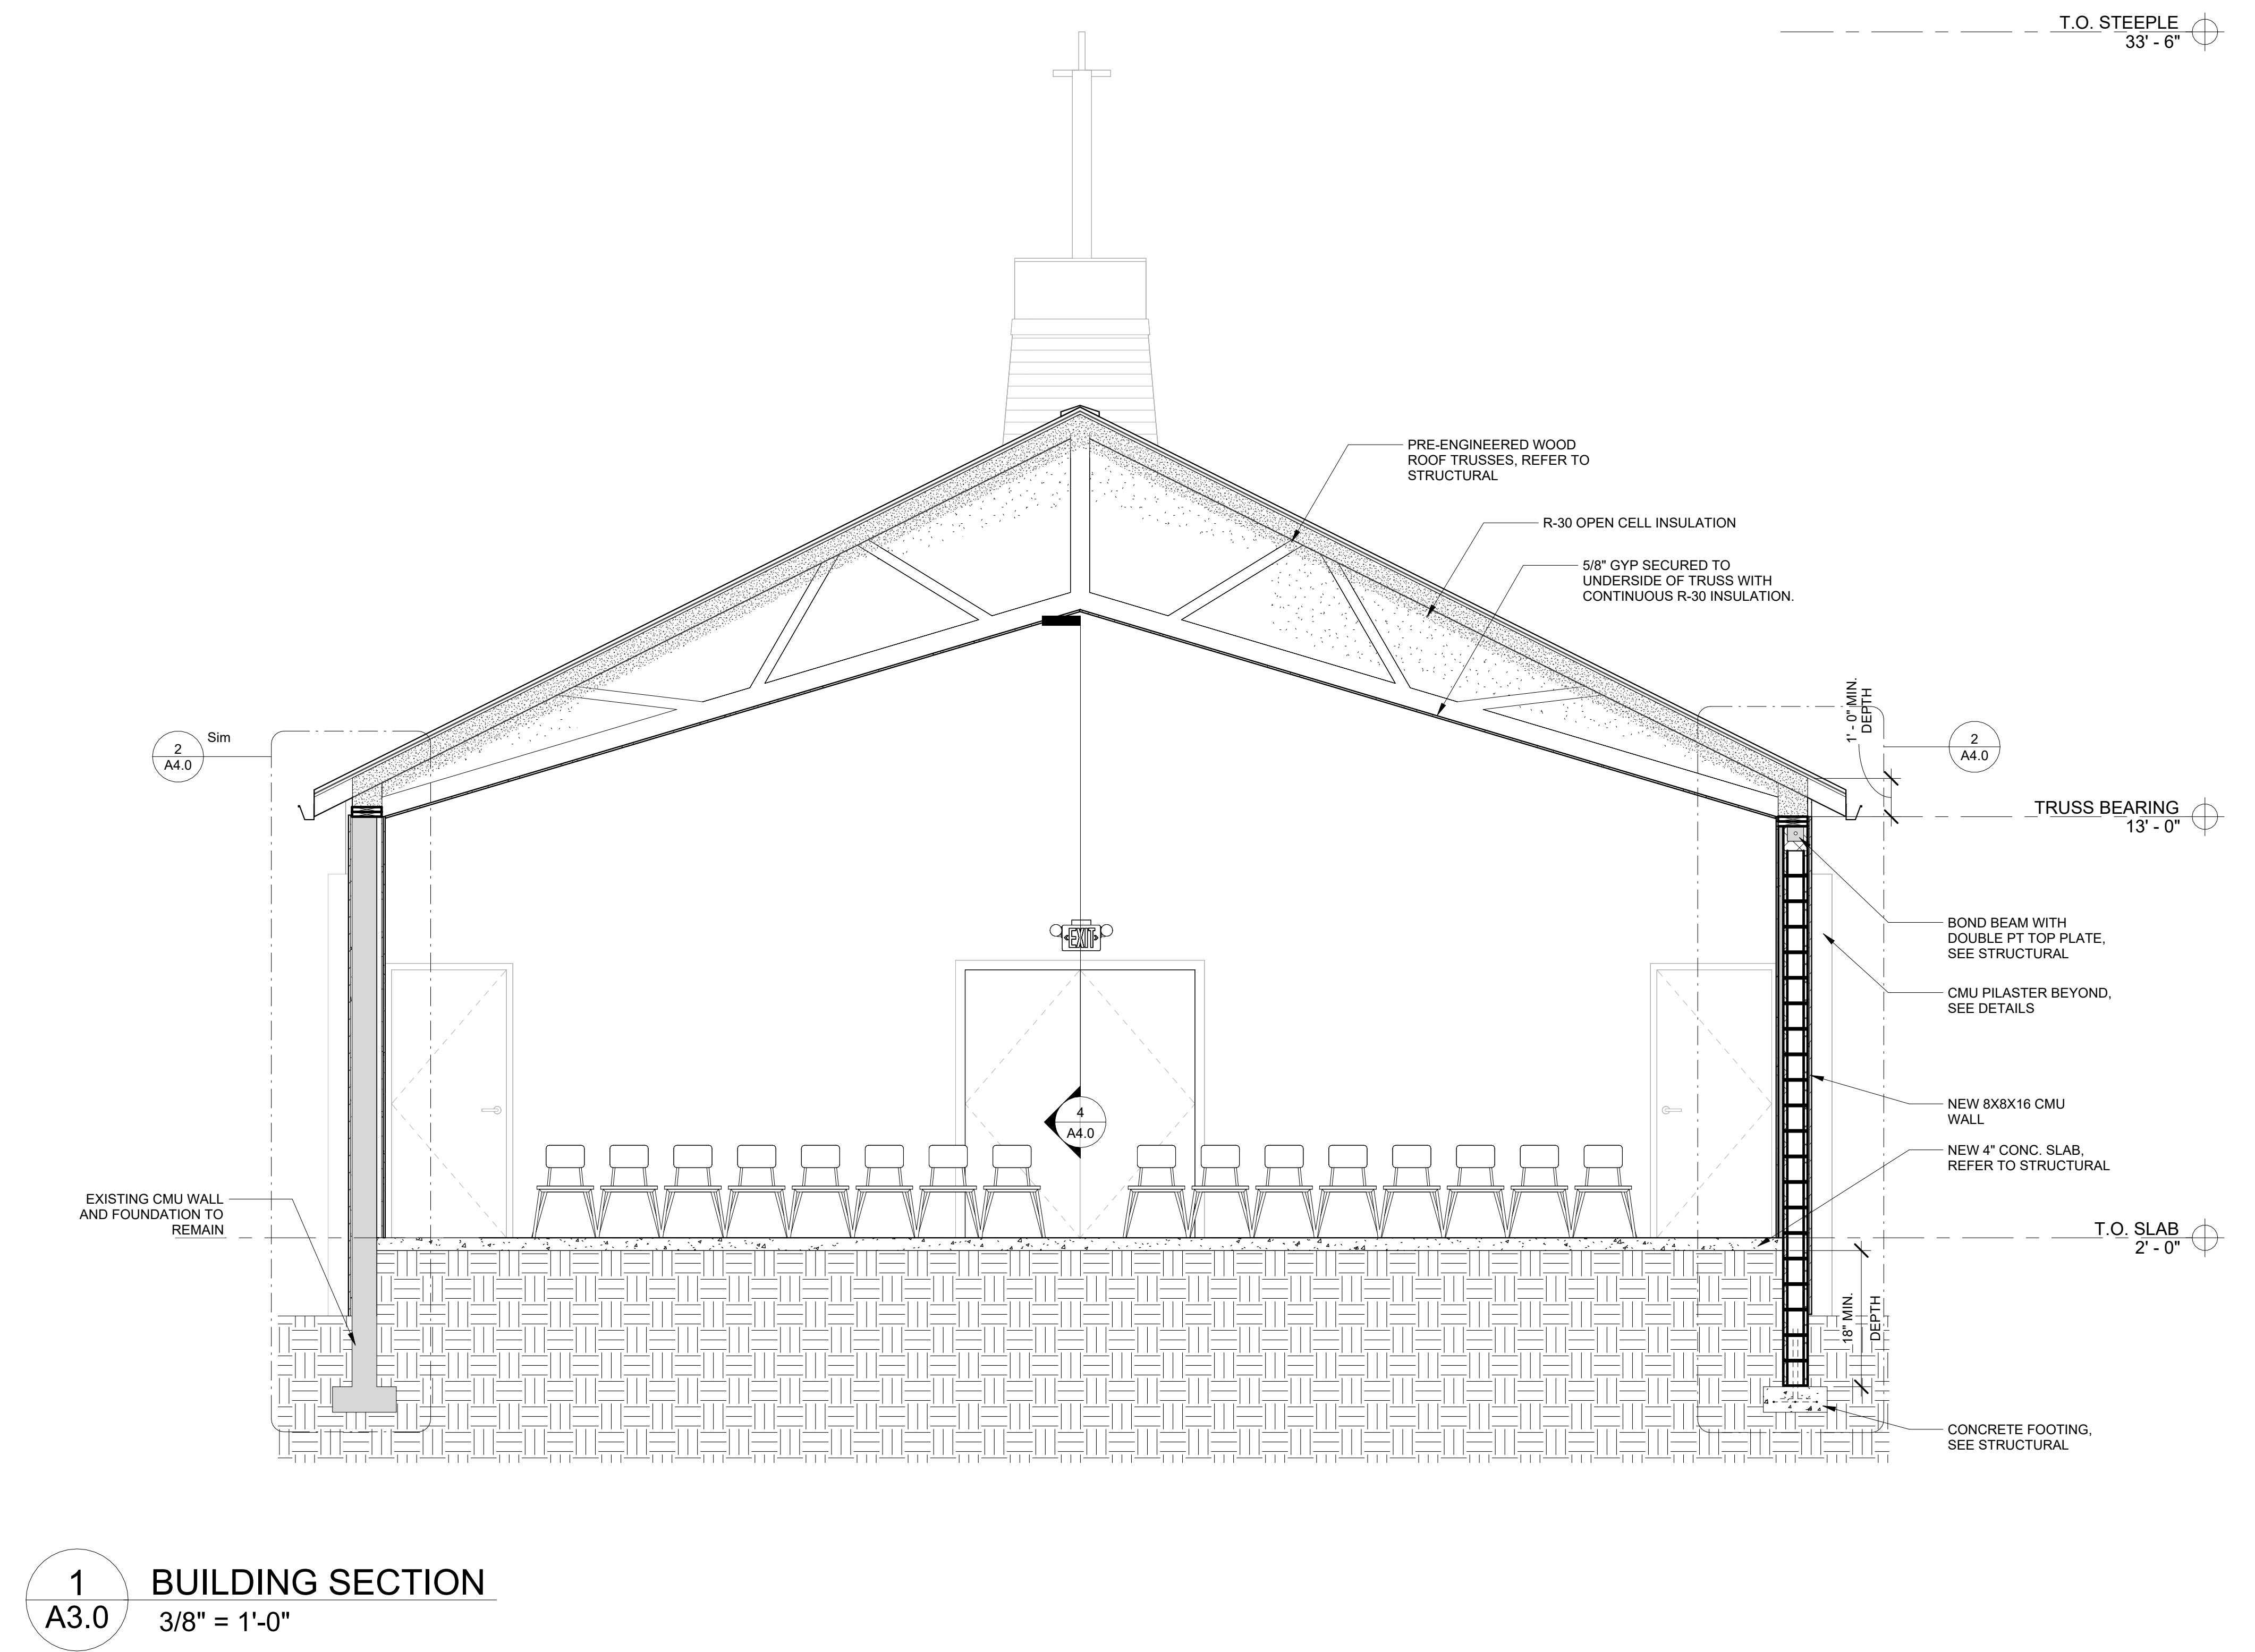

#1 CHURCH OF CHRIST  
1802 PASCO STREET TALLAHASSEE, FL 32301

BUILDING SECTIONS





**CONN + ARCHITECTS**


1950-C Crawford Boulevard | Tallahassee, Florida 32308

www.CONNarchitects.com | Lic. No. AA C01662


01/26/2026	ALG
20-194	
	A3.0

01/26/2026
ALG
20-194
A4.0

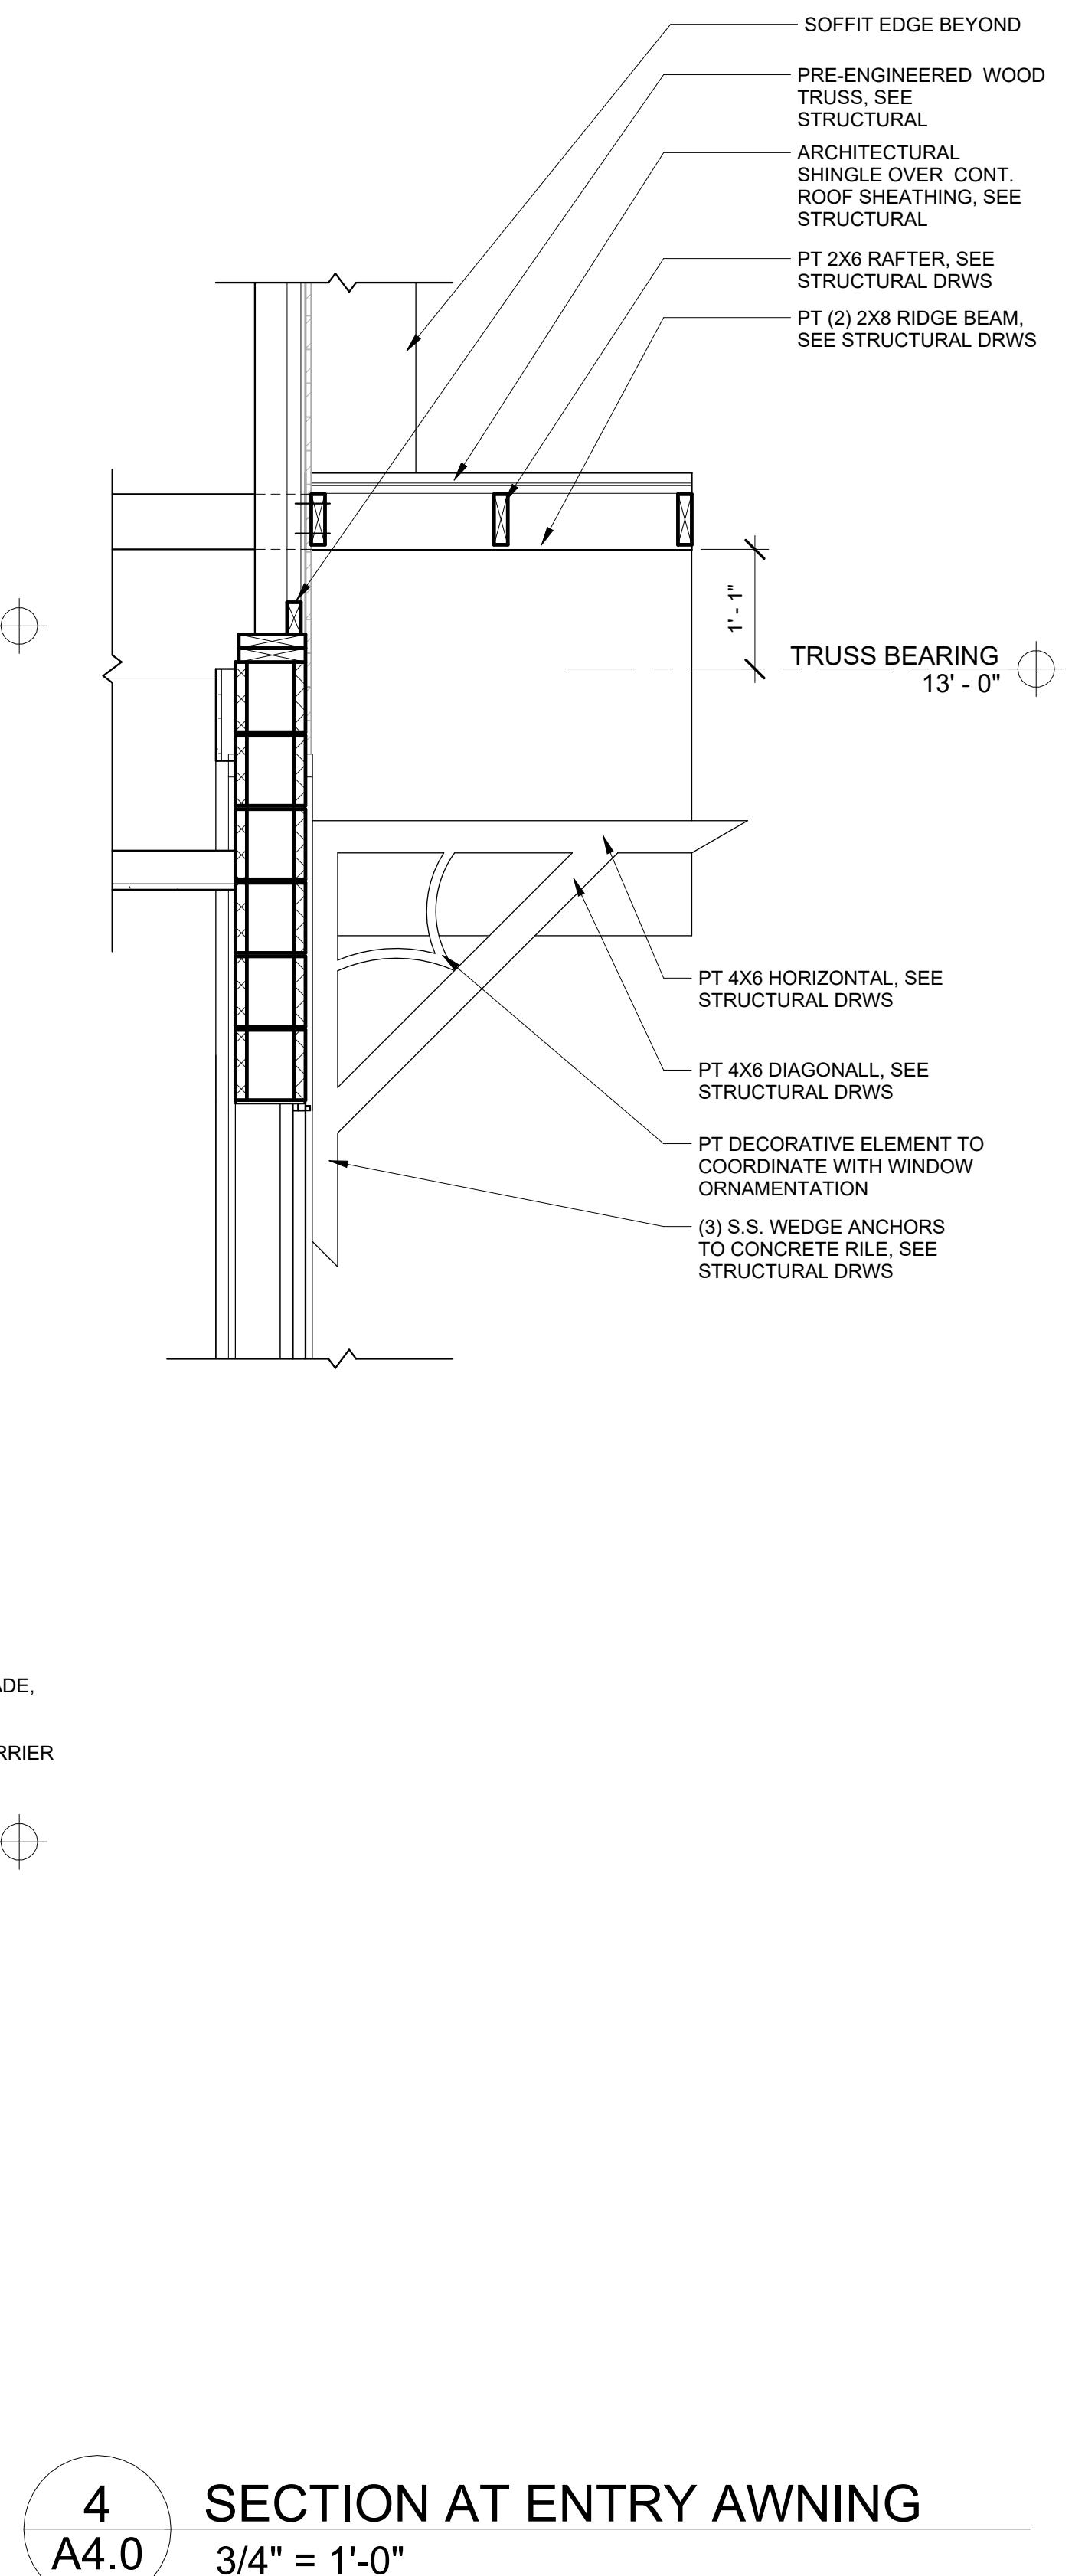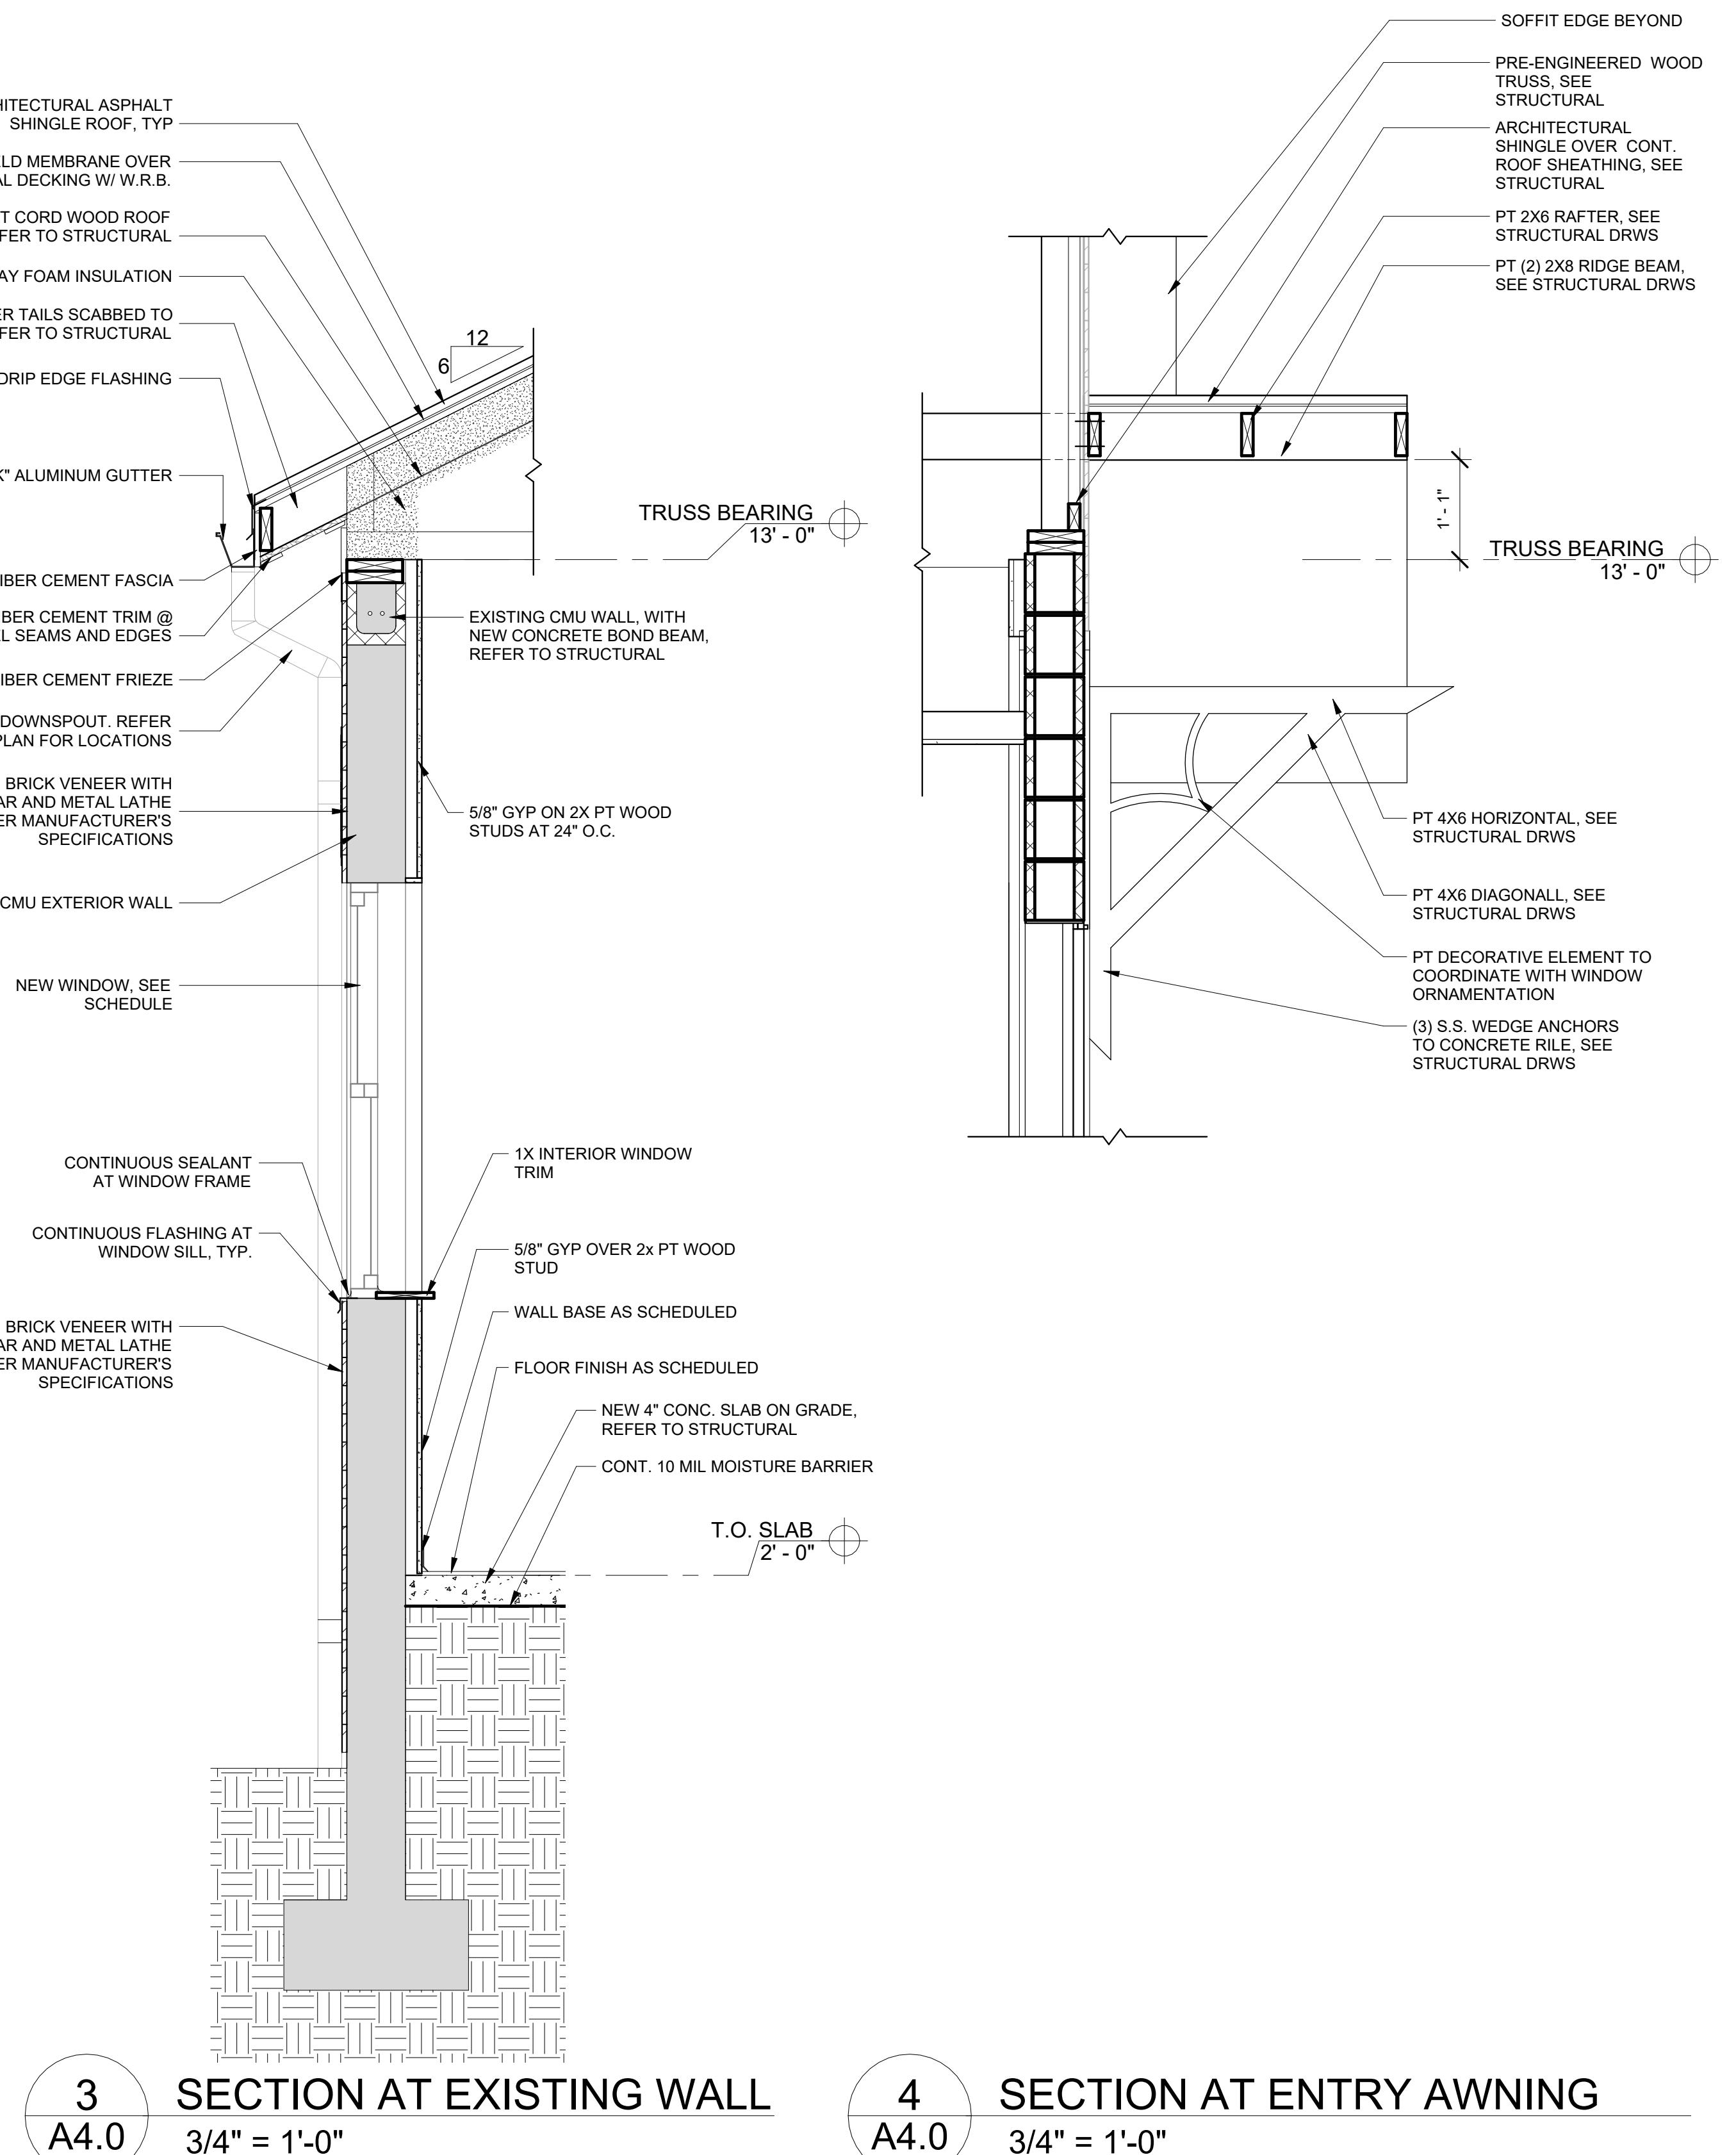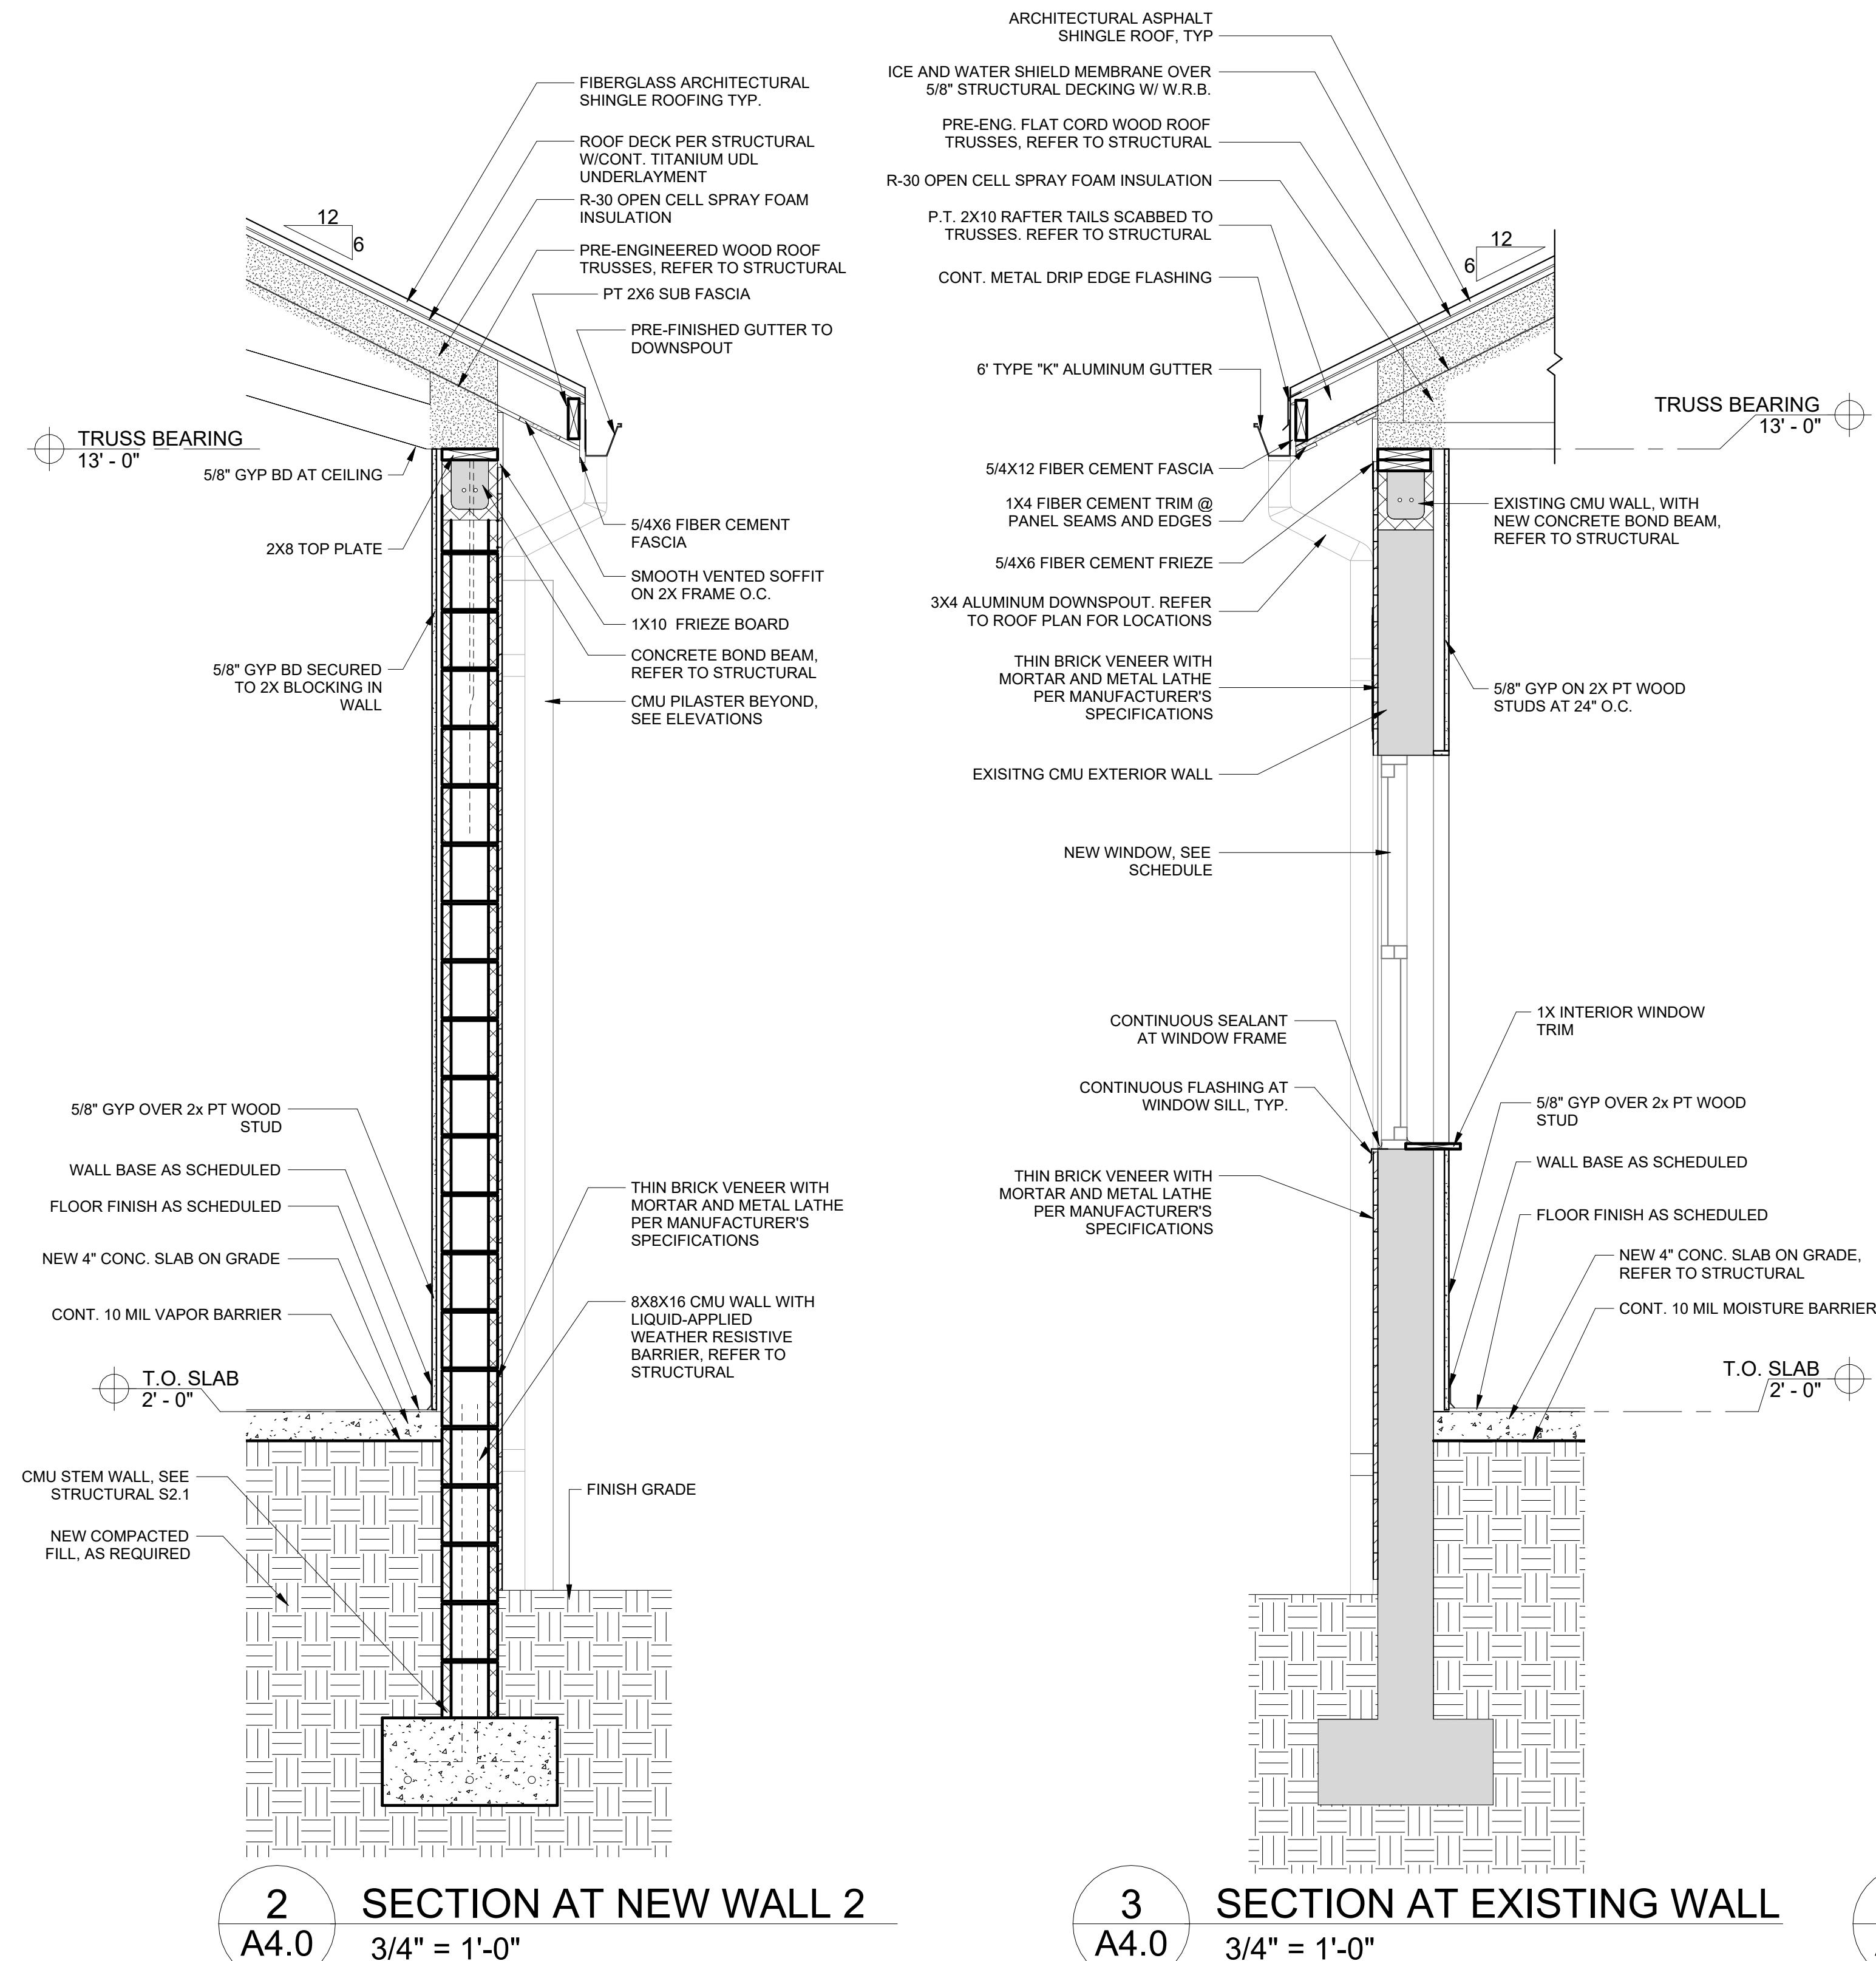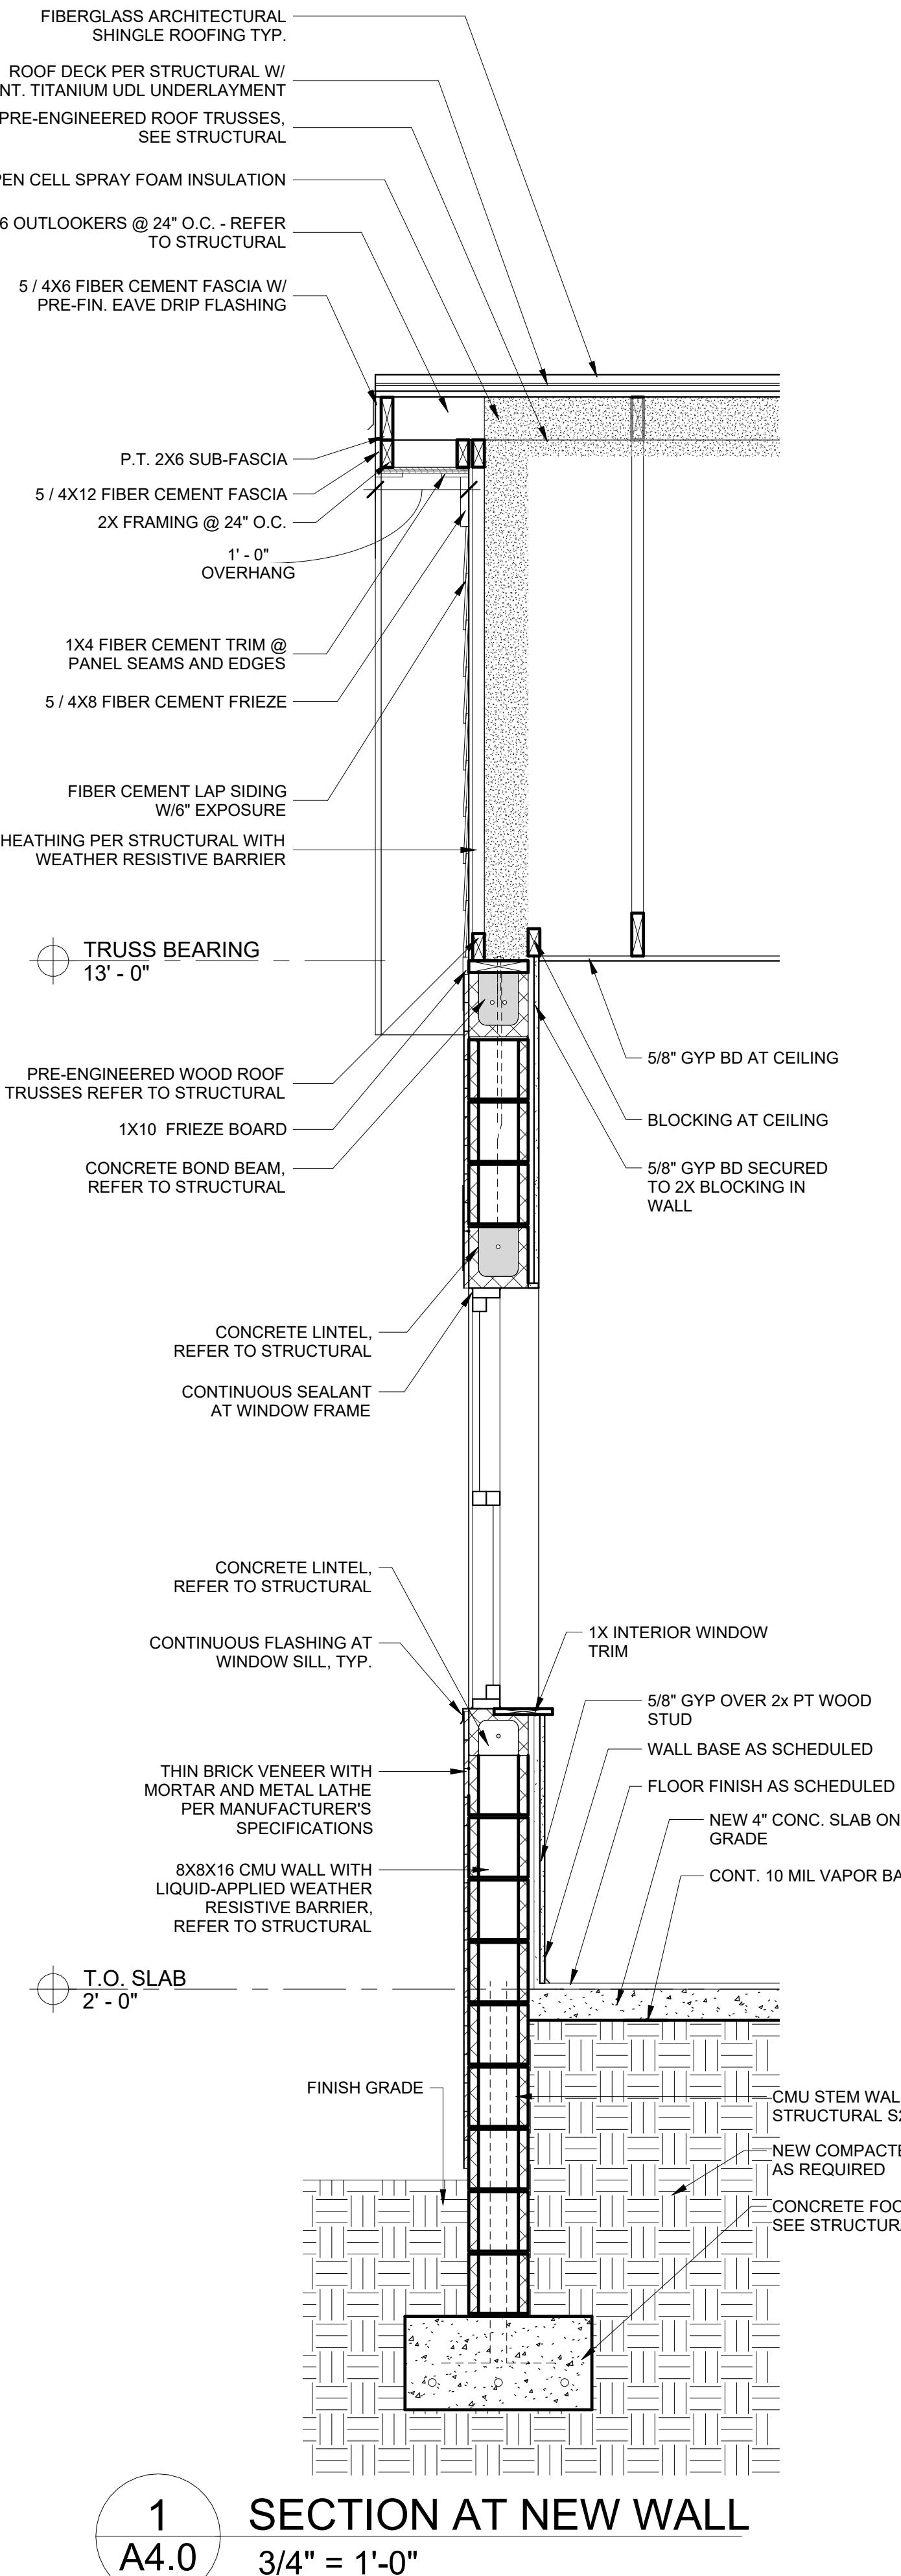


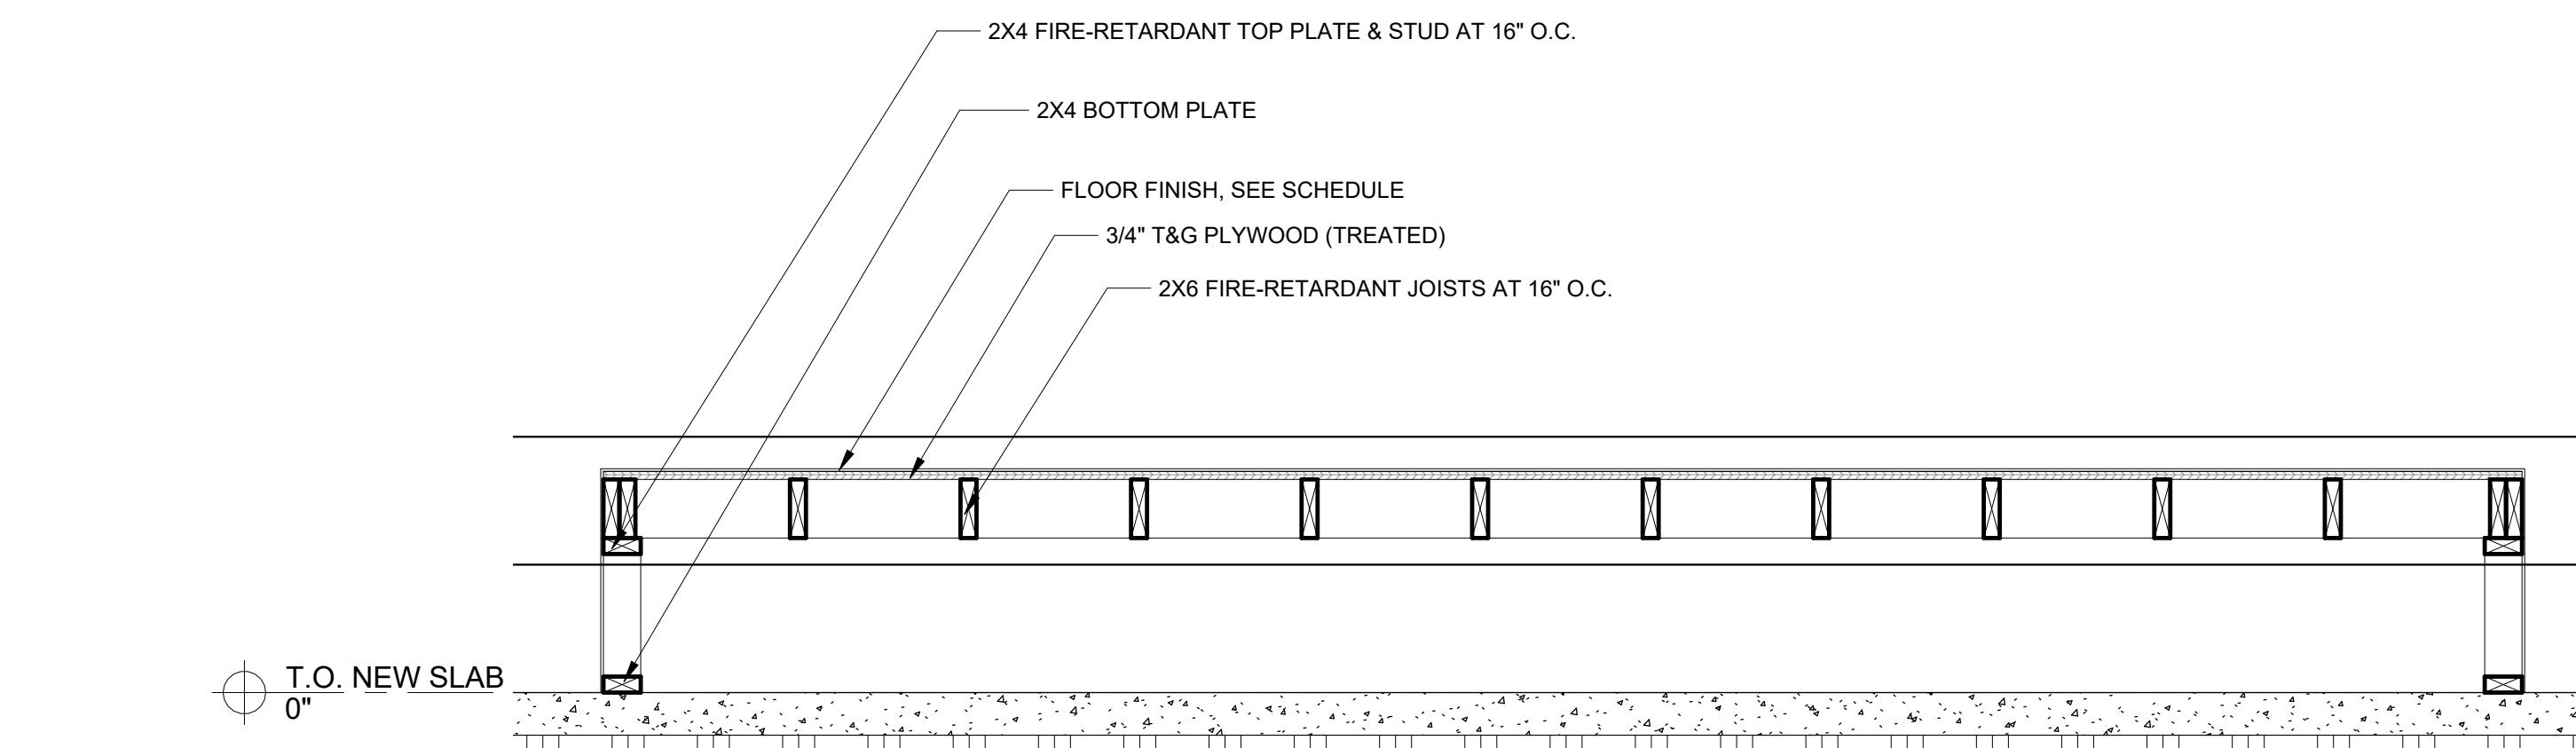


8 LONGITUDINAL SECTION THROUGH PULPIT  
A4.1 3/4" = 1'-0"

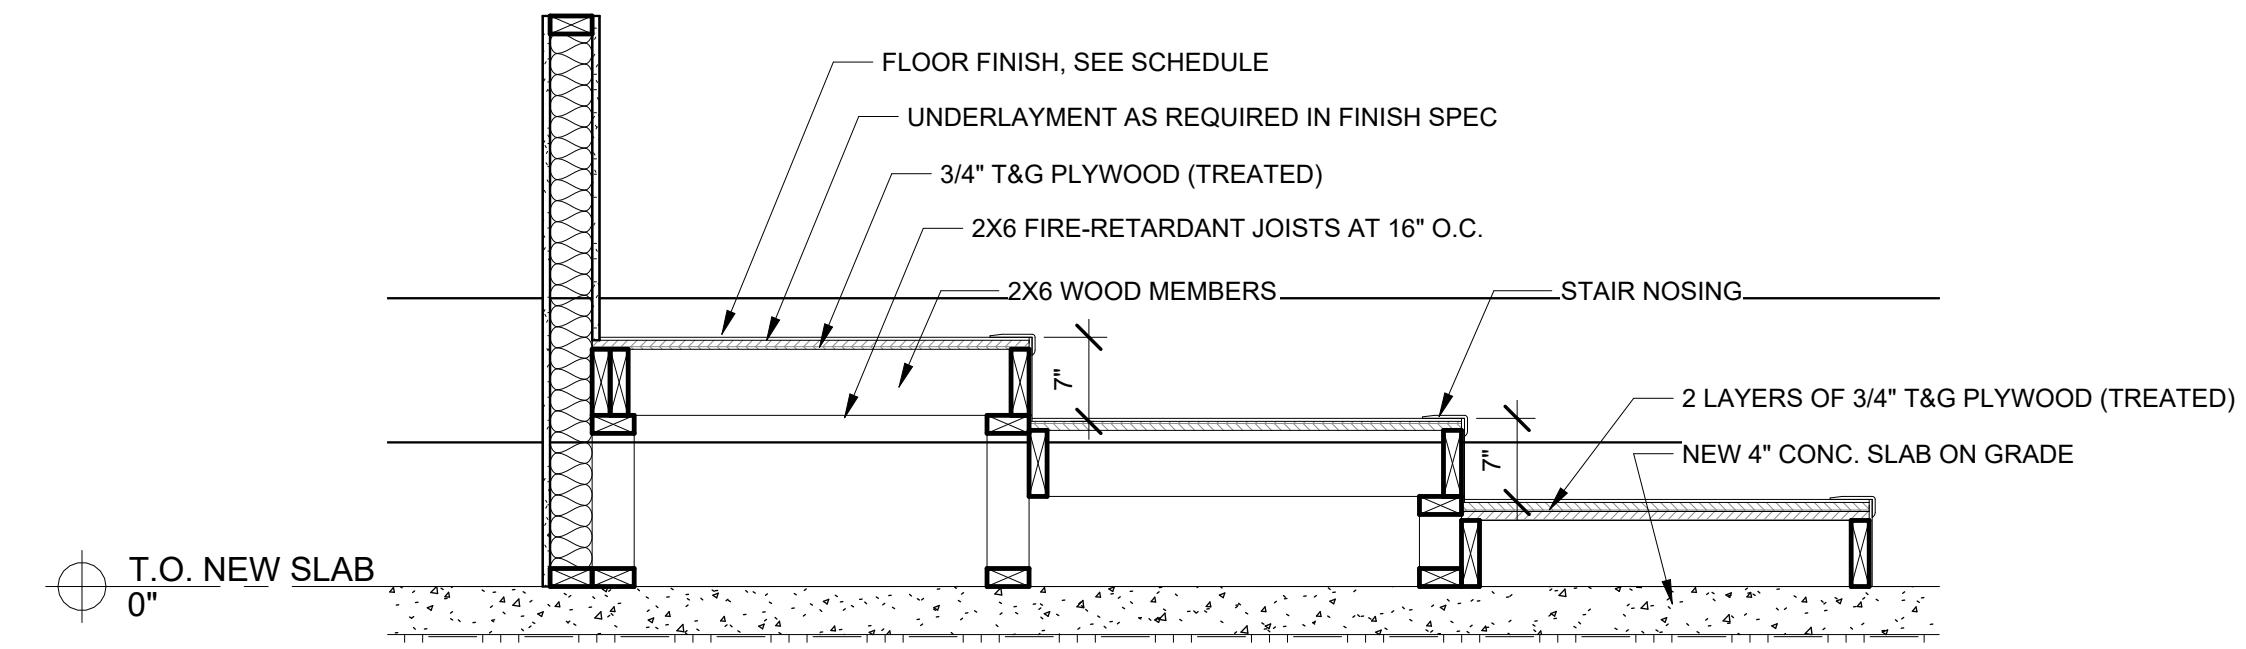


9 TRANSVERSE SECTION THROUGH PULPIT  
A4.1 3/4" = 1'-0"

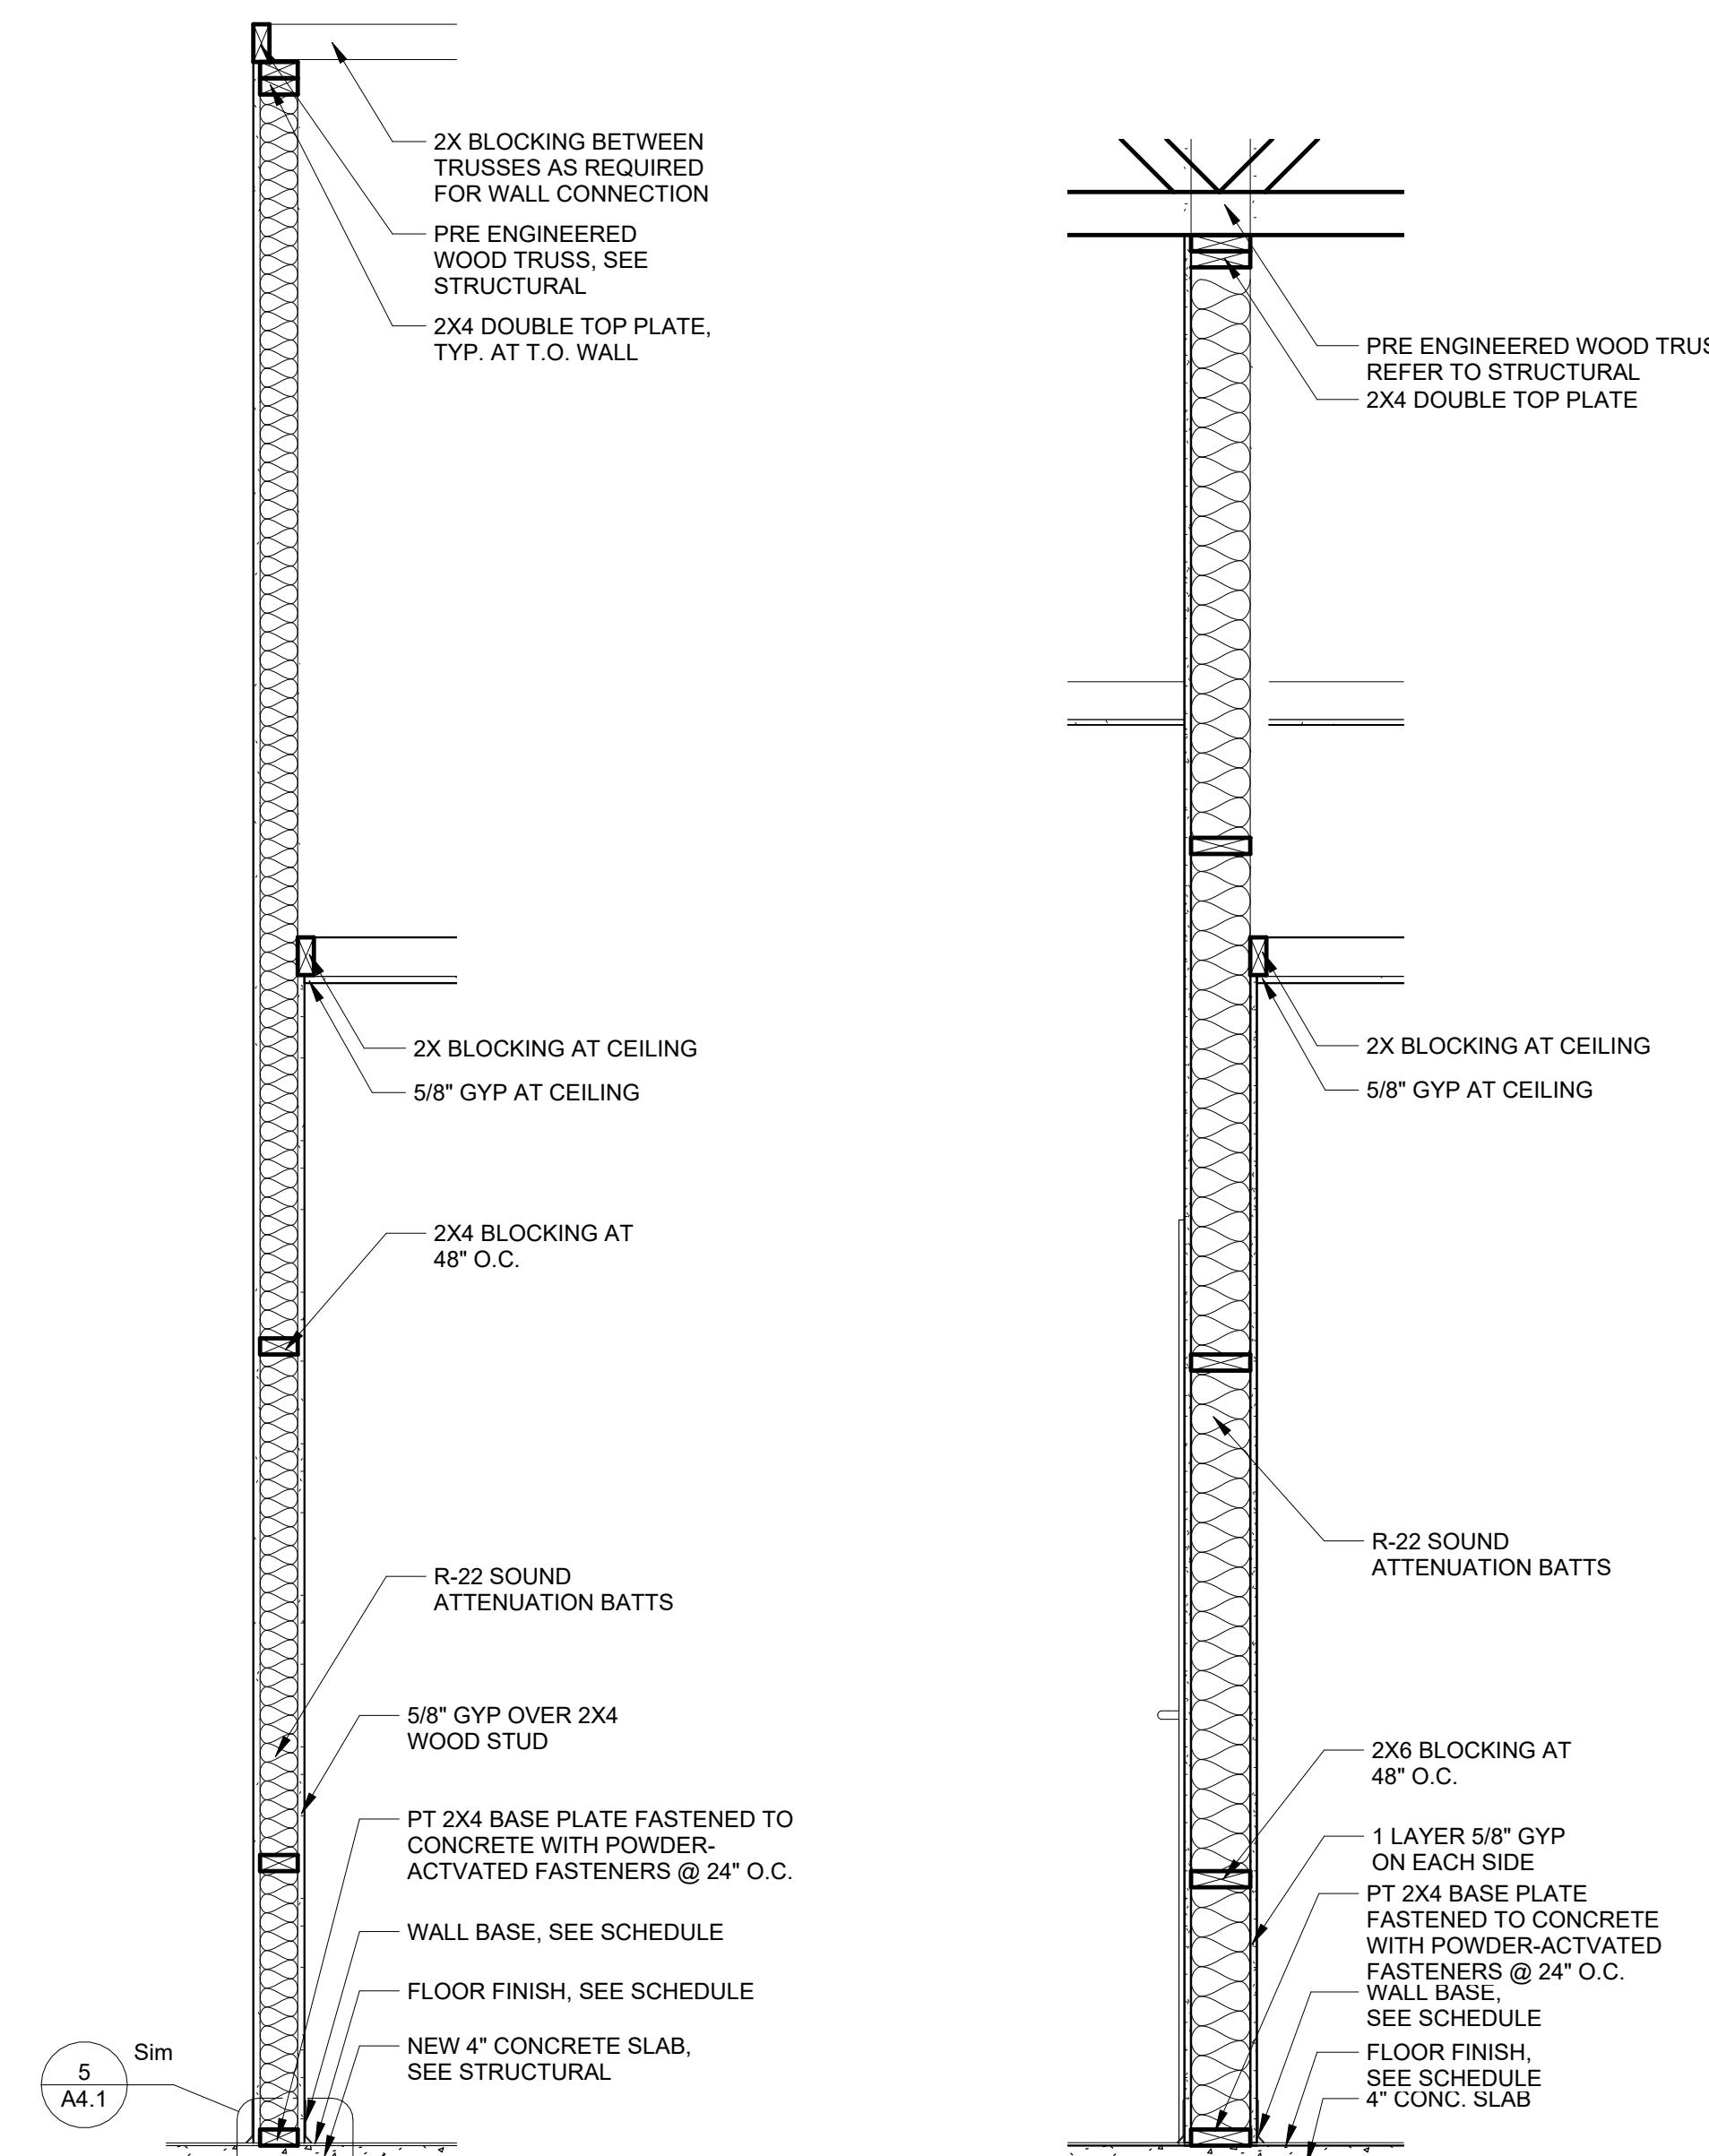


1 TYP 2X4 WALL SECTION  
A4.1 3/4" = 1'-0"

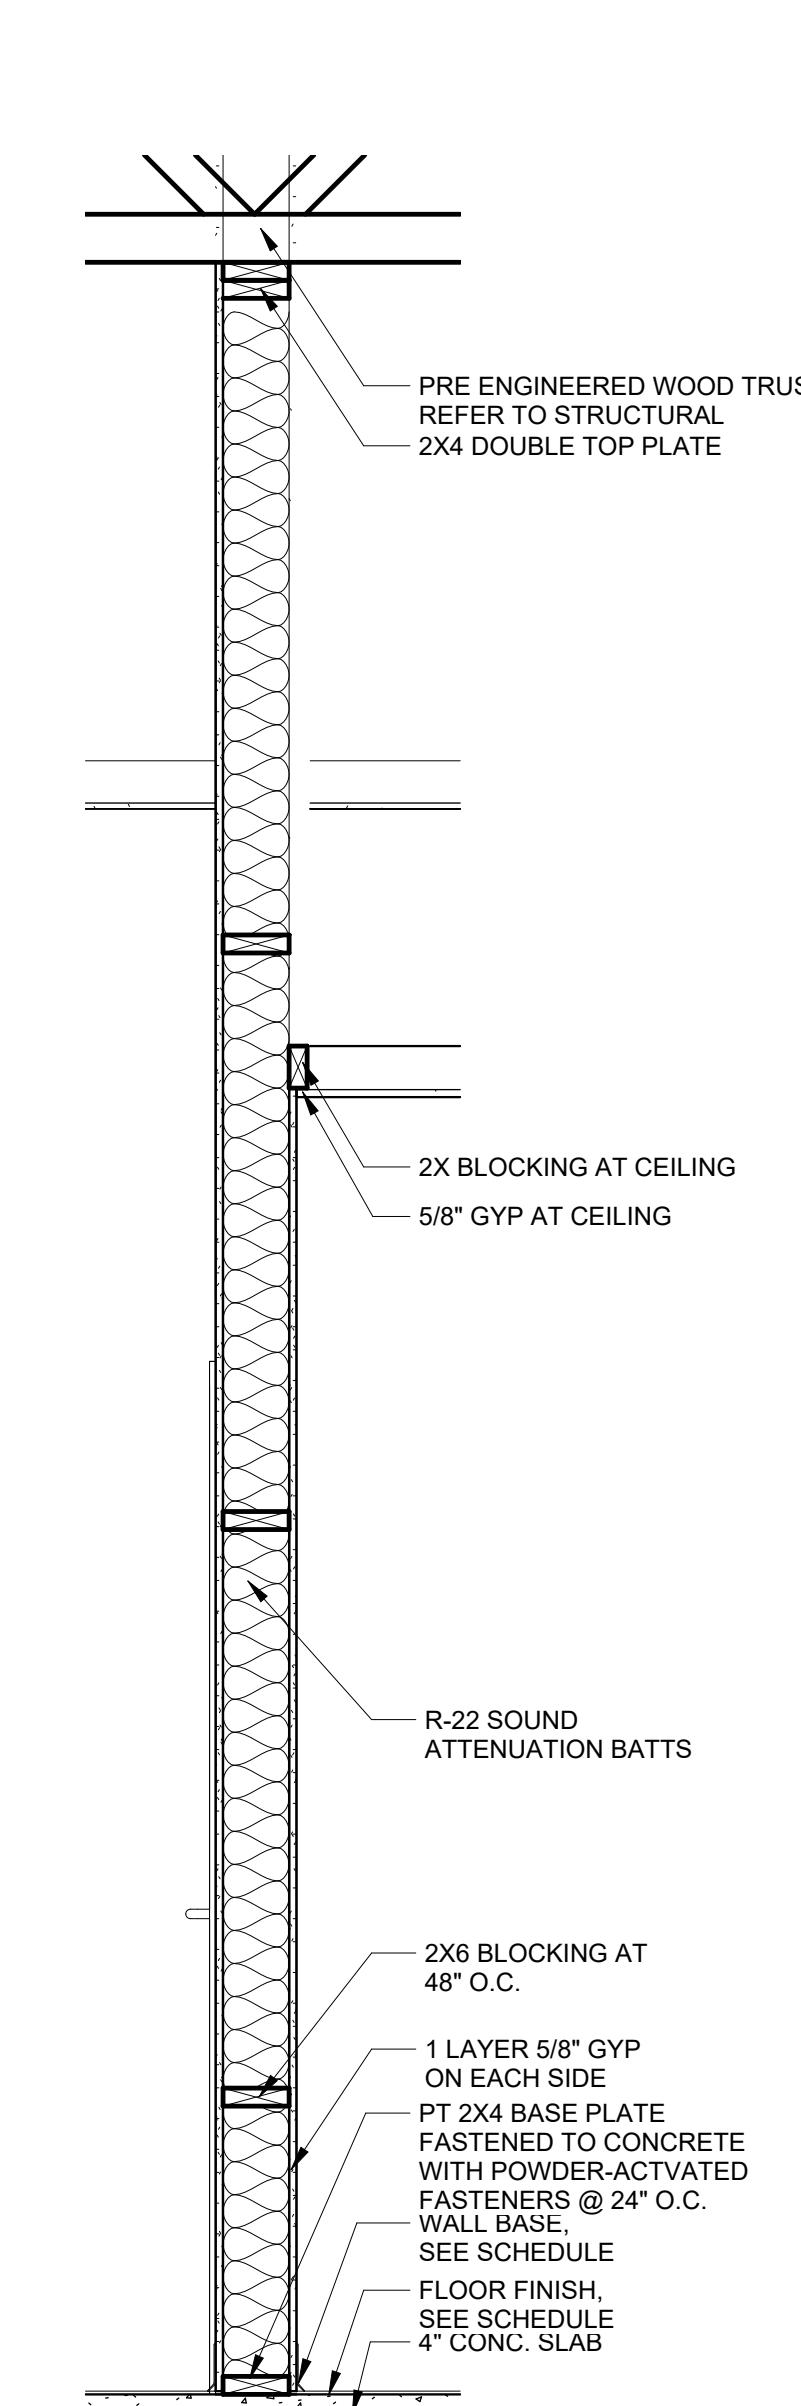


2 TYP 2X6 WALL SECTION  
A4.1 3/4" = 1'-0"

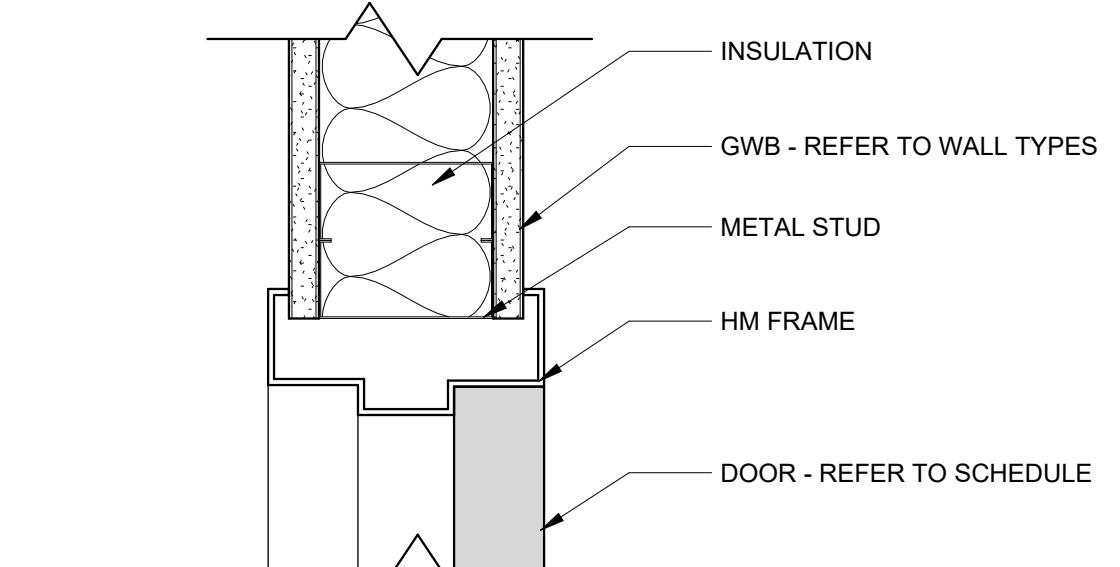


6 INTERIOR HM DOOR HEAD  
A4.1 3" = 1'-0"

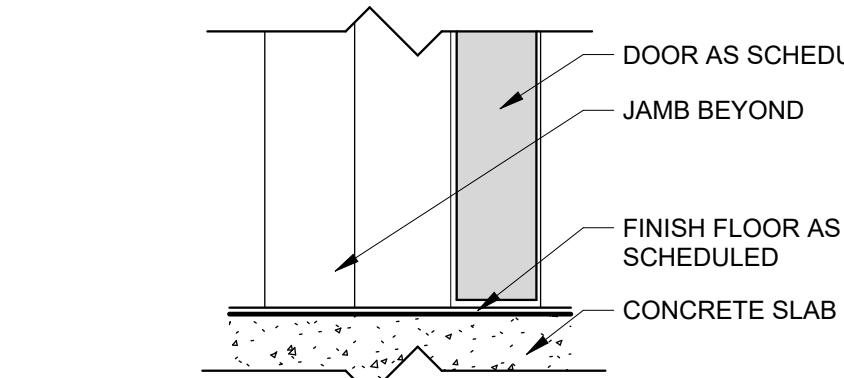


5 INTERIOR HM DOOR THRESHOLD  
A4.1 3" = 1'-0"

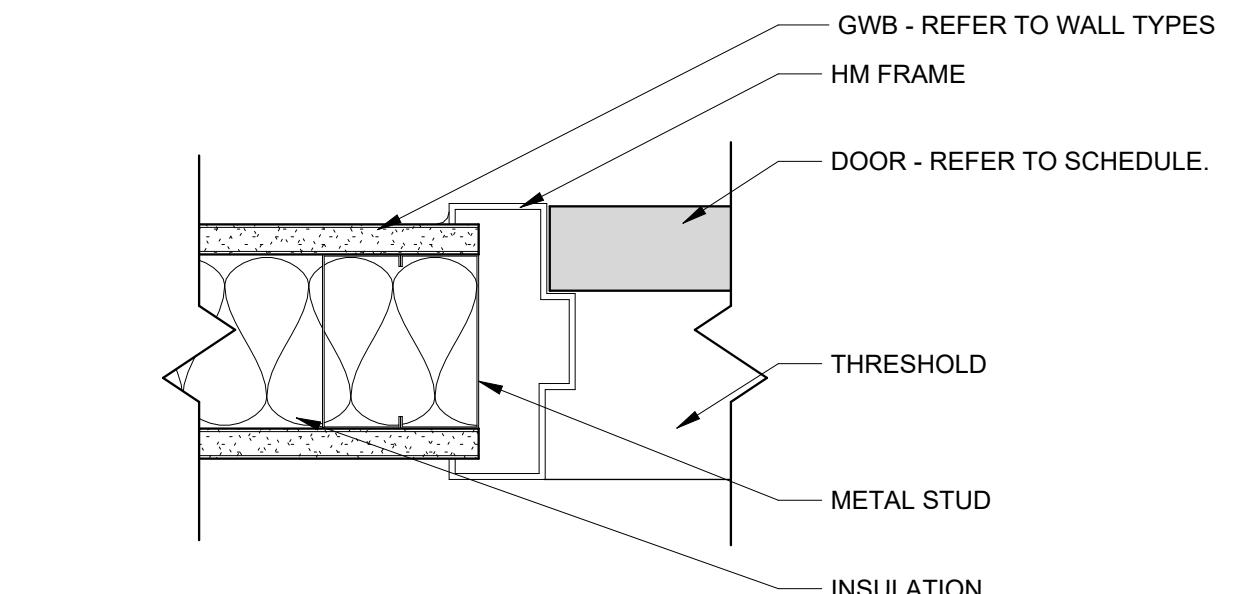

4 INTERIOR HM DOOR JAMB  
A4.1 3" = 1'-0"

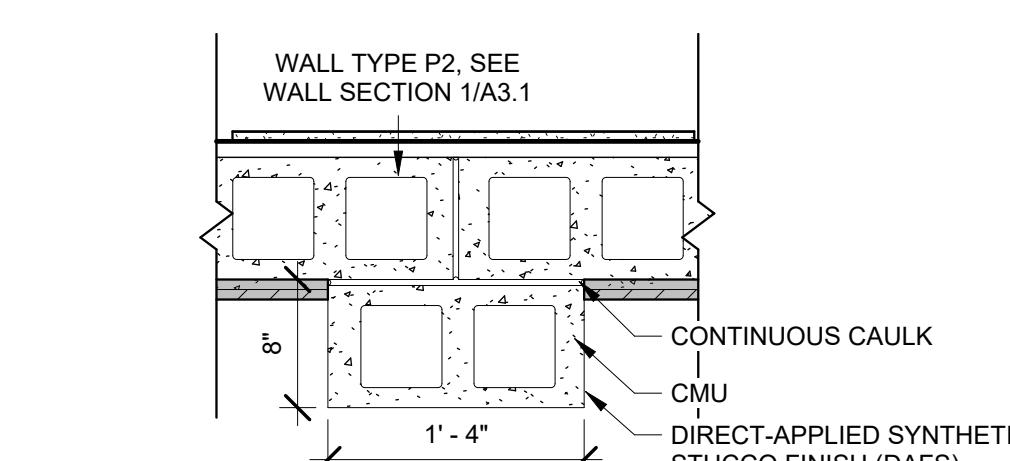

3 TYP PILASTER DETAIL  
A4.1 1" = 1'-0"

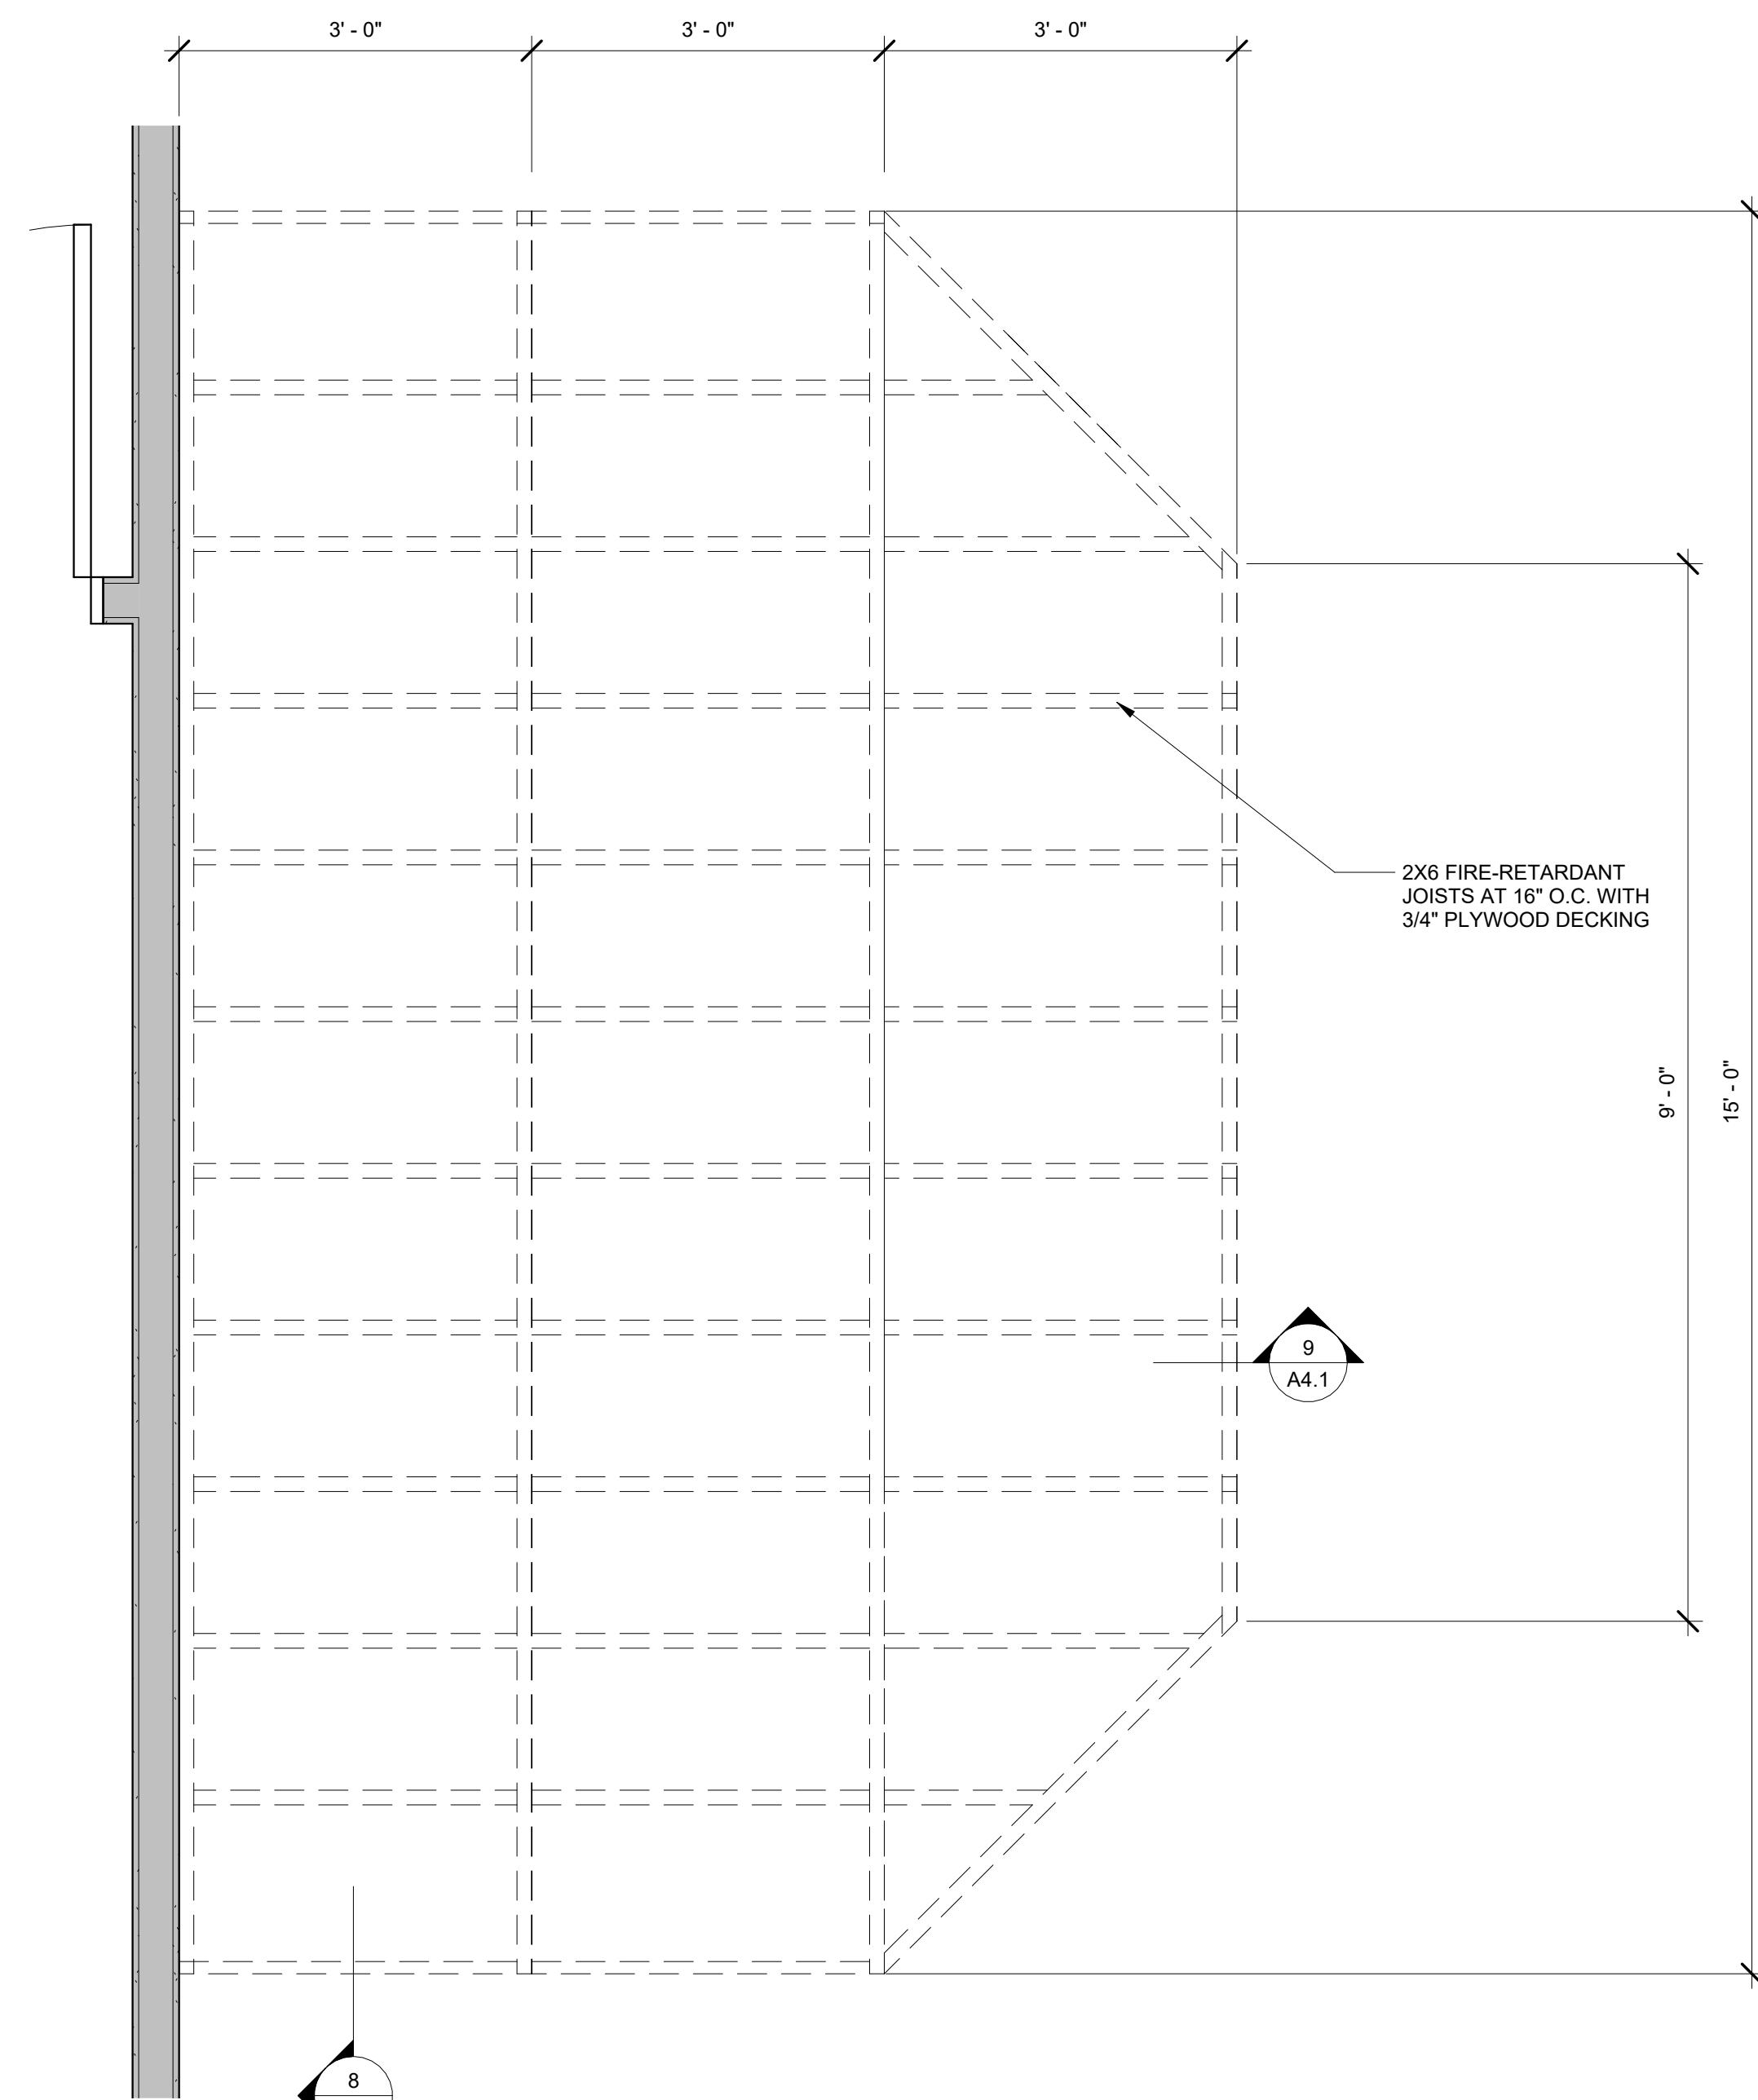

7 FRAMING PLAN AT PULPIT  
A4.1 3/4" = 1'-0"

DOOR SCHEDULE								
MARK	SIZE		DOOR		FRAME			
	WIDTH	HEIGHT	MATERIAL	DOOR ELEVATION	GLAZING	MATERIAL	ELEVATION	HARDWARE
100	6'-0"	7'-0"	S.C. WOOD, ST-1	2	-	H.M.	A	1
101	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	2
102	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	2
103	6'-0"	7'-0"	ALUMINUM	1	-	H.M.	A	1
104	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
105	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
106	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
107	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
108	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	2
109	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
110	6'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	3
111	3'-0"	7'-0"	ALUMINUM	1	-	H.M.	A	1
112	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
113	3'-0"	7'-0"	ALUMINUM	1	-	H.M.	A	4
114	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
115	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
116	3'-0"	7'-0"	S.C. WOOD	1	-	H.M.	A	4
117	2'-6"	7'-0"	S.C. WOOD	1	-	H.M.	A	4

## DOOR SCHEDULE NOTES

- ALL DOORS SHALL HAVE LEVER TYPE HARDWARE AS PER FLORIDA ACCESSIBILITY CODE.
- FINISH, TYPE AND COLOR OF ALL DOORS, WINDOWS AND FRAMES TO MATCH EXISTING.
- COORDINATE ALL DOOR AND FINISH WITH OWNER PRIOR TO BID.
- DOOR SUPPLIER SHALL SUBMIT DOOR HARDWARE SCHEDULE TO THE OWNER FOR APPROVAL PRIOR TO CONSTRUCTION.
- INSTALL PANIC, EXIT, CODE COMPLIANT AND FIRE HARDWARE AS REQUIRED BY CODE.
- ALL GLASS IN DOORS, WITHIN 48" OF A DOOR, OR WITHIN 18' FROM FINISHED FLOOR SHALL BE TEMPERED.
- DOOR THRESHOLDS SHALL COMPLY WITH FLORIDA BUILDING CODE REQUIREMENTS FOR ACCESSIBILITY.
- ALL RATED DOORS SHALL HAVE CLOSERS.
- TIPTICAL DOOR FUNCTIONS SHALL UTILIZE THE HARDWARE SETS AS NOTED. ALL NEW DOORS SHALL BE PROVIDED FBC HARDWARE MEETING ACCESSIBILITY REQUIREMENTS.
- THE DOOR HARDWARE IS PROVIDED AS A GUIDE SPEC AND SHOULD BE VERIFIED WITH A HARDWARE CONSULTANT AND THE OWNER PRIOR TO ORDERING AND INSTALLING.
- COORDINATE DOOR KEYING WITH OWNER.


## INTERIOR &amp; EXTERIOR DOOR ACCESSIBILITY NOTES

- ALL DOORS SHALL BE OPERABLE BY A SINGLE EFFORT. THE DOORS, AND CLOSERS SHALL BE ADJUSTED SUCH THAT EXTERIOR SWINGING DOORS CAN BE OPERATED BY NOT MORE THAN 8.5 POUNDS OF FORCE THE LATCH STILE, INTERIOR DOORS BY NOT MORE THAN 5.0 POUNDS OF FORCE.
- NOTE: HANDRAILS, PULLS, LOCKSETS, AND OTHER OPERATING MECHANISMS ON ALL DOORS AND OTHER MECHANISMS, OR U-SHAPED HANDLES SHALL HAVE A SHAPE THAT IS EASY TO GRASP WITH ONE HAND AND DOES NOT REQUIRE TIGHT GRASPING, TIGHT PINCHING, OR TWISTING OF THE WRIST TO OPERATE. THIS REQUIREMENT SHALL BE SATISFIED BY THE 6 POUND FEET STANDARD. ALL DOORS SHALL MEET ACCESSIBILITY REQUIREMENTS AS PER CODES STATED ON THE COVER SHEET.

## DOOR HARDWARE SCHEDULE

SET 1:	SET 2:	SET 3:	SET 4:
HARDWARE BY DOOR MANUFACTURER, ENTRY LOCKSET, DOOR CLOSERS, PUSH PULL TYPE HARDWARE, WEATHER STRIPPING, ADA THRESHOLD	(3) HINGES 1 PRIVACY LOCKSET, 1 DOOR STEP, 2 KICKPLATES, 4 DOOR SILENCERS	(3) HINGES 1 STOREROOM LOCKSET, 1 DOOR CLOSER, 4 DOOR SILENCERS	(3) HINGES 1 EACH OFFICE LOCKSET, 1 EACH DOORSTOP, 4 EACH DOOR SILENCERS
AS SCHEDULED	AS SCHEDULED	AS SCHEDULED	AS SCHEDULED
H.M. / SOLID CORE WOOD	H.M. / ALUMINUM	REFRIGERATOR, BY OWNER	MICROWAVE, BY OWNER
AS SCHEDULED	AS SCHEDULED	AS SCHEDULED	AS SCHEDULED

WINDOW SCHEDULE				
MARK	WIDTH	HEIGHT	TYPE	REMARKS
A	2'-8"	4'-6"	WOOD	

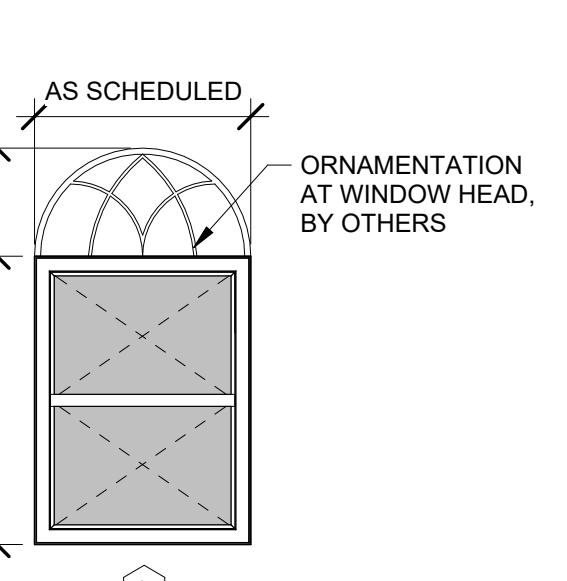

## WINDOW SPECIFICATION:

- ALL EXTERIOR WINDOWS SHALL HAVE A U-FACTOR OF 0.45 AND A SHGC OF 0.52. (THESE FACTORS ARE MINIMUM REQUIREMENTS.)
- ALL EXTERIOR DOORS SHALL HAVE A U-FACTOR OF 0.45 AND A SHGC OF 0.52. (THESE FACTORS ARE MINIMUM REQUIREMENTS.)
- ALL EXTERIOR WINDOW AND DOOR GLAZING SHALL BE LOW-E INSULATING GLASS. FIELD VERIFY ALL WINDOW TYPE OPENINGS PRIOR TO INSTALLATION OF WINDOWS.
- EXTERIOR WINDOWS AND GLASS DOORS SHALL BEAR THE "AAMA", "WDMA" OR OTHER APPROVED LABEL INDICATING COMPLIANCE WITH ANSI/AAMA/NWEDA 101/S.2-97 AND SHALL MEET THE DESIGN PRESSURE AS NOTED ON THE STRUCTURAL DRAWINGS.
- PROVIDE INSPECTOR WITH MANUFACTURER'S SHOP DRAWINGS FOR INSTALLATION.
- ALL WINDOWS AND DOORS SHALL BE (WHERE REQUIRED) OF THE TYPE DESIGNED FOR AND INTENDED FOR USE IN MASONRY CONSTRUCTION.
- ALL DOORS, WINDOWS, FRAMES AND GLAZING SHALL BE INSTALLED AS PER MANUFACTURER'S WRITTEN INSTRUCTIONS.

ROOM FINISH SCHEDULE									
MARK	ROOM NAME	FLOORING		BASE	WALLS	CEILING	WALL & CEILING RATING	CLG. HT.	NOTES
		FINISH	CLASS						
1	ENTRY	LVT	I OR II	WB-1	GYP - PT-1	GWB	A OR B	9'-0"	
2	RR	TILE	-	WB-2	GYP, PT-1, TILE	GWB	A, B OR C	9'-0"	
3	RR	TILE	-	WB-2	GYP, PT-1, TILE	GWB	A, B OR C	9'-0"	
4	SANCTUARY	LVT	I OR II	WB-1	GYP - PT-1	GWB	A OR B	SLOPED SEE BLDG SECTION	
5	SOUND	CONC.	-	WB-1	GYP - PT-1	OPEN	A, B OR C	OPEN	
6	AC	CONC.	-	WB-1	GYP - PT-1	OPEN	A, B OR C	OPEN	
7	HALL	LVT	I OR II	WB-1	GYP - PT-1	GWB	A OR B	9'-0"	
8	RR	TILE	-	WB-2	GYP, PT-1, TILE	GWB	A, B OR C	9'-0"	
9	OFFICE	LVT	-	WB-1	GYP - PT-1	GWB	A, B OR C	9'-0"	
10	PASTOR	LVT	-	WB-1	GYP - PT-1	GWB	A, B OR C	9'-0"	
11	HALL	LVT	I OR II	WB-1	GYP - PT-1	GWB	A OR B	9'-0"	
12	FELLOWSHIP HALL	TILE	I OR II	WB-2	GYP - PT-1	ACT	A OR B	10'-0"	
13	STORAGE	CONC.	-	WB-1	GYP - PT-1	OPEN	A, B OR C	OPEN	
14	AC	CONC.	-	WB-1	GYP - PT-1	OPEN	A, B OR C	OPEN	

## FLAMESPREAD CLASS STATING DEFINITION:

CLASS A INTERIOR WALL AND CEILING FINISH - FLAME SPREAD 0-25, (NEW) SMOKE DEVELOPED 0-450  
CLASS B INTERIOR WALL AND CEILING FINISH - FLAME SPREAD 26-75, (NEW) SMOKE DEVELOPED 0-450  
CLASS C INTERIOR WALL AND CEILING FINISH - FLAME SPREAD 76-100, (NEW) SMOKE DEVELOPED 0-450

## ROOM FINISH SCHEDULE LEGEND

## TILE

T1: TYPE - MANUFACTURER, STYLE COLOR

LVT: TYPE - MANUFACTURER, STYLE COLOR

STAINED CONCRETE: TYPE - MANUFACTURER, STYLE COLOR

## FLOOR

PROVIDE FLOORING TRANSITION STRIP.

## LUXURY VINYL TILE

LVT1: TYPE - MANUFACTURER, STYLE COLOR

## WALL

PAINT 1: TYPE - MANUFACTURER, STYLE COLOR

## WALL BASE

WB1: TYPE - MANUFACTURER, STYLE COLOR

WB2: TYPE - MANUFACTURER, STYLE COLOR

## STAIN

ST1: TYPE - MANUFACTURER, STYLE COLOR

## PAINT

PT1: TYPE - MANUFACTURER, STYLE COLOR

## COUNTERTOPS

CT1: TYPE - WITH BACKSPLASH, MANUFACTURER, STYLE COLOR

CT2: TYPE - MANUFACTURER, STYLE COLOR

## CEILING

C1: TYPE - MANUFACTURER, STYLE COLOR

C2: TYPE - MANUFACTURER, STYLE COLOR

## ROOM FINISH SCHEDULE NOTES

## FLOOR

TILE: TYPE - MANUFACTURER, STYLE COLOR

LVT: TYPE - MANUFACTURER, STYLE COLOR

STAINED CONCRETE: TYPE - MANUFACTURER, STYLE COLOR

## WALL

PAINT 1: TYPE - MANUFACTURER, STYLE COLOR

## WALL BASE

WB: TYPE - MANUFACTURER, STYLE COLOR

## STAIN

ST: TYPE - MANUFACTURER, STYLE COLOR

## PAINT

PT: TYPE - MANUFACTURER, STYLE COLOR


## COUNTERTOPS

CT: TYPE - WITH BACKSPLASH, MANUFACTURER, STYLE COLOR


CT2: TYPE - MANUFACTURER, STYLE COLOR

## CEILING


C1: TYPE - MANUFACTURER, STYLE COLOR

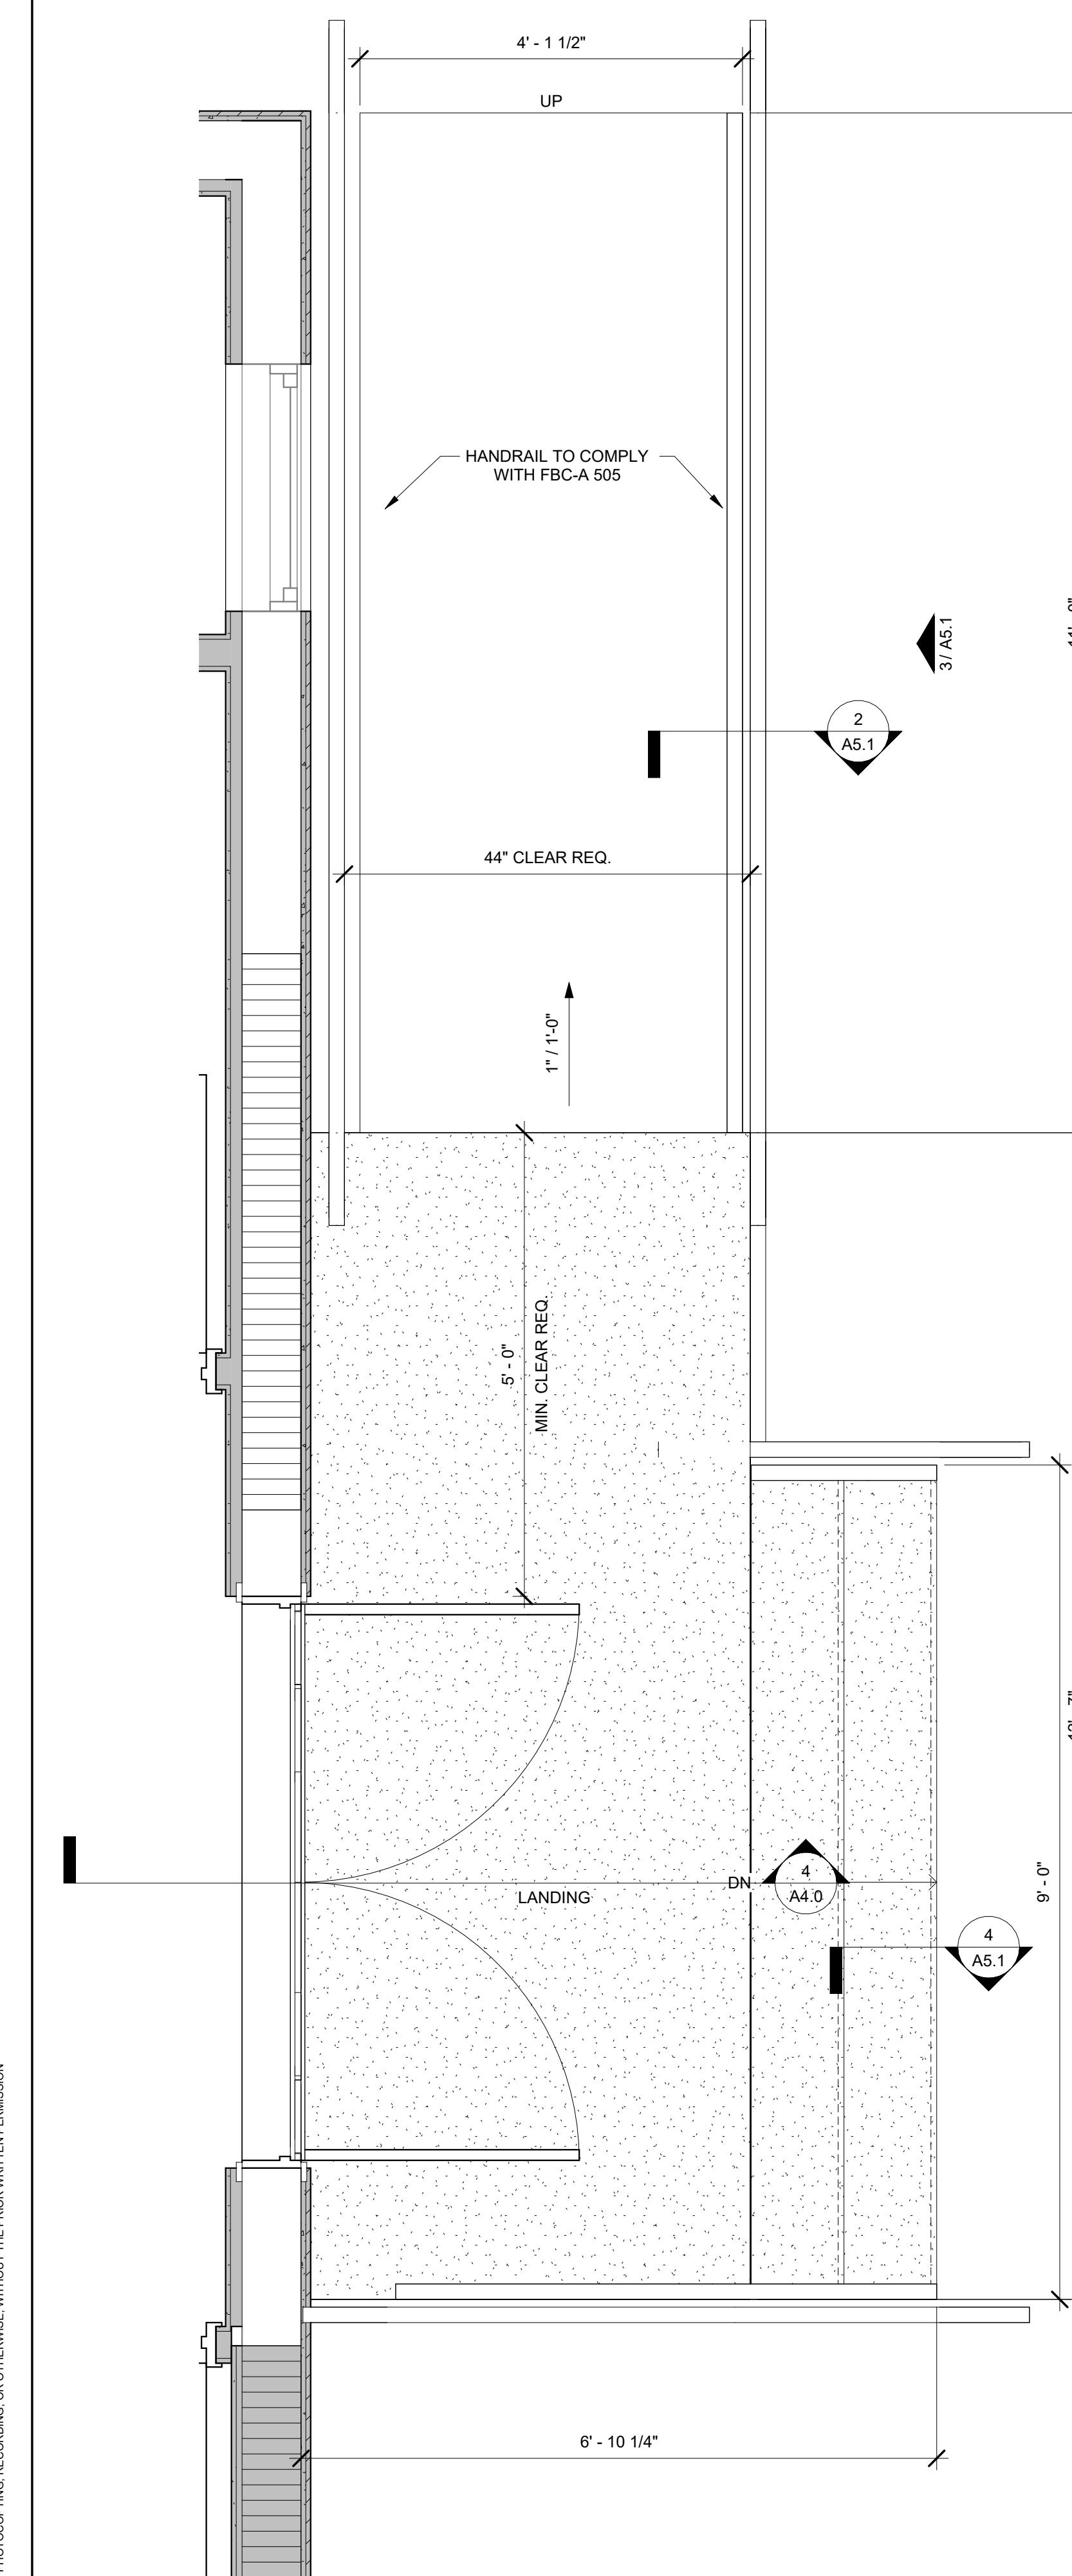


1 A5.1 ENLARGED ENTRY RAMP AND STAIR PLAN  
3/4" = 1'-0"

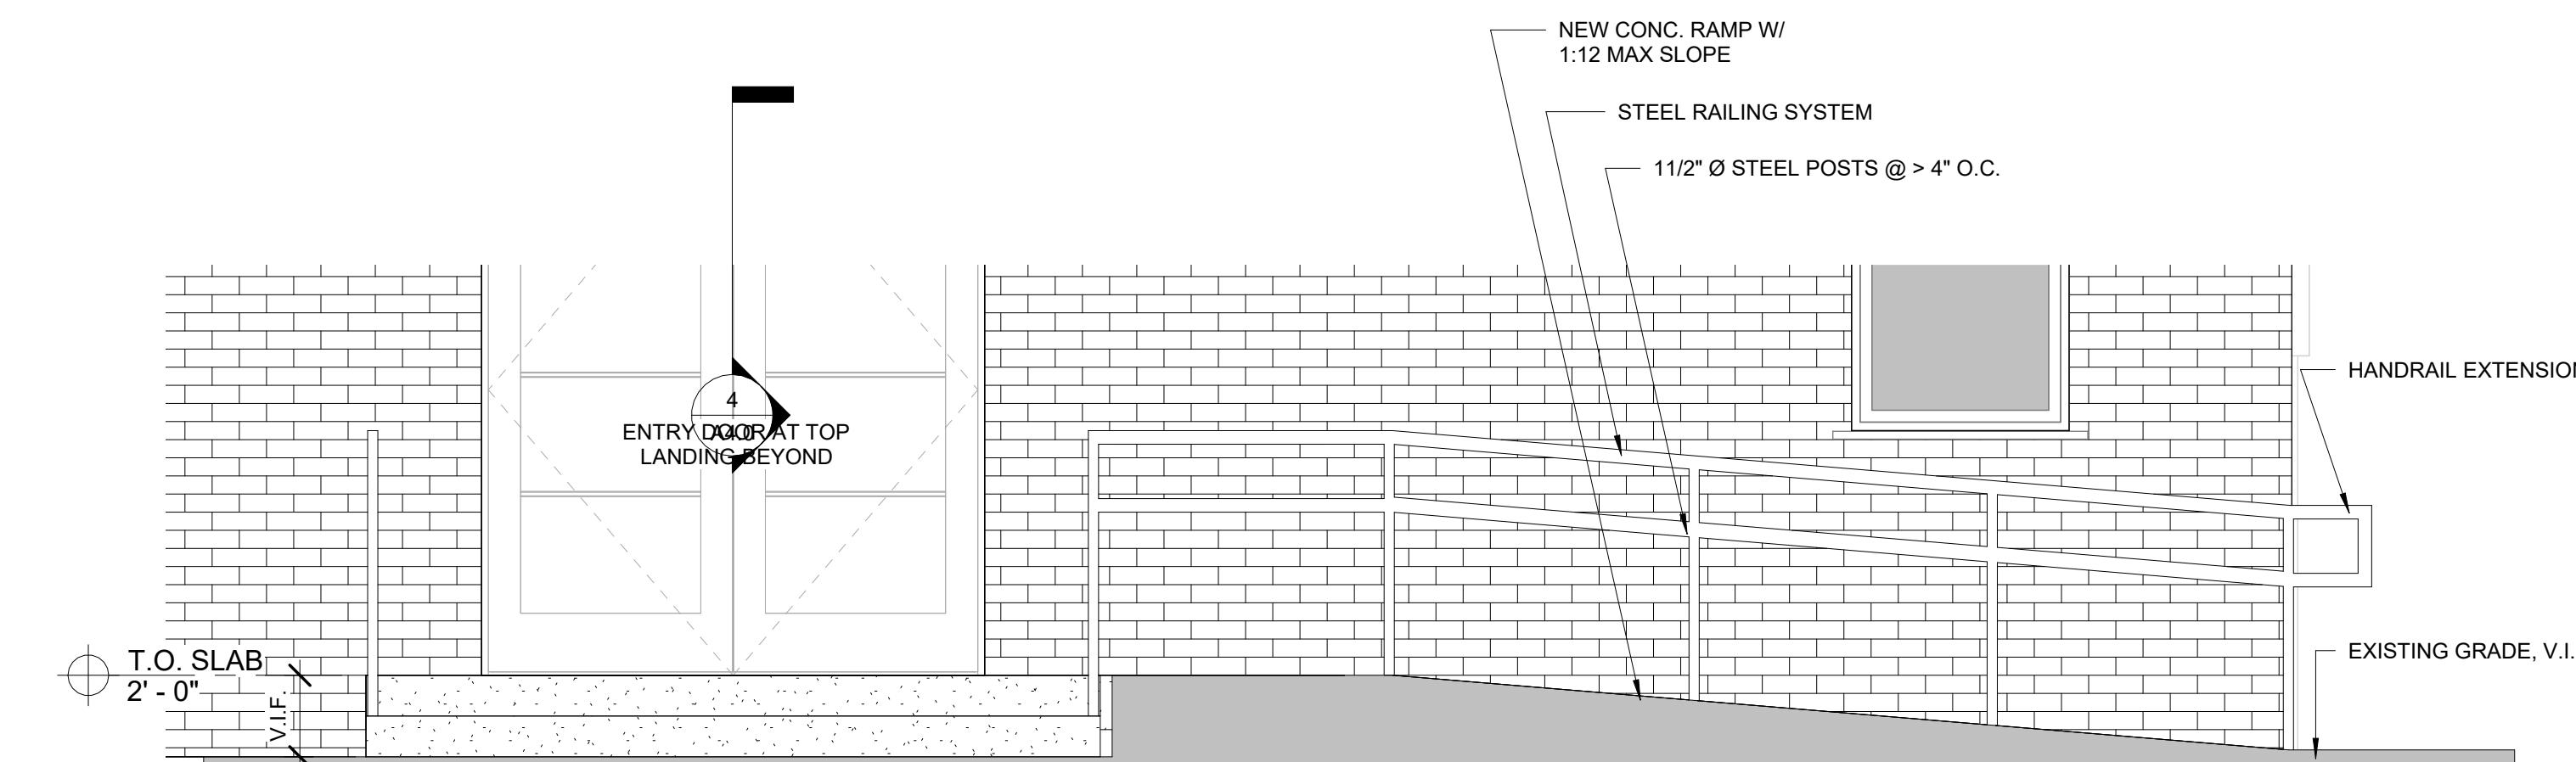

2 A5.1 SECTION AT RAMP  
3/4" = 1'-0"

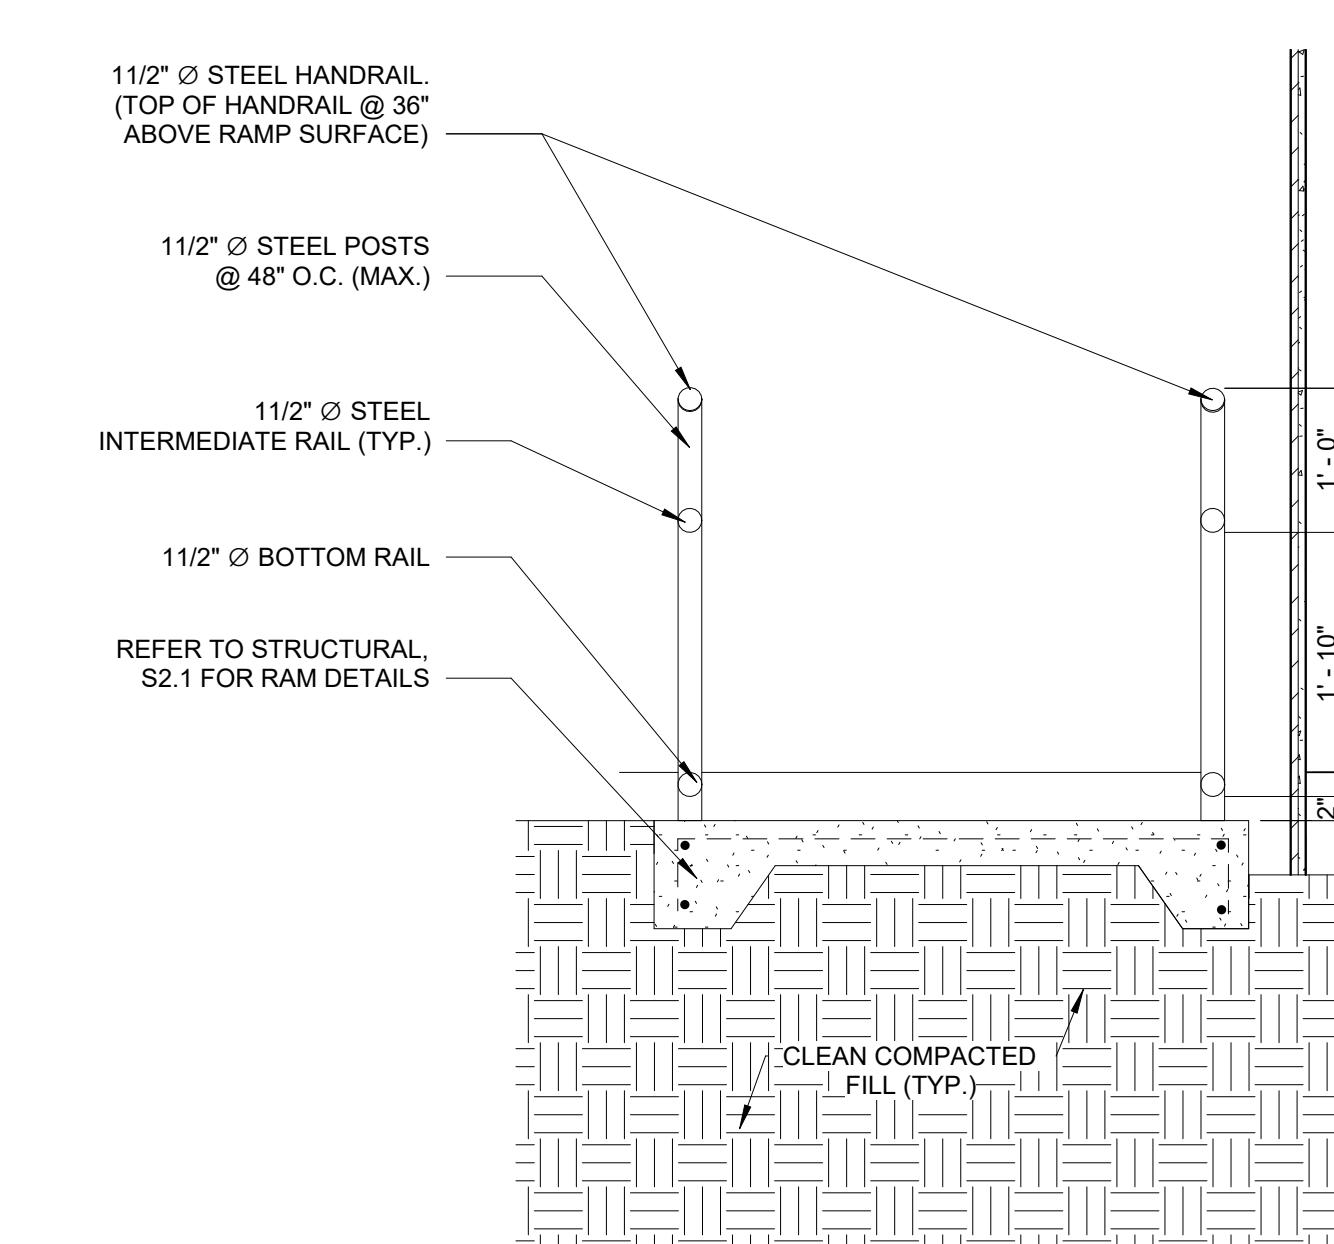


3 A5.1 ENLARGED STAIR AND RAMP ELEVATION  
1/2" = 1'-0"

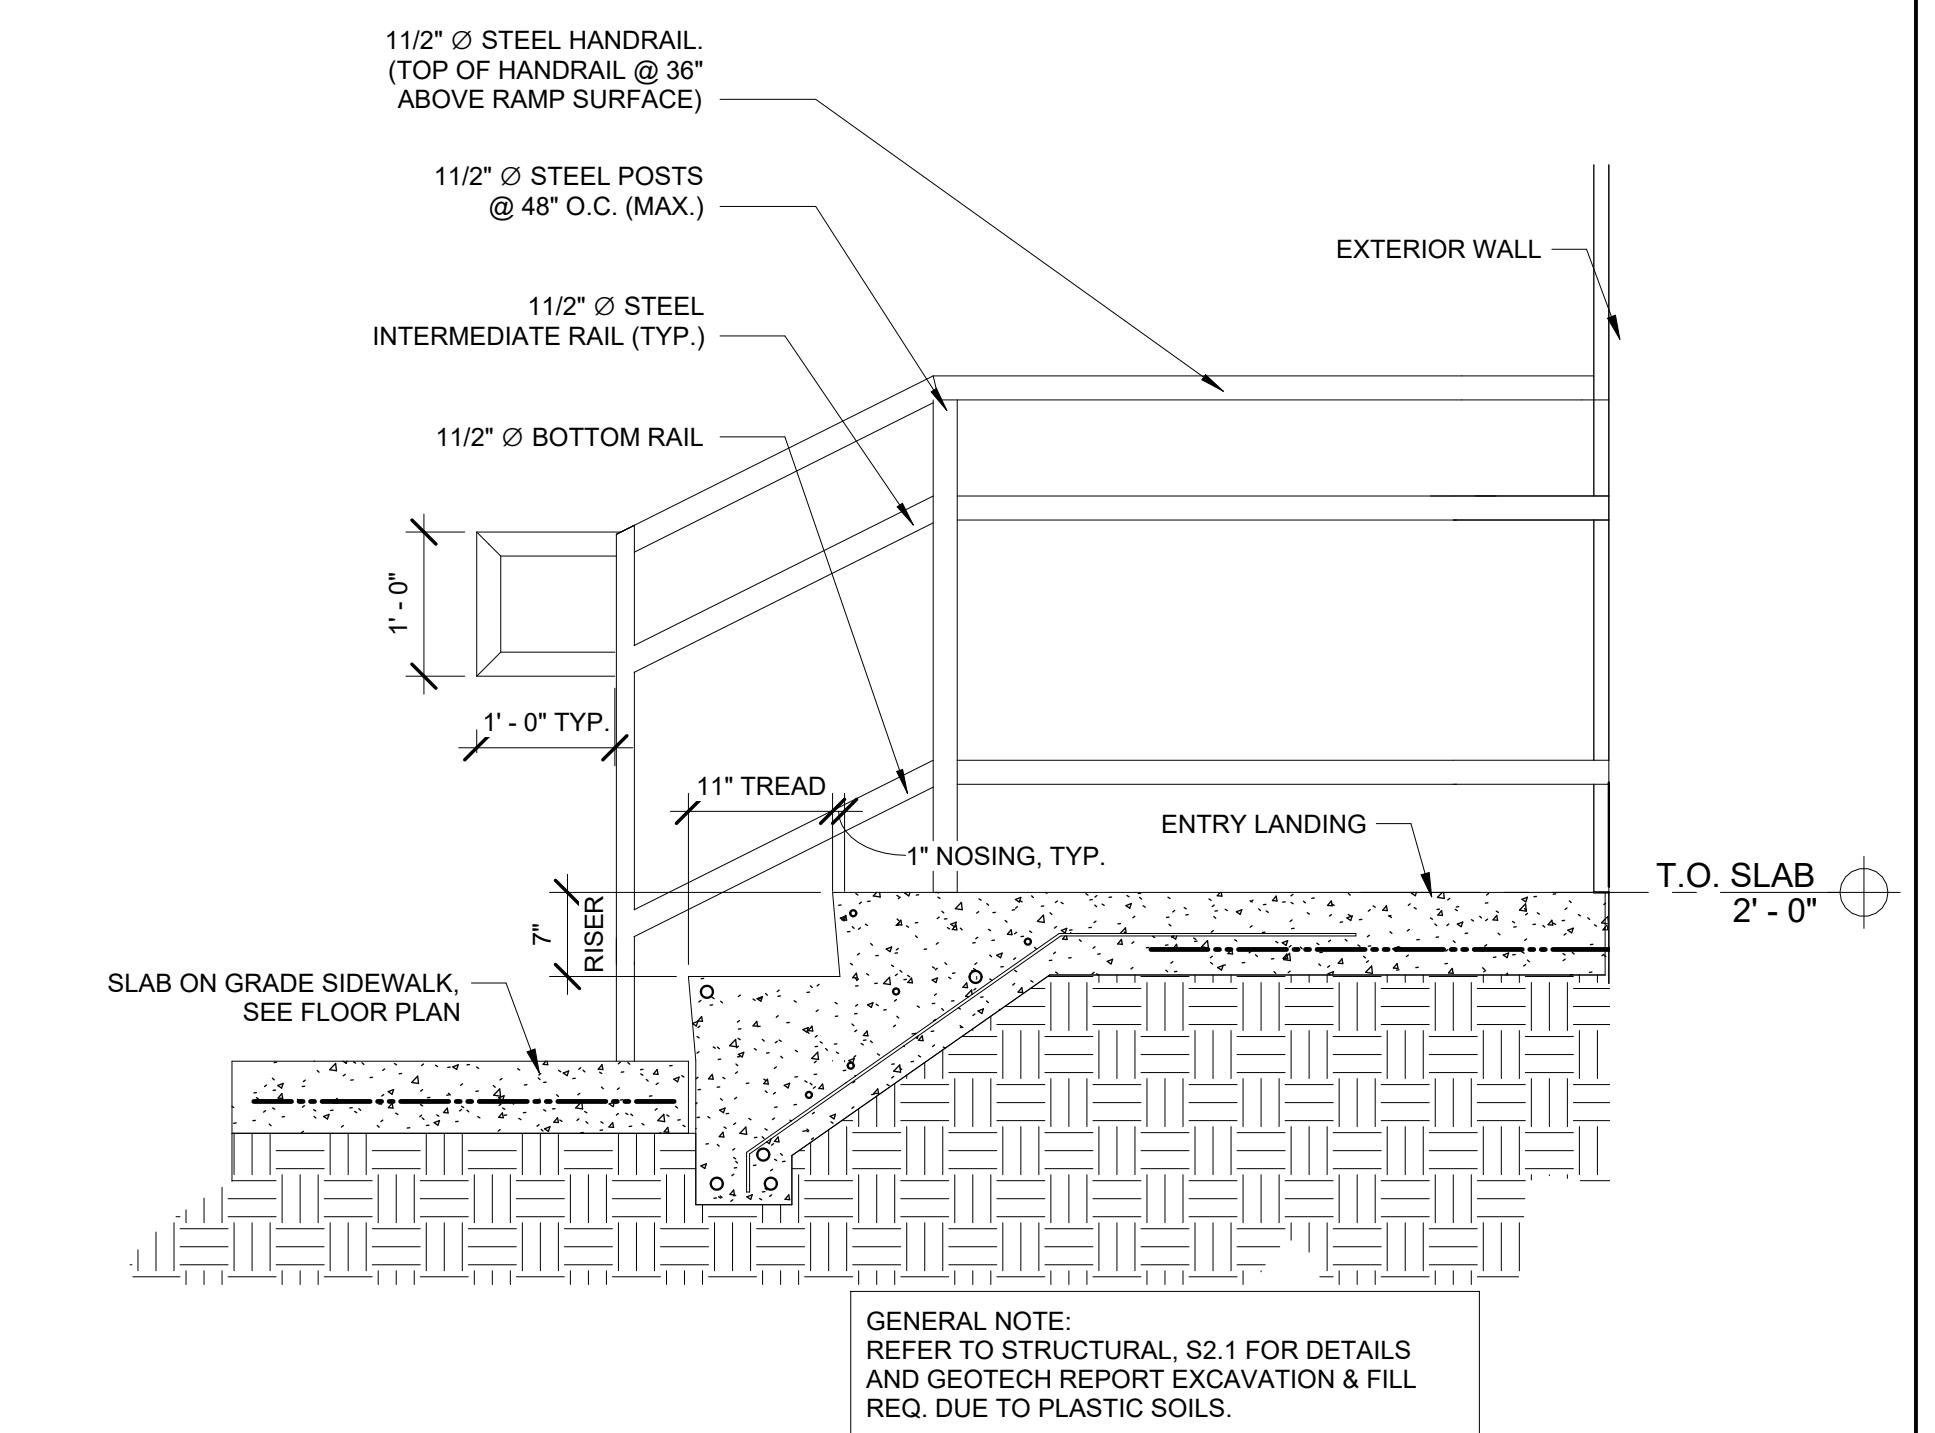

4 A5.1 SECTION AT STAIR  
3/4" = 1'-0"

#1 CHURCH OF CHRIST  
1802 PASCO STREET TALLAHASSEE, FL 32301  
ENLARGED RESTROOM PLANS, ELEVATIONS, AND DETAILS

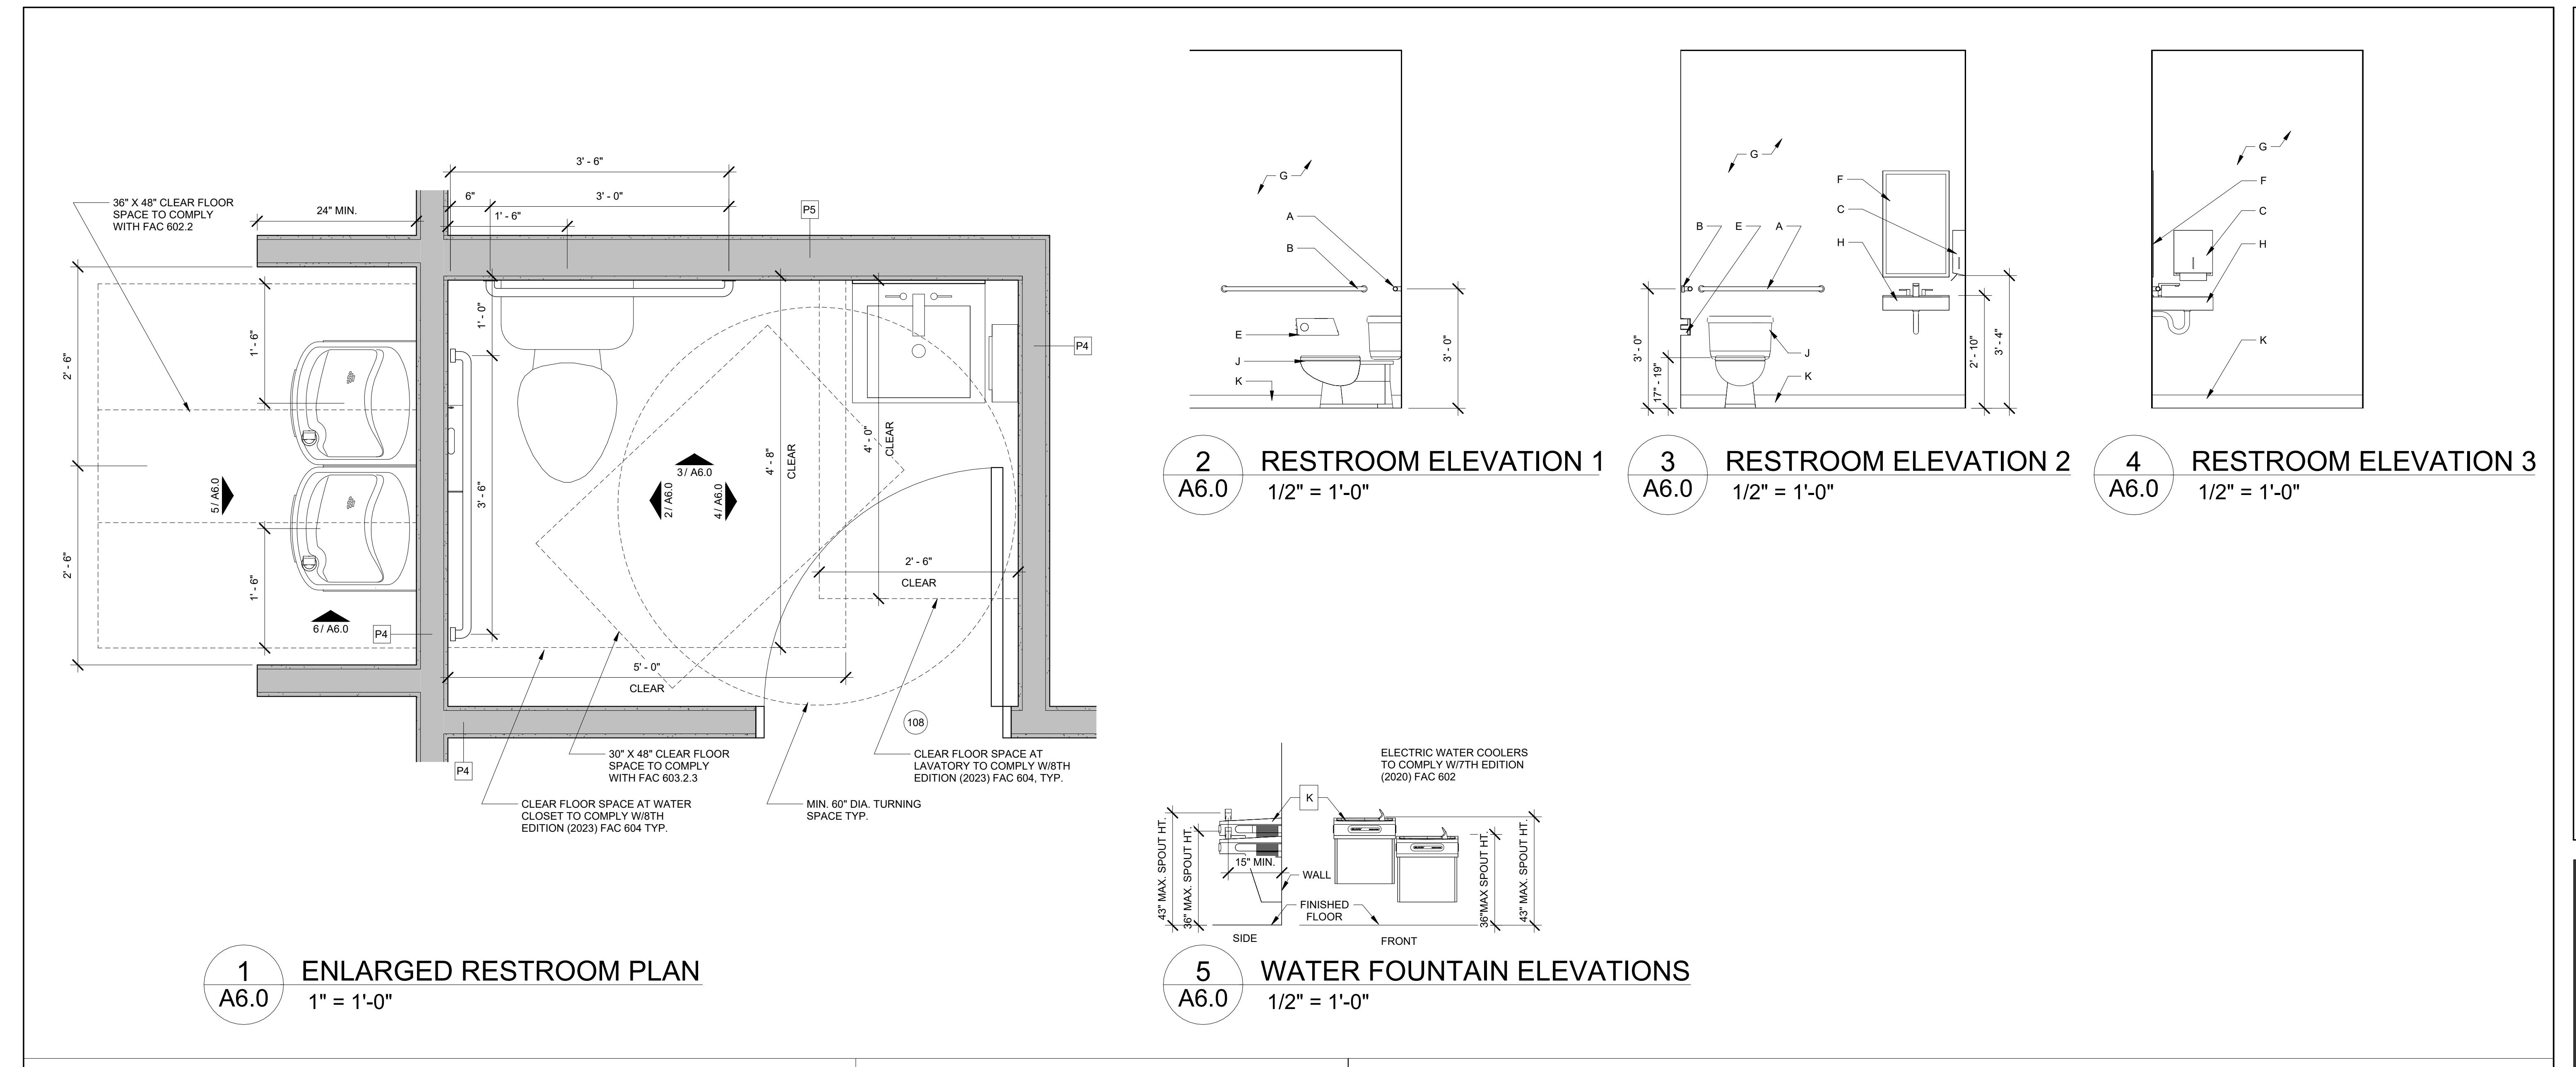

RESTROOM NOTES	GENERAL NOTES	TOILET ACCESSORIES LEGEND
<p>1. INSULATE ALL EXPOSED HOT WATER PIPING AT HANDICAP LOCATIONS.</p> <p>2. LAVATORIES SHALL BE MOUNTED WITH LAVATORY APRON 2-5" A.F.F. IN ACCORDANCE WITH FLORIDA BUILDING CODE ACCESSIBILITY REQUIREMENTS.</p> <p>3. MIRRORS SHALL BE CENTERED OVER SINKS. TYPICAL UNLESS OTHERWISE NOTED.</p> <p>4. H/C TOILETS SHALL MEET REQUIREMENTS OF FLORIDA BUILDING CODE ACCESSIBILITY REQUIREMENTS.</p> <p>5. SHOULD ANY DISCREPANCY BE FOUND BETWEEN ITEMS NOTED IN THE CONTRACT DOCUMENTS AND APPLICABLE CODES, THE CONTRACTOR SHALL BRING THE NEWS TO THE ATTENTION OF THE ARCHITECT PRIOR TO ORDERING.</p> <p>6. PROVIDE SEALANT AROUND THE BASE OF ALL WATER CLOSETS.</p> <p>7. ALL BLOCKING REQUIRED FOR INSTALLATION SHALL BE PROVIDED BY THE CONTRACTOR.</p> <p>8. SHOULD EXISTING WALL DEPTH BE INADEQUATE TO ALLOW INSTALLATION OF RECESSED FIXTURES, SURFACE MOUNTED FIXTURES MAY BE ACCEPTABLE WITH THE ARCHITECT'S REVIEW.</p>	<p>1. ENLARGED TOILET PLANS SHOW LOCATION OF TOILET FIXTURES, ACCESSORIES, AND NOTES. SEE FLOOR PLAN FOR INFORMATION REGARDING WALL TYPES, CONSTRUCTION NOTES AND ROOM FINISHES.</p> <p>2. ALL STUD WALLS SURROUNDING RESTROOMS SHALL HAVE SOUND ATTENUATION BATTING.</p> <p>3. DIMENSIONS LOCATING TOILET ACCESSORIES ARE TYPICAL UNLESS NOTED OTHERWISE.</p> <p>4. REFER TO FINISH SCHEDULE FOR ROOM FINISHES.</p> <p>5. TYPICAL ELEVATIONS ARE SHOWN FOR CLARITY OF FIXTURE AND ACCESSORY LOCATIONS AND HEIGHTS. REFER TO PLAN FOR LOCATIONS.</p> <p>6. ALL WALL MOUNTED GRAB BARS, SINKS OR OTHER EQUIPMENT SHALL HAVE BLOCKING INSTALLED AS REQUIRED.</p>	<p><b>A</b> 1 1/2" DIAMETER GRAB BAR X 36" LONG (PEENED FINISH)</p> <p><b>B</b> 1 1/2" DIAMETER GRAB BAR X 42" LONG (PEENED FINISH)</p> <p><b>C</b> PAPER TOWEL DISPENSER - SURFACE MOUNTED</p> <p><b>D</b> SOAP DISPENSER - SURFACE MOUNTED</p> <p><b>E</b> TOILET TISSUE DISPENSER - SURFACE MOUNTED</p> <p><b>F</b> MIRROR 18" X 36"</p> <p><b>G</b> PAINTED GWB</p> <p><b>H</b> ADA COMPLIANT LAVATORY</p> <p><b>J</b> ADA COMPLIANT TOILET</p> <p><b>K</b> BASE AS SCHEDULED</p>
SIGNAGE NOTES	LATCH SIDE OF DOOR.	
<p>RESTROOM GRAPHICS AND STAIR SIGNAGE SHALL COMPLY WITH THE CODES LISTED ON THE COVER SHEET.</p> <p>CHARACTER PROPORTION, LETTERS AND NUMBERS ON SIGNS SHALL HAVE A WIDTH-TO-HEIGHT RATIO BETWEEN 3:5 AND 1:1 AND A STROKE WIDTH-TO-HEIGHT RATIO BETWEEN 1:5 AND 1:10.</p> <p>CHARACTER HEIGHT, CHARACTERS AND NUMBERS ON SIGNS SHALL BE SIZED ACCORDING TO THE VIEWING DISTANCE FROM WHICH THEY ARE TO BE READ. THE MINIMUM HEIGHT IS MEASURED USING AN UPPER CASE "X". LOWER CASE CHARACTERS ARE PERMITTED.</p> <p>MINIMUM CHARACTER HEIGHT SHALL BE 3".</p> <p>FINISH AND CONTRAST. THE CHARACTERS AND BACKGROUND OF SIGNS SHALL BE EGGSHELL, MATTE, OR OTHER NON GLARE FINISH. CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THEIR BACKGROUND-EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND.</p> <p>RAISED AND BRAILLE CHARACTERS AND PICTORIAL SYMBOL SIGNS (PICTOGRAMS). LETTERS AND NUMERALS SHALL BE RAISED 1/32 INCHES (.8 MM). UPPER CASE, SANS SERIF OR SIMPLE SERIF TYPE AND SHALL BE ACCOMPANIED WITH GRADE 2 BRAILLE. RAISED CHARACTERS SHALL BE AT LEAST 5/8 INCHES (16 MM) HIGH, BUT NO HIGHER THAN 2 INCHES (51 MM). PICTOGRAMS SHALL BE ACCOMPANIED BY THE EQUIVALENT VERBAL DESCRIPTION PLACED DIRECTLY BELOW THE PICTOGRAM. THE BORDER DIMENSION OF THE PICTOGRAM SHALL BE 6 INCHES (152 MM) MINIMUM IN HEIGHT.</p> <p>MOUNTING LOCATION AND HEIGHT. WHERE PERMANENT IDENTIFICATION IS PROVIDED FRO ROOMS AND SPACES, SIGNS SHALL BE INSTALLED ON THE WALL ADJACENT TO THE LATCH SIDE OF THE DOOR. WHERE THERE IS NO WALL SPACE TO THE LATCH SIDE OF THE DOOR, INCLUDING AT DOUBLE LEAF DOORS, SIGNS SHALL BE PLACED ON THE NEAREST ADJACENT WALL. MOUNTING HEIGHT SHALL BE 60 INCHES (1525 MM) ABOVE THE FINISH FLOOR TO THE CENTERLINE OF THE SIGN. MOUNTING LOCATION FOR SUCH SIGNAGE SHALL BE SO THAT A PERSON MAY APPROACH WITHIN 3 INCHES (76 MM) OF SIGNAGE WITHOUT ENCOUNTERING PROTRUDING OBJECTS OR STANDING WITH THE SWING OF A DOOR.</p>		
RESTROOM SIGNAGE	RESTROOM FIXTURES	
MOUNTING HEIGHTS	N.T.S.	A.D.A MOUNTING HEIGHTS
		N.T.S.

01/26/2026
ALG
20-194
A6.0