THE LINE SHOWN ABOVE IS EXACTLY ONE HORIZONTAL INCH ON ORIGINAL ARCHITECT'S DRAWINGS

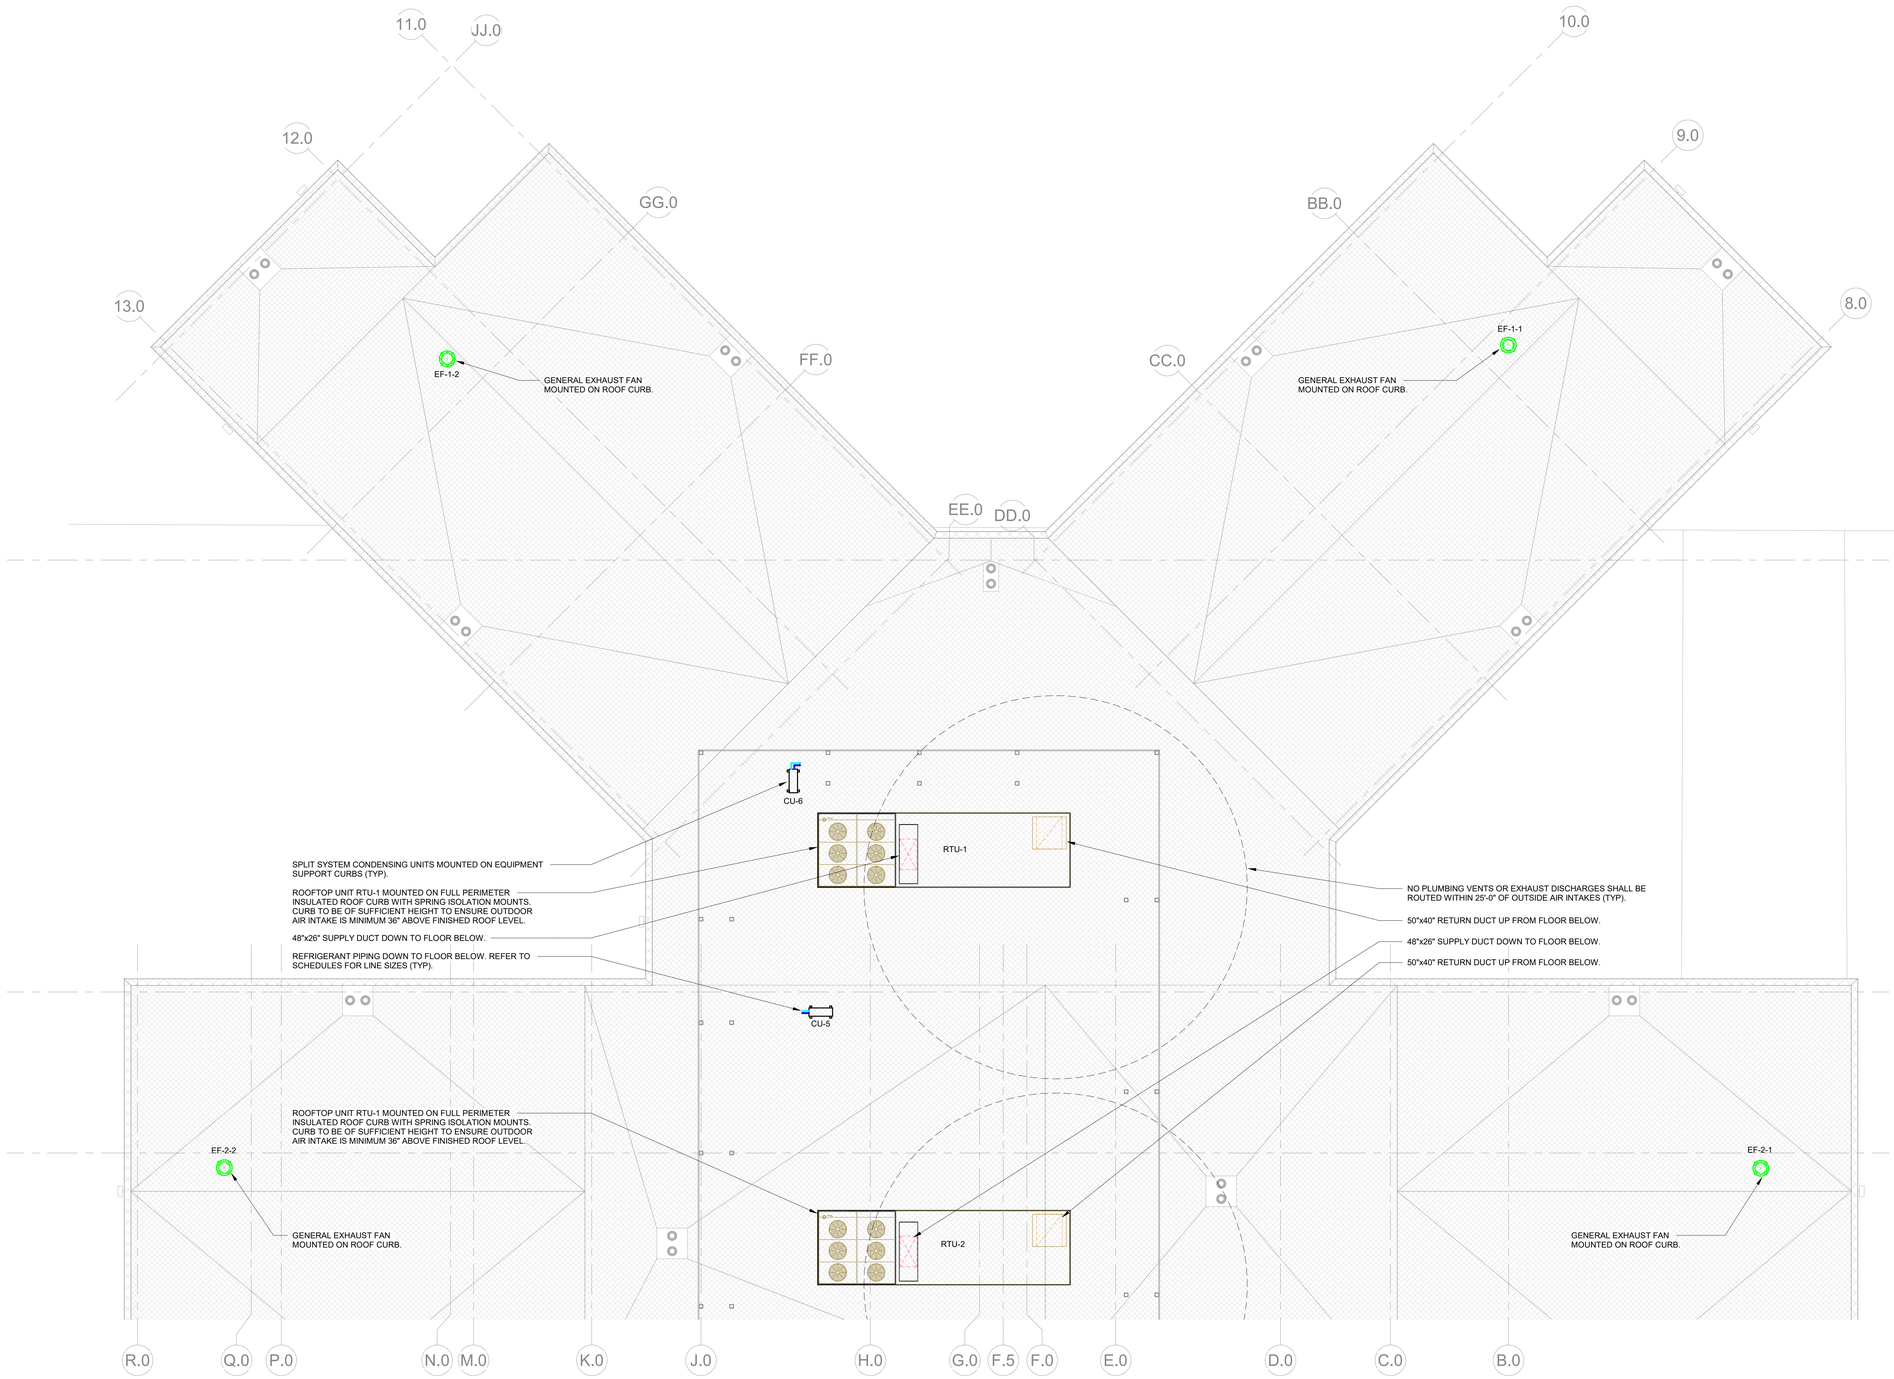

1 / M1.21b MECHANICAL - ROOF PLAN - AREA B
1/8" = 1'-0"

TRUE NORTH PROJECT NORTH

NEW CONSTRUCTION NOTES:

1. ALL MECHANICAL ROOFTOP EQUIPMENT INCLUDING, BUT NOT LIMITED TO, AIR HANDLING UNITS, EXHAUST FANS, AND CONDENSING UNITS MUST BE LOCATED AT LEAST 10'-0" FROM EDGE OF ROOF.
2. ALL EXPOSED DUCTWORK SHALL BE A MINIMUM OF 20 GAUGE.
3. ROOF MOUNTED EQUIPMENT SHALL BE MOUNTED AT A MINIMUM OF 8" ABOVE ROOF SURFACE. WHERE ROOFING MATERIALS EXTEND BENEATH THE EQUIPMENT, THE EQUIPMENT SHALL BE MOUNTED AT A MINIMUM HEIGHT DEPENDENT ON THE EQUIPMENT WIDTH.

EQUIPMENT WIDTH	MIN. CLEARANCE ABOVE ROOF
< 24"	14"
24" < 36"	18"
36" < 48"	24"
48" < 60"	30"
> 60"	48"

ENVIRONMENTS FOR HEALTH ARCHITECTURE
e4h
888.781.8441 817.229.1917 801 Cherry St. Ste. 500, Fort Worth, TX 76102 e4harchitecture.com

© 2025 E4H - Environments For Health, LLC

exalt health

RYAN

ICT
I.C. Thomasson Associates, Inc.
A Salas O'Brien Company
2950 Kraft Drive
Nashville, TN 37204
PHONE 615-346-3400
https://www.ictthomasson.com/
ICT Project No. 2545-02546

FIRM CERTIFICATE OF AUTHORIZATION: CA-1276

ELECTRICAL ENGINEER
FLORIDA REGISTRATION:
JOSHUA R. CARTWRIGHT, P.E. #71893

MECHANICAL ENGINEER
FLORIDA REGISTRATION:
ZACHARY N. McCOY, P.E. #93060

EXALT HEALTH
40 BED REHAB HOSPITAL - PANAMA CITY BEACH
2851 HWY 77
PANAMA CITY, FLORIDA 32405

PROJECT: H002125

Δ	DATE	DESCRIPTION

KEY PLAN:



NOT FOR CONSTRUCTION

ORIG SUBMISSION: 02/13/26
CURRENT:

SHEET TITLE AND NUMBER:

M1.21b

MECHANICAL - ROOF PLAN - AREA B