THE LINE SHOWN ABOVE IS EXACTLY ONE HORIZONTAL INCH ON ORIGINAL ARCHITECT'S DRAWINGS

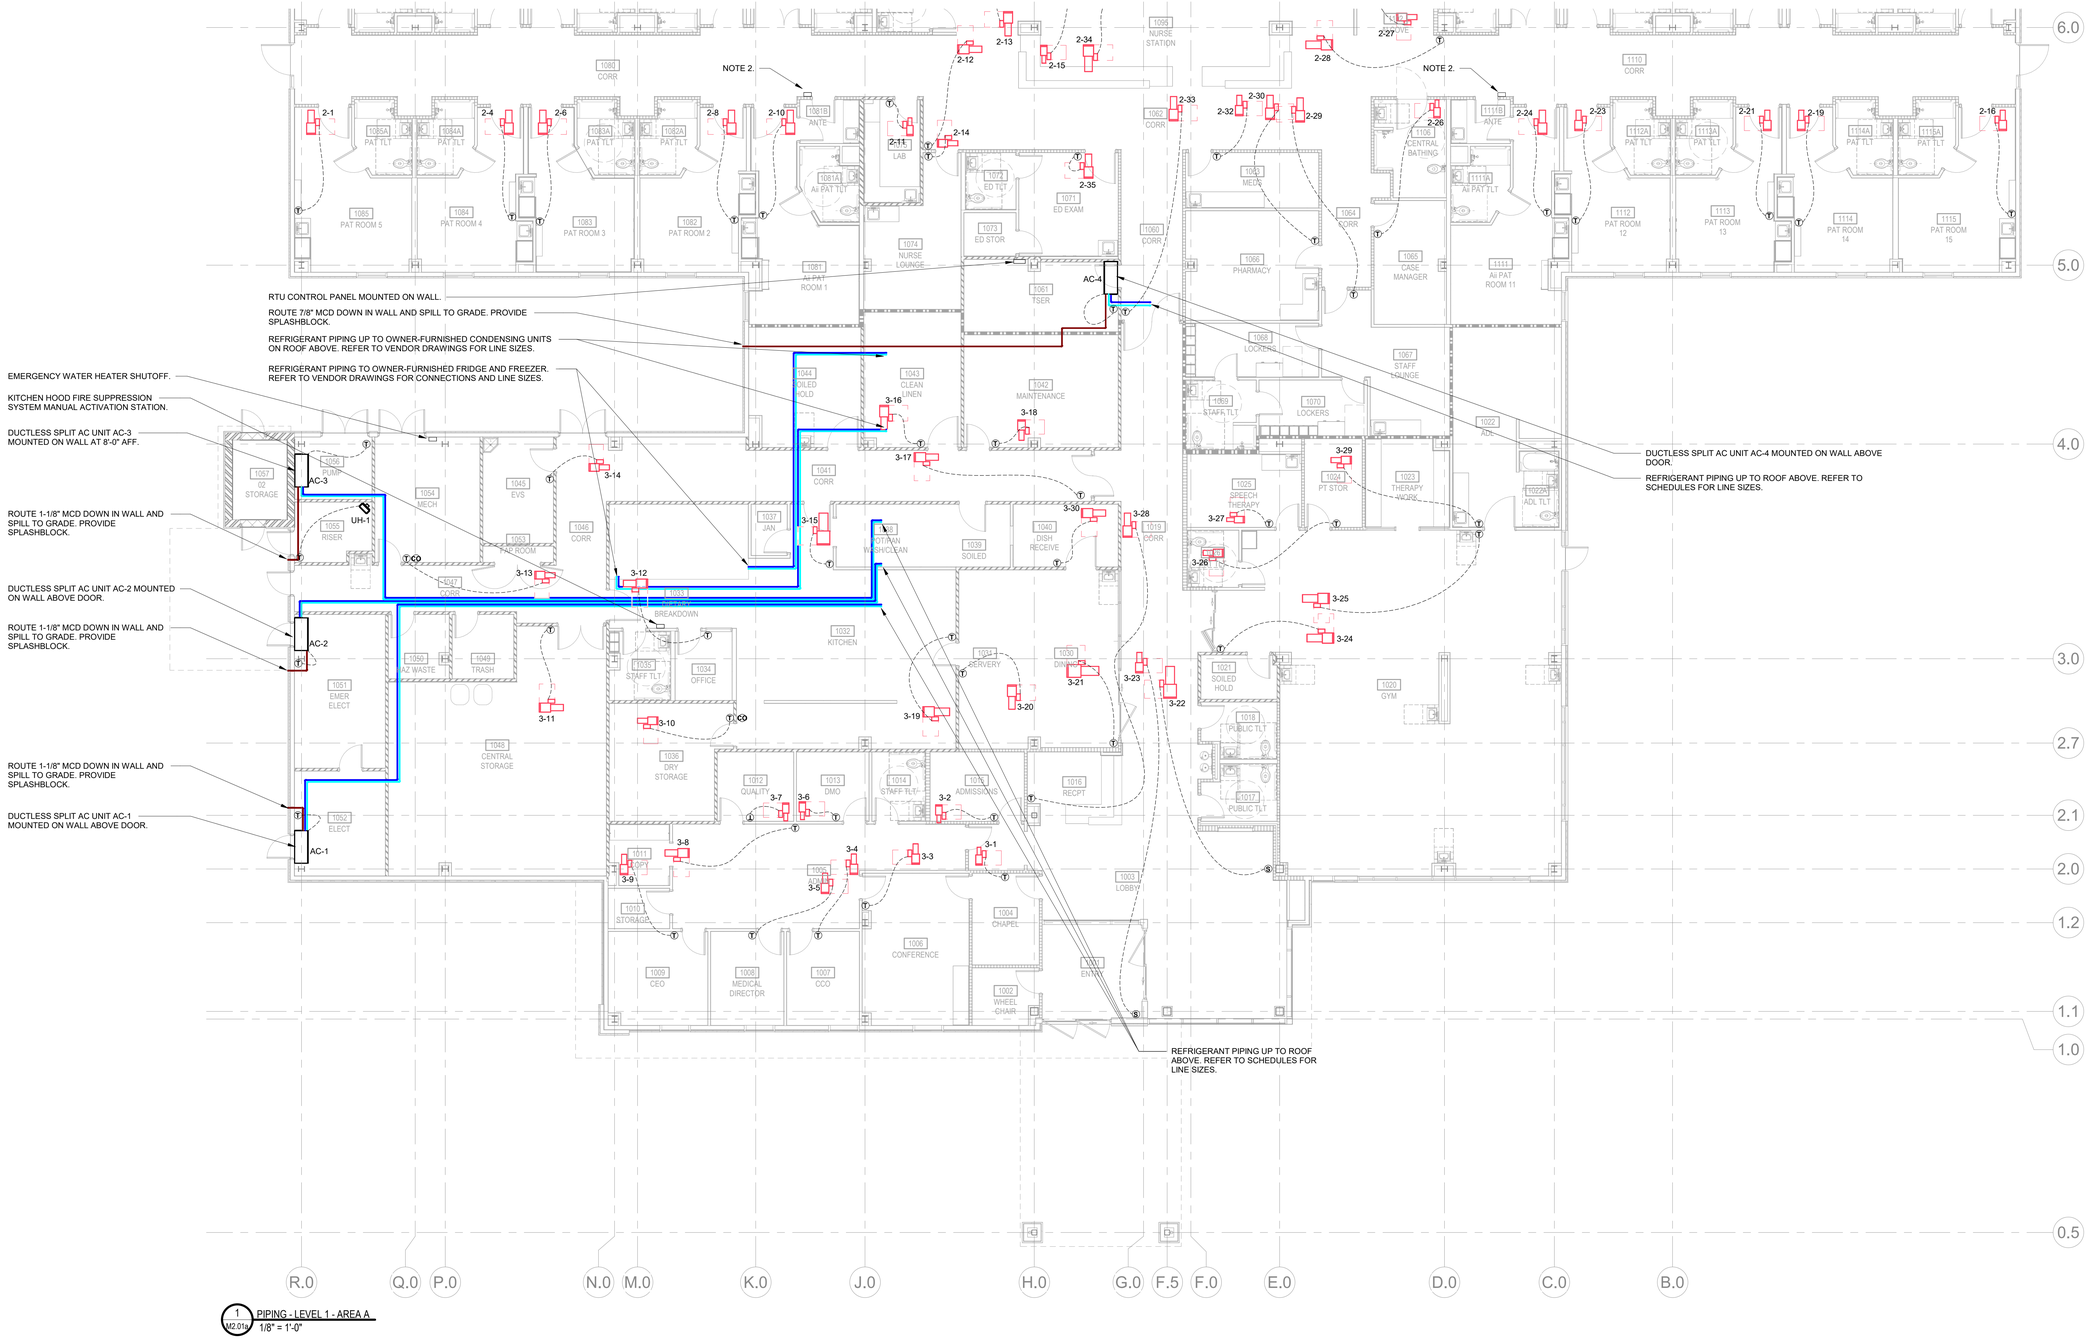

1. M2.01a PIPING - LEVEL 1 - AREA A
1/8" = 1'-0"

NEW CONSTRUCTION NOTES:

1. ALL DUCT AND PIPE TO BE INSTALLED AT A MINIMUM OF 6" CLEAR TO RATED WALLS TO ALLOW FOR INSPECTION OF PARTITION ASSEMBLIES. ALL UTILITIES SHALL BE LOCATED SO THAT ACCESS IS MAINTAINED TO ADJACENT WALL SURFACES AND TO ALL ACESS DOORS.
2. PROVIDE AUDIO/VISUAL ROOM PRESSURIZATION MONITOR FOR ISOLATION ROOM. ALARM SHALL BE INTEGRATED INTO BUILDING EMS. PRESSURE DIFFERENTIAL MINIMUM SET POINT TO BE 0.01".

TRUE NORTH
PROJECT NORTH

BUILDING ELEMENTS
- NON-RATED WALL
- PARTITION CONSTRUCTED TO RESIST THE PASSAGE OF SMOKE
- 1 HR FIRE RATED BARRIER
- 1 HR FIRE RATED SMOKE BARRIER (SMOKE COMPARTMENT WALL)

ENVIRONMENTS FOR HEALTH ARCHITECTURE
e4h
817.229.1917 | 801 Cherry St. Ste. 500, Fort Worth, TX 76102 | e4harchitecture.com

© 2025 E4H - Environments For Health, LLC

exalt health

RYAN

ICT
I.C. Thomasson Associates, Inc.
A Salas O'Brien Company
2950 Kraft Drive
Nashville, TN 37204
PHONE 615-346-3400
https://www.ictthomasson.com/
ICT Project No. 2545-02546

FIRM CERTIFICATE OF AUTHORIZATION: CA-1276

ELECTRICAL ENGINEER
FLORIDA REGISTRATION:
JOSHUA R. CARTWRIGHT, P.E. #71893

MECHANICAL ENGINEER
FLORIDA REGISTRATION:
ZACHARY N. McCOY, P.E. #93060

EXALT HEALTH 40 BED REHAB HOSPITAL - PANAMA CITY BEACH

2851 HWY 77
PANAMA CITY, FLORIDA 32405

PROJECT: H002125

Δ	DATE	DESCRIPTION

KEY PLAN:



NOT FOR CONSTRUCTION

ORIG SUBMISSION: 02/13/26
CURRENT:

SHEET TITLE AND NUMBER:

M2.01a

PIPING - LEVEL 1 - AREA A