

| PLUMBING FIXTURE SCHEDULE: | |
|----------------------------|--|
| OB-1 | PROVIDE A GUY GRAY MODEL FRIB12S FIRE RATED RECESSED SUPPLY BOX WITH WALL FLANGE OR EQUAL. FURNISH WITH 1/2" X 1/4" QUARTER TURN ANGLE VALVE. SUPPLY BOX DIMENSIONS TO BE A MAXIMUM 6" x 6". ON THE LEAVING SIDE OF THE VALVE, PROVIDE A 4 FOOT COIL OF ROLL TYPE "K" SOFT COPPER. MOUNT BOX BEHIND EQUIPMENT. COORDINATE MOUNTING HEIGHT WITH EQUIPMENT. CONTRACTOR TO MAKE THE FINAL CONNECTION TO THE ICE MAKER. |
| S-1 | PROVIDE AN AMERICAN STANDARD (RAVIV) MODEL 18DB000132C2.075 STAINLESS STEEL DOUBLE BOWL, TOP MOUNT SINK WITH PULL-DOWN FAUCET AND COLOR MATCHING SOAP DISPENSER OR EQUAL. SINK TO BE 18 GAUGE STAINLESS STEEL, 33"x22"x9" OVERALL. EACH BOWL SIZE = 14-9/16"x19-1/16"x9" DEEP, PUNCHED FOR 2 HOLES (CENTER AND RIGHT SIDE), AND POLISHED TO A SATIN FINISH. SINK TO COME COMPLETE WITH TWO ELKAY LK-35 STAINLESS STEEL DRAINS. INCLUDED PULL-DOWN FAUCET TO BE STAINLESS STEEL WITH SWIVEL SPOUT, SINGLE HANDLE, CERAMIC DISC, 1.8 GPM OUTLET HAVING SPRAY, STREAM AND PAUSE FEATURES. PROVIDE COLD WATER AND HOT WATER INLETS WITH 1/4 TURN ANGLE BALL STOPS WITH 1/2" IPS INLET AND 3/8" IPS OUTLET EQUAL TO BRASSCRAFT MODEL KTR19X. STOPS TO BE ALL BRASS WITH REMOVABLE HANDLE AND RATED FOR TEMPERATURES GREATER THAN 115 DEG F. PROVIDE STOPS WITH CHROME WALL ESCUTCHEONS AND STAINLESS STEEL FLEXIBLE SUPPLIES FROM STOPS TO FAUCET. PROVIDE CHROME PLATED DOUBLE BOWL DRAIN FITTING EQUAL TO ELKAY MODEL LK35 AND A CHROME PLATED 17 GAUGE 1-1/2" X 1-1/2" P-TRAP WITH CLEANOUT. |
| WHA | PROVIDE A WATTS MODEL LF15M2 WATER HAMMER ARRESTOR OR EQUAL. ARRESTOR TO BE PISTON OR BELLOWS TYPE, SUITABLE FOR DOMESTIC POTABLE WATER, PDI LISTED AND SIZED PER PDI RECOMMENDATIONS. |

| ABBREVIATIONS | |
|---------------|------------------------------------|
| AC | ABOVE CEILING |
| AFF | ABOVE FINISHED FLOOR |
| BF | BELOW FLOOR |
| CL | CEILING |
| CO | CLEANOUT |
| DCW | DOMESTIC COLD WATER |
| DHW | DOMESTIC HOT WATER |
| DN | DOWN |
| EWC | ELECTRIC WATER COOLER |
| EWH | ELECTRIC WATER HEATER |
| FCO | FLOOR CLEANOUT |
| FD | FLOOR DRAIN |
| FL | FLOOR |
| HB | HOSE BIBB |
| INV | INVERT |
| L | LAVATORY |
| MS | MOP SINK |
| NTS | NOT TO SCALE |
| S | SINK |
| ST | STORM |
| TMV | THERMOSTATIC MIXING VALVE |
| U | URINAL |
| V | VENT |
| VTR | VENT THROUGH ROOF |
| W | SANITARY WASTE INSIDE THE BUILDING |
| WC | WATER CLOSET |
| WHA | WATER HAMMER ARRESTOR |

| CODE REFERENCES | |
|------------------------|--|
| FBC, BUILDING | FLORIDA BUILDING CODE, 2023 EIGHTH EDITION |
| FBC, MECHANICAL | FLORIDA BUILDING CODE, 2023 EIGHTH EDITION |
| FBC, PLUMBING | FLORIDA BUILDING CODE, 2023 EIGHTH EDITION |
| FBC, TEST PROTOCOL | FLORIDA BUILDING CODE, 2023 EIGHTH EDITION |
| FBC, EXISTING BUILDING | FLORIDA BUILDING CODE, 2023 EIGHTH EDITION |
| FBC, ENERGY | FLORIDA BUILDING CODE, 2023 EIGHTH EDITION |
| FFPC | FLORIDA FIRE PREVENTION CODE, 2023 EIGHTH EDITION |
| NFPA 25 | STANDARD FOR THE INSPECTION, TESTING, AND MAINTENANCE OF WATER-BASED FIRE PROTECTION SYSTEMS, 2020 EDITION |
| NFPA 51B | STANDARD FOR FIRE PREVENTION DURING WELDING, CUTTING, AND OTHER HOT WORK, 2019 EDITION |
| NFPA 70 | NATIONAL ELECTRIC CODE, 2020 EDITION |
| NFPA 101 | LIFE SAFETY CODE, 2021 EDITION |
| NFPA 101A | GUIDE ON ALTERNATIVE APPROACHES TO LIFE SAFETY, 2019 EDITION |

| SYMBOLS LEGEND | |
|----------------|-------------------------|
| | 'DEMOLISH TO' SYMBOL |
| | 'CONNECT TO' SYMBOL |
| | PLUMBING FIXTURE TAG |
| | EXISTING DCW PIPING |
| | DCW PIPING |
| | DHW PIPING |
| | EXISTING WASTE PIPING |
| | WASTE PIPING |
| | EXISTING VENT PIPING |
| | VENT PIPING |
| | EXISTING STORM PIPING |
| | ITEMS TO BE DEMOLISHED |
| | PIPE BREAK |
| | PIPE TURNED UP |
| | PIPE TURNED DOWN |
| | BOTTOM PIPE TAP |
| | PIPE CAP |
| | FLOOR OR GRADE CLEANOUT |
| | DIRECTION OF FLOW |
| | BALL VALVE |
| | SQUARE FLOOR DRAIN/SINK |
| | ROUND FLOOR DRAIN/SINK |
| | WATER HAMMER ARRESTOR |

| GENERAL PLUMBING NOTES | |
|--|--|
| THESE GENERAL NOTES APPLY TO THE CONTRACTOR HOLDING THE GENERAL CONTRACT AS WELL AS ALL OTHER SUB CONTRACTORS AND AGENTS REQUIRED TO PERFORM WORK ON THIS PROJECT. | |
| 1 | TOMAHAWK ENGINEERING AND CONSULTING, INC. SHALL NOT BE HELD RESPONSIBLE FOR ANY MISUSE AND/OR MISREPRESENTATION OF THIS SET OF DOCUMENTS. |
| 2 | THE CONTRACTOR ASSUMES RESPONSIBILITY FOR USE OF THE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL MAKE HIMSELF AWARE OF PROJECT CONDITIONS AND OWNER REQUIREMENTS PRIOR TO PROCUREMENT OF EQUIPMENT AND SERVICES. CHANGES IN PROJECT COST WILL NOT BE GRANTED DUE TO FIELD CONFLICTS AND/OR PROJECT CONDITIONS. |
| 3 | THIS SET OF DRAWINGS AND SPECIFICATIONS SHALL NOT BE CONSIDERED A SET OF CONSTRUCTION DOCUMENTS UNLESS A SIGNATURE AND DATE ARE AFFIXED TO THE DRAWINGS AND SPECIFICATIONS BY THE ENGINEER IN RESPONSIBLE CHARGE FOR THE GIVEN DISCIPLINE. |
| 4 | CONFLICTS BETWEEN THIS SET OF DRAWINGS AND THE CONTRACT SPECIFICATIONS SHALL BE RESOLVED BY THE ENGINEER OF RECORD. THE CONTRACTOR DOES NOT HAVE THE AUTHORITY TO INTERPRET CONFLICTS AND RESOLVE ISSUES WITHOUT WRITTEN DIRECTION FROM THE ENGINEER OF RECORD. |
| 5 | ANY CONFLICTS IN THE FIELD OR WITHIN THESE DOCUMENTS SHALL BE RECORDED AND PROVIDED TO THE ENGINEER OF RECORD ON THE CONTRACTOR'S STANDARD LETTERHEAD. WRITTEN DIRECTION RESOLVING CONFLICT WILL BE ISSUED BY THE ENGINEER OF RECORD. |
| 6 | WHERE THE CONTRACTOR DEVIATES FROM THIS SET OF CONSTRUCTION DOCUMENTS AND RESUBMISSION OF REVISED DRAWINGS IS REQUIRED BY THE PERMITTING OFFICE/OFFICIAL, A MINIMUM CHARGE OF \$750.00 PER AFFECTED DRAWING SHEET WILL BE BILLED TO THE CONTRACTOR. THE REVISED DRAWINGS WILL NOT BE PROVIDED AND/OR SUBMITTED TO THE PERMIT OFFICE UNTIL A PURCHASE ORDER OR SIGNED AGREEMENT IS ISSUED BY THE CONTRACTOR TO THE DESIGN PROFESSIONAL FOR WORK REQUIRED. THIS SHALL NOT APPLY TO UNFORESEEN CONDITIONS OR CHANGES REQUIRED FOR THE PROJECT THAT ARE NOT INITIATED BY THE CONTRACTOR. |
| 7 | DRAWINGS ARE DIAGRAMMATIC IN NATURE. PIPING SIZES, PIPING INVERTS, EQUIPMENT DIMENSIONS, MOUNTING HEIGHTS AND GENERAL ARRANGEMENT SHALL BE FIELD MEASURED AND VERIFIED PRIOR TO PROCUREMENT. ALL FITTINGS MAY NOT BE SHOWN. THE PLUMBING CONTRACTOR SHALL PROVIDE ALL REQUIRED FITTINGS, TAPS FOR EXISTING SANITARY AND DOMESTIC PRESSURE PIPING, TRANSITIONS, FLEXIBLE CONNECTORS, VALVES, LABOR, OR ANY OTHER WORK INDICATED OR IMPLIED FOR A FULLY FUNCTIONAL SYSTEM. |
| 8 | WHERE APPLICABLE AND AVAILABLE, ACTUAL EQUIPMENT DRAWINGS ARE USED FOR SYMBOLS ON PLAN VIEWS AND IN DETAILS. HOWEVER, SIMPLE BLOCK DIAGRAMS WITH ESTIMATED DIMENSIONS ARE ALSO USED FOR PLAN VIEWS. WHERE EQUIPMENT OR DEVICES ARE NOT LABELED, INDUSTRY STANDARD TERMINOLOGY AND SYMBOLOGY SHALL APPLY. |
| 9 | THE CONTRACTOR SHALL MAKE HIS OR HERSELF AWARE OF THE OWNER'S SCHEDULE AND BE PREPARED TO WORK AT NIGHT OR ON WEEKENDS TO COMPLETE WORK SHOWN IN THESE DOCUMENTS. INTERRUPTIONS TO OWNER'S NORMAL WORK SCHEDULE SHALL NOT BE MADE WITHOUT WRITTEN INSTRUCTION TO DO SO FROM OWNER'S REPRESENTATIVE. |
| 10 | FOR EQUIPMENT DEMOLISHED UNDER THIS CONTRACT, THE CONTRACTOR SHALL ALLOW THE OWNER FIRST REFUSAL OF DEMOLITION EQUIPMENT. IF EQUIPMENT IS REFUSED, THE CONTRACTOR SHALL DISPOSE OF DEMOLISHED EQUIPMENT IN ACCORDANCE WITH THE AUTHORITY HAVING JURISDICTION. IN ADDITION, FOR EQUIPMENT INDICATED TO BE DEMOLISHED, THE CONTRACTOR SHALL ASSUME THAT THIS ALSO REQUIRES DEMOLITION OF ALL ASSOCIATED APPURTENANCES INCLUDING ELECTRICAL CONNECTIONS, CONTROLS CONNECTIONS, ETC. |
| 11 | THE CONTRACTOR SHALL FURNISH ALL LABOR, MATERIAL, AND EQUIPMENT REQUIRED TO PROVIDE THE OWNER WITH A COMPLETE, FULLY OPERATIONAL SYSTEM. WORK AND COMPONENTS NOT INDICATED BUT IMPLIED SHALL BE PROVIDED AND BE PART OF THE CONTRACT. THE CONTRACTOR SHALL GUARANTY ALL LABOR AND EQUIPMENT ASSOCIATED WITH PROJECT FOR A MINIMUM OF 1-YEAR. |
| 12 | THE CONTRACTOR SHALL PROVIDE ALL CORES AND SAW CUTS FOR WALLS AND FLOORS AS REQUIRED TO INSTALL PIPING AND SERVICES AS INDICATED ON THESE DOCUMENTS. WHERE BUILDING SERVICES PENETRATE EXTERIOR WALL, SLEEVE AND SEAL WATER AND WEATHER TIGHT. THE CONTRACTOR SHALL MAKE THEMSELVES FAMILIAR WITH THE BUILDING SITE PRIOR TO PROVIDING A BID. EXTRAS FOR NOT FULLY UNDERSTANDING THE EXISTING CONDITIONS OR THIS SET OF DOCUMENTS WILL NOT BE GIVEN. |
| 13 | WORK SHALL CONFORM TO THE FLORIDA BUILDING CODE, 2017 AND ANY OTHER APPLICABLE STATE, LOCAL, AND/OR FEDERAL CODES AND LAWS. |
| 14 | THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL REQUIRED PERMITS AND INSPECTIONS AND IS ALSO RESPONSIBLE FOR ALL ASSOCIATED FEES FOR SAID PERMITS AND INSPECTIONS. |
| 15 | SOME PIPING MAY BE LOCATED IN WALLS THAT ARE NOT ACCESSIBLE. THE CONTRACTOR SHALL INCLUDE IN THEIR COSTS, THE CUTTING AND PATCHING OF WALLS TO ACCESS PIPING AS REQUIRED TO MAKE TIE-INS AS INDICATED HEREIN. |
| 16 | THE CONTRACTOR IS RESPONSIBLE FOR THE ENTIRE SITE DURING CONSTRUCTION ACTIVITIES. AS SUCH, THE CONTRACTOR SHALL PROVIDE ALL NECESSARY PROTECTIONS AS REQUIRED BY LAW OR OWNER REQUIREMENTS. ANY DAMAGE DONE BY THE CONTRACTOR OR SUB OF SAID CONTRACTOR SHALL BE REPAIRED AT NO COST TO THE OWNER. THIS INCLUDES, BUT IS NOT LIMITED TO, ALL BUILDING CONSTRUCTION AND ALL EQUIPMENT LOCATED WITHIN THE BUILDING OR ON SITE PREMISES. |
| 17 | WORK SHALL BE CARRIED OUT IN A NEAT WORKMAN LIKE MANNER. ALL CONSTRUCTION DEBRIS SHALL BE CLEANED UP AT THE END OF EVERY WORK DAY AND ALL CONSTRUCTION DUST SHALL BE VACUUMED UP AT THE END OF EVERY WORK DAY. |
| 18 | UNLESS NOTED OTHERWISE, ALL MATERIALS, EQUIPMENT, PIPING, FIXTURES, WIRING, CABLING, AND OTHER DEVICES REQUIRED FOR COMPLETION OF PROJECT SHALL BE NEW. |
| 19 | IN GENERAL, ITEMS SHOWN ON DRAWINGS LIGHTLY COMPARED TO OTHER COMPONENTS ARE EXISTING, WHERE ITEMS ARE NOT INDICATED EXPLICITLY TO BE DEMOLISHED, IT SHALL BE ASSUMED THAT THEY ARE TO REMAIN. |
| 20 | (2) COPIES OF OPERATION AND MAINTENANCE MANUALS FOR MATERIALS AND EQUIPMENT SHALL BE PROVIDED TO THE OWNER AT PROJECT COMPLETION. |
| 21 | THE CONTRACTOR AND ALL SUBCONTRACTORS ARE RESPONSIBLE FOR EXAMINING DRAWINGS (ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL, STRUCTURAL AND CIVIL) AND ACTUAL SITE CONDITIONS PRIOR TO SUBMITTING BIDS. EXTRAS WILL NOT BE GIVEN DUE TO FAILURE TO UNDERSTAND ALL CONDITIONS INVOLVED OR DISCREPANCIES BETWEEN ACTUAL DIMENSIONS AND CONDITIONS AND DIMENSIONS AND CONDITIONS INDICATED ON PLANS. WORK SHALL BE MODIFIED AND PROVIDED AS REQUIRED BY FIELD CONDITIONS AND THIS ADDITIONAL WORK SHALL BE CARRIED OUT AT NO COST TO THE OWNER. |
| 22 | EQUIPMENT AND FIXTURES SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S WRITTEN INSTRUCTIONS AND STANDARD INDUSTRY PRACTICES. WHERE DISCREPANCIES BETWEEN CONTRACT DRAWINGS AND MANUFACTURER'S REQUIREMENTS ARISE, REQUEST CLARIFICATION FROM ENGINEER. |
| 23 | PRIOR TO START-UP, PERFORM MANUFACTURER'S START-UP AND CHECKOUT PROCEDURES AND ATTACH FORMS TO OPERATION AND MAINTENANCE MANUALS. |
| 24 | WHERE BUILDING SERVICES ARE DEMOLISHED, PATCH AND PAINT OPENINGS TO MATCH EXISTING CONSTRUCTION AND NEW FINISHES. |
| 25 | PROVIDE ACCESS DOORS FOR EQUIPMENT, DAMPERS, ETC. LOCATED ABOVE GYPSUM CEILINGS OR WITHIN WALLS REQUIRING ACCESS. DOOR SIZES SHALL SUIT EQUIPMENT SERVED. |
| 26 | TRAP PRIMERS TO BE PROVIDED ON ALL FLOOR DRAINS AND WHERE INDICATED ON FLOOR SINKS. |
| 27 | REFER TO DETAILS AND VENDOR DRAWINGS FOR FURTHER INFORMATION REGARDING INSTALLATION AND CONNECTION OF VENDOR PROVIDED EQUIPMENT. CONTRACTOR SHALL PROVIDE ALL COMPONENTS REQUIRED FOR A FULLY FUNCTIONAL, LEAK FREE INSTALLATION. |

| WATER HEATER SCHEDULE | | | | | | | | | | | |
|-----------------------|---|---------------------------|----------------------------|------------|----------|--------------------------------|----------------------|--------------|-----------|-------------|-------|
| EQUIPMENT NO. | MODEL NO. | FUEL SUPPLY (GAS OR ELEC) | STORAGE CAPACITY (GALLONS) | INPUT BTUH | INPUT KW | RECOVERY @ 60°F RISE (GALLONS) | TEMP. RISE @ 1.0 GPM | SET TEMP. °F | MIN. EFF. | VOLTS-PHASE | NOTES |
| EWH-119 | SPEX8208T | ELEC | - | - | 8.3 | - | 57°F | 120 | 99% | 208V-1Ø | 1,2,3 |
| NOTES: | | | | | | | | | | | |
| 1. | BASIS OF DESIGN: EEMAX | | | | | | | | | | |
| 2. | MOUNT WATER HEATER BELOW SINK. | | | | | | | | | | |
| 3. | UNIT TO COME COMPLETE WITH DIGITAL TEMPERATURE CONTROL. | | | | | | | | | | |

| | |
|-----------|------------|
| DATE: | |
| REVISION: | |
| NO.: | |
| DATE: | |
| NO.: | |
| DATE: | 12/16/2025 |
| NO.: | WHT |
| DATE: | 03/06/2026 |
| NO.: | WHT |

PHASE: CONCEPT SCHEM DESIGN
 ADVANCED SCHEM DESIGN
 DESIGN DEVELOP. DDOS, TIE
 75% CONSTRUCTION DDOS, TIE
 PERMIT DDOS, TIE
 100% CONSTRUCTION DDOS, TIE

Client: Florida State University
 Tallahassee, Florida

Job Title: Parking Garage 1 Remodeling
 - Phase 2

1940 Buford Boulevard
 Tallahassee, FL 32308
 Phone: 850-402-3040
 Fax: 850-402-9659
 WWW.TOMAHAWK-ENGINEERING.COM
 AUTHORIZED BY THE BOARD OF PROFESSIONAL ENGINEERS AND SURVEYORS OF THE STATE OF FLORIDA
 PROFESSIONAL ENGINEER AND SURVEYOR
 LICENSE NO. 65705
 EXPIRES 02-28-27

Consultant: TOMAHAWK ENGINEERING AND CONSULTING, INC.
 Tomahawk Project #: 25042
 Project #: 19370.42
 Phase: 100% Construction Documents


Seal: RICHARD LINDBURG
 PE# 62829
 WESLEY H. THIGPEN, JR.
 LICENSE No. 65705
 STATE OF FLORIDA
 EXPIRES 02-28-27
 PROFESSIONAL ENGINEER
 PE# 65705
 WESLEY THIGPEN, JR.

Architects Lewis + Whitlock
 206 West Virginia St.
 Tallahassee, Florida 32301
 850.942.1718
 www.think3d.net

Description:
Legend, Notes & Schedules - Plumbing

Sheet No.:
P0.1

**Corridor
3004**

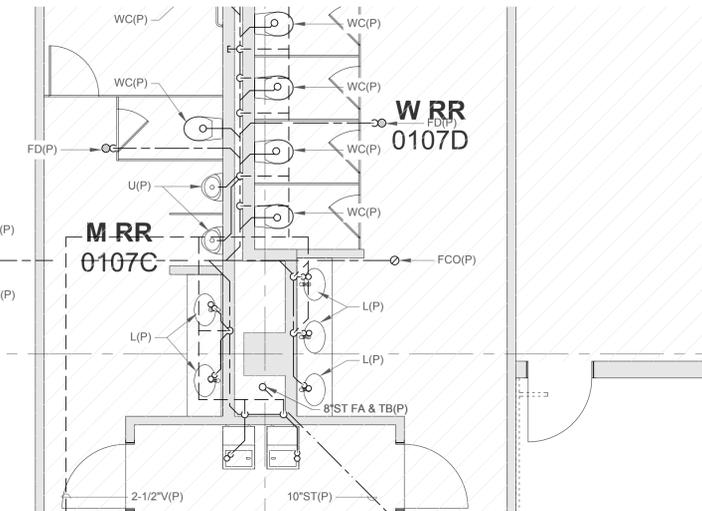

**Existing
Mechanical**

1:12.71

1:11.86

1 Partial Floor Plan - Demolition - Gravity Plumbing
SCALE: 1/4" = 1'-0"



| PHASE: | DRAWN: | REVIEWED: | DATE: | ID: | REVISION: | DATE: |
|-------------------------|--------|-----------|------------|-----|-----------|-------|
| CONCEPT SCHEM DESIGN | | | | | | |
| ADVANCED SCHEM DESIGN | | | | | | |
| DESIGN DEVELOP. DOCS. | TKE | WHT | 12/16/2025 | | | |
| 75% CONSTRUCTION DOCS. | | | | | | |
| PERMIT DOCS. | | | | | | |
| 100% CONSTRUCTION DOCS. | | | | | | |

Client: **Florida State University**
Tallahassee, Florida

Job Title: **Parking Garage 1 Remodeling**
- Phase 2

1940 Buford Boulevard
Tallahassee, FL 32308
Phone: 850-402-3040
Fax: 850-402-9659

TOMAHAWK
ARCHITECTURE & CONSULTING, P.C.

COA #: 29709
Tomahawk Project #: 25042
Project #: **19370.42**
Phase: **100% Construction Documents**

RICHARD LINDBURG
PE#: 62829

WESLEY H. THIGPEN, JR.
LICENSE
No. 65705
STATE OF
FLORIDA
EXPIRES
02-28-27
PROFESSIONAL ENGINEER


Seal: PE# 65705
WESLEY THIGPEN, JR.

ALW

Architects Lewis + Whitlock
206 West Virginia St.
Tallahassee, Florida 32301
850.942.1718
www.think3d.net

Description:
**Partial Floor Plan -
Demolition - Gravity
Plumbing**


Sheet No.:
PD1.1

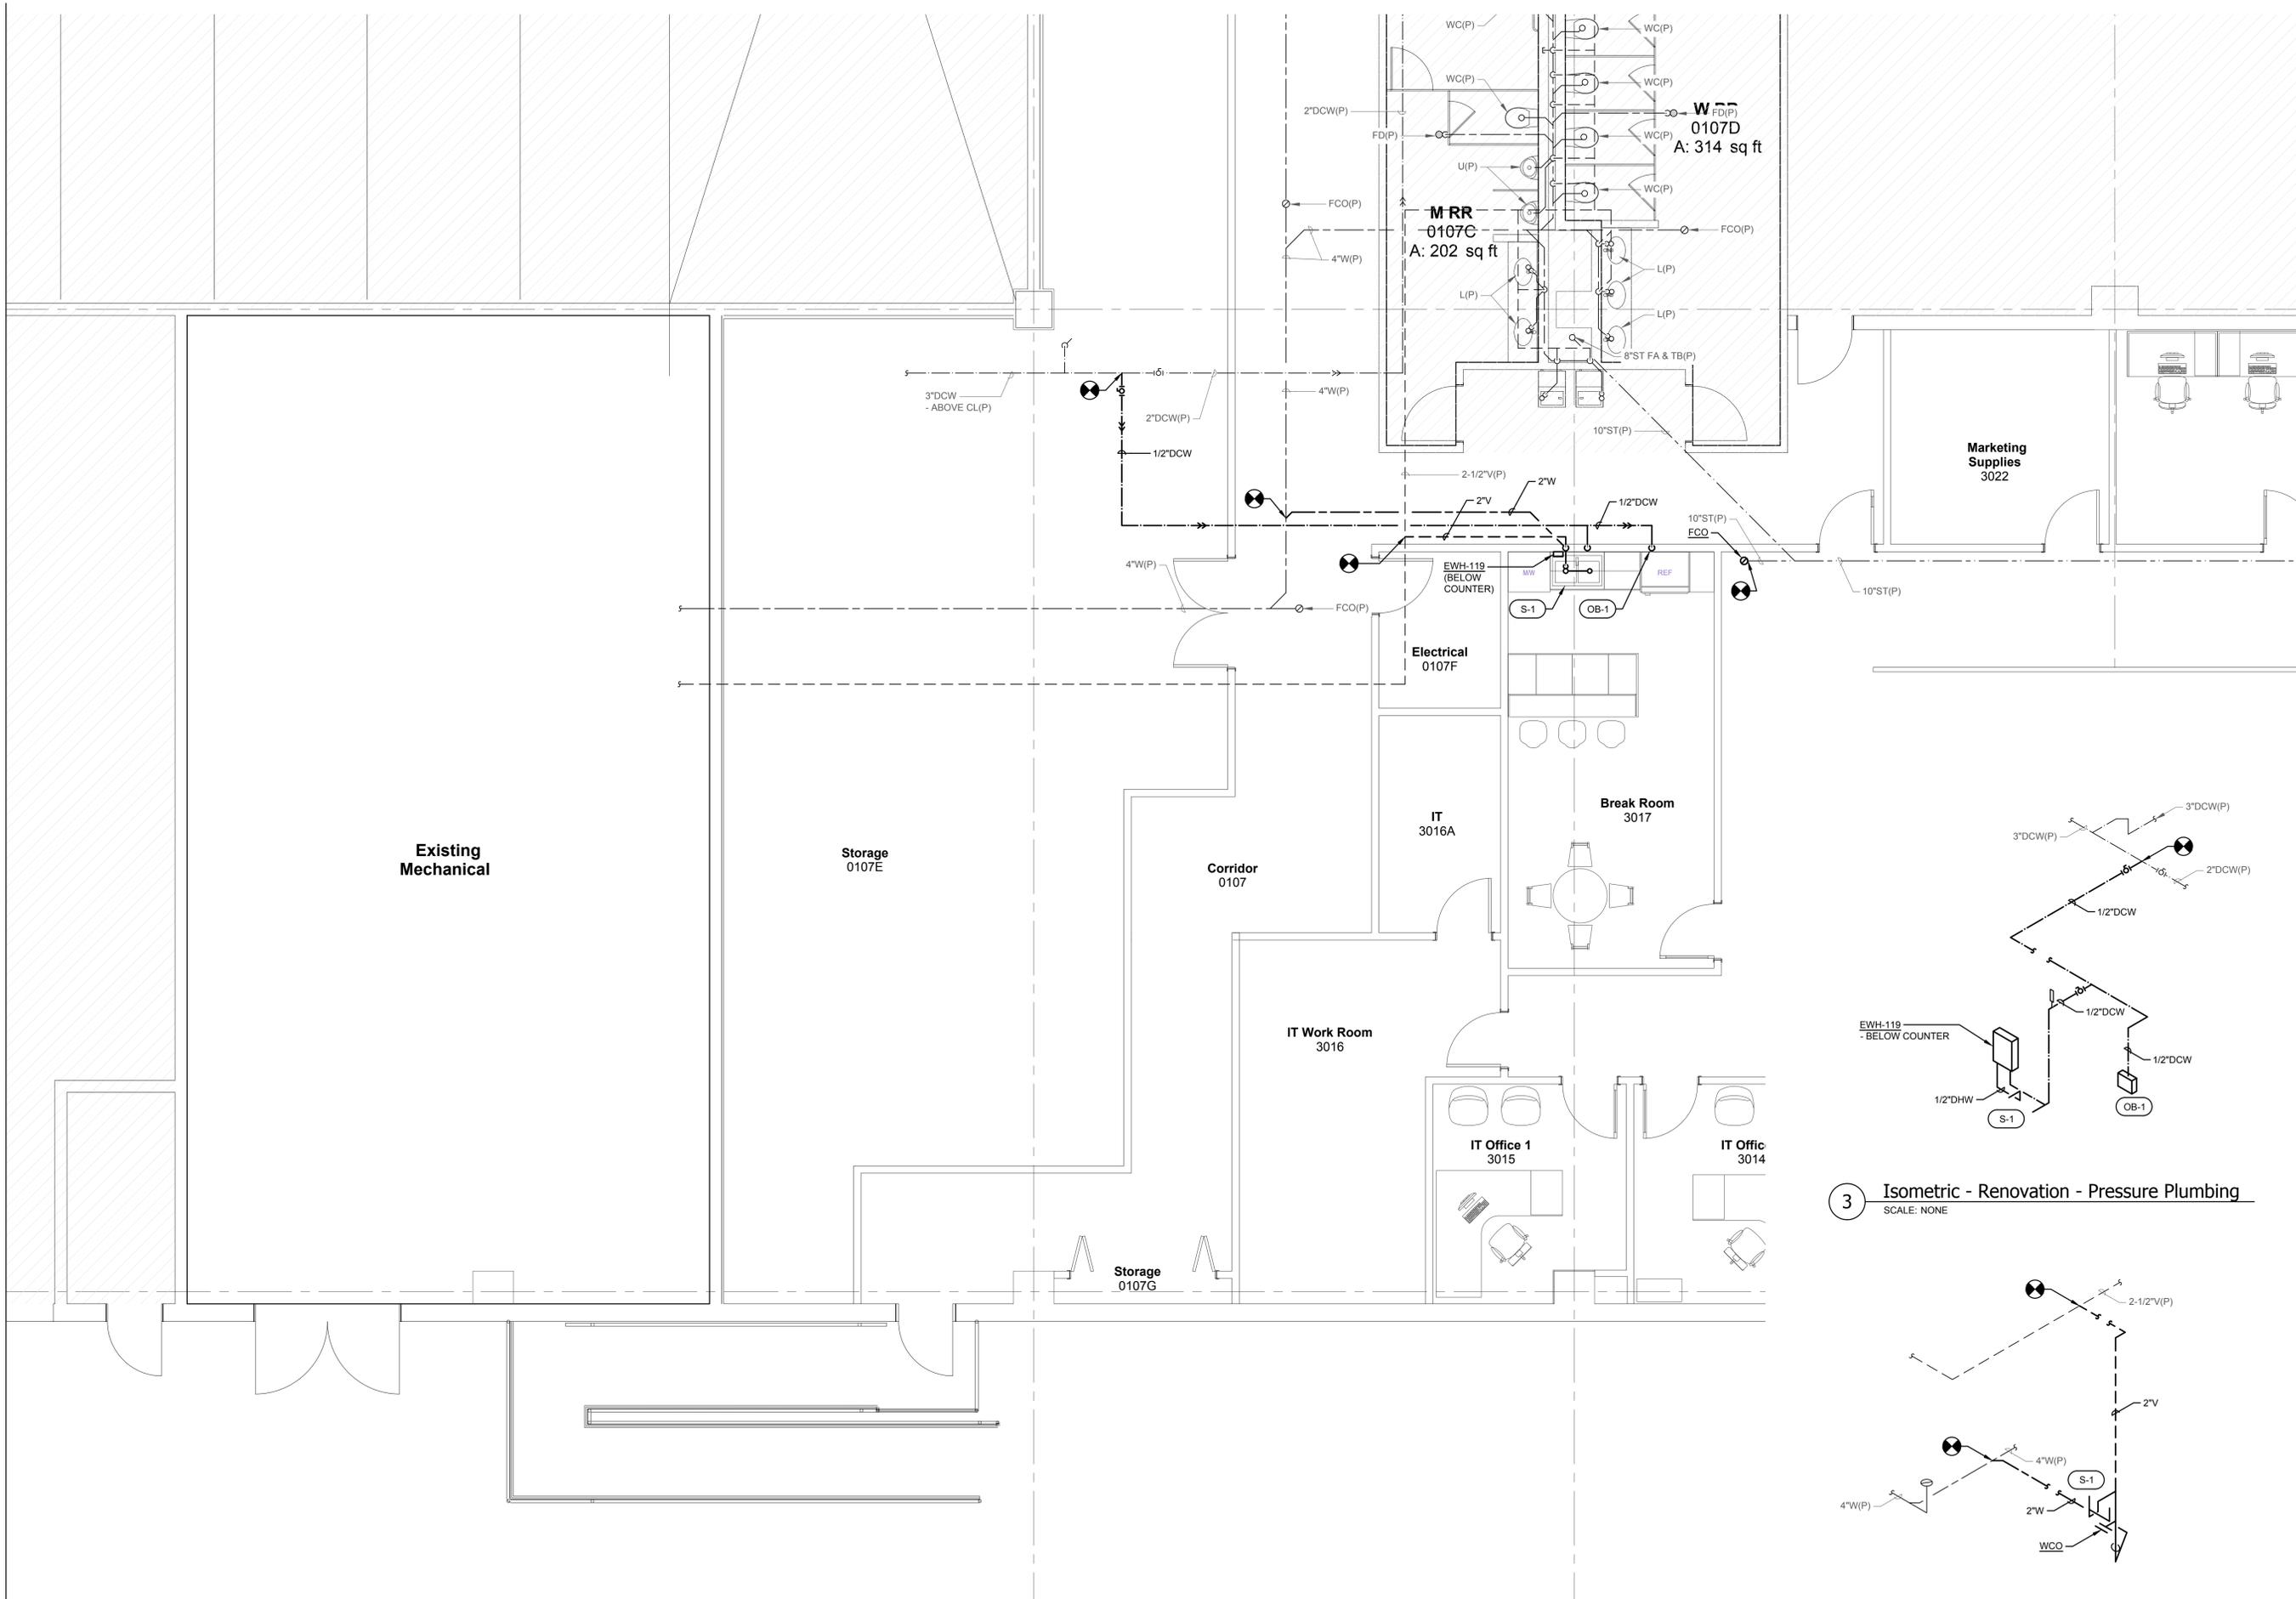

1 Partial Floor Plan - Renovation - Plumbing
SCALE: 1/4" = 1'-0"



3 Isometric - Renovation - Pressure Plumbing
SCALE: NONE

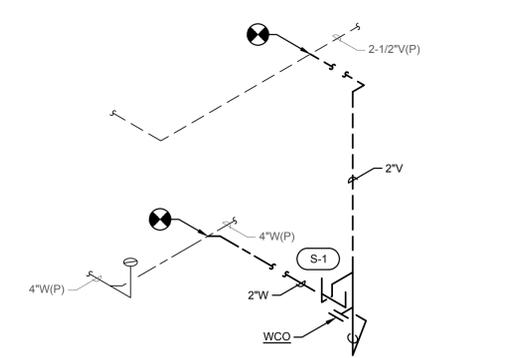

2 Isometric - Renovation - Gravity Plumbing
SCALE: NONE



| PHASE: | DRAWN: | REVIEWED: | DATE: | ID: | REVISION: | DATE: |
|-------------------------|--------|-----------|------------|-----|-----------|-------|
| CONCEPT SCHEM DESIGN | | | | | | |
| ADVANCED SCHEM DESIGN | | | | | | |
| DESIGN DEVELOP. DOCS. | TKE | WHT | 12/16/2025 | | | |
| 75% CONSTRUCTION DOCS. | | | | | | |
| PERMIT DOCS. | | | | | | |
| 100% CONSTRUCTION DOCS. | | | | | | |

Client: **Florida State University**
Tallahassee, Florida

Job Title: **Parking Garage 1 Remodeling - Phase 2**

1940 Buford Boulevard
Tallahassee, FL 32308
Phone: 850-402-3040
Fax: 850-402-9659

TOMAHAWK
ARCHITECTURE & CONSULTANTS, P.C.

Consultant:
COA #: 29709
Tomahawk Project #: 25042
Project #: **19370.42**
Phase: **100% Construction Documents**

RICHARD LINDBURG
PE#: 62829

WESLEY H. THIGPEN, JR.
LICENSE
No. 65705
STATE OF FLORIDA
EXPIRES 02-28-27
PROFESSIONAL ENGINEER

Seal: PE#: 65705
WESLEY THIGPEN, JR.


ALW

Architects Lewis + Whitlock
206 West Virginia St.
Tallahassee, Florida 32301
850.942.1718
www.think3d.net

Description:
Partial Floor Plan & Isometrics - Renovation - Plumbing


Sheet No.: **P1.1**

THESE DRAWINGS AND RENDERINGS ARE INSTRUMENTS OF SERVICE. THE DRAWINGS AND ASSOCIATED COPIES THEREOF, INCLUDING ELECTRONIC MEDIA AND CAD FILES, ARE THE PROPERTY OF ARCHITECTS LEWIS + WHITLOCK, P.A. THEIR USE, REPRESENTATION OR REPRODUCTION FOR ANY PURPOSE EXCEPT BY WRITTEN AGREEMENT WITH THE ARCHITECT IS PROHIBITED. THIS COPYRIGHT NOTICE SHALL BE TRUE AS IF DIRECTLY PLACED ON EACH DRAWING OR INSTRUMENT ON THIS DOCUMENT AND SHALL NOT BE REMOVED FROM THESE DOCUMENTS.

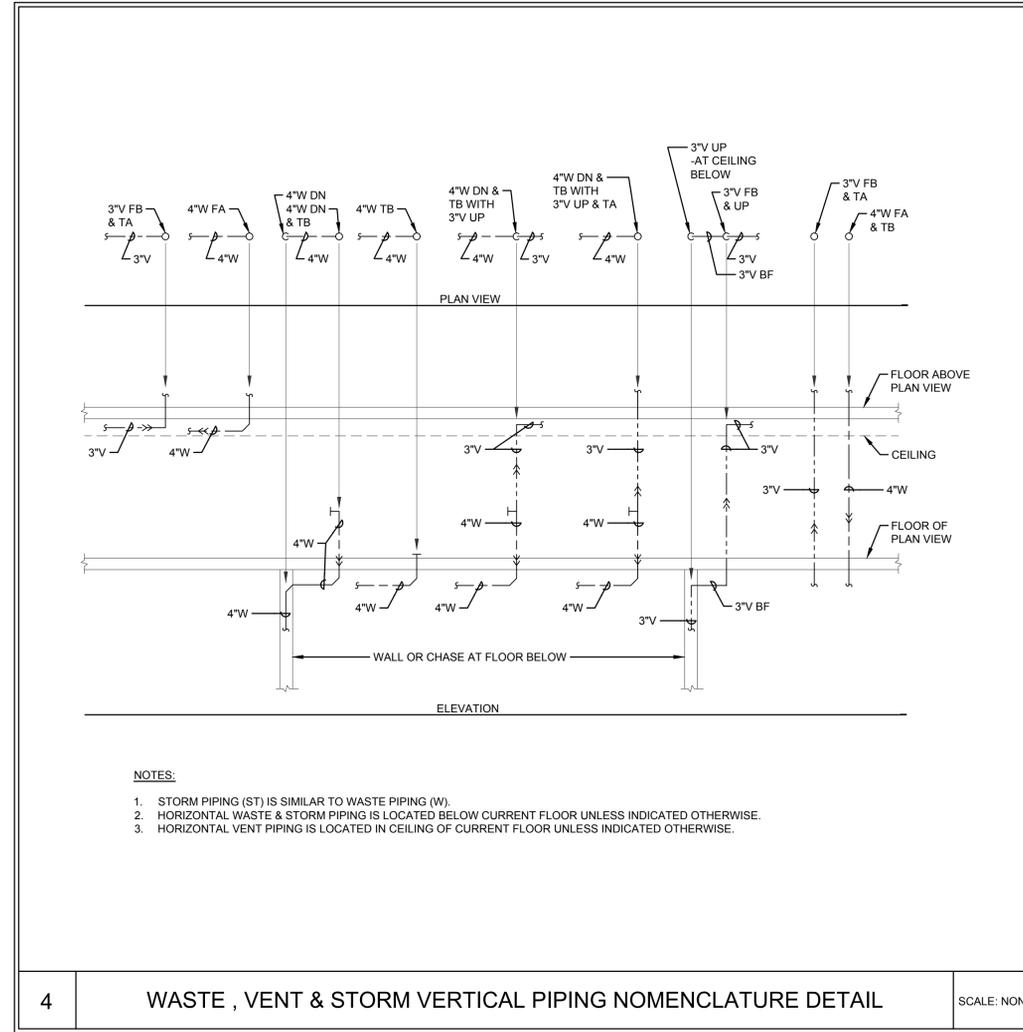


4 WASTE , VENT & STORM VERTICAL PIPING NOMENCLATURE DETAIL

SCALE: NONE

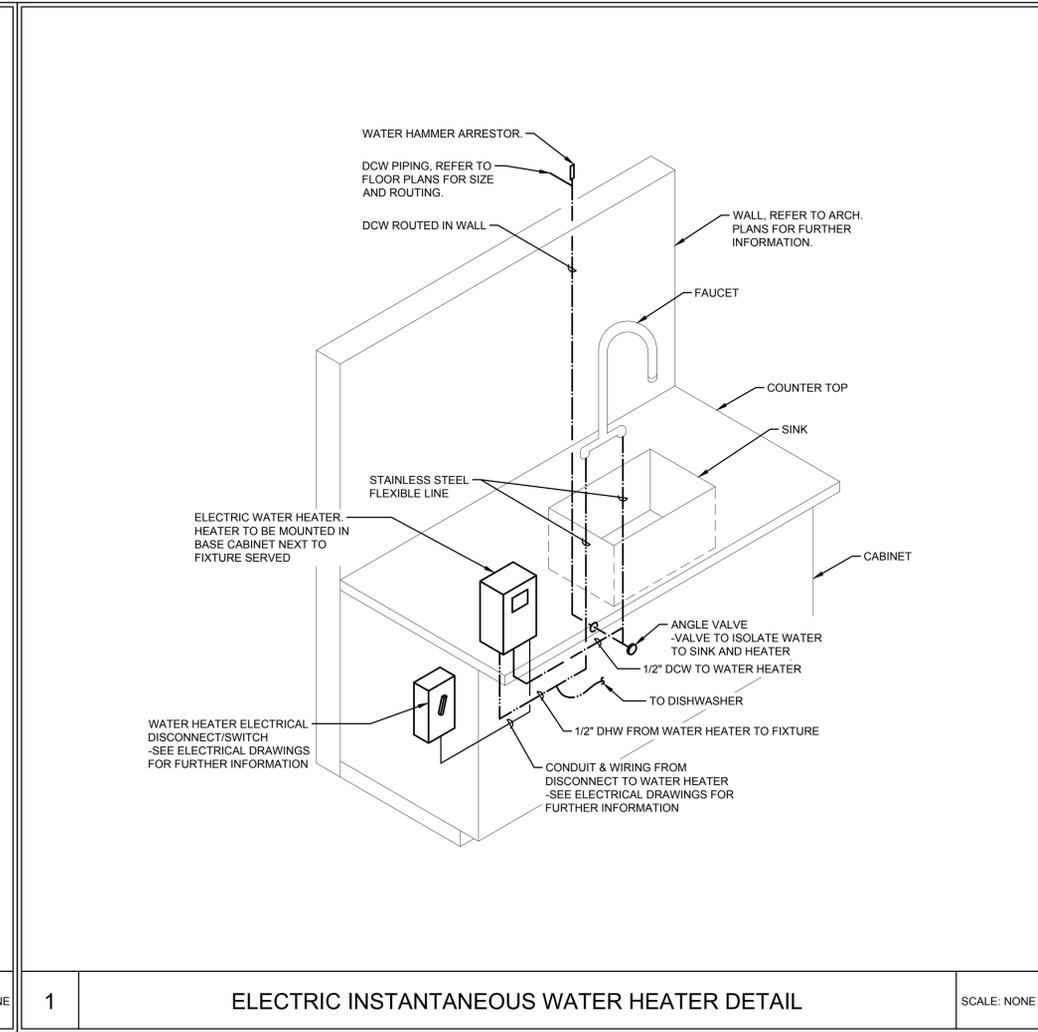


1 ELECTRIC INSTANTANEOUS WATER HEATER DETAIL

SCALE: NONE

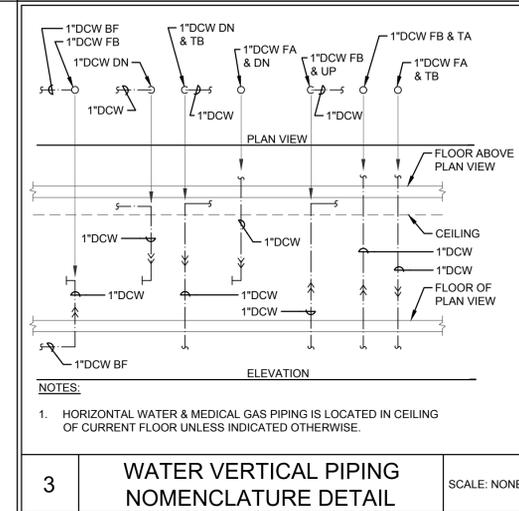

3 WATER VERTICAL PIPING NOMENCLATURE DETAIL

SCALE: NONE

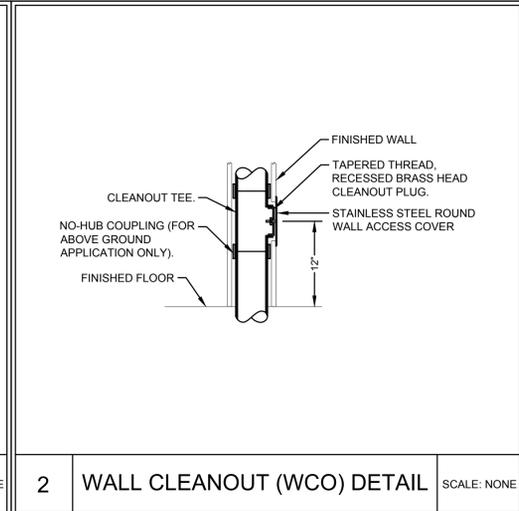

2 WALL CLEANOUT (WCO) DETAIL

SCALE: NONE

| PHASE: | DRAWN: | REVIEWED: | DATE: | ID: | REVISION: | DATE: |
|------------------------|--------|-----------|------------|-----|-----------|-------|
| CONCEPT SCHEM DESIGN | | | | | | |
| ADVANCED SCHEM DESIGN | | | | | | |
| DESIGN DEVELOP. DDOS | TKE | WHT | 12/16/2025 | | | |
| 75% CONSTRUCTION DDOS | | | | | | |
| PERMIT DDOS | | | | | | |
| 100% CONSTRUCTION DDOS | TKE | WHT | 03/06/2026 | | | |

Client: **Florida State University**
Tallahassee, Florida

Job Title: **Parking Garage 1 Remodeling**
- Phase 2

1940 Buford Boulevard
Tallahassee, FL 32308
Phone: 850-402-3040
Fax: 850-402-9659
www.tomahawk-engineering.com
CONSULTANTS IN THE DESIGN AND CONSTRUCTION OF
MECHANICAL, ELECTRICAL, PLUMBING, AND
FIRE PROTECTION SYSTEMS FOR BUILDINGS AND
INDUSTRIAL FACILITIES.
PROVIDED BY: RICHARD LINDBURG, PE
DATE: 02/28/25
SCALE: AS SHOWN UNLESS OTHERWISE NOTED

Consultant:
TOMAHAWK
ENGINEERING & CONSTRUCTION, INC.
COA #: 29709
Tomahawk Project #: 25042
Project #: **19370.42**
Phase: **100% Construction**
Documents

RICHARD LINDBURG
PE#: 62829

WESLEY H. THIGPEN, JR.
LICENSE
No. 65705
STATE OF
FLORIDA
EXPIRES
02-28-27
PROFESSIONAL ENGINEER

Seal: PE#: 65705
WESLEY THIGPEN, JR.

ALW

Architects Lewis + Whitlock
206 West Virginia St.
Tallahassee, Florida 32301
850.942.1718
www.think3d.net

Description:
Details - Plumbing

Sheet No.:
P5.1