PROJECT NO.: FTFA 21-JR05

SPEC NO. AE23
DRAWING NO. AE23

SPECIFICATIONS

FOR

PZIOCB / DSN-Temporary Facility for 350th SWW
EGLIN AFB, FL

96TH CIVIL ENGINEERING GROUP

14 APRIL 2023

(FINAL SUBMITTAL)

VOLUME I OF II

HEFFERNAN HOLLAND MORGAN
ARCHITECTURE
312 SOUTH ALCANIZ STREET, PENSACOLA, FLORIDA 32502
(850) 433-2799 (850) 433-3109
www.hhma.com

PROJECT NO.: FTFA 21-JR05

SPEC NO. AE23
DRAWING NO. AE23

SPECIFICATIONS

FOR

PZIOCB / DSN-Temporary Facility for 350th SWW
EGLIN AFB, FL

96TH CIVIL ENGINEERING GROUP

14 APRIL 2023

(FINAL SUBMITTAL)

VOLUME II OF II

HEFFERNAN HOLLAND MORGAN
ARCHITECTURE
312 SOUTH ALCANIZ STREET, PENSACOLA, FLORIDA 32502
(850) 433-2799 (850) 433-3109
www.hhma.com

PROJECT TABLE OF CONTENTS

DIVISION 01 - GENERAL REQUIREMENTS

01 11 00	08/11	SUMMARY OF WORK
01 14 00	05/11	WORK RESTRICTIONS
01 33 00	05/11	SUBMITTAL PROCEDURES
01 35 26	02/10	GOVERNMENTAL SAFETY REQUIREMENTS
01 42 00	02/19	SOURCES FOR REFERENCE PUBLICATIONS
01 45 00.00 10	02/10	QUALITY CONTROL
01 50 00	08/09	TEMPORARY CONSTRUCTION FACILITIES AND CONTROLS
01 54 00	07/01	AFFIRMATIVE PROCUREMENT
01 57 19	03/20	TEMPORARY ENVIRONMENTAL CONTROLS - EGLIN STANDARD
01 74 19	01/07	CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT
01 78 00	05/19, CHG 1: 08/21	CLOSEOUT SUBMITTALS
01 78 23	08/15, CHG 2: 08/21	OPERATION AND MAINTENANCE DATA
01 91 00.15 10	05/19, CHG 2: 08/20	TOTAL BUILDING COMMISSIONING

DIVISION 02 - EXISTING CONDITIONS

02 41 00		DEMOLITION

DIVISION 03 - CONCRETE

03 30 00	02/19, CHG 3: 11/21	CAST-IN-PLACE CONCRETE

DIVISION 04 - MASONRY

04 20 00	11/15, CHG 2: 05/19	UNIT MASONRY

DIVISION 06 - WOOD, PLASTICS, AND COMPOSITES

06 10 00	08/16	ROUGH CARPENTRY
06 41 16.00 10	08/10	LAMINATE CLAD ARCHITECTURAL CASEWORK
06 61 16	08/10	SOLID SURFACING FABRICATIONS

DIVISION 07 - THERMAL AND MOISTURE PROTECTION

07 21 16	11/11	MINERAL FIBER BLANKET INSULATION
07 24 00	05/11, CHG 4: 08/18	EXTERIOR INSULATION AND FINISH SYSTEMS
07 54 19	02/13, CHG 3: 02/21	POLYVINYL-CHLORIDE ROOFING
07 60 00	08/08	FLASHING AND SHEET METAL
07 61 14.00 20	05/11	STEEL STANDING SEAM ROOFING
07 92 00	08/16	JOINT SEALANTS

DIVISION 08 - OPENINGS

08 11 13	02/10	STEEL DOORS AND FRAMES
08 33 23	08/15	OVERHEAD COILING DOORS
08 34 73	02/15	SOUND CONTROL DOOR ASSEMBLIES
08 41 13	11/16	ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS
08 51 13	05/19	ALUMINUM WINDOWS
08 71 00	08/08	DOOR HARDWARE
08 81 00	05/19	GLAZING

DIVISION 09 - FINISHES

09 06 00	05/09, CHG 1: 11/13	SCHEDULES FOR FINISHES
09 22 00	02/10	SUPPORTS FOR PLASTER AND GYPSUM BOARD
09 29 00	05/11	GYPSUM BOARD
09 30 10	08/20	CERAMIC, QUARRY, AND GLASS TILING
09 51 00	08/10	ACOUSTICAL CEILINGS
09 62 38	08/17, CHG 1: 08/18	STATIC-CONTROL FLOORING
09 65 00	08/10, CHG 3: 08/18	RESILIENT FLOORING
09 68 00	11/17, CHG 2: 08/20	CARPETING
09 84 20	08/16, CHG 1: 08/18	ACOUSTICAL WALL PANELS
09 90 00	05/11	PAINTS AND COATINGS

DIVISION 10 - SPECIALTIES

10 14 00.20	08/20	INTERIOR SIGNAGE
10 21 13	08/20	TOILET COMPARTMENTS
10 26 00	08/20	WALL AND DOOR PROTECTION
10 28 13	08/17	TOILET ACCESSORIES
10 44 16	11/19	FIRE EXTINGUISHERS

DIVISION 12 - FURNISHINGS

12 24 13	08/20	ROLLER WINDOW SHADES

DIVISION 21 - FIRE SUPPRESSION

21 13 13	08/20	WET PIPE SPRINKLER SYSTEMS, FIRE PROTECTION

DIVISION 22 - PLUMBING

22 00 00	11/15	PLUMBING, GENERAL PURPOSE

DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)

23 05 93	11/15	TESTING, ADJUSTING, AND BALANCING FOR HVAC
23 07 00	02/13, CHG 7: 05/20	THERMAL INSULATION FOR MECHANICAL SYSTEMS
23 09 00	02/19, CHG 3: 05/21	INSTRUMENTATION AND CONTROL FOR HVAC
23 09 13	11/15, CHG 2: 05/21	INSTRUMENTATION AND CONTROL DEVICES FOR HVAC
23 09 23.02	02/19, CHG 1: 02/20	BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS
23 21 23	08/17	HYDRONIC PUMPS
23 23 00	10/07	REFRIGERANT PIPING
23 30 00	05/20	HVAC AIR DISTRIBUTION
23 64 10	11/16, CHG 2: 08/18	WATER CHILLERS, VAPOR COMPRESSION TYPE
23 64 26	08/09, CHG 5: 11/19	CHILLED, CHILLED-HOT, AND CONDENSER WATER PIPING SYSTEMS
23 73 13.00 40	05/17	MODULAR INDOOR CENTRAL-STATION AIR-HANDLING UNITS
23 81 23	11/20	COMPUTER ROOM AIR CONDITIONING UNITS
23 82 19.00 40	05/17	FAN COIL UNITS

DIVISION 26 - ELECTRICAL

26 20 00	08/19, CHG 3: 11/21	INTERIOR DISTRIBUTION SYSTEM
26 24 13	08/21	SWITCHBOARDS
26 28 01.00 10	08/21	COORDINATED POWER SYSTEM PROTECTION
26 29 23	02/20, CHG 1: 05/21	ADJUSTABLE SPEED DRIVE (ASD) SYSTEMS UNDER 600 VOLTS
26 32 15.00	05/20	ENGINE-GENERATOR SET STATIONARY 15-2500 KW, WITH AUXILIARIES
26 36 23	05/20, CHG 1: 08/21	AUTOMATIC TRANSFER SWITCHES AND BY-PASS/ISOLATION SWITCH
26 51 00	05/20, CHG 2: 11/21	INTERIOR LIGHTING
26 56 00	08/21	EXTERIOR LIGHTING

DIVISION 27 - COMMUNICATIONS

27 10 00	08/11	BUILDING TELECOMMUNICATIONS CABLING SYSTEM

DIVISION 28 - ELECTRONIC SAFETY AND SECURITY

28 31 76	08/20	INTERIOR FIRE ALARM AND MASS NOTIFICATION SYSTEM, ADDRESSABLE

DIVISION 31 - EARTHWORK

31 00 00		EARTHWORK
31 11 00	11/18	CLEARING AND GRUBBING

DIVISION 32 - EXTERIOR IMPROVEMENTS

32 11 23	08/17	AGGREGATE BASE COURSES
32 12 13	05/17	BITUMINOUS TACK AND PRIME COATS
32 12 16		HOT-MIX ASPHALT (HMA) FOR ROADS
32 16 19	05/18	CONCRETE CURBS, GUTTERS AND SIDEWALKS
32 17 23	08/16	PAVEMENT MARKINGS
32 92 23	04/06	SODDING

DIVISION 33 - UTILITIES

33 11 00		WATER UTILITY DISTRIBUTION PIPING
33 30 00		SANITARY SEWERS
33 40 00	02/10	STORM DRAINAGE UTILITIES
33 71 02	02/15 (FOR UNDERGROUN	UNDERGROUND ELECTRICAL DISTRIBUTION
33 82 00	04/06	TELECOMMUNICATIONS OUTSIDE PLANT (OSP)

APPENDICIES

APPENDIX A - SID
APPENDIX B - FF&E
APPENDIX C - MEMORANDUM FOR RECORD SECURITY DOOR
APPENDIX D - EGLIN SPECIFIC AS-BUILT DRAWING REQUIREMENTS
APPENDIX E - EGLIN STANDARD TOILET ACCESSORIES
APPENDIX F - BASIS OF DESIGN FOR MODULAR UNITS
APPENDIX G - GEOTECHNICAL ENGINEERING REPORT
APPENDIX H - EGLIN AFB FIRE ALARM AND FIRE SUPPRESSION CRITERIA
APPENDIX I - EGLIN AFB EMCS (DDC) SYSTEM REQUIREMENTS
APPENDIX J - GUIDANCE FOR PREPARATION OF SOIL MANAGEMENT PLANS, FDEP

-- End of Project Table of Contents --

SECTION 01 11 00

SUMMARY OF WORK
08/11

PART 1 GENERAL

1.1 DEFINITIONS

a. "Environmentally preferable products" have a lesser or reduced effect on the environment in comparison to conventional products and services. This comparison may consider raw materials acquisition, production, manufacturing, packaging, distribution, reuse, operation, maintenance, or disposal of the product.

b. "Indoor environmental quality" is the physical characteristics of the building interior that impact occupants, including air quality, illumination, acoustics, occupant control, thermal comfort, daylighting, and views.

c. "Operational performance" is the functional behavior of the building as a whole or of the building components.

d. "Sustainability" is the balance of environmental, economic, and societal considerations.

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. The following shall be submitted in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Upon receipt of Government Furnished Equipment, the Contractor shall submit records in accordance with paragraph entitled, "Government Furnished Property," of this section.

Submit the following items to the Contracting Officer:

Utility Outage Requests
Utility Connection Requests
Welding Permits
Burning Permits

1.3 WORK COVERED BY CONTRACT DOCUMENTS

1.3.1 Project Description

MODULAR BUILDING UNITS:
The selected company manufacturing the modular building units will be experienced in SAPF/SCIF ICD705 construction and have an accredited secure facility in which to perform this work.
An appointed government security representative will inspect and approve the facility and periodically inspect the construction of the modules at critical moments prior to concealment, as they progress.
The appointed government security representative will be allowed facility

access at any time, and may task the manufacturer with producing photographic documentation during the process. The contractor will PURCHASE and NOT LEASE from a company that manufacturer's modular building units that are experienced in the SAPF/SCIF ICD 705.`

ARCHITECTURE:
This is a temporary, pre-engineered modular structure of approximately 32,700 interior square feet, one story, administrative facility. The typical modular unit is 13'-9" x 70', with free-span interior, there will be 34 of these "ganged together". This new facility will be a SAPF with select areas designed to ICD 705 standards. Interior spaces will include open and private offices, conference rooms, work rooms, a break room, storage, and latrines. Additionally, there are typical building support functions including mechanical, electrical, fire protection and communications equipment rooms.

INTERIOR:
The interior finishes consist of acoustical ceiling tile including a moisture resistant tile for wet areas, impact resistant acrylic corner guards, porcelain tile on flooring and walls, acrylic/silicone resin grout, modular carpet tile, heavy duty walk off carpet tile, luxury vinyl tile planks, static dissipative tile for the Comm Room, painted walls, trim and ceilings, plastic laminate casework, thermoplastic rubber wall base, acrylic signs, HDPE toilet partitions, solid surface counter tops and shower walls, and factory stained wood doors.

The FF&E shall be procured and installed by general contractor. Refer to the SID and FF&E packages and notes on the Interiors drawings for more details.

STRUCTURAL:
The proposed project includes a new modular facility structure with approximate 32,760 sf interior space. The structural requirements of this project shall be in full compliance with building codes, including the DoD Building Code, UFC provisions. The structure shall consist of modular sections which shall be constructed to create the overall structure. The structure shall bear on a continuous shallow foundation system. This concrete system shall support the jacks and pilasters required.

CIVIL:
Civil Sitework includes installation and maintenance of erosion control measures, clearing and grubbing of the project site, installation of water, sewer and fire protection utilities, installation of stormwater collection infrastructure, construction of stormwater treatment/flood attenuation facility, building pad preparation, curb-work and flexible paving, and installation of pedestrian paving.

As the site was previously occupied by base housing, the soils at the site are assumed to exceed the FDEP soil cleanup target for leachability of dieldrin and possibly other termiticides as well. See Specification Sections Xx XXXX XX and Section 31 00 00, "Earthwork" for detailed information about the Contractor's responsibilities for management soil materials on the site.

MECHANICAL:
The Mechanical scope of work includes the design of a complete HVAC system to serve the new temporary facility. The HVAC system is designed in accordance with the ASHRA 62.1, the statement of work, UFC design guidelines and UFC specifications.

PLUMBING:
The Plumbing system scope is to provide a complete functioning drainage and

water supply system to the temporary facility. All Plumbing system work shall be in compliance with the International Plumbing code (IPC) and UFC 3-420-01 Plumbing Systems.

FIRE PROTECTION:
Fire Alarm: The fire alarm scope of work includes providing a complete working addressable fire alarm and mass notification system throughout the new temporary facility. The new addressable fire alarm and mass notification system and all work shall be provided in accordance with NFPA 72, UFC 3-600-1, UFC 4-021-01, contract drawings, contract specifications, Eglin Criteria, and the authority having jurisdiction.

Fire Sprinkler: The fire sprinkler scope of work includes providing a complete functional wet pipe fire sprinkler system throughout the new temporary facility. The new wet pipe fire sprinkler system and all work shall be provided in accordance with UFC 3-600-01, NFPA 13, contract drawings, contract specifications, Eglin Criteria, and the authority having jurisdiction.

ELECTRICAL:
A new 480Y/277V, 3 phase electrical service will be installed for the facility. Chelco will install all primary including the transformer. Chelco will be a subcontractor to the GC. Dry type transformers shall be installed to feed 208Y/120V, 3 phase electrical panels. Electrical service and communications panels shall be provided with surge suppression. LED lighting with UFC compliant controls shall be provided throughout interior areas. Receptacles shall be provided at all workstations and equipment.

COMMUNICATION:
The new facility will have new OSP conduit and 24 strand SM fiber installed to node at Bldg 500 per the drawings. There will be a 96CS Comm Room and User Secure Comm Room in the facility. All NIPR and SIPR will feed out of the 96CS Comm Room. User networks will feed out of the User Secure Comm Room. All network cabling shall be plenum rated fiber. The user will be using blade servers. Fiber will be installed to the respective network blade server locations. Fiber will then be installed from the server locations to the workstations. The contractor shall provide all materials and labor for a complete terminated, labeled, and tested communications system. All work shall be compliant with 96CS requirements and February 2020 guide.

SECURITY:
The secure area shall have IDS, ACS, white noise, and security monitoring system infrastructure installed. Also the 96CS room will require a separate IDS system. The user will contract with vendors separate of the construction contract to install any GFGI systems as identified on the drawings. The contractor shall install all power and pathways required for GFGI systems. Other systems that are not GFGI shall be fully installed turn-key by the construction contractor.

1.3.2 Location

The work shall be located as indicated. The exact location will be shown by the Contracting Officer.

1.4 CONTRACT DRAWINGS

Soft copies of contract drawings, maps, and specifications will be furnished to the Contractor without charge. Reference publications will

not be furnished.

Contractor shall immediately check furnished drawings and notify the Government of any discrepancies.

1.5 WORK RESCHEDULING

Contractor shall allow for a maximum of 7 calendar days where construction activity is prohibitive. Government will provide 24 hour notification each time the restrictions are invoked.

Normal duty hours for work shall be from 7 a.m. to 5 p.m., Monday through Friday. Requests for work outside normal duty hours shall require written approval from the Contracting Officer 7 days in advance of the proposed work period."

1.6 PROJECT ENVIRONMENTAL GOALS

Contractor shall distribute copies of the Environmental Goals to each subcontractor and the Contracting Officer. The overall goal for design, construction, and operation is to produce a building that meets the functional program needs and incorporates the principles of sustainability. Specifically:

a. Preserve and restore the site; avoid site degradation and erosion. Minimize environmental impact.

b. Use environmentally preferable products and decrease toxicity level of materials used.

c. Use renewable energy and material resources.

d. Optimize operational performance (through commissioning efforts) in order to ensure energy efficient equipment operates as intended. Consider the durability, maintainability, and flexibility of building systems.

e. Manage construction site and storage of materials to ensure no negative impact on the indoor environmental quality of the building.

f. Reduce construction waste through reuse, recycling, and supplier take-back.

1.7 OCCUPANCY OF PREMISES

Building will not be occupied during performance of work under this Contract.

Before work is started, the Contractor shall arrange with the Contracting Officer a sequence of procedure, means of access, space for storage of materials and equipment, and use of approaches, corridors, and stairways.

1.8 EXISTING WORK

In addition to "FAR 52.236-9, Protection of Existing Vegetation, Structures, Equipment, Utilities, and Improvements":

a. Remove or alter existing work in such a manner as to prevent injury or damage to any portions of the existing work which remain.

b. Repair or replace portions of existing work which have been altered during construction operations to match existing or adjoining work, as approved by the Contracting Officer. At the completion of operations, existing work shall be in a condition equal to or better than that which existed before new work started.

1.9 ON-SITE PERMITS

1.9.1 Utility Outage Requests and Utility Connection Requests

Work shall be scheduled to hold outages to a minimum.

Utility outages and connections required during the prosecution of work that affect existing systems shall be arranged for at the convenience of the Government and shall be scheduled outside the regular working hours or on weekends.

Contracting Officer may permit utility outages at his discretion.

Contractor shall not be entitled to additional payment for utility outages and connections required to be performed outside the regular work hours.

Requests for utility outages and connections shall be made in writing to the Contracting Officer at least5 calendar days in advance of the time required. Each request shall state the system involved, area involved, approximate duration of outage, and the nature of work involved.

1.9.2 Borrow, Excavation, Welding, and Burning Permits

ACTIVITY	SUBMISSION DATE
Burning Permits	5 calendar days prior to work
Welding Permits	5 calendar days prior to work

1.9.3 Confined Space Permit

Provide for confined space plan if required by base safety that meets the following:
1) The contractor is to abide by the provisions of AFI 91-203 (latest release) Chapter 23, and in particular Section 23.8 entitled "Contractor Responsibilities" by the providing of a qualified on-site rescue team for the duration of hazardous activity within the confines of the elevator shaft.

2) Contractor shall meet the general requirements of Section 23.8 and specifically, Section 23.8.2 requires the contractor to meet the Air Force Confined Space Program requirements as addressed in Section 23.2.5.

3) Hazardous activity includes but not limited to welding inside the shaft, painting inside the shaft, or cleaning as described in Chapter 23, Sections 23.3.9.1 through 23.3.9.3.

4) The contractor will provide an attendant (or superintendent) outside the elevator shaft during the hazardous work scheduled that meets the requirements addressed in Section 23.2.9.

5) The rescue team shall have hands-on training meeting the requirements of Section 23.7 entitled "Training". Contractor shall provide documentation that the qualified rescue team meets training requirements for government review and approval a minimum of 10 calendar days before hazardous activities begins.

6) Contractor shall resubmit his "Confined Space Plan" which addresses the above requirements.

Permits shall be posted at a conspicuous location in the construction area.

Burning of trash or rubbish is not permitted on project site.

PART 2 PRODUCTS

Not used.

PART 3 EXECUTION

Not used.

-- End of Section --

SECTION 01 14 00

WORK RESTRICTIONS
05/11

PART 1 GENERAL

1.1 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. The following shall be submitted in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

List of Contact Personnel; G

Statement of Acknowledgement Form SF 1413; G

1.2 CONTRACTOR ACCESS AND USE OF PREMISES

1.2.1 Activity Regulations

Ensure that Contractor personnel employed on the Activity become familiar with and obey Activity regulations including safety, fire, traffic and security regulations. Keep within the limits of the work and avenues of ingress and egress. To minimize traffic congestion, delivery of materials shall be outside of peak traffic hours (6:30 to 8:00 a.m. and 3:30 to 5:00 p.m.) unless otherwise approved by the Contracting Officer. Wear hard hats in designated areas. Do not enter any restricted areas unless required to do so and until cleared for such entry. The Contractor's equipment shall be conspicuously marked for identification.

1.2.1.1 Subcontractors and Personnel Contacts

Furnish a list of contact personnel of the Contractor and subcontractors including addresses and telephone numbers for use in the event of an emergency. As changes occur and additional information becomes available, correct and change the information contained in previous lists.

1.2.1.2 Identification Badges

Identification badges, if required, will be furnished without charge. Application for and use of badges will be as directed.

1.2.1.3 No Smoking Policy

Smoking is prohibited within and outside of all buildings on installations except in designated smoking areas. This applies to existing buildings, buildings under construction and buildings under renovation. Discarding tobacco materials other than into designated tobacco receptacles is considered littering and is subject to fines. The Contracting Officer will identify designated smoking areas.

1.2.2 Working Hours

Regular working hours shall consist of an 8 1/2 hour period established by

the Contractor Officer, Monday through Friday, excluding Government holidays.

1.2.3 Work Outside Regular Hours

Work outside regular working hours requires Contracting Officer approval. Make application 3 calendar days prior to such work to allow arrangements to be made by the Government for inspecting the work in progress, giving the specific dates, hours, location, type of work to be performed, contract number and project title. During periods of darkness, the different parts of the work shall be lighted in a manner approved by the Contracting Officer.

1.2.4 Occupied and Existing Buildings

The Contractor shall be working around existing buildings which are occupied. Do not enter the buildings without prior approval of the Contracting Officer.

1.3 SECURITY REQUIREMENTS

1.3.1 Personnel List

Submit for approval, at least 4 work days prior to the desired date of entry, the required affidavit and memorandum to the contract specialist for processing of personnel who require entry into Government property to perform work on the project. Furnish for each person:

a. Name

b. Date and place of birth

c. Citizenship

d. Home address

The request for contractor badges or temporary passes shall be accompanied with the following certification:

"I hereby certify that all personnel on this list are either born U.S. citizens, naturalized U.S. citizens with the naturalization number shown."

Signature/Firm Name

1.3.1.1 Citizenship Requirements

Work under this contract is restricted to U.S. citizens.

1.3.1.2 Documents Acceptable for Proof of Citizenship

a. Birth registration card

b. Certificate of live birth, birth certificate

c. Certificate of Naturalization

d. Certificate of registration

e. DD-214 (Must Cite Birthplace)

f. DD Form 4 (Contract for Enlistment and Must Cite Birthplace)

g. DD 1966 (Application for Enlistment)

h. Military discharge papers (must cite birthplace)

i. Delayed birth certificate

j. Hawaii certificate of foreign birth

k. Hospital birth certificate

l. Marriage license certificate

m. Merchant marine certificate

n. Military officer ID card

o. Notification of birth registration

p. State of Hawaii ID card

q. USA passport

r. Verbal inquiry with State of Hawaii Vital Statistics Office

1.3.2 Badges and Temporary Passes for Subcontractors

Submit the signed SF 1413's Statement of Acknowledgement to the Contract Specialist 'prior to' requesting any subcontractor badges.

1.3.3 Passes

Submit request for personnel and vehicle passes together. Include the Certificate of Insurance for Contractor and Subcontractor(s) and the Statement of Acknowledgement Form SF 1413 with the submittal. Passes will normally be issued within 21 days.

1.3.3.1 Control

Maintain strict accountability over passes. Immediately report to the source of issue, passes missing or lost and the circumstances. If the Contractor has another active contract or one commencing immediately, employees' names may be transferred from one contract to the other. Final payment will not be effected until employees are transferred to another contract or the records are cleared. Furnish a signed letter, countersigned by the source of issue, stating that passes have been turned in.

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

Not Used

-- End of Section --

SECTION 01 33 00

SUBMITTAL PROCEDURES
05/11

PART 1 GENERAL

1.1 SUMMARY

The Contracting Officer may request submittals in addition to those specified when deemed necessary to adequately describe the work covered in the respective sections.

Units of weights and measures used on all submittals are to be the same as those used in the contract drawings.

Each submittal is to be complete and in sufficient detail to allow ready determination of compliance with contract requirements.

Contractor's to check and approve all items prior to submittal and stamp, sign, and date indicating action taken. Proposed deviations from the contract requirements are to be clearly identified. Include within submittals items such as: Contractor's, manufacturer's, or fabricator's drawings; descriptive literature including (but not limited to) catalog cuts, diagrams, operating charts or curves; test reports; test cylinders; samples; O&M manuals (including parts list); certifications; warranties; and other such required submittals.

Submittals requiring Government approval are to be scheduled and made prior to the acquisition of the material or equipment covered thereby. Pick up and dispose of samples not incorporated into the work in accordance with manufacturer's Material Safety Data Sheets (MSDS) and in compliance with existing laws and regulations.

1.2 DEFINITIONS

1.2.1 Submittal Descriptions (SD)

Submittals requirements are specified in the technical sections. Submittals are identified by Submittal Description (SD) numbers and titles as follows:

SD-01 Preconstruction Submittals

Submittals which are required prior to issuance of contract notice to proceed.or commencing work on site.or the start of the next major phase of the construction on a multi-phase contract, includes schedules, tabular list of data, or tabular list including location, features, or other pertinent information regarding products, materials, equipment, or components to be used in the work.

Certificates of insurance

Surety bonds

List of proposed Subcontractors

List of proposed products

Construction Progress Schedule

Submittal register

Schedule of prices

Health and safety plan

Work plan

Quality Control(QC) plan

Environmental protection plan

SD-02 Shop Drawings

Drawings, diagrams and schedules specifically prepared to illustrate some portion of the work.

Diagrams and instructions from a manufacturer or fabricator for use in producing the product and as aids to the Contractor for integrating the product or system into the project.

Drawings prepared by or for the Contractor to show how multiple systems and interdisciplinary work will be coordinated.

SD-03 Product Data

Catalog cuts, illustrations, schedules, diagrams, performance charts, instructions and brochures illustrating size, physical appearance and other characteristics of materials, systems or equipment for some portion of the work.

Samples of warranty language when the contract requires extended product warranties.

SD-04 Samples

Fabricated or unfabricated physical examples of materials, equipment or workmanship that illustrate functional and aesthetic characteristics of a material or product and establish standards by which the work can be judged.

Color samples from the manufacturer's standard line (or custom color samples if specified) to be used in selecting or approving colors for the project.

Field samples and mock-ups constructed on the project site establish standards by which the ensuring work can be judged. Includes assemblies or portions of assemblies which are to be incorporated into the project and those which will be removed at conclusion of the work.

SD-05 Design Data

Design calculations, mix designs, analyses or other data pertaining to a part of work.

SD-06 Test Reports

Report signed by authorized official of testing laboratory that a material, product or system identical to the material, product or system to be provided has been tested in accord with specified requirements. (Testing must have been within three years of date of contract award for the project.)

Report which includes findings of a test required to be performed by the Contractor on an actual portion of the work or prototype prepared for the project before shipment to job site.

Report which includes finding of a test made at the job site or on sample taken from the job site, on portion of work during or after installation.

Investigation reports.

Daily logs and checklists.

Final acceptance test and operational test procedure.

SD-07 Certificates

Statements printed on the manufacturer's letterhead and signed by responsible officials of manufacturer of product, system or material attesting that product, system or material meets specification requirements. Must be dated after award of project contract and clearly name the project.

Document required of Contractor, or of a manufacturer, supplier, installer or Subcontractor through Contractor, the purpose of which is to further quality of orderly progression of a portion of the work by documenting procedures, acceptability of methods or personnel qualifications.

Confined space entry permits.

Text of posted operating instructions.

SD-08 Manufacturer's Instructions

Preprinted material describing installation of a product, system or material, including special notices and (MSDS)concerning impedances, hazards and safety precautions.

SD-09 Manufacturer's Field Reports

Documentation of the testing and verification actions taken by manufacturer's representative at the job site, in the vicinity of the job site, or on a sample taken from the job site, on a portion of the work, during or after installation, to confirm compliance with manufacturer's standards or instructions. The documentation must be signed by an authorized official of a testing laboratory or agency and must state the test results; and indicate whether the material, product, or system has passed or failed the test.

Factory test reports.

SD-10 Operation and Maintenance Data

Data that is furnished by the manufacturer, or the system provider, to the equipment operating and maintenance personnel, including manufacturer's help and product line documentation necessary to maintain and install equipment. This data is needed by operating and maintenance personnel for the safe and efficient operation, maintenance and repair of the item.

This data is intended to be incorporated in an operations and maintenance manual or control system.

SD-11 Closeout Submittals

Documentation to record compliance with technical or administrative requirements or to establish an administrative mechanism.

Special requirements necessary to properly close out a construction contract. For example, Record Drawings and as-built drawings. Also, submittal requirements necessary to properly close out a major phase of construction on a multi-phase contract.

Interim "DD Form 1354" with cost breakout for all assets 30 days prior to facility turnover.

1.2.2 Approving Authority

Office or designated person authorized to approve submittal.

1.2.3 Work

As used in this section, on- and off-site construction required by contract documents, including labor necessary to produce submittals, except those SD-01 Pre-Construction Submittals noted above, construction, materials, products, equipment, and systems incorporated or to be incorporated in such construction.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor QC approval. Submit the following in accordance with this section.

SD-01 Preconstruction Submittals

Submittal Register; G
Accident Prevention Plan; G
Confined Space Plan; G

1.4 SUBMITTAL CLASSIFICATION

Submittals are classified as follows:

1.4.1 Government Approved (G)

Within the terms of the Contract Clause entitled, "Specifications and Drawings for Construction," they are considered to be "shop drawings."

1.5 FORWARDING SUBMITTALS REQUIRING GOVERNMENT APPROVAL

1.5.1 Submittals Required from the Contractor

As soon as practicable after award of contract, and before procurement of fabrication, forward to the Contracting Officer submittals required in the technical sections of this specification, including shop drawings, product data and samples. Provide at least two copies of the transmittal form used in tracking the distribution and submission of one or more submittals to the government for review and approval.

1.6 PREPARATION

1.6.1 Transmittal Form

Transmit each submittal, except sample installations and sample panels to office of approving authority. Transmit submittals with transmittal form prescribed by Contracting Officer and standard for project. On the transmittal form identify Contractor, indicate date of submittal, and include information prescribed by transmittal form and required in paragraph entitled, "Identifying Submittals," of this section. Process transmittal forms to record actions regarding samples.

Use AF Form 3000 for submitting both Government approved and information only submittals. This form will be furnished to the Contractor. Properly complete this form by filling out all the heading blank spaces and identifying each item submitted. Exercise special care to ensure proper listing of the specification paragraph and sheet number of the contract drawings pertinent to the data submitted for each item.

1.6.2 Identifying Submittals

When submittals are provided by a Subcontractor, the Prime Contractor is to prepare, review and stamp with Contractor's approval all specified submittals prior to submitting for Government approval.

Identify submittals, except sample installations and sample panels, with the following information permanently adhered to or noted on each separate component of each submittal and noted on transmittal form. Mark each copy of each submittal identically, with the following:

a. Project title and location.

b. Construction contract number.

c. Date of the drawings and revisions.

d. Name, address, and telephone number of subcontractor, supplier, manufacturer and any other subcontractor associated with the submittal.

e. Section number of the specification section by which submittal is required.

f. Submittal description (SD) number of each component of submittal.

g. When a resubmission, add alphabetic suffix on submittal description, for example, submittal 18 would become 18A, to indicate resubmission.

h. Product identification and location in project.

1.6.3 Format for SD-02 Shop Drawings

Shop drawings are not to be less than 8 1/2 by 11 inches nor more than 30 by 42 inches, except for full size patterns or templates. Prepare drawings to accurate size, with scale indicated, unless other form is required. Drawings are to be suitable for reproduction and be of a quality to produce clear, distinct lines and letters with dark lines on a white background. Shop drawings must be readable for acceptance by Base Civil Engineer.

Present 8 1/2 by 11 inches sized shop drawings as part of the bound volume for submittals required by section. Present larger drawings in sets.

Include on each drawing the drawing title, number, date, and revision numbers and dates, in addition to information required in paragraph entitled, "Identifying Submittals," of this section.

Number drawings in a logical sequence. Contractors may use their own number system. Each drawing is to bear the number of the submittal in a uniform location adjacent to the title block. Place the Government contract number in the margin, immediately below the title block, for each drawing.

Reserve a blank space, no smaller than 2 inches on the right hand side of each sheet for the Government disposition stamp.

Dimension drawings, except diagrams and schematic drawings; prepare drawings demonstrating interface with other trades to scale. Use the same unit of measure for shop drawings as indicated on the contract drawings. Identify materials and products for work shown.

Include the nameplate data, size and capacity on drawings. Also include applicable federal, military, industry and technical society publication references.

1.6.4 Format of SD-03 Product Data and SD-08 Manufacturer's Instructions

Present product data submittals for each section as a complete, bound volume. Include table of contents, listing page and catalog item numbers for product data.

Indicate, by prominent notation, each product which is being submitted; indicate specification section number and paragraph number to which it pertains.

Supplement product data with material prepared for project to satisfy submittal requirements for which product data does not exist. Identify this material as developed specifically for project, with information and format as required for submission of SD-07 Certificates.

Include the manufacturer's name, trade name, place of manufacture, and catalog model or number on product data. Also include applicable federal, military, industry and technical society publication references. Should manufacturer's data require supplemental information for clarification, submit as specified for SD-07 Certificates.

Where equipment or materials are specified to conform to industry and technical society reference standards of the organizations such as

American National Standards Institute (ANSI), ASTM International (ASTM), National Electrical Manufacturer's Association (NEMA), Underwriters Laboratories (UL), and Association of Edison Illuminating Companies (AEIC), submit proof of such compliance. The label or listing by the specified organization will be acceptable evidence of compliance. In lieu of the label or listing, submit a certificate from an independent testing organization, competent to perform testing, and approved by the Contracting Officer. State on the certificate that the item has been tested in accordance with the specified organization's test methods and that the item complies with the specified organization's reference standard.

Collect required data submittals for each specific material, product, unit of work, or system into a single submittal and marked for choices, options, and portions applicable to the submittal. Mark each copy of the product data identically. Partial submittals will not be accepted for expedition of construction effort.

Submit manufacturer's instructions prior to installation.

1.6.5 Format of SD-04 Samples

Furnish samples in sizes below, unless otherwise specified or unless the manufacturer has prepackaged samples of approximately same size as specified:

a. Sample of Equipment or Device: Full size.

b. Sample of Materials Less Than 2 by 3 inches: Built up to 8 1/2 by 11 inches.

c. Sample of Materials Exceeding 8 1/2 by 11 inches: Cut down to 8 1/2 by 11 inches and adequate to indicate color, texture, and material variations.

d. Sample of Linear Devices or Materials: 10 inch length or length to be supplied, if less than 10 inches. Examples of linear devices or materials are conduit and handrails.

e. Sample of Non-Solid Materials: Pint. Examples of non-solid materials are sand and paint.

f. Color Selection Samples: 2 by 4 inches. Where samples are specified for selection of color, finish, pattern, or texture, submit the full set of available choices for the material or product specified. Sizes and quantities of samples are to represent their respective standard unit.

g. Sample Panel: 4 by 4 feet.

h. Sample Installation: 100 square feet.

Samples Showing Range of Variation: Where variations in color, finish, pattern, or texture are unavoidable due to nature of the materials, submit sets of samples of not less than three units showing extremes and middle of range. Mark each unit to describe its relation to the range of the variation.

Reusable Samples: Incorporate returned samples into work only if so

specified or indicated. Incorporated samples are to be in undamaged condition at time of use.

Recording of Sample Installation: Note and preserve the notation of area constituting sample installation but remove notation at final clean up of project.

When color, texture or pattern is specified by naming a particular manufacturer and style, include one sample of that manufacturer and style, for comparison.

1.6.6 Format of SD-05 Design Data and SD-07 Certificates

Provide design data and certificates on 8 1/2 by 11 inches paper. Provide a bound volume for submittals containing numerous pages.

1.6.7 Format of SD-06 Test Reports and SD-09 Manufacturer's Field Reports

Provide reports on 8 1/2 by 11 inches paper in a complete bound volume.

Indicate by prominent notation, each report in the submittal. Indicate specification number and paragraph number to which it pertains.

1.6.8 Format of SD-10 Operation and Maintenance Data (O&M)

Comply with the requirements specified for O&M Data format.

1.6.9 Format of SD-01 Preconstruction Submittals and SD-11 Closeout Submittals

When submittal includes a document which is to be used in project or become part of project record, other than as a submittal, do not apply Contractor's approval stamp to document, but to a separate sheet accompanying document.

1.7 QUANTITY OF SUBMITTALS

1.7.1 Number of Copies of SD-02 Shop Drawings

Submit four copies of submittals of shop drawings requiring review and approval only by QC organization and seven copies of shop drawings requiring review and approval by Contracting Officer.

1.7.2 Number of Copies of SD-03 Product Data and SD-08 Manufacturer's Instructions

Submit in compliance with quantity requirements specified for shop drawings.

1.7.3 Number of Samples SD-04 Samples

a. Submit two samples, or two sets of samples showing range of variation, of each required item. One approved sample or set of samples will be retained by approving authority and one will be returned to Contractor.

b. Submit one sample panel or provide one sample installation where directed. Include components listed in technical section or as directed.

c. Submit one sample installation, where directed.

d. Submit one sample of non-solid materials.

1.7.4 Number of Copies SD-05 Design Data and SD-07 Certificates

Submit in compliance with quantity requirements specified for shop drawings.

1.7.5 Number of Copies SD-06 Test Reports and SD-09 Manufacturer's Field Reports

Submit in compliance with quantity and quality requirements specified for shop drawings other than field test results that will be submitted with QC reports.

1.7.6 Number of Copies of SD-01 Preconstruction Submittals and SD-11 Closeout Submittals

Unless otherwise specified, submit three sets of administrative submittals.

1.8 SUBMITTAL REGISTER AND DATABASE

Submittals must be on AF Form 3000.

1.9 SCHEDULING

Progress reports shall be on AF Form 3064

1.10 GOVERNMENT APPROVING AUTHORITY

When approving authority is Contracting Officer, the Government will:

a. Note date on which submittal was received from QC Manager.

b. Review submittals for approval within scheduling period specified and only for conformance with project design concepts and compliance with contract documents.

c. Identify returned submittals with one of the actions defined in paragraph entitled, "Review Notations," of this section and with markings appropriate for action indicated.

Upon completion of review of submittals requiring Government approval, stamp and date approved submittals. One copy of the approved submittal will be retained by the Contracting Officer and 6 copies of the submittal will be returned to the Contractor. If the Government performs a conformance review of other Designer of Record approved submittals, the submittals will be so identified and returned, as described above.

1.10.1 Review Notations

Contracting Officer review will be completed within 10 calendar days after date of submission. Submittals will be returned to the Contractor with the following notations:

a. Submittals marked "approved" or "accepted" authorize the Contractor to proceed with the work covered.

b. Submittals marked "approved as noted" "or approved except as noted, resubmittal not required," authorize the Contractor to proceed with the work covered provided he takes no exception to the corrections.

c. Submittals marked "not approved" or "disapproved," or "revise and resubmit," indicate noncompliance with the contract requirements or design concept, or that submittal is incomplete. Resubmit with appropriate changes. No work shall proceed for this item until resubmittal is approved.

d. Submittals marked "not reviewed" will indicate submittal has been previously reviewed and approved, is not required, does not have evidence of being reviewed and approved by Contractor, or is not complete. A submittal marked "not reviewed" will be returned with an explanation of the reason it is not reviewed. Resubmit submittals returned for lack of review by Contractor or for being incomplete, with appropriate action, coordination, or change.

1.11 DISAPPROVED OR REJECTED SUBMITTALS

Contractor shall make corrections required by the Contracting Officer. If the Contractor considers any correction or notation on the returned submittals to constitute a change to the contract drawings or specifications; notice as required under the clause entitled, "Changes," is to be given to the Contracting Officer. Contractor is responsible for the dimensions and design of connection details and construction of work. Failure to point out deviations may result in the Government requiring rejection and removal of such work at the Contractor's expense.

If changes are necessary to submittals, the Contractor shall make such revisions and submission of the submittals in accordance with the procedures above. No item of work requiring a submittal change is to be accomplished until the changed submittals are approved.

1.12 APPROVED/ACCEPTED SUBMITTALS

The Contracting Officer's approval or acceptance of submittals is not to be construed as a complete check, and indicates only that

Approval or acceptance will not relieve the Contractor of the responsibility for any error which may exist, as the Contractor under the Contractor Quality Control (CQC) requirements of this contract is responsible for.

After submittals have been approved or accepted by the Contracting Officer, no resubmittal for the purpose of substituting materials or equipment will be considered unless accompanied by an explanation of why a substitution is necessary.

1.13 APPROVED SAMPLES

Approval of a sample is only for the characteristics or use named in such approval and is not be construed to change or modify any contract requirements. Before submitting samples, the Contractor to assure that the materials or equipment will be available in quantities required in the project. No change or substitution will be permitted after a sample has been approved.

Match the approved samples for materials and equipment incorporated in the

work. If requested, approved samples, including those which may be damaged in testing, will be returned to the Contractor, at his expense, upon completion of the contract. Samples not approved will also be returned to the Contractor at its expense, if so requested.

Failure of any materials to pass the specified tests will be sufficient cause for refusal to consider, under this contract, any further samples of the same brand or make of that material. Government reserves the right to disapprove any material or equipment which previously has proved unsatisfactory in service.

Samples of various materials or equipment delivered on the site or in place may be taken by the Contracting Officer for testing. Samples failing to meet contract requirements will automatically void previous approvals. Contractor to replace such materials or equipment to meet contract requirements.

Approval of the Contractor's samples by the Contracting Officer does not relieve the Contractor of his responsibilities under the contract.

1.14 PROGRESS SCHEDULE

Progress Reports shall be on AF Form 3065.

1.15 STAMPS

Stamps used by the Contractor on the submittal data to certify that the submittal meets contract requirements is to be similar to the following:

CONTRACTOR
(Firm Name)
_____ Approved
_____ Approved with corrections as noted on submittal data and/or attached sheets(s)
SIGNATURE: _____
TITLE: _____
DATE: _____

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

Not Used

-- End of Section --

TITLE:	PZIOCB / DSN-Temporary Facility for 350th SWW
JOB NAME:	FTFA21-JR05
LOCATION:	EGLIN AFB, FL
CONTRACT NO:	
CONTRACTOR:	

SUBMITTAL REGISTER

									CONTRACTOR SCHEDULE DATES			CONTRACTOR ACTION			APPROVING AUTHORITY					
	(a)	(b)	(c)	(d)			(e)	(f)	(g)	(h)	(i)	(j)	(k)	(l)	(m)	(n)	(o)	(p)	(q)	(r)
Line	Activity #	Transmittal #	Specification Section	SD #	Submittal Description	Item Submitted	Paragraph #	Classification: GOVT or A/E Reviewer	Submit	Approval Needed By	Material Needed By	Action Code	Date Of Action	Date FWD to APPR / Auth Date RCD From CONTR	Date FWD To Other Revwr	Date RCD From Other Reviewer	Action Code	Date Of Action	Mailed To CONTR/ Date RCD From APPR Authority	Remarks
1			01 11 00	1	Preconstruction Submittals	Utility Outage Requests	1.10.1													
2			01 11 00	1	Preconstruction Submittals	Utility Connection Requests	1.10.1													
3			01 11 00	1	Preconstruction Submittals	Welding Permits	1.10.2													
4			01 11 00	1	Preconstruction Submittals	Burning Permits	1.10.2													
5			01 14 00	1	Preconstruction Submittals	List of Contact Personnel	1.2.1.1	G												
6			01 14 00	1	Preconstruction Submittals	Statement of Acknowledgement Form SF 1413		G												
7			01 33 00	1	Preconstruction Submittals	Submittal Register	1.8	G												
8			01 33 00	1	Preconstruction Submittals	Accident Prevention Plan		G												
9			01 33 00	1	Preconstruction Submittals	Confined Space Plan		G												
10			01 35 26	1	Preconstruction Submittals	Accident Prevention Plan (APP)		G												
11			01 35 26	1	Preconstruction Submittals	Activity Hazard Analysis (AHA)	1.6	G												
12			01 35 26	6	Test Reports	Reports	1.1													
13			01 35 26	6	Test Reports	Accident Reports	1.10.1													
14			01 35 26	7	Certificates	License Certificates														
15			01 35 26	7	Certificates	Contractor Safety Self-Evaluation Checklist		G												
16			01 35 26	7	Certificates	Machinery & Mechanized Equipment Certification Form	3.2.2													
17			01 50 00	1	Preconstruction Submittals	Construction site plan	1.4	G												
18			01 54 00	3	Product Data	Product Sources and Information	2.1													
19			01 54 00	7	Certificates	Product Sources and Information	2.1													
20			01 57 19	1	Preconstruction Submittals	Preconstruction Survey	1.6.1													
21			01 57 19	1	Preconstruction Submittals	Solid Waste Management Permit	1.1	G RO												
22			01 57 19	1	Preconstruction Submittals	Regulatory Notifications	1.6.2	G												
23			01 57 19	1	Preconstruction Submittals	Environmental Protection Plan	1.7	G RO												
24			01 57 19	1	Preconstruction Submittals	Stormwater Notice of Intent	3.3.1.2	G RO												
25			01 57 19	1	Preconstruction Submittals	Dirt and Dust Control Plan	1.7.9.1	G RO												
26			01 57 19	1	Preconstruction Submittals	Employee Training Records	1.6.5	G RO												
27			01 57 19	1	Preconstruction Submittals	Environmental Manager Qualifications	1.6.4	G												
28			01 57 19	6	Test Reports	Laboratory Analysis	3.8.1.1.2													
29			01 57 19	6	Test Reports	Inspection Reports	3.3.1.3													
30			01 57 19	6	Test Reports	Solid Waste Management Report	3.8.2.1	G												
31			01 57 19	7	Certificates	Employee Training Records	1.6.5	G												
32			01 57 19	7	Certificates	Erosion and Sediment Control Inspector	1.6.5													
33			01 57 19	11	Closeout Submittals	Stormwater Pollution Prevention Plan Compliance Notebook	3.3.1.4													
34			01 57 19	11	Closeout Submittals	, RO														
35			01 57 19	11	Closeout Submittals	Stormwater Notice of Termination	3.3.1.5	G RO												
36			01 57 19	11	Closeout Submittals	Waste Determination Documentation	3.8.1	G RO												
37			01 57 19	11	Closeout Submittals	Disposal Documentation for Hazardous and Regulated Waste	3.8.3.6	G RO												
38			01 57 19	11	Closeout Submittals	Assembled Employee Training Records	1.6.5	G												

39			01 57 19	11	Closeout Submittals	Solid Waste Management Permit	1.1	G											
40			01 57 19	11	Closeout Submittals	Solid Waste Management Report	3.8.2.1	G											
41			01 57 19	11	Closeout Submittals	Hazardous Waste/Debris Management	3.8.3.1	G											
42			01 57 19	11	Closeout Submittals	Regulatory Notifications	1.6.2	G											
43			01 57 19	11	Closeout Submittals	Sales Documentation	3.8.2.1	G											
44			01 57 19	11	Closeout Submittals	Contractor Certification	3.8.2.1												
45			01 74 19	1	Preconstruction Submittals	Waste Management Plan	1.6	G											
46			01 74 19	11	Closeout Submittals	Records	1.7												
47			01 78 00	3	Product Data	Warranty Management Plan	1.8.1												
48			01 78 00	3	Product Data	Warranty Tags	1.8.5												
49			01 78 00	3	Product Data	Final Cleaning	3.8												
50			01 78 00	3	Product Data	Spare Parts Data	1.6												
51			01 78 00	8	Manufacturer's Instructions	Instructions	1.8.1												
52			01 78 00	10	Operation and Maintenance Data	Operation and Maintenance Manuals	3.7	G											
53			01 78 00	11	Closeout Submittals	As-Built Drawings	3.1	G											
54			01 78 00	11	Closeout Submittals	Record Model		G											
55			01 78 00	11	Closeout Submittals	As-Built Record of Equipment and Materials	1.8.1												
56			01 78 00	11	Closeout Submittals	As-Built Record of Equipment and Materials	3.6												
57			01 78 00	11	Closeout Submittals	Final Approved Shop Drawings	3.4	G											
58			01 78 00	11	Closeout Submittals	Construction Contract Specifications	3.5	G											
59			01 78 00	11	Closeout Submittals	Certification of EPA Designated Items	2.2	G											
60			01 78 00	11	Closeout Submittals	Certification Of USDA Designated Items	2.3	G											
61			01 78 00	11	Closeout Submittals	Interim DD FORM 1354	3.9.1	G											
62			01 78 00	11	Closeout Submittals	Checklist for DD FORM 1354		G											
63			01 78 00	11	Closeout Submittals	High Performance and Sustainable Building (HPSB) Checklist		G											
64			01 78 23	10	Operation and Maintenance Data	O&M Database	1.4	G											
65			01 78 23	10	Operation and Maintenance Data	Training Plan	3.1.1	G											
66			01 78 23	10	Operation and Maintenance Data	Training Outline	3.1.3	G											
67			01 78 23	10	Operation and Maintenance Data	Training Content	3.1.2	G											
68			01 78 23	11	Closeout Submittals	Training Video Recording	3.1.4	G											
69			01 78 23	11	Closeout Submittals	Validation of Training Completion	3.1.6	G											
70			01 91 00.15 10	1	Preconstruction Submittals	Commissioning Firm	1.8	G DO											
71			01 91 00.15 10	1	Preconstruction Submittals	Lead Commissioning Specialist	1.8.1	G DO											
72			01 91 00.15 10	1	Preconstruction Submittals	Technical Commissioning Specialists	1.8.2	G DO											
73			01 91 00.15 10	6	Test Reports	Interim Construction Phase Commissioning Plan	3.1.2.1	G DO											
74			01 91 00.15 10	6	Test Reports	Final Construction Phase Commissioning Plan	3.1.2.2	G DO											
75			01 91 00.15 10	6	Test Reports	Pre-Functional Checklists	3.1.4.2	G DO											
76			01 91 00.15 10	6	Test Reports	Issues Log	1.9												
77			01 91 00.15 10	6	Test Reports	Commissioning Report	3.2	G DO											
78			01 91 00.15 10	7	Certificates	Certificate of Readiness	1.1	G DO											
79			01 91 00.15 10	10	Operation and Maintenance Data	Training Plan	3.1.5	G RO											
80			01 91 00.15 10	10	Operation and Maintenance Data	Training Attendance Rosters	3.1.5	G RO											
81			01 91 00.15 10	10	Operation and Maintenance Data	Systems Manual	3.1.6	G DO											
82			01 91 00.15 10	10	Operation and Maintenance Data	Systems Manual	3.1.6	G DO											
83			01 91 00.15 10	10	Operation and Maintenance Data	Maintenance and Service Life Plans	3.1.7	G DO											
84			01 91 00.15 10	11	Closeout Submittals	Final Commissioning Report	3.2	S DO											

85			02 41 00	1	Preconstruction Submittals	Demolition Plan	1.2.1												
86			03 30 00	1	Preconstruction Submittals	Quality Control Plan	1.6.6	G											
87			03 30 00	1	Preconstruction Submittals	Quality Control Personnel Certifications	1.6.7	G											
88			03 30 00	1	Preconstruction Submittals	Quality Control Organizational Chart	1.6.7												
89			03 30 00	1	Preconstruction Submittals	Laboratory Accreditation	1.6.9	G											
90			03 30 00	2	Shop Drawings	Formwork													
91			03 30 00	2	Shop Drawings	Reinforcing Steel	1.6.2.1	G											
92			03 30 00	3	Product Data	Cementitious Materials	2.2.1												
93			03 30 00	3	Product Data	Concrete Curing Materials	2.3.1												
94			03 30 00	3	Product Data	Reinforcement	2.5												
95			03 30 00	3	Product Data	Admixtures	2.2.4												
96			03 30 00	3	Product Data	Pumping Concrete	1.6.3.2												
97			03 30 00	5	Design Data	Concrete Mix Design	1.6.1.1	G											
98			03 30 00	6	Test Reports	Concrete Mix Design	1.6.1.1	G											
99			03 30 00	6	Test Reports	Fly Ash	1.6.4.1												
100			03 30 00	6	Test Reports	Pozzolan	1.6.4.1												
101			03 30 00	6	Test Reports	Slag Cement	1.6.4.2												
102			03 30 00	6	Test Reports	Aggregates	1.6.4.3												
103			03 30 00	6	Test Reports	Compressive Strength Tests	3.11.3.3	G											
104			03 30 00	6	Test Reports	Air Content	3.11.3.4												
105			03 30 00	6	Test Reports	Slump Tests	3.11.3.1												
106			03 30 00	6	Test Reports	Water	2.2.2												
107			03 30 00	7	Certificates	Reinforcing Bars	2.5.1												
108			03 30 00	7	Certificates	VOC Content for Form Release Agents, Curing Compounds, and Concrete Penetrating Sealers	1.6.3.3												
109			03 30 00	7	Certificates	Safety Data Sheets	1.6.3.4												
110			03 30 00	7	Certificates	Field Testing Technician and Testing Agency	1.6.7.2												
111			03 30 00	8	Manufacturer's Instructions	Curing Compound	2.3.1												
112			04 20 00	2	Shop Drawings	Cut CMU	3.3.2.1	G											
113			04 20 00	2	Shop Drawings	Detail Drawings	3.4.1.1	G											
114			04 20 00	3	Product Data	Hot Weather Procedures	1.5.1	G											
115			04 20 00	3	Product Data	Cold Weather Procedures	1.5.2	G											
116			04 20 00	3	Product Data	Cement	2.2.2.2.1	G											
117			04 20 00	3	Product Data	Cementitious Materials	2.4.1.1	G											
118			04 20 00	4	Samples	Concrete Masonry Units (CMU)	2.2.2.2	G											
119			04 20 00	4	Samples	Admixtures for Masonry Mortar	2.4.1.3	G											
120			04 20 00	4	Samples	Anchors, Ties, and Bar Positioners	2.6.2	G											
121			04 20 00	4	Samples	Joint Reinforcement	2.6.3	G											
122			04 20 00	5	Design Data	Masonry Compressive Strength	2.1.2	G											
123			04 20 00	6	Test Reports	Field Testing of Mortar	3.6.1.1												
124			04 20 00	6	Test Reports	Field Testing of Grout	3.6.1.2												
125			04 20 00	7	Certificates	Concrete Masonry Units (CMU)	2.2.2.2												
126			04 20 00	7	Certificates	Cementitious Materials	2.4.1.1												
127			04 20 00	7	Certificates	Admixtures for Masonry Mortar	2.4.1.3												
128			04 20 00	7	Certificates	Admixtures for Grout	2.4.2.2												
129			04 20 00	7	Certificates	Anchors, Ties, and Bar Positioners	2.6.2												
130			04 20 00	7	Certificates	Joint Reinforcement	2.6.3												
131			04 20 00	8	Manufacturer's Instructions	Admixtures for Masonry Mortar	2.4.1.3												
132			04 20 00	8	Manufacturer's Instructions	Admixtures for Grout	2.4.2.2												
133			04 20 00	10	Operation and Maintenance Data	Take-Back Program	3.8												
134			06 10 00	6	Test Reports	Preservative-treated	1.4.3												
135			06 10 00	7	Certificates	Preservative Treatment	1.7												
136			06 41 16.00 10	2	Shop Drawings	Shop Drawings	2.1												
137			06 41 16.00 10	2	Shop Drawings	Installation	3.1												
138			06 41 16.00 10	3	Product Data	Wood Materials	2.1												

139			06 41 16.00 10	3	Product Data	Wood Finishes													
140			06 41 16.00 10	3	Product Data	Finish Schedule	2.10.7.3												
141			06 41 16.00 10	3	Product Data	Certification													
142			06 41 16.00 10	4	Samples	Plastic Laminates	2.3												
143			06 41 16.00 10	4	Samples	Cabinet Hardware	2.6												
144			06 41 16.00 10	7	Certificates	Quality Assurance	1.4												
145			06 41 16.00 10	7	Certificates	Laminate Clad Casework	3.1												
146			06 61 16	2	Shop Drawings	Detail Drawings		G											
147			06 61 16	3	Product Data	Solid Polymer Material	2.1												
148			06 61 16	4	Samples	Material	2.1	G											
149			06 61 16	4	Samples	Counter Tops		G											
150			06 61 16	4	Samples	Window Stools		G											
151			07 21 16	3	Product Data	Blanket insulation	2.1												
152			07 21 16	3	Product Data	Certification													
153			07 21 16	8	Manufacturer's Instructions	Insulation	3.3.1												
154			07 24 00	2	Shop Drawings	Shop Drawings	3.3	G											
155			07 24 00	3	Product Data	Sheathing Board	2.2												
156			07 24 00	3	Product Data	Thermal Insulation	2.6												
157			07 24 00	3	Product Data	Adhesive	2.3												
158			07 24 00	3	Product Data	Mechanical Fasteners	2.5												
159			07 24 00	3	Product Data	Accessories	2.12												
160			07 24 00	3	Product Data	Base Coat	2.7												
161			07 24 00	3	Product Data	Portland Cement	2.8												
162			07 24 00	3	Product Data	Reinforcing Fabric	2.9												
163			07 24 00	3	Product Data	Finish Coat	2.1												
164			07 24 00	3	Product Data	Joint Sealant	2.13												
165			07 24 00	3	Product Data	Sealant Primer	2.11												
166			07 24 00	3	Product Data	Bond Breaker	2.14												
167			07 24 00	3	Product Data	Backer Rod	2.15												
168			07 24 00	3	Product Data	Insulation Board	1.4.5												
169			07 24 00	3	Product Data	Warranty	1.7												
170			07 24 00	4	Samples	Sample Boards	1.2.3.7	G											
171			07 24 00	5	Design Data	Wind Load	1.2.1.2												
172			07 24 00	5	Design Data	Moisture Analysis	1.2.4												
173			07 24 00	6	Test Reports	Abrasion Resistance	1.2.3.1												
174			07 24 00	6	Test Reports	Accelerated Weathering	1.2.3.2												
175			07 24 00	6	Test Reports	Impact Resistance	1.2.2.3												
176			07 24 00	6	Test Reports	Mildew Resistance	1.2.3.3												
177			07 24 00	6	Test Reports	Salt Spray Resistance	1.2.3.4												
178			07 24 00	6	Test Reports	Vapor Transmission	1.2.4												
179			07 24 00	6	Test Reports	Absorption-Freeze-Thaw	1.2.3.6												
180			07 24 00	6	Test Reports	Wall Fire Test	1.2.1.3												
181			07 24 00	6	Test Reports	Water Penetration	1.2.1.1												
182			07 24 00	6	Test Reports	Water Resistance	1.2.3.5												
183			07 24 00	6	Test Reports	Full Scale or Intermediate Scale Fire Test	1.2.1.3												
184			07 24 00	6	Test Reports	Surface Burning Characteristics	1.2.2.1												
185			07 24 00	6	Test Reports	Radiant Heat	1.2.2.2												
186			07 24 00	6	Test Reports	Substrate	3.1												
187			07 24 00	6	Test Reports	Wind Load	1.2.1.2												
188			07 24 00	7	Certificates	Qualifications of EIFS Manufacturer	1.4.1												
189			07 24 00	7	Certificates	Qualification of EIFS Installer	1.4.2												
190			07 24 00	7	Certificates	Qualification of Sealant Applicator	1.4.3												
191			07 24 00	7	Certificates	Qualifications of Third Party Inspector	1.4.4												
192			07 24 00	7	Certificates	Inspection Check List	3.5.2	G											
193			07 24 00	8	Manufacturer's Instructions	Installation	3.3												

194			07 24 00	10	Operation and Maintenance Data	EIFS	1.7													
195			07 54 19	2	Shop Drawings	Detail Drawings	1.6	G												
196			07 54 19	2	Shop Drawings	Roof Plan	1.6	G												
197			07 54 19	3	Product Data	PVC Roofing Membrane	3.2.2	G												
198			07 54 19	3	Product Data	Bonding Adhesive	2.1.2													
199			07 54 19	3	Product Data	Flashing	1.5.3													
200			07 54 19	3	Product Data	Flashing	3.2.2.2													
201			07 54 19	3	Product Data	Protection Mat														
202			07 54 19	3	Product Data	Pre-Manufactured Accessories	2.1.6													
203			07 54 19	3	Product Data	Water Cutoffs	3.5.1													
204			07 54 19	3	Product Data	Information Card	2.1.1													
205			07 54 19	5	Design Data	Wind Uplift Resistance	1.3.2	G												
206			07 54 19	7	Certificates	Qualification of Manufacturer	1.5.1													
207			07 54 19	7	Certificates	Wind Uplift Resistance	1.3.2													
208			07 54 19	7	Certificates	Fire Resistance	1.3.1													
209			07 54 19	7	Certificates	Minimum Polymer Thickness	2.1.1													
210			07 54 19	7	Certificates	Minimum Polymer Thickness	2.1.4													
211			07 54 19	7	Certificates	Sample	1.1	G												
212			07 54 19	8	Manufacturer's Instructions	Application Method	3.2	G												
213			07 54 19	8	Manufacturer's Instructions	Membrane Flashing	2.1.4	G												
214			07 54 19	8	Manufacturer's Instructions	Membrane Flashing	3.3.2	G												
215			07 54 19	8	Manufacturer's Instructions	Perimeter Attachment	3.2.4													
216			07 54 19	8	Manufacturer's Instructions	Auxiliary Fasteners	2.1.5.1													
217			07 54 19	8	Manufacturer's Instructions	Protection Mat														
218			07 54 19	8	Manufacturer's Instructions	Pre-Manufactured Accessories	2.1.6													
219			07 54 19	8	Manufacturer's Instructions	Cold Weather	1.8	G												
220			07 54 19	11	Closeout Submittals	Warranty	1.1	G												
221			07 54 19	11	Closeout Submittals	Information Card	2.1.1	G												
222			07 54 19	11	Closeout Submittals	Instructions to Government Personnel	3.8	G												
223			07 60 00	2	Shop Drawings	Covering on flat, sloped, or curved surfaces	3.1.16	G												
224			07 60 00	2	Shop Drawings	Gutters	3.1.12	G												
225			07 60 00	2	Shop Drawings	Downspouts	3.1.13	G												
226			07 60 00	2	Shop Drawings	Expansion joints	3.1.17	G												
227			07 60 00	2	Shop Drawings	Base flashing	3.1.10	G												
228			07 60 00	2	Shop Drawings	Counterflashing	3.1.11	G												
229			07 60 00	2	Shop Drawings	Flashing at roof penetrations	3.1.18	G												
230			07 60 00	2	Shop Drawings	Eave flashing	3.1.15	G												
231			07 61 14.00 20	2	Shop Drawings	Roofing	1.2.5	G												
232			07 61 14.00 20	3	Product Data	Roofing panels	2.1	G												
233			07 61 14.00 20	3	Product Data	Attachment clips	2.2													
234			07 61 14.00 20	3	Product Data	Closures	2.3.1													
235			07 61 14.00 20	3	Product Data	Accessories	2.3													
236			07 61 14.00 20	3	Product Data	Fasteners	2.3.2													
237			07 61 14.00 20	3	Product Data	Sealants	2.3.3													
238			07 61 14.00 20	3	Product Data	warranty	1.7	G												
239			07 61 14.00 20	4	Samples	panel	2.1	G												
240			07 61 14.00 20	4	Samples	Accessories	2.3	G												
241			07 61 14.00 20	4	Samples	Sealants	2.3.3	G												
242			07 61 14.00 20	4	Samples	Intermediate Support		G												
243			07 61 14.00 20	5	Design Data	Design calculations	1.5	G												
244			07 61 14.00 20	6	Test Reports	Field Inspection	3.6													
245			07 61 14.00 20	6	Test Reports	Structural performance	1.3.3	G												
246			07 61 14.00 20	6	Test Reports	Finish	1.6.6	G												
247			07 61 14.00 20	7	Certificates	Manufacturer's Technical Representative	1.6.3	G												

248			07 61 14.00 20	7	Certificates	Installer's Qualifications	1.6.4	G											
249			07 61 14.00 20	8	Manufacturer's Instructions	Installation	3.3	G											
250			07 61 14.00 20	11	Closeout Submittals	Information card	3.8	G											
251			07 92 00	3	Product Data	Sealants	2.2	G											
252			07 92 00	3	Product Data	Primers	2.3	G											
253			07 92 00	3	Product Data	Bond Breakers	2.4	G											
254			07 92 00	3	Product Data	Backstops	2.5	G											
255			07 92 00	7	Certificates	Indoor Air Quality	1.4.1	G											
256			07 92 00	11	Closeout Submittals	Indoor Air Quality For Interior Sealants	2.2.1												
257			07 92 00	11	Closeout Submittals	Indoor Air Quality For Interior Floor Joint Sealants	2.2.3												
258			07 92 00	11	Closeout Submittals	Indoor Air Quality For Interior Acoustical Sealants	2.2.4												
259			07 92 00	11	Closeout Submittals	Indoor Air Quality For Interior Caulking													
260			08 11 13	2	Shop Drawings	Doors	2.1												
261			08 11 13	2	Shop Drawings	Doors	2.1												
262			08 11 13	2	Shop Drawings	Frames	2.5												
263			08 11 13	2	Shop Drawings	Frames	2.5												
264			08 11 13	2	Shop Drawings	Accessories													
265			08 11 13	3	Product Data	Doors	2.1												
266			08 11 13	3	Product Data	Frames	2.5												
267			08 11 13	3	Product Data	Accessories													
268			08 33 23	2	Shop Drawings	Overhead Coiling Doors	2.2.1	G											
269			08 33 23	2	Shop Drawings	Counterbalancing Mechanism	2.2.3	G											
270			08 33 23	2	Shop Drawings	Electric Door Operators	2.2.4	G											
271			08 33 23	2	Shop Drawings	Bottom Bars	2.2.1.4	G											
272			08 33 23	2	Shop Drawings	Guides	2.1.1.1	G											
273			08 33 23	2	Shop Drawings	Mounting Brackets	2.2.3.1	G											
274			08 33 23	2	Shop Drawings	Overhead Drum	2.2.1.9	G											
275			08 33 23	2	Shop Drawings	Hood	3.3.2	G											
276			08 33 23	2	Shop Drawings	Installation Drawings	2.1.1.1	G											
277			08 33 23	3	Product Data	Overhead Coiling Doors	2.2.1	G											
278			08 33 23	3	Product Data	Hardware	2.2.2	G											
279			08 33 23	3	Product Data	Counterbalancing Mechanism	2.2.3	G											
280			08 33 23	3	Product Data	Electric Door Operators	2.2.4	G											
281			08 33 23	5	Design Data	Overhead Coiling Doors	2.2.1	G											
282			08 33 23	5	Design Data	Hardware	2.2.2	G											
283			08 33 23	5	Design Data	Counterbalancing Mechanism	2.2.3	G											
284			08 33 23	5	Design Data	Electric Door Operators	2.2.4	G											
285			08 33 23	10	Operation and Maintenance Data	Operation and Maintenance Manuals	3.3.2	G											
286			08 33 23	10	Operation and Maintenance Data	Materials	3.3.2	G											
287			08 33 23	10	Operation and Maintenance Data	Devices	3.3.2	G											
288			08 33 23	10	Operation and Maintenance Data	Procedures	3.3.2	G											
289			08 33 23	10	Operation and Maintenance Data	Manufacture's Brochures	3.3.2	G											
290			08 33 23	10	Operation and Maintenance Data	Parts Lists	3.3.2	G											
291			08 33 23	11	Closeout Submittals	Warranty	3.3.1	G											
292			08 34 73	2	Shop Drawings	Hollow Metal Sound Retardant Doors	2.1	G											
293			08 34 73	2	Shop Drawings	Door Frames	2.1	G											
294			08 34 73	3	Product Data	Hollow Metal Sound Retardant Doors	2.1	G											
295			08 34 73	3	Product Data	Door Frames	2.1	G											
296			08 34 73	3	Product Data	Door Hardware	2.1	G											
297			08 34 73	3	Product Data	Thresholds	2.1	G											

298			08 34 73	3	Product Data	Astragals	2.1	G											
299			08 34 73	6	Test Reports	Wind Loading Tests	2.4.3	G											
300			08 34 73	6	Test Reports	Water Leakage Tests	2.4.3	G											
301			08 34 73	6	Test Reports	Acoustical Tests	2.4.3	G											
302			08 34 73	6	Test Reports	Air Infiltration Tests	2.4.3	G											
303			08 34 73	7	Certificates	Hollow Metal Sound Retardant Doors	2.1	G											
304			08 34 73	7	Certificates	Door Frames	2.1	G											
305			08 34 73	7	Certificates	Door Hardware	2.1	G											
306			08 34 73	7	Certificates	Thresholds	2.1	G											
307			08 34 73	7	Certificates	Astragals	2.1	G											
308			08 41 13	1	Preconstruction Submittals	Sample Warranty	1.2.1												
309			08 41 13	1	Preconstruction Submittals	List of Product Installations	1.2.1												
310			08 41 13	2	Shop Drawings	Installation Drawings	3.3												
311			08 41 13	2	Shop Drawings	Fabrication Drawings	2.2												
312			08 41 13	3	Product Data	Finish	2.2.3												
313			08 41 13	4	Samples	Finish and Color Samples	1.2.1												
314			08 41 13	6	Test Reports	Certified Test Reports	1.2.1												
315			08 41 13	6	Test Reports	Deflection	3.4.3												
316			08 41 13	6	Test Reports	Air Infiltration	3.4.1												
317			08 41 13	6	Test Reports	Condensation Resistance and Thermal Transmittance													
318			08 41 13	6	Test Reports	Water Infiltration													
319			08 41 13	8	Manufacturer's Instructions	Manufacturer's Instructions	3.3												
320			08 41 13	11	Closeout Submittals	Manufacturer's Product Warranty	3.6												
321			08 51 13	2	Shop Drawings	Windows	2.1	G											
322			08 51 13	2	Shop Drawings	Fabrication Drawings	1.7												
323			08 51 13	3	Product Data	Windows	2.1	G											
324			08 51 13	3	Product Data	Fasteners	2.2.2	G											
325			08 51 13	3	Product Data	Window Performance	1.8	G											
326			08 51 13	3	Product Data	Thermal-Barrier Windows		G											
327			08 51 13	4	Samples	Finish Sample	1.3.4.1												
328			08 51 13	4	Samples	Window Sample	1.3.4.2												
329			08 51 13	5	Design Data	Structural Calculations for Deflection	2.1	G											
330			08 51 13	5	Design Data	Design Analysis	1.3.5	G											
331			08 51 13	6	Test Reports	Minimum Condensation Resistance Factor	1.3.6												
332			08 51 13	6	Test Reports	Resistance to Forced Entry													
333			08 51 13	6	Test Reports	Standard Airblast Test	1.8.2.2	G											
334			08 51 13	6	Test Reports	Windborne-Debris-Impact Performance	1.8.7												
335			08 51 13	7	Certificates	Engineer's Qualifications	1.3.3												
336			08 51 13	10	Operation and Maintenance Data	Windows	2.1	G											
337			08 51 13	10	Operation and Maintenance Data	Plastic Identification	1.5												
338			08 71 00	2	Shop Drawings	Hardware schedule	1.3	G											
339			08 71 00	2	Shop Drawings	Keying system	2.3.6												
340			08 71 00	3	Product Data	Hardware items	2.3	G											
341			08 71 00	8	Manufacturer's Instructions	Installation	3.1												
342			08 71 00	10	Operation and Maintenance Data	Hardware Schedule	1.3	G											
343			08 71 00	11	Closeout Submittals	Key Bitting	1.4												
344			08 81 00	3	Product Data	Insulating Glass	2.3												
345			08 81 00	3	Product Data	Glazing Accessories	1.3												
346			08 81 00	3	Product Data	Sealants	2.4.3.1												
347			08 81 00	3	Product Data	Joint Backer	2.4.4												
348			08 81 00	7	Certificates	Insulating Glass	2.3												
349			08 81 00	8	Manufacturer's Instructions	Setting and Sealing Materials	2.4												
350			08 81 00	8	Manufacturer's Instructions	Glass Setting	3.2												

351			08 81 00	11	Closeout Submittals	Insulated Glass Units	1.6.1													
352			08 81 00	11	Closeout Submittals	Energy Efficient Equipment for Residential Windows		S												
353			09 22 00	2	Shop Drawings	Metal support systems	2.1													
354			09 29 00	3	Product Data	Certification														
355			09 29 00	3	Product Data	Gypsum Board	2.1.1													
356			09 29 00	3	Product Data	Adhesives														
357			09 29 00	3	Product Data	Joint Treatment Materials	2.1.4													
358			09 29 00	3	Product Data	Environmental Data														
359			09 29 00	7	Certificates	Asbestos Free Materials	2.1													
360			09 30 10	2	Shop Drawings	Detail Drawings	3.2	G												
361			09 30 10	3	Product Data	Porcelain Tile	2.1.1	G												
362			09 30 10	3	Product Data	Recycled Content for Porcelain Tile														
363			09 30 10	3	Product Data	Mosaic Tile														
364			09 30 10	3	Product Data	Recycled Content for Mosaic Tile														
365			09 30 10	3	Product Data	Glazed Ceramic Wall Tile														
366			09 30 10	3	Product Data	Recycled Content for Glazed Ceramic Wall Tile														
367			09 30 10	3	Product Data	Transition Strips	2.1													
368			09 30 10	3	Product Data	Transition Strips	2.6.1													
369			09 30 10	3	Product Data	Metal Strips	2.6.2													
370			09 30 10	3	Product Data	Setting-Bed	2.2													
371			09 30 10	3	Product Data	Mortar, Grout, and Adhesive	2.4													
372			09 30 10	3	Product Data	Cementitious Backer Units	2.5.1													
373			09 30 10	3	Product Data	Glass-Mat Gypsum Water-Resistant Backing Board														
374			09 30 10	3	Product Data	Waterproof Membrane														
375			09 30 10	3	Product Data	Crack Isolation Membrane														
376			09 30 10	4	Samples	Tile	2.1	G												
377			09 30 10	4	Samples	Accessories	2.1	G												
378			09 30 10	4	Samples	Accessories	2.1.3	G												
379			09 30 10	4	Samples	Transition Strips	2.1	G												
380			09 30 10	4	Samples	Transition Strips	2.6.1	G												
381			09 30 10	4	Samples	Grout		G												
382			09 30 10	7	Certificates	Indoor Air Quality for Adhesives	2.4													
383			09 30 10	7	Certificates	Indoor Air Quality for Sealants														
384			09 30 10	7	Certificates	Water Absorption Rates	1.3.2													
385			09 30 10	8	Manufacturer's Instructions	Manufacturer's Approved Cleaning Instructions	3.8													
386			09 30 10	10	Operation and Maintenance Data	Porcelain Tile	2.1.1	G												
387			09 30 10	10	Operation and Maintenance Data	Mosaic Tile		G												
388			09 30 10	10	Operation and Maintenance Data	Glazed Ceramic Wall Tile		G												
389			09 30 10	10	Operation and Maintenance Data	Transition Strips	2.1	G												
390			09 30 10	10	Operation and Maintenance Data	Transition Strips	2.6.1	G												
391			09 51 00	3	Product Data	Acoustical Ceiling Systems														
392			09 51 00	6	Test Reports	Ceiling Attenuation Class and Test	1.2.1													
393			09 51 00	7	Certificates	Acoustical Units	2.1													
394			09 51 00	7	Certificates	Acoustic Ceiling Tiles	2.1.1													
395			09 62 38	3	Product Data	Static-Control Resilient Flooring	2.1	G												
396			09 62 38	3	Product Data	Accessories		G												
397			09 62 38	3	Product Data	Adhesives	2.3	G												
398			09 62 38	3	Product Data	Warranty	1.9													
399			09 62 38	4	Samples	Static-Control Resilient Flooring	2.1	G												
400			09 62 38	4	Samples	Moldings	2.4	G												
401			09 62 38	6	Test Reports	Fire Resistance	2.6													

402			09 62 38	6	Test Reports	Moisture, Alkalinity and Bond	3.2												
403			09 62 38	6	Test Reports	Testing	3.7												
404			09 62 38	7	Certificates	Indoor Air Quality for Static-Dissipative Vinyl Tile													
405			09 62 38	8	Manufacturer's Instructions	Static-Control Resilient Flooring	2.1	G											
406			09 62 38	10	Operation and Maintenance Data	Static-Control Resilient Flooring	2.1	G											
407			09 65 00	2	Shop Drawings	Resilient Flooring and Accessories	2.7												
408			09 65 00	3	Product Data	Resilient Flooring and Accessories	2.7												
409			09 65 00	3	Product Data	Adhesives	2.4												
410			09 65 00	3	Product Data	Luxury Vinyl Tile	2.1												
411			09 65 00	3	Product Data	Recycled content for Luxury Vinyl Tile	2.1	S											
412			09 65 00	3	Product Data	Wall Base													
413			09 65 00	4	Samples	Resilient Flooring and Accessories	2.7	G											
414			09 65 00	6	Test Reports	Moisture, Alkalinity and Bond Tests	3.3	G											
415			09 65 00	7	Certificates	Indoor Air Quality for Luxury Vinyl Tile		S											
416			09 65 00	7	Certificates	Indoor Air Quality for Wall Base		S											
417			09 65 00	7	Certificates	Indoor Air Quality for Adhesives		S											
418			09 65 00	8	Manufacturer's Instructions	Surface Preparation	3.2												
419			09 65 00	8	Manufacturer's Instructions	Installation	3.1												
420			09 65 00	10	Operation and Maintenance Data	Resilient Flooring and Accessories	2.7												
421			09 68 00	2	Shop Drawings	Installation Drawings	3.4	G											
422			09 68 00	3	Product Data	Carpet	2.1	G											
423			09 68 00	3	Product Data	Recycled Content for Carpeting		S											
424			09 68 00	3	Product Data	Moldings	2.4	G											
425			09 68 00	4	Samples	Carpet	2.1	G											
426			09 68 00	4	Samples	Moldings	2.4	G											
427			09 68 00	6	Test Reports	Moisture and Alkalinity Tests	3.2	G											
428			09 68 00	8	Manufacturer's Instructions	Surface Preparation	3.1												
429			09 68 00	11	Closeout Submittals	Warranty	1.6												
430			09 84 20	2	Shop Drawings	Approved Detail Drawings	2.2	G											
431			09 84 20	3	Product Data	Installation	3.2												
432			09 84 20	3	Product Data	Acoustical Wall Panels	2.2	G											
433			09 84 20	3	Product Data	Recycled Content for Wood Panels		S											
434			09 84 20	3	Product Data	Recycled Content for Fabric Panels	2.1.1.1	S											
435			09 84 20	3	Product Data	Indoor Air Quality for Composite Wood and Agrifiber Products	2.1.1.1	S											
436			09 84 20	4	Samples	Acoustical Wall Panels	2.2	G											
437			09 84 20	7	Certificates	Acoustical Wall Panels	2.2												
438			09 84 20	7	Certificates	Certified Sustainably Harvested Wood		S											
439			09 84 20	11	Closeout Submittals	Warranty	1.4												
440			09 90 00	2	Shop Drawings	Piping identification	3.9												
441			09 90 00	2	Shop Drawings	stencil	3.9												
442			09 90 00	3	Product Data	Environmental Data													
443			09 90 00	3	Product Data	Materials	2.1												
444			09 90 00	3	Product Data	Coating	2.1												
445			09 90 00	3	Product Data	Manufacturer's Technical Data Sheets	2.1												
446			09 90 00	3	Product Data	Sealant	3.2.5												
447			10 14 00.20	2	Shop Drawings	Detail Drawings	1.4.2	G											
448			10 14 00.20	3	Product Data	Room Identification And Directional Signage System	2.1	G											
449			10 14 00.20	3	Product Data	Exit Door Tactile Sign	2.2	G											
450			10 14 00.20	4	Samples	Interior Signage	1.4.1	G											
451			10 14 00.20	4	Samples	Software	1.3	G											
452			10 14 00.20	10	Operation and Maintenance Data	Approved Manufacturer's Instructions	3.2	G											

453			10 14 00.20	10	Operation and Maintenance Data	Protection and Cleaning	3.2.2	G											
454			10 21 13	2	Shop Drawings	Fabrication Drawings	2.1												
455			10 21 13	2	Shop Drawings	Installation Drawings	3.2	G											
456			10 21 13	3	Product Data	Cleaning and Maintenance Instructions	2.1												
457			10 21 13	3	Product Data	Colors And Finishes	2.7												
458			10 21 13	3	Product Data	Anchoring Devices and Fasteners	2.2.2												
459			10 21 13	3	Product Data	Hardware and Fittings	2.2.4												
460			10 21 13	3	Product Data	Brackets	2.2.3												
461			10 21 13	3	Product Data	Door Hardware	2.2.5												
462			10 21 13	3	Product Data	Toilet Enclosures	2.3.1												
463			10 21 13	3	Product Data	Urinal Screens	2.3.2												
464			10 21 13	3	Product Data	Pilaster Shoes	2.5												
465			10 21 13	3	Product Data	Finishes	2.2.4.2	G											
466			10 21 13	3	Product Data	Finishes	2.7.2	G											
467			10 21 13	4	Samples	Colors and Finishes	2.7	G											
468			10 21 13	4	Samples	Hardware and Fittings	2.2.4												
469			10 21 13	4	Samples	Anchoring Devices and Fasteners	2.2.2												
470			10 21 13	7	Certificates	Warranty	1.6												
471			10 21 13	10	Operation and Maintenance Data	Plastic Identification	2.1.1	G											
472			10 26 00	2	Shop Drawings	Corner Guards	2.2	G											
473			10 26 00	2	Shop Drawings	Wall Covering and Panels	2.3	G											
474			10 26 00	3	Product Data	Corner Guards	2.2	G											
475			10 26 00	3	Product Data	Wall Covering and Panels	2.3	G											
476			10 26 00	3	Product Data	Recycled content for aluminum component of corner guards	2.2.1												
477			10 26 00	3	Product Data	Recycled content for steel component of corner guards		S											
478			10 26 00	4	Samples	Corner Guards	2.2	G											
479			10 26 00	4	Samples	Wall Covering and Panels	2.3	G											
480			10 26 00	6	Test Reports	Fire Resistance Rating	2.1.1.2												
481			10 26 00	7	Certificates	Indoor air quality for wall covering/panels	2.3	S											
482			10 26 00	7	Certificates	Indoor air quality for adhesives	2.6	S											
483			10 26 00	10	Operation and Maintenance Data	Corner Guards	2.2	G											
484			10 26 00	10	Operation and Maintenance Data	Wall Covering and Panels	2.3	G											
485			10 28 13	3	Product Data	Finishes	2.1.2	G											
486			10 28 13	3	Product Data	Accessory Items	2.2	G											
487			10 28 13	4	Samples	Finishes	2.1.2	G											
488			10 28 13	4	Samples	Accessory Items	2.2												
489			10 44 16	3	Product Data	Fire Extinguishers	2.1.1	G											
490			10 44 16	3	Product Data	Accessories	Part 2	G											
491			10 44 16	3	Product Data	Cabinets	Part 2	G											
492			10 44 16	3	Product Data	Wall Brackets	2.2.2	G											
493			10 44 16	7	Certificates	Fire Extinguishers Certifications	2.1.1	G											
494			10 44 16	7	Certificates	Manufacturer's Warranty with Inspection Tag	1.4	G											
495			12 24 13	2	Shop Drawings	Detailed Drawings	3.3	G											
496			12 24 13	2	Shop Drawings	Location Schedule	2.1	G											
497			12 24 13	3	Product Data	Window Shades	2.1	G											
498			12 24 13	3	Product Data	Recycled Content for various fiber components	2.1	S											
499			12 24 13	4	Samples	Window Shades	2.1	G											
500			12 24 13	6	Test Reports	Flammability Requirements	1.4.2	G											
501			12 24 13	7	Certificates	Indoor Air Quality for roller window shades	2.1	S											
502			12 24 13	7	Certificates	Qualifications	1.4.1.1												

503			12 24 13	10	Operation and Maintenance Data	Window Shades	2.1	G											
504			21 13 13	1	Preconstruction Submittals	Qualified Fire Protection Engineer (QFPE)	1.2.3	G											
505			21 13 13	1	Preconstruction Submittals	Sprinkler System Designer	1.4.2.1	G											
506			21 13 13	1	Preconstruction Submittals	Sprinkler System Installer	1.4.2.2	G											
507			21 13 13	2	Shop Drawings	Shop Drawing	1.2.1.1	G											
508			21 13 13	3	Product Data	Pipe	2.2.1	G											
509			21 13 13	3	Product Data	Fittings	2.3.1.2	G											
510			21 13 13	3	Product Data	Valves	2.3.3	G											
511			21 13 13	3	Product Data	Alarm Valves	2.3.4	G											
512			21 13 13	3	Product Data	Relief Valves	2.8.5	G											
513			21 13 13	3	Product Data	Sprinklers	2.7	G											
514			21 13 13	3	Product Data	Pipe Hangers and Supports	2.3.2	G											
515			21 13 13	3	Product Data	Sprinkler Alarm Switch	2.4.1	G											
516			21 13 13	3	Product Data	Valve Supervisory (Tamper) Switch	2.4.2	G											
517			21 13 13	3	Product Data	Fire Department Connection	2.6	G											
518			21 13 13	3	Product Data	Backflow Prevention Assembly	2.5	G											
519			21 13 13	3	Product Data	Air Vent	2.8.6	G											
520			21 13 13	3	Product Data	Hose Valve	2.5.1	G											
521			21 13 13	3	Product Data	Nameplates	2.1.2	G											
522			21 13 13	5	Design Data	Hydraulic Calculations	1.2.1.2	G											
523			21 13 13	6	Test Reports	Test Procedures	3.7.1	G											
524			21 13 13	7	Certificates	Verification of Compliant Installation	3.7.2.1	G											
525			21 13 13	7	Certificates	Request for Government Final Test	3.7.2.2	G											
526			21 13 13	10	Operation and Maintenance Data	Operating and Maintenance (O&M) Instructions	3.9	G											
527			21 13 13	10	Operation and Maintenance Data	Spare Parts	1.6	G											
528			21 13 13	11	Closeout Submittals	As-built drawings	3.9												
529			22 00 00	2	Shop Drawings	Plumbing System	3.9.1												
530			22 00 00	3	Product Data	Fixtures	2.5												
531			22 00 00	3	Product Data	Flush Valve Water Closets	2.5.1												
532			22 00 00	3	Product Data	Flush Valve Urinals	2.5.2												
533			22 00 00	3	Product Data	Wall Hung Lavatories	2.5.3												
534			22 00 00	3	Product Data	Countertop Lavatories	2.5.4												
535			22 00 00	3	Product Data	Kitchen Sinks	2.5.5												
536			22 00 00	3	Product Data	Mop/Service Sinks	2.5.8												
537			22 00 00	3	Product Data	Drinking-Water Coolers	2.5.6	G											
538			22 00 00	3	Product Data	Plastic Shower Stalls	2.5.7												
539			22 00 00	3	Product Data	Water Heaters	2.9	G											
540			22 00 00	3	Product Data	Pumps	2.1	G											
541			22 00 00	3	Product Data	Backflow Prevention Assemblies	3.9.1.1	G											
542			22 00 00	3	Product Data	Shower Faucets	2.7.2	G											
543			22 00 00	3	Product Data	Welding	1.5.1												
544			22 00 00	3	Product Data	Vibration-Absorbing Features	3.4												
545			22 00 00	6	Test Reports	Tests, Flushing and Disinfection	3.9												
546			22 00 00	6	Test Reports	Test of Backflow Prevention Assemblies	3.9.1.1	G											
547			22 00 00	7	Certificates	Materials and Equipment	1.3												
548			22 00 00	7	Certificates	Bolts	2.2.1												
549			22 00 00	10	Operation and Maintenance Data	Plumbing System	3.9.1												
550			22 00 00	11	Closeout Submittals	Water-Efficient Products	2.1.1												
551			22 00 00	11	Closeout Submittals	Energy-Efficient Water Heaters	2.1.2												
552			23 05 93	1	Preconstruction Submittals	Records of Existing Conditions	1.3.3	G											
553			23 05 93	1	Preconstruction Submittals	TAB Firm	1.5.3.1	G											
554			23 05 93	1	Preconstruction Submittals	TAB Team Assistants	1.2	G											
555			23 05 93	1	Preconstruction Submittals	TAB Team Engineer	1.2	G											

556			23 05 93	1	Preconstruction Submittals	TAB Specialist	1.5.3.2	G											
557			23 05 93	1	Preconstruction Submittals	TAB Team Field Leader	1.2	G											
558			23 05 93	2	Shop Drawings	TAB Schematic Drawings and Report Forms	1.3.3	G											
559			23 05 93	3	Product Data	Equipment and Performance Data	1.3	G											
560			23 05 93	3	Product Data	TAB Related HVAC Submittals	1.5.3.4	G											
561			23 05 93	3	Product Data	TAB Procedures	1.5.2	G											
562			23 05 93	3	Product Data	Calibration	1.5.2	G											
563			23 05 93	3	Product Data	Systems Readiness Check	1.3.3	G											
564			23 05 93	3	Product Data	TAB Execution	1.5.4	G											
565			23 05 93	3	Product Data	TAB Verification	1.5.4.3	G											
566			23 05 93	6	Test Reports	Completed Pre-Final DALT Report	3.3.5	G											
567			23 05 93	6	Test Reports	Certified Final DALT Report	3.3.8	G											
568			23 05 93	6	Test Reports	TAB Design Review Report	1.7.1.1	G											
569			23 05 93	6	Test Reports	TAB Report for Season 1	1.5.5.2	G											
570			23 05 93	6	Test Reports	TAB Report for Season 2	1.5.5.2	G											
571			23 05 93	7	Certificates	Independent TAB Agency and Personnel Qualifications	1.5.1	G											
572			23 05 93	7	Certificates	DALT and TAB Submittal and Work Schedule	1.7.1	G											
573			23 05 93	7	Certificates	TAB Pre-Field Engineering Report	1.7.1.3	G											
574			23 05 93	7	Certificates	TAB Firm	1.5.3.1	G											
575			23 05 93	7	Certificates	Design Review Report	1.3.3	G											
576			23 05 93	7	Certificates	Pre-field DALT Preliminary Notification	1.7.1.2	G											
577			23 05 93	7	Certificates	Advanced Notice for TAB Field Work	1.7.1	G											
578			23 07 00	2	Shop Drawings	Pipe Insulation Systems	2.3												
579			23 07 00	2	Shop Drawings	Pipe Insulation Systems	3.2												
580			23 07 00	2	Shop Drawings	Duct Insulation Systems	3.3												
581			23 07 00	2	Shop Drawings	Equipment Insulation Systems	3.4												
582			23 07 00	3	Product Data	Pipe Insulation Systems	2.3	G											
583			23 07 00	3	Product Data	Pipe Insulation Systems	3.2	G											
584			23 07 00	3	Product Data	Duct Insulation Systems	3.3	G											
585			23 07 00	3	Product Data	Equipment Insulation Systems	3.4	G											
586			23 07 00	4	Samples	Thermal Insulation	2.2.1.3	G											
587			23 07 00	8	Manufacturer's Instructions	Pipe Insulation Systems	2.3	G											
588			23 07 00	8	Manufacturer's Instructions	Pipe Insulation Systems	3.2	G											
589			23 07 00	8	Manufacturer's Instructions	Duct Insulation Systems	3.3	G											
590			23 07 00	8	Manufacturer's Instructions	Equipment Insulation Systems	3.4	G											
591			23 09 00	2	Shop Drawings	DDC Contractor Design Drawings	3.3	G											
592			23 09 00	2	Shop Drawings	Draft As-Built Drawings	3.3	G											
593			23 09 00	2	Shop Drawings	Final As-Built Drawings	3.3	G											
594			23 09 00	3	Product Data	Programming Software	1.8.3	G											
595			23 09 00	3	Product Data	Controller Application Programs	1.8.4	G											
596			23 09 00	3	Product Data	Configuration Software	1.8.1	G											
597			23 09 00	3	Product Data	Controller Configuration Settings	1.8.2	G											
598			23 09 00	3	Product Data	Proprietary Multi-Split Engineering Tool Software	1.1.1.3	G											
599			23 09 00	3	Product Data	Manufacturer's Product Data	2.2	G											
600			23 09 00	3	Product Data	Niagara Framework Supervisory Gateway Backups	1.8.5	G											
601			23 09 00	5	Design Data	Boiler Or Chiller Plant Gateway Request	1.9												
602			23 09 00	6	Test Reports	Existing Conditions Report	3.1.1												
603			23 09 00	6	Test Reports	Pre-Construction Quality Control (QC) Checklist	1.10.1	G											
604			23 09 00	6	Test Reports	Post-Construction Quality Control (QC) Checklist	1.10.2	G											
605			23 09 00	6	Test Reports	Start-Up Testing Report	3.5.2	G											
606			23 09 00	6	Test Reports	PVT Procedures	3.6.1	G											

607			23 09 00	6	Test Reports	PVT Report	3.6.3	G											
608			23 09 00	10	Operation and Maintenance Data	Operation and Maintenance (O&M) Instructions	3.7	G											
609			23 09 00	10	Operation and Maintenance Data	Training Documentation	3.9.1	G											
610			23 09 00	11	Closeout Submittals	Enclosure Keys	2.5	G											
611			23 09 00	11	Closeout Submittals	Password Summary Report	3.2.6.1	G											
612			23 09 00	11	Closeout Submittals	Closeout Quality Control (QC) Checklist	1.10.3	G											
613			23 21 23	2	Shop Drawings	System Coordination	2.1.2	G											
614			23 21 23	3	Product Data	Instructions	2.2.2	G											
615			23 21 23	3	Product Data	Equipment Data	2.2.5	G											
616			23 21 23	3	Product Data	Training Period	3.5.2	G											
617			23 21 23	6	Test Reports	Factory Tests	2.8												
618			23 21 23	6	Test Reports	Field Quality Control	3.3												
619			23 21 23	7	Certificates	Manufacturer's Representative	1.3.1												
620			23 21 23	10	Operation and Maintenance Data	Operation and Maintenance Manuals	3.5.1	G											
621			23 21 23	10	Operation and Maintenance Data	Training	3.5.2	G											
622			23 23 00	2	Shop Drawings	Refrigerant Piping System	2.3	G											
623			23 23 00	3	Product Data	Refrigerant Piping System	2.3												
624			23 23 00	3	Product Data	Qualifications	1.3.1												
625			23 23 00	3	Product Data	Refrigerant Piping Tests	3.5												
626			23 23 00	6	Test Reports	Refrigerant Piping Tests	3.5												
627			23 23 00	10	Operation and Maintenance Data	Maintenance	1.5	G											
628			23 23 00	10	Operation and Maintenance Data	Operation and Maintenance Manuals	3.4	G											
629			23 30 00	2	Shop Drawings	Detail Drawings	1.4.3	G											
630			23 30 00	3	Product Data	Metallic Flexible Duct	2.9.1.1												
631			23 30 00	3	Product Data	Insulated Nonmetallic Flexible Duct Runouts	2.9.1.2												
632			23 30 00	3	Product Data	Duct Connectors	2.9.1.2												
633			23 30 00	3	Product Data	Duct Access Doors	2.9.2	G											
634			23 30 00	3	Product Data	Manual Balancing Dampers	2.9.3	G											
635			23 30 00	3	Product Data	Diffusers	2.9.6.1												
636			23 30 00	3	Product Data	Registers and Grilles	2.9.6.2												
637			23 30 00	3	Product Data	Louvers	2.9.7												
638			23 30 00	3	Product Data	Air Vents	2.9.8												
639			23 30 00	3	Product Data	In-Line Centrifugal Fans	2.10.1.1												
640			23 30 00	3	Product Data	Panel Type Power Wall Ventilators	2.10.1.2												
641			23 30 00	3	Product Data	Test Procedures	1.4.4												
642			23 30 00	3	Product Data	Diagrams	1.2.1.2	G											
643			23 30 00	3	Product Data	Indoor Air Quality for Duct Sealants	2.9.1	S											
644			23 30 00	6	Test Reports	Performance Tests	3.11	G											
645			23 30 00	6	Test Reports	Damper Acceptance Test	3.9	G											
646			23 30 00	8	Manufacturer's Instructions	Manufacturer's Installation Instructions	3.2												
647			23 30 00	8	Manufacturer's Instructions	Operation and Maintenance Training	3.13.2												
648			23 30 00	10	Operation and Maintenance Data	Operation and Maintenance Manuals	3.13.1	G											
649			23 30 00	10	Operation and Maintenance Data	Manual Balancing Dampers	2.9.3	G											
650			23 30 00	10	Operation and Maintenance Data	In-Line Centrifugal Fans	2.10.1.1	G											
651			23 30 00	10	Operation and Maintenance Data	Panel Type Power Wall Ventilators	2.10.1.2	G											
652			23 30 00	11	Closeout Submittals	Indoor Air Quality During Construction	3.12	S											
653			23 64 10	3	Product Data	Water Chiller	2.4	G											
654			23 64 10	3	Product Data	Verification of Dimensions	1.5.1												
655			23 64 10	3	Product Data	Demonstrations	3.3												

656			23 64 10	7	Certificates	Refrigeration System	3.1.4	G											
657			23 64 10	8	Manufacturer's Instructions	Water Chiller - Installation Instructions	3.1	G											
658			23 64 10	10	Operation and Maintenance Data	Operation and Maintenance Manuals	3.3	G											
659			23 64 26	3	Product Data	Grooved Mechanical Connections For Steel	2.2.2.4	G											
660			23 64 26	3	Product Data	Grooved Mechanical Connections For Copper	2.3.3	G											
661			23 64 26	3	Product Data	Calibrated Balancing Valves	2.4.8	G											
662			23 64 26	3	Product Data	Pump Discharge Valve	2.4.9	G											
663			23 64 26	3	Product Data	Pressure Relief Valve	2.4.11	G											
664			23 64 26	3	Product Data	Expansion Joints	2.5.9	G											
665			23 64 26	3	Product Data	Combination Strainer and Pump Suction Diffuser	2.5.3	G											
666			23 64 26	3	Product Data	Expansion Tanks	2.7	G											
667			23 64 26	3	Product Data	Air Separator Tanks	2.8	G											
668			23 64 26	6	Test Reports	Piping Welds NDE Report	3.1.1.1												
669			23 64 26	6	Test Reports	Pressure Tests Reports	3.4.2	G											
670			23 64 26	10	Operation and Maintenance Data	Calibrated Balancing Valves	2.4.8	G											
671			23 64 26	10	Operation and Maintenance Data	Pump Discharge Valve	2.4.9	G											
672			23 64 26	10	Operation and Maintenance Data	Water Pressure Reducing Valve	2.4.10	G											
673			23 64 26	10	Operation and Maintenance Data	Pressure Relief Valve	2.4.11	G											
674			23 64 26	10	Operation and Maintenance Data	Expansion Joints	2.5.9	G											
675			23 64 26	10	Operation and Maintenance Data	Pumps	2.6	G											
676			23 64 26	10	Operation and Maintenance Data	Combination Strainer and Pump Suction Diffuser	2.5.3	G											
677			23 64 26	10	Operation and Maintenance Data	Expansion Tanks	2.7	G											
678			23 64 26	10	Operation and Maintenance Data	Air Separator Tanks	2.8	G											
679			23 73 13.00 40	2	Shop Drawings	Installation Drawings	3.2	G											
680			23 73 13.00 40	2	Shop Drawings	Fabrication and Connection Drawings	2.1	G											
681			23 73 13.00 40	3	Product Data	Equipment and Performance Data	2.1	G											
682			23 73 13.00 40	3	Product Data	Sample Warranty	1.3.2	G											
683			23 73 13.00 40	3	Product Data	Air Filter Gauges	2.2.8.4	G											
684			23 73 13.00 40	6	Test Reports	Final Test Reports	3.3.3	G											
685			23 73 13.00 40	7	Certificates	List of Product Installations	1.3												
686			23 73 13.00 40	7	Certificates	Certificates of Conformance	1.3.1	G											
687			23 73 13.00 40	7	Certificates	Unit Cabinet	2.2.2												
688			23 73 13.00 40	7	Certificates	Fan	2.2.3												
689			23 73 13.00 40	7	Certificates	Drain Pans	2.2.4												
690			23 73 13.00 40	7	Certificates	Insulation	2.2.5												
691			23 73 13.00 40	7	Certificates	Spare Parts	2.1												
692			23 73 13.00 40	10	Operation and Maintenance Data	Operation and Maintenance Manuals	3.4.1												
693			23 73 13.00 40	11	Closeout Submittals	Warranty	1.5												
694			23 81 23	3	Product Data	Computer Room Air Conditioner	2.1	G											
695			23 81 23	3	Product Data	Small Computer Room Air Conditioners	2.2	G											
696			23 81 23	3	Product Data	Space Temperature Control System Drawings	2.6.3	G											
697			23 81 23	3	Product Data	Filters	2.1.5												
698			23 81 23	3	Product Data	Refrigerants	1.4	G											
699			23 81 23	3	Product Data	Leak Detection	2.3.1.3	G											
700			23 81 23	6	Test Reports	Manufacturer's Factory Test Plans	2.8.1	G											
701			23 81 23	6	Test Reports	Factory Test Reports	2.8.4	G											

702			23 81 23	6	Test Reports	Field Test Schedule	3.3.2	G											
703			23 81 23	6	Test Reports	Manufacturer's Field Test Plans	3.3.1	G											
704			23 81 23	6	Test Reports	Field Test Reports	3.3.6	G											
705			23 81 23	7	Certificates	Certificate of Specification Compliance	2.4	G											
706			23 81 23	7	Certificates	Credentials of the Manufacturer's Field Test Representative	3.3.3	G											
707			23 81 23	7	Certificates	Ozone Depleting Substances Technician Certification	1.5.1												
708			23 81 23	7	Certificates	Certified List Of Qualified Permanent Service Organizations	1.6.3												
709			23 81 23	8	Manufacturer's Instructions	Installation Manual for Each Type of CRAC	3.1.2												
710			23 81 23	10	Operation and Maintenance Data	Computer Room Air Conditioner Operation and Maintenance Data	3.1.3	G											
711			23 81 23	11	Closeout Submittals	Indoor Air Quality During Construction	3.2	G											
712			23 82 19.00 40	2	Shop Drawings	Fabrication Drawings	2.2	G											
713			23 82 19.00 40	2	Shop Drawings	Installation Drawings	3.1	G											
714			23 82 19.00 40	3	Product Data	Equipment and Performance Data	2.2	G											
715			23 82 19.00 40	3	Product Data	Coils	2.2	G											
716			23 82 19.00 40	3	Product Data	Casing	2.2	G											
717			23 82 19.00 40	3	Product Data	Enclosure	2.2	G											
718			23 82 19.00 40	3	Product Data	Motors	2.2	G											
719			23 82 19.00 40	3	Product Data	Fan	2.2	G											
720			23 82 19.00 40	3	Product Data	Drain Pans	2.2	G											
721			23 82 19.00 40	3	Product Data	Filters	2.2	G											
722			23 82 19.00 40	3	Product Data	Controls	2.2	G											
723			23 82 19.00 40	3	Product Data	Vibration Isolation	2.2	G											
724			23 82 19.00 40	4	Samples	Manufacturer's Standard Color Chart	2.2	G											
725			23 82 19.00 40	7	Certificates	List of Product Installations	1.3												
726			23 82 19.00 40	7	Certificates	Certificates of Conformance	2.2												
727			23 82 19.00 40	10	Operation and Maintenance Data	Operation and Maintenance Manuals	3.3												
728			23 82 19.00 40	11	Closeout Submittals	Warranty	3.3												
729			26 20 00	2	Shop Drawings	Panelboards	2.12	G											
730			26 20 00	2	Shop Drawings	Transformers	2.13	G											
731			26 20 00	2	Shop Drawings	Cable Trays	2.3	G											
732			26 20 00	3	Product Data	Receptacles	2.11	G											
733			26 20 00	3	Product Data	Circuit Breakers	2.12.3	G											
734			26 20 00	3	Product Data	Switches	2.1	G											
735			26 20 00	3	Product Data	Transformers	2.13	G											
736			26 20 00	3	Product Data	Motor Controllers	2.15	G											
737			26 20 00	3	Product Data	Manual Motor Starters	2.16	G											
738			26 20 00	3	Product Data	Metering	2.25	G											
739			26 20 00	3	Product Data	CATV Outlets		G											
740			26 20 00	3	Product Data	Secondary Bonding Busbar		G											
741			26 20 00	3	Product Data	Surge Protective Devices	2.26	G											
742			26 20 00	3	Product Data	Cable Trays	2.3	G											
743			26 20 00	3	Product Data	Cable Tray Design	2.3	G											
744			26 20 00	6	Test Reports	600-volt Wiring Test	3.5.2	G											
745			26 20 00	6	Test Reports	Grounding System Test	3.5.6	G											
746			26 20 00	6	Test Reports	Transformer Tests	3.5.3	G											
747			26 20 00	6	Test Reports	Ground-fault Receptacle Test	3.5.4	G											
748			26 20 00	10	Operation and Maintenance Data	Electrical Systems	1.5.1	G											
749			26 24 13	2	Shop Drawings	Switchboard Drawings	1.5.2	G											
750			26 24 13	3	Product Data	Switchboard	2.2	G											
751			26 24 13	6	Test Reports	Switchboard Design Tests	2.5.2	G											
752			26 24 13	6	Test Reports	Switchboard Production Tests	2.5.3	G											

753			26 24 13	6	Test Reports	Acceptance Checks and Tests	3.5.1	G											
754			26 24 13	7	Certificates	Cybersecurity Installation Certification	3.5.1.7	G											
755			26 24 13	10	Operation and Maintenance Data	Switchboard Operation and Maintenance	1.6.1	G											
756			26 24 13	11	Closeout Submittals	Assembled Operation and Maintenance Manuals	1.6.2	G											
757			26 24 13	11	Closeout Submittals	Equipment Test Schedule	2.5.1	G											
758			26 24 13	11	Closeout Submittals	Required Settings	3.5	G											
759			26 24 13	11	Closeout Submittals	Service Entrance Available Fault Current Label	2.8	G											
760			26 28 01.00 10	3	Product Data	Fault Current Analysis	2.1												
761			26 28 01.00 10	3	Product Data	Protective Device Coordination Study	2.1												
762			26 28 01.00 10	3	Product Data	System Coordinator	1.4.1												
763			26 29 23	2	Shop Drawings	Schematic Diagrams	1.5.1	G											
764			26 29 23	2	Shop Drawings	Interconnecting Diagrams	1.5.2	G											
765			26 29 23	2	Shop Drawings	Installation Drawings	1.5.3	G											
766			26 29 23	2	Shop Drawings	As-Built Drawings	1.5.3	G											
767			26 29 23	3	Product Data	Adjustable Speed Drives	2.1	G											
768			26 29 23	3	Product Data	Wires and Cables	2.3												
769			26 29 23	3	Product Data	Equipment Schedule	1.5.4												
770			26 29 23	6	Test Reports	ASD Test	3.3.1												
771			26 29 23	6	Test Reports	Performance Verification Tests	3.3.2												
772			26 29 23	6	Test Reports	Endurance Test	3.3.3												
773			26 29 23	8	Manufacturer's Instructions	Installation instructions	1.5.5												
774			26 29 23	9	Manufacturer's Field Reports	ASD Test Plan	2.5.1	G											
775			26 29 23	9	Manufacturer's Field Reports	Standard Products	1.5.6												
776			26 29 23	10	Operation and Maintenance Data	Adjustable Speed Drives	2.1												
777			26 32 15.00	2	Shop Drawings	Engine-Generator Set and Auxiliary Equipment	2.1.1	G											
778			26 32 15.00	2	Shop Drawings	Auxiliary Systems	1.4.9	G											
779			26 32 15.00	2	Shop Drawings	Detailed Drawings	1.4.8	G											
780			26 32 15.00	2	Shop Drawings	Acceptance	3.17	G											
781			26 32 15.00	3	Product Data	Harmonic Requirements	2.1.8	G											
782			26 32 15.00	3	Product Data	Engine-Generator Set Efficiencies	2.1.1	G											
783			26 32 15.00	3	Product Data	Emissions	2.13	G											
784			26 32 15.00	3	Product Data	filters	2.7.2	G											
785			26 32 15.00	3	Product Data	special tools	2.15	G											
786			26 32 15.00	3	Product Data	Remote Alarm Annunciator	2.14.4	G											
787			26 32 15.00	3	Product Data	Engine-Generator Parameter Schedule	2.1.1												
788			26 32 15.00	3	Product Data	Heat Exchanger	2.8.2												
789			26 32 15.00	3	Product Data	Generator	2.16												
790			26 32 15.00	3	Product Data	Manufacturer's Catalog	2.5												
791			26 32 15.00	3	Product Data	Site Welding	1.4.2												
792			26 32 15.00	3	Product Data	Spare Parts	1.7.2												
793			26 32 15.00	3	Product Data	Onsite Training	3.12												
794			26 32 15.00	3	Product Data	Vibration-Isolation	2.1.7												
795			26 32 15.00	3	Product Data	Posted Data and Instructions	3.16	G											
796			26 32 15.00	3	Product Data	Instructions	3.6.7.1	G											
797			26 32 15.00	3	Product Data	Experience	1.4.6												
798			26 32 15.00	3	Product Data	Field Engineer	1.4.7												
799			26 32 15.00	3	Product Data	General Installation	3.2												
800			26 32 15.00	3	Product Data	Exciter	2.17												
801			26 32 15.00	5	Design Data	Performance Criteria	2.16												
802			26 32 15.00	5	Design Data	Sound Limitations	2.9	G											
803			26 32 15.00	5	Design Data	Integral Main Fuel Storage Tank	2.6.4												
804			26 32 15.00	5	Design Data	Day Tank	2.6.5												

805			26 32 15.00	5	Design Data	Power Factor	3.6.1.2												
806			26 32 15.00	5	Design Data	Heat Exchanger	2.8.2												
807			26 32 15.00	5	Design Data	Time-Delay on Alarms	2.20.5												
808			26 32 15.00	5	Design Data	Cooling System	2.8												
809			26 32 15.00	5	Design Data	Vibration Isolation	2.1.7												
810			26 32 15.00	5	Design Data	Battery Charger	2.14.3.2												
811			26 32 15.00	5	Design Data	Capacity Calculations for Engine-Generator Set	2.1.1	G											
812			26 32 15.00	5	Design Data	Brake Mean Effective Pressure (BMEP) Calculations	2.1.1	G											
813			26 32 15.00	5	Design Data	Torsional Vibration Stress Analysis Computations	2.1.1	G											
814			26 32 15.00	5	Design Data	Capacity Calculations for Batteries	2.1.1	G											
815			26 32 15.00	5	Design Data	Turbocharger Load Calculations	2.1.1	G											
816			26 32 15.00	6	Test Reports	Performance Tests	3.6.9												
817			26 32 15.00	6	Test Reports	Factory Inspection and Tests	2.3												
818			26 32 15.00	6	Test Reports	Factory Tests	2.30.2												
819			26 32 15.00	6	Test Reports	Onsite Inspection and Tests	3.6	G											
820			26 32 15.00	6	Test Reports	Acceptance Checks and Tests	3.9.2	G											
821			26 32 15.00	6	Test Reports	Functional Acceptance Tests	3.10.2	G											
822			26 32 15.00	6	Test Reports	Maintenance Procedures	3.12	G											
823			26 32 15.00	6	Test Reports	Operation and Maintenance Manuals	3.12	G											
824			26 32 15.00	6	Test Reports	Inspections	3.6.3	G											
825			26 32 15.00	6	Test Reports	Functional Acceptance Test Procedure	3.9.6	G											
826			26 32 15.00	7	Certificates	Cooling System	2.8												
827			26 32 15.00	7	Certificates	Vibration Isolation	2.1.7												
828			26 32 15.00	7	Certificates	Prototype Test	2.30.2												
829			26 32 15.00	7	Certificates	Reliability and Durability	2.1.5												
830			26 32 15.00	7	Certificates	Fuel System Certification	1.4.12	G											
831			26 32 15.00	7	Certificates	Start-Up Engineer	3.8	G											
832			26 32 15.00	7	Certificates	Instructor's Qualification Resume	3.11.1	G											
833			26 32 15.00	7	Certificates	Engine Emission Limits	2.1.2.1	G											
834			26 32 15.00	7	Certificates	Sound Limitations	2.9												
835			26 32 15.00	7	Certificates	Site Visit	3.1												
836			26 32 15.00	7	Certificates	Current Balance	2.16.1												
837			26 32 15.00	7	Certificates	Materials and Equipment	2.4												
838			26 32 15.00	7	Certificates	Factory Inspection and Tests	2.3												
839			26 32 15.00	7	Certificates	Engine Tests	3.6.4	G											
840			26 32 15.00	7	Certificates	Generator Tests	3.6.5	G											
841			26 32 15.00	7	Certificates	Assembled Engine-Generator Set Tests	3.6.6	G											
842			26 32 15.00	10	Operation and Maintenance Data	Preliminary Assembled Operation and Maintenance Manuals	3.9.5	G											
843			26 32 15.00	10	Operation and Maintenance Data	Posted Data and Instructions	3.16	G											
844			26 32 15.00	10	Operation and Maintenance Data	Training Plan	3.11.2	G											
845			26 36 23	2	Shop Drawings	Automatic Transfer Switch Drawings	1.5.2	G											
846			26 36 23	3	Product Data	Automatic Transfer Switches	2.1	G											
847			26 36 23	3	Product Data	By-Pass/Isolation Switch (BP/IS)	2.2	G											
848			26 36 23	3	Product Data	Remote Annunciator Panel		G											
849			26 36 23	3	Product Data	Remote Annunciator and Control System Panel	2.4	G											
850			26 36 23	6	Test Reports	Acceptance Checks and Tests	3.3.1	G											
851			26 36 23	6	Test Reports	Functional Acceptance Tests	3.3.2	G											
852			26 36 23	6	Test Reports	Factory Testing	2.5	G											
853			26 36 23	6	Test Reports	Factory Test Reports	2.5.2	G											
854			26 36 23	7	Certificates	Proof of Listing	1.5.1	G											

855			26 36 23	10	Operation and Maintenance Data	Operation and Maintenance Manual	1.4	G											
856			26 51 00	2	Shop Drawings	Luminaire Drawings	1.5.1	G											
857			26 51 00	2	Shop Drawings	Occupancy/Vacancy Sensor Coverage Layout	1.5.9	G											
858			26 51 00	3	Product Data	Luminaires	2.2	G											
859			26 51 00	3	Product Data	Light Sources	2.3	G											
860			26 51 00	3	Product Data	LED Drivers	2.4	G											
861			26 51 00	3	Product Data	Luminaire Warranty	1.6.1	G											
862			26 51 00	3	Product Data	Lighting Contactor	2.5.1.1.1	G											
863			26 51 00	3	Product Data	Switches	2.5.2.1	G											
864			26 51 00	3	Product Data	Occupancy/Vacancy Sensors	2.5.2.3	G											
865			26 51 00	3	Product Data	Photosensors	2.5.2.4	G											
866			26 51 00	3	Product Data	Time Clocks	2.5.2.5	G											
867			26 51 00	3	Product Data	Power Packs	2.5.2.3.4	G											
868			26 51 00	3	Product Data	Exit Signs	2.6.1	G											
869			26 51 00	3	Product Data	Emergency Drivers	2.6.2	G											
870			26 51 00	5	Design Data	Luminaire Design Data	1.5.2	G											
871			26 51 00	5	Design Data	Photometric Plan	1.5.8	G											
872			26 51 00	6	Test Reports	ANSI/IES LM-79 Test Report	1.5.3	G											
873			26 51 00	6	Test Reports	ANSI/IES LM-80 Test Report	1.5.4	G											
874			26 51 00	6	Test Reports	ANSI/IES TM-21 Test Report	1.5.5	G											
875			26 51 00	6	Test Reports	ANSI/IES TM-30 Test Report	1.5.6	G											
876			26 51 00	6	Test Reports	Occupancy/Vacancy Sensor Verification Test	3.2.1.1	G											
877			26 51 00	6	Test Reports	Photosensor Verification Test	3.2.1.1	G											
878			26 51 00	7	Certificates	LED Driver and Dimming Switch Compatibility Certificate	1.5.7	G											
879			26 51 00	10	Operation and Maintenance Data	Lighting System	1.7.1	G											
880			26 51 00	10	Operation and Maintenance Data	Maintenance Staff Training Plan	3.3.2.1	G											
881			26 51 00	10	Operation and Maintenance Data	End-User Training Plan	3.3.2.2	G											
882			26 56 00	2	Shop Drawings	Luminaire Drawings	1.5.1.1	G											
883			26 56 00	2	Shop Drawings	Pole Drawings	1.5.1.2	G											
884			26 56 00	2	Shop Drawings	Control System One-Line Diagram	1.8.2	G											
885			26 56 00	2	Shop Drawings	Sequence of Operation for Exterior Lighting Control System	2.5.1	G											
886			26 56 00	3	Product Data	Luminaires	2.2	G											
887			26 56 00	3	Product Data	Light Sources	2.3	G											
888			26 56 00	3	Product Data	LED Drivers	2.4	G											
889			26 56 00	3	Product Data	Luminaire Warranty	1.7.1	G											
890			26 56 00	3	Product Data	Lighting Controls Warranty	1.7.2	G											
891			26 56 00	3	Product Data	Pole Warranty	1.7.3	G											
892			26 56 00	3	Product Data	Photosensors	2.5.2.2	G											
893			26 56 00	3	Product Data	Lighting Contactor	2.5.2.3	G											
894			26 56 00	3	Product Data	Poles	2.6	G											
895			26 56 00	3	Product Data	Brackets	2.6.2												
896			26 56 00	5	Design Data	Luminaire Design Data	1.5.2	G											
897			26 56 00	6	Test Reports	ANSI/IES LM-79 Test Report	1.5.3	G											
898			26 56 00	6	Test Reports	ANSI/IES LM-80 Test Report	1.5.4	G											
899			26 56 00	6	Test Reports	ANSI/IES TM-21 Test Report	1.5.5	G											
900			26 56 00	8	Manufacturer's Instructions	Poles	2.6												
901			26 56 00	10	Operation and Maintenance Data	Lighting System	1.8.1	G											
902			26 56 00	10	Operation and Maintenance Data	Exterior Lighting Control System	1.8.2	G											
903			26 56 00	10	Operation and Maintenance Data	Maintenance Staff Training Plan	3.3.1.1	G											
904			26 56 00	10	Operation and Maintenance Data	End-User Training Plan	3.3.1.2	G											

905			27 10 00	2	Shop Drawings	Telecommunications drawings	1.6.1.1	G											
906			27 10 00	2	Shop Drawings	Telecommunications Space Drawings	1.6.1.2	G											
907			27 10 00	3	Product Data	Telecommunications cabling	2.3	G											
908			27 10 00	3	Product Data	Patch panels	2.4.5	G											
909			27 10 00	3	Product Data	Telecommunications outlet/connector assemblies	2.5	G											
910			27 10 00	3	Product Data	Equipment support frame	2.4.2	G											
911			27 10 00	3	Product Data	Connector blocks	2.4.3	G											
912			27 10 00	6	Test Reports	Telecommunications cabling testing	3.5.1	G											
913			27 10 00	7	Certificates	Telecommunications Contractor	1.6.2.1	G											
914			27 10 00	7	Certificates	Key Personnel	1.6.2.2	G											
915			27 10 00	7	Certificates	Manufacturer Qualifications	1.6.2.3	G											
916			27 10 00	7	Certificates	Test plan	1.6.3	G											
917			27 10 00	9	Manufacturer's Field Reports	Factory reel tests	2.11.1	G											
918			27 10 00	10	Operation and Maintenance Data	Telecommunications cabling and pathway system	1.10.1	G											
919			27 10 00	11	Closeout Submittals	Record Documentation	1.10.2	G											
920			28 31 76	1	Preconstruction Submittals	Qualified Fire Protection Engineer (QFPE)	1.3.2	G											
921			28 31 76	1	Preconstruction Submittals	Fire alarm system designer	1.8.2.1	G											
922			28 31 76	1	Preconstruction Submittals	Supervisor	1.8.2.2	G											
923			28 31 76	1	Preconstruction Submittals	Technician	1.8.2.3	G											
924			28 31 76	1	Preconstruction Submittals	Installer	1.8.2.4	G											
925			28 31 76	1	Preconstruction Submittals	Test Technician	1.8.2.5	G											
926			28 31 76	1	Preconstruction Submittals	Fire Alarm System Site-Specific Software Acknowledgement	1.7	G											
927			28 31 76	2	Shop Drawings	Nameplates	1.8.1.3	G											
928			28 31 76	2	Shop Drawings	Instructions	2.2.4	G											
929			28 31 76	2	Shop Drawings	Wiring Diagrams	1.8.1.4	G											
930			28 31 76	2	Shop Drawings	System Layout	1.8.1.5	G											
931			28 31 76	2	Shop Drawings	Notification Appliances	1.8.1.6	G											
932			28 31 76	2	Shop Drawings	Initiating devices	1.8.1.7	G											
933			28 31 76	2	Shop Drawings	Amplifiers	1.8.1.8	G											
934			28 31 76	2	Shop Drawings	Battery Power	1.8.1.9	G											
935			28 31 76	2	Shop Drawings	Voltage Drop Calculations	1.8.1.10	G											
936			28 31 76	3	Product Data	Fire Alarm and Mass Notification Control Unit (FMCU)	2.3	G											
937			28 31 76	3	Product Data	Local Operating Console (LOC)	1.4.4	G											
938			28 31 76	3	Product Data	Amplifiers	1.8.1.8	G											
939			28 31 76	3	Product Data	Tone Generators	2.5	G											
940			28 31 76	3	Product Data	Digitalized voice generators	2.5	G											
941			28 31 76	3	Product Data	LCD Annunciator	2.6.1	G											
942			28 31 76	3	Product Data	Manual Stations	2.7	G											
943			28 31 76	3	Product Data	Smoke Detectors	2.8	G											
944			28 31 76	3	Product Data	Duct Smoke Detectors	2.8.2	G											
945			28 31 76	3	Product Data	Carbon monoxide detector	2.9	G											
946			28 31 76	3	Product Data	Addressable Interface Devices	2.1	G											
947			28 31 76	3	Product Data	Addressable Control Modules	2.11	G											
948			28 31 76	3	Product Data	Isolation Modules	2.12	G											
949			28 31 76	3	Product Data	Notification Appliances	1.8.1.6	G											
950			28 31 76	3	Product Data	Batteries	2.15.1	G											
951			28 31 76	3	Product Data	Battery Chargers	2.15.2	G											
952			28 31 76	3	Product Data	Supplemental Notification Appliance Circuit Panels	2.15.1.1	G											
953			28 31 76	3	Product Data	Auxiliary Power Supply Panels	2.15.1.1	G											
954			28 31 76	3	Product Data	Surge Protective Devices	2.16	G											
955			28 31 76	3	Product Data	Alarm Wiring	2.16	G											
956			28 31 76	3	Product Data	Back Boxes and Conduit	3.3.4	G											
957			28 31 76	3	Product Data	Ceiling Bridges	3.2.8	G											

958			28 31 76	3	Product Data	Terminal Cabinets	3.3.2	G											
959			28 31 76	3	Product Data	Automatic Fire Alarm Transceiver	2.18	G											
960			28 31 76	3	Product Data	Radio Transceiver and Interface Panels	2.18.1	G											
961			28 31 76	3	Product Data	Document Storage Cabinet	3.9.3	G											
962			28 31 76	6	Test Reports	Test Procedures	3.5.1	G											
963			28 31 76	7	Certificates	Verification of Compliant Installation	3.5.2.1	G											
964			28 31 76	7	Certificates	Request for Government Final Test	3.5.2.2	G											
965			28 31 76	10	Operation and Maintenance Data	Operation and Maintenance (O&M) Instructions	3.7	G											
966			28 31 76	10	Operation and Maintenance Data	Instruction of Government Employees	3.8	G											
967			28 31 76	11	Closeout Submittals	As-Built Drawings	1.8.1.13												
968			28 31 76	11	Closeout Submittals	Spare Parts	1.10.1												
969			31 00 00	1	Preconstruction Submittals	Dewatering Work Plan	1.4.3												
970			31 00 00	1	Preconstruction Submittals	Contaminated Soil Management Plan	3.1												
971			31 00 00	3	Product Data	Utilization/Management of Excavated Soils	3.7												
972			31 00 00	6	Test Reports	Testing	3.15												
973			31 00 00	6	Test Reports	Borrow Site Testing	1.3.1												
974			31 00 00	7	Certificates	Testing	3.15												
975			31 00 00	7	Certificates	Landfill Certification Demonstrating Capacity to Legally Accept Contaminated Soil	3.1												
976			31 11 00	1	Preconstruction Submittals	Herbicide Application Plan	3.1.1												
977			31 11 00	3	Product Data	Herbicide	2.1.2												
978			31 11 00	11	Closeout Submittals	Pest Management Report	3.5.1												
979			32 11 23	3	Product Data	Plant, Equipment, and Tools	1.4												
980			32 11 23	6	Test Reports	Initial Tests	2.2.1												
981			32 11 23	6	Test Reports	In-Place Tests	3.12.1												
982			32 12 13	6	Test Reports	Sampling and Testing	3.7												
983			32 12 16	1	Preconstruction Submittals	Quality Control Plan	3.9.1												
984			32 12 16	3	Product Data	Mix Design	2.4												
985			32 12 16	3	Product Data	Quality Control	3.9	G											
986			32 12 16	3	Product Data	Material Acceptance	3.1	G											
987			32 12 16	3	Product Data	Prime Coat Product	2.5.1	G											
988			32 12 16	6	Test Reports	Aggregates	2.3	G											
989			32 12 16	6	Test Reports	QC Monitoring	3.9.2.1												
990			32 12 16	7	Certificates	Asphalt Mixing Plant	2.1.1												
991			32 12 16	7	Certificates	Testing Laboratory	3.3												
992			32 12 16	7	Certificates	FDOT Certification For Asphalt Mixing Plant	2.1.1												
993			32 12 16	7	Certificates	Corps Certification	3.3												
994			32 16 19	3	Product Data	Concrete	2.1												
995			32 16 19	3	Product Data	Biodegradable Form Release Agent	2.6.5												
996			32 16 19	3	Product Data	Biodegradable Form Release Agent	3.2												
997			32 16 19	6	Test Reports	Field Quality Control	3.8												
998			32 17 23	3	Product Data	Surface Preparation Equipment List	2.1.1												
999			32 17 23	3	Product Data	Application Equipment List	2.1.2												
1000			32 17 23	3	Product Data	Exterior Surface Preparation	3.2												
1001			32 17 23	3	Product Data	Safety Data Sheets	1.3.1												
1002			32 17 23	3	Product Data	Reflective media for roads	2.2.3.1												
1003			32 17 23	3	Product Data	Waterborne Paint	2.2.1												
1004			32 17 23	6	Test Reports	Reflective Media for Roads	2.2.3.1												
1005			32 17 23	6	Test Reports	Waterborne Paint	2.2.1												
1006			32 17 23	6	Test Reports	High Build Acrylic Coating (HBAC)	2.2.2												
1007			32 17 23	6	Test Reports	Test Reports	3.4.1												
1008			32 17 23	7	Certificates	Qualifications	1.3.2												
1009			32 17 23	7	Certificates	Reflective Media for Roads	2.2.3.1												

1010			32 17 23	7	Certificates	Waterborne Paint	2.2.1												
1011			32 17 23	7	Certificates	Volatile Organic Compound	1.3.1												
1012			32 17 23	7	Certificates	Volatile Organic Compound	2.2.2												
1013			32 17 23	8	Manufacturer's Instructions	Waterborne Paint	2.2.1												
1014			32 92 23	3	Product Data	Fertilizer	2.4												
1015			32 92 23	6	Test Reports	Topsoil composition tests	2.2.3												
1016			32 92 23	7	Certificates	sods	2.1												
1017			33 40 00	4	Samples	Pipe for Culverts and Storm Drains	2.1												
1018			33 40 00	7	Certificates	Resin Certification	2.1.2												
1019			33 40 00	7	Certificates	Oil Resistant Gasket	2.3.3.1												
1020			33 40 00	7	Certificates	Determination of Density	3.7.1.1												
1021			33 40 00	7	Certificates	Frame and Cover for Gratings	2.3.2												
1022			33 40 00	7	Certificates	Placing Pipe	3.3												
1023			33 71 02	2	Shop Drawings	Precast underground structures	1.4.1	G											
1024			33 71 02	3	Product Data	Precast concrete structures	2.7.1.1	G											
1025			33 71 02	3	Product Data	Sealing Material	2.7.1.4												
1026			33 71 02	3	Product Data	Pulling-In Irons	3.2.2												
1027			33 71 02	3	Product Data	Manhole frames and covers	2.7.2	G											
1028			33 71 02	3	Product Data	Handhole frames and covers	2.7.3	G											
1029			33 71 02	3	Product Data	Cable supports	2.8	G											
1030			33 71 02	3	Product Data	Field Acceptance Checks and Tests	3.8.1												
1031			33 71 02	3	Product Data	Certificate of Conformance	1.4.2												
1032			33 82 00	2	Shop Drawings	Telecommunications Outside Plant	1.6.1.1	G											
1033			33 82 00	2	Shop Drawings	Telecommunications Entrance Facility Drawings	1.6.1.2	G											
1034			33 82 00	3	Product Data	Wire and cable	2.7	G											
1035			33 82 00	3	Product Data	Cable splices, and connectors	2.4	G											
1036			33 82 00	3	Product Data	Closures	2.3	G											
1037			33 82 00	3	Product Data	Building protector assemblies	2.2.1	G											
1038			33 82 00	3	Product Data	Protector modules	2.2.2	G											
1039			33 82 00	3	Product Data	Cross-connect terminal cabinets		G											
1040			33 82 00	6	Test Reports	Pre-installation tests	3.5.1	G											
1041			33 82 00	6	Test Reports	Acceptance tests	3.5.2	G											
1042			33 82 00	6	Test Reports	Outside Plant Test Plan	1.6.3	G											
1043			33 82 00	7	Certificates	Telecommunications Contractor	1.6.2.1	G											
1044			33 82 00	7	Certificates	Key Personnel	1.6.2.2	G											
1045			33 82 00	7	Certificates	Manufacturer's Qualifications	1.6.2.3	G											
1046			33 82 00	8	Manufacturer's Instructions	Building protector assembly installation	2.2.1	G											
1047			33 82 00	8	Manufacturer's Instructions	Cable tensions	3.1.7.1	G											
1048			33 82 00	8	Manufacturer's Instructions	Fiber Optic Splices	3.1.8.2	G											
1049			33 82 00	9	Manufacturer's Field Reports	Factory Reel Test Data	2.13.1	G											
1050			33 82 00	10	Operation and Maintenance Data	Telecommunications outside plant (OSP)	1.6.1.1	G											
1051			33 82 00	11	Closeout Submittals	Record Documentation	1.8.1	G											

SECTION 01 35 26

GOVERNMENTAL SAFETY REQUIREMENTS
02/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 241	(2009) Standard for Safeguarding Construction,Alteration, and Demolition Operations
NFPA 70E	(2012) Standard for Electrical Safety in the Workplace

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 385-1-1	(2008; Errata 1-2010; Changes 1-3 2010; Changes 4-6 2011) Safety and Health Requirements Manual

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

Government acceptance is required for submittals with a "G" designation.

SD-01 Preconstruction Submittals

Accident Prevention Plan (APP); G

Activity Hazard Analysis (AHA); G

SD-06 Test Reports

Reports

Submit reports as their incidence occurs, in accordance with the requirements of the paragraph entitled, "Reports."

Accident Reports

SD-07 Certificates

License Certificates

Contractor Safety Self-Evaluation Checklist; G

Submit one copy of each permit/certificate attached to each Daily Production Report.

Machinery & Mechanized Equipment Certification Form

1.3 DEFINITIONS

a. High Visibility Accident. Any mishap which may generate publicity and/or high visibility.

b. Medical Treatment. Treatment administered by a physician or by registered professional personnel under the standing orders of a physician. Medical treatment does not include first aid treatment even through provided by a physician or registered personnel.

c. Recordable Injuries or Illnesses. Any work-related injury or illness that results in:

(1) Death, regardless of the time between the injury and death, or the length of the illness;

(2) Days away from work (any time lost after day of injury/illness onset);

(3) Restricted work;

(4) Transfer to another job;

(5) Medical treatment beyond first aid;

(6) Loss of consciousness; or

(7) A significant injury or illness diagnosed by a physician or other licensed health care professional, even if it did not result in (1) through (6) above.

d. "USACE" property and equipment specified in USACE EM 385-1-1 should be interpreted as Government property and equipment.

1.4 REGULATORY REQUIREMENTS

In addition to the detailed requirements included in the provisions of this contract, comply with the most recent addition of USACE EM 385-1-1, and the following federal, state, and local, laws, ordinances, criteria, rules and regulations. Submit matters of interpretation of standards to the appropriate administrative agency for resolution before starting work. Where the requirements of this specification, applicable laws, criteria, ordinances, regulations, and referenced documents vary, the most stringent requirements govern.

1.5 SITE QUALIFICATIONS, DUTIES AND MEETINGS

1.5.1 Meetings

1.5.1.1 Preconstruction Conference

a. Contractor representatives who have a responsibility or significant role in accident prevention on the project shall attend the preconstruction conference. This includes the project superintendent,

site safety and health officer, quality control supervisor, or any other assigned safety and health professionals who participated in the development of the APP (including the Activity Hazard Analyses (AHAs) and special plans, program and procedures associated with it).

b. Discuss the details of the submitted APP to include incorporated plans, programs, procedures and a listing of anticipated AHAs that will be developed and implemented during the performance of the contract. This list of proposed AHAs will be reviewed at the conference and an agreement will be reached between the Contractor and the Contracting Officer's representative as to which phases will require an analysis. In addition, establish a schedule for the preparation, submittal, review, and acceptance of AHAs to preclude project delays.

c. Deficiencies in the submitted APP will be brought to the attention of the Contractor at the preconstruction conference, and the Contractor shall revise the plan to correct deficiencies and re-submit it for acceptance. Do not begin work until there is an accepted APP.

1.5.1.2 Safety Meetings

Conduct and document meetings as required by EM 385-1-1. Attach minutes showing contract title, signatures of attendees and a list of topics discussed to the Contractors' daily production report.

1.6 ACTIVITY HAZARD ANALYSIS (AHA)

The Activity Hazard Analysis (AHA) format shall be in accordance with USACE EM 385-1-1, Section 1. Submit the AHA for review at least 15 calendar days prior to the start of each phase. Format subsequent AHAs as amendments to the APP. The analysis should be used during daily inspections to ensure the implementation and effectiveness of the activity's safety and health controls.

The AHA list will be reviewed periodically (at least monthly) at the Contractor supervisory safety meeting and updated as necessary when procedures, scheduling, or hazards change.

Develop the activity hazard analyses using the project schedule as the basis for the activities performed. Any activities listed on the project schedule will require an AHA. The AHAs will be developed by the contractor, supplier or subcontractor and provided to the prime contractor for submittal to the Contracting Officer.

1.7 DISPLAY OF SAFETY INFORMATION

Within 1 calendar day after commencement of work, erect a safety bulletin board at the job site. Where size, duration, or logistics of project do not facilitate a bulletin board, an alternative method, acceptable to the Contracting Officer, that is accessible and includes all mandatory information for employee and visitor review, shall be deemed as meeting the requirement for a bulletin board. Include and maintain information on safety bulletin board as required by EM 385-1-1, section 01.A.06.

1.8 SITE SAFETY REFERENCE MATERIALS

Maintain safety-related references applicable to the project, including those listed in the article "References." Maintain applicable equipment manufacturer's manuals.

1.9 EMERGENCY MEDICAL TREATMENT

Contractors will arrange for their own emergency medical treatment. Government has no responsibility to provide emergency medical treatment.

1.10 REPORTS

1.10.1 Accident Reports

a. Conduct an accident investigation for recordable injuries and illnesses, as defined in 1.3.h and property damage accidents resulting in at least $2,000 in damages, to establish the root cause(s) of the accident, complete the Navy Contractor Significant Incident Report (CSIR) from and provide the report to the Contracting Officer within 5 calendar day(s) of the accident. The Contracting Officer will provide copies of any required or special forms.

1.10.2 Mishap Notification Requirements for Contractors per AFI 91-204, paras 2.4.5 -2.4.6.1.6:

The contractor shall notify the 96 TW Safety Office telephonically within one (1) hour after initial notification of all mispahs or incidents involving damage to DoD property (material plus labor) or injuries to government personnel as a result of contractor operations. THe Safety Office can be reached at (850)-882-2540 extension 4 during duty hours and (850)-883-4020 after hours. Initial written confirmatino of hte mishap must be forwarded within three calendar days to the Contracting Officer (CO) who will forward the report to 96 TW /SEG (Safety Office). A complete report shall be provided within 20 calendar days after the mishap. Mishap notification shall contain, as a minimum, the following information:

a. Contract, Contract Number, Name and Title of Person(s) Reporting
b. Date, Time and exact location of accident/incident
c. Brief Narrative of accident/incident (Events leading to accident/incident)
d. Cause of accident/incident, if known
e. Estimated cost of accident/incident (material and labor to repair/replace)
f. Nomenclature of equipment and personnel involved in accident/incident
g. Corrective actions (taken or proposed)

The contractor shall immediately secure the mishap scene/damaged property and impound pertinent maintenance and training records until released by the 96 TW Safety Office. The contractor and subcontractors (if involved) shall cooperate fully and assist the government personnel during the investigation.

SUBCONTRACTORS: (AFI 91-204, para 2.4.6.1) The prime contractor performing work on Eglin Air Force Base, FL shall include a clause in all contracts requiring the subcontractors to comply with the safety provisions of this contract. This requirement also applies to the contractor's suppliers, vendors and visitors while working on an Air Force Installation.

1.11 FACILITY OCCUPANCY CLOSURE

Streets, walks, and other facilities occupied and used by the Government shall not be closed or obstructed without written permission from the Contracting Officer.

1.12 SEVERE STORM PLAN

In the event of a severe storm warning, the Contractor must:

a. Secure outside equipment and materials and place materials that could be damaged in protected areas.

b. Check surrounding area, including roof, for loose material, equipment, debris, and other objects that could be blown away or against existing facilities.

c. Ensure that temporary erosion controls are adequate.

PART 2 PRODUCTS

Not used.

PART 3 EXECUTION

3.1 CONSTRUCTION AND/OR OTHER WORK

Comply with USACE EM 385-1-1, NFPA 241, the APP, the AHA, Federal and/or State OSHA regulations, and other related submittals and activity fire and safety regulations. The most stringent standard prevails.

3.1.1 Hazardous Material Use

Each hazardous material must receive approval from the Contracting Office or their designated representative prior to being brought onto the job site or prior to any other use in connection with this contract. Allow a minimum of 10 working days for processing of the request for use of a hazardous material.

3.1.2 Hazardous Material Exclusions

Notwithstanding any other hazardous material used in this contract, radioactive materials or instruments capable of producing ionizing/non-ionizing radiation (with the exception of radioactive material and devices used in accordance with USACE EM 385-1-1 such as nuclear density meters for compaction testing and laboratory equipment with radioactive sources) as well as materials which contain asbestos, mercury or polychlorinated biphenyls, di-isocynates, lead-based paint are prohibited. The Contracting Officer, upon written request by the Contractor, may consider exceptions to the use of any of the above excluded materials. The Radiation Safety Officer (RSO) must be notified prior to excepted items of radioactive material and devices being brought on base.

3.1.3 Unforeseen Hazardous Material

The design should have identified materials such as PCB, lead paint, and friable and non-friable asbestos and other OSHA regulated chemicals (i.e. 29 CFR Part 1910.1000). If material, not indicated, that may be hazardous

to human health upon disturbance during construction operations is encountered, stop that portion of work and notify the Contracting Officer immediately. Within 14 calendar days the Government will determine if the material is hazardous. If material is not hazardous or poses no danger, the Government will direct the Contractor to proceed without change. If material is hazardous and handling of the material is necessary to accomplish the work, the Government will issue a modification pursuant to "FAR 52.243-4, Changes" and "FAR 52.236-2, Differing Site Conditions."

3.2 EQUIPMENT

3.2.1 Material Handling Equipment

a. Material handling equipment such as forklifts shall not be modified with work platform attachments for supporting employees unless specifically delineated in the manufacturer's printed operating instructions.

b. The use of hooks on equipment for lifting of material must be in accordance with manufacturer's printed instructions.

c. Operators of forklifts or power industrial trucks shall be licensed in accordance with OSHA.

3.2.2 Equipment and Mechanized Equipment

a. Proof of qualifications for operator shall be kept on the project site for review.

b. Manufacture specifications or owner's manual for the equipment shall be on-site and reviewed for additional safety precautions or requirements that are sometimes not identified by OSHA or USACE EM 385-1-1. Incorporate such additional safety precautions or requirements into the AHAs.

c. Submit a Machinery & Mechanized Equipment Certification Form for acceptance by the Contracting Officer prior to being placed into use. A copy of the certification form will be provided during the Pre-construction Conference.

3.3 UTILITIES WITHIN CONCRETE SLABS

Utilities located within concrete slabs or pier structures, bridges, and the like, are extremely difficult to identify due to the reinforcing steel used in the construction of these structures. Whenever contract work involves concrete chipping, saw cutting, or core drilling, the existing utility location must be coordinated with station utility departments in addition to a private locating service. Outages to isolate utility systems must be used in circumstances where utilities are unable to be positively identified. The use of historical drawings does not alleviate the contractor from meeting this requirement.

3.4 ELECTRICAL

3.4.1 Portable Extension Cords

Size portable extension cords in accordance with manufacturer ratings for the tool to be powered and protected from damage. Immediately removed from service all damaged extension cords. Portable extension cords shall

meet the requirements of NFPA 70E and OSHA electrical standards.

-- End of Section --

SECTION 01 42 00

SOURCES FOR REFERENCE PUBLICATIONS
02/19

PART 1 GENERAL

1.1 REFERENCES

Various publications are referenced in other sections of the specifications to establish requirements for the work. These references are identified in each section by document number, date and title. The document number used in the citation is the number assigned by the standards producing organization (e.g. ASTM B564 Standard Specification for Nickel Alloy Forgings). However, when the standards producing organization has not assigned a number to a document, an identifying number has been assigned for reference purposes.

1.2 ORDERING INFORMATION

The addresses of the standards publishing organizations whose documents are referenced in other sections of these specifications are listed below, and if the source of the publications is different from the address of the sponsoring organization, that information is also provided.

ACOUSTICAL SOCIETY OF AMERICA (ASA)
1305 Walt Whitman Road, Suite 300
Melville, NY 11747-4300
Ph: 516-576-2360
Fax: 631-923-2875
E-mail: asa@acousticalsociety.org
Internet: https://acousticalsociety.org/

AIR MOVEMENT AND CONTROL ASSOCIATION INTERNATIONAL, INC. (AMCA)
30 West University Drive
Arlington Heights, IL 60004-1893
Ph: 847-394-0150
Fax: 847-253-0088
E-mail: communications@amca.org
Internet: http://www.amca.org

AIR-CONDITIONING, HEATING AND REFRIGERATION INSTITUTE (AHRI)
2111 Wilson Blvd, Suite 400
Arlington, VA 22201
Ph: 703-524-8800
Internet: http://www.ahrinet.org

ALUMINUM ASSOCIATION (AA)
1400 Crystal Drive
Suite 430
Arlington, VA 22202
Ph: 703-358-2960
E-Mail: info@aluminum.org
Internet: https://www.aluminum.org/

AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION (AAMA)
1900 E Golf Rd, Suite 1250

Schaumburg, IL 60173
Ph: 847-303-5664
E-mail: customerservice@aamanet.org
Internet: https://aamanet.org/

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)
444 North Capital Street, NW, Suite 249
Washington, DC 20001
Ph: 202-624-5800
Fax: 202-624-5806
E-Mail: info@aashto.org
Internet: https://www.transportation.org/

AMERICAN ASSOCIATION OF TEXTILE CHEMISTS AND COLORISTS (AATCC)
1 Davis Drive
P.O. Box 12215
Research Triangle Park, NC 27709-2215
Ph: 919-549-8141
Fax: 919-549-8933
Internet: https://www.aatcc.org/

AMERICAN BEARING MANUFACTURERS ASSOCIATION (ABMA)
330 N. Wabash Ave., Suite 2000
Chicago, IL 60611
Ph: 202-367-1155
E-mail: info@americanbearings.org
Internet: https://www.americanbearings.org/

AMERICAN CONCRETE INSTITUTE (ACI)
38800 Country Club Drive
Farmington Hills, MI 48331-3439
Ph: 248-848-3700
Fax: 248-848-3701
Internet: https://www.concrete.org/

AMERICAN CONFERENCE OF GOVERNMENTAL INDUSTRIAL HYGIENISTS (ACGIH)
1330 Kemper Meadow Drive
Cincinnati, OH 45240
Ph: 513-742-2020
Fax: 513-742-3355
Internet: https://www.acgih.org/

AMERICAN IRON AND STEEL INSTITUTE (AISI)
25 Massachusetts Avenue, NW Suite 800
Washington, DC 20001
Ph: 202-452-7100
Internet: https://www.steel.org/

AMERICAN LUMBER STANDARDS COMMITTEE (ALSC)
7470 New Technology Way, Suite F
Frederick, MD 21703
Ph: 301-972-1700
Fax: 301-540-8004
E-mail: alsc@alsc.org
Internet: http://www.alsc.org

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)
1899 L Street, NW,11th Floor

Washington, DC 20036
Ph: 202-293-8020
Fax: 202-293-9287
E-mail: storemanager@ansi.org
Internet: https://www.ansi.org/

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)
1801 Alexander Bell Drive
Reston, VA 20191
Ph: 800-548-2723; 703-295-6300
Internet: https://www.asce.org/

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)
1791 Tullie Circle, NE
Atlanta, GA 30329
Ph: 404-636-8400 or 800-527-4723
Fax: 404-321-5478
E-mail: ashrae@ashrae.org
Internet: https://www.ashrae.org/

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)
Two Park Avenue
New York, NY 10016-5990
Ph: 800-843-2763
Fax: 973-882-1717
E-mail: customercare@asme.org
Internet: https://www.asme.org/

AMERICAN SOCIETY OF SAFETY PROFESSIONALS (ASSP)
520 N. Northwest Highway
Park Ridge, IL 60068
Ph: 847-699-2929
E-mail: customerservice@assp.org
Internet: https://www.assp.org/

AMERICAN SOCIETY OF SANITARY ENGINEERING (ASSE)
18927 Hickory Creek Drive, Suite 220
Mokena, IL 60448
Ph: 708-995-3019
Fax: 708-479-6139
Internet: http://www.asse-plumbing.org

AMERICAN WATER WORKS ASSOCIATION (AWWA)
6666 W. Quincy Avenue
Denver, CO 80235 USA
Ph: 303-794-7711 or 800-926-7337
Fax: 303-347-0804
Internet: https://www.awwa.org/

AMERICAN WELDING SOCIETY (AWS)
8669 NW 36 Street, #130
Miami, FL 33166-6672
Ph: 800-443-9353
Internet: https://www.aws.org/

AMERICAN WOOD COUNCIL (AWC)
222 Catoctin Circle SE, Suite 201
Leesburg, VA 20175

Ph: 800-890-7732
Fax: 412-741-0609
E-mail: publications@awc.org
Internet: https://www.awc.org/

AMERICAN WOOD PROTECTION ASSOCIATION (AWPA)
P.O. Box 361784
Birmingham, AL 35236-1784
Ph: 205-733-4077
Fax: 205-733-4075
Internet: http://www.awpa.com

APA - THE ENGINEERED WOOD ASSOCIATION (APA)
7011 South 19th St.
Tacoma, WA 98466-5333
Ph: 253-565-6600
Fax: 253-565-7265
Internet: https://www.apawood.org/

ARCHITECTURAL WOODWORK INSTITUTE (AWI)
46179 Westlake Drive, Suite 120
Potomac Falls, VA 20165
Ph: 571-323-3636
Fax: 571-323-3630
E-mail: info@awinet.org
Internet: http://www.awinet.org

ASSOCIATED AIR BALANCE COUNCIL (AABC)
1220 19th St NW, Suite 410
Washington, DC 20036
Ph: 202-737-0202
Fax: 202-315-0285
E-mail: info@aabc.com
Internet: https://www.aabc.com/

ASSOCIATION OF EDISON ILLUMINATING COMPANIES (AEIC)
600 North 18th Street
P.O. Box 2641
Birmingham, AL 35291
Ph: 205-257-3839
Fax: 205-257-2540
Internet: https://aeic.org/

ASTM INTERNATIONAL (ASTM)
100 Barr Harbor Drive, P.O. Box C700
West Conshohocken, PA 19428-2959
Ph: 610-832-9500
Fax: 610-832-9555
E-mail: service@astm.org
Internet: https://www.astm.org/

BACNET INTERNATIONAL (BTL)
BACnet Testing Laboratories
1827 Powers Ferry Road
Building 14, Suite 100
Atlanta, GA 30339
Ph: 770-971-6003
Fax: 678-229-2777
E-mail: info@bacnetinternational.org

Internet: https://www.bacnetlabs.org/

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)
355 Lexington Avenue, 15th Floor
New York, NY 10017
Ph: 212-297-2122
Fax: 212-370-9047
Internet: https://www.buildershardware.com/

CALIFORNIA AIR RESOURCES BOARD (CARB)
1001 I Street
Sacramento, CA 95814
Ph: 800-242-4450
Email: helpline@arb.ca.gov
Internet: https://ww2.arb.ca.gov/

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)
PO Box 997377, MS 0500
Sacramento, CA 95899-7377
Ph: 916-558-1784
Internet: https://www.cdph.ca.gov/

CARPET AND RUG INSTITUTE (CRI)
P.O. Box 2048
Dalton, GA 30722-2048
Ph: 706-278-3176
Fax: 706-278-8835
Internet: https://carpet-rug.org/

COMPOSITE PANEL ASSOCIATION (CPA)
19465 Deerfield Avenue, Suite 306
Leesburg, VA 20176
Ph: 703-724-1128
Fax: 703-724-1588
Internet: https://www.compositepanel.org/

CONCRETE REINFORCING STEEL INSTITUTE (CRSI)
933 North Plum Grove Road
Schaumburg, IL 60173-4758
Ph: 847-517-1200
Fax: 847-517-1206
Internet: http://www.crsi.org/

COPPER DEVELOPMENT ASSOCIATION (CDA)
Internet: https://www.copper.org/

CSA GROUP (CSA)
178 Rexdale Blvd.
Toronto, ON, Canada M9W 1R3
Ph: 416-747-4044
Fax: 416-747-2510
E-mail: member@csagroup.org
Internet: https://www.csagroup.org/

ELECTRICAL GENERATING SYSTEMS ASSOCIATION (EGSA)
1650 South Dixie Highway, Suite 400
Boca Raton, FL 33432-7462
Ph: 561-750-5575

Fax: 561-395-8557
Internet: http://www.egsa.org

ELECTRONIC COMPONENTS INDUSTRY ASSOCIATION (ECIA)
310 Maxwell Road, Suite 200
Alpharetta, GA 30009
Ph: 678-393-9990
Fax: 678-393-9998
E-mail: emikoski@ecianow.org
Internet: https://www.ecianow.org

ELECTROSTATIC DISCHARGE ASSOCIATION (ESD)
7900 Turin Road, Building 3
Rome, NY 13440-2069
Ph: 315-339-6937
Fax: 315-339-6793
E-mail: info@esda.org
https://www.esda.org/

ETL TESTING LABORATORIES (ETL)
Intertek
Ph: 800-967-5352
Internet: http://www.intertek.com/

EUROPEAN COMMITTEE FOR STANDARDIZATION (CEN/CENELEC)
CEN-CENELEC Management Centre
Rue de la Science 23
B - 1040 Brussels, Belgium
Ph: 32-2-550-08-11
Fax: 32-2-550-08-19
Internet: https://www.cen.eu/

EUROPEAN UNION (EU)
European Commission
Rue de la Loi 200
1000 Bruxelle
Belgium
Ph: +32 2 299 96 96
Internet: https://ec.europa.eu/info/index_en

EXPANSION JOINT MANUFACTURERS ASSOCIATION (EJMA)
25 North Broadway
Tarrytown, NY 10591
Fax: 914-332-1541
E-mail: inquiries@ejma.org
Internet: http://www.ejma.org

FLUID CONTROLS INSTITUTE (FCI)
1300 Sumner Avenue
Cleveland, OH 44115
Ph: 216-241-7333
Fax: 216-241-0105
E-mail: fci@fluidcontrolsinstitute.org
Internet: https://fluidcontrolsinstitute.org/

FM GLOBAL (FM)
270 Central Avenue
Johnston, RI 02919-4949
Ph: 401-275-3000

Fax: 401-275-3029
Internet: https://www.fmglobal.com/

GLASS ASSOCIATION OF NORTH AMERICA (GANA)
National Glass Association
1945 Old Gallows Rd., Suite 750
Vienna, VA 22182
Ph: 866-342-5642
Ph: 703-442-4890
Fax: 703-442-0630
Internet: http://www.glasswebsite.com

GREEN SEAL (GS)
1001 Connecticut Avenue, NW
Suite 827
Washington, DC 20036-5525
Ph: 202-872-6400
Fax: 202-872-4324
E-mail: greenseal@greenseal.org
Internet: https://www.greenseal.org/

GYPSUM ASSOCIATION (GA)
962 Wayne Ave., Suite 620
Silver Spring, MD 20910
Ph: 301-277-8686
Fax: 301-277-8747
E-mail: info@gypsum.org
Internet: https://www.gypsum.org/

HYDRAULIC INSTITUTE (HI)
6 Campus Drive, First Floor North
Parsippany, NJ 07054-4405
Ph: 973-267-9700
Fax: 973-267-9055
Internet: http://www.pumps.org

ILLUMINATING ENGINEERING SOCIETY (IES)
120 Wall Street, Floor 17
New York, NY 10005-4001
Ph: 212-248-5000
Fax: 212-248-5018
E-mail: membership@ies.org
Internet: https://www.ies.org/

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)
445 and 501 Hoes Lane
Piscataway, NJ 08854-4141
Ph: 732-981-0060 or 800-701-4333
Fax: 732-981-9667
E-mail: onlinesupport@ieee.org
Internet: https://www.ieee.org/

INSULATED CABLE ENGINEERS ASSOCIATION (ICEA)
P.O. Box 493
Miamitown, OH 45041-9998
E-mail: info@icea.net
Internet: https://www.icea.net/

INSULATING GLASS MANUFACTURERS ALLIANCE (IGMA)
27 N. Wacker Dr. Suite 365
Chicago, IL 60606-2800
Ph: 613-233-1510
Fax: 613-482-9436
E-mail: enquiries@igmaonline.org
Internet: https://www.igmaonline.org/

INTELLIGENCE COMMUNITY STANDARD (ICS)
Homeland Security Digital Library
Ph: 831-272-2437
E-mail: hsdl@nps.edu
Internet: https://www.hsdl.org/c/

INTERNATIONAL ASSOCIATION OF PLUMBING AND MECHANICAL OFFICIALS (IAPMO)
4755 E. Philadelphia St.
Ontario, CA 91761
Ph: 909-472-4100
Fax: 909-472-4150
E-mail: iapmo@iapmo.org
Internet: http://www.iapmo.org

INTERNATIONAL CODE COUNCIL (ICC)
500 New Jersey Avenue, NW
6th Floor, Washington, DC 20001
Ph: 800-786-4452 or 888-422-7233
Fax: 202-783-2348
E-mail: order@iccsafe.org
Internet: https://www.iccsafe.org/

INTERNATIONAL CONCRETE REPAIR INSTITUTE (ICRI)
1000 Westgate Drive, Suite 252
St. Paul, MN 55114
Ph: 651-366-6095
Fax: 651-290-2266
E-mail: info@icri.org
Internet: https://www.icri.org/

INTERNATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)
3050 Old Centre Ave. Suite 101
Portage, MI 49024
Ph: 269-488-6382
Fax: 269-488-6383
Internet: https://www.netaworld.org/

INTERNATIONAL ELECTROTECHNICAL COMMISSION (IEC)
3, rue de Varembe, 1st floor
P.O. Box 131
CH-1211 Geneva 20, Switzerland
Ph: 41-22-919-02-11
Fax: 41-22-919-03-00
E-mail: info@iec.ch
Internet: https://www.iec.ch/

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION (ISO)
ISO Central Secretariat
BIBC II
Chemin de Blandonnet 8

CP 401 - 1214 Vernier, Geneva
Switzerland
Ph: 41-22-749-01-11
E-mail: central@iso.ch
Internet: https://www.iso.org

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY (MSS)
127 Park Street, NE
Vienna, VA 22180-4602
Ph: 703-281-6613
E-mail: info@msshq.org
Internet: http://msshq.org

MASTER PAINTERS INSTITUTE (MPI)
2800 Ingleton Avenue
Burnaby, BC CANADA V5C 6G7
Ph: 1-888-674-8937
Fax: 1-888-211-8708
E-mail: info@paintinfo.com or techservices@mpi.net
Internet: http://www.mpi.net/

MIDWEST INSULATION CONTRACTORS ASSOCIATION (MICA)
16712 Elm Circle
Omaha, NE 68130
Ph: 402-342-3463 or 800-747-6422
Fax: 402-330-9702
Internet: https://www.micainsulation.org/

NACE INTERNATIONAL (NACE)
15835 Park Ten Place
Houston, TX 77084
Ph: 281-228-6200
Fax: 281-228-6300
E-mail: firstservice@nace.org
Internet: https://www.nace.org

NATIONAL ASSOCIATION OF ARCHITECTURAL METAL MANUFACTURERS (NAAMM)
800 Roosevelt Road, Bldg C, Suite 312
Glen Ellyn, IL 60137
Ph: 630-942-6591
Fax: 630-790-3095
E-mail: info@naamm.org
Internet: http://www.naamm.org

NATIONAL ELECTRICAL CONTRACTORS ASSOCIATION (NECA)
3 Bethesda Metro Center, Suite 1100
Bethesda, MD 20814
Ph: 301-657-3110
Fax: 301-215-4500
Internet: https://www.necanet.org/

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)
1300 North 17th Street, Suite 900
Arlington, VA 22209
Ph: 703-841-3200
Internet: https://www.nema.org

NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB)
8575 Grovemont Circle
Gaithersburg, MD 20877
Ph: 301-977-3698
Fax: 301-977-9589
Internet: http://www.nebb.org

NATIONAL FENESTRATION RATING COUNCIL (NFRC)
6305 Ivy Lane, Suite 140
Greenbelt, MD 20770
Ph: 301-589-1776
Fax: 301-589-3884
E-Mail: info@nfrc.org
Internet: http://www.nfrc.org

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)
1 Batterymarch Park
Quincy, MA 02169-7471
Ph: 800-344-3555
Fax: 800-593-6372
Internet: https://www.nfpa.org

NATIONAL HARDWOOD LUMBER ASSOCIATION (NHLA)
6830 Raleigh LaGrange Road
PO Box 34518
Memphis, TN 38184
Ph: 901-377-1818
Internet: https://nhla.com/

NATIONAL INSTITUTE FOR CERTIFICATION IN ENGINEERING TECHNOLOGIES (NICET)
1420 King Street
Alexandria, VA 22314-2794
Ph: 888-476-4238 (1-888 IS-NICET)
E-mail: tech@nicet.org
Internet: https://www.nicet.org/

NATIONAL ROOFING CONTRACTORS ASSOCIATION (NRCA)
10255 West Higgins Road, Suite 600
Rosemont, IL 60018-5607
Ph: 847-299-9070
Fax: 847-299-1183
Internet: http://www.nrca.net

NORTHEASTERN LUMBER MANUFACTURERS ASSOCIATION (NELMA)
272 Tuttle Road
Cumberland, ME 04021
Ph: 207-829-6901
Fax: 207-829-4293
E-mail: info@nelma.org
Internet: https://www.nelma.org/

NSF INTERNATIONAL (NSF)
789 North Dixboro Road
P.O. Box 130140
Ann Arbor, MI 48105
Ph: 734-769-8010 or 800-NSF-MARK
Fax: 734-769-0109
E-mail: info@nsf.org

Internet: http://www.nsf.org

PLASTIC PIPE AND FITTINGS ASSOCIATION (PPFA)
800 Roosevelt Road
Building C, Suite 312
Glen Ellyn, IL 60137
Ph: 630-858-6540
Fax: 630-790-3095
Internet: https://www.ppfahome.org/

PLUMBING AND DRAINAGE INSTITUTE (PDI)
800 Turnpike Street, Suite 300
North Andover, MA 01845
Ph: 978-557-0720 or 800-589-8956
E-Mail: pdi@PDIonline.org
Internet: http://www.pdionline.org

REDWOOD INSPECTION SERVICE (RIS) OF THE CALIFORNIA REDWOOD ASSOCIATION (CRA)
818 Grayson Road, Suite 201
Pleasant Hill, CA 94523
Ph: 925-935-1499
Fax: 925-935-1496
Internet:
https://www.wwpa.org/about-wwpa/redwood-inspection-service

RESILIENT FLOOR COVERING INSTITUTE (RFCI)
115 Broad Street
Suite 201
LaGrange, Georgia 30240
Internet: https://rfci.com/

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)
2000 Powell Street, Suite 600
Emeryville, CA 94608
Ph: 510-452-8000
Fax: 510-452-8001
E-mail: info@SCSglobalservices.com
Internet: https://www.scsglobalservices.com/

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)
4201 Lafayette Center Drive
Chantilly, VA 20151-1219
Ph: 703-803-2980
Fax: 703-803-3732
Internet: https://www.smacna.org/

SOCIETY FOR PROTECTIVE COATINGS (SSPC)
800 Trumbull Drive
Pittsburgh, PA 15205
Ph: 877-281-7772 or 412-281-2331
Fax: 412-444-3591
E-mail: customerservice@sspc.org
Internet: http://www.sspc.org

SOCIETY OF AUTOMOTIVE ENGINEERS INTERNATIONAL (SAE)
400 Commonwealth Drive

Warrendale, PA 15096
Ph: 877-606-7323 or 724-776-4841
Fax: 724-776-0790
E-mail: customerservice@sae.org
Internet: https://www.sae.org/

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)
21865 Copley Drive
Diamond Bar, CA 91765
Ph: 909-396-2000
E-mail: webinquiry@aqmd.gov
Internet: http://www.aqmd.gov

SOUTHERN CYPRESS MANUFACTURERS ASSOCIATION (SCMA)
665 Rodi Road, Suite 305
Pittsburgh, PA 15235
Ph: 412-244-0440
Fax: 412-244-9090
Internet: http://www.cypressinfo.org

SOUTHERN PINE INSPECTION BUREAU (SPIB)
P.O. Box 10915
Pensacola, FL 32524-0915
Ph: 850-434-2611 or 800-995-7742
Fax: 850-434-1290
E-mail: spib@spib.org
Internet: https://www.spib.org/

STEEL DOOR INSTITUTE (SDI/DOOR)
30200 Detroit Road
Westlake, OH 44145
Ph: 440-899-0010
Fax: 440-892-1404
E-mail: info@steeldoor.org
Internet: https://www.steeldoor.org/

TECHNICAL ASSOCIATION OF THE PULP AND PAPER INDUSTRY (TAPPI)
15 Technology Parkway South, Suite 115
Peachtree Corners, GA 30092
Ph: 800-332-8686 or 770-446-1400
Fax: 770-446-6947
E-mail: memberconnection@tappi.org
Internet: http://www.tappi.org

TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA)
1320 North Courthouse Rosd, Suite 200
Arlington, VA 22201
Ph: 703-907-7700
Fax: 703-907-7727
E-mail: marketing@tiaonline.org
Internet: https://www.tiaonline.org/

THE MASONRY SOCIETY (TMS)
105 South Sunset Street, Suite Q
Longmont, CO 80501-6172
Ph: 303-939-9700
Fax: 303-541-9215
E-mail: info@masonrysociety.org
https://masonrysociety.org/

TILE COUNCIL OF NORTH AMERICA (TCNA)
100 Clemson Research Boulevard
Anderson, SC 29625
Ph: 864-646-8453
Fax: 864-646-2821
E-mail: info@tileusa.com
Internet: https://www.tcnatile.com/

TRIDIUM, INC (TRIDIUM)
3951 Westerre Parkway, Suite 350
Richmond, VA 23233
Ph: 804-747-4771
Fax: 804-747-5204
E-mail: support@tridium.com
Internet: https://www.tridium.com/

TURFGRASS PRODUCERS INTERNATIONAL (TPI)
444 E. Roosevelt Road
#346
Lombard, IL 60148
Ph: 800-405-8873 or 847-649-5555
Fax: 847-649-5678
E-mail: info@turfgrasssod.org
Internet: http://www.turfgrasssod.org

U.S. ARMY CORPS OF ENGINEERS (USACE)
CRD-C DOCUMENTS available on Internet:
http://www.wbdg.org/ffc/army-coe/standards
Order Other Documents from:
Official Publications of the Headquarters, USACE
E-mail: hqpublications@usace.army.mil
Internet: http://www.publications.usace.army.mil/
or
https://www.hnc.usace.army.mil/Missions/Engineering-Directorate/TECHINFO/

U.S. DEPARTMENT OF AGRICULTURE (USDA)
Order AMS Publications from:
AGRICULTURAL MARKETING SERVICE (AMS)
Seed Regulatory and Testing Branch
801 Summit Crossing Place, Suite C
Gastonia, NC 28054-2193
Ph: 704-810-8884
E-mail: PA@ams.usda.gov
Internet: https://www.ams.usda.gov/
Order Other Publications from:
USDA Rural Development
Rural Utilities Service
STOP 1510, Rm 5135
1400 Independence Avenue SW
Washington, DC 20250-1510
Phone: (202) 720-9540
Internet:
https://www.rd.usda.gov/about-rd/agencies/rural-utilities-service

U.S. DEPARTMENT OF DEFENSE (DOD)
Order DOD Documents from:
Room 3A750-The Pentagon
1400 Defense Pentagon

Washington, DC 20301-1400
Ph: 703-571-3343
Fax: 215-697-1462
E-mail: customerservice@ntis.gov
Internet: https://www.ntis.gov/
Obtain Military Specifications, Standards and Related Publications from:
Acquisition Streamlining and Standardization Information System (ASSIST)
Department of Defense Single Stock Point (DODSSP)
Document Automation and Production Service (DAPS)
Building 4/D
700 Robbins Avenue
Philadelphia, PA 19111-5094
Ph: 215-697-6396 - for account/password issues
Internet: https://assist.dla.mil/online/start/; account registration required
Obtain Unified Facilities Criteria (UFC) from:
Whole Building Design Guide (WBDG)
National Institute of Building Sciences (NIBS)
1090 Vermont Avenue NW, Suite 700
Washington, DC 20005
Ph: 202-289-7800
Fax: 202-289-1092
Internet:
https://www.wbdg.org/ffc/dod/unified-facilities-criteria-ufc

U.S. DEPARTMENT OF ENERGY (DOE)
1000 Independence Avenue Southwest
Washington, D.C. 20585
Ph: 202-586-5000
Fax: 202-586-4403
E-mail: The.Secretary@hq.doe.gov
Internet: https://www.energy.gov/

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)
1200 Pennsylvania Avenue, N.W.
Washington, DC 20004
Ph: 202-564-4700
Internet: https://www.epa.gov
--- Some EPA documents are available only from:
National Technical Information Service (NTIS)
5301 Shawnee Road
Alexandria, VA 22312
Ph: 703-605-6060 or 1-800-363-2068
Fax: 703-605-6880
TDD: 703-487-4639
E-mail: info@ntis.gov
Internet: https://www.ntis.gov/

U.S. FEDERAL AVIATION ADMINISTRATION (FAA)
Order for sale documents from:
Superintendent of Documents
U.S. Government Publishing Office (GPO)
732 N. Capitol Street, NW
Washington, DC 20401
Ph: 202-512-1800 or 866-512-1800
Bookstore: 202-512-0132
Internet: https://www.gpo.gov/

Order free documents from:
U.S. Department of Transportation
Federal Aviation Administration
800 Independence Avenue, SW
Washington, DC 20591
Ph: 866-835-5322
Internet: https://www.faa.gov/

U.S. FEDERAL COMMUNICATIONS COMMISSION (FCC)
445 12th Street SW
Washington, DC 20554
Ph: 888-225-5322
TTY: 888-835-5322
Fax: 866-418-0232
Internet: https://www.fcc.gov/
Order Publications From:
Superintendent of Documents
U.S. Government Publishing Office (GPO)
732 N. Capitol Street, NW
Washington, DC 20401
Ph: 202-512-1800 or 866-512-1800
Bookstore: 202-512-0132
Internet: https://www.gpo.gov/

U.S. FEDERAL HIGHWAY ADMINISTRATION (FHWA)
1200 New Jersey Ave., SE
Washington, DC 20590
Ph: 202-366-4000
E-mail: ExecSecretariat.FHWA@dot.gov
Internet: https://www.fhwa.dot.gov/
Order from:
Superintendent of Documents
U.S. Government Publishing Office (GPO)
732 N. Capitol Street, NW
Washington, DC 20401
Ph: 202-512-1800 or 866-512-1800
Bookstore: 202-512-0132
Internet: https://www.gpo.gov/

U.S. GENERAL SERVICES ADMINISTRATION (GSA)
General Services Administration
1800 F Street, NW
Washington, DC 20405
Ph: 1-844-472-4111
Internet: https://www.gsaelibrary.gsa.gov/ElibMain/home.do
Obtain documents from:
Acquisition Streamlining and Standardization Information System (ASSIST)
Internet: https://assist.dla.mil/online/start/; account registration required

U. S. GREEN BUILDING COUNCIL (USGBC)
2101 L St NW, Suite 500
Washington, DC 20037
Ph: 202-828-7422
Internet: https://new.usgbc.org/

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)
8601 Adelphi Road

College Park, MD 20740-6001
Ph: 866-272-6272
Internet: https://www.archives.gov/
Order documents from:
Superintendent of Documents
U.S. Government Publishing Office (GPO)
732 N. Capitol Street, NW
Washington, DC 20401
Ph: 202-512-1800 or 866-512-1800
Bookstore: 202-512-0132
Internet: https://www.gpo.gov/

UNDERWRITERS LABORATORIES (UL)
2600 N.W. Lake Road
Camas, WA 98607-8542
Ph: 877-854-3577 or 360-817-5500
E-mail: CustomerExperienceCenter@ul.com
Internet: https://www.ul.com/
UL Directories available through IHS at https://ihsmarkit.com/

WEST COAST LUMBER INSPECTION BUREAU (WCLIB)
6980 S.W. Varns
Tigard, OR 97223
Ph: 503-639-0651
Fax: 503-684-8928
E-mail: info@wclib.org
Internet: http://www.wclib.org

WESTERN WOOD PRODUCTS ASSOCIATION (WWPA)
1500 SW First Ave., Suite 870
Portland, OR 97201
Ph: 503-224-3930
E-mail: info@wwpa.org
Internet: http://www.wwpa.org

WINDOW AND DOOR MANUFACTURERS ASSOCIATION (WDMA)
2025 M Street, NW, Suite 800
Washington, DC 20036-3309
Ph: 202-367-1157
or
330 N Wabash Avenue, Suite 2000
Chicago, IL 60611
Ph: 312-321-6802
E-mail: membersupport@wdma.com
Internet: https://www.wdma.com/

PART 2 PRODUCTS

Not used

PART 3 EXECUTION

Not used

-- End of Section --

SECTION 01 45 00.00 10

QUALITY CONTROL
02/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM D 3740	(2010) Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction
ASTM E 329	(2011) Standard Specification for Agencies Engaged in the Testing and/or Inspection of Materials Used in Construction

1.2 PAYMENT

Separate payment will not be made for providing and maintaining an effective Quality Control program, and all associated costs will be included in the applicable Bid Schedule unit or lump-sum prices.

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

3.1 GENERAL REQUIREMENTS

Establish and maintain an effective quality control (QC) system in compliance with the Contract Clause titled "Inspection of Construction." QC consist of plans, procedures, and organization necessary to produce an end product which complies with the contract requirements. Cover all operations, both onsite and offsite, and be keyed to the proposed sequence. The project superintendent will be held responsible for the quality of work and is subject to removal by the Contracting Officer for non-compliance with the quality requirements specified in the contract. In this context the highest level manager responsible for the overall construction activities at the site, including quality and production is the project superintendent. The project superintendent must maintain a physical presence at the site at all times and is responsible for all construction and related activities at the site, except as otherwise acceptable to the Contracting Officer.

3.2 QUALITY CONTROL PLAN

Submit no later than 15 days after receipt of notice to proceed, the Contractor Quality Control (CQC) Plan proposed to implement the

requirements of the Contract Clause titled "Inspection of Construction." The Government will consider an interim plan for the first 15 days of operation. will be permitted to begin only after acceptance of the CQC Plan or acceptance of an interim plan applicable to the particular feature of work to be started. Work outside of the accepted interim plan will not be permitted to begin until acceptance of a CQC Plan or another interim plan containing the additional work.

3.2.1 Content of the CQC Plan

Include, as a minimum, the following to cover all operations, both onsite and offsite, including work by :

a. A description of the quality control organization, including a chart showing lines of authority and acknowledgment that the CQC staff will implement the three phase control system for all aspects of the work specified. Include a CQC System Manager who reports to the project superintendent.

b. The name, qualifications (in resume format), duties, responsibilities, and authorities of each person assigned a CQC function.

c. A copy of the letter to the CQC System Manager signed by an authorized official of the firm which describes the responsibilities and delegates sufficient authorities to adequately perform the functions of the CQC System Manager, including authority to stop work which is not in compliance with the contract. Letters of direction to all other various quality control representatives outlining duties, authorities, and responsibilities will be issued by the CQC System Manager. Copies of these letters must be furnished to the Government.

d. Procedures for scheduling, reviewing, certifying, and managing submittals, including those of . These procedures must be in accordance with Section 01 33 00 SUBMITTAL PROCEDURES.

e. Control, verification, and acceptance testing procedures for each specific test to include the test name, specification paragraph requiring test, feature of work to be tested, test frequency, and person responsible for each test. (Laboratory facilities approved by the Contracting Officer must be used.)

f. Procedures for tracking preparatory, initial, and follow-up control phases and control, verification, and acceptance tests including documentation.

g. Procedures for tracking deficiencies from identification through acceptable corrective action. Establish verification procedures that identified deficiencies have been corrected.

h. Reporting procedures, including proposed reporting formats.

i. A list of the definable features of work. A definable feature of work is a task which is separate and distinct from other tasks, has separate control requirements, and may be identified by different trades or disciplines, or it may be work by the same trade in a different environment. Although each section of the specifications may generally be considered as a definable feature of work, there are frequently more than one definable features under a particular section. This list will be agreed upon during the coordination

meeting.

3.2.2 Acceptance of Plan

Acceptance of the Contractor's plan is required prior to the start of construction. Acceptance is conditional and will be predicated on satisfactory performance during the construction. The Government reserves the right to require the Contractor to make changes in his CQC Plan and operations including removal of personnel, as necessary, to obtain the quality specified.

3.2.3 Notification of Changes

After acceptance of the CQC Plan, notify the Contracting Officer in writing of any proposed change. Proposed changes are subject to acceptance by the Contracting Officer.

3.3 COORDINATION MEETING

After the and prior to acceptance by the Government of the CQC Plan, meet with the Contracting Officer or Authorized Representative and discuss the Contractor's quality control system. Submit the CQC Plan a minimum of 7 calendar days prior to the Coordination Meeting. During the meeting, a mutual understanding of the system details must be developed, including the forms for recording the CQC , control activities, testing, administration of the system for both onsite and offsite work, and the interrelationship of Contractor's Management and control with the Government's Quality Assurance. Minutes of the meeting will be prepared by the Government, signed by both the Contractor and the Contracting Officer and will become a part of the contract file. There may be occasions when subsequent conferences will be called by either party to reconfirm mutual understandings and/or address deficiencies in the CQC system or procedures which may require corrective action by the Contractor.

3.4 QUALITY CONTROL ORGANIZATION

3.4.1 Personnel Requirements

The requirements for the CQC organization are a and sufficient number of additional qualified personnel to ensure safety and contract compliance. The Safety and Health Manager must receive direction and authority from the CQC System Manager and serve as a member of the CQC staff. Personnel identified in the technical provisions as requiring specialized skills to assure the required work is being performed properly will also be included as part of the CQC organization. The Contractor's CQC staff must maintain a presence at the site at all times during progress of the work and have complete authority and responsibility to take any action necessary to ensure contract compliance. The CQC staff will be subject to acceptance by the Contracting Officer. Provide adequate office space, filing systems and other resources as necessary to maintain an effective and fully functional CQC organization. Promptly complete and furnish all letters, material submittals, shop drawing submittals, schedules and all other project documentation to the CQC organization. The CQC organization shall be responsible to maintain these documents and records at the site at all times, except as otherwise acceptable to the Contracting Officer.

3.4.2 CQC System Manager

Identify as CQC System Manager an individual within the onsite work

organization who is responsible for overall management of CQC and have the authority to act in all CQC matters for the Contractor. The CQC System Manager must be a construction person with a minimum of 5 years in related work. This CQC System Manager must be on the site at all times during construction and be employed by the prime Contractor. The CQC System Manager must be assigned as System Manager but may have duties as project superintendent in addition to quality control. Identify in the plan an alternate to serve in the event of the CQC System Manager's absence. The requirements for the alternate are the same as the CQC System Manager.

3.4.3 CQC Personnel

In addition to CQC personnel specified elsewhere in the contract, provide as part of the CQC organization specialized personnel to assist the CQC System Manager for the following areas: submittals clerk. These individuals must be directly employed by the prime Contractor and may not be employed by a supplier or subcontractor on this project; be responsible to the CQC System Manager; be physically present at the construction site during work on their areas of responsibility; have the necessary education and/or experience. These individuals may perform other duties but must be allowed sufficient time to perform their assigned quality control duties as described in the Quality Control Plan. A single person may cover more than one area provided that they are qualified to perform QC activities in each designated and that workload allows.

3.4.4 Organizational Changes

Maintain the CQC staff at full strength at all times. When it is necessary to make changes to the CQC staff, revise the CQC Plan to reflect the changes and submit the changes to the Contracting Officer for acceptance.

3.5 SUBMITTALS AND DELIVERABLES

Submittals, if needed, must comply with the requirements in Section 01 33 00SUBMITTAL PROCEDURES. The CQC organization is responsible for certifying that all submittals and deliverables are in compliance with the contract requirements.

3.6 CONTROL

Contractor Quality Control is the means by which the Contractor ensures that the construction, to include that of subcontractors and suppliers, complies with the requirements of the contract. At least three phases of control must be conducted by the CQC System Manager for each definable feature of the construction work as follows:

3.6.1 Preparatory Phase

This phase is performed prior to beginning work on each definable feature of work, after all required plans/documents/materials are approved/accepted, and after copies are at the work site. This phase includes:

a. A review of each paragraph of applicable specifications, reference codes, and standards. Make available during the preparatory inspection a copy of those sections of referenced codes and standards applicable to that portion of the work to be accomplished in the field. Maintain and make available in the field for use by Government personnel until final acceptance of the work.

b. Review of the contract drawings.

c. Check to assure that all materials and/or equipment have been tested, submitted, and approved.

d. Review of provisions that have been made to provide required control inspection and testing.

e. Examination of the work area to assure that all required preliminary work has been completed and is in compliance with the contract.

f. Examination of required materials, equipment, and sample work to assure that they are on hand, conform to approved shop drawings or submitted data, and are properly stored.

g. Review of the appropriate activity hazard analysis to assure safety requirements are met.

h. Discussion of procedures for controlling quality of the work including repetitive deficiencies. Document construction tolerances and workmanship standards for that feature of work.

i. Check to ensure that the portion of the plan for the work to be performed has been accepted by the Contracting Officer.

j. Discussion of the initial control phase.

k. The Government must be notified at least 48 hours in advance of beginning the preparatory control phase. Include a meeting conducted by the CQC System Manager and attended by the superintendent, other CQC personnel (as applicable), and the foreman responsible for the definable feature. Document the results of the preparatory phase actions by separate minutes prepared by the CQC System Manager and attach to the daily CQC report. Instruct applicable workers as to the acceptable level of workmanship required in order to meet contract specifications.

3.6.2 Initial Phase

This phase is accomplished at the beginning of a definable feature of work. Accomplish the following:

a. Check work to ensure that it is in full compliance with contract requirements. Review minutes of the preparatory meeting.

b. Verify adequacy of controls to ensure full contract compliance. Verify required control inspection and testing.

c. Establish level of workmanship and verify that it meets minimum acceptable workmanship standards. Compare with required sample panels as appropriate.

d. Resolve all differences.

e. Check safety to include compliance with and upgrading of the safety plan and activity hazard analysis. Review the activity analysis with each worker.

f. The Government must be notified at least 48 hours in advance of

beginning the initial phase. Prepare separate minutes of this phase by the CQC System Manager and attach to the daily CQC report. Indicate the exact location of initial phase for future reference and comparison with follow-up phases.

g. The initial phase should be repeated for each new crew to work onsite, or any time acceptable specified quality standards are not being met.

3.6.3 Follow-up Phase

Perform daily checks to assure control activities, including control testing, are providing continued compliance with contract requirements, until completion of the particular feature of work. Record the checks in the CQC documentation. Conduct final follow-up checks and correct all deficiencies prior to the start of additional features of work which may be affected by the deficient work. Do not build upon nor conceal non-conforming work.

3.6.4 Additional Preparatory and Initial Phases

Conduct additional preparatory and initial phases on the same definable features of work if: the quality of on-going work is unacceptable; if there are changes in the applicable CQC staff, onsite production supervision or work crew; if work on a definable feature is resumed after a substantial period of inactivity; or if other problems develop.

3.7 TESTS

3.7.1 Testing Procedure

Perform specified or required tests to verify that control measures are adequate to provide a product which conforms to contract requirements. Upon request, furnish to the Government duplicate samples of test specimens for possible testing by the Government. Testing includes operation and/or acceptance tests when specified. Procure the services of a Corps of Engineers approved testing laboratory or establish an approved testing laboratory at the project site. Perform the following activities and record and provide the following data:

a. Verify that testing procedures comply with contract requirements.

b. Verify that facilities and testing equipment are available and comply with testing standards.

c. Check test instrument calibration data against certified standards.

d. Verify that recording forms and test identification control number system, including all of the test documentation requirements, have been prepared.

e. Record results of all tests taken, both passing and failing on the CQC report for the date taken. Specification paragraph reference, location where tests were taken, and the sequential control number identifying the test. If approved by the Contracting Officer, actual test reports may be submitted later with a reference to the test number and date taken. Provide an information copy of tests performed by an offsite or commercial test facility directly to the Contracting Officer. Failure to submit timely test reports as stated may result in nonpayment for related work performed and disapproval of the test

facility for this contract.

3.7.2 Testing Laboratories

3.7.2.1 Capability Check

The Government reserves the right to check laboratory equipment in the proposed laboratory for compliance with the standards set forth in the contract specifications and to check the laboratory technician's testing procedures and techniques. Laboratories utilized for testing soils, concrete, asphalt, and steel must meet criteria detailed in ASTM D 3740 and ASTM E 329.

3.7.3 Onsite Laboratory

The Government reserves the right to utilize the Contractor's control testing laboratory and equipment to make assurance tests, and to check the Contractor's testing procedures, techniques, and test results at no additional cost to the Government.

3.8 COMPLETION INSPECTION

3.8.1 Punch-Out Inspection

Conduct an inspection of the work by the CQC Manager near the end of the work, or any increment of the work established by a time stated in the SPECIAL CONTRACT REQUIREMENTS Clause, "Commencement, Prosecution, and Completion of Work", or by the specifications. Prepare and include in the CQC documentation a punch list of items which do not conform to the approved drawings and specifications, as required by paragraph DOCUMENTATION. Include within the list of deficiencies the estimated date by which the deficiencies will be corrected. Make a second inspection the CQC System Manager or staff to ascertain that all deficiencies have been corrected. Once this is accomplished, notify the Government that the facility is ready for the Government Pre-Final inspection.

3.8.2 Pre-Final Inspection

The Government will perform the pre-final inspection to verify that the facility is complete and ready to be occupied. A Government Pre-Final Punch List may be developed as a result of this inspection. Ensure that all items on this list have been corrected before notifying the Government, so that a Final inspection with the customer can be scheduled. Correct any items noted on the Pre-Final inspection in a timely manner. These inspections and any deficiency corrections required by this paragraph must be accomplished within the time slated for completion of the entire work or any particular increment of the work if the project is divided into increments by separate completion dates.

3.8.3 Final Acceptance Inspection

The Contractor's Quality Control Inspection personnel, plus the superintendent or other primary management person, and the Contracting Officer's Representative must be in attendance at the final acceptance inspection. Additional Government personnel including, but not limited to, those from Base/Post Civil Facility Engineer user groups, and major commands may also be in attendance. The final acceptance inspection will be formally scheduled by the Contracting Officer based upon results of the Pre-Final inspection. Notify the Contracting Officer at least 5 days

prior to the final acceptance inspection and include the Contractor's assurance that all specific items previously identified to the Contractor as being unacceptable, along with all remaining work performed under the contract, will be complete and acceptable by the date scheduled for the final acceptance inspection. Failure of the Contractor to have all contract work acceptably complete for this inspection will be cause for the Contracting Officer to bill the Contractor for the Government's additional inspection cost in accordance with the contract clause titled "Inspection of Construction".

3.9 DOCUMENTATION

Maintain current records providing factual evidence that required quality control activities and/or tests have been performed. Include in these records the work of subcontractors and suppliers on an acceptable form that includes, as a minimum, the following information:

a. Contractor/subcontractor and their area of responsibility.

b. Operating plant/equipment with hours worked, idle, or down for repair.

c. Work performed each day, giving location, description, and by whom. When Network Analysis (NAS) is used, identify each phase of work performed each day by NAS activity number.

d. Test and/or control activities performed with results and references to specifications/drawings requirements. Identify the control phase (Preparatory, Initial, Follow-up). List of deficiencies noted, along with corrective action.

e. Quantity of materials received at the site with statement as to acceptability, storage, and reference to specifications/drawings requirements.

f. Submittals and deliverables reviewed, with contract reference, by whom, and action taken.

g. Offsite surveillance activities, including actions taken.

h. Job safety evaluations stating what was checked, results, and instructions or corrective actions.

i. Instructions given/received and conflicts in plans and/or specifications.

j. Contractor's verification statement.

Indicate a description of trades working on the project; the number of personnel working; weather conditions encountered; and any delays encountered. Cover both conforming and deficient features and include a statement that equipment and materials incorporated in the work and workmanship comply with the contract. Furnish the original and one copy of these records in report form to the CE Project Inspector and the Contract Specialist daily by 12:00PM (noon) the following day after the date covered by the report, except that reports need not be submitted for days on which no work is performed. All calendar days must be accounted for throughout the life of the contract. The first report following a day of no work will be for that day only. Reports must be signed and dated by the CQC System Manager. Include copies of test reports and copies of

reports prepared by all subordinate quality control personnel within the CQC System Manager Report.

3.10 SAMPLE FORMS

Sample forms enclosed at the end of this section.

3.11 NOTIFICATION OF NONCOMPLIANCE

The Contracting Officer will notify the Contractor of any detected noncompliance with the foregoing requirements. Take immediate corrective action after receipt of such notice. Such notice, when delivered to the Contractor at the work site, will be deemed sufficient for the purpose of notification. If the Contractor fails or refuses to comply promptly, the Contracting Officer may issue an order stopping all or part of the work until satisfactory corrective action has been taken. No part of the time lost due to such stop orders will be made the subject of claim for extension of time or for excess costs or damages by the Contractor.

-- End of Section --

SECTION 01 50 00

TEMPORARY CONSTRUCTION FACILITIES AND CONTROLS
08/09

PART 1 GENERAL

1.1 SUMMARY

Requirements of this Section apply to, and are a component of, each section of the specifications.

1.2 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 241	(2009) Standard for Safeguarding Construction,Alteration, and Demolition Operations
NFPA 70	(2011; TIA 11-1; Errata 2011; TIA 11-2; TIA 11-3; TIA 11-4) National Electrical Code

U.S. FEDERAL HIGHWAY ADMINISTRATION (FHWA)

MUTCD	(2009) Manual of Uniform Traffic Control Devices

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Construction site plan; G

1.4 CONSTRUCTION SITE PLAN

Prior to the start of work, submit a site plan showing the locations and dimensions of temporary facilities (including layouts and details, equipment and material storage area (onsite and offsite), and access and haul routes, avenues of ingress/egress to the fenced area and details of the fence installation. Identify any areas which may have to be graveled to prevent the tracking of mud. Indicate if the use of a supplemental or other staging area is desired. Show locations of safety and construction fences, site trailers, construction entrances, trash dumpsters, temporary sanitary facilities, and worker parking areas.

PART 2 PRODUCTS

2.1 TEMPORARY SIGNAGE

2.1.1 Bulletin Board

Immediately upon beginning of work, provide a weatherproof glass-covered bulletin board not less than 36 by 48 inches in size for displaying the Equal Employment Opportunity poster, a copy of the wage decision contained in the contract, Wage Rate Information poster, and other information approved by the Contracting Officer. Locate the bulletin board at the project site in a conspicuous place easily accessible to all employees, as approved by the Contracting Officer.

2.1.2 Project and Safety Signs

The requirements for the signs, their content, and location are as directed by the Contracting Officer. Erect signs within 15 days after receipt of the notice to proceed. Correct the data required by the safety sign daily, with light colored metallic or non-metallic numerals.

2.2 TEMPORARY TRAFFIC CONTROL

2.2.1 Haul Roads

At contractors expense construct access and haul roads necessary for proper prosecution of the work under this contract. Construct with suitable grades and widths; sharp curves, blind corners, and dangerous cross traffic are be avoided. Provide necessary lighting, signs, barricades, and distinctive markings for the safe movement of traffic. The method of dust control, although optional, must be adequate to ensure safe operation at all times. Location, grade, width, and alignment of construction and hauling roads are subject to approval by the Contracting Officer. Lighting must be adequate to assure full and clear visibility for full width of haul road and work areas during any night work operations.

2.2.2 Barricades

Erect and maintain temporary barricades to limit public access to hazardous areas. Whenever safe public access to paved areas such as roads, parking areas or sidewalks is prevented by construction activities or as otherwise necessary to ensure the safety of both pedestrian and vehicular traffic barricades will be required. Securely place barricades clearly visible with adequate illumination to provide sufficient visual warning of the hazard during both day and night.

2.2.3 Fencing

a. Provide fencing along the construction site at all open excavations and tunnels to control access by unauthorized people. Fencing must be installed to be able to restrain a force of at least 250 pounds against it.

b. In addition, prior to the start of work, enclose those areas at the construction site which are not within the construction fence with a temporary safety fence, including gates and warning signs, to protect the public from construction activities. The safety fence shall match the base standard color (or bright orange where it protects excavated

areas), shall be made of high density polyethylene grid or approved equal, a minimum of 42 inches high, supported and tightly secured to steel posts located on minimum 10 foot centers. Remove the fence from the work site upon completion of the contract.

2.2.4 Temporary Wiring

Provide temporary wiring in accordance with NFPA 241 and NFPA 70, Article 305-6(b), Assured Equipment Grounding Conductor Program. Include frequent inspection of all equipment and apparatus.

PART 3 EXECUTION

3.1 EMPLOYEE PARKING

Contractor employees will park privately owned vehicles in an area designated by the Contracting Officer. This area will be within reasonable walking distance of the construction site. Contractor employee parking must not interfere with existing and established parking requirements of the government installation.

3.2 AVAILABILITY AND USE OF UTILITY SERVICES

3.2.1 Temporary Utilities

Provide temporary utilities required for construction. Materials may be new or used, must be adequate for the required usage, not create unsafe conditions, and not violate applicable codes and standards.

3.2.2 Payment for Utility Services

a. The Government will make all reasonably required utilities available to the Contractor from existing outlets and supplies, as specified in the contract. Carefully conserve any utilities furnished without charge.

b. Reasonable amounts of the following utilities will be made available to the Contractor without charge.

c. The point at which the Government will deliver such utilities or services and the quantity available is as indicated. Pay all costs incurred in connecting, converting, and transferring the utilities to the work. Make connections, including providing backflow-preventing devices on connections to domestic water lines; and providing transformers; and make disconnections. Under no circumstances will taps to base fire hydrants be allowed for obtaining domestic water. Install temporary meters for power and water.

3.2.3 Sanitation

a. Provide and maintain within the construction area minimum field-type sanitary facilities approved by the Contracting Officer and periodically empty wastes into a municipal, district, or station sanitary sewage system, or remove waste to a commercial facility. Obtain approval from the system owner prior to discharge into any municipal, district, or commercial sanitary sewer system. Any penalties and / or fines associated with improper discharge will be the responsibility of the Contractor. Coordinate with the Contracting Officer and follow station regulations and procedures when discharging

into the station sanitary sewer system. Maintain these conveniences at all times without nuisance. Include provisions for pest control and elimination of odors. Government toilet facilities will not be available to Contractor's personnel.

b. Provide temporary sewer and sanitation facilities that are self-contained units with both urinals and stool capabilities. Ventilate the units to control odors and fumes and empty and clean them at least once a week or more often if required by the Contracting Officer. The doors shall be self-closing. The exterior of the unit shall match the base standard color. Locate the facility behind the construction fence or out of the public view.

3.2.4 Telephone

Make arrangements and pay all costs for telephone facilities desired.

3.2.5 Fire Protection

Provide temporary fire protection equipment for the protection of personnel and property during construction. Remove debris and flammable materials daily to minimize potential hazards.

3.3 TRAFFIC PROVISIONS

3.3.1 Maintenance of Traffic

a. Conduct operations in a manner that will not close any thoroughfare or interfere in any way with traffic on railways or highways except with written permission of the Contracting Officer at least 15 calendar days prior to the proposed modification date, and provide a Traffic Control Plan detailing the proposed controls to traffic movement for approval. The plan must be in accordance with State and local regulations and the Manual on Uniform Traffic Control Devices MUTCD, Part VI. Make all notifications and obtain any permits required for modification to traffic movements outside Station's jurisdiction. Contractor may move oversized and slow-moving vehicles to the worksite provided requirements of the highway authority have been met.

b. Conduct work so as to minimize obstruction of traffic, and maintain traffic on at least half of the roadway width at all times. Obtain approval from the Contracting Officer prior to starting any activity that will obstruct traffic.

c. Provide, erect, and maintain, at contractors expense, lights, barriers, signals, passageways, detours, and other items, that may be required by the Life Safety Signage, overhead protection authority having jurisdiction.

3.3.2 Protection of Traffic

Maintain and protect traffic on all affected roads during the construction period except as otherwise specifically directed by the Contracting Officer. Measures for the protection and diversion of traffic, including the provision of watchmen and flagmen, erection of barricades, placing of lights around and in front of equipment the work, and the erection and maintenance of adequate warning, danger, and direction signs, will be as required by the State and local authorities having jurisdiction. Protect the traveling public from damage to person and property. Minimize the

interference with public traffic on roads selected for hauling material to and from the site. Investigate the adequacy of existing roads and their allowable load limit. Contractor is responsible for the repair of any damage to roads caused by construction operations.

3.3.3 Rush Hour Restrictions

Do not interfere with the peak traffic flows preceding and during normal operations without notification to and approval by the Contracting Officer.

3.3.4 Dust Control

Dust control methods and procedures must be approved by the Contracting Officer. Treat dust abatement on access roads with applications of calcium chloride, water sprinklers, or similar methods or treatment.

3.4 CONTRACTOR'S TEMPORARY FACILITIES

Contractor-owned or -leased trailers must be identified by Government assigned numbers. Size and location of the number will comply with Base Standards. Apply the number to the trailer within 14 calendar days of notification, or sooner, if directed by the Government.

3.4.1 Safety

Protect the integrity of any installed safety systems or personnel safety devices. If entrance into systems serving safety devices is required, the Contractor must obtain prior approval from the Contracting Officer. If it is temporarily necessary to remove or disable personnel safety devices in order to accomplish contract requirements, provide alternative means of protection prior to removing or disabling any permanently installed safety devices or equipment and obtain approval from the Contracting Officer.

3.4.2 Administrative Field Offices

Provide and maintain administrative field office facilities within the construction area at the designated site. Government office and warehouse facilities will not be available to the Contractor's personnel.

3.4.3 Supplemental Storage Area

Upon Contractor's request, the Contracting Officer will designate another or supplemental area for the Contractor's use and storage of trailers, equipment, and materials. This area may not be in close proximity of the construction site but will be within the installation boundaries. Fencing of materials or equipment will not be required at this site; however, the Contractor is responsible for cleanliness and orderliness of the area used and for the security of any material or equipment stored in this area. Utilities will not be provided to this area by the Government.

3.4.4 Appearance of Trailers

a. Trailers utilized by the Contractor for administrative or material storage purposes must present a clean and neat exterior appearance and be in a state of good repair. Trailers which, in the opinion of the Contracting Officer, require exterior painting or maintenance will not be allowed on installation property.

b. Paint in accordance with facility standards and maintain the temporary

facilities. Failure to do so will be sufficient reason to require their removal.

3.4.5 Trailers or Storage Buildings

a. Trailers or storage buildings will be permitted, where space is available, subject to the approval of the Contracting Officer. The trailers or buildings shall be in good condition, free from visible damage rust and deterioration, and meet all applicable safety requirements. Trailers shall be roadworthy and comply with all appropriate state and local vehicle requirements. Failure to maintain storage trailers or buildings to these standards shall result in the removal of non-complying units at the Contractor's expense. A sign not smaller than 24 by 24 inches shall be conspicuously placed on the trailer depicting the company name, business phone number, and emergency phone number. Trailers shall be anchored to resist high winds and must meet applicable state of local standards for anchoring mobile trailers.

3.4.6 Maintenance of Storage Area

a. Keep fencing in a state of good repair and proper alignment. Grassed or unpaved areas, which are not established roadways, will be covered with a layer of gravel as necessary to prevent rutting and the tracking of mud onto paved or established roadways, should the Contractor elect to traverse them with construction equipment or other vehicles; gravel gradation will be at the Contractor's discretion. Mow and maintain grass located within the boundaries of the construction site for the duration of the project. Grass and vegetation along fences, buildings, under trailers, and in areas not accessible to mowers will be edged or trimmed neatly.

b. Cut grass (or annual weeds) within the construction and storage sites to a maximum 4 inch height at least once a week during the growing season unless the grass area is not visible to the public. Trim the grass around fences at time of grass cutting. Maintain grass or weeds on stockpiled earth as descried above.

3.4.7 Security Provisions

Provide adequate outside security lighting at the Contractor's temporary facilities. The Contractor will be responsible for the security of its own equipment; in addition, the Contractor will notify the appropriate law enforcement agency requesting periodic security checks of the temporary project field office.

3.4.8 Storage Size and Location

The open site available for storage must be confined to the indicated operations area.

3.4.9 Storage in Existing Buildings

The Contractor will be working around existing buildings; the storage of material will not be allowed in the buildings.

3.4.10 Weather Protection of Temporary Facilities and Stored Materials

Take necessary precautions to ensure that roof openings and other critical openings in the building are monitored carefully. Take immediate actions required to seal off such openings when rain or other detrimental weather is imminent, and at the end of each workday. Ensure that the openings are completely sealed off to protect materials and equipment in the building from damage.

3.4.10.1 Building and Site Storm Protection

When a warning of gale force winds is issued, take precautions to minimize danger to persons, and protect the work and nearby Government property. Precautions must include, but are not limited to, closing openings; removing loose materials, tools and equipment from exposed locations; and removing or securing scaffolding and other temporary work. Close openings in the work when storms of lesser intensity pose a threat to the work or any nearby Government property.

3.4.10.2 Hurricane Condition of Readiness

Unless directed otherwise, comply with:

a. Condition FOUR (Sustained winds of 50 knots or greater expected within 72 hours): Normal daily jobsite cleanup and good housekeeping practices. Collect and store in piles or containers scrap lumber, waste material, and rubbish for removal and disposal at the close of each work day. Maintain the construction site including storage areas, free of accumulation of debris. Stack form lumber in neat piles less than 4 feet high. Remove all debris, trash, or objects that could become missile hazards. Contact Contracting Officer for Condition of Readiness (COR) updates and completion of required actions.

b. Condition THREE (Sustained winds of 50 knots or greater expected within 48 hours): Maintain "Condition FOUR" requirements and commence securing operations necessary for "Condition ONE" which cannot be completed within 18 hours. Cease all routine activities which might interfere with securing operations. Commence securing and stow all gear and portable equipment. Make preparations for securing buildings. Review requirements pertaining to "Condition TWO" and continue action as necessary to attain "Condition THREE" readiness. Contact Contracting Officer for weather and COR updates and completion of required actions.

c. Condition TWO (Sustained winds of 50 knots or greater expected within 24 hours): Curtail or cease routine activities until securing operation is complete. Reinforce or remove form work and scaffolding. Secure machinery, tools, equipment, materials, or remove from the jobsite. Expend every effort to clear all missile hazards and loose equipment from general base areas. Contact Contracting Officer for weather and Condition of Readiness (COR) updates and completion of required actions.

d. Condition ONE. (Sustained winds of 50 knots or greater expected within 12 hours): Secure the jobsite, and leave Government premises.

3.5 TEMPORARY PROJECT SAFETY FENCING

As soon as practicable, but not later than 15 days after the date established for commencement of work, furnish and erect temporary project safety fencing at the work site. The safety fencing must be a high visibility orange colored, high density polyethylene grid or approved equal, a minimum of 42 inches high, supported and tightly secured to steel posts located on maximum 10 foot centers, constructed at the approved location. Maintain the safety fencing during the life of the contract and, upon completion and acceptance of the work, will become the property of the Contractor and be removed from the work site.

3.6 CLEANUP

Remove construction debris, waste materials, packaging material and the like from the work site daily. Any dirt or mud which is tracked onto paved or surfaced roadways must be cleaned away. Store within the fenced area described above or at the supplemental storage area any materials resulting from demolition activities which are salvageable. Neatly stacked stored materials not in trailers, whether new or salvaged.

3.7 RESTORATION OF STORAGE AREA

Upon completion of the project remove the bulletinboard, signs, barricades, haulroads, and any other temporary products from the site. After removal of trailers, materials, and equipment from within the fenced area, remove the fence that will become the property of the Contractor. Restore to the original or better condition, areas used by the Contractor for the storage of equipment or material, or other use. Gravel used to traverse grassed areas must be removed and the area restored to its original condition, including top soil and seeding as necessary.

-- End of Section --

SECTION 01 54 00

AFFIRMATIVE PROCUREMENT
07/01

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only. The publications shall be the most current issue.

AIR FORCE CIVIL ENGINEER CENTER

AF APP	Air Force Affirmative Procurement Plan

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)

CPG 1	Comprehensive Procurement Guidelines
ETL 00-1	EPA Guideline Items in Construction and Other Civil Engineering Specifications

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

40 CFR 247	Comprehensive Procurement Guideline for Products Containing Recovered Materials
48 CFR FAR 23.402	Code of Federal Acquistion Regulations, Subpart 23.4 - Use of Recovered Materials
5 USC 102	Government Organization and Employees, Part I - The Agencies Generally, Chapter 1 - Organization, Section 102. Military Departments
5 USC 105	Government Organization and Employees, Part I - The Agencies Generally, Chapter 1 - Organization, Section 105. Executive Agency
42 USC 6903	The Public Health and Welfare, Chapter 82 - Solid Waste Disposal, Sec. 6903. Definitions
42 USC 13102	The Public Health and Welfare, Chapter 133 - Pollution Prevention, Sec. 13102. Definitions
RCRA Sec. 6002	The Resource Conservation and Recovery Act (RCRA) (42 USC 6962)

OFFICE OF THE FEDERAL ENVIRONMENTAL EXECUTIVE (OFEE)

EO 13101	Greening the Government through Waste Prevention, Recycling, and Federal Acquisition

OFFICE OF FEDERAL PROCUREMENT POLICY

OFPP 92-4	Policy Letter 92-4, Procurement of Environmentally Sound and Energy-Efficient Products and Services

1.2 RELATED SPECIFICATION SECTIONS:

Section 01010 - GENERAL REQUIREMENTS

1.3 AFFIRMATIVE PROCUREMENT AND POLLUTION PREVENTION

a. Affirmative Procurement is a mandatory component of the Air Force pollution prevention program. The AF Installation Pollution Prevention Program Guide includes this goal for Affirmative Procurement: "100% of all products purchased each year in each of U.S. EPA's 'Guideline Item' categories shall contain recycled materials meeting U.S. EPA's Guideline Criteria."

b. Currently, reporting of affirmative procurement purchases is limited to contracts having a total value greater than $100,000 which includes the purchase of any amount of U.S. EPA-designated items.

c. This document contains guidelines for implementing the RCRA, EO, DOD, and Air Force requirements.

1.4 INTENT

a. The intent of this section is to increase the awareness of all contractors as to the availability of products manufactured from or that contain recycled materials, thereby increasing the use of these products in the construction of this project.

b. The various sections of the specifications contain references to products to be used in the construction of this project. The listed product **may or may not** be manufactured from or contain recycled materials. Therefore all contractor(s), subcontractors, equipment suppliers and material suppliers are responsible for compliance with this specification, particularly paragraph 1.9 and those items/products listed in paragraph 2.1. Recycled products shall be used wherever possible subject to the exemptions as per paragraph 1.9.

c. Substitution of recycled materials or recycled products for specified products are subject to the provisions of paragraph 1.5 Submittals.

1.5 SUBMITTALS

The following shall be submitted in accordance with Section 01 33 00, SUBMITTAL PROCEDURES:

SD-03 Product Data

Product Sources and Information

Submit manufacturer's material specifications, installation

instructions, physical characteristics

SD-07 Certificates

Product Sources and Information

Certify that products meet or exceed the specified requirements.

1.6 RECYCLED OR RECOVERED PRODUCTS

Those construction materials identified in paragraph 2.1 at the end of this section.

1.7 QUALITY ASSURANCE

1.7.1 Manufacturer

Companies specializing in the manufacture of products that comply with the requirements of this section with a minimum of three (3) years documented experience.

1.8 DEFINITIONS

a. AFFIRMATIVE PROCUREMENT: The purchase of environmentally preferable products manufactured from recycled and reclaimed materials.

b. ACQUISITION: The acquiring by contract with appropriated funds for supplies or services (including construction) by and for the use of the Federal Government through purchase or lease, whether the supplies or services are already in existence or must be created, developed, demonstrated, and evaluated. Acquisition begins at the point when agency needs are established and includes the description of requirements to satisfy agency needs, solicitation and selection of sources, award of contracts, contract financing, contract performance, contract administration, and those technical and management functions directly related to the process of fulfilling agency needs by contract.

c. CONTRACTOR (S): The prime contractor, subcontractors, material suppliers, and equipment suppliers who provide the products that will be used in the construction of this project.

d. ENVIRONMENTALLY PREFERABLE: Products or services having a lesser or reduced effect on human health and the environment when compared to competing products or services, serving the same purpose. This comparison may consider raw materials acquisition, production, manufacturing, packing, distribution, reuse, operation, maintenance, or product or service disposal. (EO 13101)

e. EPA DESIGNATED ITEM: An item that is or can be made with recovered material; that is listed by the Environmental Protection Agency (EPA) in a procurement guideline (40 CFR 247); and for which EPA has advised purchasing recommendations in a related Recovered materials Advisory Notice (RMAN). (48 CFR FAR 23.402)

f. EXECUTIVE AGENCY OR AGENCY: An executive agency as defined in 5 USC 105. For the purpose of this order, military departments, as defined in 5 USC 102 are covered under the auspices of the

Department of Defense.

g. POLLUTION PREVENTION: Source reduction as defined in the Pollution Prevention Act of 1990 (42 USC 13102), and other practices that reduce or eliminate the creation of pollutants through (a) increased efficiency in the use of raw materials, energy, water, or other resources; or (b) protection of natural resources by conservation.

h. PRODUCT: Materials and equipment that will be used in the construction of this project.

i. POSTCONSUMER MATERIAL: A material or finished product that has served its intended use and has been discarded for disposal or recovery, having completed its life as a consumer item. "Postconsumer material" is a part of the broader category of "recovered material".

j. PROCUREMENT: The purchase and providing of products to be used in the construction of this project.

k. RECOVERED MATERIALS: Waste materials and by-products which have been recovered or diverted from solid waste, but such term does not include those materials and by-products generated from, and commonly reused within, an original manufacturing process. (EO 13101, 42 USC 6903 (19) and 48 CFR FAR 23.402)

l. RECYCLABILITY: The ability of a product or material to be recovered from or otherwise diverted from the solid waste stream for the purpose of recycling. (EO 13101)

m. RECYCLING: The series of activities, including collection, separation, and processing by which products or other materials are recovered from the solid waste steam for use in form of raw materials in the manufacture of new products other than fuel for producing heat or power by combustion. (EO 13101)

n. RECYCLED MATERIAL: A material utilized in place of raw or virgin material in product manufacturing consisting of materials derived from postconsumer waste, industrial scrap, material derived from agricultural wastes, and other items, all of which can be used in new product manufacturer. (CPG 1, ETL 00-1 & OFPP 92-4)

o. RECYCLED PRODUCT: A recycled product is one made completely or partially from waste materials or by-products recovered or diverted from the solid waste stream.

p. SOLID WASTE: Garbage, refuse, sludges and other discarded materials including those from industrial, commercial, and agricultural operations, and from community activities. This excludes solids or dissolved materials in domestic sewage or other significant pollutants in water resources, such as silt, dissolved or suspended solids in industrial waste water effluents, dissolved materials in irrigation return flow, etc. (CPG 1 and ETL 00-1)

q. SPECIFICATION (S): A clear and accurate description of the technical requirements for materials, products, or services including the minimum requirement for materials' quality and construction and any equipment necessary for an acceptable

product. In general, specifications are in the form of written descriptions, drawings, prints, commercial designations, industry standards, and other descriptive references.

r. UNREASONABLE PRICE: If the cost of the recycled content product exceeds the cost of a non-recycled item, the Air Force considers the cost to be unreasonable. (AF APP)

s. VERIFICATION: Procedures used by procuring agencies to confirm both vendor estimates and certifications of the percentages of recovered materials contained in the products supplied to them or to be used in the performance of a contract. (CPG 1 and ETL 00-1)

t. WASTE PREVENTION: Any change in the design, manufacturing, purchase, or use of materials or products (including packaging) to reduce their amount or toxicity before they are discarded. Waste prevention also refers to the reuse of products or materials.

u. WASTE REDUCTION: Preventing or decreasing the amount of waste being generated through waste prevention, recycling, or purchasing recycled and environmentally preferable products.

1.9 EXEMPTIONS

U.S. EPA recommends minimum content levels for those items listed at paragraph 1.10. The minimum content levels can be found at www.epa.gov/cpg. These levels are **mandatory unless one of the following exemptions applies**. RCRA Sec. 6002 provides the following exemptions from the requirement to purchase EPA-designated items:

a. The product is not available from a sufficient number of sources to maintain a satisfactory level of competition (i.e., available from two or more sources).

b. The product is not available within a reasonable period of time.

c. The product does not meet the performance standards in applicable specifications or fails to meet reasonable performance standards of the procuring agency.

d. The product is not available at a reasonable price. For Air Force purposes, "unreasonable price" is defined as follows: If the price of the recycled-content product exceeds the cost of a non-recycled item, then the price is considered unreasonable.

1.10 U.S. EPA-DESIGNATED ITEMS

The 54 U.S. EPA-designated items are listed below. **Not all of these materials may be required in the construction of this project. Please refer to the drawings and specifications.**

1.10.1 Paper Products

Item 1: All paper and paper products, excluding building and construction paper grades.

1.10.2 Vehicular Products

Item 2: Lubricating oils containing re-refined oil, including engine

lubricating oils, hydraulic fluids, and gear oils, but excluding marine and aviation oils.
Item 3: Tires, excluding airplane tires.
Item 4: Reclaimed engine coolants, excluding coolants used in non-vehicular applications.

1.10.3 Construction Products

Item 5: Building insulation products.
Item 6: Structural fiberboard products for applications other than building insulation.
Item 7: Laminated paperboard products for applications other than building insulation.
Item 8: Cement and concrete, including products such as pipe and block, containing fly ash.
Item 9: Cement and concrete, including concrete products such as pipe and block, containing ground-granulated blast furnace (GGBF) slag.
Item 10: Carpet made of polyester fiber for use in low- and medium-wear applications.
Item 11: Floor tiles containing recovered rubber or plastic.
Item 12: Patio blocks containing recovered rubber or plastic.
Item 25: Shower and restroom dividers/partitions containing recovered steel or plastic.
Item 26: Reprocessed and consolidated latex paint for specific uses.
Item 37: Carpet cushion.
Item 38: Flowable fill.
Item 39: Railroad grade crossing surfaces.

1.10.4 Transportation Products

Item 13: Traffic barricades used in controlling or restricting vehicular traffic.
Item 14: Traffic cones used in controlling or restricting vehicular traffic.
Item 27: Parking stops.
Item 28: Channelizers used as temporary traffic control devices.
Item 29: Delineators used as temporary traffic control devices.
Item 30: Flexible delineators used as temporary traffic control devices.

1.10.5 Park And Recreation Products

Item 15: Playground surfaces containing recovered rubber or plastic.
Item 16: Running tracks containing recovered rubber or plastic.
Item 31: Plastic fencing.
Item 40: Park benches and picnic tables.
Item 41: Playground equipment.

1.10.6 Landscaping Products

Item 17: Hydraulic mulch products containing recovered paper or recovered wood.
Item 18: Compost made from yard trimmings, leaves, and/or grass clippings.
Item 32: Garden and soaker hoses containing recovered rubber or plastic.
Item 33: Lawn and garden edging containing recovered rubber or plastic.
Item 42: Food waste compost.
Item 43: Plastic lumber landscaping timbers and posts.

1.10.7 Non-Paper Office Products

Item 19: Office recycling containers.
Item 20: Office waste receptacles.
Item 16: Plastic desktop accessories.
Item 22: Toner cartridges.
Item 23: Binders.
Item 24: Plastic trash bags.
Item 34: Printer ribbons (re-inked ribbons or re-inking equipment/service for ribbons).
Item 35: Plastic envelops.
Item 44: Solid plastic binders.
Item 45: Plastic clipboards.
Item 46: Plastic file folders.
Item 47: Plastic clip portfolios.
Item 48: Plastic presentation folders.

1.10.8 Miscellaneous Products

Item 36: Pallets.
Item 49: Sorbents.
Item 50: Industrial drums.
Item 51: Awards and plaques.
Item 52: Mats.
Item 53: Signage, including supports and posts.
Item 54: Manual grade strapping.

1.11 APPLICABILITY

a. These requirements apply to all contractors employed in the construction of this project.

b. Please direct all questions regarding the plan to the contracting officer or designated representative.

PART 2 PRODUCTS

2.1 PARTIAL LIST OF PRODUCT SOURCES AND INFORMATION

2.1.1 General Data

a. Comprehensive Procurement Guidelines, epa.gov/cpg

b. Environmental Building News, www.ebuild.com

c. Certified Forest Products Council, www.cerifiedwood.org/

d. Wiley Series in Sustainable Design, www.wiley.com/

e. The Carpet and Rug Institute, www.carpet-rug.com/

f. Information, McGraw-Hill, dialogue@mcgraw-hill.com

g. Florida Directory of Recycled Product Vendors, www.2.dep.state.fl.us/waste/programs/rbac/downloads/rbac_dir.pd

h. Oikos Green Building Source, News, searchable products data base, library, www.oikos.com

i. Green Design Network, News, publications, databases, www.greendesign.net

j. Green Works Recycled Content7 Product Guide, detailed vendors directory, www.metrokc.gov/greenworks/recycontent.htm>

2.1.2 Division 03, Concrete

a. GranCem, granulated blast-furnace slag, www.grancem.com/

b. Syndesis, cement-based, pre-cast product workable with wood tools, www.syndesisinc.com/

2.1.3 Division 04, Masonry

a. Heble Building Systems, autoclaved aerated concrete blocks, www.heble.com/

b. Ytong Florida Ltd., autoclaved aerated concrete blocks, www.ytong-usa.com/

2.1.4 Division 06, Wood & Plastics

a. Avonite, solid surfacing, www.avonite.com/

b. Chemical Specialties, wood treatment, www.treatedwood.com/

c. Homasote Company, structural fiberboard, www.homasote.com/

d. Isobar, fiberboard composed of straw fibers and non-toxic resins, www.isoboard.com/

e. Trashiest Mac Millan, engineered wood products, www.homasote.com

2.1.5 Division 07, Thermal & Moisture Protection

a. Duro-Last Roofing, recycled PVC walkway pads, 1-800-2480280

b. Johns Manville, Insulation products, www.jm.com/

c. Majestic Skylines, rubber-based slate-look roofing for steep roofs, www.majesticskylines.com/

d. Owens-Corning, insulation products, www.owenscorning.com/

2.1.6 Division 08, Doors & Windows

a. Marvin Window & Door, windows, some meeting "Energy Star Label", www.marvin.com

b. Pella, energy efficient windows, www.pella.com

2.1.7 Division 09, Finishes

a. Armstrong World Industries, Inc.-Flooring Systems, www.armstrong-floors.com/

b. Armstrong World Industries, Inc.-Ceiling Systems, www.ceilings.com/

c. Benjamin Moore & Co., VOC free acrylic interior latex paint, www.benjaminmoore.com/

d. CanFibre Group Ltd., all-green medium-density fiberboard, www.canfibre.com

e. Chemrex Inc., low-e interior paint, www.chemrex.com/

f. Collins & Aikman Floor coverings, carpet with 100% post-consumer backing, www.powerbond.com

g. DesignTex, Inc., polyester panel fabric made from 100% PET fiber, www.dtex.com

h. Dodge-Regupol, Inc., 100% recycled rubber-flooring, www.regupol.com/

i. Eco-sensitive modular tile, vinyl tile with 100% recycled carpet-backing, www.powerbond.com

j. Environmental Stone Products, stone manufactured from 100% recycled glass, www.environmentalstone.com

k. Glidden: residential interior latex paints 100% free of VOC, www.icipaintstores.com

l. Homasote Inc., sound barrier, www.homasote.com

m. Isobar Enterprises, Inc. panel made from wheat straw and non-toxic resins, 1-503-2427345

n. Marley-Flexco Co., flooring made from 95% recycled truck and bus tires, www.marleyflexco.com

o. The Mat Factory, Inc., interlocking roll-up tiles made from 100% postconsumer tire rubber and PVC plastic from electric cable covers, 1-949-6453122

p. Permafirm Pad Co., carpet pads made from almost 100% recycled content, 1-800-3446977

q. Sherwin Williams, VOC compliant paints and enamels, www.sherwin.com/

r. SierraPine Limited, formaldehyde-free particleboard and medium density fiberboard containing recycled/recovered wood fiber, www.sierrapine.com/

s. Summittville Tiles, impervious porcelain tiles using feldspar tailings, www.summitville.com/

t. Tectum, natural-fiber acoustical ceiling and wall panels, www.tectum.com/

u. Tiles with natural fibers, tiles made of a bio-alloy material and natural fibers, www.maderatile.com

v. USG Interiors, Inc., synthetic gypsum board, www.usg.com/

w. Decorative Architectural Tiles, floor, counter & wall tile made from 100 % postconsumer glass, 1-808-8857812

x. Forbo, linoleum-flooring utilizing renewable resources, www.forbo.com/

2.1.8 Division 10, Specialties

a. The Access Store, modular ramping system made from 100% recycled rubber, www.accessstore.com/

b. BP Solar, photovoltaic modules and systems, www.bp.com/bpsolar/index

c. Mecho Shade Systems, interior shadecloths, www.mechoshade.com/

d. R Control, structural insulated panel (SIP), www.mechoshade.com/

2.1.9 Division 12, Furnishings

a. Guilford of Maine, fabric from 100% recycled materials, www.terratex.com/

b. Phenix Biocomposites, tabletops made from soy based products free of petrochemicals, 1-800-3248187

c. Safe Solutions, LLC, furniture manufactured from waste wood, 1-970-247-3333

2.1.10 Division 16, Electrical

a. Advance Transformer Company, linear reactor ballast, www.advancetransformer.com/

b. Artemide Inc., energy efficient cold-cathode lighting, www.artemide.com/

c. Edison Price Lighting, track mounted metal-halide PAR 30 &38 lamps, 1-212-5216995

d. Leviton Manufacturing Corporation, Inc., occupancy sensors, www.leviton.com/

e. Phillips Lighting, energy efficient compact fluorescent lamps, www.phillips.com/lighting

f. Osram Sylvania, mercury-free lamps and energy efficient fluorescent lamps, www.osramsylvania.com/

g. Sensor Switch, lighting control occupancy sensors, www.sensorswitch.com/

h. Venture Lighting, pulse-start high performance lamp and ballast system, www.venturelighting.com/

PART 3 EXECUTION

Not used.

-- End of Section --

SECTION 01 57 19

TEMPORARY ENVIRONMENTAL CONTROLS - EGLIN STANDARD
03/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)

EPA SW-846	(Third Edition; Update IV) Test Methods for Evaluating Solid Waste: Physical/Chemical Methods

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.120	Hazardous Waste Operations and Emergency Response
40 CFR 112	Oil Pollution Prevention
40 CFR 122.26	Storm Water Discharges (Applicable to State NPDES Programs, see section 123.25)
40 CFR 241	Guidelines for Disposal of Solid Waste
40 CFR 243	Guidelines for the Storage and Collection of Residential, Commercial, and Institutional Solid Waste
40 CFR 258	Subtitle D Landfill Requirements
40 CFR 260	Hazardous Waste Management System: General
40 CFR 261	Identification and Listing of Hazardous Waste
40 CFR 261.7	Residues of Hazardous Waste in Empty Containers
40 CFR 262	Standards Applicable to Generators of Hazardous Waste
40 CFR 262.31	Standards Applicable to Generators of Hazardous Waste-Labeling
40 CFR 262.34	Standards Applicable to Generators of Hazardous Waste-Accumulation Time
40 CFR 263	Standards Applicable to Transporters of Hazardous Waste
40 CFR 264	Standards for Owners and Operators of

	Hazardous Waste Treatment, Storage, and Disposal Facilities
40 CFR 265	Interim Status Standards for Owners and Operators of Hazardous Waste Treatment, Storage, and Disposal Facilities
40 CFR 266	Standards for the Management of Specific Hazardous Wastes and Specific Types of Hazardous Waste Management Facilities
40 CFR 268	Land Disposal Restrictions
40 CFR 273	Standards For Universal Waste Management
40 CFR 273.2	Standards for Universal Waste Management - Batteries
40 CFR 273.3	Standards for Universal Waste Management - Pesticides
40 CFR 273.4	Standards for Universal Waste Management - Mercury Containing Equipment
40 CFR 273.5	Standards for Universal Waste Management - Lamps
40 CFR 279	Standards for the Management of Used Oil
40 CFR 300	National Oil and Hazardous Substances Pollution Contingency Plan
40 CFR 300.125	National Oil and Hazardous Substances Pollution Contingency Plan - Notification and Communications
40 CFR 355	Emergency Planning and Notification
40 CFR 403	General Pretreatment Regulations for Existing and New Sources of Pollution
40 CFR 50	National Primary and Secondary Ambient Air Quality Standards
40 CFR 60	Standards of Performance for New Stationary Sources
40 CFR 61	National Emission Standards for Hazardous Air Pollutants
40 CFR 63	National Emission Standards for Hazardous Air Pollutants for Source Categories
40 CFR 64	Compliance Assurance Monitoring
40 CFR 745	Lead-Based Paint Poisoning Prevention in Certain Residential Structures
40 CFR 761	Polychlorinated Biphenyls (PCBs)

	Manufacturing, Processing, Distribution in Commerce, and Use Prohibitions
49 CFR 171	General Information, Regulations, and Definitions
49 CFR 172	Hazardous Materials Table, Special Provisions, Hazardous Materials Communications, Emergency Response Information, and Training Requirements
49 CFR 172.101	Hazardous Material Regulation-Purpose and Use of Hazardous Material Table
49 CFR 173	Shippers - General Requirements for Shipments and Packagings
49 CFR 178	Specifications for Packagings

1.2 DEFINITIONS

1.2.1 Class I and II Ozone Depleting Substance (ODS)

Class I ODS is defined in Section 602(a) of The Clean Air Act. A list of Class I ODS can be found on the EPA website at the following weblink. http://www.epa.gov/ozone/science/ods/classone.html.

Class II ODS is defined in Section 602(s) of The Clean Air Act. A list of Class II ODS can be found on the EPA website at the following weblink. http://www.epa.gov/ozone/science/ods/classtwo.html.

1.2.2 Contractor Generated Hazardous Waste

Contractor generated hazardous waste is materials that, if abandoned or disposed of, may meet the definition of a hazardous waste. These waste streams would typically consist of material brought on site by the Contractor to execute work, but are not fully consumed during the course of construction. Examples include, but are not limited to, excess paint thinners (i.e., methyl ethyl ketone, toluene), waste thinners, excess paints, excess solvents, waste solvents, excess pesticides, and contaminated pesticide equipment rinse water.

1.2.3 Electronics Waste

Electronics waste is discarded electronic devices intended for salvage, recycling, or disposal.

1.2.4 Environmental Pollution and Damage

Environmental pollution and damage is the presence of chemical, physical, or biological elements or agents which adversely affect human health or welfare; unfavorably alter ecological balances of importance to human life; affect other species of importance to humankind; or degrade the environment aesthetically, culturally or historically.

1.2.5 Environmental Protection

Environmental protection is the prevention/control of pollution and habitat disruption that may occur to the environment during construction.

The control of environmental pollution and damage requires consideration of land, water, and air; biological and cultural resources; and includes management of visual aesthetics; noise; solid, chemical, gaseous, and liquid waste; radiant energy and radioactive material as well as other pollutants.

1.2.6 Hazardous Debris

As defined in paragraph SOLID WASTE, debris that contains listed hazardous waste (either on the debris surface, or in its interstices, such as pore structure) in accordance with 40 CFR 261. Hazardous debris also includes debris that exhibits a characteristic of hazardous waste in accordance with 40 CFR 261.

1.2.7 Hazardous Materials

Hazardous materials as defined in 49 CFR 171 and listed in 49 CFR 172.

Hazardous material is any material that: Is regulated as a hazardous material in accordance with 49 CFR 173; or requires a Safety Data Sheet (SDS) in accordance with 29 CFR 1910.120; or during end use, treatment, handling, packaging, storage, transportation, or disposal meets or has components that meet or have potential to meet the definition of a hazardous waste as defined by 40 CFR 261 Subparts A, B, C, or D. Designation of a material by this definition, when separately regulated or controlled by other sections or directives, does not eliminate the need for adherence to that hazard-specific guidance which takes precedence over this section for "control" purposes. Such material includes ammunition, weapons, explosive actuated devices, propellants, pyrotechnics, chemical and biological warfare materials, medical and pharmaceutical supplies, medical waste and infectious materials, bulk fuels, radioactive materials, and other materials such as asbestos, mercury, and polychlorinated biphenyls (PCBs).

1.2.8 Hazardous Waste

Hazardous Waste is any material that meets the definition of a solid waste and exhibit a hazardous characteristic (ignitability, corrosivity, reactivity, or toxicity) as specified in 40 CFR 261, Subpart C, or contains a listed hazardous waste as identified in 40 CFR 261, Subpart D.

1.2.9 Land Application

Land Application means spreading or spraying discharge water at a rate that allows the water to percolate into the soil. No sheeting action, soil erosion, discharge into storm sewers, discharge into defined drainage areas, or discharge into the "waters of the United States" must occur. Comply with federal, state, and local laws and regulations.

1.2.10 Municipal Separate Storm Sewer System (MS4) Permit

MS4 permits are those held by installations to obtain NPDES permit coverage for their stormwater discharges.

1.2.11 National Pollutant Discharge Elimination System (NPDES)

The NPDES permit program controls water pollution by regulating point sources that discharge pollutants into waters of the United States.

1.2.12 Oily Waste

Oily waste are those materials that are, or were, mixed with Petroleum, Oils, and Lubricants (POLs) and have become separated from that POLs. Oily wastes also means materials, including wastewaters, centrifuge solids, filter residues or sludges, bottom sediments, tank bottoms, and sorbents which have come into contact with and have been contaminated by, POLs and may be appropriately tested and discarded in a manner which is in compliance with other state and local requirements.

This definition includes materials such as oily rags, "kitty litter" sorbent clay and organic sorbent material. These materials may be land filled provided that: It is not prohibited in other state regulations or local ordinances; the amount generated is "de minimus" (a small amount); it is the result of minor leaks or spills resulting from normal process operations; and free-flowing oil has been removed to the practicable extent possible. Large quantities of this material, generated as a result of a major spill or in lieu of proper maintenance of the processing equipment, are a solid waste. As a solid waste, perform a hazardous waste determination prior to disposal. As this can be an expensive process, it is recommended that this type of waste be minimized through good housekeeping practices and employee education.

1.2.13 Regulated Waste

Regulated waste are solid wastes that have specific additional federal, state, or local controls for handling, storage, or disposal.

1.2.14 Sediment

Sediment is soil and other debris that have eroded and have been transported by runoff water or wind.

1.2.15 Solid Waste

Solid waste is a solid, liquid, semi-solid or contained gaseous waste. A solid waste can be a hazardous waste, non-hazardous waste, or non-Resource Conservation and Recovery Act (RCRA) regulated waste. Types of solid waste typically generated at construction sites may include:

1.2.15.1 Debris

Debris is non-hazardous solid material generated during the construction, demolition, or renovation of a structure that exceeds 2.5-inch particle size that is: a manufactured object; plant or animal matter; or natural geologic material (for example, cobbles and boulders), broken or removed concrete, masonry, and rock asphalt paving; ceramics; roofing paper and shingles. Inert materials may be reinforced with or contain ferrous wire, rods, accessories and weldments. A mixture of debris and other material such as soil or sludge is also subject to regulation as debris if the mixture is comprised primarily of debris by volume, based on visual inspection.

1.2.15.2 Green Waste

Green waste is the vegetative matter from landscaping, land clearing and grubbing, including, but not limited to, grass, bushes, scrubs, small trees and saplings, tree stumps and plant roots. Marketable trees, grasses and plants that are indicated to remain, be re-located, or be

re-used are not included.

1.2.15.3 Material not regulated as solid waste

Material not regulated as solid waste is nuclear source or byproduct materials regulated under the Federal Atomic Energy Act of 1954 as amended; suspended or dissolved materials in domestic sewage effluent or irrigation return flows, or other regulated point source discharges; regulated air emissions; and fluids or wastes associated with natural gas or crude oil exploration or production.

1.2.15.4 Non-Hazardous Waste

Non-hazardous waste is waste that is excluded from, or does not meet, hazardous waste criteria in accordance with 40 CFR 263.

1.2.15.5 Recyclables

Recyclables are materials, equipment and assemblies such as doors, windows, door and window frames, plumbing fixtures, glazing and mirrors that are recovered and sold as recyclable, wiring, insulated/non-insulated copper wire cable, wire rope, and structural components. It also includes commercial-grade refrigeration equipment with Freon removed, household appliances where the basic material content is metal, clean polyethylene terephthalate bottles, cooking oil, used fuel oil, textiles, high-grade paper products and corrugated cardboard, stackable pallets in good condition, clean crating material, and clean rubber/vehicle tires. Metal meeting the definition of lead contaminated or lead based paint contaminated may not be included as recyclable if sold to a scrap metal company. Paint cans that meet the definition of empty containers in accordance with 40 CFR 261.7 may be included as recyclable if sold to a scrap metal company.

1.2.15.6 Surplus Soil

Surplus soil is existing soil that is in excess of what is required for this work, including aggregates intended, but not used, for on-site mixing of concrete, mortars, and paving. Contaminated soil meeting the definition of hazardous material or hazardous waste is not included and must be managed in accordance with paragraph HAZARDOUS MATERIAL MANAGEMENT.

1.2.15.7 Scrap Metal

This includes scrap and excess ferrous and non-ferrous metals such as reinforcing steel, structural shapes, pipe, and wire that are recovered or collected and disposed of as scrap. Scrap metal meeting the definition of hazardous material or hazardous waste is not included.

1.2.15.8 Wood

Wood is dimension and non-dimension lumber, plywood, chipboard, hardboard. Treated or painted wood that meets the definition of lead contaminated or lead based contaminated paint is not included. Treated wood includes, but is not limited to, lumber, utility poles, crossties, and other wood products with chemical treatment.

1.2.16 Surface Discharge

Surface discharge means discharge of water into drainage ditches, storm

sewers, creeks or "waters of the United States". Surface discharges are discrete, identifiable sources and require a permit from the governing agency. Comply with federal, state, and local laws and regulations.

1.2.17 Wastewater

Wastewater is the used water and solids from a community that flow to a treatment plant.

1.2.17.1 Stormwater

Stormwater is any precipitation in an urban or suburban area that does not evaporate or soak into the ground, but instead collects and flows into storm drains, rivers, and streams.

1.2.18 Waters of the United States

Waters of the United States means Federally jurisdictional waters, including wetlands, that are subject to regulation under Section 404 of the Clean Water Act or navigable waters, as defined under the Rivers and Harbors Act.

1.2.19 Wetlands

Wetlands are those areas that are inundated or saturated by surface or groundwater at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions.

1.2.20 Universal Waste

The universal waste regulations streamline collection requirements for certain hazardous wastes in the following categories: batteries, pesticides, mercury-containing equipment (for example, thermostats), and lamps (for example, fluorescent bulbs). The rule is designed to reduce hazardous waste in the municipal solid waste (MSW) stream by making it easier for universal waste handlers to collect these items and send them for recycling or proper disposal. These regulations can be found at 40 CFR 273.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Preconstruction Survey

Solid Waste Management Permit; G, RO

Regulatory Notifications; G

Environmental Protection Plan; G, RO

Stormwater Notice of Intent (for NPDES coverage under the general

permit for construction activities); G, RO

Dirt and Dust Control Plan; G, RO

Employee Training Records; G, RO

Environmental Manager Qualifications; G

SD-06 Test Reports

Laboratory Analysis

Inspection Reports

Solid Waste Management Report; G

SD-07 Certificates

Employee Training Records; G

Certificate of Competency

Erosion and Sediment Control Inspector Qualifications

SD-11 Closeout Submittals

Stormwater Pollution Prevention Plan Compliance Notebook, RO

Stormwater Notice of Termination (for NPDES coverage under the general permit for construction activities); G, RO

Waste Determination Documentation; G, RO

Disposal Documentation for Hazardous and Regulated Waste; G, RO

Assembled Employee Training Records; G

Solid Waste Management Permit; G

Solid Waste Management Report; G

Hazardous Waste/Debris Management; G

Regulatory Notifications; G

Sales Documentation; G

Contractor Certification

As-Built Topographic Survey

1.4 ENVIRONMENTAL PROTECTION REQUIREMENTS

Provide and maintain, during the life of the contract, environmental protection as defined. Plan for and provide environmental protective measures to control pollution that develops during construction practice. Plan for and provide environmental protective measures required to correct conditions that develop during the construction of permanent or temporary environmental features associated with the project. Protect the

environmental resources within the project boundaries and those affected outside the limits of permanent work during the entire duration of this Contract. Comply with federal, state, and local regulations pertaining to the environment, including water, air, solid waste, hazardous waste and substances, oily substances, and noise pollution.

See https://em.eglin.af.mil/emc/ for environmental compliance and pollution prevention requirements for Eglin AFB.

Tests and procedures assessing whether construction operations comply with Applicable Environmental Laws may be required. Analytical work must be performed by qualified laboratories; and where required by law, the laboratories must be certified.

1.4.1 Conformance with the Environmental Management System

Perform work under this contract consistent with the policy and objectives identified in the installation's Environmental Management System (EMS). Perform work in a manner that conforms to objectives and targets of the environmental programs and operational controls identified by the EMS. Support Government personnel when environmental compliance and EMS audits are conducted by escorting auditors at the Project site, answering questions, and providing proof of records being maintained. Provide monitoring and measurement information as necessary to address environmental performance relative to environmental, energy, and transportation management goals. In the event an EMS nonconformance or environmental noncompliance associated with the contracted services, tasks, or actions occurs, take corrective and preventative actions. In addition, employees must be aware of their roles and responsibilities under the installation EMS and of how these EMS roles and responsibilities affect work performed under the contract.

See https://em.eglin.af.mil/emc/ for environmental compliance and pollution prevention requirements for Eglin AFB.

Coordinate with the installation's EMS coordinator to identify training needs associated with environmental aspects and the EMS, and arrange training or take other action to meet these needs. Provide training documentation to the Contracting Officer. The Installation Environmental Office will retain associated environmental compliance records. Make EMS Awareness training completion certificates available to Government auditors during EMS audits and include the certificates in the Employee Training Records. See paragraph EMPLOYEE TRAINING RECORDS.

1.5 TEMPORARY ENVIRONMENTAL CONTROLS

The Contractor shall list all permits that are to be obtained by the Contractor in Specification Section 01 57 19, Temporary Environmental Controls. The permits shall be listed by title, permit number, permitting agency, effective date and expiration date.

1.6 QUALITY ASSURANCE

1.6.1 Preconstruction Survey and Protection of Features

This paragraph supplements the Contract Clause PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS. Prior to start of any onsite construction activities, perform a Preconstruction Survey of the project site with the Contracting Officer, and take

photographs showing existing environmental conditions in and adjacent to the site. Submit a report for the record. Include in the report a plan describing the features requiring protection under the provisions of the Contract Clauses, which are not specifically identified on the drawings as environmental features requiring protection along with the condition of trees, shrubs and grassed areas immediately adjacent to the site of work and adjacent to the Contractor's assigned storage area and access route(s), as applicable. The Contractor and the Contracting Officer will sign this survey report upon mutual agreement regarding its accuracy and completeness. Protect those environmental features included in the survey report and any indicated on the drawings, regardless of interference that their preservation may cause to the work under the Contract.

1.6.2 Regulatory Notifications

Provide regulatory notification requirements in accordance with federal, state and local regulations. In cases where the Government will also provide public notification (such as stormwater permitting), coordinate with the Contracting Officer. Submit copies of regulatory notifications to the Contracting Officer at least 30 days prior to commencement of work activities. Typically, regulatory notifications must be provided for the following (this listing is not all-inclusive): demolition, renovation, NPDES defined site work, construction, removal or use of a permitted air emissions source, and remediation of controlled substances (asbestos, hazardous waste, lead paint).

1.6.3 Environmental Brief

Attend an environmental brief to be included in the preconstruction meeting. Provide the following information: types, quantities, and use of hazardous materials that will be brought onto the installation; and types and quantities of wastes/wastewater that may be generated during the Contract. Discuss the results of the Preconstruction Survey at this time.

Prior to initiating any work on site, meet with the Contracting Officer and installation Environmental Office to discuss the proposed Environmental Protection Plan (EPP). Develop a mutual understanding relative to the details of environmental protection, including measures for protecting natural and cultural resources, required reports, required permits, permit requirements (such as mitigation measures), and other measures to be taken.

1.6.4 Environmental Manager

Appoint in writing an Environmental Manager for the project site. The Environmental Manager is directly responsible for coordinating contractor compliance with federal, state, local, and installation requirements. The Environmental Manager must ensure compliance with Hazardous Waste Program requirements (including hazardous waste handling, storage, manifesting, and disposal); implement the EPP; ensure environmental permits are obtained, maintained, and closed out; ensure compliance with Stormwater Program requirements; ensure compliance with Hazardous Materials (storage, handling, and reporting) requirements; and coordinate any remediation of regulated substances (lead, asbestos, PCB transformers). This can be a collateral position; however, the person in this position must be trained to adequately accomplish the following duties: ensure waste segregation and storage compatibility requirements are met; inspect and manage Satellite Accumulation areas; ensure only authorized personnel add wastes to containers; ensure Contractor personnel are trained in 40 CFR

requirements in accordance with their position requirements; coordinate removal of waste containers; and maintain the Environmental Records binder and required documentation, including environmental permits compliance and close-out. Submit Environmental Manager Qualifications to the Contracting Officer.

1.6.5 Employee Training Records

Prepare and maintain Employee Training Records throughout the term of the contract meeting applicable 40 CFR requirements. Provide Employee Training Records in the Environmental Records Binder. Ensure every employee completes a program of classroom instruction or on-the-job training that teaches them to perform their duties in a way that ensures compliance with federal, state and local regulatory requirements for RCRA Large Quantity Generator. Provide a Position Description for each employee, by subcontractor, based on the Davis-Bacon Wage Rate designation or other equivalent method, evaluating the employee's association with hazardous and regulated wastes. This Position Description will include training requirements as defined in 40 CFR 265 for a Large Quantity Generator facility. Submit these Assembled Employee Training Records to the Contracting Officer at the conclusion of the project, unless otherwise directed.

Train personnel to meet EPA and state requirements. Conduct environmental protection/pollution control meetings for personnel prior to commencing construction activities. Contact additional meetings for new personnel and when site conditions change. Include in the training and meeting agenda: methods of detecting and avoiding pollution; familiarization with statutory and contractual pollution standards; installation and care of devices, vegetative covers, and instruments required for monitoring purposes to ensure adequate and continuous environmental protection/pollution control; anticipated hazardous or toxic chemicals or wastes, and other regulated contaminants; recognition and protection of archaeological sites, artifacts, waters of the United States, and endangered species and their habitat that are known to be in the area. Provide copy of the Erosion and Sediment Control Inspector Qualifications as defined by EPA or Certification as required by state.

1.6.6 Non-Compliance Notifications

The Contracting Officer will notify the Contractor in writing of any observed noncompliance with federal, state or local environmental laws or regulations, permits, and other elements of the Contractor's EPP. After receipt of such notice, inform the Contracting Officer of the proposed corrective action and take such action when approved by the Contracting Officer. The Contracting Officer may issue an order stopping all or part of the work until satisfactory corrective action has been taken. No time extensions will be granted or equitable adjustments allowed for any such suspensions. This is in addition to any other actions the Contracting Officer may take under the contract, or in accordance with the Federal Acquisition Regulation or Federal Law. The Prime Contractor will have the sole responsibility to ensure all their subcontractors comply with all environmental protection requirements of this specification section.

1.7 ENVIRONMENTAL PROTECTION PLAN

The purpose of the EPP is to present an overview of known or potential environmental issues that must be considered and addressed during construction. Incorporate construction related objectives and targets

from the installation's EMS into the EPP. Include in the EPP measures for protecting natural and cultural resources, required reports, and other measures to be taken. Meet with the Contracting Officer or Contracting Officer Representative to discuss the EPP and develop a mutual understanding relative to the details for environmental protection including measures for protecting natural resources, required reports, and other measures to be taken. Submit the EPP within 15 days after Contract award and not less than 10 days before the preconstruction meeting. Revise the EPP throughout the project to include any reporting requirements, changes in site conditions, or contract modifications that change the project scope of work in a way that could have an environmental impact. No requirement in this section will relieve the Contractor of any applicable federal, state, and local environmental protection laws and regulations. During Construction, identify, implement, and submit for approval any additional requirements to be included in the EPP. Maintain the current version onsite.

The EPP includes, but is not limited to, the following elements:

1.7.1 General Overview and Purpose

1.7.1.1 Descriptions

A brief description of each specific plan required by environmental permit or elsewhere in this Contract such as stormwater pollution prevention plan, spill control plan, solid waste management plan, wastewater management plan, air pollution control plan, contaminant prevention plan, pesticide treatment plan, traffic control plan, Non-Hazardous Solid Waste Disposal Plan, and borrowing material plan.

1.7.1.2 Duties

The duties and level of authority assigned to the person(s) on the job site who oversee environmental compliance, such as who is responsible for adherence to the EPP, who is responsible for spill cleanup and training personnel on spill response procedures, who is responsible for manifesting hazardous waste to be removed from the site (if applicable), and who is responsible for training the Contractor's environmental protection personnel.

1.7.1.3 Procedures

A copy of any standard or project-specific operating procedures that will be used to effectively manage and protect the environment on the project site.

1.7.1.4 Communications

Communication and training procedures that will be used to convey environmental management requirements to Contractor employees and subcontractors.

1.7.1.5 Contact Information

Emergency contact information contact information (office phone number, cell phone number, and e-mail address).

1.7.2 General Site Information

1.7.2.1 Drawings

Drawings showing locations of proposed temporary excavations or embankments for haul roads, stream crossings, jurisdictional wetlands, material storage areas, structures, sanitary facilities, storm drains and conveyances, and stockpiles of excess soil.

1.7.2.2 Work Area

Work area plan showing the proposed activity in each portion of the area and identify the areas of limited use or nonuse. Include measures for marking the limits of use areas, including methods for protection of features to be preserved within authorized work areas and methods to control runoff and to contain materials on site, and a traffic control plan.

1.7.2.3 Documentation

A letter signed by an officer of the firm appointing the Environmental Manager and stating that person is responsible for managing and implementing the Environmental Program as described in this contract. Include in this letter the Environmental Manager's authority to direct the removal and replacement of non-conforming work.

1.7.3 Management of Natural Resources

a. Land resources.

b. Tree protection.

c. Replacement of damaged landscape features.

d. Temporary construction.

e. Stream crossings.

f. Fish and wildlife resources.

g. Wetland areas.

1.7.4 Protection of Historical and Archaeological Resources

a. Objectives.

b. Methods.

1.7.5 Stormwater Management and Control

a. Ground cover.

b. Erodible soils.

c. Temporary measures.

(1) Structural Practices.

(2) Temporary and permanent stabilization.

d. Effective selection, implementation and maintenance of Best Management Practices (BMPs).

1.7.6 Protection of the Environment from Waste Derived from Contractor Operations

Control and disposal of solid and sanitary waste. Control and disposal of hazardous waste.

This item consist of the management procedures for hazardous waste to be generated. The elements of those procedures will coincide with the Installation Hazardous Waste Management Plan. The Contracting Officer will provide a copy of the Installation Hazardous Waste Management Plan. As a minimum, include the following:

a. List of the types of hazardous wastes expected to be generated.

b. Procedures to ensure a written waste determination is made for appropriate wastes that are to be generated.

c. Sampling/analysis plan, including laboratory method(s) that will be used for waste determinations and copies of relevant laboratory certifications.

d. Methods and proposed locations for hazardous waste accumulation/storage (that is, in tanks or containers).

e. Management procedures for storage, labeling, transportation, and disposal of waste (treatment of waste is not allowed unless specifically noted). The contractor shall provide applicable landfill tipping fee(s)and the projected cost of disposing of all project waste in the landfill(s).

f. Management procedures and regulatory documentation ensuring disposal of hazardous waste complies with Land Disposal Restrictions (40 CFR 268).

g. Management procedures for recyclable hazardous materials such as lead-acid batteries, used oil, and similar.

h. Used oil management procedures in accordance with 40 CFR 279; Hazardous waste minimization procedures.

i. Plans for the disposal of hazardous waste by permitted facilities; and Procedures to be employed to ensure required employee training records are maintained.

1.7.7 Prevention of Releases to the Environment

Procedures to prevent releases to the environment,

Notifications in the event of a release to the environment,

1.7.8 Regulatory Notification and Permits

List what notifications and permit applications must be made. Some permits require up to 180 days to obtain. Demonstrate that those permits have been obtained or applied for by including copies of applicable

environmental permits. The EPP will not be approved until the permits have been obtained.

1.7.9 Clean Air Act Compliance

1.7.9.1 Haul Route

Submit truck and material haul routes along with a Dirt and Dust Control Plan for controlling dirt, debris, and dust on Installation roadways. As a minimum, identify in the plan the subcontractor and equipment for cleaning along the haul route and measures to reduce dirt, dust, and debris from roadways.

1.7.9.2 Pollution Generating Equipment

Identify air pollution generating equipment or processes that may require federal, state, or local permits under the Clean Air Act. Determine requirements based on any current installation permits and the impacts of the project. Provide a list of all fixed or mobile equipment, machinery or operations that could generate air emissions during the project to the Installation Environmental Office (Air Program Manager).

If emergency generators, boilers, or other sources of air pollutants will be associated with this facility, coordinate with the 96 CEG/CEIEC Air Quality Program Manager Mr. Harry Fortenberry, 882-7677 - a Title V permit revision may be required. Complete the appropriate registration form(s) at the following website, https://em.eglin.af.mil/emc/emce/emcea/aqpweb/inventory_registration_forms.asp and return completed form(s) to Mr. Fortenberry BEFORE source installation. Ensure generator engines are certified to meet 40 CFR Part 60 Subpart IIII - Standards of Performance for Stationary Compression Ignition Internal Combustion Engines or CFR Part 60 Subpart JJJJ - Standards of Performance for Stationary Spark Ignition Internal Combustion Engines. Comply with Eglin Title V permit (Appendix TV-34) Refrigerant Requirements. Any facility having refrigeration equipment, including air conditioning equipment, which uses a Class I or II substance (listed at 40 CFR 82, Subpart A, Appendices A and B), and any facility which maintains, services, or repairs motor vehicles using a Class I or Class II substance as refrigerant must comply with all requirements of 40 CFR 82, Subparts B and F, and with Chapter 62-281, F.A.C. Any refrigerant recycle/recovery equipment must be registered with the Air Quality Program manager. Contact Harry Fortenberry, 882-7677 if you have further questions.

1.7.9.3 Stationary Internal Combustion Engines

Identify portable and stationary internal combustion engines that will be supplied, used or serviced. Comply with 40 CFR 60 Subpart IIII, 40 CFR 60 Subpart JJJJ, 40 CFR 63 Subpart ZZZZ, and local regulations as applicable. At minimum, include the make, model, serial number, manufacture date, size (engine brake horsepower), and EPA emission certification status of each engine. Maintain applicable records and log hours of operation and fuel use. Logs must include reasons for operation and delineate between emergency and non-emergency operation.

1.7.9.4 Refrigerants

Identify management practices to ensure that heating, ventilation, and air conditioning (HVAC) work involving refrigerants complies with 40 CFR 82 requirements. Technicians must be certified, maintain copies of

certification on site, use certified equipment and log work that requires the addition or removal of refrigerant. Any refrigerant reclaimed is the property of the Government, coordinate with the Installation Environmental Office to determine the appropriate turn in location.

1.7.9.5 Air Pollution-engineering Processes

Identify planned air pollution-generating processes and management control measures (including, but not limited to, spray painting, abrasive blasting, demolition, material handling, fugitive dust, and fugitive emissions). Log hours of operations and track quantities of materials used.

1.7.9.6 Compliant Materials

Provide the Government a list of and SDSs for all hazardous materials proposed for use on site. Materials must be compliant with all Clean Air Act regulations for emissions including solvent and volatile organic compound contents, and applicable National Emission Standards for Hazardous Air Pollutants requirements. The Government may alter or limit use of specific materials as needed to meet installation permit requirements for emissions.

1.8 LICENSES AND PERMITS

Obtain licenses and permits required for the construction of the project and in accordance with FAR 52.236-7. Notify the Government of all general use permitted equipment the Contractor plans to use on site.

1.9 ENVIRONMENTAL RECORDS BINDER

Maintain on-site a separate three-ring Environmental Records Binder and submit at the completion of the project. Make separate parts within the binder that correspond to each submittal listed under paragraph CLOSEOUT SUBMITTALS in this section.

1.10 SOLID WASTE MANAGEMENT PERMIT

Provide the Contracting Officer with written notification of the quantity of anticipated solid waste or debris that is anticipated or estimated to be generated by construction. Include in the report the locations where various types of waste will be disposed or recycled. Include letters of acceptance from the receiving location or as applicable; submit one copy of the receiving location state and local Solid Waste Management Permit or license showing such agency's approval of the disposal plan before transporting wastes off Government property.

1.10.1 Solid Waste Management Report

Monthly, submit a solid waste disposal report to the Contracting Officer. For each waste, the report will state the classification (using the definitions provided in this section), amount, location, and name of the business receiving the solid waste.

1.11 FACILITY HAZARDOUS WASTE GENERATOR STATUS

Eglin AFB is designated as a Large Quantity Generator. Meet the regulatory requirements of this generator designation for any work conducted within the boundaries of this Installation. Comply with

provisions of federal, state, and local regulatory requirements applicable to this generator status regarding training and storage, handling, and disposal of construction derived wastes.

PART 2 PRODUCTS

Not Used.

PART 3 EXECUTION

3.1 ENVIRONMENTAL PERMITS AND COMMITMENTS

The Contractor shall ensure that required environmental permits are obtained prior to start of construction and/or installing or operating any new or modified equipment or processes or disturbing any land area. The contractor shall coordinate with the Contracting Officer and Eglin AFB 96 CEG/CEIEA to determine when permits are required. Where environmental permits are thought to be required, the Contractor shall coordinate with the Contracting Officer and Eglin AFB 96 CEG/CEIEA , prepare any required technical documentation for the permit application, and submit to the Contracting Officer and Eglin AFB 96 CEG/CEIEA . Eglin AFB 96 CEG/CEIEA will sign and forward applications to the appropriate regulatory authority. The Contractor shall be responsible for operating within permit limits and abiding by all permit conditions. The Contracting Officer and Eglin AFB 96 CEG/CEIEA shall be notified immediately of any exceedances of permit limits or violation of permit conditions. The Contractor shall immediately notify the Contracting Officer and Eglin AFB 96 CEG/CEIEA of any unforeseen environmental conditions, which may conflict with approved permits. Any certifications required by permits shall be the responsibility of the Contractor. Copies of all permits and certifications shall be submitted to the Contracting Officer and Eglin AFB 96 CEG/CEIEA .

The Contractor shall be responsible for obtaining and complying with all environmental permits and commitments required by Federal, State, Regional, and local environmental laws and regulations.

Assurance that subcontractors comply with all environmental protection requirements of this section will be the sole responsibility of the prime Contractor.

3.2 PROTECTION OF NATURAL RESOURCES

Minimize interference with, disturbance to, and damage to fish, wildlife, and plants, including their habitats. Prior to the commencement of activities, consult with the Installation Environmental Office, regarding rare species or sensitive habitats that need to be protected. The protection of rare, threatened, and endangered animal and plant species identified, including their habitats, is the Contractor's responsibility.

Preserve the natural resources within the project boundaries and outside the limits of permanent work. Restore to an equivalent or improved condition upon completion of work that is consistent with the requirements of the Installation Environmental Office or as otherwise specified. Confine construction activities to within the limits of the work indicated or specified.

In accordance with Section 7 of the Endangered Species Act (ESA), a consultation with the United States Fish and Wildlife Service (USFWS) has

been completed. Their concurrence with our Biological Assessment (BA) was received 09 Dec 2013. This consultation describes guidelines under which the project must be completed to minimize potential impacts to threatened and endangered species. A copy of this document is attached. In accordance with this document, the following requirements must be followed: (A) Gopher Tortoise Survey is required. Contact Eglin Natural Resources (Jackson Guard) to arrange for the survey to take place within 30 days of ground disturbing activities. If tortoise burrows are found to conflict with the proposed project site, and burrows cannot be avoided by at least 25 ft, the tortoise(s) must be relocated. POC: Rodney Felix, 96 CEG/CEIEA, 883-1153 or Wayne Pittman, 96 CEG/CEIEA, 883-6975. (B) If any trees are to be removed, a red-cockaded woodpecker (RCW) survey is required. This survey will determine suitability of habitat and location(s) of possible cavity trees in the area. Contact Natural Resources (Jackson Guard) at least one month prior to tree removal to arrange the survey. POC: Kathy Gault, 96 CEG/CEIEA, 883-1145. (C) Proponent will also be provided with Eastern Indigo Snake Signs and personnel would be given instructions not to harass, injure, harm, or kill this species. Should an indigo snake be sighted, personnel would be directed to cease any activities and allow the eastern indigo snake sufficient time to move away from the site on its own before resuming such activities. Personnel would contact Eglin Natural Resources immediately if an indigo snake is sighted. POC: Jeremy Preston, 96 CEG/CEIEA, 883-1155. (D) If any trees are to be removed as a result of this project, contact Al Sutsko, 96 CEG/CEIEA, 883-1126 or Ryan Campbell, CEG/CEIEA, 883-1169, prior to tree removal as trees may be merchantable.

3.2.1 Flow Ways

Do not alter water flows or otherwise significantly disturb the native habitat adjacent to the project and critical to the survival of fish and wildlife, except as specified and permitted.

3.2.2 Vegetation

Except in areas to be cleared, do not remove, cut, deface, injure, or destroy trees or shrubs without the Contracting Officer's permission. Do not fasten or attach ropes, cables, or guys to existing nearby trees for anchorages unless authorized by the Contracting Officer. Where such use of attached ropes, cables, or guys is authorized, the Contractor is responsible for any resultant damage.

Protect existing trees that are to remain to ensure they are not injured, bruised, defaced, or otherwise damaged by construction operations. Remove displaced rocks from uncleared areas. Coordinate with the Contracting Officer and Installation Environmental Office to determine appropriate action for trees and other landscape features scarred or damaged by equipment operations.

3.2.3 Streams

Stream crossings must allow movement of materials or equipment without violating water pollution control standards of the federal, state, and local governments. Construction of stream crossing structures must be in compliance with any required permits including, but not limited to, Clean Water Act Section 404, and Section 401 Water Quality.

The Contracting Officer's approval and appropriate permits are required before any equipment will be permitted to ford live streams. In areas where frequent crossings are required, install temporary culverts or

bridges. Obtain Contracting Officer's approval prior to installation. Remove temporary culverts or bridges upon completion of work, and repair the area to its original condition unless otherwise required by the Contracting Officer.

3.3 STORMWATER

Do not discharge stormwater from construction sites to the sanitary sewer. Discharge of hazardous substances will not be permitted under any circumstances. Construction site runoff will be prevented from entering any storm drain by the use of best management practices from the Florida Stormwater Erosion and Sedimentation Control Inspector's Manual.Prior to any project that disturbs greater than one acre, the contractor must complete a Notice of Intent with FDEP and have a Stormwater Pollution Prevention Plan approved by the Contracting Officer and Eglin AFB 96 CEG/CEIEA. A notice of termination must also be filed at the conclusion of the project.

3.3.1 Construction General Permit

Comply with State of Florida Department of Environmental Protection Generic Permit for Stormwater Discharge from Large and Small Construction Activities. Under the terms and conditions of the permit, install, inspect, maintain BMPs, prepare stormwater erosion and sediment control inspection reports, and submit SWPPP inspection reports. Maintain construction operations and management in compliance with the terms and conditions of the general permit for stormwater discharges from construction activities.

3.3.1.1 Stormwater Pollution Prevention Plan

Submit a project-specific Stormwater Pollution Prevention Plan (SWPPP) to the Contracting Officer for approval, prior to the commencement of work. The SWPPP must meet the requirements of 40 CFR 122.26 and the EPA General Permit and the State of Florida General Permit for stormwater discharges from construction sites.

Include the following:

a. Comply with terms of the state general permit for stormwater discharges from large and small construction activities. Prepare SWPPP in accordance with state requirements. Use state guide Developing your Stormwater Pollution Prevention Plan located at http://water.epa.gov/polwaste/npdes/stormwater/Stormwater-Pollution-Prevention-Plans-for-Construction-Activities.cfm to prepare the SWPPP.

b. Select applicable BMPs from EPA Fact Sheets located at http://water.epa.gov/polwaste/npdes/swbmp/Construction-Site-StormWater-Run-Off-Control.cfm or in accordance with applicable state or local requirements.

c. Include a completed copy of the Notice of Intent, BMP Inspection Report Template, and Stormwater Notice of Termination, except for the effective date.

3.3.1.2 Stormwater Notice of Intent for Construction Activities

Prepare and submit a Stormwater Notice of Intent for NPDES coverage under the general permit for construction activities to the Contracting Officer

for review and approval. Create a Stormwater Pollution Prevention Plan (SWPPP) for the project meeting the Florida General Permit for Stormwater Discharge from Large and Small Construction Activities for stormwater discharges from construction sites.

Prepare and submit a Notice of Intent as a co-permittee to the Contracting Officer, for review and approval.

Submit the approved NOI and appropriate permit fees onto the appropriate federal or state agency for approval. No land disturbing activities may commence without permit coverage. Maintain an approved copy of the SWPPP at the onsite construction office, and continually update as regulations require, reflecting current site conditions.

3.3.1.3 Inspection Reports

Submit "Inspection Reports" to the Contracting Officer in accordance with the State of Florida Construction General Permit.

3.3.1.4 Stormwater Pollution Prevention Plan Compliance Notebook

Create and maintain a three ring binder of documents that demonstrate compliance with the Construction General Permit. Include a copy of the permit Notice of Intent, proof of permit fee payment, SWPPP and SWPPP update amendments, inspection reports and related corrective action records, copies of correspondence with the State Permitting Agency, and a copy of the permit Notice of Termination in the binder. At project completion, the notebook becomes property of the Government. Provide the compliance notebook to the Contracting Officer.

3.3.1.5 Stormwater Notice of Termination for Construction Activities

Submit a Notice of Termination to the Contracting Officer for approval once construction is complete and final stabilization has been achieved on all portions of the site for which the permittee is responsible. Once approved, submit the Notice of Termination to the appropriate state or federal agency.

3.3.2 Erosion and Sediment Control Measures

Provide erosion and sediment control measures in accordance with state and local laws and regulations. Preserve vegetation to the maximum extent practicable.

Erosion control inspection reports may be compiled as part of a stormwater pollution prevention plan inspection reports.

3.3.2.1 Erosion Control

Prevent erosion by mulching, Compost Blankets, Geotextiles, temporary slope drains,and/or silt fence. Stabilize slopes by sodding, seeding, or such combination of these methods necessary for effective erosion control. Use of hay bales is prohibited.

3.3.2.2 Sediment Control Practices

Implement sediment control practices to divert flows from exposed soils, temporarily store flows, or otherwise limit runoff and the discharge of pollutants from exposed areas of the site. Implement sediment control

practices prior to soil disturbance and prior to creating areas with concentrated flow, during the construction process to minimize erosion and sediment laden runoff. Include the following devices: silt fence, temporary diversion dikes, and/or storm drain inlet protection.

3.3.3 Work Area Limits

Mark the areas that need not be disturbed under this Contract prior to commencing construction activities. Mark or fence isolated areas within the general work area that are not to be disturbed. Protect monuments and markers before construction operations commence. Where construction operations are to be conducted during darkness, any markers must be visible in the dark. Personnel must be knowledgeable of the purpose for marking and protecting particular objects.

3.3.4 Contractor Facilities and Work Areas

Place field offices, staging areas, stockpile storage, and temporary buildings in areas designated on the drawings or as directed by the Contracting Officer. Move or relocate the Contractor facilities only when approved by the Government. Provide erosion and sediment controls for onsite borrow and spoil areas to prevent sediment from entering nearby waters. Control temporary excavation and embankments for plant or work areas to protect adjacent areas.

3.3.5 Environmental Resource Permit

The Contractor shall comply with all Environmental Resource Permit requirements in accordance with FL Admin Code 62-330.

3.4 SURFACE AND GROUNDWATER

3.4.1 Dewatering

Construction operations for dewatering must be constantly controlled to maintain compliance with existing state water quality standards and designated uses of the surface water body. Comply with the State of Florida water quality standards and anti-degradation provisions. Do not discharge excavation ground water to the sanitary sewer, storm drains, or to surface waters without prior specific authorization in writing from the Installation Environmental Office. Discharge of hazardous substances will not be permitted under any circumstances. Use sediment control BMPs to prevent construction site runoff from directly entering any storm drain or surface waters.

If the construction dewatering is noted or suspected of being contaminated, it may only be released to the storm drain system if the discharge is specifically permitted. Obtain authorization for any contaminated groundwater release in advance from the Installation Environmental Officer and the federal or state authority, as applicable. Discharge of hazardous substances will not be permitted under any circumstances.

3.4.2 Waters of the United States

Do not enter, disturb, destroy, or allow discharge of contaminants into waters of the United States.

3.5 PROTECTION OF CULTURAL RESOURCES

3.5.1 Archaeological Resources

If, during excavation or other construction activities, any previously unidentified or unanticipated historical, archaeological, and cultural resources are discovered or found, activities that may damage or alter such resources will be suspended. Resources covered by this paragraph include, but are not limited to: any human skeletal remains or burials; artifacts; shell, midden, bone, charcoal, or other deposits; rock or coral alignments, pavings, wall, or other constructed features; and any indication of agricultural or other human activities. Upon such discovery or find, immediately notify the Contracting Officer so that the appropriate authorities may be notified and a determination made as to their significance and what, if any, special disposition of the finds should be made. Cease all activities that may result in impact to or the destruction of these resources. Secure the area and prevent employees or other persons from trespassing on, removing, or otherwise disturbing such resources. The Government retains ownership and control over archaeological resources.

3.6 AIR RESOURCES

Equipment operation, activities, or processes will be in accordance with 40 CFR 64 and state air emission and performance laws and standards.

3.6.1 Preconstruction Air Permits

Notify the Air Program Manager, through the Contracting Officer, at least 6 months prior to bringing equipment, assembled or unassembled, onto the Installation, so that air permits can be secured. Necessary permitting time must be considered in regard to construction activities. Clean Air Act (CAA) permits must be obtained prior to bringing equipment, assembled or unassembled, onto the Installation.

Confirm that these permits have been obtained.

3.6.2 Oil or Dual-fuel Boilers and Furnaces

Provide product data and details for new, replacement, or relocated fuel fired boilers, heaters, or furnaces to the Installation Environmental Office (Air Program Manager) through the Contracting Officer. Data to be reported include: equipment purpose (water heater, building heat, process), manufacturer, model number, serial number, fuel type (oil type, gas type) size (MMBTU heat input). Provide in accordance with paragraph PRECONSTRUCTION AIR PERMITS.

3.6.3 Burning

Burning is prohibited on the Government premises.

3.6.4 Class I and II ODS Prohibition

Class I and II ODS are Government property and must be returned to the Government for appropriate management. Coordinate with the Installation Environmental Office to determine the appropriate location for turn in of all reclaimed refrigerant.

3.6.5 Accidental Venting of Refrigerant

Accidental venting of a refrigerant is a release and must be reported immediately to the Contracting Officer.

3.6.6 EPA Certification Requirements

Heating and air conditioning technicians must be certified through an EPA-approved program. Maintain copies of certifications at the employees' places of business; technicians must carry certification wallet cards, as provided by environmental law.

3.6.7 Dust Control

Keep dust down at all times, including during nonworking periods. Sprinkle or treat, with dust suppressants, the soil at the site, haul roads, and other areas disturbed by operations. Dry power brooming will not be permitted. Instead, use vacuuming, wet mopping, wet sweeping, or wet power brooming. Air blowing will be permitted only for cleaning nonparticulate debris such as steel reinforcing bars. Only wet cutting will be permitted for cutting concrete blocks, concrete, and bituminous concrete. Do not unnecessarily shake bags of cement, concrete mortar, or plaster.

3.6.7.1 Particulates

Dust particles, aerosols and gaseous by-products from construction activities, and processing and preparation of materials (such as from asphaltic batch plants) must be controlled at all times, including weekends, holidays, and hours when work is not in progress. Maintain excavations, stockpiles, haul roads, permanent and temporary access roads, plant sites, spoil areas, borrow areas, and other work areas within or outside the project boundaries free from particulates that would exceed 40 CFR 50, state, and local air pollution standards or that would cause a hazard or a nuisance. Sprinkling, chemical treatment of an approved type, baghouse, scrubbers, electrostatic precipitators, or other methods will be permitted to control particulates in the work area. Sprinkling, to be efficient, must be repeated to keep the disturbed area damp. Provide sufficient, competent equipment available to accomplish these tasks. Perform particulate control as the work proceeds and whenever a particulate nuisance or hazard occurs. Comply with state and local visibility regulations.

3.6.7.2 Abrasive Blasting

Blasting operations cannot be performed without prior approval of the Installation Air Program Manager. The use of silica sand is prohibited in sandblasting.

Provide tarpaulin drop cloths and windscreens to enclose abrasive blasting operations to confine and collect dust, abrasive agent, paint chips, and other debris. Perform work involving removal of hazardous material in accordance with 29 CFR 1910.

3.6.8 Odors

Control odors from construction activities. The odors must be in compliance with state regulations and local ordinances and may not constitute a health hazard.

3.7 WASTE MINIMIZATION

Minimize the use of hazardous materials and the generation of waste. Include procedures for pollution prevention/ hazardous waste minimization in the Hazardous Waste Management Section of the EPP. Obtain a copy of the installation's Pollution Prevention/Hazardous Waste Minimization Plan for reference material when preparing this part of the EPP. If no written plan exists, obtain information by contacting the Contracting Officer. Describe the anticipated types of the hazardous materials to be used in the construction when requesting information.

3.7.1 Salvage, Reuse and Recycle

Identify anticipated materials and waste for salvage, reuse, and recycling. Describe actions to promote material reuse, resale or recycling. To the extent practicable, all scrap metal must be sent for reuse or recycling and will not be disposed of in a landfill.

Include the name, physical address, and telephone number of the hauler, if transported by a franchised solid waste hauler. Include the destination and, unless exempted, provide a copy of the state or local permit (cover) or license for recycling.

3.7.2 Nonhazardous Solid Waste Diversion Report

Maintain an inventory of nonhazardous solid waste diversion and disposal of construction and demolition debris. Submit a report to the Contracting Officer on the first working day after each fiscal year quarter, starting the first quarter that nonhazardous solid waste has been generated. Include the following in the report:

Construction and Demolition (C&D) Debris Disposed	cubic yards or tons as appropriate
C&D Debris Recycled	cubic yards or tons as appropriate
Total C&D Debris Generated	cubic yards or tons as appropriate
Waste Sent to Waste-To-Energy Incineration Plant (This amount should not be included in the recycled amount)	cubic yards or tons as appropriate

3.8 WASTE MANAGEMENT AND DISPOSAL

3.8.1 Waste Determination Documentation

Complete a Waste Determination form (provided at the pre-construction conference) for Contractor-derived wastes to be generated. All potentially hazardous solid waste streams that are not subject to a specific exclusion or exemption from the hazardous waste regulations (e.g., scrap metal, domestic sewage) or subject to special rules, (lead-acid batteries and precious metals) must be characterized in accordance with

the requirements of 40 CFR 261 or corresponding applicable state or local regulations. Base waste determination on user knowledge of the processes and materials used, and analytical data when necessary. Consult with the Installation environmental staff for guidance on specific requirements. Attach support documentation to the Waste Determination form. As a minimum, provide a Waste Determination form for the following waste (this listing is not inclusive): oil- and latex -based painting and caulking products, solvents, adhesives, aerosols, petroleum products, and containers of the original materials.

3.8.1.1 Sampling and Analysis of Waste

3.8.1.1.1 Waste Sampling

Sample waste in accordance with EPA SW-846. Clearly mark each sampled drum or container with the Contractor's identification number, and cross reference to the chemical analysis performed.

3.8.1.1.2 Laboratory Analysis

Follow the analytical procedure and methods in accordance with the 40 CFR 261. Provide analytical results and reports performed to the Contracting Officer.

3.8.1.1.3 Analysis Type

Identify hazardous waste by analyzing for the following characteristics: ignitability, corrosivity, reactivity, or toxicity based on TCLP results.

3.8.2 Solid Waste Management

3.8.2.1 Solid Waste Management Report

Provide copies of the waste handling facilities' weight tickets, receipts, bills of sale, and other sales documentation. In lieu of sales documentation, a statement indicating the disposal location for the solid waste that is signed by an employee authorized to legally obligate or bind the firm may be submitted. The Contractor certification must include the receiver's tax identification number and business, EPA or state registration number, along with the receiver's delivery and business addresses and telephone numbers. For each solid waste retained for the Contractor's own use, submit the information previously described in this paragraph on the solid waste disposal report. Prices paid or received do not have to be reported to the Contracting Officer unless required by other provisions or specifications of this Contract or public law.

3.8.2.2 Control and Management of Solid Wastes

Pick up solid wastes, and place in covered containers that are regularly emptied. Do not prepare or cook food on the project site. Prevent contamination of the site or other areas when handling and disposing of wastes. At project completion, leave the areas clean. Employ segregation measures so that no hazardous or toxic waste will become co-mingled with non-hazardous solid waste. Transport solid waste off Government property and dispose of it in compliance with 40 CFR 260, state, and local requirements for solid waste disposal. A Subtitle D RCRA permitted landfill is the minimum acceptable offsite solid waste disposal option. Verify that the selected transporters and disposal facilities have the necessary permits and licenses to operate. Segregate and separate treated

wood components disposed at a lined landfill approved to accept this waste in accordance with local and state regulations. Solid waste disposal offsite must comply with most stringent local, state, and federal requirements, including 40 CFR 241, 40 CFR 243, and 40 CFR 258.

Manage hazardous material used in construction, including but not limited to, aerosol cans, waste paint, cleaning solvents, contaminated brushes, and used rags, in accordance with 49 CFR 173.

3.8.3 Control and Management of Hazardous Waste

Do not dispose of hazardous waste on Government property. Do not discharge any waste to a sanitary sewer, storm drain, or to surface waters or conduct waste treatment or disposal on Government property without written approval of the Contracting Officer.

3.8.3.1 Hazardous Waste/Debris Management

Identify construction activities that will generate hazardous waste or debris. Provide a documented waste determination for resultant waste streams. Identify, label, handle, store, and dispose of hazardous waste or debris in accordance with federal, state, and local regulations, including 40 CFR 261, 40 CFR 262, 40 CFR 263, 40 CFR 264, 40 CFR 265, 40 CFR 266, and 40 CFR 268.

Manage hazardous waste in accordance with the approved Hazardous Waste Management Section of the EPP. Store hazardous wastes in approved containers in accordance with 49 CFR 173 and 49 CFR 178. Hazardous waste generated within the confines of Government facilities is identified as being generated by the Government. Prior to removal of any hazardous waste from Government property, hazardous waste manifests must be signed by personnel from the Installation Environmental Office. Do not bring hazardous waste onto Government property. Provide the Contracting Officer with a copy of waste determination documentation for any solid waste streams that have any potential to be hazardous waste or contain any chemical constituents listed in 40 CFR 372-SUBPART D.

3.8.3.2 Waste Storage/Satellite Accumulation/90 Day Storage Areas

Accumulate hazardous waste at satellite accumulation points and in compliance with 40 CFR 262.34 and applicable state or local regulations. Individual waste streams will be limited to 55 gallons of accumulation (or 1 quart for acutely hazardous wastes). If the Contractor expects to generate hazardous waste at a rate and quantity that makes satellite accumulation impractical, the Contractor may request a temporary 90 day accumulation point be established. Submit a request in writing to the Contracting Officer and provide the following information (Attach Site Plan to the Request):

Contract Number	
Contractor	
Haz/Waste or Regulated Waste POC	
Phone Number	
Type of Waste	

Contract Number	
Source of Waste	
Emergency POC	
Phone Number	
Location of the Site	

Attach a Waste Determination form for the expected waste streams. Allow 10 working days for processing this request. Additional compliance requirements (e.g., training and contingency planning) that may be required are the responsibility of the Contractor. Barricade the designated area where waste is being stored and post a sign identifying as follows:

"DANGER - UNAUTHORIZED PERSONNEL KEEP OUT"

3.8.3.3 Hazardous Waste Disposal

3.8.3.3.1 Responsibilities for Contractor's Disposal

Provide hazardous waste manifest to the Installations Environmental Office for review, approval, and signature prior to shipping waste off Government property.

3.8.3.3.1.1 Services

Provide service necessary for the final treatment or disposal of the hazardous material or waste in accordance with 40 CFR 260, local, and state, laws and regulations, and the terms and conditions of the Contract within 60 days after the materials have been generated. These services include necessary personnel, labor, transportation, packaging, detailed analysis (if required for disposal or transportation, include manifesting or complete waste profile sheets, equipment, and compile documentation).

3.8.3.3.1.2 Samples

Obtain a representative sample of the material generated for each job done to provide waste stream determination.

3.8.3.3.1.3 Analysis

Analyze each sample taken and provide analytical results to the Contracting Officer. See paragraph WASTE DETERMINATION DOCUMENTATION.

3.8.3.3.1.4 Labeling

Determine the Department of Transportation's (DOT's) proper shipping names for waste (each container requiring disposal) and demonstrate to the Contracting Officer how this determination is developed and supported by the sampling and analysis requirements contained herein. Label all containers of hazardous waste with the words "Hazardous Waste" or other words to describe the contents of the container in accordance with 40 CFR 262.31 and applicable state or local regulations.

3.8.3.3.2 Contractor Disposal Turn-In Requirements

Hazardous waste generated must be disposed of in accordance with the following conditions to meet installation requirements:

a. Drums must be compatible with waste contents and drums must meet DOT requirements for 49 CFR 173 for transportation of materials.

b. Band drums to wooden pallets.

c. No more than three 55 gallon drums or two 85 gallon over packs are to be banded to a pallet.

d. Band using 1-1/4 inch minimum band on upper third of drum.

e. Provide label in accordance with 49 CFR 172.101.

f. Leave 3 to 5 inches of empty space above volume of material.

3.8.3.4 Universal Waste Management

Manage the following categories of universal waste in accordance with federal, state, and local requirements and installation instructions:

a. Batteries as described in 40 CFR 273.2.

b. Lamps as described in 40 CFR 273.5.

c. Mercury-containing equipment as described in 40 CFR 273.4.

d. Pesticides as described in 40 CFR 273.3 and Armed Forces Management Board (AFPMD) standard pesticides list.

Mercury is prohibited in the construction of this facility, unless specified otherwise, and with the exception of mercury vapor lamps and fluorescent lamps. Dumping of mercury-containing materials and devices such as mercury vapor lamps, fluorescent lamps, and mercury switches, in rubbish containers is prohibited. Remove without breaking, pack to prevent breakage, and transport out of the activity in an unbroken condition for disposal as directed.

3.8.3.5 Electronics End-of-Life Management

Recycle or dispose of electronics waste, including, but not limited to, used electronic devices such computers, monitors, hard-copy devices, televisions, mobile devices, in accordance with 40 CFR 260-262, state, and local requirements, and installation instructions.

3.8.3.6 Disposal Documentation for Hazardous and Regulated Waste

Contact the Contracting Officer for the facility RCRA identification number that is to be used on each manifest.

3.8.4 Releases/Spills of Oil and Hazardous Substances

3.8.4.1 Response and Notifications

Exercise due diligence to prevent, contain, and respond to spills of hazardous material, hazardous substances, hazardous waste, sewage,

regulated gas, petroleum, lubrication oil, and other substances regulated in accordance with 40 CFR 300. Maintain spill cleanup equipment and materials at the work site. In the event of a spill, take prompt, effective action to stop, contain, curtail, or otherwise limit the amount, duration, and severity of the spill/release. In the event of any releases of oil and hazardous substances, chemicals, or gases; immediately (within 15 minutes) notify the Installation Fire Department, the Installation Command Duty Officer, the Installation Environmental Office, the Contracting Officer and the state or local authority.

Submit verbal and written notifications as required by the federal (40 CFR 300.125 and 40 CFR 355), state, local regulations and instructions. Provide copies of the written notification and documentation that a verbal notification was made within 20 days. Spill response must be in accordance with 40 CFR 300 and applicable state and local regulations. Contain and clean up these spills without cost to the Government.

3.8.4.2 Clean Up

Clean up hazardous and non-hazardous waste spills. Reimburse the Government for costs incurred including sample analysis materials, clothing, equipment, and labor if the Government will initiate its own spill cleanup procedures, for Contractor- responsible spills, when: Spill cleanup procedures have not begun within one hour of spill discovery/occurrence; or, in the Government's judgment, spill cleanup is inadequate and the spill remains a threat to human health or the environment.

3.8.5 Mercury Materials

Immediately report to the Environmental Office and the Contracting Officer instances of breakage or mercury spillage. Clean mercury spill area to the satisfaction of the Contracting Officer.

Do not recycle a mercury spill cleanup; manage it as a hazardous waste for disposal.

3.8.6 Wastewater

3.8.6.1 Disposal of wastewater must be as specified below.

3.8.6.1.1 Treatment

Do not allow wastewater from construction activities, such as onsite material processing, concrete curing, foundation and concrete clean-up, water used in concrete trucks, and forms to enter water ways or to be discharged prior to being treated to remove pollutants. Dispose of the construction- related waste water off-Government property in accordance with 40 CFR 403, state, regional, and local laws and regulations.

3.8.6.1.2 Surface Discharge

For discharge of ground water, obtain a state or federal permit specific for pumping and discharging ground water prior to surface discharging. Surface discharge in accordance with the requirements of the NPDES or state STORMWATER DISCHARGES FROM CONSTRUCTION SITES permit.

3.8.6.1.3 Land Application

Water generated from the flushing of lines after disinfection or disinfection in conjunction with hydrostatic testing must be discharged into the sanitary sewer with prior approval and notification to the Wastewater Treatment Plant's Operator.

3.9 HAZARDOUS MATERIAL MANAGEMENT

Address procedures and proper handling of hazardous materials, including the appropriate transportation requirements. Do not bring hazardous material onto Government property that does not directly relate to requirements for the performance of this contract. Submit an SDS and estimated quantities to be used for each hazardous material to the Contracting Officer prior to bringing the material on the installation. Typical materials requiring SDS and quantity reporting include, but are not limited to, oil and latex based painting and caulking products, solvents, adhesives, aerosol, and petroleum products. Use hazardous materials in a manner that minimizes the amount of hazardous waste generated. Containers of hazardous materials must have National Fire Protection Association labels or their equivalent. Certify that hazardous materials removed from the site are hazardous materials and do not meet the definition of hazardous waste, in accordance with 40 CFR 261.

3.9.1 Hazardous Material (HM)

For the purposes of the document, Hazardous Materials (HM) are defined as any product, material, chemical or substance listed in 49 CFR 172.101 (revised) and 40 CFR 302-304 (revised). Specifically, a HM is any substance or material, in any quantity or form that has the potential to harm human health or the environment or displays specific characteristics (reactive, corrosive, ignitable, and toxic).

Absolutely NO HM shall be brought onto Eglin AFB until that material is registered with the Hazardous Materials Pharmacy (HAZMART) per Eglin AFB. See https://em.eglin.af.mil/emc/ for environmental compliance and pollution prevention requirements for Eglin AFB. This requirement shall apply for all HM that the Contractor intends to bring onto government property for any/all processes or applications. The Contractor shall submit a complete hazardous material inventory list including Material Safety Data Sheets and any other supporting documentation for each HM used prior to contract start or introduction of that material to Eglin AFB. The HM inventory shall include the contract number, performance period, and a Contractor point of contact for HM matters. All excess material and empty containers are the responsibility of the Contractor and shall be removed accordingly at the end of the contract. Should Contractor HM requirements change during the performance period, the Contractor shall immediately notify the HAZMART of such changes in writing. The Contractor shall observe HM storage practices in accordance with regulations, policies, plans and procedures employed by the base.

Reference EGLINAFB 32-7003 Hazardous Waste Management and AFI 32-7042 Solid and Hazardous Waste Compliance.

3.9.2 Hazardous Waste (Includes Special and Universal Waste)

The Contractor shall be considered the primary co-generator for all hazardous wastes generated throughout the duration of the contract. However, all hazardous waste management activities shall be coordinated

and approved by the Contracting Officer and Eglin .The Contractor shall identify what wastes are hazardous using specific and technical knowledge and/or sampling and analysis. This responsibility also includes preparation of waste profile sheets, packaging, marking and labeling of wastes in accordance with 49 CFR Subchapter C.

Hazardous and special waste include, but are not limited to:

1. Fuels and oils of all types
2. Used tires
3. Computer monitors
4. Lighting ballast
5. Exit signs and lighting (batteries)
6. Asbestos (survey required)
7. Lead roof vent flashing
8. All electronic devices
9. Aerosol spray cans (including empties)
10. Paints
11. Adhesives
12. Corrosives
13. Non-flammable and non-corrosive cleaners
14. Fertilizer
15. Hydraulic fluid
16. Antifreeze

Universal waste include, but are not limited to:

1. Spent fluorescent lamps
2. High Intensity Discharge (HID) lamps
3. Batteries (except alkaline)
4. Mercury thermostats
5. Silent switches
6. Mechanical switches
7. Relays and contacts

All hazardous, special, and universal waste items mentioned-above shall be managed IAW local, state, federal, and Eglin AFB Hazardous Waste Management Plan. The CO shall contact the Eglin AFB 96 CEG/CEIEA if handling procedures for hazardous waste and materials is unclear. **Under no circumstances shall hazardous, special, or universal waste be disposed of in the dumpster.** In addition, the contractor shall ensure that all employees, including their subs, comply with the rules and procedures outlined in this specification and the Eglin AFB Hazardous Waste Management Plan.

The contractor shall be familiar with and have immediate access to the following publications and regulations:

1. Environmental Protection Agency (EPA): Title 40 Code of Federal Regulations, Parts 260-279

2. Occupational Safety and Health Administration (OSHA): 29 Code of Federal Regulations Parts 1910 and 1926

3. Department of Transportation (DOT): Title 49 Code of Federal Regulations, Parts 171-177

4. Eglin AFB Hazardous Waste Management Plan

The contactor shall manage all hazardous waste, special waste, and universal waste IAW the HFLD Hazardous Waste Management Plan. In addition,

the contractor shall ensure that all employees, including their subs, comply with the rules and procedures outlined in the Eglin AFB Hazardous Waste Management Plan.

If transportation of Hazardous Wastes is required, the contractor shall possess or ensure the transportation of hazardous waste has a valid state and federal identification number and provide such identification to the Contracting Officer and Eglin AFB 96 CEG/CEIEA prior to any waste movement. The contractor shall ensure a designated representative from Eglin AFB 96 CEG/CEIEA signs the hazardous waste/non-hazardous waste manifest.

3.9.3 Toxic Waste

A. Asbestos: All asbestos work must be accomplished in accordance with federal, state, and local laws and the Eglin AFB Asbestos Management Plan.

1. Notice of Asbestos Renovation or Demolition, DEP Form 62-257.900(1) must be submitted to Florida Department of Environmental Protection at least 10 working days prior to any demolition and/or renovation regardless of whether asbestos is present or not. A copy of this notification must be provided to the Contracting Officer and Eglin AFB 96 CEG/CEIEA prior to performing any work.

2. A copy of all submittals must be provided to the Contracting Officer and Eglin AFB 96 CEG/CEIEA with adequate time built in for review.

3. The use of materials, products or equipment containing asbestos is not allowed. See sample list below.

4. Prior to the commencement of construction, the prime Contractor, each subcontractor and material/equipment supplier shall provide the Contracting Officer and Eglin AFB 96 CEG/CEIEA with a Notarized statement that to the best of their knowledge, no asbestos will be used in the construction of this project. Additionally, the Contractor must have available the most current Material Data Safety Sheet proving the materials contain no asbestos.

5. Sample list of Asbestos Containing Materials (ACM):

Note: The following list does not include every product/material that may contain asbestos. It is intended as a general guide to show which types of materials may contain asbestos:

(1) Cement Pipes	(2) Cement Wallboard
(3) Cement Siding	(4) Asphalt Floor Tile
(5) Vinyl Floor Tile	(6) Vinyl Sheet Flooring
(7) Flooring Backing	(8) Construction Mastics
(9) Acoustical Plaster	(10) Decorative Plaster
(11) Textured Paints/Coatings	(12) Ceiling Tiles & Lay-in-Panels
(13) Spray-Applied Insulation	(14) Blown-in Insulation
(15) Fireproofing Materials	(16) Taping Compounds
(17) Packing Materials	(18) High Temperature Gaskets
(19) Laboratory Hoods	(20) Laboratory Gloves
(21) Fire Blankets & Table Tops	(22) Fire Curtains
(23) Elevator Equipment Panels	(24) Elevator Brake Shoes
(25) HVAC Duct Insulation	(26) Boiler Insulation
(27) Breeching Insulation	(28) Ductwork Flexible Fabric

(29) Cooling Towers	(30) Pipe Insulation
(31) Heating and Electrical	(32) Electrical Panel Partitions
(33) Electrical Cloth ducts	(34) Spackling compounds
(35) Chalkboards	(36) Roofing Shingles
(37) Roofing Felt	(38) Base Flashing
(39) Thermal Paper Products	(40) Fire doors
(41) Caulking/putties	(42) Adhesives
(43) Wallboard	(44) Joint Compounds
(45) Vinyl Wall Coverings	(46) Electrical Wiring Insulation

Caution needs to be taken to ensure materials purchased do not contain one or more % asbestos by volume.

B. Lighting Ballast: When fluorescent and mercury vapor fixtures are removed, the ballast shall be examined for PCB labeling. Ballast is presumed to contain PCBs unless they are clearly labeled "NO PCBs". Suspected ballasts shall be removed and disposed of IAW Eglin AFB directives.

C. Lead Based Paint: No paint containing lead shall be used during the course of this contract. The Occupational Health and Safety Act (OSHA) Lead Construction Standard, 29 CFR 1926.62 is in effect whenever materials are disturbed that contain any amount of lead. Contractors disturbing lead-based paint shall institute medical surveillance, training, engineering controls, worker protection measures and employee monitoring until monitoring results per the OSHA Lead Construction Standard, 29 CFR 1926.62, in order to demonstrate that employee exposure is below the action level and permissible exposure limit. The Contractor on site shall maintain all documentation regarding lead exposure by either historical data or project data. **This data shall also be made available to the Contracting Officer and Eglin AFB 96 CEG/CEIEA upon completion of the project.**

1. Prior to the commencement of construction, the prime Contractor, each subcontractor and material/equipment supplier shall provide to the Contracting Officer and Eglin AFB 96 CEG/CEIEA with a Notarized statement that to the best of their knowledge, no lead based paint will be used in the construction of this project. Additionally, the Contractor must have available the most current *Material Data Safety Sheet* proving that the paint does not have any lead content.
2. The contractor shall be responsible for collection and disposal of all lead paint chips and lead paint-contaminated materials, and for accumulation of these chips/materials on site. The contractor shall test the paint materials, provide containers for proper disposal, and transport any resulting hazardous waste to an appropriate hazardous waste accumulation area should it test positive as hazardous waste. All necessary accumulation, disposal activities and documentation shall be coordinated with the Contracting Officer and Eglin AFB 96 CEG/CEIEA .
3. A copy of contractor's exposure assessment data shall be provided to the Contracting Officer and Eglin AFB 96 CEG/CEIEA.
4. Copies of all lead paint-related documentation generated from this project, including lead testing, air monitoring and hazardous waste manifests, shall be provided by the Contractor to the Contracting Officer. A copy shall be forwarded to Eglin AFB 96 CEG/CEIEA within 10 working days of test completion.
5. ***On Military Family Housing Projects***, there shall be in-depth coordination with the Contracting Officer and Eglin AFB 96 CEG/CEIEA to allow for resident notification and necessary arrangements.

The contractor is strongly encouraged to coordinate closely with the Contracting Officer and Eglin AFB 96 CEG/CEIEA for any required guidance on this critical issue. The Contracting Officer may request documentation for any spills or releases, environmental reports, or off-site transfers.

3.10 PREVIOUSLY USED EQUIPMENT

Clean previously used construction equipment prior to bringing it onto the project site. Equipment must be free from soil residuals, egg deposits from plant pests, noxious weeds, and plant seeds. Consult with the U.S. Department of Agriculture jurisdictional office for additional cleaning requirements.

3.11 CONTROL AND MANAGEMENT OF ASBESTOS-CONTAINING MATERIAL (ACM)

Manage and dispose of asbestos- containing waste in accordance with 40 CFR 61. Manifest asbestos-containing waste and provide the manifest to the Contracting Officer. Notifications to the state and Installation Air Program Manager are required before starting any asbestos work.

3.12 CONTROL AND MANAGEMENT OF LEAD-BASED PAINT (LBP)

Manage and dispose of lead-contaminated waste in accordance with 40 CFR 745. Manifest any lead-contaminated waste and provide the manifest to the Contracting Officer.

3.13 CONTROL AND MANAGEMENT OF LIGHTING BALLAST AND LAMPS CONTAINING PCBS

Manage and dispose of contaminated waste in accordance with 40 CFR 761.

3.14 PETROLEUM, OIL, LUBRICANT (POL) STORAGE AND FUELING

POL products include flammable or combustible liquids, such as gasoline, diesel, lubricating oil, used engine oil, hydraulic oil, mineral oil, and cooking oil. Store POL products and fuel equipment and motor vehicles in a manner that affords the maximum protection against spills into the environment. Manage and store POL products in accordance with EPA 40 CFR 112, and other federal, state, regional, and local laws and regulations. Use secondary containments, dikes, curbs, and other barriers, to prevent POL products from spilling and entering the ground, storm or sewer drains, stormwater ditches or canals, or navigable waters of the United States. Describe in the EPP (see paragraph ENVIRONMENTAL PROTECTION PLAN) how POL tanks and containers must be stored, managed, and inspected and what protections must be provided. Storage of fuel on the project site must be in accordance with EPA, state, and local laws and regulations and paragraph OIL STORAGE INCLUDING FUEL TANKS. The COR and Eglin AFB 96 CEG/CEIEA must approve the use of fuel storage tanks on base, and the contractor must ensure adequate spill containment (spill kits) for any tanks approved for use on Eglin AFB. The contractor must have written spill procedures for tanks and heavy equipment that they use on base. Temporary gasoline is NOT permitted on base.

POL/Storage Tanks: Storage tanks and POL can be a source of contamination if not managed appropriately. Contractor personnel obtaining fuels from Storage Tanks agrees to follow all 62-761 FAC and the following list of Air Force Technical Order's to ensure compliance: 37-1-1, 37A-1-101, 42B-1-1, 42B-1-1S-2, 42B-1-16, 42B-1-22, 42B-1-23, and 42C-1-12.

All fuel, oil, and chemical spills that occur on Eglin AFB (regardless of amount) must be immediately reported to the base fire department (911).

3.14.1 Used Oil Management

Manage used oil generated on site in accordance with 40 CFR 279. Determine if any used oil generated while onsite exhibits a characteristic of hazardous waste. Used oil containing 1,000 parts per million of solvents is considered a hazardous waste and disposed of at the Contractor's expense. Used oil mixed with a hazardous waste is also considered a hazardous waste. Dispose in accordance with paragraph HAZARDOUS WASTE DISPOSAL.

3.14.2 Oil Storage Including Fuel Tanks

Provide secondary containment and overfill protection for oil storage tanks. A berm used to provide secondary containment must be of sufficient size and strength to contain the contents of the tanks plus 5 inches freeboard for precipitation. Construct the berm to be impervious to oil for 72 hours that no discharge will permeate, drain, infiltrate, or otherwise escape before cleanup occurs. Use drip pans during oil transfer operations; adequate absorbent material must be onsite to clean up any spills and prevent releases to the environment. Cover tanks and drip pans during inclement weather. Provide procedures and equipment to prevent overfilling of tanks. If tanks and containers with an aggregate aboveground capacity greater than 1320 gallons will be used onsite (only containers with a capacity of 55 gallons or greater are counted), provide and implement a SPCC plan meeting the requirements of 40 CFR 112. Do not bring underground storage tanks to the installation for Contractor use during a project. Submit the SPCC plan to the Contracting Officer for approval.

Monitor and remove any rainwater that accumulates in open containment dikes or berms. Inspect the accumulated rainwater prior to draining from a containment dike to the environment, to determine there is no oil sheen present.

3.15 INADVERTENT DISCOVERY OF PETROLEUM-CONTAMINATED SOIL OR HAZARDOUS WASTES

If petroleum-contaminated soil, or suspected hazardous waste is found during construction that was not identified in the Contract documents, immediately notify the Contracting Officer. Do not disturb this material until authorized by the Contracting Officer.

3.16 CHLORDANE

Evaluate excess soils and concrete foundation debris generated during the demolition of housing units or other wooden structures for the presence of chlordane or other pesticides prior to reuse or final disposal.

3.17 SOUND INTRUSION

Make the maximum use of low-noise emission products, as certified by the EPA. Blasting or use of explosives are not permitted without written permission from the Contracting Officer, and then only during the designated times. Confine pile-driving operations to the period between 8 a.m. and 4 p.m., Monday through Friday, exclusive of holidays, unless

otherwise specified.

Keep construction activities under surveillance and control to minimize environment damage by noise. Comply with the provisions of the State of Florida rules.

3.18 POST CONSTRUCTION CLEANUP

Clean up areas used for construction in accordance with Contract Clause: "Cleaning Up". Unless otherwise instructed in writing by the Contracting Officer, remove traces of temporary construction facilities such as haul roads, work area, structures, foundations of temporary structures, stockpiles of excess or waste materials, and other vestiges of construction prior to final acceptance of the work. Grade parking area and similar temporarily used areas to conform with surrounding contours.

3.19 INSTALLATION RESTORATION PROGRAM (IRP)

A. Contractors and Project Manages (PM) planning projects on Eglin AFB should be aware of the potential to encounter soil/groundwater contamination throughout many areas of the base. The following guidance has been developed to assist in the planning, designing and construction of projects in possibly contaminated areas (IRP sites). The first set of guidance is the most stringent and involves projects planned in and area that has know contamination and regulatory Land Use Controls. The second set of guidance applies to projects near a known IRP site with suspected contamination. The last set of guidance is general and applies to any areas of the base where contamination has not been confirmed. It is imperative that planners, designers, and contractors involve Eglin AFB 96 CEG/CEIEA early and often in the planning, designing, and construction process to minimize the impact that contaminated soils/groundwater may have on their project.

B. Projects located on a site with known soil and/or groundwater contamination with land use controls:
1. There are land use controls on this area imposed by an environmental regulatory agency designed to protect public health.
2. Project Manager should investigate and plan to ensure all monitor wells/cleanup systems are avoided.
3. Project Manager should submit detailed work plans to Eglin AFB 96 CEG/CEIEA early in planning stages so Eglin AFB 96 CEG/CEIEA can obtain concurrence from the regulatory agencies on project details.
4. Project Manager should educate workers on potential to encounter contamination and also should ensure workers are adequately protected with personal protective equipment.
5. If unusual soil or groundwater color/odor is encountered during subsurface work, contact Eglin AFB 96 CEG/CEIEA .

C. Projects located near a site with known or suspected soil and/or groundwater contamination without land use controls:
1. If unusual soil or groundwater color/odor is encountered during subsurface work, contact Eglin AFB 96 CEG/CEIEA .
2. Project Manager should investigate and plan to ensure all monitor wells/cleanup systems are avoided.
3. Project Manager should educate workers on potential to encounter contamination and also should ensure workers are adequately protected with personal protective equipment.

D. Sites without land use controls and not in close proximity to known

contamination or IRP site:
1. If unusual soil or groundwater color/odor is encountered during subsurface work, contact Eglin AFB 96 CEG/CEIEA .
2. Project Manager should educate workers on potential to encounter contamination and also should ensure workers are adequately protected with personal protective equipment.

Be aware that the regulatory agency can halt the project for long periods of time due to the discovery of contamination but Eglin AFB 96 CEG/CEIEA is committed to expediting projects with IRP compliance related issues.

-- End of Section --

SECTION 01 74 19

CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT
01/07

PART 1 GENERAL

1.1 GOVERNMENT POLICY

Government policy is to apply sound environmental principles in the design, construction and use of facilities. As part of the implementation of that policy: (1) practice efficient waste management when sizing, cutting, and installing products and materials and (2) use all reasonable means to divert construction and demolition waste from landfills and incinerators and to facilitate their recycling or reuse.

1.2 MANAGEMENT

Develop and implement a waste management program. Take a pro-active, responsible role in the management of construction and demolition waste and require all subcontractors, vendors, and suppliers to participate in the effort. Construction and demolition waste includes products of demolition or removal, excess or unusable construction materials, packaging materials for construction products, and other materials generated during the construction process but not incorporated into the work. In the management of waste consideration shall be given to the availability of viable markets, the condition of the material, the ability to provide the material in suitable condition and in a quantity acceptable to available markets, and time constraints imposed by internal project completion mandates. The Contractor is responsible for implementation of any special programs involving rebates or similar incentives related to recycling of waste. Revenues or other savings obtained for salvage, or recycling accrue to the Contractor. Appropriately permit firms and facilities used for recycling, reuse, and disposal for the intended use to the extent required by federal, state, and local regulations. Also, provide on-site instruction of appropriate separation, handling, recycling, salvage, reuse, and return methods to be used by all parties at the appropriate stages of the project.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. The following shall be submitted in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Waste Management Plan; G

SD-11 Closeout Submittals

Records;

1.4 MEETINGS

After award of the Contract and prior to commencement of work, schedule

and conduct a meeting with the Contracting Officer to discuss the proposed Waste Management Plan and to develop a mutual understanding relative to the details of waste management. The requirements for this meeting may be fulfilled during the coordination and mutual understanding meeting outlined in Section 01 45 00.00 10 QUALITY CONTROL. At a minimum, environmental and waste management goals and issues shall be discussed at the following additional meetings:

a. Pre-bid meeting.

b. Preconstruction meeting.

c. Regular QC meetings.

d. Work safety meetings.

1.5 WASTE MANAGEMENT PLAN

A waste management plan shall be submitted within 15 days after notice to proceed and not less than 10 days before the preconstruction meeting. The plan shall demonstrate how the project waste diversion goal shall be met and shall include the following:

a. Name of individuals on the Contractor's staff responsible for waste prevention and management.

b. Actions that will be taken to reduce solid waste generation, including coordination with subcontractors to ensure awareness and participation.

c. Description of the regular meetings to be held to address waste management.

d. Description of the specific approaches to be used in recycling/reuse of the various materials generated, including the areas on site and equipment to be used for processing, sorting, and temporary storage of wastes.

e. Characterization, including estimated types and quantities, of the waste to be generated.

f. Name of landfill and/or incinerator to be used and the estimated costs for use, assuming that there would be no salvage or recycling on the project.

g. Identification of local and regional reuse programs, including non-profit organizations such as schools, local housing agencies, and organizations that accept used materials such as materials exchange networks and Habitat for Humanity. Include the name, location, and phone number for each reuse facility to be used, and provide a copy of the permit or license for each facility.

h. List of specific waste materials that will be salvaged for resale, salvaged and reused on the current project, salvaged and stored for reuse on a future project, or recycled. Recycling facilities that will be used shall be identified by name, location, and phone number, including a copy of the permit or license for each facility.

i. Identification of materials that cannot be recycled/reused with an explanation or justification, to be approved by the Contracting

Officer.

j. Description of the means by which any waste materials identified in item (h) above will be protected from contamination.

k. Description of the means of transportation of the recyclable materials (whether materials will be site-separated and self-hauled to designated centers, or whether mixed materials will be collected by a waste hauler and removed from the site).

l. Anticipated net cost savings determined by subtracting Contractor program management costs and the cost of disposal from the revenue generated by sale of the materials and the incineration and/or landfill cost avoidance.

Revise and resubmit Plan as required by the Contracting Officer. Approval of Contractor's Plan will not relieve the Contractor of responsibility for compliance with applicable environmental regulations or meeting project cumulative waste diversion requirement. Distribute copies of the Waste Management Plan to each subcontractor, the Quality Control Manager, and the Contracting Officer.

1.6 RECORDS

Records shall be maintained to document the quantity of waste generated; the quantity of waste diverted through sale, reuse, or recycling; and the quantity of waste disposed by landfill or incineration. Quantities may be measured by weight or by volume, but must be consistent throughout. List each type of waste separately noting the disposal or diversion date. Identify the landfill, recycling center, waste processor, or other organization used to process or receive the solid waste. Provide explanations for any waste not recycled or reused. With each application for payment, submit updated documentation for solid waste disposal and diversion, and submit manifests, weight tickets, receipts, and invoices specifically identifying the project and waste material. The records shall be made available to the Contracting Officer during construction, and a copy of the records shall be delivered to the Contracting Officer upon completion of the construction.

1.7 COLLECTION

Separate, store, protect, and handle at the site identified recyclable and salvageable waste products in a manner that maximizes recyclability and salvagability of identified materials. Provide the necessary containers, bins and storage areas to facilitate effective waste management and clearly and appropriately identify them. Provide materials for barriers and enclosures around recyclable material storage areas which are nonhazardous and recyclable or reusable. Locate out of the way of construction traffic. Provide adequate space for pick-up and delivery and convenience to subcontractors. Recycling and waste bin areas are to be kept neat and clean, and recyclable materials shall be handled to prevent contamination of materials from incompatible products and materials. Clean contaminated materials prior to placing in collection containers. Use cleaning materials that are nonhazardous and biodegradable. Separate materials by one of the following methods:

1.7.1 Source Separated Method.

Waste products and materials that are recyclable shall be separated from

trash and sorted as described below into appropriately marked separate containers and then transported to the respective recycling facility for further processing. Deliver materials in accordance with recycling or reuse facility requirements (e.g., free of dirt, adhesives, solvents, petroleum contamination, and other substances deleterious to the recycling process). Separate materials into the following category types as appropriate to the project waste and to the available recycling and reuse programs in the project area:

a. Land clearing debris.

b. Asphalt.

c. Concrete and masonry.

d. Metal (e.g. banding, stud trim, ductwork, piping, rebar, roofing, other trim, steel, iron, galvanized, stainless steel, aluminum, copper, zinc, lead brass, bronze).

(1) Ferrous.

(2) Non-ferrous.

e. Wood (nails and staples allowed).

f. Debris.

g. Glass (colored glass allowed).

h. Paper.

(1) Bond.

(2) Newsprint.

(3) Cardboard and paper packaging materials.

i. Plastic.

(1) Type 1: Polyethylene Terephthalate (PET, PETE).

(2) Type 2: High Density Polyethylene (HDPE).

(3) Type 3: Vinyl (Polyvinyl Chloride or PVC).

(4) Type 4: Low Density Polyethylene (LDPE).

(5) Type 5: Polypropylene (PP).

(6) Type 6: Polystyrene (PS).

(7) Type 7: Other. Use of this code indicates that the package in question is made with a resin other than the six listed above, or is made of more than one resin listed above, and used in a multi-layer combination.

j. Gypsum.

k. Non-hazardous paint and paint cans.

l. Carpet.

m. Ceiling tiles.

n. Insulation.

o. Beverage containers.

1.7.2 Co-Mingled Method.

Waste products and recyclable materials shall be placed into a single container and then transported to a recycling facility where the recyclable materials are sorted and processed.

1.7.3 Other Methods.

Other methods proposed by the Contractor may be used when approved by the Contracting Officer.

1.8 DISPOSAL

Control accumulation of waste materials and trash. Recycle or dispose of collected materials off-site at intervals approved by the Contracting Officer and in compliance with waste management procedures. Except as otherwise specified in other sections of the specifications, disposal shall be in accordance with the following:

1.8.1 Reuse.

First consideration shall be given to salvage for reuse since little or no re-processing is necessary for this method, and less pollution is created when items are reused in their original form. Coordinate reuse with the Contracting Officer. Sale or donation of waste suitable for reuse shall be considered.

1.8.2 Recycle.

Waste materials not suitable for reuse, but having value as being recyclable, shall be made available for recycling. All fluorescent lamps, HID lamps, and mercury-containing thermostats removed from the site shall be recycled. Arrange for timely pickups from the site or deliveries to recycling facilities in order to prevent contamination of recyclable materials.

1.8.3 Waste.

Materials with no practical use or economic benefit shall be disposed at a landfill or incinerator.

1.8.4 Return

Set aside and protect misdelivered and substandard products and materials and return to supplier for credit.

PART 2 PRODUCTS

Not used.

PART 3 EXECUTION

Not used. -- End of Section --

SECTION 01 78 00

CLOSEOUT SUBMITTALS
05/19, CHG 1: 08/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E1971	(2005; R 2011) Standard Guide for Stewardship for the Cleaning of Commercial and Institutional Buildings

GREEN SEAL (GS)

GS-37	(2017) Cleaning Products for Industrial and Institutional Use

U.S. ARMY CORPS OF ENGINEERS (USACE)

ERDC/ITL TR-12-1	(2015) A/E/C Graphics Standard, Release 2.0
ERDC/ITL TR-12-6	(2015) A/E/C CAD Standard - Release 6.0

U.S. DEPARTMENT OF DEFENSE (DOD)

FC 1-300-09N	(2014; with Change 4, 2018) Navy and Marine Corps Design
UFC 1-300-08	(2009, with Change 2, 2011) Criteria for Transfer and Acceptance of DoD Real Property

1.2 DEFINITIONS

1.2.1 As-Built Drawings

a. As-built drawings are the marked-up drawings, maintained by the Contractor on-site, that depict actual conditions and deviations from the Contract Documents. These deviations and additions may result from coordination required by, but not limited to: contract modifications; official responses to submitted Requests for Information (RFI's); direction from the Contracting Officer; design that is the responsibility of the Contractor, and differing site conditions. Maintain the as-builts throughout construction as red-lined hard copies on site and or red-lined PDF files. These files serve as the basis for the creation of the record drawings.

b. Eglin-Specific Requirements: See Appendix "A"

1.2.2 Record Drawings

The record drawings are the final compilation of actual conditions reflected in the as-built drawings.

1.3 SOURCE DRAWING FILES

Request the full set of electronic drawings, in the source format, for Record Drawing preparation, after award and at least 30 days prior to required use.

1.3.1 Terms and Conditions

Data contained on these electronic files must not be used for any purpose other than as a convenience in the preparation of construction drawings and data for the referenced project. Any other use or reuse shall be at the sole risk of the Contractor and without liability or legal exposure to the Government. The Contractor must make no claim and waives to the fullest extent permitted by law, any claim or cause of action of any nature against the Government, its agents or sub consultants that may arise out of or in connection with the use of these electronic files. The Contractor must, to the fullest extent permitted by law, indemnify and hold the Government harmless against all damages, liabilities or costs, including reasonable attorney's fees and defense costs, arising out of or resulting from the use of these electronic files.

These electronic CAD drawing files are not construction documents. Differences may exist between the CAD files and the corresponding construction documents. The Government makes no representation regarding the accuracy or completeness of the electronic CAD files, nor does it make representation to the compatibility of these files with the Contractor hardware or software. In the event that a conflict arises between the signed and sealed construction documents prepared by the Government and the furnished Source drawing files, the signed and sealed construction documents govern. The Contractor is responsible for determining if any conflict exists. Use of these Source Drawing files does not relieve the Contractor of duty to fully comply with the contract documents, including and without limitation, the need to check, confirm and coordinate the work of all contractors for the project. If the Contractor uses, duplicates or modifies these electronic source drawing files for use in producing construction drawings and data related to this contract, remove all previous indicia of ownership (seals, logos, signatures, initials and dates).

1.4 RECORD DRAWINGS

The Government will provide pdf and or program files at the preconstruction conference that contains one set of "as-designed" electronic CAD files in the specified software and format revised to reflect all amendments and the final contract PDF drawings. The CAD files are provided to enable preparation of as-built or as-constructed drawings. If discrepancies exist between the CAD files and the contract PDF drawings, correct the CAD files to show the contract PDF drawings.

1.4.1 Variation with Contract Drawings

The electronic files provided are not part of the contract documents. If there is any discrepancy between the electronic files and the contract drawings, the contract drawings govern. The Government has no

responsibility to modify any GFM due to changes in the design that occur after award.

Evaluate the content and quality of the GFM upon receipt. If major discrepancies or omissions occur in the GFM, notify the Contracting Officer and indicate the nature of such variations.

1.4.2 Data Loss, Corruption, and Error

Transfer of GFM files may result in corrupted files resulting in data loss and errors. Use of GFM files at own risk. Verify data integrity upon receipt and request a replacement if necessary. Make any adjustment in file structure, format, or software version as needed to make GFM compatible with computer systems and/or software to meet the requirements of the contract.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Warranty Management Plan

Warranty Tags

Final Cleaning

Spare Parts Data

SD-08 Manufacturer's Instructions

Posted Instructions

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals; G

SD-11 Closeout Submittals

As-Built Drawings; G

Record Model; G

As-Built Record of Equipment and Materials

Final Approved Shop Drawings; G

Construction Contract Specifications; G

Certification of EPA Designated Items; G

Certification Of USDA Designated Items; G

Interim DD FORM 1354; G

Checklist for DD FORM 1354; G

High Performance and Sustainable Building (HPSB) Checklist; G

1.6 SPARE PARTS DATA

Submit two copies of the Spare Parts Data list.

a. Indicate manufacturer's name, part number, and stock level required for test and balance, pre-commissioning, maintenance and repair activities. List those items that may be standard to the normal maintenance of the system.

b. At acceptance of commissioning, ensure the required stock level is supplied as indicated in subparagraph a for maintenance and repair activities through the facilities warranty period. Provision of spare parts does not relieve the Contractor of responsibilities listed under the contract guarantee provisions.

1.7 QUALITY CONTROL

Additions and corrections to the contract drawings must be equal in quality and detail to that of the originals. Line colors, line weights, lettering, layering conventions, and symbols must be the same as the original line colors, line weights, lettering, layering conventions, and symbols.

1.8 WARRANTY MANAGEMENT

1.8.1 Warranty Management Plan

Develop a warranty management plan which contains information relevant to FAR 52.246-21 Warranty of Construction. At least 30 days before the planned pre-warranty conference, submit one set of the warranty management plan. Include within the warranty management plan all required actions and documents to assure that the Government receives all warranties to which it is entitled. The plan narrative must contain sufficient detail to render it suitable for use by future maintenance and repair personnel, whether tradesmen, or of engineering background, not necessarily familiar with this contract. The term "status" as indicated below must include due date and whether item has been submitted or was accomplished. Submit warranty information, made available during the construction phase, to the Contracting Officer for approval prior to each monthly pay estimate. Assemble approved information in a binder and turn over to the Government upon acceptance of the work. The construction warranty period must begin on the date of project acceptance and continue for the full product warranty period. Conduct a joint 4 month and 9 month warranty inspection, measured from time of acceptance; with the Contractor, Contracting Officer and the Customer Representative. The warranty management plan must include, but is not limited to, the following:

a. Roles and responsibilities of personnel associated with the warranty process, including points of contact and telephone numbers within the organizations of the Contractors, subcontractors, manufacturers or suppliers involved.

b. For each warranty, the name, address, telephone number, and e-mail of each of the guarantor's representatives nearest to the project

location.

c. A list and status of delivery of Certificates of Warranty for extended warranty items, including roofs, HVAC balancing, pumps, motors, transformers, and for commissioned systems, such as fire protection and alarm systems, sprinkler systems, and lightning protection systems.

d. As-Built Record of Equipment and Materials list for each warranted equipment, item, feature of construction or system indicating:

(1) Name of item.
(2) Model and serial numbers.
(3) Location where installed.
(4) Name and phone numbers of manufacturers or suppliers.
(5) Names, addresses and telephone numbers of sources of spare parts.
(6) Warranties and terms of warranty. Include one-year overall warranty of construction, including the starting date of warranty of construction. Items which have warranties longer than one year must be indicated with separate warranty expiration dates.
(7) Cross-reference to warranty certificates as applicable.
(8) Starting point and duration of warranty period.
(9) Summary of maintenance procedures required to continue the warranty in force.
(10) Cross-reference to specific pertinent Operation and Maintenance manuals.
(11) Organization, names and phone numbers of persons to call for warranty service.
(12) Typical response time and repair time expected for various warranted equipment.

e. The plans for attendance at the 4 and 9 month post-construction warranty inspections conducted by the Government.

f. Procedure and status of tagging of equipment covered by warranties longer than one year.

g. Copies of instructions to be posted near selected pieces of equipment where operation is critical for warranty or safety reasons.

1.8.2 Performance Bond

The Performance Bond must remain effective throughout the construction and warranty period.

a. In the event the Contractor fails to commence and diligently pursue any construction warranty work required, the Contracting Officer will have the work performed by others, and after completion of the work, will charge the remaining construction warranty funds of expenses incurred by the Government while performing the work, including, but not limited to administrative expenses.

b. In the event sufficient funds are not available to cover the construction warranty work performed by the Government at the Contractor's expense, the Contracting Officer will have the right to recoup expenses from the bonding company.

c. Following oral or written notification of required construction warranty repair work, respond in a timely manner. Written verification will follow oral instructions. Failure to respond will

be cause for the Contracting Officer to proceed against the Contractor.

1.8.3 Pre-Warranty Conference

Prior to contract completion, and at a time designated by the Contracting Officer, meet with the Contracting Officer to develop a mutual understanding with respect to the requirements of this section. At this meeting, establish and review communication procedures for Contractor notification of construction warranty defects, priorities with respect to the type of defect, reasonable time required for Contractor response, and other details deemed necessary by the Contracting Officer for the execution of the construction warranty In connection with these requirements and at the time of the Contractor's quality control completion inspection, furnish the name, telephone number and address of a licensed and bonded company which is authorized to initiate and pursue construction warranty work action on behalf of the Contractor. This point of contact must be located within the local service area of the warranted construction, be continuously available, and be responsive to Government inquiry on warranty work action and status. This requirement does not relieve the Contractor of any of its responsibilities in connection with other portions of this provision.

1.8.4 Contractor's Response to Construction Warranty Service Requirements

Following oral or written notification by the Contracting Officer, respond to construction warranty service requirements in accordance with the "Construction Warranty Service Priority List" and the three categories of priorities listed below. Submit a report on any warranty item that has been repaired during the warranty period. Include within the report the cause of the problem, date reported, corrective action taken, and when the repair was completed. If the Contractor does not perform the construction warranty within the timeframe specified, the Government will perform the work and back charge the construction warranty payment item established.

a. First Priority Code 1. Perform onsite inspection to evaluate situation, and determine course of action within 4 hours, initiate work within 6 hours and work continuously to completion or relief.

b. Second Priority Code 2. Perform onsite inspection to evaluate situation, and determine course of action within 8 hours, initiate work within 24 hours and work continuously to completion or relief.

c. Third Priority Code 3. All other work to be initiated within 3 work days and work continuously to completion or relief.

d. The "Construction Warranty Service Priority List" is as follows:

Code 1-Life Safety Systems
(1) Fire suppression systems.
(2) Fire alarm system(s) in place in the building.

Code 1-Air Conditioning Systems
(1) Recreational support.
(2) Air conditioning leak in part of building, if causing damage.
(3) Air conditioning system not cooling properly.

Code 1-Doors
(1) Interior, exterior personnel doors or hardware, not functioning properly, causing a security, fire, or safety problem.

Code 3-Doors
(1) Interior/exterior personnel doors or hardware not functioning properly.

Code 1-Electrical
(1) Power failure (entire area or any building operational after 1600 hours).
(2) Security lights
(3) Smoke detectors

Code 2-Electrical
(1) Power failure (no power to a room or part of building).
(2) Receptacle and lights (in a room or part of building).

Code 3-Electrical
Street lights.

Code 1-Gas
(1) Leaks and breaks.
(2) No gas to family housing unit or cantonment area.

Code 1-Heat
(1) Area power failure affecting heat.
(2) Heater in unit not working.

Code 2-Kitchen Equipment
(1) Dishwasher not operating properly.
(2) All other equipment hampering preparation of a meal.

Code 1-Plumbing
(1) Hot water heater failure.
(2) Leaking water supply pipes.

Code 2-Plumbing
(1) Flush valves not operating properly.
(2) Fixture drain, supply line to commode, or any water pipe leaking.
(3) Commode leaking at base.

Code 3 -Plumbing
Leaky faucets.

Code 3-Interior
(1) Floors damaged.
(2) Paint chipping or peeling.
(3) Casework.

Code 1-Roof Leaks
Temporary repairs will be made where major damage to property is occurring.

Code 2-Roof Leaks
Where major damage to property is not occurring, check for location of leak during rain and complete repairs on a Code 2 basis.

Code 2-Water (Exterior)
No water to facility.

Code 2-Water (Hot)

No hot water in portion of building listed.

Code 3-All other work not listed above.

1.8.5 Warranty Tags

At the time of installation, tag each warranted item with a durable, oil and water resistant tag approved by the Contracting Officer. Attach each tag with a copper wire and spray with a silicone waterproof coating. Also, submit twofour record copies of the warranty tags showing the layout and design. The date of acceptance and the QC signature must remain blank until the project is accepted for beneficial occupancy. Show the following information on the tag.

Type of product/material	
Model number	
Serial number	
Contract number	
Warranty period from/to	
Inspector's signature	
Construction Contractor	
Address	
Telephone number	
Warranty contact	
Address	
Telephone number	
Warranty response time priority code	
WARNING - PROJECT PERSONNEL TO PERFORM ONLY OPERATIONAL MAINTENANCE DURING THE WARRANTY PERIOD.	

PART 2 PRODUCTS

2.1 RECORD DRAWINGS

Prepare the CAD drawing files in AutoCAD Release 2013 format compatible with a Windows 7 operating system.

2.1.1 Additional Drawings

If additional drawings are required, prepare them using the specified electronic file format applying the same graphic standards specified for original drawings. The title block and drawing border to be used for any new final record drawings must be identical to that used on the contract drawings.

2.1.1.1 Sheet Numbers and File Names

If a sheet needs to be added between two sequential sheets, append a Supplemental Drawing Designator in accordance with ERDC/ITL TR-12-6 Adding a drawing sheet, and ERDC/ITL TR-12-1 Adding or deleting drawing sheets and index sheet procedures.

2.2 CERTIFICATION OF EPA DESIGNATED ITEMS

Submit the Certification of EPA Designated Items as required by FAR 52.223-9 Estimate of Percentage of Recovered Material Content for EPA Designated Items and FAR 52-223-17 Affirmative Procurement of EPA designated items in Service and Construction Contracts. Include on the certification form the following information: project name, project number, Contractor name, license number, Contractor address, and certification. The certification will read as follows and be signed and dated by the Contractor. "I hereby certify the information provided herein is accurate and that the requisition/procurement of all materials listed on this form comply with current EPA standards for recycled/recovered materials content. The following exemptions may apply to the non-procurement of recycled/recovered content materials:

a. The product does not meet appropriate performance standards;

b. The product is not available within a reasonable time frame;

c. The product is not available competitively (from two or more sources);

d. The product is only available at an unreasonable price (compared with a comparable non-recycled content product)."

Record each product used in the project that has a requirement or option of containing recycled content, noting total price, total value of post-industrial recycled content, total value of post-consumer recycled content, exemptions (a, b, c, or d, as indicated), and comments. Recycled content values may be determined by weight or volume percent, but must be consistent throughout.

2.3 CERTIFICATION OF USDA DESIGNATED ITEMS

Submit the Certification of USDA Designated Items as required by FAR 52-223-1 Bio-based Product Certifications and FAR 52.223-2 Affirmative Procurement of Biobased Products Under Service and Construction Contracts. Include on the certification form the following information: project name, project number, Contractor name, license number, Contractor address, and certification. The certification will read as follows and be signed and dated by the Contractor. "I hereby certify the information provided herein is accurate and that the requisition/procurement of all materials listed on this form comply with current USDA standards for biobased materials content. The following exemptions may apply to the non-procurement of biobased content materials:

a. The product does not meet appropriate performance standards;

b. The product is not available within a reasonable time frame;

c. The product is not available competitively (from two or more sources);

d. The product is only available at an unreasonable price (compared with a comparable bio-based content product)."

Record each product used in the project that has a requirement or option of containing biobased content, noting total price, total value of post-industrial recycled content, total value of post-consumer recycled content, total value of biobased content, exemptions (a, b, c, or d, as indicated), and comments. Biobased content values may be determined by weight or volume percent, but must be consistent throughout.

2.4 PDF AS-BUILT FILES

Provide electronic PDF "plots" of all contract drawings sheets associated with the as-built drawing submittal. Compile and organize the PDF set to match the contract drawings.

2.5 REDLINES AND MARKUPS

Provide PDFs of the current working redlines and/or markups complying with the as-builts drawing and markup requirements contained in this specification.

2.6 GEO-DATA-BASE FILES

Provide a SDSFIE/FGDC GeoReferenced personal GeoDataBase. For all information outside of the building walls, provide a personal GeoDataBase in .mdb format using the latest version of Spatial Data Standard for Facilities, Infrastructure, and Environment (SDSFIE) as the database structure. Provide a shell database to define the projection and database structure.

For all drawings within and including the exterior walls, utilize the advanced modeling formats described and referenced herein. Provide a short GeoDataBase read-me file explaining the deliverable. The read-me file will include a description of the software used to create the data, projection, and include the attribute tables used.

2.7 AS-BUILT OR ADVANCED MODELING RE-SUBMISSION REQUIREMENTS

If elements of an as-built submittal are rejected, provide the following for each re-submission, in addition to any information required in Section 01 33 00 SUBMITTAL PROCEDURES:

a. Re-submit all components required under paragraph As-Builts or Advanced Modeling Package, including a new Advanced Modeling Submittal Checklist and updated content in response to Government comments.

b. Provide a copy of all Government review comments.

c. Provide a disposition/response to each Government review comment for a back-check of the re-submission deliverable.

PART 3 EXECUTION

3.1 AS-BUILT DRAWINGS

Provide and maintain two black line print copies of the PDF contract drawings for As-Built Drawings. Maintain the as-builts throughout construction as red-lined hard copies on site and red-lined PDF files. Submit As-Built Drawings 30 days prior to Beneficial Occupancy Date (BOD).

3.1.1 Markup Guidelines

Make comments and markup the drawings complete without reference to letters, memos, or materials that are not part of the As-Built drawing. Show what was changed, how it was changed, where item(s) were relocated and change related details. These working as-built markup prints must be neat, legible and accurate as follows:

a. Use base colors of red, green, and blue. Color code for changes as follows:

(1) Special (Blue) - Items requiring special information, coordination, or special detailing or detailing notes.

(2) Deletions (Red) - Over-strike deleted graphic items (lines), lettering in notes and leaders.

(3) Additions (Green) - Added items, lettering in notes and leaders.

b. Provide a legend if colors other than the "base" colors of red, green, and blue are used.

c. Add and denote any additional equipment or material facilities, service lines, incorporated under As-Built Revisions if not already shown in legend.

d. Use frequent written explanations on markup drawings to describe changes. Do not totally rely on graphic means to convey the revision.

e. Use legible lettering and precise and clear digital values when marking prints. Clarify ambiguities concerning the nature and application of change involved.

f. Wherever a revision is made, also make changes to related section views, details, legend, profiles, plans and elevation views, schedules, notes and call out designations, and mark accordingly to avoid conflicting data on all other sheets.

g. For deletions, cross out all features, data and captions that relate to that revision.

h. For changes on small-scale drawings and in restricted areas, provide large-scale inserts, with leaders to the applicable location.

i. Indicate one of the following when attaching a print or sketch to a markup print:

1) Add an entire drawing to contract drawings

2) Change the contract drawing to show

3) Provided for reference only to further detail the initial design.

j. Incorporate all shop and fabrication drawings into the markup drawings.

3.1.2 As-Built Drawings Content

Revise As-Built Drawings in accordance with ERDC/ITL TR-12-1. Keep these working as-built markup drawings current on a weekly basis and at least one set available on the jobsite at all times. Changes from the contract drawings which are made during construction or additional information which might be uncovered in the course of construction must be accurately and neatly recorded as they occur by means of details and notes. Submit the working as-built markup drawings for approval prior to submission of each monthly pay estimate. For failure to maintain the working and final record drawings as specified herein, the Contracting Officer will withhold 10 percent of the monthly progress payment until approval of updated drawings. Show on the as-built drawings, but not limited to, the following information:

a. The actual location, kinds and sizes of all sub-surface utility lines. In order that the location of these lines and appurtenances may be determined in the event the surface openings or indicators become covered over or obscured, show by offset dimensions to two permanently fixed surface features the end of each run including each change in direction on the record drawings. Locate valves, splice boxes and similar appurtenances by dimensioning along the utility run from a reference point. Also record the average depth below the surface of each run.

b. The location and dimensions of any changes within the building structure.

c. Layout and schematic drawings of electrical circuits and piping.

d. Correct grade, elevations, cross section, or alignment of roads, earthwork, structures or utilities if any changes were made from contract plans.

e. Changes in details of design or additional information obtained from working drawings specified to be prepared or furnished by the Contractor; including but not limited to shop drawings, fabrication, erection, installation plans and placing details, pipe sizes, insulation material, dimensions of equipment, and foundations.

f. The topography, invert elevations and grades of drainage installed or affected as part of the project construction.

g. Changes or Revisions which result from the final inspection.

h. Where contract drawings or specifications present options, show only the option selected for construction on the working as-built markup drawings.

i. If borrow material for this project is from sources on Government property, or if Government property is used as a spoil area, furnish a contour map of the final borrow pit/spoil area elevations.

j. Systems designed or enhanced by the Contractor, such as HVAC controls,

fire alarm, fire sprinkler, and irrigation systems.

k. Changes in location of equipment and architectural features.

l. Modifications and compliance with FC 1-300-09N procedures.

m. Actual location of anchors, construction and control joints, etc., in concrete.

n. Unusual or uncharted obstructions that are encountered in the contract work area during construction.

o. Location, extent, thickness, and size of stone protection particularly where it will be normally submerged by water.

3.2 RECORD DRAWING FILES

If additional drawings are required, prepare them using the specified electronic file format applying the same graphic standards specified for original drawings ERDC/ITL TR-12-6 and ERDC/ITL TR-12-1. The title block and drawing border to be used for any new final record drawings must be identical to that used on the contract drawings. Accomplish additions and corrections to the contract drawings using CAD files. Provide all program files and hardware necessary to prepare final PDF record drawings. The Contracting Officer will review final PDF record drawings for accuracy and return them to the Contractor for required corrections, changes, additions, and deletions.

3.2.1 Rename the CAD Drawing files

Rename the CAD Drawing files using the contract number as the Project Code field,(e.g., W91238-15-C-10A-102.DWGDGN) as instructed in the Pre-Construction conference. Use only those renamed files for the Marked-up changes. Make all changes on the layer/level as the original item.

a. For AutoCAD files (DWG), enter all as-built delta changes and notations on the AS-BUILT layer.MicroStation files (DGN), enter all as-built delta changes and notations on:

- Level #63
- Level/Layer Name contains: ANNO-REVS
- Level/Layer Description: Revisions

b. When final revisions have been completed, show the wording "RECORD DRAWING AS-BUILTS" followed by the name of the Contractor in letters at least 3/16 inch high on the cover sheet drawing. Date RECORD DRAWING AS-BUILTS" drawing revisions in the revision block.

c. Within 1020 days after Government approval of all of the working record drawings for a phase of work, prepare the final CAD record drawings for that phase of work and submit PDF drawing files and two sets of prints for review and approval. The Government will promptly return one set of prints annotated with any necessary corrections. Within 710 days revise the CAD files accordingly at no additional cost and submit one set of final prints for the completed phase of work to the Government. Within 1020 days of substantial completion of all phases of work, submit the final record drawing package for the entire project. Submit one set of electronic CAD files, and one set of the

approved working record PDF and or programfiles with two sets of prints. The CAD files must be complete in all details and identical in form and function to the CAD drawing files supplied by the Government. Prepare AutoCAD files for transmittal using e-Transmit. Prepare MicroStation files for transmittal using the Packager (Archive). Make any transactions or adjustments necessary to accomplish this. The Government reserves the right to reject any drawing files it deems incompatible with the customer's CAD system. Paper prints, drawing files and storage media submitted will become the property of the Government upon final approval. Failure to submit final record PDF drawing files, CAD files and marked prints as specified will be cause for withholding any payment due under this contract. Approval and acceptance of final record drawings must be accomplished before final payment is made.

3.3 RECORD DRAWINGS

Prepare and provide Record Drawings and Source Documents in accordance with FC 1-300-09N. Provide four copies of Record Drawings and Documents on separate CDs or DVDs 30 days after BOD.

Prepare final record drawings after the completion of each definable phase of work as listed in the Contractor Quality Control Plan (such as Foundations, Utilities, or Structural Steel as appropriate for the project). Transfer the changes from the approved working as-built markup drawings to the original electronic CAD drawing files. Modify the as-built CAD drawing files to correctly show the features of the project as-built by bringing the working CAD drawing set into agreement with approved working as-built markup drawings, and adding such additional drawings as may be necessary. Refer to ERDC/ITL TR-12-1. Jointly review the working as-built markup drawings with printouts from working as-built CAD drawing PDF files for accuracy and completeness. Monthly review of working as-built CAD drawing PDF file printouts must cover all sheets revised since the previous review. These PDF drawing files are part of the permanent records of this project. Any drawings damaged or lost must be satisfactorily replaced at no expense to the Government.

Drawing revisions (include within change order price the cost to change working and final record drawings to reflect revisions) and compliance with the following procedures.

a. Follow directions in the revision for posting descriptive changes.

b. The revision delta size must be 5/16 inch unless the area where the delta is to be placed is crowded. Use a smaller size delta for crowded areas.

c. Place a revision delta at the location of each deletion.

d. For new details or sections which are added to a drawing, place a revision delta by the detail or section title.

e. For minor changes, place a revision delta by the area changed on the drawing (each location).

f. For major changes to a drawing, place a revision delta by the title of the affected plan, section, or detail at each location.

g. For changes to schedules or drawings, place a revision delta either by the schedule heading or by the change in the schedule.

3.3.1 Final Record Drawing Package

Submit the final record PDF and CAD drawings package for the entire project within 20 days of substantial completion of all phases of work. Submit one set of ANSI D size PDF and CAD files, two sets of ANSI D size prints and one set of the approved working record drawings. The package must be complete in all details and identical in form and function to the contract drawing files supplied by the Government.

3.4 FINAL APPROVED SHOP DRAWINGS

Submit final approved project shop drawings 30 days after transfer of the completed facility.

3.5 CONSTRUCTION CONTRACT SPECIFICATIONS

Submit final PDF file record construction contract specifications, including revisions thereto, 30 days after transfer of the completed facility.

3.6 AS-BUILT RECORD OF EQUIPMENT AND MATERIALS

Furnish one copy of preliminary record of equipment and materials used on the project 15 days prior to final inspection. This preliminary submittal will be reviewed and returned 2 days after final inspection with Government comments. Submit Two sets of final record of equipment and materials 10 days after final inspection. Key the designations to the related area depicted on the contract drawings. List the following data:

RECORD OF DESIGNATED EQUIPMENT AND MATERIALS DATA				
Description	Specification Section	Manufacturer and Catalog, Model, and Serial Number	Composition and Size	Where Used

3.7 OPERATION AND MAINTENANCE MANUALS

Provide project operation and maintenance manuals. Provide four electronic copies of the Operation and Maintenance Manual files and one hard copy of the Operation and Maintenance Manuals. Submit to the Contracting Officer for approval within 30 calendar days of the Beneficial Occupancy Date (BOD). Update and resubmit files for final approval at BOD.

3.8 CLEANUP

Provide final cleaning in accordance with ASTM E1971 and submit two copies of the listing of completed final clean-up items. Leave premises "broom clean." Comply with GS-37 for general purpose cleaning and bathroom cleaning. Use only nonhazardous cleaning materials, including

natural cleaning materials, in the final cleanup. Clean interior and exterior glass surfaces exposed to view; remove temporary labels, stains and foreign substances; polish transparent and glossy surfaces; vacuum carpeted and soft surfaces. Clean equipment and fixtures to a sanitary condition. Replace filters of operating equipment and comply with the Indoor Air Quality (IAQ) Management Plan. Clean debris from roofs, gutters, downspouts and drainage systems. Sweep paved areas and rake clean landscaped areas. Remove waste and surplus materials, rubbish and construction facilities from the site. Recycle, salvage, and return construction and demolition waste from project, and 01 74 19 CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL.

3.9 REAL PROPERTY RECORD

Refer to UFC 1-300-08 for instruction on completing the DD FORM 1354. Contact the Contracting Officer for any project specific information necessary to complete the DD FORM 1354.

3.9.1 Interim DD FORM 1354

Near the completion of Project, but a minimum of 60 days prior to final acceptance of the work, complete, and submit an accounting of all installed property with Interim DD FORM 1354. Include any additional assets, improvements, and alterations from the Draft DD FORM 1354.

-- End of Section --

SECTION 01 78 23

OPERATION AND MAINTENANCE DATA
08/15, CHG 2: 08/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E1971	(2005; R 2011) Standard Guide for Stewardship for the Cleaning of Commercial and Institutional Buildings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-10 Operation and Maintenance Data

O&M Database; G

Training Plan; G

Training Outline; G

Training Content; G

SD-11 Closeout Submittals

Training Video Recording; G

Validation of Training Completion; G

1.3 OPERATION AND MAINTENANCE DATA

Submit Operation and Maintenance (O&M) Data for the provided equipment, product, or system, defining the importance of system interactions, troubleshooting, and long-term preventive operation and maintenance. Compile, prepare, and aggregate O&M data to include clarifying and updating the original sequences of operation to as-built conditions. Organize and present information in sufficient detail to clearly explain O&M requirements at the system, equipment, component, and subassembly level. Include an index preceding each submittal. Submit in accordance with this section and Section 01 33 00 SUBMITTAL PROCEDURES.

1.3.1 Package Quality

Documents must be fully legible. Operation and Maintenance data must be consistent with the manufacturer's standard brochures, schematics, printed

instructions, general operating procedures, and safety precautions.

1.3.2 Package Content

Provide data package content in accordance with paragraph SCHEDULE OF OPERATION AND MAINTENANCE DATA PACKAGES. Comply with the data package requirements specified in the individual technical sections, including the content of the packages and addressing each product, component, and system designated for data package submission, except as follows. Use Data Package 3 for commissioned items without a specified data package requirement in the individual technical sections. Provide a Data Package 3 instead of Data Package 1 or 2, as specified in the individual technical section, for items that are commissioned.

1.3.3 Changes to Submittals

Provide manufacturer-originated changes or revisions to submitted data if a component of an item is so affected subsequent to acceptance of the O&M Data. Submit changes, additions, or revisions required by the Contracting Officer for final acceptance of submitted data within 30 calendar days of the notification of this change requirement.

1.3.4 Commissioning Authority Review and Approval

Submit the commissioned systems and equipment submittals to the Commissioning Authority (CxA) to review for completeness and applicability. Obtain validation from the CxA that the systems and equipment provided meet the requirements of the Contract documents and design intent, particularly as they relate to functionality, energy performance, water performance, maintainability, sustainability, system cost, indoor environmental quality, and local environmental impacts. The CxA communicates deficiencies to the Contracting Officer. Submit the O&M manuals to the Contracting Officer upon a successful review of the corrections, and with the CxA recommendation for approval and acceptance of these O&M manuals. This work is in addition to the normal review procedures for O&M data.

1.4 O&M DATABASE

Develop an editable, electronic spreadsheet based on the equipment in the Operation and Maintenance Manuals that contains the information required to start a preventive maintenance program. As a minimum, provide list of system equipment, location installed, warranty expiration date, manufacturer, model, and serial number.

1.5 OPERATION AND MAINTENANCE MANUAL FILE FORMAT

Assemble data packages into electronic Operation and Maintenance Manuals. Assemble each manual into a composite electronically indexed file using the most current version of Adobe Acrobat or similar software capable of producing PDF file format. Provide compact disks (CD) or data digital versatile disk (DVD) as appropriate, so that each one contains operation, maintenance and record files, project record documents, and training videos. Include a complete electronically linked operation and maintenance directory.

1.5.1 Organization

Bookmark Product and Drawing Information documents using the current

version of CSI MasterFormat numbering system, and arrange submittals using the specification sections as a structure. Use CSI MasterFormat and UFGS numbers along with descriptive bookmarked titles that explain the content of the information that is being bookmarked.

1.5.2 CD or DVD Label and Disk Holder or Case

Provide the following information on the disk label and disk holder or case:

a. Building Number

b. Project Title

c. Activity and Location

d. Construction Contract Number

e. Prepared For: (Contracting Agency)

f. Prepared By: (Name, title, phone number and email address)

g. Include the disk content on the disk label

h. Date

i. Virus scanning program used

1.6 TYPES OF INFORMATION REQUIRED IN O&M DATA PACKAGES

The following are a detailed description of the data package items listed in paragraph SCHEDULE OF OPERATION AND MAINTENANCE DATA PACKAGES.

1.6.1 Operating Instructions

Provide specific instructions, procedures, and illustrations for the following phases of operation for the installed model and features of each system:

1.6.1.1 Safety Precautions and Hazards

List personnel hazards and equipment or product safety precautions for operating conditions. List all residual hazards identified in the Activity Hazard Analysis provided under Section 01 35 26 GOVERNMENT SAFETY REQUIREMENTS. Provide recommended safeguards for each identified hazard.

1.6.1.2 Operator Prestart

Provide procedures required to install, set up, and prepare each system for use.

1.6.1.3 Startup, Shutdown, and Post-Shutdown Procedures

Provide narrative description for Startup, Shutdown and Post-shutdown operating procedures including the control sequence for each procedure.

1.6.1.4 Normal Operations

Provide Control Diagrams with data to explain operation and control of

systems and specific equipment. Provide narrative description of Normal Operating Procedures.

1.6.1.5 Emergency Operations

Provide Emergency Procedures for equipment malfunctions to permit a short period of continued operation or to shut down the equipment to prevent further damage to systems and equipment. Provide Emergency Shutdown Instructions for fire, explosion, spills, or other foreseeable contingencies. Provide guidance and procedures for emergency operation of utility systems including required valve positions, valve locations and zones or portions of systems controlled.

1.6.1.6 Operator Service Requirements

Provide instructions for services to be performed by the operator such as lubrication, adjustment, inspection, and recording gauge readings.

1.6.1.7 Environmental Conditions

Provide a list of Environmental Conditions (temperature, humidity, and other relevant data) that are best suited for the operation of each product, component or system. Describe conditions under which the item equipment should not be allowed to run.

1.6.1.8 Operating Log

Provide forms, sample logs, and instructions for maintaining necessary operating records.

1.6.1.9 Additional Requirements for HVAC Control Systems

Provide Data Package 5 and the following for control systems:

a. Narrative description on how to perform and apply functions, features, modes, and other operations, including unoccupied operation, seasonal changeover, manual operation, and alarms. Include detailed technical manual for programming and customizing control loops and algorithms.

b. Full as-built sequence of operations.

c. Copies of checkout tests and calibrations performed by the Contractor (not Cx tests).

d. Full points list. Provide a listing of rooms with the following information for each room:

(1) Floor

(2) Room number

(3) Room name

(4) Air handler unit ID

(5) Reference drawing number

(6) Air terminal unit tag ID

(7) Heating or cooling valve tag ID

(8) Minimum cfm

(9) Maximum cfm

e. Full print out of all schedules and set points after testing and acceptance of the system.

f. Full as-built print out of software program.

g. Marking of system sensors and thermostats on the as-built floor plan and mechanical drawings with their control system designations.

1.6.2 Preventive Maintenance

Provide the following information for preventive and scheduled maintenance to minimize repairs for the installed model and features of each system. Include potential environmental and indoor air quality impacts of recommended maintenance procedures and materials.

1.6.2.1 Lubrication Data

Include the following preventive maintenance lubrication data, in addition to instructions for lubrication required under paragraph OPERATOR SERVICE REQUIREMENTS:

a. A table showing recommended lubricants for specific temperature ranges and applications.

b. Charts with a schematic diagram of the equipment showing lubrication points, recommended types and grades of lubricants, and capacities.

c. A Lubrication Schedule showing service interval frequency.

1.6.2.2 Preventive Maintenance Plan, Schedule, and Procedures

Provide manufacturer's schedule for routine preventive maintenance, inspections, condition monitoring (predictive tests) and adjustments required to ensure proper and economical operation and to minimize repairs. Provide instructions stating when the systems should be retested. Provide manufacturer's projection of preventive maintenance work-hours on a daily, weekly, monthly, and annual basis including craft requirements by type of craft. For periodic calibrations, provide manufacturer's specified frequency and procedures for each separate operation.

a. Define the anticipated time required to perform each of each test (work-hours), test apparatus, number of personnel identified by responsibility, and a testing validation procedure permitting the record operation capability requirements within the schedule. Provide a remarks column for the testing validation procedure referencing operating limits of time, pressure, temperature, volume, voltage, current, acceleration, velocity, alignment, calibration, adjustments, cleaning, or special system notes. Delineate procedures for preventive maintenance, inspection, adjustment, lubrication and cleaning necessary to minimize repairs.

b. Repair requirements must inform operators how to check out,

troubleshoot, repair, and replace components of the system. Include electrical and mechanical schematics and diagrams and diagnostic techniques necessary to enable operation and troubleshooting of the system after acceptance.

1.6.2.3 Cleaning Recommendations

Provide environmentally preferable cleaning recommendations in accordance with ASTM E1971.

1.6.3 Repair

Provide manufacturer's recommended procedures and instructions for correcting problems and making repairs for the installed model and features of each system. Include potential environmental and indoor air quality impacts of recommended maintenance procedures and materials.

1.6.3.1 Troubleshooting Guides and Diagnostic Techniques

Provide step-by-step procedures to promptly isolate the cause of typical malfunctions. Describe clearly why the checkout is performed and what conditions are to be sought. Identify tests or inspections and test equipment required to determine whether parts and equipment may be reused or require replacement.

1.6.3.2 Wiring Diagrams and Control Diagrams

Provide point-to-point drawings of wiring and control circuits including factory-field interfaces. Provide a complete and accurate depiction of the actual job specific wiring and control work. On diagrams, number electrical and electronic wiring and pneumatic control tubing and the terminals for each type, identically to actual installation configuration and numbering.

1.6.3.3 Repair Procedures

Provide instructions and a list of tools required to repair or restore the product or equipment to proper condition or operating standards.

1.6.3.4 Removal and Replacement Instructions

Provide step-by-step procedures and a list of required tools and supplies for removal, replacement, disassembly, and assembly of components, assemblies, subassemblies, accessories, and attachments. Provide tolerances, dimensions, settings and adjustments required. Use a combination of text and illustrations.

1.6.3.5 Spare Parts and Supply Lists

Provide lists of spare parts and supplies required for repair to ensure continued service or operation without unreasonable delays. Special consideration is required for facilities at remote locations. List spare parts and supplies that have a long lead-time to obtain.

1.6.3.6 Repair Work-Hours

Provide manufacturer's projection of repair work-hours including requirements by type of craft. Identify, and tabulate separately, repair that requires the equipment manufacturer to complete or to participate.

1.6.4 Real Property Equipment

Provide a list of installed equipment furnished under this contract. Include all information usually listed on manufacturer's name plate. In the "EQUIPMENT-IN-PLACE LIST" include, as applicable, the following for each piece of equipment installed: description of item, location (by room number), model number, serial number, capacity, name and address of manufacturer, name and address of equipment supplier, condition, spare parts list, manufacturer's catalog, and warranty. Submit the final list 30 days after transfer of the completed facility.

Key the designations to the related area depicted on the contract drawings. List the following data:

RECORD OF DESIGNATED EQUIPMENT AND MATERIALS DATA				
Description	Specification Section	Manufacturer and Catalog, Model, and Serial Number	Composition and Size	Where Used

1.6.5 Appendices

Provide information required below and information not specified in the preceding paragraphs but pertinent to the maintenance or operation of the product or equipment. Include the following:

1.6.5.1 Product Submittal Data

Provide a copy of SD-03 Product Data submittals documented with the required approval.

1.6.5.2 Certificates

Provide a copy of SD-07 Certificates submittals documented with the required approval.

1.6.5.3 Manufacturer's Instructions

Provide a copy of SD-08 Manufacturer's Instructions submittals documented with the required approval.

1.6.5.4 O&M Submittal Data

Provide a copy of SD-10 Operation and Maintenance Data submittals documented with the required approval.

1.6.5.5 Parts Identification

Provide identification and coverage for the parts of each component, assembly, subassembly, and accessory of the end items subject to replacement. Include special hardware requirements, such as requirement to use high-strength bolts and nuts. Identify parts by make, model, serial number, and source of supply to allow reordering without further identification. Provide clear and legible illustrations, drawings, and

exploded views to enable easy identification of the items. When illustrations omit the part numbers and description, both the illustrations and separate listing must show the index, reference, or key number that will cross-reference the illustrated part to the listed part. Group the parts shown in the listings by components, assemblies, and subassemblies in accordance with the manufacturer's standard practice. Parts data may cover more than one model or series of equipment, components, assemblies, subassemblies, attachments, or accessories, such as typically shown in a master parts catalog.

1.6.5.6 Warranty Information

List and explain the various warranties and clearly identify the servicing and technical precautions prescribed by the manufacturers or contract documents in order to keep warranties in force. Include warranty information for primary components of the system. Provide copies of warranties required by Section 01 78 00 CLOSEOUT SUBMITTALS.

1.6.5.7 Extended Warranty Information

List all warranties for products, equipment, components, and sub-components whose duration exceeds one year. For each warranty listed, indicate the applicable specification section, duration, start date, end date, and the point of contact for warranty fulfillment. Also, list or reference the specific operation and maintenance procedures that must be performed to keep the warranty valid. Provide copies of warranties required by Section 01 78 00 CLOSEOUT SUBMITTALS.

1.6.5.8 Personnel Training Requirements

Provide information available from the manufacturers that is needed for use in training designated personnel to properly operate and maintain the equipment and systems.

1.6.5.9 Testing Equipment and Special Tool Information

Include information on test equipment required to perform specified tests and on special tools needed for the operation, maintenance, and repair of components. Provide final set points.

1.6.5.10 Testing and Performance Data

Include completed prefunctional checklists, functional performance test forms, and monitoring reports. Include recommended schedule for retesting and blank test forms. Provide final set points.

1.6.5.11 Field Test Reports and Manufacturer's Field Reports

Provide a copy of Field Test Reports (SD-06) and Manufacturer's Field Reports (SD-09) submittals documented with the required approval.

1.6.5.12 Contractor Information

Provide a list that includes the name, address, and telephone number of the General Contractor and each Subcontractor who installed the product or equipment, or system. For each item, also provide the name address and telephone number of the manufacturer's representative and service organization that can provide replacements most convenient to the project site. Provide the name, address, and telephone number of the product,

equipment, and system manufacturers.

1.7 SCHEDULE OF OPERATION AND MAINTENANCE DATA PACKAGES

Provide the O&M data packages specified in individual technical sections. The information required in each type of data package follows:

1.7.1 Data Package 1

a. Safety precautions and hazards

b. Cleaning recommendations

c. Maintenance and repair procedures

d. Warranty information

e. Extended warranty information

f. Contractor information

g. Spare parts and supply list

1.7.2 Data Package 2

a. Safety precautions and hazards

b. Normal operations

c. Environmental conditions

d. Lubrication data

e. Preventive maintenance plan, schedule, and procedures

f. Cleaning recommendations

g. Maintenance and repair procedures

h. Removal and replacement instructions

i. Spare parts and supply list

j. Parts identification

k. Warranty information

l. Extended warranty information

m. Contractor information

1.7.3 Data Package 3

a. Safety precautions and hazards

b. Operator prestart

c. Startup, shutdown, and post-shutdown procedures

d. Normal operations

e. Emergency operations

f. Environmental conditions

g. Operating log

h. Lubrication data

i. Preventive maintenance plan, schedule, and procedures

j. Cleaning recommendations

k. Troubleshooting guides and diagnostic techniques

l. Wiring diagrams and control diagrams

m. Maintenance and repair procedures

n. Removal and replacement instructions

o. Spare parts and supply list

p. Product submittal data

q. O&M submittal data

r. Parts identification

s. Warranty information

t. Extended warranty information

u. Testing equipment and special tool information

v. Testing and performance data

w. Contractor information

x. Field test reports

1.7.4 Data Package 4

a. Safety precautions and hazards

b. Operator prestart

c. Startup, shutdown, and post-shutdown procedures

d. Normal operations

e. Emergency operations

f. Operator service requirements

g. Environmental conditions

h. Operating log

i. Lubrication data

j. Preventive maintenance plan, schedule, and procedures

k. Cleaning recommendations

l. Troubleshooting guides and diagnostic techniques

m. Wiring diagrams and control diagrams

n. Repair procedures

o. Removal and replacement instructions

p. Spare parts and supply list

q. Repair work-hours

r. Product submittal data

s. O&M submittal data

t. Parts identification

u. Warranty information

v. Extended warranty information

w. Personnel training requirements

x. Testing equipment and special tool information

y. Testing and performance data

z. Contractor information

aa. Field test reports

1.7.5 Data Package 5

a. Safety precautions and hazards

b. Operator prestart

c. Start-up, shutdown, and post-shutdown procedures

d. Normal operations

e. Environmental conditions

f. Preventive maintenance plan, schedule, and procedures

g. Troubleshooting guides and diagnostic techniques

h. Wiring and control diagrams

i. Maintenance and repair procedures

j. Removal and replacement instructions

k. Spare parts and supply list

l. Product submittal data

m. Manufacturer's instructions

n. O&M submittal data

o. Parts identification

p. Testing equipment and special tool information

q. Warranty information

r. Extended warranty information

s. Testing and performance data

t. Contractor information

u. Field test reports

v. Additional requirements for HVAC control systems

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

3.1 TRAINING

Prior to acceptance of the facility by the Contracting Officer for Beneficial Occupancy, provide comprehensive training for the systems and equipment specified in the technical specifications. The training must be targeted for the Facilities Management Specialist, building maintenance personnel, and applicable building occupants. Instructors must be well-versed in the particular systems that they are presenting. Address aspects of the Operation and Maintenance Manual submitted in accordance with Section 01 78 00 CLOSEOUT SUBMITTALS.. Training must include classroom or field lectures based on the system operating requirements. The location of classroom training requires approval by the Contracting Officer.

3.1.1 Training Plan

Submit a written training plan to the Contracting Officer for approval at least 60 calendar days prior to the scheduled training. Training plan must be approved by the Commissioning Authority (CxA) prior to forwarding to the Contracting Officer. Also, coordinate the training schedule with the Contracting Officer and CxA. Include within the plan the following elements:

a. Equipment included in training

b. Intended audience

c. Location of training

d. Dates of training

e. Objectives

f. Outline of the information to be presented and subjects covered including description

g. Start and finish times and duration of training on each subject

h. Methods (e.g. classroom lecture, video, site walk-through, actual operational demonstrations, written handouts)

i. Instructor names and instructor qualifications for each subject

j. List of texts and other materials to be furnished by the Contractor that are required to support training

k. Description of proposed software to be used for video recording of training sessions.

3.1.2 Training Content

The core of this training must be based on manufacturer's recommendations and the operation and maintenance information. The CxA is responsible for overseeing and approving the content and adequacy of the training. Spend 95 percent of the instruction time during the presentation on the OPERATION AND MAINTENANCE DATA. Include the following for each system training presentation:

a. Start-up, normal operation, shutdown, unoccupied operation, seasonal changeover, manual operation, controls set-up and programming, troubleshooting, and alarms.

b. Relevant health and safety issues.

c. Discussion of how the feature or system is environmentally responsive. Advise adjustments and optimizing methods for energy conservation.

d. Design intent.

e. Use of O&M Manual Files.

f. Review of control drawings and schematics.

g. Interactions with other systems.

h. Special maintenance and replacement sources.

i. Tenant interaction issues.

3.1.3 Training Outline

Provide the Operation and Maintenance Manual Files (Bookmarked PDF) and a written course outline listing the major and minor topics to be discussed by the instructor on each day of the course to each trainee in the course. Provide the course outline 14 calendar days prior to the training.

3.1.4 Training Video Recording

Record classroom training session(s) on video. Provide to the Contracting Officer two copies of the training session(s) in DVD video recording format. Capture within the recording, in video and audio, the instructors' training presentations including question and answer periods with the attendees. The recording camera(s) must be attended by a person during the recording sessions to assure proper size of exhibits and projections during the recording are visible and readable when viewed as training.

3.1.5 Unresolved Questions from Attendees

If, at the end of the training course, there are questions from attendees that remain unresolved, the instructor must send the answers, in writing, to the Contracting Officer for transmittal to the attendees, and the training video must be modified to include the appropriate clarifications.

3.1.6 Validation of Training Completion

Ensure that each attendee at each training session signs a class roster daily to confirm Government participation in the training. At the completion of training, submit a signed validation letter that includes a sample record of training for reporting what systems were included in the training, who provided the training, when and where the training was performed, and copies of the signed class rosters. Provide two copies of the validation to the Contracting Officer, and one copy to the Operation and Maintenance Manual Preparer for inclusion into the Manual's documentation.

3.1.7 Quality Control Coordination

Coordinate this training with the CxA in accordance with Section 01 45 00.00 10 QUALITY CONTROL.

-- End of Section --

SECTION 01 91 00.15 10

TOTAL BUILDING COMMISSIONING
05/19, CHG 2: 08/20

PART 1 GENERAL

1.1 SUMMARY

Commission the building systems listed herein. Employ the services of an independent Commissioning Firm. The Commissioning Firm must be a 1st tier subcontractor of the General or Prime Contractor and must be financially and corporately independent of all other subcontractors. The Commissioning Firm must employ a Lead Commissioning Specialist that coordinates all aspects of the commissioning process. Conform to the commissioning procedures outlined in this specification.

1.2 UNIFIED FACILTIES GUIDE SPECIFICATION REFERENCES

This specification section is intended to work in conjunction with the requirements included in the Unified Facilities Guide Specifications (UFGS) referenced within this specification section. Comply with the requirements of the referenced UFGS to the extent specified herein. UFGS can be found at on the Whole Building Design Guide website at: http://www.wbdg.org/

1.3 SYSTEMS TO BE COMMISSIONED

Commission the following systems:

Heating, Ventilating, Air Conditioning, and Refrigeration Systems (HVAC)
Building Automation System
Utility Monitoring and Control System
Lighting Systems
Service Water Heating Systems
Plumbing Systems
Energy and Water Utility Metering Systems and Sub-Meters

1.4 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 180	(2012) Standard Practice for Inspection and Maintenance of Commercial Building HVAC Systems
ASHRAE 202	(2018) Commissioning Process for Buildings and Systems

ASSOCIATED AIR BALANCE COUNCIL (AABC)

ACG Commissioning Guideline	(2005) Commissioning Guideline

NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB)

NEBB Commissioning Standard	(2009) Procedural Standards for Whole Building Systems Commissioning of New Construction; 3rd Edition

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)

ANSI/SMACNA 014	(2013) HVAC Systems Commissioning Manual, 2nd Edition

U.S. ARMY CORPS OF ENGINEERS (USACE)

ER 25-345-1	(2019) Commissioning -- Systems Manual

1.5 COMMUNICATION WITH THE GOVERNMENT

The Lead Commissioning Specialist (CxC) must submit all plans, schedules, reports, and documentation directly to the Contracting Officer Representative concurrent with submission to the CQC System Manager. The Lead Commissioning Specialist must have direct communication with the Contracting Officer's Representative regarding all elements of the commissioning process; however, the Government has no direct contract authority with the Lead Commissioning Specialist.

1.6 SEQUENCING AND SCHEDULING

1.6.1 Sequencing

Complete the following prior to starting Functional Performance Tests of mechanical systems:

a. All equipment and systems have been completed, cleaned, flushed, disinfected, calibrated, tested, and operate in accordance with contract documents and construction plans and specifications.

b. Performance Verification Tests of the controls systems have been completed and the Performance Verification Test Report has been submitted and approved in accordance with Specification Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

c. Testing, Adjusting, and Balancing has been completed and the Testing, Adjusting, and Balancing Report, has been submitted and approved in accordance with Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC.

d. The building envelope is enclosed according to contract documents with final construction completed.

e. The Pre-Functional Checklists have been submitted and approved.

f. The Certificate of Readiness for mechanical systems has been submitted and approved.

Complete the following prior to starting Functional Performance Tests of the electrical systems:

a. All electrical, power generation, and lighting equipment and systems have been completed, calibrated, tested, and operate in accordance with contract documents and construction plans and specifications.

b. The building envelope is enclosed according to contract documents with final construction completed.

c. Ceiling tiles, floor coverings, and window coverings are in place.

d. The Certificate of Readiness for electrical systems has been submitted and approved.

1.6.2 Project Schedule

Include the following tasks in the project schedule required by the PROJECT SCHEDULE. Ensure sufficient time is scheduled to accommodate the requirements of this specification section. The order of items listed below is not intended to imply a specified sequence:

a. Submission and approval of the Commissioning Firm and Commissioning Specialist

b. Submission and approval of the Testing, Adjusting, and Balancing (TAB) Firm and TAB Specialist specified in Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC

d. Submission of the Design Review Report specified in Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC.

e. Submission and approval of the Construction Phase Commissioning Plan

f. Installation of permanent utilities (gas, water, electric)

j. Drainage and Vent, Building Sewers, Water Supply Systems and Backflow Prevention Assembly Tests specified in Specification Section 22 00 00 PLUMBING, GENERAL PURPOSE

k. Factory Acceptance Testing for each of the systems to be commissioned as required by technical specifications

l. Manufacturer's Equipment Start-Up for each of the systems to be commissioned.

m. Potable Water System Flushing specified in Specification Section 22 00 00 PLUMBING, GENERAL PURPOSE

n. Operational Tests of the plumbing system specified in Specification Section 22 00 00 PLUMBING, GENERAL PURPOSE.

o. Potable Water System Disinfection specified in Specification Section 22 00 00 PLUMBING, GENERAL PURPOSE

p. Submission and approval of the TAB Schematic Drawings, Report Forms, and Procedures specified in Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC.

q. Submission and approval of Duct Air Leakage Test Procedures specified in Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC

r. Duct Air Leakage Test Execution specified in Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC

s. Submission and approval of the Final Duct Air Leakage Test Report specified in Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC

t. Testing, Adjusting, and Balancing (TAB) Field Work required by Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC

u. Submission and approval of the TAB Report specified in Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC

v. TAB Field Acceptance Testing required by Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC

w. Submission and approval of the Start-Up Testing Report specified in Specification Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

x. Submission and approval of the Performance Verification Test Procedures specified in Specification Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

y. Performance Verification Tests required by Specification Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC

z. Performance Verification Test Report specified in Specification Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC

aa. Pre-Functional Checklist Submittal

bb. Functional Performance Testing for each system to be commissioned

dd. Post-Test Deficiency Correction for each system to be commissioned

ee. Re-Testing

gg. Training for each of the systems to be commissioned

hh. Systems Manual, Maintenance Plan, and Service Life Plan submission and approval

ii. Submission and approval of the Commissioning Report

kk. Post-Construction Endurance Testing

ll. Post-Construction Site Visit

1.7 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Commissioning Firm; G, DO

Lead Commissioning Specialist; G, DO

Technical Commissioning Specialists; G, DO

SD-06 Test Reports

Interim Construction Phase Commissioning Plan; G, DO

Final Construction Phase Commissioning Plan; G, DO

Pre-Functional Checklists; G, DO

Issues Log

Commissioning Report; G, DO

SD-07 Certificates

Certificate of Readiness; G, DO

SD-10 Operation and Maintenance Data

Training Plan; G, RO

Training Attendance Rosters; G, RO

Systems Manual; G, DO

Systems Manual G, DO

Maintenance and Service Life Plans; G, DO

SD-11 Closeout Submittals

Final Commissioning Report; S, DO

1.8 COMMISSIONING FIRM

Provide a Commissioning Firm that is certified in commissioning by one of the following: the AABC Commissioning Group (ACG); the National Environmental Balancing Bureau (NEBB); the International Certification Board/Testing, Adjusting, and Balancing Bureau (ICB/TABB), the Building Commissioning Association (BCA); the Association of Energy Engineers (AEE). The Commissioning Firm must be certified in all systems to be commissioned to the extent such certifications are available from the certifying body. Describe any lapses in certification or disciplinary action taken by the certifying body against the proposed Commissioning Firm or Lead Commissioning Specialist in detail. Any firm or commissioning professional that has been the subject of disciplinary action by the certifying body within the five years preceding contract award is not eligible to perform any duties related to commissioning.

a. Submit the Commissioning Firm's certification of qualifications

including the name of the firm and certifications no later than 30 calendar days after Notice to Proceed. Submit one hard copy and an electronic copy.

b. The Commissioning Firm's and Commissioning Specialists' certifications must be maintained for the entire duration of the duties specified herein. If, for any reason, the firm or a specialist loses a certification during this period, immediately notify the Contracting Officer's Representative and submit another Commissioning Firm or Commissioning Specialist for approval. All work specified in this specification section performed by the Commissioning Firm or associated Commissioning Specialists is invalid if the Commissioning Firm or Commissioning Specialist loses its certification prior to contract completion and must be performed by an approved successor.

c. The Commissioning Firm must oversee and assist the General or Prime Contractor with the work specified herein.

1.8.1 Lead Commissioning Specialist

The Commissioning Firm must provide a Lead Commissioning Specialist (CxC) that has a minimum of five years of commissioning experience, including two projects of similar size and complexity, and that is one of the following: a NEBB qualified Systems Commissioning Administrator (SCA); ACG Certified Commissioning Authority (CxA); ICB/TABB Certified Commissioning Supervisor; BCA Certified Commissioning Professional (CCP); AEE Certified Building Commissioning Professional (CBCP); University of Wisconsin-Madison Qualified Commissioning Process Provider (QCxP); Building Commissioning Professional (BCxP).

a. Submit the Lead Commissioning Specialist's certification of qualifications including the name of the specialist and firm; certifications; years of experience; and a listing of representative projects of similar size and complexity no later than 30 calendar days after Notice to Proceed. Submit one hard copy and an electronic copy.

b. The Lead Commissioning Specialists certifications must be maintained for the entire duration of the duties specified herein. If, for any reason, the specialist loses a certification during this period, immediately notify the Contracting Officer's Representative and submit another Lead Commissioning Specialist for approval. All work specified in this specification section to be performed by the Lead Commissioning Specialist is invalid if the Lead Commissioning Specialist loses its certification prior to contract completion and must be performed by an approved successor.

c. The Lead Commissioning Specialist must lead and oversee the commissioning work specified herein and be the primary point of contact for the Government regarding the commissioning work. One of the Technical Commissioning Specialists may be the Lead Commissioning Specialist provided that all of the qualification requirements are met.

1.8.2 Technical Commissioning Specialists

Technical Commissioning Specialists, employed by the Commissioning Firm and that have the following qualifications, must perform the technical work specified herein associated with each system to be commissioned:

a. Mechanical Technical Commissioning Specialist: The technical work associated with mechanical systems including Heating, Ventilating, Air Conditioning, and Refrigeration Systems; Building Automation System; Utility Monitoring and Control System; Service Water Heating Systems; Plumbing Systems; Water Pumping and Mixing Systems; Energy and Water Utility Metering Systems must be performed by a Commissioning Specialist certified by NEBB, ACG, ICB/TABB, or BCA in the commissioning of HVAC systems with five years of experience in the commissioning of HVAC systems.

b. Submit the Technical Commissioning Specialist's certification of qualifications including the name of the specialist and firm; certifications; years of experience; and a listing of representative projects of similar size and complexity no later than 30 calendar days after Notice to Proceed. Submit one hard copy and an electronic copy.

1.8.3 Commissioning Standard

Comply with the requirements of the commissioning standard under which the Commissioning Firm and Specialists qualifications are approved. When the firm and specialists are certified by BCA, AEE, ASHRAE, or the University of Wisconsin-Madison, comply with the requirements of one of the acceptable standards unless otherwise stated herein. The acceptable standards are ACG Commissioning Guideline, NEBB Commissioning Standard, ANSI/SMACNA 014, or ASHRAE 202. Comply with applicable NETA testing standards for electrical systems.

a. Implement all recommendations and suggested practices contained in the Commissioning Standard and electrical test standards.

b. Use the Commissioning Standard for all aspects of Commissioning, including calibration of instruments.

c. Where the instrument manufacturer calibration recommendations are more stringent than those listed in the Commissioning Standard, adhere to the manufacturer calibration recommendations.

d. All quality assurance provisions of the Commissioning Standard such as performance guarantees are part of this contract.

e. The Commissioning Specialists must develop commissioning procedures for any systems or system components not covered in the Commissioning Standard.

f. Use any new requirements, recommendations, and procedures published or adopted prior to contract solicitation by the body responsible for the Commissioning Standard.

1.9 ISSUES LOG

The Lead Commissioning Specialist must develop and maintain an Issues Log for tracking and resolution of all deficiencies discovered through submittal reviews, inspection, and testing. Include the date of final resolution of issues as confirmed by the Commissioning Specialist. Submit the Issues Log on a monthly basis at a minimum. At any point during construction, any commissioning team member finding deficiencies may communicate those deficiencies in writing to the Commissioning Specialist for inclusion into the Issues Log.

Track construction deficiencies identified in the Issues Log using QCS.

1.10 CERTIFICATE OF READINESS

Prior to scheduling Functional Performance Tests for each system, issue a Certificate of Readiness for the system certifying that the system is ready for Functional Performance Testing. The Certificate of Readiness must include, for each system to be commissioned, all equipment and system start-up reports; Performance Verification Test Reports; completed Pre-Functional Checklists; Testing, Adjusting, and Balancing (TAB) Report; HVAC Controls Start-Up Reports to the extent applicable to the system. The Contractor; the Lead Commissioning Specialist; the Contractor's Quality Control Representative; the Mechanical, Electrical, Controls, and TAB subcontractor representatives must sign and date the Certificate of Readiness. Submit the Certificate of Readiness for each system no later than 14 calendar days prior to Functional Performance Tests of that system. Submit one hard copy and an electronic copy. Do not schedule Functional Performance Tests for a system until the Certificate of Readiness for that system receives approval by the Government.

PART 2 PRODUCTS

Not used

PART 3 EXECUTION

3.1 CONSTRUCTION PHASE

3.1.1 Construction Commissioning Coordination Meeting

The Lead Commissioning Specialist must lead a Construction Commissioning Coordination Meeting no later than 14 days after approval of the Commissioning Firm and Commissioning Specialists to discuss the commissioning process including contract requirements, lines of communication, roles and responsibilities, schedules, documentation requirements, inspection and test procedures, and logistics as specified in this specification section. The Contractor's Superintendent or Project Manager, the Contractor's Quality Control Representative, and the Government must attend this meeting. Invite the User and a Base Civil Engineer Office Representative, to attend this meeting.

3.1.2 Construction Phase Commissioning Plan

3.1.2.1 Interim Construction Phase Commissioning Plan

The Lead Commissioning Specialist (CxC) must prepare the Interim Construction Phase Commissioning Plan. Submit the Interim Construction Phase Commissioning Plan no later than 30 calendar days after the Construction Commissioning Coordination Meeting and no later than 14 days prior to the start of construction of the building envelope. Submit one hard copy and an electronic copy.

Identify the commissioning and testing standards and outline the overall commissioning process, the commissioning schedule, the commissioning team members and responsibilities, lines of communication, documentation requirements for the construction phase of the project in the Interim Construction Phase Commissioning Plan.

3.1.2.1.1 Checklists

Download example Pre-Functional Checklists and Functional Performance Test Checklists for specification section 01 91 00.15 10 TOTAL BUILDING COMMISSIONING at the following location: http://www.wbdg.org/ffc/dod/unified-facilities-guide-specifications-ufgs/forms-graphic The checklists submitted in the Interim and Final Construction Phase Commissioning Plans must contain the same level of detail shown in the examples. The submitted checklists are not required to match the format of the examples.

3.1.2.2 Final Construction Phase Commissioning Plan

The Lead Commissioning Specialist (CxC) must prepare the Final Construction Phase Commissioning Plan. Submit the Final Construction Phase Commissioning Plan no later than 30 calendar days prior to the start of Pre-Functional Checks. Submit one hard copy and an electronic copy. Once approved, file the approved plan in the Sustainability eNotebook.

Include the information provided in the Interim Construction Phase Commissioning Plan. In addition, the Technical Commissioning Specialist must develop the Pre-Functional Checklists and Functional Performance Test Checklists for each building, for each system required to be commissioned, and for each component for inclusion in the Final Construction Phase Commissioning Plan.

3.1.2.2.1 Pre-Functional Checklists

The Pre-Functional Checklists must include items for physical inspection or testing that demonstrate that installation and start-up of equipment and systems is complete. Refer to paragraph Pre-Functional Checks for more information.

3.1.2.2.2 Functional Performance Test Checklists

Functional Performance Test Checklists must include procedures that explain, step-by-step, the actions and expected results that will demonstrate that the system performs in accordance with the contract. Refer to paragraph Functional Performance Tests for more information. Include the following sections and details appropriate to the systems being tested in the Functional Performance Test Checklists:

a. Notable system features including information about controls to facilitate understanding of system operation

b. Conclusions and recommendations. Conclusions must clearly indicate if system does or does not perform in accordance with contract requirements. Recommendation must clearly indicate that the system should or should not be accepted by the Government.

c. Test conditions including date, beginning and ending time, and beginning and ending outdoor air conditions

d. Attendees

e. Identification of the equipment involved in the test

f. Control system feature identification

g. Point-to-point observations including demonstrating system flow meters and sensors have been calibrated and are correctly displayed on the Operator work station

h. Actuator operation observations demonstrating actuator responses to commands from the control system

i. As-found condition of the system operation

j. List of test items with step numbers along with the corresponding feature or control operation, intended test procedure, expected system response, and pass/fail indication.

k. Space for comments for each test item.

3.1.3 Construction Submittals

Provide all submittals associated with the systems to be commissioned, including shop drawings; equipment submittals; test plans, procedures, and reports; and resubmittal's to the Commissioning Specialists. The Technical Commissioning Specialist must review the submittals to the extent necessary verify that the equipment and system installation will comply with the contract requirements and the requirements of the Basis of Design and the Owner's Project Requirements Document.

3.1.4 Inspection and Testing

Demonstrate that all system components have been installed, that each control device and item of equipment operates, and that the systems operate and perform, including interactive operation between systems, in accordance with contract documents and the Owner's Project Requirements. Requirements in related specification sections are independent from the requirements of this section and do not satisfy any of the requirements specified in this specification section. Provide all materials, services, and labor required to perform the Pre-Functional Checks and Functional Performance Tests.

3.1.4.1 Commissioning Team

Provide a commissioning representative for each sub-contractor associated with the systems to be commissioned. Each commissioning representative is responsible for coordination of their respective sub-contractor's execution of the commissioning activities and participation in the inspection and testing required by this specification section. The designers listed below are the designers of record for their respective systems. Substitutes must be approved by the Contracting Officer's Representative.

3.1.4.1.1 Mechanical System Pre-Functional Checks Team

The following team members must participate in Pre-Functional checks of mechanical systems:

Designation	Function
CxM	Mechanical System Technical Commissioning Specialist
QAR	Contracting Officer's Quality Assurance Representative
CQC	Contractor's Quality Control Personnel
MC	Contractor's Mechanical Commissioning Representative
EC	Contractor's Electrical Commissioning Representative
CC	Contractor's Controls Commissioning Representative
TABC	Contractor's TAB Commissioning Representative
PC	Contractor's Plumbing Commissioning Representative
IC	Contractor's Irrigation Commissioning Representative

3.1.4.1.2 Electrical System Pre-Functional Checks Team

The following team members must participate in Pre-Functional checks of electrical systems:

Designation	Function
CxE	Electrical System Technical Commissioning Specialist
QAR	Contracting Officer's Quality Assurance Representative
CQC	Contractor's Quality Control Personnel
EC	Contractor's Electrical Commissioning Representative

3.1.4.1.3 Mechanical Systems Test Team

The following team members must participate in Functional Performance of mechanical systems:

Designation	Function
CxM	Mechanical System Technical Commissioning Specialist
QAR	Contracting Officer's Quality Assurance Representative
CQC	Contractor's Quality Control Personnel
MC	Contractor's Mechanical Commissioning Representative

Designation	Function
CC	Contractor's Controls Commissioning Representative
TABC	Contractor's TAB Commissioning Representative
PC	Contractor's Plumbing Commissioning Representative

3.1.4.1.4 Other Pre-Functional and Functional Performance Participants

The following may participate as team members during Pre-Functional Checks and Functional Performance Testing:

Designation	Function
BCE	Base Civil Engineer Office Representative
User	Using Agent's Representative

3.1.4.2 Pre-Functional Checks

Pre-Functional Checklists from the approved Final Construction Phase Commissioning Plan must be completed by the commissioning team. Complete one Pre-Functional Checklist for each individual item of equipment or system for each system required to be commissioned including, but not limited to, ductwork, piping, equipment, fixtures (lighting and plumbing), and controls. Indicate commissioning team member inspection and acceptance of each Pre-Functional Checklist item by initials. Acceptance of each Pre-Functional Checklist item by each team member indicates that item conforms to the construction contract requirements in their area of responsibility. Technical Commissioning Specialist acceptance of each Pre-Functional Checklist item indicates that each item has been installed correctly and in accordance with contract documents and the Owner's Project Requirements. Submit the completed and initialed Pre-Functional Checklists no later than 7 calendar days after completion of inspection of all checklists items for each system. Submit one hard copy and an electronic copy. Include manufacturer start-up checklists associated with equipment with the submission of the Pre-Functional Checklists.

3.1.4.3 Testing, Adjusting, and Balancing (TAB) Report and Field Acceptance Testing

The Mechanical System Technical Commissioning Specialist must review the pre-final TAB Report required by Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC. Identify any deficiencies to the Contracting Officer's Representative and the Contractor's Quality Control Personnel. Resolve all deficiencies prior to TAB Field Acceptance Testing.

The Mechanical System Technical Commissioning Specialist must witness the TAB Field Acceptance Testing specified by Specification Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC. Include a certification by the Mechanical Technical Specialist that no outstanding deficiencies exist in the systems relative to Testing, Adjusting, and Balancing with the final TAB Report submittal.

3.1.4.4 HVAC Controls Test Reports

The Mechanical System Technical Commissioning Specialist must review the Start-Up Testing Report and the PVT Procedures and Reports required by Specification Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC . Include a certification by the Mechanical System Technical Commissioning Specialist that the submittals contain no deficiencies or that the submittals do not indicate any deficiencies in the HVAC systems or HVAC control systems with each of these submittals.

3.1.4.5 Tests

3.1.4.5.1 Functional Performance Tests

Schedule Functional Performance Tests for each system only after the Certificate of Readiness has been approved by the Government for the system. Correct all deficiencies identified through any prior review, inspection, or test activity before the start of Functional Performance Tests.

a. Functional Performance Tests must be performed with the Contracting Officer's Quality Assurance Representative present.

b. Abort Functional Performance Tests when any system deficiency prevents the successful completion of the test.

c. Technical Commissioning Specialists must lead and document all Functional Performance Tests for the systems to be commissioned with the Contractor and appropriate sub-contractors performing the Functional Performance Tests. The representatives listed in the paragraph Commissioning Team must attend the tests. Abort Functional Performance Tests when any required commissioning team member is not present for the test.

3.1.4.5.1.1 Checklist

Use the Functional Performance Test Checklists from the approved Final Construction Phase Commissioning Plan to guide the Functional Performance Tests. Functional Performance Tests must be performed for each item of equipment and each system required to be commissioned and verify all sensor calibrations, control responses, safeties, interlocks, operating modes, sequences of operation, capacities, lighting levels, and all other performance requirements comply with construction contract regardless of the specific items listed within the Functional Performance Test provided. Testing must progress from equipment or components to subsystems to systems to interlocks and connections between systems. The order of components and systems to be tested must be determined by the Technical Commissioning Specialists.

3.1.4.5.1.2 Acceptance

Indicate acceptance of each item of equipment and systems tested by signature of each commissioning team member for each Functional Performance Test. The Contractor's Quality Control Representative and the Technical Commissioning Specialists must indicate acceptance after the equipment and systems are free of deficiencies.

3.1.4.5.2 HVAC Test Methods

Perform Functional Performance Tests in accordance with the following:

3.1.4.5.2.1 Prior to Testing

Prior to testing operating modes, sequences of operation, interlocks, and safeties, complete control point-to-point observations, test sensor calibrations, and test actuator commands.

3.1.4.5.2.2 Simulating Conditions

Over-writing control input values through the controls system is not acceptable, unless approved by the Contracting Officer's Representative. Identify proposed exceptions in a protocol submitted to the Contracting Officer's Representative for approval. Before simulating conditions, overwriting values (if approved), or changing set-points, calibrate all sensors, transducers and devices. Below are several examples of exceptions that would be considered acceptable:

a. When varying static pressures inside ductwork can not be simulated within the duct, and where a sensor signals the controls system to initiate sequences at various duct static pressures, it is acceptable to simulate the various pressures with a Pneumatic Squeeze-Bulb Type Signaling Device with gauge temporarily attached to the sensing tube leading to the transmitter. It is not acceptable to reset the various set-points, nor to simulate an electric analog signal (unless approved as noted above).

b. Dirty filter pressure drops can be simulated using sheets of cardboard at filter face.

c. Freeze-stat safeties can be simulated by packing portion of sensor with ice.

d. High outside air temperatures can be simulated with a hair blower.

e. High entering cooling coil temperatures can be used to simulate entering cooling coil conditions.

f. Do not use signal generators to simulate sensor signals unless approved by the Contracting Officer's Representative, as noted above, for special cases.

g. Control set points can be altered. For example, to see the air conditioning compressor lockout work at an outside air temperature below 55 degrees F, when the outside air temperature is above 55 degrees F, temporarily change the lockout set point to be 0 degrees F above the current outside air temperature. Caution: Set points are not to be raised or lowered to a point such that damage to the components, systems, or the building structure and/or contents will occur.

h. Test duct mounted smoke detectors in accordance with the manufacturer's recommendations. Perform the tests with air system at minimum airflow condition in ductwork.

i. Test current sensing relays used for fan and pump status signals to control system to indicate unit failure and run status by resetting the set point on the relay to simulate a lost belt or unit failure

while the unit is running. Confirm that the failure alarm was generated and received at the control system. After the test is conducted, return the set point to its original set-point or a set-point as indicated by the Contracting Officer's Representative.

3.1.4.5.2.3 Setup

Perform each test under conditions that simulate actual conditions as close as is practically possible. Provide all necessary materials and system modifications to produce the necessary flows, pressures, temperatures, and other conditions necessary to execute the test according to the specified conditions. At completion of the test, return the affected building equipment and systems to their pre-test condition.

3.1.4.5.3 Sample Strategy

Perform Functional Performance Tests using the following sample strategy. Prepare and complete a Functional Performance Test Checklist for each item of equipment or system to be tested. For sample sizes less than 100 percent for all similar equipment, the Government will select the specific equipment or system to be tested during testing. Equipment Identifiers are as indicated on the design drawings:

Equipment Identifier	Sample Size (Percent)
AHU	
FCU	
CH	
CHWP	
EWH	

3.1.4.5.4 Aborted Tests and Re-Testing

Abort Functional Performance Tests or Seasonal Tests if any deficiency prevents successful completion of the test or if any required commissioning team member is not present for the test. Reimburse the Government for all costs associated with effort lost due to re-testing due to test failures and aborted tests. These costs must include salary, travel costs, and per diem for Government commissioning team members. Re-test only after all deficiencies identified during the original tests have been corrected.

3.1.4.5.4.1 100 Percent Sample

Systems or equipment for which 100 percent sample size are tested fail if one or more of the test procedures results in discovery of a deficiency and the deficiency cannot be resolved within 5 minutes during the test.

Re-test to the extent necessary to confirm that the deficiencies have been corrected without negatively impacting the performance of the rest of the system.

3.1.4.5.4.2 Less than 100 Percent Sample

For systems tests with a sample size less than 100 percent, if one or more of the test procedures for an item of equipment or a system results in discovery of a deficiency, regardless of whether the deficiency is corrected during the sample tests, the item of equipment or system fails the test.

a. If the system failure rate is 5 percent or less, meaning that 5 percent or less of the equipment or systems had at least one deficiency, re-test only on the items which experienced the initial failures.

b. If the system failure rate is higher than 5 percent, meaning that more than 5 percent of equipment or systems tested had at least one deficiency, re-test the items which experienced the initial failures to the extent necessary to confirm that the deficiencies have been corrected . In addition, test another random sample of the same size as the initial sample for the first time. If the second random sample set has any failures, re-test those failed items and all remaining equipment and systems to complete 100 percent testing of that system type.

3.1.5 Training Plan

Develop a training plan which identifies all training required by specification sections associated with commissioned systems. Include a matrix listing each training requirement, content of the training, the trainer name, trainer contact information, and schedule and location of training. Submit one hard copy and an electronic copy of the Training Plan to the Commissioning Specialists and the Government no later than 30 calendar days prior to the associated training.

Document training attendance using training attendance rosters and provide completed attendance rosters to the Commissioning Specialists and the Government no later than 7 calendar days following the completion of training for each system to be commissioned. Submit one hard copy and an electronic copy..

3.1.6 Systems Manual

Prepare and submit a Systems Manual including a signed certification or letter from the Technical Commissioning Specalists and the Lead Commissioning Specialist stating that the Systems Manual is complete, clear, and accurate. The Systems Manual, for all commissioned systems, must conform to Appendix A SYSTEMS MANUAL ORGANIZATION AND CONTENT to ER 25-345-1, available at the USACE Publications website at the following location: https://www.publications.usace.army.mil/USACE-Publications/Engineer-Regulations/. Update and resubmit the Systems Manual based on any corrective action taken during the warranty period.

Submit Systems Manual no later than 30 calendar days following completion of Functional Performance Tests. Submit three hard copies and an electronic copy.

3.1.7 Maintenance and Service Life Plans

3.1.7.1 Maintenance Plan

Prepare and submit a Maintenance Plan for the project mechanical, electrical, plumbing, and fire protection systems. Prepare the HVAC and refrigeration sections of the Maintenance Plan in accordance with ASHRAE 180. Develop required inspection and maintenance tasks similar to Section 5 of ASHRAE 180 for the other commissioned systems and fire protection systems.

Submit the Maintenance Plan no later than 30 calendar days following the completion of Functional Performance Tests. Submit three hard copies and an electronic copy.

3.1.7.2 Service Life Plan

Prepare and submit a Service Life Plan for the building envelope, structural systems, and site hardscape that includes the following for each assembly or component:

a. A description of each including the materials or products.

b. The estimated service life, in years.

c. The estimated maintenance frequency and description of maintenance tasks.

d. The point of maintenance access for the components with estimated service life less than service life of the building.

Submit the Service Life Plan no later than 30 calendar days following the completion of Functional Performance Tests. Submit three hard copies and an electronic copy.

3.2 COMMISSIONING REPORT

Following the completion of Functional Performance Tests, with the exception of Seasonal Tests, the Lead Commissioning Specialist must prepare a Commissioning Report.

a. Include an executive summary describing the overall commissioning process, the results of the commissioning process, any outstanding deficiencies and recommended resolutions, and any seasonal testing that must be scheduled for a later date. Indicate, in the executive summary, whether the systems meet the requirements of the construction contract and the Owner's Project Requirements.

b. Detail any deficiencies discovered during the commissioning process and the corrective actions taken in the report. Include the completed Pre-Functional Checklists, Functional Performance Test Checkliststhe Commissioning Plans, the Issues Log, Performance Verification Test Reports, Training Attendance Rosters, the Design Review Report, the final TAB Report.

c. Submit the Commissioning Report no later than 14 calendar days following commissioning team acceptance of all Functional Performance Tests with the exception of Seasonal Tests. Submit three hard copies and an electronic copy.

d. Following any Seasonal Tests or Post-Construction Activities, update the Final Commissioning Report to reflect any changes and resubmit. File the approved, updated, Final Commissioning Report in the Sustainability eNotebook.

APPENDIX A - OWNER'S PROJECT REQUIREMENTS DOCUMENT

OWNER'S PROJECT REQUIREMENTS DOCUMENT

Project: Project, Location, PN #####

Approved:

Name	Design Agent's Representative	Date

Name	Owner's Representative	Date

OWNER'S PROJECT REQUIREMENTS DOCUMENT

Contents

1. Owner and User Requirements
   a. Primary Purpose, Program, and Use
   b. Project History
   c. Broad Goals
      i. Future Expansion
     ii. Flexibility
    iii. Quality of Materials
     iv. Construction Costs
      v. Operational Costs
2. Environmental and Sustainability Goals
   a. LEED or Green Globes Goal
   b. Other
3. Energy Efficiency Goals
   a. Goals/Policy
   b. Systems and Feature Energy Impact
4. Indoor Environmental Quality Requirements
   a. Space Type 1
      i. Intended Use
     ii. Occupancy Schedule
    iii. Environmental Requirements
     iv. Occupant System Control Ability
      v. Type of Lighting
     vi. After-hour Use Accommodation
   b. Space Type 2
      i. Intended Use
     ii. Occupancy Schedule
    iii. Environmental Requirements
     iv. Occupant System Control Ability
      v. Type of Lighting
     vi. After-hour Use Accommodation
5. Equipment and System Expectations
   a. HVAC Systems
      i. Quality and Reliability
     ii. Type
    iii. Automation
     iv. Flexibility
      v. Maintenance Requirements
   b. Lighting Systems
      i. Quality and Reliability
     ii. Type
    iii. Automation
     iv. Flexibility
      v. Maintenance Requirements
   c. Domestic Hot Water Systems
      i. Quality and Reliability
     ii. Type
    iii. Automation
     iv. Flexibility
      v. Maintenance Requirements

Contents (continued)

d. On-site Power Systems
    i. Quality and Reliability
    ii. Type
    iii. Automation
    iv. Flexibility
    v. Maintenance Requirements
e. Other Systems
    i. Quality and Reliability
    ii. Type
    iii. Automation
    iv. Flexibility
    v. Maintenance Requirements

6. Building Occupant and O&M Personnel Requirements
   a. Facility Operation
   b. UMCS (EMCS or FMCS)
   c. Occupant Training and Orientation
   d. O&M Staff Training and Orientation

1. Owner and User Requirements

a. Primary Purpose, Program, and Use

Explain the purpose, program, and use of the facility. (i.e. Army Reserve Center used for training reserve units. Training includes spaces such as weapons, medical, vehicle repair, cooking, etc.)

b. Project History

Explain the history of the project related to design/construction (i.e. D/B/B, D/B, IDIQ, JOC, COE in-house, A/E, etc.). Explain any additional project background that would impact energy/sustainability goals.

c. Broad Goals

i. Future Expansion: Explain goals related to potential future expansion.

ii. Flexibility: Explain goals related to flexibility for layout and use of the building. (i.e. high rate of office churn, expected frequency of renovation, etc.)

iii. Quality of Materials: Explain goals related to quality of materials. (i.e. highest quality materials, 50 yr life, 25 yr life, highest quality within budget, etc.)

iv. Construction Costs: Explain goals related to construction costs. (i.e. how low can you go, set project amount, select simplest systems for low cost, etc.)

v. Operational Costs: Explain goals related to operational costs. (i.e. low utilities based on water and energy conservation, trade-off allowable on maintenance costs to reduce utility cost, utility cost unimportant compared to construction cost, etc.)

2. Environmental and Sustainability Goals

a. LEED/Green Globes Goal

Set LEED/Green Globes goal and explain sustainable features permissible or preferred to be incorporated. Explain relative importance of LEED/Green Globes goal within project scope. Indicate requirement from service or agency specific criteria and policy.

b. Other

Explain any special sustainability or environmental goals associated with the project. Identify specific sustainability features that may be required or desired. (i.e. hydro-power, solar power, on-site water treatment, on-site water infiltration, impervious cover reduction, parking capacity, etc.)

3. Energy Efficiency Goals

a. Goals/Policy

Explain the specific project goals and requirements regarding energy efficiency. Incorporate the requirements of UFC 1-200-02 High Performance and Sustainable Building Requirements and/or other relevant agency policies.

b. Systems and Feature Energy Impacts

Identify and explain envelope, system, or site and building features that will be incorporated to maximize energy efficiency. Identify features that must be incorporated that will reduce or limit energy efficiency.

4. Indoor Environmental Quality Requirements

a. Space Type 1

i. Intended Use: Explain how the space will be used (i.e. classroom occasionally used as conference room).

ii. Occupancy Schedule: Describe the occupancy including number of people at various times (i.e. drill weekend-maximum capacity, weekdays-20 percent; or 0700-0900 - none, 0900-1400 - 30 people, 1400-1600 - none).

iii. Environmental Requirements: Describe the environmental requirements of the space. Include description of temperatures, humidity levels, ventilation rates, air quality, lighting levels, or any other specific parameters desired (i.e. 75 deg F, 50 percent rh, 30 fc, etc.).

iv. Occupant System Control Ability: Describe the desired level of control the occupants will have over the thermal comfort and lighting systems. (i.e. adjustable thermostat for every person, adjustable thermostat in all private offices, no adjustable thermostats, adjustable thermostat in senior rank also controlling other offices, occupancy sensors for lighting, adjustable dimming, etc.)

v. Type of Lighting: Describe the type of lighting desired (i.e. task lighting with minimal overhead, maximize daylight with dimming on overhead, accent lighting, particular fixtures, etc.).

vi. After-hour Use Accommodations: Describe whether and how often the space may be used after hours. Describe the systems that activate when an occupant uses the building after-hours. Describe the level of control of after-hour use HVAC.

(Example: Space is rarely used after-hours by few occupants. HVAC and lighting system should activate when occupants enter after-hours. The HVAC operation will be limited to that required to provide heating, A/C, and ventilation to the occupied space alone.) (Example: Space is rarely used after-hours by few occupants. Lighting and heating systems should activate. Ventilation and cooling should remain in normal after-hour operation.)

b. Space Type 2

5. Equipment and System Expectations

a. HVAC Systems

i. Quality and Reliability: Explain the level of quality and reliability required of the HVAC systems.

(Example: Equipment efficiency should meet ASHRAE and FEMP/Energy Star requirements. Due to critical nature of facility, additional redundancy in the cooling and heating systems is required, i.e. multiple chillers, boilers, and pumps.) (Example: No specific quality or reliability requirements specified. Equipment should remain serviceable over life of building or to the extent typical of the type of equipment.)

ii. Type: Explain the type of equipment desired.

(Example: Boilers should be condensing type. Use hydronic heating and cooling. Use self-contained A/C units in computer rooms.)

iii. Automation: Explain the level of automation in the HVAC System desired.

(Example: Single loop HVAC systems permissible. Use packaged controls only.) (Example: Control HVAC systems from DDC system connected to the base UMCS.) (Example: Boilers should have packaged controls connected to the DDC system.)

iv. Flexibility: Describe the desired level of flexibility of the HVAC system.

(Example: System should accommodate frequent office layout changes including private office wall movement.) (Example: Layout will remain mostly unchanged; no flexibility required.) (Example: Accommodate potential for conference and classrooms to change to offices.)

v. Maintenance Requirements: Describe the level of maintenance available or the requirements of the equipment regarding maintainability.

(Example: Equipment should be located to allow easy maintenance access. Equipment vendors or repair service should be able to respond within 24 hrs.)

b. Lighting Systems

i. Quality and Reliability: Explain the level of quality and reliability required of the lighting system controls.

(Example: The building lighting system should meet ASHRAE 90.1 - IP requirements.)

ii. Type: Explain the type of lighting or control equipment desired.

(Example: High-efficiency fluorescent lamps with high-efficiency ballasts will be specified. Indirect lighting will be used in all office and classroom spaces. Lighting foot-candle levels may be reduced to 45 foot-candles in lieu of the typical 50 foot-candles when indirect lighting is used.)

iii. Automation: Explain the level of automation in the lighting control

system desired.

(Example: Provide occupancy sensors in restrooms, corridors, and storage areas.)

iv. Flexibility: Describe the desired level of flexibility of the lighting system and control systems.

(Example: Provide dual level switching in classrooms and conference rooms.)

v. Maintenance Requirements: Describe the level of maintenance available or the requirements of the equipment regarding maintainability.

(Example:)

c. Domestic Hot Water Systems

i. Quality and Reliability: Explain the level of quality and reliability required of the domestic hot water systems.

(Example: Equipment efficiency should meet ASHRAE and FEMP/Energy Star requirements. Due to critical nature of facility, additional redundancy in the water heating systems is required, i.e. multiple hot water heaters and circulation pumps.) (Example: No specific quality or reliability requirements specified. Equipment should remain serviceable over life of building or to the extent typical of the type of equipment.)

ii. Type: Explain the type of equipment desired.

(Example: Gas-fired storage tank water heater with mixing valve for temperature control.) (Example: Instantaneous electric water heater at lavatories.) (Example: Instantaneous electric water heater with integral control system for eyewash/showers.)

iii. Automation: Explain the level of automation in the domestic hot water control system desired.

(Example: Occupancy schedule control for recirculation loop and gas burner. Connect package controls to DDC system.)

iv. Flexibility: Describe the desired level of flexibility of the domestic hot water systems.

(Example: No anticipated changes to restroom layout; no additional flexibility required.)

v. Maintenance Requirements: Describe the level of maintenance available or the requirements of the equipment regarding maintainability.

(Example: Equipment should be located to allow easy maintenance access. Equipment vendors or repair service should be able to respond within 24 hrs.)

d. On-site Power Systems

i. Quality and Reliability: Explain the level of quality and reliability required of the on-site power system.

ii. Type: Explain the type of on-site power system desired.

iii. Automation: Explain the level of automation in the on-site power system desired.

iv. Flexibility: Describe the desired level of flexibility of the on-site power system.

v. Maintenance Requirements: Describe the level of maintenance available or the requirements of the on-site power system regarding maintainability.

e. Other Systems

i. Quality and Reliability: Explain the level of quality and reliability required of the system.

ii. Type: Explain the type of system desired.

iii. Automation: Explain the level of automation in the system desired.

iv. Flexibility: Describe the desired level of flexibility of the system.

v. Maintenance Requirements: Describe the level of maintenance available or the requirements of the system regarding maintainability.

6. Building Occupant and O&M Personnel Requirements

a. Facility Operation

Describe how the facility will be operated. Who operates the facility? Who maintains the facility? Who pays the utility bills?

b. UMCS (EMCS or FMCS)

Will the building be tied to an UMCS/EMCS/FMCS? What system will be connected to? Provide information regarding connection requirements, protocols, and control, scheduling and monitoring points.

c. Occupant Training and Orientation

How much training and orientation is desired for building occupants? Will training need to be provided for all systems? To what extent do the occupants need to understand and use the systems?

d. O&M Staff Training and Orientation

How much training and orientation is desired for building occupants? Will training need to be provided for all systems? To what extent do the occupants need to understand and use the systems?

APPENDIX B - BASIS OF DESIGN

APPENDIX C - DESIGN PHASE COMMISSIONING PLAN

-- End of Section --

SECTION 02 41 00

DEMOLITION

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO M 145	(1991; R 2012) Standard Specification for Classification of Soils and Soil-Aggregate Mixtures for Highway Construction Purposes

AMERICAN SOCIETY OF SAFETY ENGINEERS (ASSE/SAFE)

ASSE/SAFE A10.6	(2006) Safety Requirements for Demolition Operations

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 385-1-1	(2014) Safety and Health Requirements Manual

U.S. FEDERAL AVIATION ADMINISTRATION (FAA)

FAA AC 70/7460-1	(2016; Rev L; Change 2) Obstruction Marking and Lighting

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

40 CFR 61	National Emission Standards for Hazardous Air Pollutants

1.2 PROJECT DESCRIPTION

1.2.1 Demolition/Deconstruction Plan

Prepare a Demolition Plan and submit proposed salvage, demolition, and removal procedures for approval before work is started. Include in the plan procedures for careful removal and disposition of materials specified to be salvaged, coordination with other work in progress, a disconnection schedule of utility services, and a detailed description of methods and equipment to be used for each operation and of the sequence of operations. Identify components and materials to be salvaged for reuse or recycling with reference to paragraph Existing Facilities to be Removed. Append tracking forms for all removed materials indicating type, quantities, condition, destination, and end use. Coordinate with Waste Management Plan. Provide procedures for safe conduct of the work in accordance with EM 385-1-1. Plan shall be approved by Contracting Officer prior to work beginning.

1.2.2 General Requirements

Do not begin demolition or deconstruction until authorization is received from the Contracting Officer. The work of this section is to be performed in a manner that maximizes the value derived from the salvage and recycling of materials. Remove rubbish and debris from the project site; do not allow accumulations inside or outside the buildings. The work includes demolition, salvage of identified items and materials, and removal of resulting rubbish and debris. Remove rubbish and debris from Government property daily, unless otherwise directed. Store materials that cannot be removed daily in areas specified by the Contracting Officer.

In the interest of occupational safety and health, perform the work in accordance with EM 385-1-1, Section 23, Demolition, and other applicable Sections.

1.3 ITEMS TO REMAIN IN PLACE

Take necessary precautions to avoid damage to existing items to remain in place, to be reused, or to remain the property of the Government. Repair or replace damaged items as approved by the Contracting Officer. Coordinate the work of this section with all other work indicated. Construct and maintain shoring, bracing, and supports as required. Ensure that structural elements are not overloaded. Increase structural supports or add new supports as may be required as a result of any cutting, removal, deconstruction, or demolition work performed under this contract. Repairs, reinforcement, or structural replacement require approval by the Contracting Officer prior to performing such work.

1.3.1 Existing Construction Limits and Protection

Do not disturb existing construction beyond the extent indicated or necessary for installation of new construction. Provide protective measures to control accumulation and migration of dust and dirt in all work areas. Remove dust, dirt, and debris from work areas daily.

1.3.2 Trees

Protect trees within the project site which might be damaged during demolition or deconstruction, and which are indicated to be left in place.

1.3.3 Utility Service

Maintain existing utilities indicated to stay in service and protect against damage during demolition and deconstruction operations.

1.3.4 Facilities

Protect electrical and mechanical services and utilities. Where removal of existing utilities and pavement is specified or indicated, provide approved barricades, temporary covering of exposed areas, and temporary services. Ensure that no elements determined to be unstable are left unsupported and place and secure bracing, shoring, or lateral supports as may be required as a result of any cutting, removal, deconstruction, or demolition work performed under this contract.

1.4 BURNING

The use of burning at the project site for the disposal of refuse and

debris will not be permitted.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Demolition Plan

SD-11 Closeout Submittals

1.6 QUALITY ASSURANCE

Submit timely notification of demolition projects to Federal, State, regional, and local authorities in accordance with 40 CFR 61, Subpart M. Notify the Contracting Officer in writing 10 working days prior to the commencement of work in accordance with 40 CFR 61, Subpart M. Comply with federal, state, and local hauling and disposal regulations. In addition to the requirements of the "Contract Clauses," conform to the safety requirements contained in ASSE/SAFE A10.6. Comply with the Environmental Protection Agency requirements specified. Use of explosives will not be permitted.

1.6.1 Dust and Debris Control

Prevent the spread of dust and debris and avoid the creation of a nuisance or hazard in the surrounding area. Do not use water if it results in hazardous or objectionable conditions such as, but not limited to, ice, flooding, or pollution.

1.7 PROTECTION

1.7.1 Traffic Control Signs

a. Where pedestrian and driver safety is endangered in the area of removal work, use traffic barricades with flashing lights. Notify the Contracting Officer prior to beginning such work.

Provide a minimum of 2 aviation red or high intensity white obstruction lights on temporary structures (including cranes) over 100 feet above ground level. Light construction and installation shall comply with FAA AC 70/7460-1. Lights shall be operational during periods of reduced visibility, darkness, and as directed by the Contracting Officer. Maintain the temporary services during the period of construction and remove only after permanent services have been installed and tested and are in operation.

1.7.2 Protection of Personnel

Before, during and after the demolition work continuously evaluate the condition of the structure being demolished and take immediate action to protect all personnel working in and around the project site. No area, section, or component of floors, roofs, walls, columns, pilasters, or

other structural element will be allowed to be left standing without sufficient bracing, shoring, or lateral support to prevent collapse or failure while workmen remove debris or perform other work in the immediate area.

1.8 RELOCATIONS

Perform the removal and reinstallation of relocated items as indicated with workmen skilled in the trades involved. Repair or replace items to be relocated which are damaged by the Contractor with new undamaged items as approved by the Contracting Officer.

1.9 EXISTING CONDITIONS

Before beginning any demolition or deconstruction work, survey the site and examine the drawings and specifications to determine the extent of the work. Record existing conditions in the presence of the Contracting Officer showing the condition of structures and other facilities adjacent to areas of alteration or removal. Photographs sized 4 inch will be acceptable as a record of existing conditions. Include in the record the elevation of the top of foundation walls, finish floor elevations, possible conflicting electrical conduits, plumbing lines, alarms systems, the location and extent of existing cracks and other damage and description of surface conditions that exist prior to before starting work. It is the Contractor's responsibility to verify and document all required outages which will be required during the course of work, and to note these outages on the record document.

PART 2 PRODUCTS

2.1 FILL MATERIAL

a. Comply with excavating, backfilling, and compacting procedures for soils used as backfill material to fill voids, depressions or excavations resulting from demolition of structures.

b. Fill material shall conform to the definition of satisfactory soil material as defined in AASHTO M 145, Soil Classification Groups A-1, A-2-4, A-2-5 and A-3. In addition, fill material shall be free from roots and other organic matter, trash, debris, frozen materials, and stones larger than 2 inches in any dimension.

PART 3 EXECUTION

3.1 EXISTING FACILITIES TO BE REMOVED

Inspect and evaluate existing structures onsite for reuse. Existing construction scheduled to be removed for reuse shall be disassembled. Dismantled and removed materials are to be separated, set aside, and prepared as specified, and stored or delivered to a collection point for reuse, remanufacture, recycling, or other disposal, as specified.

3.1.1 Structures

a. Remove existing structures indicated to be removed to 4 feet below grade.

b. Demolish structures in a systematic manner from the top of the structure to the ground. Complete demolition work above each tier or

floor before the supporting members on the lower level are disturbed. Demolish concrete and masonry in small sections.

3.1.2 Utilities and Related Equipment

3.1.2.1 General Requirements

Do not interrupt existing utilities serving occupied or used facilities, except when authorized in writing by the Contracting Officer. Do not interrupt existing utilities serving facilities occupied and used by the Government except when approved in writing and then only after temporary utility services have been approved and provided. Do not begin demolition or deconstruction work until all utility disconnections have been made. Shut off and cap utilities for future use, as indicated.

3.1.2.2 Disconnecting Existing Utilities

Remove existing utilities, as indicated and terminate in a manner conforming to the nationally recognized code covering the specific utility and approved by the Contracting Officer. When utility lines are encountered but are not indicated on the drawings, notify the Contracting Officer prior to further work in that area.

3.1.3 Chain Link Fencing

Remove chain link fencing, gates and other related salvaged items scheduled for removal and transport off site.

3.1.4 Paving and Slabs

Remove sawcut concrete and asphaltic concrete paving and slabs including aggregate base to a depth of 6 inches below new finish grade. Provide neat sawcuts at limits of pavement removal as indicated. Pavement and slabs not to be used in this project shall be removed from the Installation at Contractor's expense.

3.1.5 Concrete

Saw concrete along straight lines to a depth of a minimum 2 inch. Make each cut in walls perpendicular to the face and in alignment with the cut in the opposite face. Break out the remainder of the concrete provided that the broken area is concealed in the finished work, and the remaining concrete is sound. At locations where the broken face cannot be concealed, grind smooth or saw cut entirely through the concrete.

3.1.6 Electrical Equipment and Fixtures

3.1.6.1 Electrical Devices

Remove and salvage switches, switchgear, transformers, conductors including wire and nonmetallic sheathed and flexible armored cable, regulators, meters, instruments, plates, circuit breakers, panelboards, outlet boxes, and similar items. Box and tag these items for identification according to type and size.

3.1.6.2 Wiring Ducts or Troughs

Remove and salvage wiring ducts or troughs. Dismantle plug-in ducts and wiring troughs into unit lengths. Remove plug-in or disconnecting devices

from the busway and store separately.

3.1.6.3 Conduit and Miscellaneous Items

Salvage conduit except where embedded in concrete or masonry. Consider corroded, bent, or damaged conduit as scrap metal. Sort straight and undamaged lengths of conduit according to size and type. Classify supports, knobs, tubes, cleats, and straps as debris to be removed and disposed.

3.1.7 Items With Unique/Regulated Disposal Requirements

Remove and dispose of items with unique or regulated disposal requirements in the manner dictated by law or in the most environmentally responsible manner.

3.2 DISPOSITION OF MATERIAL

3.2.1 Title to Materials

Except for salvaged items specified in related Sections, and for materials or equipment scheduled for salvage, all materials and equipment removed and not reused or salvaged, shall become the property of the Contractor and shall be removed from Government property. Title to materials resulting from demolition and deconstruction, and materials and equipment to be removed, is vested in the Contractor upon approval by the Contracting Officer of the Contractor's demolition, deconstruction, and removal procedures, and authorization by the Contracting Officer to begin demolition and deconstruction. The Government will not be responsible for the condition or loss of, or damage to, such property after contract award. Showing for sale or selling materials and equipment on site is prohibited.

3.2.2 Reuse of Materials and Equipment

Remove and store materials and equipment listed in the Demolition Plan to be reused or relocated to prevent damage, and reinstall as the work progresses.

3.2.3 Salvaged Materials and Equipment

Remove materials and equipment that are listed in the Demolition Plan to be removed by the Contractor and that are to remain the property of the Government, and deliver to a storage site, as directed by the Contracting Officer.

a. Salvage items and material to the maximum extent possible.

b. Store all materials salvaged for the Contractor as approved by the Contracting Officer and remove from Government property before completion of the contract. On site sales of salvaged material is prohibited.

c. Remove salvaged items to remain the property of the Government in a manner to prevent damage, and packed or crated to protect the items from damage while in storage or during shipment. Items damaged during removal or storage must be repaired or replaced to match existing items. Properly identify the contents of containers.

d. Remove historical items in a manner to prevent damage. Deliver the following historical items to the Government for disposition: Corner stones, contents of corner stones, and document boxes wherever located on the site.

3.2.4 Unsalvageable and Non-Recyclable Material

Dispose of unsalvageable and non-recyclable noncombustible material off Government property.

3.3 CLEANUP

Remove debris and rubbish from basement and similar excavations. Remove and transport the debris in a manner that prevents spillage on streets or adjacent areas. Apply local regulations regarding hauling and disposal.

3.4 DISPOSAL OF REMOVED MATERIALS

3.4.1 Regulation of Removed Materials

Dispose of debris, rubbish, scrap, and other nonsalvageable materials resulting from removal operations with all applicable federal, state and local regulations as contractually specified.

3.4.2 Burning on Government Property

Burning of materials removed from demolished and deconstructed structures will not be permitted on Government property.

3.4.3 Removal from Government Property

Transport waste materials removed from demolished and deconstructed structures, except waste soil, from Government property for legal disposal. Dispose of waste soil as directed.

3.5 REUSE OF SALVAGED ITEMS

Replace items damaged during removal and salvage operations or restore them as necessary to usable condition.

-- End of Section --

SECTION 03 30 00

CAST-IN-PLACE CONCRETE
02/19, CHG 3: 11/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN CONCRETE INSTITUTE (ACI)

ACI 117	(2010; Errata 2011) Specifications for Tolerances for Concrete Construction and Materials and Commentary
ACI 121R	(2008) Guide for Concrete Construction Quality Systems in Conformance with ISO 9001
ACI 301	(2016) Specifications for Structural Concrete
ACI 302.1R	(2015) Guide for Concrete Floor and Slab Construction
ACI 304.2R	(2017) Guide to Placing Concrete by Pumping Methods
ACI 304R	(2000; R 2009) Guide for Measuring, Mixing, Transporting, and Placing Concrete
ACI 305R	(2020) Guide to Hot Weather Concreting
ACI 306R	(2016) Guide to Cold Weather Concreting
ACI 308.1	(2011) Specification for Curing Concrete
ACI SP-2	(2007; Abstract: 10th Edition) ACI Manual of Concrete Inspection
ACI SP-15	(2011) Field Reference Manual: Standard Specifications for Structural Concrete ACI 301-05 with Selected ACI References

ASTM INTERNATIONAL (ASTM)

ASTM A184/A184M	(2019) Standard Specification for Welded Deformed Steel Bar Mats for Concrete Reinforcement
ASTM A615/A615M	(2020) Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement

ASTM A934/A934M	(2016) Standard Specification for Epoxy-Coated Prefabricated Steel Reinforcing Bars
ASTM C31/C31M	(2021a) Standard Practice for Making and Curing Concrete Test Specimens in the Field
ASTM C33/C33M	(2018) Standard Specification for Concrete Aggregates
ASTM C39/C39M	(2021) Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens
ASTM C42/C42M	(2020) Standard Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete
ASTM C78/C78M	(2021) Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Third-Point Loading)
ASTM C94/C94M	(2021b) Standard Specification for Ready-Mixed Concrete
ASTM C136/C136M	(2019) Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates
ASTM C143/C143M	(2020) Standard Test Method for Slump of Hydraulic-Cement Concrete
ASTM C150/C150M	(2021) Standard Specification for Portland Cement
ASTM C172/C172M	(2017) Standard Practice for Sampling Freshly Mixed Concrete
ASTM C173/C173M	(2016) Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method
ASTM C231/C231M	(2017a) Standard Test Method for Air Content of Freshly Mixed Concrete by the Pressure Method
ASTM C260/C260M	(2010a; R 2016) Standard Specification for Air-Entraining Admixtures for Concrete
ASTM C311/C311M	(2018) Standard Test Methods for Sampling and Testing Fly Ash or Natural Pozzolans for Use in Portland-Cement Concrete
ASTM C330/C330M	(2017a) Standard Specification for Lightweight Aggregates for Structural Concrete
ASTM C494/C494M	(2019) Standard Specification for Chemical Admixtures for Concrete

ASTM C595/C595M	(2021) Standard Specification for Blended Hydraulic Cements
ASTM C618	(2019) Standard Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete
ASTM C845/C845M	(2018) Standard Specification for Expansive Hydraulic Cement
ASTM C989/C989M	(2018a) Standard Specification for Slag Cement for Use in Concrete and Mortars
ASTM C1012/C1012M	(2018b) Standard Test Method for Length Change of Hydraulic-Cement Mortars Exposed to a Sulfate Solution
ASTM C1017/C1017M	(2013; E 2015) Standard Specification for Chemical Admixtures for Use in Producing Flowing Concrete
ASTM C1077	(2017) Standard Practice for Agencies Testing Concrete and Concrete Aggregates for Use in Construction and Criteria for Testing Agency Evaluation
ASTM C1157/C1157M	(2020a) Standard Performance Specification for Hydraulic Cement
ASTM C1218/C1218M	(2020c) Standard Test Method for Water-Soluble Chloride in Mortar and Concrete
ASTM C1240	(2020) Standard Specification for Silica Fume Used in Cementitious Mixtures
ASTM C1260	(2021) Standard Test Method for Potential Alkali Reactivity of Aggregates (Mortar-Bar Method)
ASTM C1293	(2008; R 2015) Standard Test Method for Determination of Length Change of Concrete Due to Alkali-Silica Reaction
ASTM C1567	(2021) Standard Test Method for Potential Alkali-Silica Reactivity of Combinations of Cementitious Materials and Aggregate (Accelerated Mortar-Bar Method)
ASTM C1602/C1602M	(2018) Standard Specification for Mixing Water Used in Production of Hydraulic Cement Concrete
ASTM D3042	(2017) Standard Test Method for Insoluble Residue in Carbonate Aggregates
ASTM D5759	(2012; R 2020) Characterization of Coal Fly Ash and Clean Coal Combustion Fly Ash for Potential Uses

ASTM E329	(2021) Standard Specification for Agencies Engaged in Construction Inspection, Testing, or Special Inspection

CONCRETE REINFORCING STEEL INSTITUTE (CRSI)

CRSI 10MSP	(2018) Manual of Standard Practice
CRSI RB4.1	(2016) Supports for Reinforcement Used in Concrete

U.S. ARMY CORPS OF ENGINEERS (USACE)

COE CRD-C 104	(1980) Method of Calculation of the Fineness Modulus of Aggregate

U.S. GREEN BUILDING COUNCIL (USGBC)

LEED NC	(2009) Leadership in Energy and Environmental Design(tm) New Construction Rating System

1.2 DEFINITIONS

a. "Cementitious material" as used herein must include all portland cement, pozzolan, fly ash, slag cement.

b. "Exposed to public view" means situated so that it can be seen from eye level from a public location after completion of the building. A public location is accessible to persons not responsible for operation or maintenance of the building.

c. "Chemical admixtures" are materials in the form of powder or fluids that are added to the concrete to give it certain characteristics not obtainable with plain concrete mixes.

d. "Supplementary cementing materials" (SCM) include coal fly ash, slag cement, natural or calcined pozzolans, and ultra-fine coal ash when used in such proportions to replace the portland cement that result in improvement to sustainability and durability and reduced cost.

e. "Design strength" (f'c) is the specified compressive strength of concrete at time(s) specified in this section to meet structural design criteria.

f. "Mass Concrete" is any concrete system that approaches a maximum temperature of 158 degrees F within the first 72 hours of placement. In addition, it includes all concrete elements with a section thickness of 3 feet or more regardless of temperature.

g. "Mixture proportioning" is the process of designing concrete mixture proportions to enable it to meet the strength, service life and constructability requirements of the project while minimizing the initial and life-cycle cost.

h. "Mixture proportions" are the masses or volumes of individual ingredients used to make a unit measure (cubic meter or cubic yard) of concrete.

i. "Pozzolan" is a siliceous or siliceous and aluminous material, which in itself possesses little or no cementitious value but will, in finely divided form and in the presence of moisture, chemically react with calcium hydroxide at ordinary temperatures to form compounds possessing cementitious properties.

j. "Workability (or consistence)" is the ability of a fresh (plastic) concrete mix to fill the form/mould properly with the desired work (vibration) and without reducing the concrete's quality. Workability depends on water content, chemical admixtures, aggregate (shape and size distribution), cementitious content and age (level of hydration).

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Quality Control Plan; G

Quality Control Personnel Certifications; G

Quality Control Organizational Chart

Laboratory Accreditation; G

SD-02 Shop Drawings

FormworkReinforcing Steel; G

SD-03 Product Data

Cementitious Materials; (LEED NC)

Concrete Curing Materials

Reinforcement; (LEED NC)

Admixtures

Pumping Concrete

SD-04 Samples

SD-05 Design Data

Concrete Mix Design; G

SD-06 Test Reports

Concrete Mix Design; G

Fly Ash

Pozzolan

Slag Cement

Aggregates

Compressive Strength Tests; G

Air Content

Slump Tests

Water

SD-07 Certificates

Reinforcing Bars

VOC Content for Form Release Agents, Curing Compounds, and Concrete Penetrating Sealers

Safety Data Sheets

Field Testing Technician and Testing Agency

SD-08 Manufacturer's Instructions

Curing Compound

1.4 MODIFICATION OF REFERENCES

Accomplish work in accordance with ACI publications except as modified herein. Consider the advisory or recommended provisions to be mandatory. Interpret reference to the "Building Official," the "Structural Engineer," and the "Architect/Engineer" to mean the Contracting Officer.

1.5 DELIVERY, STORAGE, AND HANDLING

Follow ACI 301, ACI 304R and ASTM A934/A934M requirements and recommendations. Do not deliver concrete until reinforcement, embedded items, and chamfer strips are in place and ready for concrete placement. Do not store concrete curing compounds or sealers with materials that have a high capacity to adsorb volatile organic compound (VOC) emissions. Do not store concrete curing compounds or sealers in occupied spaces.

1.5.1 Reinforcement

Store reinforcement of different sizes and shapes in separate piles or racks raised above the ground to avoid excessive rusting. Protect from contaminants such as grease, oil, and dirt. Ensure bar sizes can be accurately identified after bundles are broken and tags removed.

1.6 QUALITY ASSURANCE

1.6.1 Design Data

1.6.1.1 Concrete Mix Design

Sixty days minimum prior to concrete placement, submit a mix design for each strength and type of concrete. Submit a complete list of materials

including type; brand; source and amount of cement, supplementary cementitious materials, , and admixtures; and applicable reference specifications. Submit mill test and all other test for cement, supplementary cementitious materials, aggregates, and admixtures. Provide documentation of maximum nominal aggregate size, gradation analysis, percentage retained and passing sieve, and a graph of percentage retained verses sieve size. Provide mix proportion data using at least three different water-cementitious material ratios for each type of mixture, which produce a range of strength encompassing those required for each type of concrete required. If source material changes, resubmit mix proportion data using revised source material. Provide only materials that have been proven by trial mix studies to meet the requirements of this specification, unless otherwise approved in writing by the Contracting Officer. Indicate clearly in the submittal where each mix design is used when more than one mix design is submitted. Resubmit data on concrete components if the qualities or source of components changes. For previously approved concrete mix designs used within the past twelve months, the previous mix design may be re-submitted without further trial batch testing if accompanied by material test data conducted within the last six months. Obtain mix design approval from the contracting officer prior to concrete placement.

1.6.2 Shop Drawings

1.6.2.1 Reinforcing Steel

Indicate bending diagrams, assembly diagrams, splicing and laps of bars, shapes, dimensions, and details of bar reinforcing, accessories, and concrete cover. Do not scale dimensions from structural drawings to determine lengths of reinforcing bars. Reproductions of contract drawings are unacceptable.

1.6.3 Control Submittals

1.6.3.1 Concrete Curing Plan

Submit proposed materials, methods and duration for curing concrete elements in accordance with ACI 308.1.

1.6.3.2 Pumping Concrete

Submit proposed materials and methods for pumping concrete. Submittal must include mix designs, pumping equipment including type of pump and size and material for pipe, and maximum length and height concrete is to be pumped.

1.6.3.3 VOC Content for form release agents, curing compounds, and concrete penetrating sealers

Submit certification for the form release agent, curing compounds, and concrete penetrating sealers that indicate the VOC content of each product.

1.6.3.4 Safety Data Sheets

Submit Safety Data Sheets (SDS) for all materials that are regulated for hazardous health effects. SDS must be readily accessible during each work shift to employees when they are at the construction site.

1.6.4 Test Reports

1.6.4.1 Fly Ash and Pozzolan

Submit test results in accordance with ASTM C618 for fly ash and pozzolan. Submit test results performed within 6 months of submittal date.

1.6.4.2 Slag Cement

Submit test results in accordance with ASTM C989/C989M for slag cement. Submit test results performed within 6 months of submittal date.

1.6.4.3 Aggregates

Submit test results in accordance with ASTM C33/C33M, or ASTM C330/C330M for lightweight aggregate, and ASTM C1293 or ASTM C1567 as required in the paragraph titled ALKALI-AGGREGATE REACTION.

1.6.5 Field Samples

1.6.6 Quality Control Plan

Develop and submit for approval a concrete quality control program in accordance with the guidelines of ACI 121R and as specified herein. The plan must include approved laboratories. Provide direct oversight for the concrete qualification program inclusive of associated sampling and testing. All quality control reports must be provided to the Contracting Officer, Quality Manager and Concrete Supplier. Maintain a copy of ACI SP-15 and CRSI 10MSP at project site.

1.6.7 Quality Control Personnel Certifications

The Contractor must submit for approval the responsibilities of the various quality control personnel, including the names and qualifications of the individuals in those positions and a quality control organizational chart defining the quality control hierarchy and the responsibility of the various positions. Quality control personnel must be employed by the Contractor.

Submit American Concrete Institute certification for the following:

a. CQC personnel responsible for inspection of concrete operations.

b. Lead Foreman or Journeyman of the Concrete Placing, Finishing, and Curing Crews.

c. Field Testing Technicians: ACI Concrete Field Testing Technician, Grade I.

1.6.7.1 Quality Manager Qualifications

The quality manager must hold a current license as a professional engineer in a U.S. state or territory with experience on at least five similar projects. Evidence of extraordinary proven experience may be considered by the Contracting Officer as sufficient to act as the Quality Manager.

1.6.7.2 Field Testing Technician and Testing Agency

Submit data on qualifications of proposed testing agency and technicians

for approval by the Contracting Officer prior to performing testing on concrete.

a. Work on concrete under this contract must be performed by an ACI Concrete Field Testing Technician Grade 1 qualified in accordance with ACI SP-2 or equivalent. Equivalent certification programs must include requirements for written and performance examinations as stipulated in ACI SP-2.

b. Testing agencies that perform testing services on reinforcing steel must meet the requirements of ASTM E329.

c. Testing agencies that perform testing services on concrete materials must meet the requirements of ASTM C1077.

1.6.8 Laboratory Qualifications for Concrete Qualification Testing

The concrete testing laboratory must have the necessary equipment and experience to accomplish required testing. The laboratory must meet the requirements of ASTM C1077 and be Cement and Concrete Reference Laboratory (CCRL) inspected.

1.6.9 Laboratory Accreditation

Laboratory and testing facilities must be provided by and at the expense of the Contractor. The laboratories performing the tests must be accredited in accordance with ASTM C1077, including ASTM C78/C78M and ASTM C1260. The accreditation must be current and must include the required test methods, as specified. Furthermore, the testing must comply with the following requirements:

a. Aggregate Testing and Mix Proportioning: Aggregate testing and mixture proportioning studies must be performed by an accredited laboratory and under the direction of a registered professional engineer in a U.S. state or territory competent in concrete materials who is competent in concrete materials and must sign all reports and designs.

b. Acceptance Testing: Furnish all materials, labor, and facilities required for molding, curing, testing, and protecting test specimens at the site and in the laboratory. Furnish and maintain boxes or other facilities suitable for storing and curing the specimens at the site while in the mold within the temperature range stipulated by ASTM C31/C31M.

c. Contractor Quality Control: All sampling and testing must be performed by an approved, onsite, independent, accredited laboratory.

PART 2 PRODUCTS

2.1 FORMWORK MATERIALS

a. Form-facing material in contact with concrete must be plywood. Submit product information on proposed form-facing materials.

2.2 CONCRETE MATERIALS

2.2.1 Cementitious Materials

2.2.1.1 Portland Cement

a. Unless otherwise specified, provide cement that conforms to ASTM C150/C150M Type I/II .

b. Use one brand and type of cement for formed concrete having exposed-to-view finished surfaces.

c. For portland cement manufactured in a kiln fueled by hazardous waste, maintain a record of source for each batch.

d. Submit information along with evidence demonstrating compliance with referenced standards. Submittals must include types of cementitious materials, manufacturing locations, shipping locations, and certificates showing compliance.

e. Cementitious materials must be stored and kept dry and free from contaminants.

2.2.1.2 Fly Ash

a. ASTM C618, Class F, except that the maximum allowable loss on ignition must not exceed 3 percent.

b. If fly ash is used it shall range from 15 to 20 percent by weight of cementitious material, provided the fly ash does not reduce the amount of cement in the concrete mix below the minimum requirements of local building codes. Where the use of fly ash cannot meet the minimum level,it shall not be used. Report the chemical analysis of the fly ash in accordance with ASTM C311/C311M. Evaluate and classify fly ash in accordance with ASTM D5759.

2.2.1.3 Slag Cement

ASTM C989/C989M, Grade 100.

2.2.1.4 Silica Fume

Silica fume must conform to ASTM C1240, including the optional limits on reactivity with cement alkalis. Silica fume may be furnished as a dry, densified material or as slurry. Proper mixing is essential to accomplish proper distribution of the silica fume and avoid agglomerated silica fume which can react with the alkali in the cement resulting in premature and extensive concrete damage. Supervision at the batch plant, finishing, and curing is essential. Provide at the Contractor's expense the services of a manufacturer's technical representative, experienced in mixing, proportioning, placement procedures, and curing of concrete containing silica fume. This representative must be present on the project prior to and during at least the first 4 days of concrete production and placement using silica fume. A High Range Water Reducing admixture (HRWRA) must be used with silica fume.

2.2.1.5 Other Supplementary Cementitious Materials

Natural pozzolan must be raw or calcined and conform to ASTM C618, Class

N, including the optional requirement for uniformity.

Ultra Fine Fly Ash (UFFA) and Ultra Fine Pozzolan (UFP) must conform to ASTM C618, Class F or N, and the following additional requirements:

a. The strength activity index at 28 days of age must be at least 95 percent of the control specimens.

b. The average particle size must not exceed 6 microns.

c. The sum of SiO2 + Al2O3 + Fe2O3 must be greater than 77 percent.

2.2.2 Water

a. Water or ice must comply with the requirements of ASTM C1602/C1602M.

b. Minimize the amount of water in the mix. Improve workability by adjusting the grading of the aggregate and using admixture rather than by adding water.

c. Water must be potable ; free from injurious amounts of oils, acids, alkalis, salts, organic materials, or other substances deleterious to concrete.

d. Protect mixing water and ice from contamination during storage and delivery.

e. Submit test report showing water complies with ASTM C1602/C1602M.

2.2.3 Aggregate

2.2.3.1 Normal-Weight Aggregate

a. Aggregates must conform to ASTM C33/C33M .

b. Aggregates used in concrete must be obtained from the same sources and have the same size range as aggregates used in concrete represented by submitted field test records or used in trial mixtures.

c. Provide sand that is at least 50 percent acid insoluble based on ASTM D3042.

d. Store and handle aggregate in a manner that will avoid segregation and prevents contamination by other materials or other sizes of aggregates. Store aggregates in locations that will permit them to drain freely. Do not use aggregates that contain frozen lumps.

e. Submit types, pit or quarry locations, producers' names, aggregate supplier statement of compliance with ASTM C33/C33M, and ASTM C1293 expansion data not more than 18 months old.

2.2.4 Admixtures

a. Chemical admixtures must conform to ASTM C494/C494M.

b. Air-entraining admixtures must conform to ASTM C260/C260M.

c. Chemical admixtures for use in producing flowing concrete must conform to ASTM C1017/C1017M.

d. Do not use calcium chloride admixtures.

e. Use a corrosion-inhibiting admixture for concrete classified under exposure category C1 .

f. Admixtures used in concrete must be the same as those used in the concrete represented by submitted field test records or used in trial mixtures.

g. Protect stored admixtures against contamination, evaporation, or damage.

h. To ensure uniform distribution of constituents, provide agitating equipment for admixtures used in the form of suspensions or unstable solutions. Protect liquid admixtures from freezing and from temperature changes that would adversely affect their characteristics.

i. Submit types, brand names, producers' names, manufacturer's technical data sheets, and certificates showing compliance with standards required herein.

2.3 MISCELLANEOUS MATERIALS

2.3.1 Concrete Curing Materials

Provide concrete curing material in accordance with ACI 301 Section 5 and ACI 308.1 Section 2. Submit product data for concrete curing compounds. Submit manufactures instructions for placement of curing compound.

2.4 CONCRETE MIX DESIGN

2.4.1 Properties and Requirements

a. Use materials and material combinations listed in this section and the contract documents.

b. Cementitious material content must be adequate for concrete to satisfy the specified requirements for strength, w/cm, durability, and finishability described in this section and the contract documents.

The minimum cementitious material content for concrete used in floors must meet the following requirements:

Nominal maximum size of aggregate, in.	Minimum cementitious material content, pounds per cubic yard
1-1/2	470
1	520
3/4	540
3/8	610

c. Selected target slump must meet the requirements this section, the contract documents, and must not exceed 9 in. Concrete must not show

visible signs of segregation.

d. The target slump must be enforced for the duration of the project. Determine the slump by ASTM C143/C143M. Slump tolerances must meet the requirements of ACI 117.

e. The nominal maximum size of coarse aggregate for a mixture must not exceed three-fourths of the minimum clear spacing between reinforcement, one-fifth of the narrowest dimension between sides of forms, or one-third of the thickness of slabs or toppings.

f. Concrete must be air entrained for members assigned to Exposure Class F1, F2, or F3. The total air content must be in accordance with the requirements of the paragraph titled DURABILITY.

g. Measure air content at the point of delivery in accordance with ASTM C173/C173M or ASTM C231/C231M.

h. Concrete for slabs to receive a hard-troweled finish must not contain an air-entraining admixture or have a total air content greater than 3 percent.

i. Concrete properties and requirements for each portion of the structure are specified in the table below. Refer to the paragraph titled DURABILITY for more details on exposure categories and their requirements.

	Minimum *f'c* psi	**Exposure Categories^**	**Miscellaneous Requirements**
Footings	3500 at 28 days	S0 ; C1 ; W0 ; F1	Max. slump: 6 in. Nominal maximum aggregate size must be 1 in.

2.4.2 Durability

2.4.2.1 Alkali-Aggregate Reaction

Do not use any aggregate susceptible to alkali-carbonate reaction (ACR). Use one of the three options below for qualifying concrete mixtures to reduce the potential of alkali-silica reaction (ASR):

a. For each aggregate used in concrete, the expansion result determined in accordance with ASTM C1293 must not exceed 0.04 percent at one year.

b. For each aggregate used in concrete, the expansion result of the aggregate and cementitious materials combination determined in accordance with ASTM C1567 must not exceed 0.10 percent at an age of 16 days.

2.4.2.2 Freezing and Thawing Resistance

a. Provide concrete meeting the following requirements based on exposure

class assigned to members for freezing-and-thawing exposure in Contract Documents:

Exposure class	Maximum *w/cm**	Minimum *f'c*, psi	Air content	Additional Requirements
F1	0.55	3500	Depends on aggregate size	N/A

*The maximum *w/cm* limits do not apply to lightweight concrete.

b. Concrete must be air entrained for members assigned to Exposure Class F1, F2, or F3. The total air content must meet the requirements of the following table:

Nominal maximum aggregate size, in.	Total air content, percent*^	
	Exposure Class F2 and F3	Exposure Class F1
3/8	7.5	6.0
1/2	7.0	5.5
3/4	6.0	5.0
1	6.0	4.5
1-1/2	5.5	4.5
2	5.0	4.0
3	5.5	3.5

*Tolerance on air content as delivered must be plus/minus 1.5 percent.
^For f'c greater than 5000 psi, reducing air content by 1.0 percentage point is acceptable.

c. Submit documentation verifying compliance with specified requirements.

d. For sections of the structure that are assigned Exposure Class F3, submit certification on cement composition verifying that concrete mixture meets the requirements of the following table:

Cementitious material	Maximum percent of total cementitious material by mass*
Fly ash or other pozzolans conforming to ASTM C618	25
Slag cement conforming to ASTM C989/C989M	50

Cementitious material	Maximum percent of total cementitious material by mass*
Silica fume conforming to ASTM C1240	10
Total of fly ash or other pozzolans, slag cement, and silica fume	50^
Total of fly ash or other pozzolans and silica fume	35^

*Total cementitious material also includes ASTM C150/C150M, ASTM C595/C595M, ASTM C845/C845M, and ASTM C1157/C1157M cement. The maximum percentages above must include:
i. Fly ash or other pozzolans present in ASTM C1157/C1157M or ASTM C595/C595M Type IP blended cement.
ii. Slag cement present in ASTM C1157/C1157M or ASTM C595/C595M Type IS blended cement.
iii. Silica fume conforming to ASTM C1240 present in ASTM C1157/C1157M or ASTM C595/C595M Type IP blended cement.
^Fly ash or other pozzolans and silica fume must constitute no more than 25 percent and 10 percent, respectively, of the total mass of the cementitious materials.

2.4.2.3 Corrosion and Chloride Content

a. Provide concrete meeting the requirements of the following table based on the exposure class assigned to members requiring protection against reinforcement corrosion in Contract Documents.

b. Submit documentation verifying compliance with specified requirements.

c. Water-soluble chloride ion content contributed from constituents including water, aggregates, cementitious materials, and admixtures must be determined for the concrete mixture by ASTM C1218/C1218M at age between 28 and 42 days.

d. The maximum water-soluble chloride ion (Cl-) content in concrete, percent by mass of cement is as follows:

Exposure class	Maximum *w/cm**	Minimum f'c, psi	Maximum water-soluble chloride ion (CL-) content in concrete, percent by mass of cement
Reinforced concrete			
C0	N/A	2500	1.00
C1	N/A	3500	0.30
C2	0.4	5000	0.15
Prestressed concrete			

*The maximum w/cm limits do not apply to lightweight concrete.

2.4.2.4 Sulfate Resistance

a. Provide concrete meeting the requirements of the following table based on the exposure class assigned to members for sulfate exposure.

Exposure class	Maximum w/cm	Minimum f'c, psi	Required cementitious materials-types			Calcium chloride admixture
			ASTM C150/C150M	ASTM C595/C595M	ASTM C1157/C1157M	
S0	0.45	3500	N/A	N/A	N/A	No restrictions
S1	0.50	4000	II*^	IP(MS); IS(<70)(MS); IT(MS)	MS	No restrictions
S2	0.45	4500	IV^	IP(HS); IS(<70)(HS); IT(HS)	HS	Not permitted
S3	0.45	4500	V + pozzolan or slag cement**	IP(HS)+ pozzolan or slag cement^; IS (<70)(HS) + pozzolan or slag cement^; IT (HS) + pozzolan or slag cement**	HS + pozzolan or slag cement**	Not permitted

* For seawater exposure, other types of portland cements with tricalcium aluminate (C3A) contents up to 10 percent are acceptable if the w/cm does not exceed 0.40.
** The amount of the specific source of the pozzolan or slag cement to be used shall be at least the amount determined by test or service record to improve sulfate resistance when used in concrete containing Type V cement. Alternatively, the amount of the specific source of the pozzolan or slag used shall not be less than the amount tested in accordance with ASTM C1012/C1012M and meeting the requirements maximum expansion requirements listed herein.
^ Other available types of cement, such as Type III or Type I, are acceptable in exposure classes S1 or S2 if the C3A contents are less than 8 or 5 percent, respectively.

b. The maximum w/cm limits for sulfate exposure do not apply to lightweight concrete.

c. Alternative combinations of cementitious materials of those listed in this paragraph are acceptable if they meet the maximum expansion requirements listed in the following table:

Exposure class	Maximum expansion when tested using ASTM C1012/C1012M		
	At 6 months	At 12 months	At 18 months
S1	0.10 percent	N/A	N/A
S2	0.05 percent	0.10 percent^	N/A
S3	N/A	N/A	0.10 percent

^The 12-month expansion limit applies only when the measured expansion exceeds the 6-month maximum expansion limit.

2.4.3 Trial Mixtures

Trial mixtures must be in accordance to ACI 301.

2.5 REINFORCEMENT

a. Bend reinforcement cold. Fabricate reinforcement in accordance with fabricating tolerances of ACI 117.

b. When handling and storing coated reinforcement, use equipment and methods that do not damage the coating. If stored outdoors for more than 2 months, cover coated reinforcement with opaque protective material.

c. Submit manufacturer's certified test report for reinforcement.

d. Submit placing drawings showing fabrication dimensions and placement locations of reinforcement and reinforcement supports. Placing drawings must indicate locations of splices, lengths of lap splices, and details of mechanical and welded splices.

e. Submit request with locations and details of splices not indicated in Contract Documents.

f. Submit request to place column dowels without using templates.

g. Submit request and procedure to field-bend or straighten reinforcing bars partially embedded in concrete at locations not indicated in Contract Documents.

h. Submit request for field cutting, including location and type of bar to be cut and reason field cutting is required.

2.5.1 Reinforcing Bars

a. Reinforcing bars must be deformed, except spirals, load-transfer dowels, and welded wire reinforcement, which may be plain.

b. ASTM A615/A615M with the bars marked S, Grade 60 c. Submit mill certificates for reinforcing bars.

2.5.1.1 Bar Mats

a. Bar mats must conform to ASTM A184/A184M.

2.5.2 Reinforcing Bar Supports

a. Provide reinforcement support types within structure as required by Contract Documents. Reinforcement supports must conform to CRSI RB4.1. Submit description of reinforcement supports and materials for fastening coated reinforcement if not in conformance with CRSI RB4.1.

Legs of supports in contact with formwork must be hot-dip galvanized, or plastic coated after fabrication, or stainless-steel bar supports.

PART 3 EXECUTION

3.1 EXAMINATION

a. Do not begin installation until substrates have been properly constructed; verify that substrates are level.

b. If substrate preparation is the responsibility of another installer, notify Contracting Officer of unsatisfactory preparation before processing.

c. Check field dimensions before beginning installation. If dimensions vary too much from design dimensions for proper installation, notify Contracting Officer and wait for instructions before beginning installation.

3.2 PREPARATION

Determine quantity of concrete needed and minimize the production of excess concrete. Designate locations or uses for potential excess concrete before the concrete is poured.

3.2.1 General

a. Surfaces against which concrete is to be placed must be free of debris, loose material, standing water, snow, ice, and other deleterious substances before start of concrete placing.

b. Remove standing water without washing over freshly deposited concrete. Divert flow of water through side drains provided for such purpose.

3.2.2 Subgrade Under Foundations and Footings

a. When subgrade material is semi-porous and dry, sprinkle subgrade surface with water as required to eliminate suction at the time concrete is deposited, or seal subgrade surface by covering surface with specified vapor retarder.

b. When subgrade material is porous, seal subgrade surface by covering surface with specified vapor retarder.

3.2.3 Reinforcement and Other Embedded Items

a. Secure reinforcement, joint materials, and other embedded materials in position, inspected, and approved before start of concrete placing.

b. When concrete is placed, reinforcement must be free of materials deleterious to bond. Reinforcement with rust, mill scale, or a combination of both will be considered satisfactory, provided minimum

nominal dimensions, nominal weight, and minimum average height of deformations of a hand-wire-brushed test specimen are not less than applicable ASTM specification requirements.

3.3 FORMS

a. Provide forms for concrete placement. Set forms mortar-tight and true to line and grade.

b. Chamfer above grade exposed joints, edges, and external corners of concrete 0.75 inch. Place chamfer strips in corners of formwork to produce beveled edges on permanently exposed surfaces. Do not bevel reentrant corners or edges of formed joints of concrete.

At construction joints, lap form-facing materials over the concrete of previous placement. Ensure formwork is placed against hardened concrete so offsets at construction joints conform to specified tolerances.

3.3.1 Coating

a. Cover formwork surfaces with an acceptable material that inhibits bond with concrete.

b. If formwork release agent is used, apply to formwork surfaces in accordance with manufacturer's recommendations before placing reinforcement. Remove excess release agent on formwork prior to concrete placement.

c. Do not allow formwork release agent to contact reinforcement or hardened concrete against which fresh concrete is to be placed.

3.3.2 Forms for Standard Rough Form Finish

Provide formwork in accordance with ACI 301 Section 5 with a surface finish, SF-1.0, for formed surfaces that are to be concealed by other construction.

3.4 PLACING REINFORCEMENT AND MISCELLANEOUS MATERIALS

a. Unless otherwise specified, placing reinforcement and miscellaneous materials must be in accordance to ACI 301. Provide bars, welded wire reinforcement, wire ties, supports, and other devices necessary to install and secure reinforcement.

b. Reinforcement must not have rust, scale, oil, grease, clay, or foreign substances that would reduce the bond. Rusting of reinforcement is a basis of rejection if the effective cross-sectional area or the nominal weight per unit length has been reduced. Remove loose rust prior to placing steel. Tack welding is prohibited.

c. Nonprestressed cast-in-place concrete members must have concrete cover for reinforcement given in the following table:

Concrete Exposure	Member	Reinforcement	Specified cover, in.
Cast against and permanently in contact with ground	All	All	3
Exposed to weather or in contact with ground	All	No. 6 through No. 18 bars	2
		No. 5 bar, W31 or D31 wire, and smaller	1-1/2
Not exposed to weather or in contact with ground	Slabs, joists, and walls	No. 14 and No. 18 bars	1-1/2
		No. 11 bar and smaller	3/4
	Beams, columns, pedestals, and tension ties	Primary reinforcement, stirrups, ties, spirals, and hoops	1-1/2

d. Cast-in-place prestressed concrete members must have concrete cover for reinforcement, ducts, and end fittings given in the following table:

Concrete	Member	Reinforcement	Specified
Cast against and permanently in contact with ground	All	All	3
Exposed to weather or in contact with ground	Slabs, joists, and walls	All	1
	All other	All	1-1/2

Concrete	Member	Reinforcement	Specified
Not exposed to weather or in contact with ground	Slabs, joists, and walls	All	3/4
	Beams, columns, and tension ties	Primary reinforcement	1-1/2
		Stirrups, ties, spirals, and hoops	1

e. Precast nonprestressed or prestressed concrete members manufactured under plant conditions must have concrete cover for reinforcement, ducts, and end fittings given in the following table:

Concrete Exposure	Member	Reinforcement	Specified cover, in.
Exposed to weather or in contact with ground	Walls	No. 14 and No. 18 bars; tendons larger than 1-1/2 in. diameter	1-1/2
		No. 11 bars and smaller; W31 and D31 wire, and smaller; tendons and strands 1-1/2 in.	3/4
	All other	No. 14 and No. 18 bars; tendons larger than 1-1/2 in.	2
		No. 6 through No. 11 bars; tendons and strands larger than 5/8 in. diameter through 1-1/2 in.	1-1/2
		No. 5 bar, W31 or D31 wire, and smaller; tendons and strands 5/8 in. diameter and smaller	1-1/4

Concrete Exposure	Member	Reinforcement	Specified cover, in.
Not exposed to weather or in contact with ground	Slabs, joists, and walls	No. 14 and No. 18 bars; tendons larger than 1-1/2 in. diameter	1-1/4
		Tendons and strands 1-1/2 in. diameter and smaller	3/4
		No. 11 bar, W31 or D31	5/8
	Beams, columns, pedestals, and tension ties	Primary reinforcement	Greater of bar diameter and 5/8 and need not exceed 1-1/2
		Stirrups, ties, spirals, and hoops	3/8

3.4.1 General

Provide details of reinforcement that are in accordance with the Contract Documents.

3.4.2 Reinforcement Supports

Provide reinforcement support in accordance with CRSI RB4.1 and ACI 301 Section 3 requirements. Supports for coated or galvanized bars must also be coated with electrically compatible material for a distance of at least

2 inches beyond the point of contact with the bars.

3.4.3 Splicing

As indicated in the Contract Documents. For splices not indicated follow ACI 301. Do not splice at points of maximum stress.

3.4.4 Future Bonding

Plug exposed, threaded, mechanical reinforcement bar connectors with a greased bolt. Provide bolt threads that match the connector. Countersink the connector in the concrete. Caulk the depression after the bolt is installed.

3.4.5 Setting Miscellaneous Material

Place and secure anchors and bolts, pipe sleeves, conduits, and other such items in position before concrete placement and support against displacement. Plumb anchor bolts and check location and elevation. Temporarily fill voids in sleeves with readily removable material to prevent the entry of concrete.

3.4.6 Fabrication

Shop fabricate reinforcing bars to conform to shapes and dimensions indicated for reinforcement, and as follows:

a. Provide fabrication tolerances that are in accordance with ACI 117.

b. Provide hooks and bends that are in accordance with the Contract Documents.

Reinforcement must be bent cold to shapes as indicated. Bending must be done in the shop. Rebending of a reinforcing bar that has been bent incorrectly is not be permitted. Bending must be in accordance with standard approved practice and by approved machine methods.

Deliver reinforcing bars bundled, tagged, and marked. Tags must be metal with bar size, length, mark, and other information pressed in by machine. Marks must correspond with those used on the placing drawings.

Do not use reinforcement that has any of the following defects:

a. Bar lengths, depths, and bends beyond specified fabrication tolerances

b. Bends or kinks not indicated on drawings or approved shop drawings

c. Bars with reduced cross-section due to rusting or other cause

Replace defective reinforcement with new reinforcement having required shape, form, and cross-section area.

3.4.7 Placing Reinforcement

Place reinforcement in accordance with ACI 301.

For slabs on grade (over earth or over capillary water barrier) and for footing reinforcement, support bars or welded wire reinforcement on precast concrete blocks, spaced at intervals required by size of

reinforcement, to keep reinforcement the minimum height specified above the underside of slab or footing.

For slabs other than on grade, supports for which any portion is less than 1 inch from concrete surfaces that are exposed to view or to be painted must be of precast concrete units, plastic-coated steel, or stainless steel protected bar supports. Precast concrete units must be wedge shaped, not larger than 3-1/2 by 3-1/2 inches, and of thickness equal to that indicated for concrete protection of reinforcement. Provide precast units that have cast-in galvanized tie wire hooked for anchorage and blend with concrete surfaces after finishing is completed.

Provide reinforcement that is supported and secured together to prevent displacement by construction loads or by placing of wet concrete, and as follows:

a. Provide supports for reinforcing bars that are sufficient in number and have sufficient strength to carry the reinforcement they support, and in accordance with ACI 301 and CRSI 10MSP. Do not use supports to support runways for concrete conveying equipment and similar construction loads.

b. Equip supports on ground and similar surfaces with sand-plates.

c. Support welded wire reinforcement as required for reinforcing bars.

d. Secure reinforcements to supports by means of tie wire. Wire must be black, soft iron wire, not less than 16 gage.

e. Reinforcement must be accurately placed, securely tied at intersections, and held in position during placing of concrete by spacers, chairs, or other approved supports. Point wire-tie ends away from the form. Unless otherwise indicated, numbers, type, and spacing of supports must conform to the Contract Documents.

f. Bending of reinforcing bars partially embedded in concrete is permitted only as specified in the Contract Documents.

3.4.8 Spacing of Reinforcing Bars

a. Spacing must be as indicated in the Contract Documents.

b. Reinforcing bars may be relocated to avoid interference with other reinforcement, or with conduit, pipe, or other embedded items. If any reinforcing bar is moved a distance exceeding one bar diameter or specified placing tolerance, resulting rearrangement of reinforcement is subject to preapproval by the Contracting Officer.

3.4.9 Concrete Protection for Reinforcement

Additional concrete protection must be in accordance with the Contract Documents.

3.5 BATCHING, MEASURING, MIXING, AND TRANSPORTING CONCRETE

In accordance with ASTM C94/C94M, ACI 301, ACI 302.1R and ACI 304R, except as modified herein. Batching equipment must be such that the concrete ingredients are consistently measured within the following tolerances: 1 percent for cement and water, 2 percent for aggregate, and 3 percent for

admixtures. Furnish mandatory batch ticket information for each load of ready mix concrete.

3.5.1 Measuring

Make measurements at intervals as specified in paragraphs SAMPLING and TESTING.

3.5.2 Mixing

a. Mix concrete in accordance with ASTM C94/C94M, ACI 301 and ACI 304R.

b. Machine mix concrete. Begin mixing within 30 minutes after the cement has been added to the aggregates. Place concrete within 90 minutes of either addition of mixing water to cement and aggregates or addition of cement to aggregates if the concrete temperature is less than 84 degrees F.

c. Place concrete within 60 minutes if the concrete temperature is greater than 84 degrees F except as follows: if set retarding admixture is used and slump requirements can be met, limit for placing concrete may remain at 90 minutes. Additional water may be added, provided that both the specified maximum slump and submitted water-cementitious material ratio are not exceeded and the required concrete strength is still met. When additional water is added, an additional 30 revolutions of the mixer at mixing speed is required.

d. If the entrained air content falls below the specified limit, add a sufficient quantity of admixture, within the manufacturer's recommended dosage, to bring the entrained air content within the specified limits. Dissolve admixtures in the mixing water and mix in the drum to uniformly distribute the admixture throughout the batch. Do not reconstitute concrete that has begun to solidify.

e. When fibers are used, add fibers together with the aggregates and never as the first component in the mixer. Fibers must be dispensed into the mixing system using appropriate dispensing equipment and procedure as recommended by the manufacturer.

3.5.3 Transporting

Transport concrete from the mixer to the forms as rapidly as practicable. Prevent segregation or loss of ingredients. Clean transporting equipment thoroughly before each batch. Do not use aluminum pipe or chutes. Remove concrete which has segregated in transporting and dispose of as directed.

3.6 PLACING CONCRETE

Place concrete in accordance with ACI 301 Section 5. Concrete shall be placed within 15 minutes of discharge into non-agitating equipment.

3.6.1 Footing Placement

Concrete for footings may be placed in excavations without forms upon inspection and approval by the Contracting Officer. Excavation width must be a minimum of 4 inches greater than indicated.

3.6.2 Pumping

ACI 304R and ACI 304.2R. Pumping must not result in separation or loss of materials nor cause interruptions sufficient to permit loss of plasticity between successive increments. Loss of slump in pumping equipment must not exceed 2 inches at discharge/placement. Do not convey concrete through pipe made of aluminum or aluminum alloy. Avoid rapid changes in pipe sizes. Limit maximum size of course aggregate to 33 percent of the diameter of the pipe. Limit maximum size of well-rounded aggregate to 40 percent of the pipe diameter. Take samples for testing at both the point of delivery to the pump and at the discharge end.

3.6.3 Cold Weather

Cold weather concrete must meet the requirements of ACI 301 unless otherwise specified. Do not allow concrete temperature to decrease below 50 degrees F. Obtain approval prior to placing concrete when the ambient temperature is below 40 degrees F or when concrete is likely to be subjected to freezing temperatures within 24 hours. Cover concrete and provide sufficient heat to maintain 50 degrees F minimum adjacent to both the formwork and the structure while curing. Limit the rate of cooling to 37 degrees F in any 1 hour and 50 degrees F per 24 hours after heat application.

3.6.4 Hot Weather

Hot weather concrete must meet the requirements of ACI 301 unless otherwise specified. Maintain required concrete temperature using Figure 4.2 in ACI 305R to prevent the evaporation rate from exceeding 0.2 pound of water per square foot of exposed concrete per hour. Cool ingredients before mixing or use other suitable means to control concrete temperature and prevent rapid drying of newly placed concrete. Shade the fresh concrete as soon as possible after placing. Start curing when the surface of the fresh concrete is sufficiently hard to permit curing without damage. Provide water hoses, pipes, spraying equipment, and water hauling equipment, where job site is remote to water source, to maintain a moist concrete surface throughout the curing period. Provide burlap cover or other suitable, permeable material with fog spray or continuous wetting of the concrete when weather conditions prevent the use of either liquid membrane curing compound or impervious sheets. For vertical surfaces, protect forms from direct sunlight and add water to top of structure once concrete is set.

3.6.5 Bonding

Surfaces of set concrete at joints, must be roughened and cleaned of laitance, coatings, loose particles, and foreign matter. Roughen surfaces in a manner that exposes the aggregate uniformly and does not leave laitance, loosened particles of aggregate, nor damaged concrete at the surface.

Obtain bonding of fresh concrete that has set as follows:

a. At joints between footings and walls or columns, between walls or columns and the beams or slabs they support, and elsewhere unless otherwise specified; roughened and cleaned surface of set concrete must be dampened, but not saturated, immediately prior to placing of fresh concrete.

b. At joints in exposed-to-view work; at vertical joints in walls; at joints near midpoint of span in girders, beams, supported slabs, other structural members; in work designed to contain liquids; the roughened and cleaned surface of set concrete must be dampened but not saturated and covered with a cement grout coating.

c. Provide cement grout that consists of equal parts of portland cement and fine aggregate by weight with not more than 6 gallons of water per sack of cement. Apply cement grout with a stiff broom or brush to a minimum thickness of 1/16 inch. Deposit fresh concrete before cement grout has attained its initial set.

3.7 WASTE MANAGEMENT

Provide as specified in the Waste Management Plan and as follows.

3.7.1 Mixing Equipment

Before concrete pours, designate Contractor-owned site meeting environmental standards for cleaning out concrete mixing trucks. Minimize water used to wash equipment.

3.7.2 Reinforcing Steel

Collect reinforcing steel and place in designated area for recycling.

3.7.3 Other Waste

Identify concrete manufacturer's or supplier's policy for collection or return of construction waste, unused material, deconstruction waste, and/or packaging material.

3.8 SURFACE FINISHES EXCEPT FLOOR, SLAB, AND PAVEMENT FINISHES

3.8.1 Defects

Repair surface defects in accordance with ACI 301 Section 5.

3.8.2 Formed Surfaces

3.8.2.1 Tolerances

Tolerances in accordance with ACI 117 and as indicated.

3.8.2.2 As-Cast Rough Form

Provide for surfaces not exposed to public view a surface finish SF-1.0. Patch holes and defects in accordance with ACI 301.

3.8.2.3 Standard Smooth Finish

Provide for surfaces exposed to public view a surface finish SF-3.0. Patch holes and defects in accordance with ACI 301.

3.9 JOINTS

3.9.1 Construction Joints

Make and locate joints not indicated so as not to impair strength and

appearance of the structure, as approved. Joints must be perpendicular to main reinforcement. Reinforcement must be continued and developed across construction joints. Locate construction joints as follows:

3.9.1.1 Construction Joints for Constructability Purposes

a. In top of footing.

Provide keyways at least 1-1/2-inches deep in construction joints in walls and slabs and between walls and footings; approved bulkheads may be used for slabs.

3.10 CURING AND PROTECTION

Curing and protection in accordance with ACI 301 Section 5, unless otherwise specified. Begin curing immediately following form removal. Avoid damage to concrete from vibration created by blasting, pile driving, movement of equipment in the vicinity, disturbance of formwork or protruding reinforcement, and any other activity resulting in ground vibrations. Protect concrete from injurious action by sun, rain, flowing water, frost, mechanical injury, tire marks, and oil stains. Do not allow concrete to dry out from time of placement until the expiration of the specified curing period. Do not use membrane-forming compound on surfaces where appearance would be objectionable, on any surface to be painted, where coverings are to be bonded to the concrete, or on concrete to which other concrete is to be bonded. If forms are removed prior to the expiration of the curing period, provide another curing procedure specified herein for the remaining portion of the curing period. Provide moist curing for those areas receiving liquid chemical sealer, hardener, or epoxy coating. Allow curing compound/sealer installations to cure prior to the installation of materials that adsorb VOCs.

3.10.1 Curing Unformed Surfaces

a. Accomplish initial curing of unformed surfaces by membrane curing.

3.10.2 Temperature of Concrete During Curing

When temperature of atmosphere is 41 degrees F and below, maintain temperature of concrete at not less than 55 degrees F throughout concrete curing period or 45 degrees F when the curing period is measured by maturity. When necessary, make arrangements before start of concrete placing for heating, covering, insulation, or housing as required to maintain specified temperature and moisture conditions for concrete during curing period.

When the temperature of atmosphere is 80 degrees F and above or during other climatic conditions which cause too rapid drying of concrete, make arrangements before start of concrete placing for installation of wind breaks, of shading, and for fog spraying, wet sprinkling, or moisture-retaining covering of light color as required to protect concrete during curing period.

Changes in temperature of concrete must be uniform and not exceed 37 degrees F in any 1 hour nor 80 degrees F in any 24-hour period.

3.10.3 Protection from Mechanical Injury

During curing period, protect concrete from damaging mechanical disturbances, particularly load stresses, heavy shock, and excessive vibration and from damage caused by rain or running water.

3.10.4 Protection After Curing

Protect finished concrete surfaces from damage by construction operations.

3.11 FIELD QUALITY CONTROL

3.11.1 Aggregate Testing

3.11.1.1 Fine Aggregate

At least once during each shift when the concrete plant is operating, there shall be one sieve analysis and fineness modulus determination in accordance with ASTM C136/C136M and COE CRD-C 104 for the fine aggregate or for each fine aggregate if it is batched in more than one size or classification. The location at which samples are taken may be selected by the Contractor as the most advantageous for control. However, the Contractor is responsible for delivering fine aggregate to the mixer within specification limits. When the amount passing on any sieve is outside the specification limits, the fine aggregate shall be immediately resampled and retested. If there is another failure on any sieve, the fact shall be immediately reported to the Contracting Officer, concreting shall be stopped, and immediate steps taken to correct the grading.

3.11.1.2 Coarse Aggregate

At least once during each shift in which the concrete plant is operating, there shall be a sieve analysis in accordance with ASTM C136/C136M for each size of coarse aggregate. The location at which samples are taken may be selected by the Contractor as the most advantageous for production control. However, the Contractor shall be responsible for delivering the aggregate to the mixer within specification limits. A test record of samples of aggregate taken at the same locations shall show the results of the current test as well as the average results of the five most recent tests including the current test. The Contractor may adopt limits for control coarser than the specification limits for samples taken other than as delivered to the mixer to allow for degradation during handling. When the amount passing any sieve is outside the specification limits, the coarse aggregate shall be immediately resampled and retested. If the second sample fails on any sieve, that fact shall be reported to the Contracting Officer. Where two consecutive averages of 5 tests are outside specification limits, the operation shall be considered out of control and reported to the Contracting Officer. Concreting shall be stopped and immediate steps shall be taken to correct the grading.

3.11.2 Concrete Sampling

ASTM C172/C172M. Collect samples of fresh concrete to perform tests specified. ASTM C31/C31M for making test specimens.

3.11.3 Concrete Testing

3.11.3.1 Slump Tests

ASTM C143/C143M. Take concrete samples during concrete placement/discharge. The maximum slump may be increased as specified with the addition of an approved admixture provided that the water-cementitious material ratio is not exceeded. Perform tests at commencement of concrete placement, when test cylinders are made, and for each batch (minimum) or every 20 cubic yards (maximum) of concrete.

3.11.3.2 Temperature Tests

Test the concrete delivered and the concrete in the forms. Perform tests in hot or cold weather conditions (below 50 degrees F and above 80 degrees F) for each batch (minimum) or every 20 cubic yards (maximum) of concrete, until the specified temperature is obtained, and whenever test cylinders and slump tests are made.

3.11.3.3 Compressive Strength Tests

ASTM C39/C39M. Make six 6 inch by 12 inch test cylinders for each set of tests in accordance with ASTM C31/C31M, ASTM C172/C172M and applicable requirements of ACI 305R and ACI 306R. Take precautions to prevent evaporation and loss of water from the specimen. Test two cylinders at 7 days, two cylinders at 28 days, and hold two cylinder in reserve. Take samples for strength tests of each mix design of and for concrete placed each day not less than once a day, nor less than once for each 100 cubic yards of concrete for the first 500 cubic yards, then every 500 cubic yards thereafter, nor less than once for each 5400 square feet of surface area for slabs or walls. For the entire project, take no less than five sets of samples and perform strength tests for each mix design of concrete placed. Each strength test result must be the average of two cylinders from the same concrete sample tested at 28 days. Concrete compressive tests must meet the requirements of this section, the Contract Document, and ACI 301. Retest locations represented by erratic core strengths. Where retest does not meet concrete compressive strength requirements submit a mitigation or remediation plan for review and approval by the contracting officer. Repair core holes with nonshrink grout. Match color and finish of adjacent concrete.

3.11.3.4 Air Content

ASTM C173/C173M or ASTM C231/C231M for normal weight concrete . Test air-entrained concrete for air content at the same frequency as specified for slump tests.

3.11.3.5 Strength of Concrete Structure

The strength of the concrete structure will be considered to be deficient if any of the following conditions are identified:

a. Failure to meet compressive strength tests as evaluated.

b. Reinforcement not conforming to requirements specified.

c. Concrete which differs from required dimensions or location in such a manner as to reduce strength.

d. Concrete curing and protection of concrete against extremes of temperature during curing, not conforming to requirements specified.

e. Concrete subjected to damaging mechanical disturbances, particularly load stresses, heavy shock, and excessive vibration.

f. Poor workmanship likely to result in deficient strength.

Where the strength of the concrete structure is considered deficient submit a mitigation or remediation plan for review and approval by the contracting officer.

3.11.3.6 Non-Conforming Materials

Factors that indicate that there are non-conforming materials include (but not limited to) excessive compressive strength, inadequate compressive strength, excessive slump, excessive voids and honeycombing, concrete delivery records that indicate excessive time between mixing and placement, or excessive water was added to the mixture during delivery and placement. Any of these indicators alone are sufficient reason for the Contracting Officer to request additional sampling and testing.

Investigations into non-conforming materials must be conducted at the Contractor's expense. The Contractor must be responsible for the investigation and must make written recommendations to adequately mitigate or remediate the non-conforming material. The Contracting Officer may accept, accept with reduced payment, require mitigation, or require removal and replacement of non-conforming material at no additional cost to the Government.

3.11.3.7 Testing Concrete Structure for Strength

When there is evidence that strength of concrete structure in place does not meet specification requirements or there are non-conforming materials, make cores drilled from hardened concrete for compressive strength determination in accordance with ASTM C42/C42M, and as follows:

a. Take at least three representative cores from each member or area of concrete-in-place that is considered potentially deficient. Location of cores will be determined by the Contracting Officer.

b. Test cores after moisture conditioning in accordance with ASTM C42/C42M if concrete they represent is more than superficially wet under service.

c. Air dry cores, (60 to 80 degrees F with relative humidity less than 60 percent) for 7 days before test and test dry if concrete they represent is dry under service conditions.

d. Strength of cores from each member or area are considered satisfactory if their average is equal to or greater than 85 percent of the 28-day design compressive strength of the class of concrete.

Fill core holes solid with patching mortar and finished to match adjacent concrete surfaces.

Correct concrete work that is found inadequate by core tests in a manner approved by the Contracting Officer.

3.12 REPAIR, REHABILITATION AND REMOVAL

Before the Contracting Officer accepts the structure the Contractor must inspect the structure for cracks, damage and substandard concrete placements that may adversely affect the service life of the structure. A report documenting these defects must be prepared which includes recommendations for repair, removal or remediation must be submitted to the Contracting Officer for approval before any corrective work is accomplished.

3.12.1 Repair of Weak Surfaces

Weak surfaces are defined as mortar-rich, rain-damaged, uncured, or containing exposed voids or deleterious materials. Concrete surfaces with weak surfaces less than 1/4 inch thick must be diamond ground to remove the weak surface. Surfaces containing weak surfaces greater than 1/4 inch thick must be removed and replaced or mitigated in a manner acceptable to the Contracting Officer.

3.12.2 Failure of Quality Assurance Test Results

Proposed mitigation efforts by the Contractor must be approved by the Contracting Officer prior to proceeding.

-- End of Section --

SECTION 04 20 00

UNIT MASONRY
11/15, CHG 2: 05/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN CONCRETE INSTITUTE (ACI)

ACI SP-66	(2004) ACI Detailing Manual

ASTM INTERNATIONAL (ASTM)

ASTM A153/A153M	(2016a) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
ASTM A615/A615M	(2020) Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement
ASTM A951/A951M	(2011) Standard Specification for Steel Wire for Masonry Joint Reinforcement
ASTM A996/A996M	(2016) Standard Specification for Rail-Steel and Axle-Steel Deformed Bars for Concrete Reinforcement
ASTM C129	(2017) Standard Specification for Nonloadbearing Concrete Masonry Units
ASTM C207	(2018) Standard Specification for Hydrated Lime for Masonry Purposes
ASTM C270	(2019a; E 2019) Standard Specification for Mortar for Unit Masonry
ASTM C476	(2020) Standard Specification for Grout for Masonry
ASTM C494/C494M	(2019) Standard Specification for Chemical Admixtures for Concrete
ASTM C641	(2017) Standard Test Method for Iron Staining Materials in Lightweight Concrete Aggregates
ASTM C780	(2020) Standard Test Method for Preconstruction and Construction Evaluation of Mortars for Plain and Reinforced Unit Masonry

ASTM C1019	(2019) Standard Test Method for Sampling and Testing Grout
ASTM C1384	(2012a) Standard Specification for Admixtures for Masonry Mortars
ASTM C1611/C1611M	(2021) Standard Test Method for Slump Flow of Self-Consolidating Concrete
ASTM D2000	(2018) Standard Classification System for Rubber Products in Automotive Applications
ASTM D2287	(2019) Nonrigid Vinyl Chloride Polymer and Copolymer Molding and Extrusion Compounds

THE MASONRY SOCIETY (TMS)

TMS MSJC	(2016) Masonry Standard Joint Committee's (MSJC) Book - Building Code Requirements and Specification for Masonry Structures, Containing TMS 402/ACI 530/ASCE 5, TMS 602/ACI 530.1/ASCE 6, and Companion Commentaries

1.2 SUBMITTALS

Government approval is required for submittals with a "G" . Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Cut CMU Drawings; G

Reinforcement Detail Drawings; G

SD-03 Product Data

Hot Weather Procedures; G

Cold Weather Procedures; G

Cement; G

Cementitious Materials; G

SD-04 Samples

Concrete Masonry Units (CMU); G

Admixtures for Masonry Mortar; G

Anchors, Ties, and Bar Positioners; G

Joint Reinforcement; G

SD-05 Design Data

Masonry Compressive Strength; G

SD-06 Test Reports

Field Testing of Mortar

Field Testing of Grout

SD-07 Certificates

Concrete Masonry Units (CMU)

Cementitious Materials

Admixtures for Masonry Mortar

Admixtures for Grout

Anchors, Ties, and Bar Positioners

Joint Reinforcement

SD-08 Manufacturer's Instructions

Admixtures for Masonry Mortar

Admixtures for Grout

SD-10 Operation and Maintenance Data

Take-Back Program

SD-11 Closeout Submittals

1.3 QUALITY ASSURANCE

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver, store, handle, and protect material to avoid chipping, breakage, and contact with soil or contaminating material. Store and prepare materials in already disturbed areas to minimize project site disturbance and size of project site.

1.4.1 Masonry Units

Cover and protect masonry units from precipitation. Conform to handling and storage requirements of TMS MSJC.

1.4.2 Reinforcement, Anchors, and Ties

Store steel reinforcing bars, coated anchors, ties, and joint reinforcement above the ground. Maintain steel reinforcing bars and uncoated ties free of loose mill scale and loose rust.

1.4.3 Cementitious Materials, Sand and Aggregates

Deliver cementitious and other packaged materials in unopened containers, plainly marked and labeled with manufacturers' names and brands. Store cementitious material in dry, weathertight enclosures or completely

cover. Handle cementitious materials in a manner that will prevent the inclusion of foreign materials and damage by water or dampness. Store sand and aggregates in a manner to prevent contamination and segregation.

1.5 PROJECT/SITE CONDITIONS

Conform to TMS MSJC for hot and cold weather masonry erection.

1.5.1 Hot Weather Procedures

When ambient air temperature exceeds 100 degrees F, or exceeds 90 degrees F and the wind velocity is greater than 8 mph, comply with TMS MSJC Article 1.8 D for: preparation prior to conducting masonry work; construction while masonry work is in progress; and protection for newly completed masonry.

1.5.2 Cold Weather Procedures

When ambient temperature is below 40 degrees F, comply with TMS MSJC Article 1.8 C for: preparation prior to conducting masonry work; construction while masonry work is in progress; and protection for newly completed masonry.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

2.1.1 Design - Specified Compressive Strength of Masonry

The specified compressive strength of masonry, f'm, is 2000 psi.

2.1.2 Performance - Verify Masonry Compressive Strength

Verify specified compressive strength of masonry using the "Unit Strength Method" of TMS MSJC. Submit calculations and certifications of unit and mortar strength.

Verify specified compressive strength of masonry using the "Prism Test Method" of TMS MSJC when the "Unit Strength Method" cannot be used. Submit test results.

2.2 MANUFACTURED UNITS

2.2.1 General Requirements

Do not change the source of materials, which will affect the appearance of the finished work, after the work has started except with Contracting Officer's approval. Submit test reports from an approved independent laboratory. Certify test reports on a previously tested material as the same materials as that proposed for use in this project. Submit certificates of compliance stating that the materials meet the specified requirements.

2.2.2 Concrete Units

2.2.2.1 Aggregates

Test lightweight aggregates, and blends of lightweight and heavier aggregates in proportions used in producing the units, for stain-producing

iron compounds in accordance with ASTM C641,visual classification method. Do not incorporate aggregates for which the iron stain deposited on the filter paper exceeds the "light stain" classification.

2.2.2.2 Concrete Masonry Units (CMU)

2.2.2.2.1 Cement

Use only cement that has a low alkali content and is of one brand.

2.2.2.2.2 Size

Provide units as indicated.

2.2.2.2.3 Surfaces

For units that are to be plastered or stuccoed, provide surfaces that are sufficiently rough to provide bond.

2.2.2.2.4 Weather Exposure

Provide concrete masonry units with water-repellant admixture added during manufacture where units will be exposed to weather.

2.2.2.2.5 Unit Types

a. Hollow Non-Load-Bearing Units: ASTM C129, lightweight.

2.2.2.2.6 Jamb Units

Provide jamb units of the shapes and sizes to conform with wall units. Solid units may be incorporated in the masonry work where necessary to fill out at corners, gable slopes, and elsewhere as approved.

Provide sash jamb units with a 3/4 by 3/4 inch groove near the center at end of each unit.

2.3 EQUIPMENT

2.3.1 Vibrators

Maintain at least one spare vibrator on site at all times.

2.3.2 Grout Pumps

Pumping through aluminum tubes is not permitted.

2.4 MATERIALS

2.4.1 Mortar Materials

2.4.1.1 Cementitious Materials

Provide cementitious materials that conform to those permitted by ASTM C270.

2.4.1.2 Hydrated Lime and Alternates

Provide lime that conforms to one of the materials permitted by ASTM C207 for use in combination with portland cement, hydraulic cement, and blended

hydraulic cement. Do not use lime in combination with masonry cement or mortar cement.

2.4.1.3 Admixtures for Masonry Mortar

In cold weather, use a non-chloride based accelerating admixture that conforms to ASTM C1384, unless Type III portland cement is used in the mortar.

In showers and kitchens, use mortar that contains a water-repellent admixture that conforms to ASTM C1384. Provide a water-repellent admixture, conforming to ASTM C1384 and of the same brand and manufacturer as the block's integral water-repellent, in the mortar used to place concrete masonry units that have an integral water-repellent admixture.

2.4.1.4 Aggregate and Water

Provide aggregate (sand) and water that conform to materials permitted by ASTM C270.

2.4.2 Grout and Ready-Mix Grout Materials

2.4.2.1 Cementitious Materials for Grout

Provide cementitious materials that conform to those permitted by ASTM C476.

2.4.2.2 Admixtures for Grout

Water-reducing admixtures that conform to ASTM C494/C494M Type F or G and viscosity-modifying admixtures that conform to ASTM C494/C494M Type S are permitted for use in grout. Other admixtures require approval by the Contracting Officer.

In cold weather, a non-chloride based accelerating admixture may be used subject to approval by the Contracting Officer; use accelerating admixture that is non-corrosive and conforms to ASTM C494/C494M, Type C.

2.4.2.3 Aggregate and Water

Provide fine and coarse aggregates and water that conform to materials permitted by ASTM C476.

2.5 MORTAR AND GROUT MIXES

2.5.1 Mortar Mix

a. Provide mortar Type S unless specified otherwise herein.

b. Provide mortar that conforms to ASTM C270. Use Type S mortar. For field-batched mortar, measure component materials by volume. Use measuring boxes for materials that do not come in packages, such as sand, for consistent batching. Mix cementitious materials and aggregates between 3 and 5 minutes in a mechanical batch mixer with a sufficient amount of water to produce a workable consistency. Do not hand mix mortar unless approved by the Contracting Officer. Maintain workability of mortar by remixing or retempering. Discard mortar that has begun to stiffen or is not used within 2-1/2 hours after initial mixing.

2.5.2 Grout and Ready Mix Grout Mix

Use grout that conforms to ASTM C476, fine. Use conventional grout with a slump between 8 and 11 inches. Use self-consolidating grout with slump flow of 24 to 30 inches and a visual stability index (VSI) not greater than 1. Provide minimum grout strength of 2000 psi in 28 days, as tested in accordance with ASTM C1019. Do not change proportions and do not use materials with different physical or chemical characteristics in grout for the work unless additional evidence is furnished that grout meets the specified requirements. Use ready-mixed grout that conforms to ASTM C476.

2.6 ACCESSORIES

2.6.1 Grout Barriers

Grout barriers for vertical cores that consist of fine mesh wire, fiberglass, or expanded metal.

2.6.2 Anchors, Ties, and Bar Positioners

2.6.2.1 General

a. Fabricate joint reinforcement in conformance with ASTM A951/A951M. Hot dip galvanize joint reinforcement in exterior walls and in interior walls exposed to moist environment in conformance with ASTM A153/A153M.

2.6.2.2 Bar Positioners

Factory-fabricate bar positioners, used to prevent displacement of reinforcing bars during the course of construction, from 9 gauge steel wire or equivalent, and hot-dip galvanized. Bar positioners must be suitable for intended use and be corrosion resistant steel. Bar positioners not fully contained within the wythe must be hot-dip galvanized.

2.6.3 Joint Reinforcement

Factory fabricate joint reinforcement in conformance with ASTM A951/A951M, welded construction. Provide ladder type joint reinforcement, having one longitudinal wire in the mortar bed of each face shell for hollow units and one wire for solid units and with all wires a minimum of 9 gauge. Size joint reinforcement to provide a minimum of 5/8 inch cover from each face. Space crosswires not more than 16 inches. Provide joint reinforcement for straight runs in flat sections not less than 10 feet long. Provide joint reinforcement with factory formed corners and intersections. If approved for use, joint reinforcement may be furnished with adjustable wall tie features. Submit one piece of each type used, including corner and wall intersection pieces, showing at least two cross wires.

2.6.4 Reinforcing Steel Bars

Reinforcing steel bars and rods shall conform to ASTM A615/A615M or ASTM A996/A996M, Grade 60.

2.6.5 Concrete Masonry Control Joint Keys

Provide control joint keys of a factory fabricated solid section of

natural or synthetic rubber (or combination thereof) conforming to ASTM D2000 M2AA-805 with a minimum durometer hardness of 80 or polyvinyl chloride conforming to ASTM D2287 Type PVC 654-4 with a minimum durometer hardness of 85. Form the control joint key with a solid shear section not less than 5/8 inch thick and 3/8 inch thick flanges, with a tolerance of plus or minus 1/16 inch, to fit neatly, but without forcing, in masonry unit jamb sash grooves.

PART 3 EXECUTION

3.1 EXAMINATION

Prior to start of work, verify the applicable conditions as set forth in TMS MSJC, inspection.

3.2 PREPARATION

3.2.1 Stains

Protect exposed surfaces from mortar and other stains. When mortar joints are tooled, remove mortar from exposed surfaces with fiber brushes and wooden paddles. Protect base of walls from splash stains by covering adjacent ground with sand, sawdust, or polyethylene.

3.2.2 Loads

Do not apply uniform loads for at least 12 hours or concentrated loads for at least 72 hours after masonry is constructed. Provide temporary bracing as required.

3.2.3 Concrete Surfaces

Where masonry is to be placed, clean concrete of laitance, dust, dirt, oil, organic matter, or other foreign materials and slightly roughen to provide a surface texture with a depth of at least 1/8 inch. Sandblast, if necessary, to remove laitance from pores and to expose the aggregate.

3.3 ERECTION

3.3.1 General

a. Coordinate masonry work with the work of other trades to accommodate built-in items and to avoid cutting and patching. Lay masonry units in running bond pattern. Lay facing courses level with back-up courses, unless the use of adjustable ties has been approved in which case the tolerances is plus or minus 1/2 inch. Adjust each unit to its final position while mortar is still soft and has plastic consistency.

b. Remove and clean units that have been disturbed after the mortar has stiffened, and relay with fresh mortar. Keep air spaces, cavities, chases, expansion joints, and spaces to be grouted free from mortar and other debris. Select units to be used in exposed masonry surfaces from those having the least amount of chipped edges or other imperfections detracting from the appearance of the finished work.

c. When necessary to temporarily discontinue the work, step (rack) back the masonry for joining when work resumes. Toothing may be used only when specifically approved by the Contracting Officer. Before

resuming work, remove loose mortar and thoroughly clean the exposed joint. Cover the top of walls subjected to rain or snow with nonstaining waterproof covering or membrane when work is not in process. Extend the covering a minimum of 610 mm 2 feet down on each side of the wall and hold securely in place.

d. Ensure that units being laid and surfaces to receive units are free of water film and frost. Lay solid units in a nonfurrowed full bed of mortar. Bevel mortar for veneer wythes and slope down toward the cavity side. Shove units into place so that the vertical joints are tight. Completely fill vertical joints between solid units with mortar, except where indicated at control, expansion, and isolation joints. Place hollow units so that mortar extends to the depth of the face shell at heads and beds, unless otherwise indicated. Mortar will be permitted to protrude up to 1/2 inch into the space or cells to be grouted. Provide means to prevent mortar from dropping into the space below or clean grout spaces prior to grouting.

e. In multi-wythe construction with collar joints no more than 3/4 inch wide, bring up the inner wythe not more than 16 inches ahead of the outer wythe. Fill collar joints with mortar during the laying of the facing wythe, and filling shall not lag the laying of the facing wythe by back-buttering each unit as it is laid.

3.3.1.1 Jointing

Tool mortar joints when the mortar is thumbprint hard. Tool horizontal joints after tooling vertical joints. Brush mortar joints to remove loose and excess mortar.

3.3.1.1.1 Tooled Joints

Tool mortar joints in exposed exterior and interior masonry surfaces concave , using a jointer that is slightly larger than the joint width so that complete contact is made along the edges of the unit. Perform tooling so that the mortar is compressed and the joint surface is sealed. Use a jointer of sufficient length to obtain a straight and true mortar joint. No exterior joints are to be left un-tooled.

3.3.1.1.2 Joint Widths

a. Provide 3/8 inch wide mortar joints in concrete masonry, except for prefaced concrete masonry units.

b. Provide 3/8 inch wide mortar joints on unfaced side of prefaced concrete masonry units and not less than 3/16 inch nor more than 1/4 inch wide on prefaced side.

c. Maintain mortar joint widths within tolerances permitted by TMS MSJC

3.3.1.2 Cutting and Fitting

Use full units of the proper size wherever possible, in lieu of cut units. Locate cut units where they would have the least impact on the architectural aesthetic goals of the facility. Perform cutting and fitting, including that required to accommodate the work of others, by masonry mechanics using power masonry saws. Concrete masonry units may be wet or dry cut. Before being placed in the work, dry wet-cut units to the same surface-dry appearance as uncut units being laid in the wall.

Provide cut edges that are clean, true and sharp.

a. Carefully make openings in the masonry so that wall plates, cover plates or escutcheons required by the installation will completely conceal the openings and will have bottoms parallel with the masonry bed joints. Provide reinforced masonry lintels above openings over 12 inches wide for pipes, ducts, cable trays, and other wall penetrations, unless steel sleeves are used.

b. Do not reduce masonry units in size by more than one-third in height and one-half in length. Do not locate cut products at ends of walls, corners, and other openings.

3.3.1.3 Unfinished Work

Rack back unfinished work for joining with new work. Toothing may be resorted to only when specifically approved by the Contracting Officer. Remove loose mortar and thoroughly clean the exposed joints before laying new work.

3.3.1.4 Control Joints

Provide control joints in concrete masonry as indicated. Construct by using special control-joint units in accordance with the details shown on the Drawings. Form a continuous vertical joint at control joint locations, including through bond beams, by utilizing half blocks in alternating courses on each side of the joint. Interrupt the control joint key in courses containing continuous bond beam reinforcement. Do not interrupt the horizontal reinforcement and grout at the control joint.

Where mortar was placed in the joint, rake both faces of the control joints to a depth of 3/4 inch. Install backer rod and sealant on both faces in accordance with Section 07 92 00 JOINT SEALANTS.

3.3.2 Reinforced, Single Wythe Concrete Masonry Units Walls

3.3.2.1 Concrete Masonry Unit Placement

a. Fully bed units used to form piers, pilasters, columns, starting courses on footings, solid foundation walls, lintels, and beams, and where cells are to be filled with grout in mortar under both face shells and webs. Provide mortar beds under both face shells for other units. Mortar head joints for a distance in from the face of the unit not less than the thickness of the face shell.

b. Submit drawings showing elevations of walls exposed to view and indicating the location of all cut CMU products.

3.3.2.2 Preparation for Reinforcement

Lay units in such a manner as to preserve the unobstructed vertical continuity of cores to be grouted. Remove mortar protrusions extending 1/2 inch or more into cells before placing grout. Position reinforcing bars accurately as indicated before placing grout. Where vertical reinforcement occurs, fill cores solid with grout in accordance with paragraph PLACING GROUT in this Section.

3.3.3 Sills and Copings

Set sills and copings in a full bed of mortar with faces plumb and true. Slope sills and copings to drain water. Mechanically anchor copings and sills longer than 4 feet as indicated.

3.4 INSTALLATION

3.4.1 Bar Reinforcement Installation

3.4.1.1 Preparation

Submit detail drawings showing bar splice locations. Identify bent bars on a bending diagram and reference and locate such bars on the drawings. Show wall dimensions, bar clearances, and wall openings. Utilize bending details that conform to the requirements of ACI SP-66. No approval will be given to the shop drawings until the Contractor certifies that all openings, including those for mechanical and electrical service, are shown. If, during construction, additional masonry openings are required, resubmit the approved shop drawings with the additional openings shown along with the proposed changes. Clearly highlight location of these additional openings. Provide wall elevation drawings with minimum scale of 1/4 inch per foot. Submit drawings including plans, elevations, and details of wall reinforcement; details of reinforcing bars at corners and wall intersections; offsets; tops, bottoms, and ends of walls; control and expansion joints; lintels; and wall openings.

Clean reinforcement of loose, flaky rust, scale, grease, mortar, grout, and other coatings that might destroy or reduce its bond prior to placing grout. Do not use bars with kinks or bends not shown on the approved shop drawings. Place reinforcement prior to grouting. Unless otherwise indicated, extend vertical wall reinforcement to within 2 inches of tops of walls.

3.4.1.2 Positioning Bars

a. Accurately place vertical bars within the cells at the positions indicated on the drawings. A minimum clearance of 1/2 inch shall be maintained between the bars and masonry units. Provide minimum clearance between parallel bars of 1/2 inch between the bars and masonry units for coarse grout and a minimum clearance of 1/4 inch between the bars and masonry units for fine grout. Provide minimum clearance between parallel bars of 1 inch or one diameter of the reinforcement, whichever is greater. Vertical reinforcement may be held in place using bar positioners located near the ends of each bar and at intermediate intervals of not more than 192 diameters of the reinforcement or by other means to prevent displacement beyond permitted tolerances. As masonry work progresses, secure vertical reinforcement to prevent displacement beyond allowable tolerances.

b. Wire column and pilaster lateral ties in position around the vertical reinforcing bars. Place lateral ties in contact with the vertical reinforcement and do not place in horizontal mortar bed joints.

c. Position horizontal reinforcing bars as indicated. Stagger splices in adjacent horizontal bars, unless otherwise indicated.

d. Form splices by lapping bars as indicated. Do not cut, bend or eliminate reinforcing bars. Foundation dowel bars may be field-bent

when permitted by TMS MSJC.

3.4.1.3 Splices of Bar Reinforcement

Lap splice reinforcing bars as indicated. When used, provide welded or mechanical connections that develop at least 125 percent of the specified yield strength of the reinforcement.

3.4.2 Placing Grout

3.4.2.1 General

Fill cells containing reinforcing bars with grout. Solidly grout hollow masonry units in walls or partitions supporting plumbing, heating, or other mechanical fixtures, voids at door and window jambs, and other indicated spaces. Solidly grout cells under lintel bearings on each side of openings for full height of openings. Solidly grout walls below grade, lintels, and bond beams. Units other than open end units may require grouting each course to preclude voids in the units.

Discard site-mixed grout that is not placed within 1-1/2 hours after water is first added to the batch or when the specified slump is not met without adding water after initial mixing. Discard ready-mixed grout that does not meet the specified slump without adding water other than water that was added at the time of initial discharge. Allow sufficient time between grout lifts to preclude displacement or cracking of face shells of masonry units. Provide a grout shear key between lifts when grouting is delayed and the lower lift loses plasticity. If blowouts, flowouts, misalignment, or cracking of face shells should occur during construction, tear down the wall and rebuild.

3.4.2.2 Horizontal Grout Barriers

Embed horizontal grout barriers in mortar below cells of hollow units receiving grout.

3.4.2.3 Grout Holes and Cleanouts

3.4.2.3.1 Grout Holes

Provide grouting holes in slabs, spandrel beams, and other in-place overhead construction. Locate holes over vertical reinforcing bars or as required to facilitate grout fill in bond beams. Provide additional openings spaced not more than 16 inches on centers where grouting of hollow unit masonry is indicated. Fom such openings not less than 4 inches in diameter or 3 by 4 inches in horizontal dimensions. Upon completion of grouting operations, plug and finish grouting holes to match surrounding surfaces.

3.4.2.4 Grout Placement

A grout pour is the total height of masonry to be grouted prior to erection of additional masonry. A grout lift is an increment of grout placement within a grout pour. A grout pour is filled by one or more lifts of grout.

a. Lay masonry to the top of a pour permitted by TMS MSJC Table 7, based on the size of the grout space and the type of grout. Prior to grouting, remove masonry protrusions that extend 1/2 inch or more into

cells or spaces to be grouted. Provide grout holes and cleanouts in accordance with paragraph GROUT HOLES AND CLEANOUTS above when the grout pour height exceeds 5 feet 4 inches. Hold reinforcement, bolts, and embedded connections rigidly in position before grouting is started. Do not prewet concrete masonry units.

b. Place grout using a hand bucket, concrete hopper, or grout pump to fill the grout space without segregation of aggregate. Operate grout pumps to produce a continuous stream of grout without air pockets, segregation, or contamination.

c. If the masonry has cured at least 4 hours, grout slump is maintained between 10 to 11 inches, and no intermediate reinforced bond beams are placed between the top and bottom of the pour height, place conventional grout in lifts not exceeding 12 feet 8 inches. For the same curing and slump conditions but with intermediate bond beams, limit conventional grout lift to the bottom of the lowest bond beam that is more than 5 feet 4 inches above the bottom of the lift, but do not exceed 12 feet 8 inches. If masonry has not cured at least 4 hours or grout slump is not maintained between 10 to 11 inches, place conventional grout in lifts not exceeding 5 feet 4 inches.

d. Consolidate conventional grout lift and reconsolidate after initial settlement before placing next lift. For grout pours that are 12 inches or less in height, consolidate and reconsolidate grout by mechanical vibration or puddling. For grout pours that are greater than 12 inches in height, consolidate and reconsolidate grout by mechanical vibration. Apply vibrators at uniformly spaced points not further apart than the visible effectiveness of the machine. Limit duration of vibration to time necessary to produce satisfactory consolidation without causing segregation. If previous lift is not permitted to set, dip vibrator into previous lift. Do not insert vibrators into lower lifts that are in a semi-solidified state. If lower lift sets prior to placement of subsequent lift, form a grout key by terminating grout a minimum of 1-1/2 inch below a mortar joint. Vibrate each vertical cell containing reinforcement in partially grouted masonry. Do not form grout keys within beams.

e. If the masonry has cured 4 hours, place self-consolidating grout (SCG) in lifts not exceeding the pour height. If masonry has not cured for at least 4 hours, place SCG in lifts not exceeding 5 feet 4 inches. Do not mechanically consolidate self-consolidating grout. Place self-consolidating grout in accordance with manufacturer's recommendations.

f. Upon completion of each day's grouting, remove waste materials and debris from the equipment, and dispose of outside the masonry.

3.4.3 Joint Reinforcement Installation

Install joint reinforcement at 16 inches on center unless otherwise indicated. Lap joint reinforcement not less than 6 inches. Install prefabricated sections at corners and wall intersections. Place the longitudinal wires of joint reinforcement in mortar beds to provide not less than 5/8 inch cover to either face of the unit.

3.4.4 Bond Beams

Reinforce and grout bond beams as indicated and as described in paragraphs

above. Install grout barriers under bond beam units to retain the grout as required, unless wall is fully grouted or solid bottom units are used. For high lift grouting in partially grouted masonry, provide grout retaining material on the top of bond beams to prevent upward flow of grout. Ensure that reinforcement is continuous, including around corners, except through control joints or expansion joints, unless otherwise indicated.

3.5 APPLICATION

3.5.1 Insulation

3.5.2 Interface with Other Products

3.5.2.1 Built-In Items

Fill spaces around built-in items with mortar. Point openings around flush-mount electrical outlet boxes in wet locations with mortar. Embed anchors, ties, wall plugs, accessories, flashing, pipe sleeves and other items required to be built-in as the masonry work progresses. Fully embed anchors, ties and joint reinforcement in the mortar. Fill cells receiving anchor bolts and cells of the first course below bearing plates with grout, unless otherwise indicated.

3.5.3 Tolerances

Lay masonry plumb, true to line, with courses level within the tolerances of TMS MSJC, Article 3.3 F.

3.6 FIELD QUALITY CONTROL

3.6.1 Tests

3.6.1.1 Field Testing of Mortar

Perform mortar testing at the following frequency: 2 times per DAY. For each required mortar test, provide a minimum of three mortar samples. Perform initial mortar testing prior to construction for comparison purposes during construction.

Prepare and test mortar samples for mortar aggregate ratio in accordance with ASTM C780 Appendix A4. Prepare and test mortar compressive strength specimens in accordance with ASTM C780 Appendix A6.

3.6.1.2 Field Testing of Grout

a. Perform grout testing at the following frequency: 1 times per 20 CY. For each required grout property to be evaluated, provide a minimum of three specimens.

b. Sample and test conventional and self-conslidating grout for compressive strength and temperature in accordance with ASTM C1019.

c. Evaluate slump in conventional grout in accordance with ASTM C1019.

d. Evaluate slump flow and visual stability index of self-consolidating grout in accordance with ASTM C1611/C1611M.

3.7 POINTING AND CLEANING

After mortar joints have attained their initial set, but prior to hardening, completely remove mortar and grout daubs and splashings from masonry-unit surfaces that will be exposed or painted. Before completion of the work, rake out defects in joints of masonry to be exposed or painted, fill with mortar, and tool to match existing joints. Immediately after grout work is completed, remove scum and stains that have percolated through the masonry work using a low pressure stream of water and a stiff bristled brush. Do not clean masonry surfaces, other than removing excess surface mortar, until mortar in joints has hardened. Leave masonry surfaces clean, free of mortar daubs, dirt, stain, and discoloration, including scum from cleaning operations, and with tight mortar joints throughout. Do not use metal tools and metal brushes for cleaning.

3.7.1 Dry-Brushing Concrete Masonry

Dry brush exposed concrete masonry surfaces at the end of each day's work and after any required pointing, using stiff-fiber bristled brushes.

3.8 CLOSE-OUT TAKE-BACK PROGRAM

Collect information from manufacturer for take-back program options. Set aside masonry units, full and partial to be returned to manufacturer for recycling into new product. When such a service is not available, seek local recyclers to reclaim the materials. Submit documentation that includes contact information, summary of procedures, and the limitations and conditions applicable to the project. Indicate manufacturer's commitment to reclaim materials for recycling and/or reuse.

3.9 PROTECTION

Protect facing materials against staining. Cover top of walls with nonstaining waterproof covering or membrane to protect from moisture intrusion when work is not in progress. Continue covering the top of the unfinished walls until the wall is waterproofed with a complete roof or parapet system. Extend covering a minimum of 2 feet down on each side of the wall and hold securely in place. Before starting or resuming work, clean top surface of masonry in place of loose mortar and foreign material.

-- End of Section --

SECTION 06 10 00

ROUGH CARPENTRY
08/16

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN LUMBER STANDARDS COMMITTEE (ALSC)

ALSC PS 20	(2015) American Softwood Lumber Standard

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B18.2.1	(2012; Errata 2013) Square and Hex Bolts and Screws (Inch Series)
ASME B18.2.2	(2015) Nuts for General Applications: Machine Screw Nuts, Hex, Square, Hex Flange, and Coupling Nuts (Inch Series)
ASME B18.5.2.1M	(2006; R 2011) Metric Round Head Short Square Neck Bolts
ASME B18.5.2.2M	(1982; R 2010) Metric Round Head Square Neck Bolts
ASME B18.6.1	(2016) Wood Screws (Inch Series)

AMERICAN WOOD COUNCIL (AWC)

AWC NDS	(2015) National Design Specification (NDS) for Wood Construction
AWC WFCM	(2012) Wood Frame Construction Manual for One- and Two-Family Dwellings

AMERICAN WOOD PROTECTION ASSOCIATION (AWPA)

AWPA BOOK	(2015) AWPA Book of Standards
AWPA M2	(2016) Standard for the Inspection of Preservative Treated Wood Products for Industrial Use
AWPA M6	(2013) Brands Used on Preservative Treated Materials
AWPA P5	(2015) Standard for Waterborne Preservatives
AWPA P18	(2014) Nonpressure Preservatives

AWPA U1 (2017) Use Category System: User Specification for Treated Wood

APA - THE ENGINEERED WOOD ASSOCIATION (APA)

APA L870 (2010) Voluntary Product Standard, PS 1-09, Structural Plywood

ASTM INTERNATIONAL (ASTM)

ASTM A153/A153M (2016) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware

ASTM A307 (2014; E 2017) Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength

ASTM F547 (2017) Standard Terminology of Nails for Use with Wood and Wood-Base Materials

ASTM F1667 (2018a) Standard Specification for Driven Fasteners: Nails, Spikes, and Staples

FM GLOBAL (FM)

FM 4435 (2013) Roof Perimeter Flashing

NATIONAL HARDWOOD LUMBER ASSOCIATION (NHLA)

NHLA Rules (2015) Rules for the Measurement & Inspection of Hardwood & Cypress

NORTHEASTERN LUMBER MANUFACTURERS ASSOCIATION (NELMA)

NELMA Grading Rules (2013) Standard Grading Rules for Northeastern Lumber

REDWOOD INSPECTION SERVICE (RIS) OF THE CALIFORNIA REDWOOD ASSOCIATION (CRA)

RIS Grade Use (1998) Redwood Lumber Grades and Uses

SOUTHERN CYPRESS MANUFACTURERS ASSOCIATION (SCMA)

SCMA Spec (1986; Supple. No. 1, Aug 1993) Standard Specifications for Grades of Southern Cypress

SOUTHERN PINE INSPECTION BUREAU (SPIB)

SPIB 1003 (2014) Standard Grading Rules for Southern Pine Lumber

U.S. GENERAL SERVICES ADMINISTRATION (GSA)

CID A-A-1923 (Rev A; Notice 3) Shield, Expansion (Lag, Machine and Externally Threaded Wedge Bolt Anchors)

CID A-A-1924	(Rev A; Notice 3) Shield, Expansion (Self Drilling Tubular Expansion Shell Bolt Anchors
CID A-A-1925	(Rev A; Notice 3) Shield Expansion (Nail Anchors)

WEST COAST LUMBER INSPECTION BUREAU (WCLIB)

WCLIB 17	(2015) Standard Grading Rules

WESTERN WOOD PRODUCTS ASSOCIATION (WWPA)

WWPA G-5	(2017) Western Lumber Grading Rules

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-06 Test Reports

Preservative-treated Lumber and Plywood

SD-07 Certificates

Preservative Treatment

1.3 DELIVERY AND STORAGE

Deliver materials to the site in an undamaged condition. Store, protect, handle, and install prefabricated structural elements in accordance with manufacturer's instructions and as specified. Store materials off the ground to provide proper ventilation, with drainage to avoid standing water, and protection against ground moisture and dampness. Store materials with a moisture barrier at both the ground level and as a cover forming a well ventilated enclosure. Store wood I-beams and glue-laminated beams and joists on edge. Adhere to requirements for stacking, lifting, bracing, cutting, notching, and special fastening requirements.

1.4 GRADING AND MARKING

1.4.1 Lumber

Mark each piece of framing and board lumber or each bundle of small pieces of lumber with the grade mark of a recognized association or independent inspection agency. Such association or agency must be certified by the Board of Review, American Lumber Standards Committee, to grade the species used. Surfaces that are to be exposed to view must not bear grademarks, stamps, or any type of identifying mark. Hammer marking will be permitted on timbers when all surfaces will be exposed to view.

1.4.2 Plywood

Mark each sheet with the mark of a recognized association or independent inspection agency that maintains continuing control over the quality of

the plywood. The mark must identify the plywood by species group or span rating, exposure durability classification, grade, and compliance with APA L870. Surfaces that are to be exposed to view must not bear grademarks or other types of identifying marks.

1.4.3 Preservative-Treated Lumber and Plywood

The Contractor is responsible for the quality of treated wood products. Each treated piece must be inspected in accordance with AWPA M2 and permanently marked or branded, by the producer, in accordance with AWPA M6. The Contractor must provide Contracting Officer's Representative (COR) with the inspection report of an approved independent inspection agency that offered products comply with applicable AWPA Standards. The appropriate Quality Mark on each piece will be accepted, in lieu of inspection reports, as evidence of compliance with applicable AWPA treatment standards.

1.5 SIZES AND SURFACING

ALSC PS 20 for dressed sizes of yard and structural lumber. Lumber must be surfaced four sides. Size references, unless otherwise specified, are nominal sizes, and actual sizes must be within manufacturing tolerances allowed by the standard under which the product is produced. Other measurements are IP or SI standard.

1.6 MOISTURE CONTENT

Air-dry or kiln-dry lumber. Kiln-dry treated lumber after treatment. Maximum moisture content of wood products must be as follows at the time of delivery to the job site:

a. Framing lumber and board, 19 percent maximum

1.7 PRESERVATIVE TREATMENT

Treat wood products with waterborne wood preservatives conforming to AWPA P5. Pressure treatment of wood products must conform to the requirements of AWPA BOOK Use Category System Standards U1 and T1. Pressure-treated wood products must not contain arsenic, chromium, or other agents classified as carcinogenic, probably carcinogenic, or possibly carcinogenic to humans (compounds in Groups 1, 2A, or 2B) by the International Agency for Research on Cancer (IARC), Lyon, France. Pressure-treated wood products must not exceed the limits of the U.S. EPA's Toxic Characteristic Leaching Procedure (TCLP), and must not be classified as hazardous waste. Submit certification from treating plant stating chemicals and process used and net amount of preservatives retained are in conformance with specified standards. In accordance with AWPA U1 provide non-copper preservative treatment such as EL2, PTI or SBX,DOT for products in direct contact with sheet metal.

a. 0.25 pcf intended for above ground use.

b. 0.40 pcf intended for ground contact and fresh water use. 0.60 pcf intended for Ammoniacal Copper Quaternary Compound (ACQ)-treated foundations. 0.80 to 1.00 pcf intended for ACQ-treated pilings. All wood must be air or kiln dried after treatment. Specific treatments must be verified by the report of an approved independent inspection agency, or the AWPA Quality Mark on each piece. Minimize cutting and avoid breathing sawdust. Brush coat areas that are cut or drilled

after treatment with either the same preservative used in the treatment or with a 2 percent copper naphthenate solution.

1.7.1 New Construction

Use a boron-based preservative conforming to AWPA P18, sodium silicate wood mineralization process, or Ammoniacal Copper Quaternary Compound to treat wood. Use boron-based preservatives for above-ground applications only.

1.8 QUALITY ASSURANCE

1.9 ENVIRONMENTAL REQUIREMENTS

During and immediately after installation of treated wood, at interior spaces, provide temporary ventilation.

1.10 CERTIFICATIONS

1.10.1 Certified Wood Grades

Provide certificates of grade from the grading agency on graded but unmarked lumber or plywood attesting that materials meet the grade requirements specified herein.

PART 2 PRODUCTS

2.1 MATERIALS

2.2 LUMBER

2.2.1 Framing Lumber

Framing lumber such as studs, plates, caps, collar beams, cant strips, bucks, sleepers, nailing strips, and nailers and board lumber such as subflooring and wall and roof sheathing must be one of the species listed in the table below. Minimum grade of species must be as listed.

Table of Grades for Framing and Board Lumber

Grading Rules	Species	Framing	Board Lumber
WWPA G-5 standard grading rules	Aspen, Douglas Fir-Larch, Douglas Fir South, Engelmann Spruce-Lodgepole Pine, Engelmann Spruce, Hem-Fir, Idaho White Pine, Lodgepole Pine, Mountain Hemlock, Mountain Hemlock-Hem-Fir, Ponderosa Pine-Sugar Pine, Ponderosa Pine-Lodgepole Pine, Subalpine Fir, White Woods, Western Woods, Western Cedars, Western Hemlock	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	All Species: No. 3 Common
WCLIB 17 standard grading rules	Douglas Fir-Larch, Hem-Fir, Mountain Hemlock, Sitka Spruce, Western Cedars, Western Hemlock	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	All Species: Standard

Table of Grades for Framing and Board Lumber

Grading Rules	Species	Framing	Board Lumber
SPIB 1003 standard grading rules	Southern Pine	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	No. 2 Boards
SCMA Spec standard specifications	Cypress	No. 2 Common	No. 2 Common
NELMA Grading Rules standard grading rules	Balsam Fir, Eastern Hemlock-Tamarack, Eastern Spruce, Eastern White Pine, Northern Pine, Northern Pine-Cedar	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	All Species: No. 3 Common except Standard for Eastern White and Northern Pine
RIS Grade Use standard specifications	Redwood	All Species: Standard Light Framing or No. 3 Structural Light Framing (Stud Grade for 2x4 nominal size, 10 feet and shorter)	Construction Heart

Table of Grades for Framing and Board Lumber

Grading Rules	Species	Framing	Board Lumber
NHLA Rules rules for the measurement and inspection of hardwood and cypress lumber	Cypress	No. 2 Dimension	No. 2 Common

2.3 ROUGH HARDWARE

Unless otherwise indicated or specified, rough hardware must be of the type and size necessary for the project requirements. Sizes, types, and spacing of fastenings of manufactured building materials must be as recommended by the product manufacturer unless otherwise indicated or specified. Rough hardware exposed to the weather or embedded in or in contact with preservative treated wood, exterior masonry, or concrete walls or slabs must be hot-dip zinc-coated in accordance with ASTM A153/A153M.

2.3.1 Bolts, Nuts, Studs, and Rivets

ASME B18.2.1, ASME B18.5.2.1M, ASME B18.5.2.2M and ASME B18.2.2.

2.3.2 Anchor Bolts

ASTM A307, size as indicated, complete with nuts and washers.

2.3.3 Expansion Shields

CID A-A-1923, CID A-A-1924, and CID A-A-1925. Except as shown otherwise, maximum size of devices must be 3/8 inch.

2.3.4 Lag Screws and Lag Bolts

ASME B18.2.1.

2.3.5 Wood Screws

ASME B18.6.1.

2.3.6 Nails

ASTM F547, size and type best suited for purpose. In general, 8-penny or larger nails must be used for nailing through 1 inch thick lumber and for toe nailing 2 inch thick lumber; 16-penny or larger nails must be used for nailing through 2 inch thick lumber. Nails used with treated lumber and sheathing must be hot-dipped galvanized in accordance with ASTM A153/A153M. Nailing must be in accordance with the recommended nailing schedule contained in AWC WFCM. Where detailed nailing requirements are not specified, nail size and spacing must be sufficient to develop an adequate strength for the connection. The connection's strength must be verified against the nail capacity tables in AWC NDS. Reasonable judgment backed

by experience must ensure that the designed connection will not cause the wood to split. If a load situation exceeds a reasonable limit for nails, a specialized connector must be used.

2.3.7 Wire Nails

ASTM F1667.

PART 3 EXECUTION

3.1 INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

Conform to AWC WFCM and install in accordance with the National Association of Home Builders (NAHB) Advanced Framing Techniques: Optimum Value Engineering, unless otherwise indicated or specified. Select lumber sizes to minimize waste. Fit framing lumber and other rough carpentry, set accurately to the required lines and levels, and secure in place in a rigid manner.

3.2 MISCELLANEOUS

3.2.1 Wood Roof Nailers, Edge Strips, Crickets, Curbs, and Cants

Provide sizes and configurations indicated or specified and anchored securely to continuous construction.

3.2.1.1 Roof Edge Strips and Nailers

Provide at perimeter of roof, around openings through roof, and where roofs abut walls, curbs, and other vertical surfaces. Except where indicated otherwise, nailers must be 6 inches wide and the same thickness as the insulation. Anchor nailers securely to underlying construction. Anchor perimeter nailers in accordance with FM 4435.

3.2.1.2 Crickets, Cants, and Curbs

Provide wood saddles or crickets, cant strips, curbs for scuttles and ventilators, as indicated, specified, or necessary.

3.2.2 Wood Blocking

Provide proper sizes and shapes at proper locations for the installation and attachment of wood and other finish materials, fixtures, equipment, and items indicated or specified.

3.2.3 Wood Grounds

Provide for fastening wood trim, finish materials, and other items to plastered walls and ceilings. Install grounds in proper alignment and true with an 8 foot straightedge.

-- End of Section --

SECTION 06 41 16.00 10

LAMINATE CLAD ARCHITECTURAL CASEWORK
08/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI A161.2	(1998) Decorative Laminate Countertops, Performance Standards for Fabricated High Pressure

ARCHITECTURAL WOODWORK INSTITUTE (AWI)

AWI AWS	(2009) Architectural Woodwork Standards

ASTM INTERNATIONAL (ASTM)

ASTM D1037	(2012) Evaluating Properties of Wood-Base Fiber and Particle Panel Materials
ASTM F547	(2006; R 2012) Nails for Use with Wood and Wood-Base Materials

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)

ANSI/BHMA A156.9	(2010) Cabinet Hardware

COMPOSITE PANEL ASSOCIATION (CPA)

CPA A208.1	(2009) Particleboard

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI/NEMA LD 3	(2005) Standard for High-Pressure Decorative Laminates

WINDOW AND DOOR MANUFACTURERS ASSOCIATION (WDMA)

ANSI/WDMA I.S.1A	(2013) Interior Architectural Wood Flush Doors

1.2 SYSTEM DESCRIPTION

Work in this section includes laminate clad custom casework cabinets and vanities as shown on the drawings and as described in this specification. This Section includes high-pressure laminate surfacing and cabinet hardware. All exposed and semi-exposed surfaces, whose finish is not otherwise noted on the drawings or finish schedule, shall be sanded smooth and shall receive a clear finish of polyurethane. Wood finish may be shop

finished or field applied in accordance with Section 09 90 00 PAINTS AND COATINGS.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Shop Drawings
Installation

SD-03 Product Data

Wood Materials
Wood Finishes
Finish Schedule
Certification

SD-04 Samples

Plastic Laminates
Cabinet Hardware

SD-07 Certificates

Quality Assurance
Laminate Clad Casework

1.4 QUALITY ASSURANCE

1.4.1 General Requirements

Unless otherwise noted on the drawings, all materials, construction methods, and fabrication shall conform to and comply with the custom grade quality standards as outlined in AWI AWS, Section for laminate clad cabinets. These standards shall apply in lieu of omissions or specific requirements in this specification. Contractors and their personnel engaged in the work shall be able to demonstrate successful experience with work of comparable extent, complexity and quality to that shown and specified. Submit a quality control statement, which illustrates compliance with and understanding of AWI AWS requirements, in general, and the specific AWI AWS requirements provided in this specification. The quality control statement shall also certify a minimum of ten years Contractor's experience in laminate clad casework fabrication and construction. The quality control statement shall provide a list of a minimum of five successfully completed projects of a similar scope, size, and complexity.

1.5 DELIVERY, STORAGE, AND HANDLING

Casework may be delivered knockdown or fully assembled. Deliver all units to the site in undamaged condition, stored off the ground in fully enclosed areas, and protected from damage. The storage area shall be well ventilated and not subject to extreme changes in temperature or humidity.

1.6 SEQUENCING AND SCHEDULING

Coordinate work with other trades. Units shall not be installed in any room or space until painting, and ceiling installation are complete within the room where the units are located. Floor cabinets shall be installed before finished flooring materials are installed.

PART 2 PRODUCTS

2.1 WOOD MATERIALS

2.1.1 Lumber

a. All framing lumber shall be kiln-dried Grade III to dimensions as shown on the drawings. Frame front, where indicated on the drawings, shall be nominal 3/4 inch hardwood.

2.1.2 Panel Products

2.1.2.1 Particleboard

All particleboard shall be industrial grade, medium density (40 to 50 pounds per cubic foot), 3/4 inch thick. A moisture-resistant particleboard in grade Type 2-M-2 or 2-M-3 shall be used as the substrate for plastic laminate covered components as located on the drawings and other areas subjected to moisture. Particleboard shall meet the minimum standards listed in ASTM D1037 and CPA A208.1.

2.2 SOLID POLYMER MATERIAL

Solid surfacing casework components shall conform to the requirements of Section 06 61 16 SOLID POLYMER (SOLID SURFACING) FABRICATIONS.

2.3 HIGH PRESSURE DECORATIVE LAMINATE (HPDL)

All plastic laminates shall meet the requirements of ANSI/NEMA LD 3 and ANSI A161.2 for high-pressure decorative laminates. Design, colors, surface finish and texture, and locations shall be as indicated on the drawings Section 09 06 00 SCHEDULES FOR FINISHES. Submit two samples of each plastic laminate pattern and color. Samples shall be a minimum of 5 by 7 inches in size. Plastic laminate types and nominal minimum thicknesses for casework components shall be as indicated in the following paragraphs.

2.3.1 Horizontal General Purpose Standard (HGS) Grade

Horizontal general purpose standard grade plastic laminate shall be 0.048 inches (plus or minus 0.005 inches) in thickness. This laminate grade is intended for horizontal surfaces where postforming is not required.

2.3.2 Vertical General Purpose Standard (VGS) Grade

Vertical general purpose standard grade plastic laminate shall be 0.028 inches (plus or minus 0.004 inches) in thickness. This laminate grade is intended for exposed exterior vertical surfaces of casework components where postforming is not required.

2.3.3 Horizontal General Purpose Postformable (HGP) Grade

Horizontal general purpose postformable grade plastic laminate shall be 0.042 inches (plus or minus 0.005 inches) in thickness. This laminate grade is intended for horizontal surfaces where post forming is required.

2.3.4 Vertical General Purpose Postformable (VGP) Grade

Vertical general purpose postformable grade plastic laminate shall be 0.028 inches (plus or minus 0.004 inches) in thickness. This laminate grade is intended for exposed exterior vertical surfaces of components where postforming is required for curved surfaces.

2.3.5 Cabinet Liner Standard (CLS) Grade

Cabinet liner standard grade plastic laminate shall be 0.020 inches in thickness. This laminate grade is intended for light duty semi-exposed interior surfaces of casework components.

2.3.6 Backing Sheet (BK) Grade

Undecorated backing sheet grade laminate is formulated specifically to be used on the backside of plastic laminated panel substrates to enhance dimensional stability of the substrate. Backing sheet thickness shall be 0.020 inches. Backing sheets shall be provided for all laminated casework components where plastic laminate finish is applied to only one surface of the component substrate.

2.4 THERMOSET DECORATIVE OVERLAYS (MELAMINE)

Thermoset decorative overlays (melamine panels) shall be not be used.

2.5 EDGE BANDING

Edge banding for casework doors and drawer fronts shall be PVC vinyl and shall be 0.125 inch thick. Material width shall be 15/16 inches. Color and pattern shall match exposed door and drawer front laminate pattern and color.

2.6 CABINET HARDWARE

Submit one sample of each cabinet hardware item specified to include hinges, pulls, drawer glides. All hardware shall conform to ANSI/BHMA A156.9, unless otherwise noted, and shall consist of the following components:

2.6.1 Door Hinges

Concealed, Euro-Style type, BHMA No. 156.9, Grade 1.

2.6.2 Cabinet Pulls

Type, brushed stainless wire, as selected, BHMA No. 156.9.

2.6.3 Drawer Slide

Side mounted type, BHMA No. 156.9 with fullextension and a minimum 100 pound load capacity. Slides shall include an integral stop to avoid accidental drawer removal.

2.6.4 Adjustable Shelf Support System

Recessed (mortised) metal standards, BHMA No. BO4071, finish: Satin Stainless. Support clips for the standards shall be open type, BHMA No. B04091

2.7 FASTENERS

Nails, screws, and other suitable fasteners shall be the size and type best suited for the purpose and shall conform to ASTM F547 where applicable.

2.8 ADHESIVES, CAULKS, AND SEALANTS

2.8.1 Adhesives

Adhesives shall be of a formula and type recommended by AWI. Adhesives shall be selected for their ability to provide a durable, permanent bond and shall take into consideration such factors as materials to be bonded, expansion and contraction, bond strength, fire rating, and moisture resistance. Adhesives shall meet local regulations regarding VOC emissions and off-gassing.

2.8.1.1 Wood Joinery

Adhesives used to bond wood members shall be a Type II for interior use polyvinyl acetate resin emulsion . Adhesives shall withstand a bond test as described in ANSI/WDMA I.S.1A.

2.8.1.2 Laminate Adhesive

Adhesive used to join high-pressure decorative laminate to wood shall be a water-based contact adhesive. PVC edgebanding shall be adhered using a polymer-based hot melt glue.

2.8.2 Caulk

Caulk used to fill voids and joints between laminated components and between laminated components and adjacent surfaces shall be clear, 100 percent silicone.

2.8.3 Sealant

Sealant shall be of a type and composition recommended by the substrate manufacturer to provide a moisture barrier at sink cutouts and all other locations where unfinished substrate edges may be subjected to moisture.

2.9 ACCESSORIES

2.10 FABRICATION

Verify field measurements as indicated in the shop drawings before fabrication. Fabrication and assembly of components shall be accomplished at the shop site to the maximum extent possible. Construction and fabrication of cabinets and their components shall meet or exceed the requirements for AWI custom grade unless otherwise indicated in this specification. Cabinet style, in accordance with AWI AWS, Section 400-G descriptions, shall be flush overlay.

2.10.1 Base and Wall Cabinet Case Body

2.10.1.1 Cabinet Components

Frame members shall be glued-together, kiln-dried hardwood lumber. Top corners, bottom corners, and cabinet bottoms shall be braced with either hardwood blocks or water-resistant glue and nailed in place metal or plastic corner braces. Cabinet components shall be constructed from the following materials and thicknesses:

2.10.1.1.1 Body Members (Ends, Divisions, Bottoms, and Tops)

3/4 inch veneer core plywood panel product

2.10.1.1.2 Face Frames and Rails

3/4 inch hardwood lumber

2.10.1.1.3 Shelving

3/4 inch veneer core plywood

2.10.1.1.4 Cabinet Backs

1/4 inch veneer core plywood panel product

2.10.1.1.5 Drawer Sides, Backs, and Subfronts

1/2 inch hardwood lumber

2.10.1.1.6 Drawer Bottoms

1/4 inch veneer core plywoodpanel product

2.10.1.1.7 Door and Drawer Fronts

3/4-inch particleboard panel product

2.10.1.2 Joinery Method for Case Body Members

2.10.1.2.1 Tops, Exposed Ends, and Bottoms

a. Stop dado, glued under pressure, and either nailed, stapled or screwed (fasteners will not be visible on exposed parts).

2.10.1.2.2 Exposed End Corner and Face Frame Attachment

2.10.1.2.2.1 Butt Joint

glued and nailed

2.10.1.2.3 Cabinet Backs (Wall Hung Cabinets)

Wall hung cabinet backs must not be relied upon to support the full weight of the cabinet and its anticipated load for hanging/mounting purposes. Method of back joinery and hanging/mounting mechanisms should transfer the load to case body members. Fabrication method shall be:

2.10.1.2.3.1 Side Bound

Side bound, captured in groove or rabbetts; glued and fastened.

2.10.1.2.4 Cabinet Backs (Floor Standing Cabinets)

2.10.1.2.4.1 Side Bound with Rabbetts

Side bound, placed in rabbetts; glued and fastened in rabbetts.

2.10.1.2.5 Wall Anchor Strips

Wall Anchor Strips shall be required for all cabinets with backs less than 1/2 inch thick. Strips shall consist of minimum 1/2 inch thick lumber, minimum 2-1/2 inches width; securely attached to wall side of cabinet back - top and bottom for wall hung cabinets, top only for floor standing cabinets.

2.10.2 Cabinet Floor Base

Floor cabinets shall be mounted on a base constructed of nominal 2 inch thick lumber . Base assembly components shall be treated lumber. Finished height for each cabinet base shall be as indicated on the drawings. Bottom edge of the cabinet door or drawer face shall be flush with top of base.

2.10.3 Cabinet Door and Drawer Fronts

Door and drawer fronts shall be fabricated from 3/4 inch medium density particleboard 3/4 inch medium density fiberboard (MDF. All door and drawer front edges shall be surfaced with PVC edgebanding, color and pattern to match exterior face laminate.

2.10.4 Drawer Assembly

2.10.4.1 Drawer Components

Drawer components shall consist of a removable drawer front, sides, backs, and bottom. Drawer components shall be constructed of the following materials and thicknesses:

2.10.4.1.1 Drawer Sides and Backs For Laminate Finish

1/2 inch thick 7-ply hardwood veneer core substrate

2.10.4.1.2 Drawer Bottom

1/4 inch thick veneer core panel product for plastic laminate finish

2.10.4.2 Drawer Assembly Joinery Method

a. Multiple dovetail (all corners) or French dovetail front/dadoed back, glued under pressure.

2.10.5 Shelving

2.10.5.1 General Requirements

Shelving shall be fabricated from 3/4 inch medium density particleboard

All shelving top and bottom surfaces shall be finished with HPDL plastic laminate. Shelf edges shall be finished in a PVC edgebanding.

2.10.5.2 Shelf Support System

The shelf support system shall be:

2.10.5.2.1 Recessed (Mortised) Metal Shelf Standards

Mortise standards flush with the finishes surface of the cabinet interior side walls, two per side. Pposition and space standards on the side walls to provide a stable shelf surface that eliminates tipping when shelf front is weighted. Install and adjust standards vertically to provide a level, stable shelf surface when clips are in place.

2.10.6 Laminate Application

Laminate application to substrates shall follow the recommended procedures and instructions of the laminate manufacturer and ANSI/NEMA LD 3, using tools and devices specifically designed for laminate fabrication and application. Provide a balanced backer sheet (Grade BK) wherever only one surface of the component substrate requires a plastic laminate finish. Apply required grade of laminate in full uninterrupted sheets consistent with manufactured sizes using one piece for full length only, using adhesives specified herein or as recommended by the manufacturer. Fit corners and joints hairline. All laminate edges shall be machined flush, filed, sanded, or buffed to remove machine marks and eased (sharp corners removed). Clean up at easing shall be such that no overlap of the member eased is visible. Fabrication shall conform to ANSI A161.2. Laminate types and grades for component surfaces shall be as follows unless otherwise indicated on the drawings:

2.10.6.1 Base/Wall Cabinet Case Body

a. Exterior (exposed) surfaces to include exposed and semi-exposed face frame surfaces: HPDL Grade VGS.

b. Interior (semi-exposed) surfaces to include interior back wall, bottom, and side walls: HPDL Grade CLS

2.10.6.2 Adjustable Shelving

2.10.6.2.1 Top and Bottom Surfaces

HPDL Grade HGS

2.10.6.2.2 All Edges

PVC edgebanding

2.10.6.3 Fixed Shelving

2.10.6.3.1 Top and Bottom Surfaces

HPDL Grade HGS

2.10.6.3.2 Exposed Edges

PVC edgebanding

2.10.6.4 Door, Drawer Fronts, Access Panels

2.10.6.4.1 Exterior (Exposed) and Interior (Semi-Exposed) Faces

HPDL Grade VGS

2.10.6.4.2 Edges

PVC edgebanding

2.10.6.5 Drawer Assembly

All interior and exterior surfaces: HPDL Grade CLS.

2.10.6.6 Countertops and Splashes

Solid Surface material.

2.10.6.7 Tolerances

Flushness, flatness, and joint tolerances of laminated surfaces shall meet the AWI AWS custom grade requirements.

2.10.7 Finishing

2.10.7.1 Filling

No fasteners shall be exposed on laminated surfaces. All nails, screws, and other fasteners in non-laminated cabinet components shall be countersunk and the holes filled with wood filler consistent in color with the wood species.

2.10.7.2 Sanding

All surfaces requiring coatings shall be prepared by sanding with a grit and in a manner that scratches will not show in the final system.

2.10.7.3 Coatings

Types, method of application and location of casework finishes shall be in accordance with the finish schedule, drawings and Section 09 90 00 PAINTS AND COATINGS. All cabinet reveals shall be painted. Submit descriptive data which provides narrative written verification of all types of construction materials and finishes, methods of construction, etc. not clearly illustrated on the submitted shop drawings. Data shall provide written verification of conformance with AWI AWS for the quality indicated to include materials, tolerances, and types of construction. Both the manufacturer of materials and the fabricator shall submit available literature which describes re-cycled product content, operations and processes in place that support efficient use of natural resources, energy efficiency, emissions of ozone depleting chemicals, management of water and operational waste, indoor environmental quality, and other production techniques supporting sustainable design and products.

PART 3 EXECUTION

3.1 INSTALLATION

Installation shall comply with applicable requirements for AWI AWS custom quality standards. Countertops and fabricated assemblies shall be installed level, plumb, and true to line, in locations shown on the drawings. Cabinets and other laminate clad casework assemblies shall be attached and anchored securely to the floor and walls with mechanical fasteners that are appropriate for the wall and floor construction.

3.1.1 Anchoring Systems

3.1.1.1 Floor

Base cabinets shall utilize a floor anchoring system as detailed on the drawings. Anchoring and mechanical fasteners shall not be visible from the finished side of the casework assembly. Cabinetassemblies shall be attached to anchored bases without visible fasteners as indicated in the drawings. Where assembly abuts a wall surface, anchoring shall include a minimum 1/2 inch thick lumber or panel product hanging strip, minimum 2-1/2 inch width; securely attached to the top of the wall side of the cabinet back.

3.1.1.2 Wall

Cabinet vanity to be wall mounted shall utilize minimum 1/2 inch thick lumber or panel product hanging strips, minimum 2-1/2 inch width; securely attached to the wall side of the cabinet back, both top and bottom.

3.1.2 Countertops

Countertops shall be installed in locations as indicated on the drawings. Countertops shall be fastened to supporting casework structure with mechanical fasteners, hidden from view. All joints formed by the countertop or countertop splash and adjacent wall surfaces shall be filled with a clear silicone caulk. Loose back side splashes shall be adhered to both the countertop surface perimeter and the adjacent wall surface with adhesives appropriate for the type of materials to be adhered. Joints between the countertop surface and splash shall be filled with clear silicone caulk in a smooth consistent concave bead. Bead size shall be the minimum necessary to fill the joint and any surrounding voids or cracks.

3.1.3 Hardware

Casework hardware shall be installed in types and locations as indicated on the drawings. Where fully concealed European-style hinges are specified to be used with particleboard or fiberboard doors, the use of plastic or synthetic insertion dowels shall be used to receive 3/16 inch "Euroscrews". The use of wood screws without insertion dowels is prohibited.

3.1.4 Doors, Drawers and Removable Panels

The fitting of doors, drawers and removable panels shall be accomplished within target fitting tolerances for gaps and flushness in accordance with AWI AWS custom grade requirements.

3.1.5 Plumbing Fixtures

Install sinks, sink hardware, and other plumbing fixtures in locations as indicated on the drawings and in accordance with Section 22 00 00 PLUMBING, GENERAL PURPOSE.

-- End of Section --

SECTION 06 61 16

SOLID SURFACING FABRICATIONS
08/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM D2583	(2013a) Indentation Hardness of Rigid Plastics by Means of a Barcol Impressor
ASTM D570	(1998; E 2010; R 2010) Standard Test Method for Water Absorption of Plastics
ASTM D638	(2014) Standard Test Method for Tensile Properties of Plastics
ASTM D696	(2016) Standard Test Method for Coefficient of Linear Thermal Expansion of Plastics Between -30 degrees C and 30 degrees C With a Vitreous Silica Dilatometer
ASTM E84	(2018a) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM G21	(2015) Standard Practice for Determining Resistance of Synthetic Polymeric Materials to Fungi

CSA GROUP (CSA)

CSA B45.5-11/IAPMO Z124	(2011; Update 1 2012) Plastic Plumbing Fixtures - First Edition

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI/NEMA LD 3	(2005) Standard for High-Pressure Decorative Laminates

NSF INTERNATIONAL (NSF)

NSF/ANSI 51	(2012) Food Equipment Materials

TILE COUNCIL OF NORTH AMERICA (TCNA)

TCNA Hdbk	(2017) Handbook for Ceramic, Glass, and Stone Tile Installation

1.2 SYSTEM DESCRIPTION

a. Work under this section includes countertops, sinks and back splashes and other items utilizing solid polymer (solid surfacing) fabrication as shown on the drawings and as described in this specification. Do not change source of supply for materials after work has started, if the appearance of finished work would be affected.

b. In most instances, installation of solid polymer fabricated components and assemblies will require strong, correctly located structural support provided by other trades. To provide a stable, sound, secure installation, close coordination is required between the solid polymer fabricator/installer and other trades to ensure that necessary structural wall support, cabinet counter top structural support, proper clearances, and other supporting components are provided for the installation of wall panels, countertops, shelving, and all other solid polymer fabrications to the degree and extent recommended by the solid polymer manufacturer.

c. Appropriate staging areas for solid polymer fabrications. Allow variation in component size and location of openings of plus or minus 1/8 inch.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Detail Drawings; G

SD-03 Product Data

Solid Polymer Material

SD-04 Samples

Material; G
Counter Tops; G
Window Stools; G

1.4 QUALITY ASSURANCE

1.4.1 Qualifications

To ensure warranty coverage, solid polymer fabricators shall be certified to fabricate by the solid polymer material manufacturer being utilized. Mark all fabrications with the fabricator's certification label affixed in an inconspicuous location. Fabricators shall have a minimum of 5 years of experience working with solid polymer materials. Submit solid polymer manufacturer's certification attesting to fabricator qualification approval.

1.5 DELIVERY, STORAGE, AND HANDLING

Do not deliver materials to project site until areas are ready for

installation. Deliver components and materials to the site undamaged, in containers clearly marked and labeled with manufacturer's name. Materials shall be stored indoors and adequate precautions taken to prevent damage to finished surfaces. Provide protective coverings to prevent physical damage or staining following installation, for duration of project.

1.6 WARRANTY

Provide manufacturer's warranty of ten years against defects in materials, excluding damages caused by physical or chemical abuse or excessive heat. Warranty shall provide for material and labor for replacement or repair of defective material for a period of ten years after component installation.

PART 2 PRODUCTS

2.1 MATERIAL

Provide solid polymer material that is a homogeneous filled solid polymer; not coated, laminated or of a composite construction; meeting CSA B45.5-11/IAPMO Z124 requirements. Material shall have minimum physical and performance properties specified. Superficial damage to a depth of 0.01 inch shall be repairable by sanding or polishing. Material thickness shall be as indicated on the drawings. In no case shall material be less than 1/4 inch in thickness. Submit a minimum 4 by 4 inch sample of each color and pattern for approval. Samples shall indicate full range of color and pattern variation. Approved samples shall be retained as a standard for this work. Submit test report results from an independent testing laboratory attesting that the submitted solid polymer material meets or exceeds each of the specified performance requirements.

2.1.1 Cast, 100 Percent Acrylic Polymer Solid Surfacing Material

Cast, 100 percent acrylic solid polymer material shall be composed of acrylic polymer, mineral fillers, and pigments and shall meet the following minimum performance requirements:

PROPERTY	REQUIREMENT (min. or max.)	TEST PROCEDURE
Tensile Strength	4000 psi (max.)	ASTM D638
Hardness	55-Barcol Impressor (min.)	ASTM D2583
Thermal Expansion	.000023 in/in/F (max.)	ASTM D696
Boiling Water Surface Resistance	No Change	ANSI/NEMA LD 3-3.05
High Temperature Resistance	No Change	ANSI/NEMA LD 3-3.06
Impact Resistance (Ball drop)		ANSI/NEMA LD 3-303
1/4 inch sheet	36 inches, 1/2 lb ball, no failure	

PROPERTY	REQUIREMENT (min. or max.)	TEST PROCEDURE
1/2 inch sheet	140 inches, 1/2 lb ball, no failure	
3/4 inch sheet	200 inches, 1/2 lb ball, no failure	
Mold & Mildew Growth	No growth	ASTM G21
Bacteria Growth	No growth	ASTM G21
Liquid Absorption (Weight in 24 hrs.)	0.1 percent max.	ASTM D570
Flammability		ASTM E84
Flame Spread	25 max.	
Smoke Developed	30 max.	
Sanitation	"Food Contact" approval	NSF/ANSI 51

2.1.2 Acrylic-modified Polymer Solid Surfacing Material

Cast, solid polymer material shall be composed of a formulation containing acrylic and polyester polymers, mineral fillers, and pigments. Acrylic polymer content shall be not less than 5 percent and not more than 10 percent in order to meet the following minimum performance requirements:

PROPERTY	REQUIREMENT (min. or max.)	TEST PROCEDURE
Tensile Strength	4100 psi (max.)	ASTM D638
Hardness	50-Barcol Impressor (min.)	ASTM D2583
Thermal Expansion	.000023 in/in/F (max.)	ASTM D696
Boiling Water Surface Resistance	No Change	ANSI/NEMA LD 3-3.05
High Temperature Resistance	No Change	ANSI/NEMA LD 3-3.06
Impact Resistance (Ball drop)		ANSI/NEMA LD 3-303
1/4 inch sheet	36 inches, 1/2 lb ball, no failure	

PROPERTY	REQUIREMENT (min. or max.)	TEST PROCEDURE
1/2 inch sheet	140 inches, 1/2 lb ball, no failure	
3/4 inch sheet	200 inches, 1/2 lb ball, no failure	
Mold & Mildew Growth	No growth	ASTM G21
Bacteria Growth	No growth	ASTM G21
Liquid Absorption (Weight in 24 hrs.)	0.6 percent max.	ASTM D570
Flammability		ASTM E84
Flame Spread	25 max.	
Smoke Developed	100 max.	
Sanitation	"Food Contact" approval	NSF/ANSI 51

2.1.3 Material Patterns and Colors

Patterns and colors for all solid polymer components and fabrications shall be those indicated on the project drawings and color schedule. Pattern and color shall occur, and shall be consistent in appearance, throughout the entire depth (thickness) of the solid polymer material.

2.1.4 Surface Finish

Exposed finished surfaces and edges shall receive a uniform appearance. Exposed surface finish shall be matte; gloss rating of 5-20.

2.2 ACCESSORY PRODUCTS

Accessory products, as specified below, shall be manufactured by the solid polymer manufacturer or shall be products approved by the solid polymer manufacturer for use with the solid polymer materials being specified.

2.2.1 Seam Adhesive

Seam adhesive shall be a two-part adhesive kit to create permanent, inconspicuous, non-porous, hard seams and joints by chemical bond between solid polymer materials and components to create a monolithic appearance of the fabrication. Adhesive shall be approved by the solid polymer manufacturer. Adhesive shall be color-matched to the surfaces being bonded where solid-colored, solid polymer materials are being bonded together. The seam adhesive shall be clear or color matched where particulate patterned, solid polymer materials are being bonded together.

2.2.2 Panel Adhesive

Panel adhesive shall be neoprene based panel adhesive meeting TCNA Hdbk, Underwriter's Laboratories (UL) listed. Use this adhesive to bond solid polymer components to adjacent and underlying substrates.

2.2.3 Silicone Sealant

Sealant shall be a mildew-resistant, FDA and OSHA Nationally Recognized Testing Laboratory (NRTL) listed silicone sealant or caulk in a clear formulation. The silicone sealant shall be approved for use by the solid polymer manufacturer. Use sealant to seal all expansion joints between solid polymer components and all joints between solid polymer components and other adjacent surfaces such as walls, floors, ceiling, and plumbing fixtures.

2.2.4 Mounting Hardware

Provide mounting hardware, including sink/bowl clips, inserts and fasteners for attachment of undermount sinks and lavatories.

2.3 FABRICATIONS

Components shall be factory or shop fabricated to sizes and shapes indicated, to the greatest extent practical, in accordance with approved Shop Drawings and manufacturer's requirements. Provide factory cutouts for sinks, lavatories, and plumbing fixtures where indicated on the drawings. Contours and radii shall be routed to template, with edges smooth. Defective and inaccurate work will be rejected. Submit product data indicating product description, fabrication information, and compliance with specified performance requirements for solid polymer, joint adhesive, sealants, and heat reflective tape. Both the manufacturer of materials and the fabricator shall submit a detailed description of operations and processes in place that support efficient use of natural resources, energy efficiency, emissions of ozone depleting chemicals, management of water and operational waste, indoor environmental quality, and other production techniques supporting sustainable design and products.

2.3.1 Joints and Seams

Form joints and seams between solid polymer components using manufacturer's approved seam adhesive. Joints shall be inconspicuous in appearance and without voids to create a monolithic appearance.

2.3.2 Edge Finishing

Rout and finish component edges to a smooth, uniform appearance and finish. Edge shapes and treatments, including any inserts, shall be as detailed on the drawings. Rout all cutouts, then sand all edges smooth. Repair or reject defective or inaccurate work.

2.3.3 Counter Top Splashes

Fabricate backsplashes and end splashes from 1/2 inch thick solid surfacing material to be 4 inches highin conformance with dimensions and shapes as indicated on the drawings. Backsplashes and end splashes shall be provided for all counter tops. Backsplashes shall be shop fabricated and be permanently attached.

2.3.3.1 Permanently Attached Backsplash

Permanently attached backsplashes shall be attached straight with seam adhesive to form a 90 degree transition.

2.3.3.2 End Splashes

End splashes shall be provided loose for installation at the jobsite after horizontal surfaces to which they are to be attached have been installed.

2.3.4 Window Stools

Fabricate window stools from 1/2 inch thick solid surfacing, solid polymer material, including dimensions, edge shape, and other details as indicated on the drawings.

2.3.5 Counter and Vanity Tops

Fabricate all solid surfacing, solid polymer counter top components from 1/2 inch thick material. Edge details, dimensions, locations, and quantities shall be as indicated on the Drawings. Counter tops shall be complete with 4 inch high loose, 90 degree transition at all locations. Attach 2 inch wide reinforcing strip of polymer material under each horizontal counter top seam. Submit a minimum 1 foot wide by 6 inch deep, full size sample for each type of counter top shown on the project drawings. The sample shall include the edge profile and backsplash as detailed on the project drawings. Solid polymer material shall be of a pattern and color as indicated on the drawings. Sample shall include at least one seam. Approved sample shall be retained as standard for this work.

2.3.5.1 Counter Top With Sink

a. Stainless Steel or Vitreous China Sink. Countertops with sinks shall include cutouts to template as furnished by the sink manufacturer. Manufacturer's standard sink mounting hardware stainless steel installation shall be provided. Seam between sink and counter top shall be sealed with silicone sealant. Sink, faucet, and plumbing requirements shall be in accordance with Section 22 00 00 PLUMBING,GENERAL PURPOSE.

2.3.5.2 Vanity Tops With Bowls

a. Countertops with vitreous china bowls shall include cutouts to template as furnished by the sink manufacturer. Manufacturer's standard sink mounting hardware shall be provided. Seam between sink and counter top shall be sealed with silicone sealant. Sink, faucet, and plumbing requirements shall be in accordance with Section 22 00 00 PLUMBING,GENERAL PURPOSE.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Components

Install all components and fabricated units plumb, level, and rigid. Make field joints between solid polymer components using solid polymer manufacturer's approved seam adhesives, to provide a monolithic appearance

with joints inconspicuous in the finished work.

3.1.1.1 Loose Counter Top Splashes

Mount loose splashes in the locations noted on the drawings. Loose splashes shall be adhered to the counter top with a color matched silicone sealant when the solid polymer components are solid colors. Use a clear silicone sealant to provide adhesion of particulate patterned solid polymer splashes to counter tops.

3.1.2 Silicone Sealant

Use a clear, silicone sealant or caulk to seal all expansion joints between solid polymer components and all joints between solid polymer components and other adjacent surfaces such as walls, floors, ceiling, and plumbing fixtures. Sealant bead shall be smooth and uniform in appearance and shall be the minimum size necessary to bridge any gaps between the solid surfacing material and the adjacent surface. Bead shall be continuous and run the entire length of the joint being sealed.

3.2 CLEAN-UP

Components shall be cleaned after installation and covered to protect against damage during completion of the remaining project items. Components damaged after installation by other trades will be repaired or replaced at the General Contractor's cost. Component supplier will provide a repair/replace cost estimate to the General Contractor who shall approve estimate before repairs are made. Submit a minimum of six copies of maintenance data indicating manufacturer's care, repair and cleaning instructions. Maintenance video shall be provided,if available. Maintenance kit for matte finishes shall be submitted.

-- End of Section --

SECTION 07 21 16

MINERAL FIBER BLANKET INSULATION
11/11

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C665	(2012) Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing
ASTM C930	(2012) Potential Health and Safety Concerns Associated with Thermal Insulation Materials and Accessories
ASTM D3575	(2014) Flexible Cellular Materials Made From Olefin Polymers
ASTM E136	(2012) Behavior of Materials in a Vertical Tube Furnace at 750 Degrees C
ASTM E84	(2014) Standard Test Method for Surface Burning Characteristics of Building Materials

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 211	(2013) Standard for Chimneys, Fireplaces, Vents, and Solid Fuel-Burning Appliances
NFPA 31	(2011) Standard for the Installation of Oil-Burning Equipment
NFPA 54	(2012) National Fuel Gas Code
NFPA 70	(2014; AMD 1 2013; Errata 1 2013; AMD 2 2013; Errata 2 2013; AMD 3 2014; Errata 3 2014) National Electrical Code

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.134	Respiratory Protection

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. The following shall be submitted in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Blanket insulation

Certification

SD-08 Manufacturer's Instructions

Insulation

1.3 DELIVERY, STORAGE, AND HANDLING

1.3.1 Delivery

Deliver materials to site in original sealed wrapping bearing manufacturer's name and brand designation, specification number, type, grade, R-value, and class. Store and handle to protect from damage. Do not allow insulation materials to become wet, soiled, crushed, or covered with ice or snow. Comply with manufacturer's recommendations for handling, storing, and protecting of materials before and during installation.

1.3.2 Storage

Inspect materials delivered to the site for damage; unload and store out of weather in manufacturer's original packaging. Store only in dry locations, not subject to open flames or sparks, and easily accessible for inspection and handling.

1.4 SAFETY PRECAUTIONS

1.4.1 Respirators

Provide installers with dust/mist respirators, training in their use, and protective clothing, all approved by National Institute for Occupational Safety and Health (NIOSH)/Mine Safety and Health Administration (MSHA) in accordance with 29 CFR 1910.134.

1.4.2 Smoking

Do not smoke during installation of blanket thermal insulation.

1.4.3 Other Safety Concerns

Consider other safety concerns and measures as outlined in ASTM C930.

PART 2 PRODUCTS

2.1 BLANKET INSULATION

ASTM C665, Type I, blankets without membrane coverings; except a flame spread rating of 25 or less when tested in accordance with ASTM E84.

2.1.1 Thermal Resistance Value (R-VALUE)

As indicated

2.1.2 Recycled Materials

Provide Thermal Insulation containing recycled materials to the extent practicable, provided the material meets all other requirements of this section. The minimum required recycled materials content by weight are:

Fiberglass: 20 to 25 percent glass cullet

2.1.3 Prohibited Materials

Do not provide asbestos-containing materials.

2.2 SILL SEALER INSULATION

Provide polyethylene foam sill sealer full width with the following characteristics:.

Physical Properties	Test Method	Measurement
Nominal Thickness	ASTM D3575	3/16 inch
Compressive Strength	ASTM D3575	1.2 psi
- Vertical Direction	Suffix D	
Tensile Strength	ASTM D3575	32 psi
	Suffix T	

2.3 BLOCKING

Metal, unfaced mineral fiber blankets in accordance with ASTM C665, Type I, or other approved materials. Use only non-combustible materials meeting the requirements of ASTM E136 for blocking around chimneys and heat producing devices.

2.4 ACCESSORIES

2.4.1 Adhesive

As recommended by the insulation manufacturer.

2.4.2 Mechanical Fasteners

Corrosion resistant fasteners as recommended by the insulation manufacturer.

PART 3 EXECUTION

3.1 EXISTING CONDITIONS

Before installing insulation, ensure that areas that will be in contact with the insulation are dry and free of projections which could cause voids, compressed insulation, or punctured vapor retarders. If moisture or other conditions are found that do not allow the workmanlike installation of the insulation, do not proceed but notify Contracting

Officer of such conditions.

3.2 PREPARATION

3.2.1 Blocking Around Heat Producing Devices

Install non-combustible blocking around heat producing devices to provide the following clearances:

a. Recessed lighting fixtures, including wiring compartments, ballasts, and other heat producing devices, unless these are certified by the manufacturer for installation surrounded by insulation: 3 inches from outside face of fixtures and devices or as required by NFPA 70 and, if insulation is to be placed above fixture or device, 24 inches above fixture.

b. Masonry chimneys or masonry enclosing a flue: 2 inches from outside face of masonry. Masonry chimneys for medium and high heat operating appliances: Minimum clearances required by NFPA 211.

c. Vents and vent connectors used for venting the products of combustion, flues, and chimneys other than masonry chimneys: Minimum clearances as required by NFPA 211.

d. Gas Fired Appliances: Clearances as required in NFPA 54.

e. Oil Fired Appliances: Clearances as required in NFPA 31.

Blocking around flues and chimneys is not required when insulation blanket, including any attached vapor retarder, passed ASTM E136, in addition to meeting all other requirements stipulated in Part 2. Blocking is also not required if the chimneys are certified by the manufacturer for use in contact with insulating materials.

3.3 INSTALLATION

3.3.1 Insulation

Install and handle insulation in accordance with manufacturer's instructions. Keep material dry and free of extraneous materials. Ensure personal protective clothing and respiratory equipment is used as required. Observe safe work practices.

3.3.1.1 Electrical wiring

Do not install insulation in a manner that would sandwich electrical wiring between two layers of insulation.

3.3.1.2 Continuity of Insulation

Install blanket insulation to butt tightly against adjoining blankets and to studs, rafters, joists, sill plates, headers and any obstructions. Provide continuity and integrity of insulation at corners, wall to ceiling joints, roof, and floor. Avoid creating thermal bridges.

3.3.1.3 Installation at Bridging and Cross Bracing

Insulate at bridging and cross bracing by splitting blanket vertically at center and packing one half into each opening. Butt insulation at

bridging and cross bracing; fill in bridged area with loose or scrap insulation.

3.3.1.4 Insulation without Affixed Vapor Retarder

Provide snug friction fit to hold insulation in place. Stuff pieces of insulation into cracks between trusses, joists, studs and other framing, such as at attic access doors, door and window heads, jambs, and sills, band joists, and headers.

3.3.1.5 Sizing of Blankets

Provide only full width blankets when insulating between trusses, joists, or studs. Size width of blankets for a snug fit where trusses, joists or studs are irregularly spaced.

-- End of Section --

SECTION 07 24 00

EXTERIOR INSULATION AND FINISH SYSTEMS
05/11, CHG 4: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM B117	(2019) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM C67/C67M	(2020) Standard Test Methods for Sampling and Testing Brick and Structural Clay Tile
ASTM C150/C150M	(2020) Standard Specification for Portland Cement
ASTM C473	(2019) Standard Test Methods for Physical Testing of Gypsum Panel Products
ASTM C578	(2019) Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation
ASTM C847	(2014a) Standard Specification for Metal Lath
ASTM C920	(2018) Standard Specification for Elastomeric Joint Sealants
ASTM C1177/C1177M	(2017) Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing
ASTM C1186	(2008; R 2012) Standard Specification for Flat Non-Asbestos Fiber Cement Sheets
ASTM C1278/C1278M	(2017) Standard Specification for Fiber-Reinforced Gypsum Panel
ASTM C1325	(2017a) Standard Specification for Non-Asbestos Fiber-Mat Reinforced Cementitious Backer Units
ASTM D968	(2017) Standard Test Methods for Abrasion Resistance of Organic Coatings by Falling Abrasive
ASTM D2247	(2015) Testing Water Resistance of Coatings in 100% Relative Humidity
ASTM D3273	(2016) Standard Test Method for Resistance to Growth of Mold on the Surface of

	Interior Coatings in an Environmental Chamber
ASTM E84	(2020) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM E136	(2019a) Standard Test Method for Assessing Combustibility of Materials Using a Vertical Tube Furnace at 750 Degrees C
ASTM E330/E330M	(2014) Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference
ASTM E331	(2000; R 2016) Standard Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference
ASTM E695	(2003; R 2015; E 2015) Measuring Relative Resistance of Wall, Floor, and Roof Construction to Impact Loading
ASTM E2098/E2098M	(2013) Determining Tensile Breaking Strength of Glass Fiber Reinforcing Mesh for Use in Class PB Exterior Insulation and Finish Systems (EIFS) after Exposure to a Sodium Hydroxide Solution
ASTM E2486	(2006) Standard Test Method for Impact Resistance of Class PB and PI Exterior Insulation and Finish Systems (EIFS)
ASTM E2570/E2570M	(2007; R 2014; E 2014) Standard Test Methods for Evaluating Water-Resistive Barrier (WRB) Coatings Used under Exterior Insulation and Finish Systems (EIFS) or EIFS with Drainage
ASTM G153	(2013) Operating Enclosed Carbon Arc Light Apparatus for Exposure of Nonmetallic Materials

INTERNATIONAL CODE COUNCIL (ICC)

ICC IBC	(2021) International Building Code

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 268	(2012) Standard Test Method for Determining Ignitibility of Exterior Wall Assemblies Using a Radiant Heat Energy Source
NFPA 285	(2012) Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior

1.2 SYSTEM DESCRIPTION AND REQUIREMENTS

The exterior insulation and finish system (EIFS) must be a job-fabricated, drainable, exterior wall covering consisting of sheathing, air and moisture barrier, insulation board, reinforcing fabric, base coat, finish coat, adhesive and mechanical fasteners as applicable. The system components must be compatible with each other and with the substrate as recommended or approved by, and the products of, a single manufacturer regularly engaged in furnishing Exterior Insulation and Finish Systems. All materials must be installed by an applicator approved by the system manufacturer. EIFS must be Class PB or Class PM and must be selected color and finish.

1.2.1 System Requirements and Tests

The system must meet the performance requirements as verified by the tests listed below. Where a wall system of similar type, size, and design as specified for this project has been previously tested under the condition specified herein, the resulting test reports may be submitted in lieu of job specific tests.

1.2.1.1 Water Penetration

Test the system for water penetration by uniform static air pressure in accordance with ASTM E331. There must be no penetration of water beyond the plane of the base coat/EPS board interface after 15 minutes at 6.4 psf, or 20 percent of positive design wind pressure, whichever is greater.

1.2.1.2 Wind Load

Test the system for wind load by uniform static air pressure in accordance with ASTM E330/E330M (procedure A) to a minimum pressure of 70 psf. There must be no permanent deformation, delamination, or other deterioration.

1.2.1.3 Full scale or intermediate scale fire test

Conduct wall fire test using apparatus, specimen, performance criteria, and procedure in accordance with NFPA 285 when required by ICC IBC 2603.5.5. The following requirements must be met:

a. No vertical spread of flame within core of panel from one story to the next.

b. No flame spread over the exterior surface.

c. No vertical flame spread over the interior surface from one story to the next.

d. No significant lateral spread of flame from compartment of fire origin to adjacent spaces.

1.2.2 Component Requirements and Tests

The components of the system must meet the performance requirements as verified by the tests listed below.

1.2.2.1 Surface Burning Characteristics

Conduct ASTM E84 test on samples consisting of base coat, reinforcing fabric, and finish coat. Cure for 28 days. The flame spread index must be 25 or less and the smoke developed index must be 450 or less.

1.2.2.2 Radiant Heat

The system must be tested in accordance with NFPA 268 on both the minimum and maximum thickness of insulation intended for use with no ignition during the 20-minute period.

1.2.2.3 Impact Resistance

a. Class PB Systems: Hemispherical Head Test; 28 day cured specimen of PB EIFS in accordance with ASTM E2486. The test specimen must exhibit no broken reinforcing fabric per ASTM E2486.

b. Impact Mass: Test 28 day cured specimen of PM EIFS in accordance with ASTM E695. The test specimen must exhibit no cracking or denting after twelve impacts by 30 lbs lead shot mass from 6 in to 6 ft drop heights in 6 in intervals.

1.2.3 Sub-Component Requirements and Tests

Unless otherwise stated, the test specimen must consist of reinforcing mesh, base coat, and finish coat applied in accordance with manufacturer's printed recommendations to the insulation board to be used on the building. For mildew resistance, only the finish coat is applied onto glass slides for testing. These specimen must be suitably sized for the apparatus used and be allowed to cure for a minimum of 28 days prior to testing.

1.2.3.1 Abrasion Resistance

Test in accordance with ASTM D968, Method A. Test a minimum of two specimens. After testing, the specimens must show only very slight smoothing, with no loss of film integrity after 132 gallons of sand.

1.2.3.2 Accelerated Weathering

Test in accordance with ASTM G153, Cycle 1. After 2000 hours specimens must exhibit no visible cracking, flaking, peeling, blistering, yellowing, fading, or other such deterioration.

1.2.3.3 Mildew Resistance

Test in accordance with ASTM D3273. The specimen shall consist of the finish coat material, applied to clean 3 inch by 4 inch glass slides and must be allowed to cure for 28 days. After 28 days of exposure, the specimen must not show any growth.

1.2.3.4 Salt Spray Resistance

Test in accordance with ASTM B117. The specimen must be a minimum of 4 inch by 6 inch and must be tested for a minimum of 300 hours. After exposure, the specimen must exhibit no observable deterioration, such as chalking, fading , or rust staining.

1.2.3.5 Water Resistance

Test in accordance with ASTM D2247. The specimen must be a minimum of 4 inch by 6 inch. After 14 days, the specimen must exhibit no cracking, checking, crazing, erosion, blistering, peeling, or delamination.

1.2.3.6 Absorption-Freeze/Thaw

Class PB systems must be tested in accordance with ASTM E2570/E2570M for 60 cycles of freezing and thawing. After testing, the specimen must exhibit no cracking, checking, or splitting, and negligible weight gain. Class PM systems must be tested in accordance with ASTM C67/C67M for 50 cycles of freezing and thawing. After testing, the specimens must exhibit no cracking or checking and have negligible weight gain.

1.2.3.7 Sample Boards

Unless otherwise stated, provide sample EIFS Component 12 by 24 inches, on sheathing board, including finish color and texture, typical joints and sealant. If more than one color, finish, or pattern is used, provide one sample for each. The test specimen must consist of reinforcing mesh, base coat, and finish coat applied in accordance with manufacturer's printed recommendations to the insulation board to be used on the building.

1.2.4 Moisture Analysis

Perform a job specific vapor transmission analysis based on project specific climate and specified wall components and materials. Indicate the temperatures and relative humidities for the inside and outside of the building; a complete listing of the building components, their thickness, thermal resistance and permeance, as well as building location and use. If a mathematical model was used for the analysis, include the name of the model and the supplier/developer.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Shop Drawings; G

Show wall layout, construction and expansion joints, decorative grooves, layout of sheathing board, thermal insulation board, and reinforcing mesh and strip reinforcing fabric; joint and flashing details; details at wall penetrations; types and location of fasteners; details at windows and doors; and details at base, roof, corners, roof/wall intersections.

SD-03 Product Data

Sheathing Board

Thermal Insulation

Adhesive

Mechanical Fasteners

Accessories

Base Coat

Portland Cement

Reinforcing Fabric

Finish Coat

Joint Sealant

Sealant Primer

Bond Breaker

Backer Rod

Insulation Board

Warranty

Include joint and other details, such as end conditions, corners, windows, and parapet. Include shelf life and recommended cleaning solvents in data for sealants. Include Safety Data Sheets (SDS)for all components of the EIFS. The SDS shall be available at the job site.

SD-04 Samples

Sample Boards; G

Color and Texture

SD-05 Design Data

Wind Load Calculations

Moisture Analysis Calculations

SD-06 Test Reports

Abrasion Resistance

Accelerated Weathering

Impact Resistance

Mildew Resistance

Salt Spray Resistance

Water Vapor Transmission

Absorption-Freeze-Thaw

Wall Fire Test

Water Penetration

Water Resistance
Full Scale or Intermediate Scale Fire Test

Surface Burning Characteristics

Radiant Heat

Substrate

Wind Load

SD-07 Certificates

Qualifications of EIFS Manufacturer

Qualification of EIFS Installer

Qualification of Sealant Applicator

Certify that EIFS installer meets requirements specified under paragraph "Qualification of Installer," and that sealant applicator is approved by the EIFS Manufacturer.

Qualifications of Third Party Inspector

Inspection Check List; G

Submit filled-out inspection check list as required in paragraph "Quality Control," certifying that the installation of critical items meets the requirements of this specification.

SD-08 Manufacturer's Instructions

Installation

Manufacturer's standard printed instructions for the installation of the EIFS. Include requirements for condition and preparation of substrate, installation of EIFS, and requirements for sealants and sealing.

SD-10 Operation and Maintenance Data

EIFS

Include detailed finish repair procedures and information regarding compatibility of sealants with base and finish coatings.

1.4 QUALITY ASSURANCE

1.4.1 Qualifications of EIFS Manufacturer

The EIFS must be the product of a manufacturer who has been in the practice of manufacturing and designing EIFS for a period of not less than 3 years, and has been involved in at least five projects similar to this project in size, scope, and complexity, in the same or a similar climate as this project.

1.4.2 Qualification of EIFS Installer

The EIFS Installer must be trained by the EIFS manufacturer to perform the installation of the System and must have successfully installed at least five projects at or near the size and complexity of this project. The contractor must employ qualified workers trained and experienced in installing the manufacturer's EIFS.

1.4.3 Qualification of Sealant Applicator

The sealant applicator must be experienced and competent in the installation of high performance industrial and commercial sealants and must have successfully installed at least five projects at or near the size and complexity of this project.

1.4.4 Qualifications of Third Party Inspector

Submit evidence that third party inspector has current certification from the Exterior Design Institute or equal inspector certification as inspector for the installation of EIFS.

1.4.5 Insulation Board

Insulation Board must be approved and labeled under third party quality program as required by applicable building code.

1.4.6 Pre-Installation Conference

After approval of submittals and before commencing any work on the EIFS, including installation of any sheathing board, insulation, and associated work, the Contracting Officer will hold a pre-installation conference to review:

a. Drawings, specifications, and samples;

b. Procedure for on site inspection and acceptance of EIFS substrate and pertinent details (for example, mock-up installation);

c. Contractor's plan for coordination of work of the various trades involved in providing EIF system and other components;

d. Inspection procedures; and

e. Safety requirements.

Pre-installation conference must be attended by the Contractor, EIFS Q.C. Specialist (EIFS Inspector), and all personnel directly responsible for installation of the EIF system, including sealant applicator, and personnel responsible for related work, such as flashing and sheet metal,

windows and doors, and a representative of the EIFS manufacturer. Before beginning EIFS work, the contractor must confirm in writing the resolution of conflicts among those attending the pre-installation conference.

1.5 DELIVERY AND STORAGE

Deliver materials to job site in original unopened packages, marked with manufacturer's name, brand name, and description of contents. Store materials off the ground and in accordance with the manufacturer's recommendations in a clean, dry, well-ventilated area. Protect stored materials from rain, sunlight, and excessive heat. Keep coating materials which would be damaged by freezing at a temperature not less than 40 degrees F. Do not expose insulation board to flame or other ignition sources.

1.6 ENVIRONMENTAL CONDITIONS

a. Do not prepare materials or apply EIFS during inclement weather unless appropriate protection is provided. Protect installed materials from inclement weather until they are dry.

b. Apply sealants and wet materials only at ambient temperatures of 40 degrees F or above and rising, unless supplemental heat is provided. The system must be protected from inclement weather and maintain this temperature for a minimum of 24 hours after installation.

c. Do not leave insulation board exposed to sunlight after installation.

1.7 WARRANTY

Furnish manufacturer's standard warranty for the EIFS. Warranty must run directly to Government and cover a period of not less than 5 years from date Government accepted the work.

PART 2 PRODUCTS

2.1 COMPATIBILITY

Provide all materials compatible with each other and with the substrate, and as recommended by EIFS manufacturer.

2.2 SHEATHING BOARD

2.2.1 Fiber Reinforced Cement Sheathing Board

a. Meet ASTM C1186, Type A, Grade I, or.

b. Meet ASTM C1325, Type A, Flexural Strength

c. Non-combustible per ASTM E136.

d. Nail Pull Resistance: No less than 120 lb when tested in accordance with ASTM C473.

e. Thickness no less than 1/2 inch.

f. Water Absorption not to exceed 17 percent.

2.2.2 Glass Mat Gypsum Sheathing Board

a. Conform to ASTM C1177/C1177M; or.

b. ASTM C1278/C1278M, Water Resistant Exterior Type only

c. Nail Pull Resistance: No less than 120 lb when tested in accordance with ASTM C473.

2.3 ADHESIVE

Manufacturer's standard product, including primer as required, must be compatible with substrate and insulation board to which the system is applied.

2.4 LATHING AND FURRING

Conform to ASTM C847, 2.5 lb/sqyd, self-furring, galvanized.

2.5 MECHANICAL FASTENERS

Corrosion resistant and as approved by EIFS manufacturer. Select fastener type and pattern based on applicable wind loads and substrate into which fastener will be attached, to provide the necessary pull-out, tensile, and shear strengths.

2.6 THERMAL INSULATION

2.6.1 Manufacturer's Recommendations

Provide only thermal insulation recommended by the EIFS manufacturer for the type of application intended.

2.6.2 Insulation Board

Insulation board must be standard product of manufacturer and must be compatible with other systems components. Boards must be factory marked individually with the manufacturer's name or trade mark, the material specification number, the R-value at 75 degree F, and thickness. No layer of insulation shall be less than 3/4 inch thick. The maximum thickness of all layers must not exceed 4 inches. Insulation Board must be certified as aged, in block form, prior to cutting and shipping, a minimum of 6 weeks by air drying, or equivalent.

a. Thermal resistance: As indicated on drawings.

b. Insulating material: ASTM C578 Type I as recommended by the EIFS manufacturer and treated to be compatible with other EIFS components. Age insulation by air drying a minimum of 6 weeks prior to cutting and shipping.

c. Drainage: Preform channels into the interior face of insulation board or provide polypropylene drainage lath spacer to provide water drainage system.

d. Recycled Content: Provide insulation material that has minimum of 10 percent recycled material. Provide data identifying percentage of recycled content for insulation materials.

2.7 BASE COAT

Manufacturer's standard product and compatible with other systems components.

2.8 PORTLAND CEMENT

Conform to ASTM C150/C150M, Type I or II as required, fresh and free of lumps, and approved by the systems manufacturer.

2.9 REINFORCING FABRIC

Reinforcing fabric mesh must be alkali-resistant, balanced, open weave , glass fiber fabric made from twisted multi-end strands specifically treated for compatibility with the other system materials, and comply with ASTM E2098/E2098M and as recommended by EIFS manufacturer.

2.10 FINISH COAT

Manufacturer's standard product conforming to the requirements in the paragraph on Sub-Component Requirements and Tests. For color consistency, use materials from the same batch or lot number.

2.11 SEALANT PRIMER

Non-staining, quick-drying type recommended by sealant manufacturer and EIFS manufacturer.

2.12 ACCESSORIES

Conform to recommendations of EIFS manufacturer, including trim, edging, anchors, and expansion joints. All metal items and fasteners to be corrosion resistant.

2.13 JOINT SEALANT

Non-staining, quick-drying type meeting ASTM C920, as Type S or M, minimum Grade NS, minimum Class 25 and compatible with the finish system type and grade, and recommended by both the sealant manufacturer and EIFS manufacturer.

2.14 BOND BREAKER

As required by EIFS manufacturer and recommended by sealant manufacturer and EIFS manufacturer.

2.15 BACKER ROD

Closed cell polyethylene free from oil or other staining elements and as recommended by sealant manufacturer and EIFS manufacturer. Do not use absorptive materials as backer rod. The backer rod should be sized 25 percent larger than the width of the joint.

PART 3 EXECUTION

3.1 EXAMINATION

Examine substrate and existing conditions to determine that the EIFS can be installed as required by the EIFS manufacturer and that all work

related to the EIFS is properly coordinated. Surface must be sound and free of oil, loose materials or protrusions which will interfere with the system installation. If deficiencies are found, notify the Contracting Officer and do not proceed with installation until the deficiencies are corrected. The substrate must be plane, with no deviation greater than 1/4 inch when tested with a 10 foot straightedge. Determine flatness, plumbness, and any other conditions for conformance to manufacturer's instructions.

3.2 SURFACE PREPARATION

Prepare existing surfaces for application of the EIFS to meet flatness tolerances and surface preparation according to manufacturer's installation instructions but provide a flatness of not more that 1/4 inch in 10 feet. Provide clean surfaces free of oil and loose material without protrusions adversely affecting the installation of the insulation board. For adhesively attached EIFS, existing deteriorated paint must be removed. Due to substrate conditions or as recommended by the system manufacturer, a primer may be required. Apply the primer to existing surfaces as recommended by the manufacturer. Use masking tape to protect areas adjacent to the EIFS to prevent base or finish coat to be applied to areas not intended to be covered with the EIFS. The contractor must not proceed with the installation until all noted deficiencies of the substrate are corrected.

3.3 INSTALLATION

Install EIFS as indicated, comply with manufacturer's instructions except as otherwise specified, and in accordance with the shop drawings. EIFS must be installed only by an applicator trained by the EIFS manufacturer. Specifically, include all manufacturer recommended provisions regarding flashing and treatment of wall penetrations. Any materials that show visual evidence of biological growth due to the presence of moisture must not be installed on the building project.

3.3.1 Sheathing Board

Edges and ends of boards must be butted snugly with vertical joints staggered to provide full and even support for the insulation. Do not align sheathing board joints with wall openings. Provide support at both vertical and horizontal joints. Attach sheathing board Place fasteners sufficiently close to support imposed loads, but not more than:

a. Maximum of 8 inches apart on each supporting stud

Space fasteners more closely when required for negative wind load resistance.

3.3.2 Insulation Board

Unless otherwise specified by the system manufacturer, place the long edge horizontally from level base line. Stagger vertical joints and interlock at corners. Butt joints tightly. Provide flush surfaces at joints. Offset insulation board joints from joints in sheathing by at least 8 inches. Align drainage channels of integral drainage system or provide polypropylene drainage lath space to provide a path for any water weeped from behind the insulation to escape wall construction. Use L-shaped insulation board pieces at corners of openings. Joints of insulation must be butted tightly. Surfaces of adjacent insulation boards must be flush

at joints. Gaps greater than 1/16 inch between the insulation boards must be filled with slivers of insulation. Uneven board surfaces with irregularities projecting more than 1/16 inch must be rasped in accordance with the manufacturer's instructions to produce an even surface. Attach insulation board as recommended by manufacturer. The adhered insulation board must be allowed to remain undisturbed for 24 hours prior to proceeding with the installation of the base coat/reinforcing mesh, or longer if necessary for the adhesive to dry. However, do not leave insulation board exposed longer than recommended by insulation manufacturer.

3.3.2.1 Mechanically Fastened Insulation Boards

Fasten with manufacturer's standard corrosion resistant anchors, spaced as recommended by manufacturer, but not more than 2 feet horizontally and vertically.

3.3.2.2 Adhesively Fastened Insulation Boards

Apply insulation board using adhesive spread with a notched trowel to the back of the insulation boards in accordance with the manufacturer’s instructions.

3.3.3 Base Coat and Reinforcing Fabric Mesh,

3.3.3.1 Class PB Systems

Allow the adhered insulation board to dry for 24 hours, or longer if necessary, prior to proceeding with the installation of the base coat/reinforcing fabric mesh. Install reinforcing fabric in accordance with manufacturer's instructions. Mix base coat in accordance with the manufacturer's instructions and apply to insulated wall surfaces to the thickness specified by the system manufacturer and provide any other reinforcement recommended by EIFS manufacturer. Trowel the reinforcing fabric mesh into the wet base coat material. Fully embed the mesh in the base coat. When properly worked-in, the pattern of the reinforcing fabric mesh must not be visible. Provide diagonal reinforcement at opening corners. Back-wrap or edge wrap all terminations of the EIFS. Overlap the reinforcing fabric mesh a minimum of 2.5 inches on previously installed mesh, or butted, in accordance with the manufacturer’s instructions.

3.3.3.2 Class PM Systems

Mechanically fasten reinforcing fabric mesh to the insulated wall using the type and spacing of fasteners specified in the manufacturer’s instructions. Provide diagonal reinforcement at opening corners. Mix base coat in accordance with manufacturer's instructions. Apply base coat in accordance with manufacturer's instruction to provide a complete, tight coating of uniform thickness as specified by the manufacturer. Cover all fiberglass reinforcing fabric, including at back wrapped areas at panel joints and at fasteners.

3.3.4 Finish Coat

The base coat/reinforcing mesh must be allowed to dry a minimum of 24 hours prior to application of the finish coat. Surface irregularities in the base coat, such as trowel marks, board lines, reinforcing mesh laps, etc., must be corrected prior to the application of the finish coat. Apply and level finish coat in one operation. Obtain final texture by

trowels, floats, or by spray application as necessary to achieve the required finish matching approved sample mock-up installation. Apply the finish coat to the dry base coat maintaining a wet edge at all times to obtain a uniform appearance. The thickness of the finish coat must be in accordance with the system manufacturer’s current published instructions. Apply finish coat so that it does not cover surfaces to which joint sealants are to be applied.

3.4 JOINT SEALING

Seal EIFS at openings as recommended by the system manufacturer. Apply sealant only to the base coat or base coat with EIFS Manufacturer's color coating. Do not apply sealant to the finish coat.

3.4.1 Surface Preparation, Backer Rod, and Primer

Immediately prior to application, remove loose matter from joint. Ensure that joint is dry and free of finish coat, or other foreign matter. Install backer rod. Apply primer as required by sealant and EIFS manufacturer. Check that joint width is as shown on drawings but in no case shall it be less than 0.5 inch for perimeter seals and 0.75 inch for expansion joints. The width must not be less than 4 times the anticipated movement. Check sealant manufacturer's recommendations regarding proper width to depth ratio.

3.4.2 Sealant

Do not apply sealant until all EIFS coatings are fully dry. Apply sealant in accordance with sealant manufacturer's instructions with gun having nozzle that fits joint width. Do not use sealant that has exceeded shelf life or cannot be discharged in a continuous flow. Completely fill the joint solidly with sealant without air pockets so that full contact is made with both sides of the joint. Tool sealant with a round instrument that provides a concave profile and a uniformly smooth and wrinkle free sealant surface. Do not wet tool the joint with soap, water, or any other liquid tooling aid. During inclement weather, protect the joints until sealant application. Use particular caution in sealing joints between window and door frames and the EIFS wall and at all other wall penetrations. Clean all surfaces to remove excess sealant.

3.5 FIELD QUALITY CONTROL

Throughout the installation, the contractor must establish and maintain an inspection procedure to assure compliance of the installed EIFS with contract requirements. Work not in compliance must be removed and replaced or corrected in an approved manner. The inspection procedures, from acceptance of deliveries through installation of sealants and final acceptance must be performed by qualified inspector trained by the manufacturer. No work on the EIFS is allowed unless the inspector is present at the job site.

3.5.1 Third Party Inspection

Provide full time third party inspection during the entire process of installing the EIFS, from examination through cleanup. The third party inspector must be certified by the Exterior Design Institute (EDI), AWCI, or by an equivalent independent party and must be trained in the proper installation of EIFS.

3.5.2 Inspection Check List

During the installation and at the completion of installation, perform inspections covering at the minimum all applicable items enumerated on the attached check list. The inspector must initial and date all applicable items, sign the check list, and submit it to the Contracting Officer at the completion of the EIFS erection.

CHECK LIST

Item	Description	Appr'd/Date
a.	Materials are handled and stored correctly.	_____ _____
b.	Environmental conditions are within specified limits, including temperature not below 4 degrees C (40 degrees F), and the work is protected from the elements as required.	_____ _____
c.	Preparation and installation is performed by qualified personnel using the correct tools.	_____ _____
d.	Adjacent areas to which EIFS is not to be applied (such as on window and door frames) are protected with masking tape, plastic films, drop cloths, etc. to prevent accidental application of EIFS materials.	_____ _____
e.	Control, expansion and aesthetic joints are installed as indicated or recommended. Accessories are properly installed.	_____ _____
f.	Substrate is in-plane, properly attached, clean, dry, and free of contaminants. Concrete substrate is free of efflorescence.	_____ _____
g.	Materials are mixed thoroughly and in proper proportions.	_____ _____
h.	Adhesive is applied in sufficient quantity with proper-size notched trowel.	_____ _____
i.	Mechanical attachments have proper spacing, layout and fastener depth.	_____ _____
j.	Insulation boards are tightly abutted, in running bond pattern, with joints staggered with the sheathing, board corners interlocked, L-shaped boards around openings, edges free of adhesive, and provision for joints. Gaps are filled and surfaces rasped.	_____ _____
k.	Insulation adhesive must be allowed to dry (a minimum of 24-hours) prior to the application of the base coat.	_____ _____
l.	Reinforcing fabric mesh is properly back-wrapped at terminations.	_____ _____
m.	Reinforcing fabric mesh is fully embedded and properly placed. Corners are reinforced. Openings are diagonally reinforced. Mesh overlaps minimum 65 mm (2-1/2 inches).	_____ _____

CHECK LIST

Item	Description	Appr'd/Date
n.	Base coat thickness is within specified limits.	_____
o.	The base coat/reinforcing fabric mesh must be allowed to dry (a minimum of 24-hours) prior to the application of the finish coat.	_____
p.	Finish coat is applied with sufficient number of personnel and stopped at suitable points. Floats and methods of texturing are uniform.	_____
q.	All flashings are properly installed.	_____
r.	All joints are properly sealed in their entire length at time and under environmental conditions as specified by the manufacturer.	_____
s.	All scaffolding, equipment, materials, debris and temporary protection are removed from site upon completion.	_____

Name of Inspector:_____ Signed:_____
Date:_____

3.6 CLEANUP

Upon completion, remove all scaffolding, equipment, materials and debris from site. Remove all temporary protection installed to facilitate installation of EIFS.

-- End of Section --

SECTION 07 54 19

POLYVINYL-CHLORIDE ROOFING
02/13, CHG 3: 02/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI/SPRI ES-1	(2003) Wind Design Standard for Edge Systems Used with Low Slope Roofing Systems

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)

ASCE 7-16	(2017; Errata 2018; Supp 1 2018) Minimum Design Loads and Associated Criteria for Buildings and Other Structures

AMERICAN SOCIETY OF SAFETY PROFESSIONALS (ASSP)

ASSP A10.24	(2014) Roofing - Safety Requirements of Low-Sloped Roofs

ASTM INTERNATIONAL (ASTM)

ASTM D4434/D4434M	(2015) Standard Specification for Poly(Vinyl Chloride) Sheet Roofing
ASTM D6754/D6754M	(2010) Standard Specification for Ketone Ethylene Ester Based Sheet Roofing
ASTM E108	(2020a) Standard Test Methods for Fire Tests of Roof Coverings

FM GLOBAL (FM)

FM 4470	(2016) Single-Ply, Polymer-Modified Bitumen Sheet, Built-up Roof (BUR), and Liquid Applied Roof Assemblies for Use in Class 1 and Noncombustible Roof Deck Construction
FM APP GUIDE	(updated on-line) Approval Guide http://www.approvalguide.com/

NATIONAL ROOFING CONTRACTORS ASSOCIATION (NRCA)

NRCA 3621	(2017) Quality Control and Quality-assurance Guidelines for the Application of Membrane Roof Systems

NRCA 3740 (2005) The NRCA Waterproofing Manual

UNDERWRITERS LABORATORIES (UL)

UL 790 (2004; Reprint Jul 2014) Standard Test Methods for Fire Tests of Roof Coverings

1.2 SUMMARY

Adhered polyvinyl-chloride (PVC) roof membrane system applied over recovery board.

1.3 ASSEMBLY REQUIREMENTS

Provide roofing membrane sheet widths consistent with membrane attachment methods and wind uplift requirements, and as large as practical. In order to minimize joints and 3-way overlaps, prefabricated sheets are not accepted. Provide membrane which is free of defects and foreign material. Coordinate flashing work to permit continuous roof-surfacing operations. Install insulation and weatherproofed planned sections on the same day.

1.3.1 Fire Resistance

Complete roof system assembly:

a. Class A rated in accordance with ASTM E108, FM 4470, or UL 790; and

b. Be listed as Class I roof deck construction in FM APP GUIDE.

FM or UL approved components of the roof covering assembly must bear the appropriate FM or UL label.

1.3.2 Wind Uplift Resistance

Provide a complete roof system assembly that is rated and installed to resist wind loads indicate and validated by uplift resistance testing in accordance with Factory Mutual (FM) test procedures. Do not install non-rated systems, except as approved by the Contracting Officer. Submit Engineering calculations, signed, sealed, and dated by a Registered Engineer validating the wind resistance per ASCE 7-16, and ANSI/SPRI ES-1 of non-rated roof system. Base wind uplift measurements on a design wind speed of as indicated on structural drawings mph in accordance with ASCE 7-16 and other applicable building code requirements.

1.3.3 Solar Reflectance Index (SRI)

SRI measures the roof's ability to reject solar heat, defined such that a standard black (reflectance 0.05, emittance 0.90) is 0 and a standard white (reflectance 0.80, emittance 0.90) is 100. Use roofing materials having minimum appropriate SRI for more than 75 percent of roof surface (low slope (less than 2:12) SRI greater than 78; high slope (greater than 2:12) SRI greater than 29).

1.4 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL

PROCEDURES:

SD-02 Shop Drawings

Detail Drawings; G

Roof Plan; G

SD-03 Product Data

PVC Roofing Membrane; G

Bonding Adhesive

Flashing

Protection Mat

Pre-Manufactured Accessories

Water Cutoffs

Information Card

SD-05 Design Data

Wind Uplift Resistance; G

SD-07 Certificates

Qualification of Manufacturer

Wind Uplift Resistance

Fire Resistance classification

Minimum Polymer Thickness

Sample Warranty; G

SD-08 Manufacturer's Instructions

Application Method; G

Membrane Flashing; G

Perimeter Attachment

Auxiliary Fasteners

Protection Mat

Pre-Manufactured Accessories

Cold Weather; G

SD-11 Closeout Submittals

Warranty; G

Information Card; G

Instructions to Government Personnel; G

1.5 QUALITY ASSURANCE

1.5.1 Qualification of Manufacturer

Polyvinyl-Chloride sheet roofing system manufacturer must have a minimum of 5 years experience in manufacturing PVC roofing products.

1.5.2 Qualifications of Applicator

Roofing system applicator must be approved, authorized, or licensed in writing by the PVC sheet roofing system manufacturer and have a minimum of five years experience as an approved, authorized, or licensed applicator with that manufacturer and be approved at a level capable of providing the specified warranty. Supply the names, locations and client contact information of five projects, within the previous three years, of similar size and scope that the applicator has constructed using the manufacturer's roofing products submitted for this project.

1.5.3 Conformance and Compatibility

Provide an entire roofing and flashing system that is in accordance with specified and indicated requirements, including fire and wind resistance.

1.5.4 Preroofing Conference

After approval of submittals and before performing roofing system installation work, hold a preroofing conference to review the following:

a. Drawings, including roof plan, specifications and submittals related to the roof work.

b. Roof system components installation;

c. Procedure for the roof manufacturer's technical representative's onsite inspection and acceptance of the roofing substrate, and roofing substrate, the name of the manufacturer's technical representatives, the frequency of the onsite visits, distribution of copies of the inspection reports from the manufacturer's technical representative to roof manufacturer;

d. Contractor's plan for coordination of the work of the various trades involved in providing the roofing system and other components secured to the roofing; and

e. Quality control(NRCA 3621) plan for the roof system installation;

f. Safety requirements.

Coordinate preroofing conference scheduling with the Contracting Officer. The conference must be attended by the Contractor, the Contracting Officer's designated personnel, personnel directly responsible for the installation of roofing, flashing and sheet metal work, mechanical and electrical work, other trades interfacing with the roof work, designated

safety personnel trained to enforce and copy with ASSP A10.24, and a representative of the roofing materials manufacturer. Before beginning roofing work, provide a copy of meeting notes and action items to all attending parties. Note action items requiring resolution prior to start of roof work.

1.6 DETAIL DRAWINGS

Submit roof plan depicting wind loads and boundaries of enhanced perimeter and corner attachments of roof system components, as applicable. Provide drawings that reflect the project roof plan of each roof level and conditions indicated. Submit bids with approved detail drawings and specifications approved and furnished by the PVC membrane manufacturer.

1.7 DELIVERY, STORAGE, AND HANDLING

1.7.1 Delivery

Deliver materials in the manufacturer's original, unopened containers and rolls with labels intact and legible. Mark and remove wet or damaged materials from the site. Where materials are covered by a referenced specification number, the container must bear the specification number, type, class, and shelf life expiration date where applicable. Deliver materials in sufficient quantity to allow work to proceed without interruption.

1.7.2 Storage

Protect materials against moisture absorption and contamination or other damage. Avoid crushing or crinkling of roll materials. Store roll materials on end on clean raised platforms or pallets one level high in dry locations with adequate ventilation, such as an enclosed building or closed trailer. Do not store roll materials in buildings under construction until concrete, mortar, and plaster work is finished and dry. Maintain roll materials at temperatures above 50 degrees F for 24 hours immediately before application. Do not store materials outdoors unless approved by the Contracting Officer. Completely cover felts stored outdoors, on and off roof, with waterproof canvas protective covering. Do not use polyethylene sheet as a covering. Tie covering securely to pallets to make completely weatherproof. Provide sufficient ventilation to prevent condensation. Do not store more materials on roof than can be installed the same day and remove unused materials at end of each days work. Distribute materials temporarily stored on roof to stay within live load limits of the roof construction.

a. Maintain a minimum distance of 35 foot for all stored flammable materials, including materials covered with shrink wraps, craft paper or tarps from all torch/welding applications.

b. Immediately remove wet, contaminated or otherwise damaged or unsuitable materials from the site. Damaged materials may be marked by the Contracting Officer.

1.7.3 Handling

Prevent damage to edges and ends of roll materials. Do not install damaged materials in the work. Select and operate material handling equipment to prevent damage to materials or applied roofing.

1.8 ENVIRONMENTAL REQUIREMENTS

Do not install roofing system when air temperature is below 40 degrees F, during any form of precipitation, including fog, or when there is ice, frost, moisture, or any other visible dampness on the roof deck. Follow manufacturer's printed instructions for Cold Weather Installation.

1.9 SEQUENCING

Coordinate the work with other trades to ensure that components which are to be secured to or stripped into the roofing system are available and that permanent flashing and counterflashing in accordance with NRCA 3740, are installed as the work progresses. Ensure temporary protection measures are in place to preclude moisture intrusion or damage to installed materials.

1.10 WARRANTY

Provide roof system material and workmanship warranties. Provide revision or amendment to standard membrane manufacturer warranty as required to comply with the specified requirements. Provide a manufacturer's warranty that has no dollar limit, covers full system water-tightness, and has a minimum duration of 20 years. Submit sample certificate.

1.10.1 Roof Membrane Manufacturer Warranty

Furnish the roof membrane manufacturer's 20-year, no dollar limit roof system materials and installation workmanship warranty, including flashing, insulation, and accessories necessary for a watertight roof system construction. Provide warranty directly to the Government commencing at the time of Government's acceptance of the building. The warranty must state that:

a. If within the warranty period the roof system, as installed for its intended use in the normal climatic and environmental conditions of the facility, becomes non-watertight, shows evidence of moisture intrusion within the assembly, splits, tears, cracks, delaminates, separates at the seams, or shows evidence of excessive weathering due to defective materials or installation workmanship, the repair or replacement of the defective and damaged materials of the roof system assembly and correction of defective workmanship are the responsibility of the roof membrane manufacturer. All costs associated with the repair or replacement work are the responsibility of the roof membrane manufacturer.

b. When the manufacturer or his approved applicator fail to perform the repairs within 72 hours of notification, emergency temporary repairs performed by others does not void the warranty.

1.10.2 Roofing System Installer Warranty

The roof system installer must warrant for a minimum period of two years that the roof system, as installed, is free from defects in installation workmanship, to include the roof membrane, flashing, insulation, accessories, attachments, and sheet metal installation integral to a complete watertight roof system assembly. Write the warranty directly to the Government. The roof system installer is responsible for correction of defective workmanship and replacement of damaged or affected materials. The roof system installer is responsible for all costs

associated with the repair or replacement work.

1.10.3 Continuance of Warranty

Repair or replacement work that becomes necessary within the warranty period must be approved, as required, and accomplished in a manner so as to restore the integrity of the roof system assembly and validity of the manufacturer warranty for the remainder of the manufacturer warranty period.

PART 2 PRODUCTS

2.1 MATERIALS

Coordinate with other specification sections related to the roof work. Furnish a combination of specified materials that comprise a roof system acceptable to the roof membrane manufacturer and meeting specified requirements. Protect materials provided from defects and make suitable for the service and climatic conditions of the installation.

2.1.1 PVC Roof Membrane

Provide a minimum polymer thickness 0.072 inch reinforced PVC as specified herein. Provide PVC system capable of obtaining 20 year warranties and as listed in the applicable wind uplift and fire rating classification listings.

Provide data that includes written acceptance by the roof membrane manufacturer of the coverboard and other products and accessories to be provided by and warranted under the full system guarantee of the roof membrane manufacturer.

a. Coordinate with other specification sections related to the roof work. Furnish a combination of specified materials that comprise a roof system acceptable to the roof membrane manufacturer and meeting specified requirements. Provide materials free of defects and suitable for the service and climatic conditions of the installation. Provide warranted roof system in which all components are sourced from the PVC roof membrane manufacturer, including but not limited to all coverboards, accessories, adhesives and edge metal.

b. For each roof, furnish a typewritten information card for facility records and a card laminated in plastic and framed for interior display at roof access point, or a photoengraved 0.032 inch thick aluminum card for exterior display. Provide card that is 8 1/2 by 11 inches minimum. On the information card identify facility name and number; location; contract number; approximate roof area; detailed roof system description, including deck type, membrane, number of plies, method of application, manufacturer, insulation and cover board system and thickness; presence of tapered insulation for primary drainage, presence of vapor retarder; date of completion; installing Contractor identification and contact information; membrane manufacturer warranty expiration, warranty reference number, and contact information. Install card at roof top or access location as directed by the Contracting Officer and provide a paper copy to the Contracting Officer.

2.1.2 Bonding Adhesive

Provide PVC membrane manufacturer's recommended adhesive, as supplied by roof membrane manufacturer, and recommended by the manufacturer's printed data for bonding of PVC membrane materials to acceptable wood, metal, concrete or other acceptable substrate materials. Do not use bonding adhesive to bond membrane materials to each other.

2.1.3 Water Cutoff Mastic/Water Block

As supplied by the roof membrane manufacturer and recommended by the manufacturer's printed data.

2.1.4 Membrane Flashing

Provide membrane flashing, including self-adhering membrane flashing, perimeter flashing, flashing around roof penetrations and prefabricated pipe seals, of a minimum polymer thickness 0.072 inch reinforced PVC for 20 year warranties, and utilized as recommended and supplied by the roof membrane manufacturer or minimum 0.072 inch thick reinforced PVC roof membrane and flashings for 20 year warranties. Submit certification from PVC membrane manufacturer that the proposed PVC membrane roofing product meets the minimum polymer thickness specified.

2.1.5 Membrane Fasteners and Plates

2.1.5.1 Auxiliary Fasteners

Provide corrosion resistant screws, nails, or anchors suitable for intended attachment purpose and be recommended and supplied for use by the PVC roof membrane manufacturer.

2.1.6 Pre-manufactured Accessories

Provide pre-manufactured accessories shall be manufacturer's standard for intended purpose, must comply with applicable specification section, be compatible with the membrane roof system and approved for use and supplied by the PVC roof membrane manufacturer.

2.1.7 Wood Products

As specified in Section 06 10 00 ROUGH CARPENTRY, except that fire retardant treated materials must not be in contact with PVC membrane or PVC accessory products, unless approved by the membrane manufacturer and the Contracting Officer.

2.2 Reinforced, PVC Membrane

Provide reinforced polyvinyl chloride (PVC) membrane containing fibers or scrim, and complying with ASTM D4434/D4434M, Type II, Grade I, or ASTM D6754/D6754M, and in all cases provide 0.072 inch minimum thickness for adhered application. Not withstanding the ASTM standards referenced, provide reinforced PVC roof membranes having the minimum, labeled thickness specified. PVC membrane thickness specified herein is exclusive of backing material on the bottom of fleece-backed membrane. Provide principal polymer used in manufacture of the membrane sheet as PVC, with width and length of PVC membrane roofing sheet consistent with membrane attachment methods and wind uplift requirements, and sheet size as large as practical. In order to minimize joints and 3-way overlaps,

prefabricated sheets are not accepted. Maximum reinforced PVC membrane roofing sheet dimensions to be the maximum width obtainable from PVC membrane roof manufacturer in order to minimize seams in the field of the roof.

PART 3 EXECUTION

3.1 EXAMINATION

Ensure that the following conditions exist prior to application of the roofing materials:

a. Do not install items that show visual evidence of biological growth.

b. Expansion joints, roof penetrating components, are in place.

c. Surfaces are rigid, clean, dry, smooth, and free from cracks, holes, and sharp changes in elevation.

d. Substrate is sloped to provide positive drainage.

e. Walls and vertical surfaces are constructed to receive counterflashing, and will permit mechanical fastening of the base flashing materials.

f. Treated wood nailers are in place on non-nailable surfaces, to permit nailing of base flashing at minimum height of 8 inches above finished roofing surface.

g. Pressure-preservative treated wood nailers are fastened in place at eaves, gable ends, openings, and intersections with vertical surfaces for securing of membrane, edging strips, attachment flanges of sheet metal, and roof fixtures.

h. PVC materials are not in contact with fire retardant treated wood, except as approved by the PVC membrane roof manufacturer and Contracting Officer.

j. Exposed nail heads in wood substrates are properly set. Warped and split sheets have been replaced. There are no cracks or end joints 1/4 inch in width or greater. Joints in plywood substrates are taped or otherwise sealed to prevent air leakage from the underside.

k. Cover boards are installed smoothly and evenly, and are not broken, cracked, or curled. There are no gaps in cover board joints exceeding 1/4 inch in width.

3.2 APPLICATION METHOD

Apply entire PVC membrane roofing utilizing adhered application method. Apply roofing materials as specified herein unless approved otherwise by the Contracting Officer.

3.2.1 Special Precautions

a. Do not dilute coatings or sealants unless specifically recommended by the material manufacturer's printed application instructions. Do not thin liquid materials or cleaners used for cleaning PVC sheet.

b. Keep liquids in airtight containers, and keep containers closed except when removing materials.

c. Use liquid components, including adhesives, within their shelf life period. Store adhesives at 60 to 80 degrees F prior to use. Avoid excessive adhesive application and adhesive spills, as they can be destructive to some thermoplastic sheets and insulations; follow adhesive manufacturer's printed application instructions. Mix and use liquid components in accordance with label directions and manufacturer's printed instructions.

d. Provide clean, dry cloths or pads for applying membrane cleaners and cleaning of membrane.

e. Do not use heat guns or open flame to expedite drying of adhesives or primers.

f. Require workmen and others who walk on the membrane to wear clean, soft-soled shoes to avoid damage to roofing materials.

g. Do not use equipment with sharp edges which could puncture the PVC membrane roofing sheet.

3.2.2 PVC Roofing Membrane

Provide a watertight roof membrane sheet free of contaminants and defects that might affect serviceability. Provide a uniform, straight, and flat edge. Provide membrane overlap of a minimum of 3 inches at sides for adhered applications and minimum 4 inches at ends. Direction of laps must allow water to flow over and not against the lap. Install membrane joints that are free of wrinkles and fishmouths. During the day of installation, probe the entire length of hot-air-welded seams and correct any deficiencies. Reweld defective areas. Cut out any fishmouths, or damaged areas and cover the area with membrane using a continuous hot-air-welded seam on all sides. Probe test repairs for continuity. Hot-air-welded seams are to be accomplished in accordance with the PVC membrane roofing manufacturer's published requirements.

3.2.2.1 Nailing

Fasten membrane to nailers in accordance with the membrane manufacturer's approved instructions. Unless otherwise specified, stagger nails on 4 inch centers maximum; stagger screws for sheet metal on 8 inch centers maximum; and install rows of fasteners at least 1/2 inch from edges of sheet metal.

3.2.2.2 Flashing

Flash all roof edges, projections through the roof and changes in roof planes. Seal the seam a minimum of 3 inches beyond the fasteners which attach the membrane to nailers. Secure the installed flashing at the top of the flashing a maximum of12 inches on centers under the counterflashing or cap. Where possible, install prefabricated components for pipe seals and flashing accessories.

3.2.2.3 Expansion Joints

Cover expansion joints using Prefabricated covers or elastomeric flashing in accordance with the recommendations of the manufacturer.

3.2.2.4 Cutoffs

If work is terminated prior to weatherproofing the entire roof, seal the membrane to the roof deck. Also, seal flutes in metal decking along the cutoff edge. Pull the membrane free or cut to expose the insulation when resuming work and remove the cut insulation sheets used for fill-in. Do not use asphalt or coal-tar products for sealing.

3.2.3 Adhered Membrane Application

Layout membrane and side lap adjoining sheets in accordance with membrane manufacturer's printed installation instructions. Allow for sufficient membrane to form proper membrane terminations. Remove dusting agents and dirt from membrane and substrate areas where bonding adhesives are to be applied. Apply specified adhesive evenly and continuously to substrate at rates recommended by the roof membrane manufacturer's printed application instructions. When adhesive is spray applied, roll with a paint roller to ensure proper contact and coverage. Do not apply bonding adhesive to surfaces of membrane in seam or lap areas. Allow adhesive to flash off or dry to consistency prescribed by manufacturer before adhering sheets to the substrate. When adhesive is peel and stick release paper-activated, follow manufacturer's printed instructions. Roll each sheet into adhesive slowly and evenly to avoid wrinkles; broom or roll the membrane to remove air pockets and fishmouths and to ensure adequately uniform bonding of sheet to substrate. Form field hot-air-welded laps or seams as specified and ensure that hot-air welded dimension is at width required by the membrane manufacturer's installation instructions. Check all seams and continuous hot-air-weld of all seams and lap seals.

3.2.4 Perimeter Attachment

Adhesive bond or mechanically secure roof membrane sheet at roof perimeter in a manner to comply with wind resistance requirements and in accordance with membrane manufacturer's printed application instructions.

3.3 FLASHINGS

Provide flashings in the angles formed at walls and other vertical surfaces and where required to make the work watertight, except where metal flashings are indicated.

3.3.1 General

Provide a one-ply flashing membrane, as specified for the system used, and install immediately after the roofing membrane is placed and prior to finish coating where a finish coating is required. Exposed joints and end laps of flashing membrane must be made and sealed in the manner required for roofing membrane.

3.3.2 Membrane Flashing

3.3.2.1 Installation

Install flashing and flashing accessories as the roof membrane is installed. Apply flashing to cleaned surfaces and as recommended by the roof membrane manufacturer and as specified. Utilize cured PVC membrane flashing and prefabricated accessory flashings to the maximum extent recommended by the roof membrane manufacturer. Limit uncured flashing

material to reinforcing inside and outside corners and angle changes in plane of membrane, and to flashing scuppers, and other formed penetrations or unusually shaped conditions as recommended by the roof membrane manufacturer where the use of cured material is impractical. Extend base flashing not less than 8 inch above roofing surface and as necessary to provide for seaming overlap on roof membrane as recommended by the roof membrane manufacturer.

3.3.2.2 Sealing

Seal flashing membrane for a minimum of 3 inch on each side of fastening device used to anchor roof membrane to nailers. Completely adhere flashing sheets in place. Seam flashing membrane in the same manner as roof membrane, except as otherwise recommended by the membrane manufacturer's printed instructions and approved by the Contracting Officer. Reinforce all corners and angle transitions by applying uncured membrane to the area in accordance with roof membrane manufacturer recommendations.

3.4 CORRECTION OF DEFICIENCES

Where any form of deficiency is found, take additional measures as deemed necessary by the Contracting Officer to determine the extent of the deficiency and provide corrective action recommendations. Perform corrective action as directed by the Contracting Officer.

3.5 PROTECTION OF APPLIED ROOFING

At the end of the day's work and when precipitation is imminent, protect applied membrane roofing system from water intrusion.

3.5.1 Water Cutoffs

Straighten insulation line using loose-laid cut insulation sheets and seal the terminated edge of the roof membrane system in an effective manner.

3.5.2 Temporary Walkways, Runways, and Platforms

Do not permit storing, walking, wheeling, and trucking directly on applied roofing system. Provide temporary walkways, runways, and platforms of smooth clean boards, mats or planks as necessary to avoid damage to applied roofing materials, and to distribute weight to conform to live load limits of roof construction. Use rubber-tired equipment for roofing work.

3.6 FIELD QUALITY CONTROL

3.6.1 Construction Monitoring

During progress of the roof work, make visual inspections as necessary to ensure compliance with specified parameters. Additionally, verify the following:

a. Equipment is in working order. Metering devices are accurate.

b. Materials are not installed in adverse weather conditions.

c. Substrates are in acceptable condition, in compliance with specification, prior to application of subsequent materials.

(1) Nailers and blocking are provided where and as needed.

(2) Coverboard substrate is smooth, properly secured to its substrate, and without excessive gaps prior to membrane application.

(3) The proper number, type, and spacing of fasteners are installed.

(4) Materials comply with the specified requirements.

(5) All materials are properly stored, handled and protected from moisture or other damages. Liquid components are properly mixed prior to application.

(6) Adhesives are applied uniformly to both mating surfaces and checked for proper set prior to bonding mating materials. Mechanical attachments are spaced as required, including additional fastening of membrane in corner and perimeter areas as required.

(7) Membrane is properly overlapped.

(8) Membrane seaming is as specified by PVC membrane manufacturer. All seams are checked at the end of each work day.

(9) Membrane is adhered without ridges, wrinkles, kinks, fishmouths.

(10) Installer adheres to specified and detailed application parameters.

(11) Associated flashing's and sheet metal are installed in a timely manner in accord with the specified requirements.

(12) Temporary protection measures are in place at the end of each work shift.

3.6.2 Manufacturer's Inspection

Manufacturer's technical representative must visit the site a minimum of 3 times during the installation for purposes of reviewing materials installation practices and adequacy of work in place. Inspections must occur during start of membrane installation, at mid-point of the installation, and at substantial completion, at a minimum. After each inspection, a report, signed by the manufacturer's technical representative to the roofing Contractor and then to the Contracting Officer within 3 working days. Within the report state the overall quality of work, deficiencies and any other concerns, and recommended corrective action.

3.7 CLEAN UP

Remove debris, scraps, containers and other rubbish and trash resulting from installation of the roofing system from job site each day.

3.8 INSTRUCTIONS TO GOVERNMENT PERSONNEL

Furnish written and verbal instructions on proper maintenance procedures to designated Government personnel. Furnish instructions by a competent representative of the roof membrane manufacturer and include a minimum of

4 hours on maintenance and emergency repair of the membrane. Include a demonstration of membrane repair, and give sources of required special tools. Furnish information on safety requirements during maintenance and emergency repair operations. Include copies of Safety Data Sheets for maintenance/repair materials.

3.9 ROOF DRAIN TEST

After completing roofing but prior to Government acceptance, perform the following test for watertightness. Plug roof drains and fill with water to edge of drain sump for 8 hours. Do not plug secondary overflow drains at the same time as adjacent primary drain. To ensure some drainage from roof, do not test all drains at same time. Measure water at beginning and end of the test period. When precipitation occurs during test period, repeat test. When water level falls, remove water, thoroughly dry, and inspect installation; repair or replace roofing at drain to provide for a properly installed watertight flashing seal. Repeat test until there is no water leakage.

-- End of Section --

SECTION 07 60 00

FLASHING AND SHEET METAL
08/08

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)

ASCE 7-16	Minimum Design Loads and Associated Criteria for Buildings and Other Structures

ASTM INTERNATIONAL (ASTM)

ASTM A480/A480M	(2019a) Standard Specification for General Requirements for Flat-Rolled Stainless and Heat-Resisting Steel Plate, Sheet, and Strip
ASTM A653/A653M	(2019) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM B101	(2012; R 2019) Standard Specification for Lead-Coated Copper Sheet and Strip for Building Construction
ASTM B209	(2014) Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
ASTM B221	(2014) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes
ASTM B32	(2008; R 2014) Standard Specification for Solder Metal
ASTM B370	(2012; R 2019) Standard Specification for Copper Sheet and Strip for Building Construction
ASTM B69	(2013) Standard Specification for Rolled Zinc

INTERNATIONAL CODE COUNCIL (ICC)

ICC IBC	(2018) International Building Code

NATIONAL ROOFING CONTRACTORS ASSOCIATION (NRCA)

NRCA RoofMan	(2017) The NRCA Roofing Manual

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)

SMACNA 1793	(2012) Architectural Sheet Metal Manual, 7th Edition

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 1-200-01	(2019) DoD Building Code
UFC 3-110-03	Unified Facilities Criteria (UFC) Roofing 1 May 2012, Change 4, 29 October 2019.

1.2 GENERAL REQUIREMENTS

Finished sheet metalwork will form a weathertight construction without waves, warps, buckles, fastening stresses or distortion, which allows for expansion and contraction. Sheet metal mechanic is responsible for cutting, fitting, drilling, and other operations in connection with sheet metal required to accommodate the work of other trades. Coordinate installation of sheet metal items used in conjunction with roofing with roofing work to permit continuous roofing operations.

1.2.1 Compliance

All work required by this section shall comply with the requirements of, but not limited to, the following:

ASCE 7-16
ICC IBC
NRCA RoofMan
SMACNA
UFC 1-200-01
UFC 3-110-03

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Covering on flat, sloped, or curved surfaces; G

Gutters; G

Downspouts; G

Expansion joints; G

Base flashing; G

Counterflashing; G

Flashing at roof penetrations; G

Eave flashing; G

Indicate thicknesses, dimensions, fastenings and anchoring methods, expansion joints, and other provisions necessary for thermal expansion and contraction. Scaled manufacturer's catalog data may be submitted for factory fabricated items.

1.4 DELIVERY, HANDLING, AND STORAGE

Package and protect materials during shipment. Uncrate and inspect materials for damage, dampness, and wet-storage stains upon delivery to the job site. Remove from the site and replace damaged materials that cannot be restored to like-new condition. Handle sheet metal items to avoid damage to surfaces, edges, and ends. Store materials in dry, weather-tight, ventilated areas until immediately before installation.

PART 2 PRODUCTS

2.1 MATERIALS

Use any metal listed by SMACNA Arch. Manual for a particular item, unless otherwise specified or indicated. Conform to the requirements specified and to the thicknesses and configurations established in SMACNA Arch. Manual for the materials. Different items need not be of the same metal, except that if copper is selected for any exposed item, all exposed items must be copper.

Furnish sheet metal items in 8 to 10 foot lengths. Single pieces less than 8 feet long may be used to connect to factory-fabricated inside and outside corners, and at ends of runs. Factory fabricate corner pieces with minimum 12 inch legs. Provide accessories and other items essential to complete the sheet metal installation. Provide accessories made of the same or compatible materials as the items to which they are applied. Fabricate sheet metal items of the materials specified below and to the gage, thickness, or weight shown in Table I at the end of this section. Provide sheet metal items with mill finish unless specified otherwise. Where more than one material is listed for a particular item in Table I, each is acceptable and may be used except as follows:

2.1.1 Exposed Sheet Metal Items

Must be of the same material. Consider the following as exposed sheet metal: gutters, including hangers; downspouts; fascias; cap, valley, steeped, base, and eave flashings and related accessories.

2.1.2 Copper, Sheet and Strip

ASTM B370, cold-rolled temper, H 00 (standard).

2.1.3 Lead-Coated Copper Sheet

ASTM B101.

2.1.4 Lead Sheet

Minimum weight 4 pounds per square foot.

2.1.5 Steel Sheet, Zinc-Coated (Galvanized)

ASTM A653/A653M.

2.1.5.1 Finish

Exposed exterior items of zinc-coated steel sheet must have a baked-on, factory-applied color coating of polyvinylidene fluoride or other equivalent fluorocarbon coating applied after metal substrates have been cleaned and pretreated. Provide finish coating dry-film thickness of 0.8 to 1.3 mils and color as indicated on drawings.

2.1.6 Zinc Sheet and Strip

ASTM B69, Type I, a minimum of 0.024 inch thick.

2.1.7 Stainless Steel

ASTM A480/A480M, Type 302 or 304, 2D Finish, fully annealed, dead-soft temper.

2.1.8 Aluminum Alloy Sheet and Plate

ASTM B209 anodized clear form alloy, and temper appropriate for use.

2.1.8.1 Finish

Exposed exterior sheet metal items of aluminum must have a baked-on, factory-applied color coating of polyvinylidene fluoride (PVF2) or other equivalent fluorocarbon coating applied after metal substrates have been cleaned and pretreated. Provide finish coating dry-film thickness of 0.8 to 1.3 mils and color as indicated on drawings.

2.1.9 Aluminum Alloy, Extruded Bars, Rods, Shapes, and Tubes

ASTM B221.

2.1.10 Solder

ASTM B32, 95-5 tin-antimony.

2.1.11 Fasteners

Use the same metal or a metal compatible with the item fastened. Use stainless steel fasteners to fasten dissimilar materials.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Workmanship

Make lines and angles sharp and true. Free exposed surfaces from visible wave, warp, buckle, and tool marks. Fold back exposed edges neatly to form a 1/2 inch hem on the concealed side. Make sheet metal exposed to the weather watertight with provisions for expansion and contraction.

Make surfaces to receive sheet metal plumb and true, clean, even, smooth, dry, and free of defects and projections. For installation of items not

shown in detail or not covered by specifications conform to the applicable requirements of SMACNA 1793, Architectural Sheet Metal Manual. Provide sheet metal flashing in the angles formed where roof decks abut walls, curbs, ventilators, pipes, or other vertical surfaces and wherever indicated and necessary to make the work watertight. Join sheet metal items together as shown in Table II.

3.1.2 Nailing

Confine nailing of sheet metal generally to sheet metal having a maximum width of 18 inch. Confine nailing of flashing to one edge only. Space nails evenly not over 3 inch on center and approximately 1/2 inch from edge unless otherwise specified or indicated. Face nailing will not be permitted. Where sheet metal is applied to other than wood surfaces, include in shop drawings, the locations for sleepers and nailing strips required to secure the work.

3.1.3 Cleats

Provide cleats for sheet metal 18 inch and over in width. Space cleats evenly not over 12 inch on center unless otherwise specified or indicated. Unless otherwise specified, provide cleats of 2 inch wide by 3 inch long and of the same material and thickness as the sheet metal being installed. Secure one end of the cleat with two nails and the cleat folded back over the nailheads. Lock the other end into the seam. Where the fastening is to be made to concrete or masonry, use screws and drive in expansion shields set in concrete or masonry. Pretin cleats for soldered seams.

3.1.4 Bolts, Rivets, and Screws

Install bolts, rivets, and screws where indicated or required. Provide compatible washers where required to protect surface of sheet metal and to provide a watertight connection. Provide mechanically formed joints in aluminum sheets 0.040 inch or less in thickness.

3.1.5 Seams

Straight and uniform in width and height with no solder showing on the face.

3.1.5.1 Flat-lock Seams

Finish not less than 3/4 inch wide.

3.1.5.2 Lap Seams

Finish soldered seams not less than one inch wide. Overlap seams not soldered, not less than 3 inch.

3.1.5.3 Loose-Lock Expansion Seams

Not less than 3 inch wide; provide minimum one inch movement within the joint. Completely fill the joints with the specified sealant, applied at not less than 1/8 inch thick bed.

3.1.5.4 Standing Seams

Not less than one inch high, double locked without solder.

3.1.5.5 Flat Seams

Make seams in the direction of the flow.

3.1.6 Soldering

Where soldering is specified, apply to copper, terne-coated stainless steel, zinc-coated steel, and stainless steel items. Pretin edges of sheet metal before soldering is begun. Seal the joints in aluminum sheets of 0.040 inch or less in thickness with specified sealants. Do not solder aluminum.

3.1.6.1 Edges

Scrape or wire-brush the edges of lead-coated material to be soldered to produce a bright surface. Flux brush the seams in before soldering. Treat with soldering acid flux the edges of stainless steel to be pretinned. Seal the joints in aluminum sheets of 0.040 inch or less in thickness with specified sealants. Do not solder aluminum.

3.1.7 Welding and Mechanical Fastening

Use welding for aluminum of thickness greater than 0.040 inch. Aluminum 0.040 inch or less in thickness must be butted and the space backed with formed flashing plate; or lock joined, mechanically fastened, and filled with sealant as recommended by the aluminum manufacturer.

3.1.8 Protection from Contact with Dissimilar Materials

3.1.8.1 Copper or Copper-bearing Alloys

Paint with heavy-bodied bituminous paint surfaces in contact with dissimilar metal, or separate the surfaces by means of moistureproof building felts.

3.1.8.2 Metal Surfaces

Paint surfaces in contact with mortar, concrete, or other masonry materials with alkali-resistant coatings such as heavy-bodied bituminous paint.

3.1.8.3 Wood or Other Absorptive Materials

Paint surfaces that may become repeatedly wet and in contact with metal with two coats of aluminum paint or a coat of heavy-bodied bituminous paint.

3.1.9 Expansion and Contraction

Provide expansion and contraction joints at not more than 32 foot intervals for aluminum and at not more than 40 foot intervals for other metals. Provide an additional joint where the distance between the last expansion joint and the end of the continuous run is more than half the required interval. Space joints evenly. Join extruded aluminum gravel stops and fascias by expansion and contraction joints spaced not more than 12 feet apart.

3.1.10 Base Flashing

Lay the base flashings with each course of the roof covering, shingle fashion, where practicable, where sloped roofs abut curbs, walls, or other vertical surfaces. Extend up vertical surfaces of the flashing not less than 8 inch and not less than 4 inch under the roof covering. Where finish wall coverings form a counterflashing, extend the vertical leg of the flashing up behind the applied wall covering not less than 6 inch. Overlap the flashing strips with the previously laid flashing not less than 3 inch. Fasten the strips at their upper edge to the deck. Horizontal flashing at vertical surfaces must extend vertically above the roof surface and fastened at their upper edge to the deck a minimum of 6 inch on center with large headed hex headed, galvanized shielded screws a minimum of 2-inch lap of any surface. Solder end laps and provide for expansion and contraction. Extend the metal flashing over crickets at the up-slope side of chimneys, curbs, and similar vertical surfaces extending through sloping roofs, the metal flashings. Extend the metal flashings onto the roof covering not less than 4.5 inch at the lower side of and similar vertical surfaces extending through the roof decks. Install and fit the flashings so as to be completely weathertight. Provide factory-fabricated base flashing for interior and exterior corners.

3.1.11 Counterflashing

Except where indicated or specified otherwise, insert counterflashing in reglets located from 9 to 10 inch above roof decks, extend down vertical surfaces over upturned vertical leg of base flashings not less than 3 inch. Fold the exposed edges of counterflashings 1/2 inch. Where stepped counterflashings are required, they may be installed in short lengths a minimum 8 inch by 8 inch or may be of the preformed one-piece type. Provide end laps in counterflashings not less than 3 inch and make it weathertight with plastic cement. Do not make lengths of metal counterflashings exceed 10 feet. Form the flashings to the required shapes before installation. Factory-form the corners not less than 12 inch from the angle. Secure the flashings in the reglets with lead wedges and space not more than 18 inch apart; on short runs, place wedges closer together. Fill caulked-type reglets or raked joints which receive counterflashing with caulking compound. Turn up the concealed edge of counterflashings built into masonry or concrete walls not less than 1/4 inch and extend not less than 2 inch into the walls. Install counterflashing to provide a spring action against base flashing. Factory form counter flashing to provide spring action against the base flashing.

3.1.12 Gutters

The hung type of shape indicated and supported on underside by brackets that permit free thermal movement of the gutter. Provide gutters in sizes indicated complete with mitered corners, end caps, outlets, brackets, and other accessories necessary for installation. Bead with hemmed edge or reinforce the outer edge of gutter with a stiffening bar not less than 3/4 by 3/16 inch of material compatible with gutter. Fabricate gutters in sections not less than 8 feet. Lap the sections a minimum of one inch in the direction of flow or provide with concealed splice plate 6 inch minimum. Join the gutters, other than aluminum, by riveted and soldered joints.

3.1.13 Downspouts

Space supports for downspouts according to the manufacturer's

recommendation for the masonry substrate. Types, shapes and sizes are indicated. Provide complete including elbows and offsets. Provide downspouts in approximately 10 foot lengths.

3.1.14 Splash Pans

Install splash pans where downspouts discharge.

3.1.15 Eave Flashing

One piece in width, applied in 8 to 10 foot lengths with expansion joints spaced as specified in paragraph entitled "Expansion and Contraction." Provide a 3/4 inch continuous fold in the upper edge of the sheet to engage cleats spaced not more than 10 inch on center. Locate the upper edge of flashing not less than 18 inch from the outside face of the building, measured along the roof slope. Fold lower edge of the flashing over and loose-lock into a continuous edge strip on the fascia. Where eave flashing intersects metal valley flashing, secure with one inch flat locked joints with cleats that are 10 inch on center.

3.1.16 Sheet Metal Covering on Flat, Sloped, or Curved Surfaces

Except as specified or indicated otherwise, cover and flash all minor flat, sloped, or curved surfaces such as crickets, bulkheads, dormers and small decks with metal sheets of the material used for flashing; maximum size of sheets, 16 by 18 inch. Fasten sheets to sheathing with metal cleats. Lock seams and solder. Lock aluminum seams as recommended by aluminum manufacturer. Provide an underlayment of roofing felt for all sheet metal covering.

3.1.17 Expansion Joints

Provide expansion joints for roofs, as indicated. Provide expansion joints in continuous sheet metal at 32 foot intervals for aluminum, aluminum gravel stops and fascias which must have expansion joints at not more than 12 foot spacing. Provide evenly spaced joints. Provide an additional joint where the distance between the last expansion joint and the end of the continuous run is more than half the required interval spacing. Conform to the requirements of Table I.

3.1.18 Flashing at Roof Penetrations and Equipment Supports

Provide metal flashing for all pipes, ducts, and conduits projecting through the roof surface and for equipment supports, guy wire anchors, and similar items supported by or attached to the roof deck.

3.1.19 Single Pipe Vents

See Table I, footnote (d). Set flange of sleeve in bituminous plastic cement and nail 3 inch on center. Bend the top of sleeve over and extend down into the vent pipe a minimum of 2 inch. For long runs or long rises above the deck, where it is impractical to cover the vent pipe with lead, use a two-piece formed metal housing. Set metal housing with a metal sleeve having a 4 inch roof flange in bituminous plastic cement and nailed 3 inch on center. Extend sleeve a minimum of8 inch above the roof deck and lapped a minimum of 3 inch by a metal hood secured to the vent pipe by a draw band. Seal the area of hood in contact with vent pipe with an approved sealant.

3.2 PAINTING

Field-paint sheet metal for separation of dissimilar materials.

3.3 CLEANING

Clean exposed sheet metal work at completion of installation. Remove grease and oil films, handling marks, contamination from steel wool, fittings and drilling debris, and scrub-clean. Free the exposed metal surfaces of dents, creases, waves, scratch marks, and solder or weld marks.

3.4 REPAIRS TO FINISH

Scratches, abrasions, and minor surface defects of finish may be repaired in accordance with the manufacturer's printed instructions and as approved. Repair damaged surfaces caused by scratches, blemishes, and variations of color and surface texture. Replace items which cannot be repaired.

3.5 FIELD QUALITY CONTROL

Establish and maintain a Quality Control Plan for sheet metal used in conjunction with roofing to assure compliance of the installed sheet metalwork with the contract requirements. Remove work that is not in compliance with the contract and replace or correct. Include quality control, but not be limited to, the following:

a. Observation of environmental conditions; number and skill level of sheet metal workers; condition of substrate.

b. Verification that specified material is provided and installed.

c. Inspection of sheet metalwork, for proper size(s) and thickness(es), fastening and joining, and proper installation.

3.5.1 Procedure

Submit for approval prior to start of roofing work. Include a checklist of points to be observed. Document the actual quality control observations and inspections. Furnish a copy of the documentation to the Contracting Officer at the end of each day.

TABLE I. SHEET METAL WEIGHTS, THICKNESSES, AND GAGES

Sheet Metal Items				Terne-Coated Stainless Steel, inch	Zinc-Coated Steel, U.S. Std. Gage
Building Expansion Joints					
Cover			.015		24

TABLE I. SHEET METAL WEIGHTS, THICKNESSES, AND GAGES					
Sheet Metal Items				Terne-Coated Stainless Steel, inch	Zinc-Coated Steel, U.S. Std. Gage
Covering on minor flat, pitched or curved surfaces			.018		-
			-		-
				-	-
					-
					-
				-	
Flashings:					
Base			.018		24
Cap (Counter-flashing)			.015		26
Eave		-	.015		24
					-
					-
					-
					-
Pipe vent sleave (d)					

TABLE I. SHEET METAL WEIGHTS, THICKNESSES, AND GAGES

Sheet Metal Items				Terne-Coated Stainless Steel, inch	Zinc-Coated Steel, U.S. Std. Gage
Extrusions	-		-	-	-
					-
Sheets, smooth			.018		24
Edge strip			.025	-	-
				-	-
		-	.010		-
					-

(a) Brass.

(b) May be lead weighing 4 pounds per square foot.

(c) May be polyvinyl chloride.

(d) 2.5 pound minimum lead sleeve with 4 inch flange. Where lead sleeve is impractical, refer to paragraph entitled "Single Pipe Vents" for optional material.

TABLE II. SHEET METAL JOINTS			
TYPE OF JOINT			
Item Designation	Zinc-Coated Steel and Stainless Steel		Remarks
Joint cap for building expansion seam, cleated joint at roof	1.25 inch single lock, standing seam, cleated		--
Flashings			
Base	One inch 3 inch lap for expansion joint		Aluminum producer's recommended hard setting sealant for locked aluminum joints. Fill each metal expansion joint with a joint sealing compound compound.
		--	
Eave	One inch flat locked, cleated. One inch loose locked, sealed expansion joint, cleated.		Same as base flashing.
Edge strip	Butt		--

TABLE II. SHEET METAL JOINTS			
TYPE OF JOINT			
Item Designation	Zinc-Coated Steel and Stainless Steel		Remarks
Extrusions	--		Use sheet flashing beneath and a cover plate
Sheet, smooth	Butt with 1/4 inch space		Use sheet flashing backup plate.
Sheet, corrugated	Butt with 1/4 inch space		Use sheet flashing beneath and a cover plate or a combination unit
(a) Provide a 3 inch lap elastomeric flashing with manufacturer's recommended sealant.			

-- End of Section --

SECTION 07 61 14.00 20

STEEL STANDING SEAM ROOFING
05/11

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN IRON AND STEEL INSTITUTE (AISI)

AISI SG03-3	(2002; Suppl 2001-2004; R 2008) Cold-Formed Steel Design Manual Set

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)

ASCE 7-16	Minimum Design Loads and Associated Criteria for Buildings and Other Structures

ASTM INTERNATIONAL (ASTM)

ASTM A1008/A1008M	(2016) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable
ASTM A1011/A1011M	(2018a) Standard Specification for Steel Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength
ASTM A653/A653M	(2019) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM A792/A792M	(2010) Standard Specification for Steel Sheet, 55% Aluminum-Zinc Alloy-Coated by the Hot-Dip Process
ASTM B117	(2016) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM D1654	(2008; R 2016; E 2017) Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments
ASTM D2244	(2016) Standard Practice for Calculation of Color Tolerances and Color Differences from Instrumentally Measured Color Coordinates

ASTM D2247	(2015) Testing Water Resistance of Coatings in 100% Relative Humidity
ASTM D4214	(2007; R 2015) Standard Test Method for Evaluating the Degree of Chalking of Exterior Paint Films
ASTM D522/D522M	(2014) Mandrel Bend Test of Attached Organic Coatings
ASTM D523	(2014; R 2018) Standard Test Method for Specular Gloss
ASTM D714	(2002; R 2017) Standard Test Method for Evaluating Degree of Blistering of Paints
ASTM D968	(2017) Standard Test Methods for Abrasion Resistance of Organic Coatings by Falling Abrasive
ASTM E1592	(2005; R 2012) Structural Performance of Sheet Metal Roof and Siding Systems by Uniform Static Air Pressure Difference
ASTM G152	(2013) Operating Open Flame Carbon Arc Light Apparatus for Exposure of Nonmetallic Materials
ASTM G153	(2013) Operating Enclosed Carbon Arc Light Apparatus for Exposure of Nonmetallic Materials

INTERNATIONAL CODE COUNCIL (ICC)

ICC IBC	(2018) International Building Code

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)

SMACNA 1793	(2012) Architectural Sheet Metal Manual, 7th Edition

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 1-200-01	(2019) DoD Building Code
UFC 3-110-03	Unified Facilities Criteria (UFC) Roofing 1 May 2012, Change 4, 29 October 2019.

1.2 DEFINITIONS

1.2.1 Field-Formed Seam

Seams of panels so configured that when adjacent sheets are installed the seam is sealed utilizing mechanical or hand seamers. Crimped (45 degree bend), roll formed (180 degree bend), double roll formed (2 - 180 degree bends), and roll and lock systems are types of field-formed seam systems.

1.2.2 Snap Together Seam

Panels so configured that the male and female portions of the seam interlock through the application of foot pressure or tamping with a mallet. Snap-on cap configurations are a type of snap together system.

1.2.3 Pre-Formed

Formed to the final, less field-formed seam, profile and configuration in the factory.

1.2.4 Field-Formed

Formed to the final, less field-formed seam, profile and configuration at the site of work prior to installation.

1.2.5 Roofing System

The roofing system is defined as the assembly of roofing components, including roofing panels, flashing, fasteners, and accessories which, when assembled properly result in a watertight installation.

1.3 SYSTEM DESCRIPTION

1.3.1 Design Requirements

a. Panels shall be continuous lengths up to manufacturer's standard longest lengths, with no joints or seams, except where indicated or specified. Ribs of adjoining sheets shall be in continuous contact from eave to ridge. Individual panels of snap together type systems shall be removable for replacement of damaged material.

b. There shall be no exposed or penetrating fasteners except where shown on approved shop drawings. Fasteners into steel shall be stainless steel, zinc cast head, or cadmium plated steel screws inserted into predrilled holes. There shall be a minimum of two fasteners per clip. Single fasteners will be allowed when supporting structural members are prepunched or predrilled.

c. Snap together type systems shall have a capillary break and a positive side lap locking device. Field-formed seam type systems shall be mechanically locked closed by the manufacturer's locking tool. The seam shall include a continuous factory applied sealant when required by the manufacturer to withstand the wind loads specified.

d. Roof panel anchor clips shall be concealed and designed to allow for longitudinal thermal movement of the panels, except where specific fixed points are indicated. Provide for lateral thermal movement in panel configuration or with clips designed for lateral and longitudinal movement.

e. All work required by this section shall comply with the requirements of, but not limited to, the following:

ASCE 7-16
ICC IBC
NRCA RoofMan
SMACNA
UFC 1-200-01

UFC 3-110-03

1.3.2 Design Conditions

The system shall be designed to resist positive and negative loads specified herein in accordance with the AISI SG03-3. Panels shall support walking loads without permanent distortion or telegraphing of the structural supports.

1.3.2.1 Wind Uplift

The design uplift pressures for the roof system shall be computed and applied using a basic wind speed of 165 miles per hour (mph).

The design uplift force for each connection assembly shall be that pressure given for the area under consideration, multiplied by the tributary load area of the connection assembly, and multiplied by the appropriate factor of safety, as follows:

a. Single fastener in a connection: 3.0

b. Two or more fasteners in each connection: 2.25

1.3.2.2 Roof Live Loads

Loads shall be applied on the horizontal projection of the roof structure. The minimum roof design live load shall be 20 psf.

1.3.2.3 Thermal Movement

System shall be capable of withstanding thermal movement based on a temperature range of 10 degrees F below 0 degrees F and s 180 degrees F.

1.3.2.4 Deflection

Panels shall be capable of supporting design loads between unsupported spans with deflection of not greater than L/180 of the span.

1.3.3 Structural Performance

The structural performance test methods and requirements of the Standing Seam Roofing Systems (SSRS) shall be in accordance with ASTM E1592.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Roofing; G

Submit roofing drawings to supplement the instructions and diagrams. Drawings shall include design and erection drawings containing an isometric view of the roof showing the design uplift pressures and dimensions of edge, ridge and corner zones; and show typical and special conditions including flashings, materials and

thickness, dimensions, fixing lines, anchoring methods, sealant locations, sealant tape locations, fastener layout, sizes, and spacing, terminations, penetrations, attachments, and provisions for thermal movement. Details of installation shall be in accordance with the manufacturer's Standard Instructions and details or the SMACNA 1793. Prior to submitting shop drawings, have drawings reviewed and approved by the manufacturer's technical engineering department.

SD-03 Product Data

Roofing panels; G

Attachment clips

Closures

Accessories

Fasteners

Sealants

Sample warranty certificate; G

Submit for materials to be provided. Submit data sufficient to indicate conformance to specified requirements.

SD-04 Samples

Roofing panel;G

Submit a 12 inch long by full width section of typical panel.

For color selection, submit 2 by 4 inch metal samples in color, finish and texture selected. When colors are not indicated, submit samples of not less than six different manufacturer's standard colors for selection.

Accessories;G

Submit each type of accessory item used in the project including, but not limited to each type of anchor clip, closure, fastener, and leg clamp.

Sealants;G

Intermediate Support;G Section

Submit full size samples of each intermediate support section, 12 inches long.

SD-05 Design Data

Design calculations;G

SD-06 Test Reports

Field Inspection; G

Submit manufacturer's technical representative's field inspection reports as specified in paragraph entitled "Manufacturer's Field Inspection."

Structural performance tests;G

Finish tests;G

SD-07 Certificates

Manufacturer's Technical Representative's Qualifications;G

Statement of Installer's Qualifications;G

Submit documentation from roofing manufacturer proving the manufacturer's technical representative meets below specified requirements. Include name, address, telephone number, and experience record.

Submit documentation proving the installer is factory-trained, has the specified experience, and authorized by the manufacturer to install the products specified.

SD-08 Manufacturer's Instructions

Installation manual; G

Submit manufacturers printed installation manual, instructions, and standard details.

SD-11 Closeout Submittals

Information card;G

For each roofing installation, submit a typewritten card or photoengraved aluminum card containing the information listed on Form 1 located at the end of this section.

1.5 DESIGN CALCULATIONS

Provide design calculations prepared by a professional engineer specializing in structural engineering any additional framing meets design load criteria indicated. Coordinate calculations with manufacturer's test results. Include calculations for:

Wind load uplift design pressure at roof locations specified in paragraph entitled "Wind Uplift."

Clip spacing and allowable load per clip.

Fastening of clips to structure or intermediate supports.

Intermediate support spacing and framing and fastening to structure when required.

Allowable panel span at anchorage spacing indicated.

Safety factor used in design loading.

Governing code requirements or criteria.

Edge and termination details.

1.6 QUALITY ASSURANCE

1.6.1 Preroofing Conference

After submittals are received and approved but before roofing and insulation work, including associated work, is preformed, the Contractor shall hold a preroofing conference to review the following:

a. The drawings and specifications

b. Procedure for on site inspection and acceptance of the roofing substrate and pertinent structural details relating to the roofing system

c. Contractor's plan for coordination of the work of the various trades involved in providing the roofing system and other components secured to the roofing

d. Safety requirements

The preroofing conference shall be attended by the Contractor and personnel directly responsible for the roofing and insulation installation, mechanical and electrical work, and the roofing manufacturer's technical representative. Conflicts among those attending the preroofing conference shall be resolved and confirmed in writing before roofing work, including associated work, is begun. Prepare written minutes of the preroofing conference and submit to the Contracting Officer.

1.6.2 Manufacturer

The SSMRS shall be the product of a metal roofing industry - recognized manufacturer who has been in the practice of manufacturing SSMRS for a period of not less than 5 years and who has been involved in at least 5 projects similar in size and complexity to this project.

1.6.3 Manufacturer's Technical Representative

The representative shall have authorization from manufacturer to approve field changes and be thoroughly familiar with the products and with installations in the geographical area where construction will take place. The manufacturer's representative shall be an employee of the manufacturer with at least 5 years experience in installing the roof system. The representative shall be available to perform field inspections and attend meetings as required herein, and as requested by the Contracting Officer.

1.6.4 Installer's Qualifications

The roofing system installer shall be factory-trained, approved by the metal roofing system manufacturer to install the system, and shall have a minimum of three years experience as an approved applicator with that manufacturer. The applicator shall have applied five installations of similar size and scope as this project within the previous 3 years.

1.6.5 Single Source

Roofing panels, clips, closures, and other accessories shall be standard products of the same manufacturer; shall be the latest design by the manufacturer; and shall have been designed by the manufacturer to operate as a complete system for the intended use.

1.6.6 Laboratory Tests For Panel Finish

The term "appearance of base metal" refers to the metal coating on steel. Panels shall meet the following test requirements:

a. Formability Test: When subjected to a 180 degree bend over a 1/8 inch diameter mandrel in accordance with ASTM D522/D522M, exterior coating film shall show only slight microchecking and no loss of adhesion.

b. Accelerated Weathering Test: Withstand a weathering test for a minimum of 2000 hours in accordance with ASTM G152 and ASTM G153, Method 1 without cracking, peeling, blistering, loss of adhesion of the protective coating, or corrosion of the base metal. Protective coating that can be readily removed from the base metal with a penknife blade or similar instrument shall be considered to indicate loss of adhesion.

c. Chalking Resistance: After the 2000-hour weatherometer test, exterior coating shall not chalk greater than No. 8 rating when measured in accordance with ASTM D4214 test procedures.

d. Color Change Test:

After the 2000-hour weatherometer test, exterior coating color change shall not exceed 2 NBS units when measured in accordance with ASTM D2244 test procedure.

e. Salt Spray Test: Withstand a salt spray test for a minimum of 1000 hours in accordance with ASTM B117, including the scribe requirement in the test. Immediately upon removal of the panel from the test, the coating shall receive a rating of 8, few blisters in field as determined by ASTM D714; and an average rating of 6, 1/8 inch failure at scribe, as determined by ASTM D1654. Rating Schedule No. 1.

f. Abrasion Resistance Test for Color Coating: When subjected to the falling sand test in accordance with ASTM D968, coating system shall withstand a minimum of 50 liters of sand per mil thickness before appearance of base metal.

g. Humidity Test: When subjected to a humidity cabinet test in accordance with ASTM D2247 for 1000 hours, a scored panel shall show no signs of blistering, cracking, creepage, or corrosion.

h. Gloss Test: The gloss of the finish shall be 30 plus or minus 5 at an angle of 60 degrees, when measured in accordance with ASTM D523.

i. Glare Resistance Test:

Surfaces of panels that will be exposed to the exterior shall have a specular reflectance of not more than 10 when measured in accordance with ASTM D523 at an angle of 85 degrees. Specular reflectance may be obtained with striations or embossing. Requirements specified under

"Formability Test" will be waived if necessary to conform to this requirement.

1.7 WARRANTY

Furnish manufacturer's no-dollar-limit materials and workmanship warranty for the roofing system. The warranty period shall be not less than 20 years from the date of Government acceptance of the work. The warranty shall be issued directly to the Government. The warranty shall provide that if within the warranty period the metal roofing system becomes non-watertight or shows evidence of corrosion, perforation, rupture or excess weathering due to deterioration of the roofing system resulting from defective materials or installed workmanship the repair or replacement of the defective materials and correction of the defective workmanship shall be the responsibility of the roofing system manufacturer. Repairs that become necessary because of defective materials and workmanship while roofing is under warranty shall be performed within 7 days after notification, unless additional time is approved by the Contracting Officer. Failure to perform repairs within the specified period of time will constitute grounds for having the repairs performed by others and the cost billed to the manufacturer. The Contractor shall also provide a 2 year contractor installation warranty.

1.8 DELIVERY, STORAGE AND HANDLING

Deliver, store, and handle preformed panels, bulk roofing products and other manufactured items in a manner to prevent damage or deformation.

1.8.1 Delivery

Provide adequate packaging to protect materials during shipment. Crated materials shall not be uncrated until ready for use, except for inspection. Immediately upon arrival of materials at the jobsite, inspect materials for damage, dampness, and staining. Damaged or permanently stained materials that cannot be restored to like-new condition shall be replaced with satisfactory material. If materials are wet, remove the moisture and re-stack and protect the panels until used.

1.8.2 Storage

Stack materials on platforms or pallets and cover with tarpaulins or other suitable weathertight covering which prevents water trapping or condensation. Store materials so that water which might have accumulated during transit or storage will drain off. Do not store the panels in contact with materials that might cause staining, such as mud, lime, cement, fresh concrete or chemicals. Protect stored panels from wind damage.

1.8.3 Handling

Handle material carefully to avoid damage to surfaces, edges and ends.

PART 2 PRODUCTS

2.1 ROOFING PANELS

Panels shall have interlocking ribs for securing adjacent sheets. System for securing the roof covering to structural framing members shall be concealed clip fastening system with no fasteners penetrating the panels

except at the ridge or eave, rakes, penetrations, and end laps. Backing plates and ends of panels at end laps shall be predrilled or prepunched; factory prepare ends of panels to be lapped by trimming part of seam, die-setting or swaging ends of panels. Length of sheets shall be sufficient to cover the entire length of any unbroken roof slope when such slope is 30 feet or less. When length of run exceeds 30 feet, each sheet in the run shall extend over two or more spans. Sheets longer than 30 feet may be furnished if approved by the Contracting Officer. Width of sheets shall provide not less than 12 inches of coverage in place. Height of corrugations of adjacent roof sheets shall be not less than 2.0 inches (nominal). Make provisions for expansion and contraction at either ridge or eave, consistent with the type of system to be used. Panels from coil stock shall be formed without warping, waviness or ripples not part of the panel profile and shall be free of damage to the finish coating system.

2.1.1 Material

Zinc-coated steel conforming to ASTM A653/A653M, G90coating designation or aluminum-zinc alloy coated steel conforming to ASTM A792/A792M, AZ 55 coating. Minimum thickness to be 0.023 inch thick (24 gage) minimum except when mid field of roof is subject to design wind uplift pressures of 60 psf or greater, entire roof system shall have a minimum thickness of 0.030 inch (22 gage).

2.1.2 Texture

Smooth with raised intermediate ribs for added stiffness.

2.1.3 Finish

Factory color finish.

2.1.3.1 Factory Color Finish

Provide factory applied, thermally cured coating to exterior and interior of metal roof and wall panels and metal accessories. Provide exterior finish top coat of 70 percent resin polyvinylidene fluoride with not less than 0.8 mil dry film thickness. Provide exterior primer standard with panel manufacturer with not less than 0.8 mil dry film thickness. Interior finish shall consist of 0.2 mildry film thickness prime coat. Provide exterior and interior coating meeting test requirements specified below. Tests shall have been performed on the same factory finish and thickness provided.

2.2 ATTACHMENT CLIPS

Fabricate clips from ASTM A1011/A1011M, or ASTM A1008/A1008M steel hot-dip galvanized in accordance with ASTM A653/A653M, G 90, or Series 300 stainless steel. Size, shape, thickness and capacity as required to meet the load, insulation thickness and deflection criteria specified.

2.3 ACCESSORIES

Sheet metal flashings, gutters, downspouts, trim, moldings, closure strips, pre-formed crickets, caps, equipment curbs, and other similar sheet metal accessories used in conjunction with preformed metal panels shall be of the same material as used for the panels. Provide metal accessories with a factory color finish to match the roofing panels, except that such items which will be concealed after installation may be

provided without the finish if they are stainless steel. Metal shall be of a thickness not less than that used for the panels. Thermal spacer blocks and other thermal barriers at concealed clip fasteners shall be as recommended by the manufacturer except that wood spacer blocks are not allowed.

2.3.1 Closures

2.3.1.1 Ridge Closures

Metal closure matching panel configuration for installation on surface of roof panel between panel ribs at ridge and headwall roof panel flashing conditions and terminations.

2.3.2 Fasteners

Zinc-coated steel, corrosion resisting steel, zinc cast head, or nylon capped steel, type and size specified below or as otherwise approved for the applicable requirements. Design the fastening system to withstand the design loads specified. Exposed fasteners shall be gasketed or have gasketed washers on the exterior side of the covering to waterproof the penetration. Washer material shall be compatible with the covering; have a minimum diameter of 3/8 inch for structural connections; and gasketed portion of fasteners or washers shall be neoprene or other equally durable elastomeric material approximately 1/8 inch thick.

2.3.2.1 Screws

Not smaller than No. 14 diameter if self-tapping type and not smaller than No. 12 diameter if self-drilling and self-tapping.

2.3.2.2 Bolts

Not smaller than 1/4 inch diameter, shouldered or plain shank as required, with proper nuts.

2.3.2.3 Automatic End-Welded Studs

Automatic end-welded studs shall be shouldered type with a shank diameter of not smaller than 3/16 inch and cap or nut for holding covering against the shoulder.

2.3.2.4 Explosive Driven Fasteners

Fasteners for use with explosive actuated tools shall have a shank diameter of not smaller than 0.145 inch with a shank length of not smaller than 1/2 inch for fastening to steel and not smaller than one inch for fastening to concrete.

2.3.2.5 Rivets

Blind rivets shall be stainless steel with 1/8 inch nominal diameter shank. Rivets shall be threaded stem type if used for other than the fastening of trim. Rivets with hollow stems shall have closed ends.

2.3.3 Sealants

Elastomeric type containing no oil or asphalt. Exposed sealant shall cure to a rubberlike consistency. Concealed sealant shall be the non-hardening

type. Seam sealant shall be factory-applied, non-skinning, non-drying, and shall conform to the roofing manufacturer's recommendations. Silicone-based sealants shall not be used in contact with finished metal panels and components unless approved otherwise by the Contracting Officer.

2.3.4 GASKETS AND INSULATING COMPOUNDS

Nonabsorptive and suitable for insulating contact points of incompatible materials. Insulating compounds shall be nonrunning after drying.

PART 3 EXECUTION

3.1 EXAMINATION

Examine surfaces to receive standing seam metal roofing and flashing. Ensure that surfaces are plumb and true, clean, even, smooth, as dry and free from defects and projections which might affect the installation.

3.2 PROTECTION FROM CONTACT WITH DISSIMILAR MATERIALS

3.2.1 Cementitious Materials

Paint metal surfaces which will be in contact with mortar, concrete, or other masonry materials with one coat of alkali-resistant coating such as heavy-bodied bituminous paint.

3.2.2 Contact with Wood

Where metal will be in contact with wood or other absorbent material subject to wetting, seal joints with sealing compound and apply one coat of heavy-bodied bituminous paint.

3.3 INSTALLATION

Install in accordance with the approved manufacturer's erection instructions, shop drawings, and diagrams. Panels shall be in full and firm contact with attachment clips. Where prefinished panels are cut in the field, or where any of the factory applied coverings or coatings are abraded or damaged in handling or installation, they shall, after necessary repairs have been made with material of the same color as the weather coating, be approved before being installed. Seal completely openings through panels. Correct defects or errors in the materials. Replace materials which cannot be corrected in an approved manner with nondefective materials. Provide molded closure strips where indicated and where necessary to provide weathertight construction. Use shims as required to ensure attachment clip line is true. Use a spacing gage at each row of panels to ensure that panel width is not stretched or shortened.

3.3.1 Roof Panels

Apply roofing panels with the standing seams parallel to the slope of the roof. Provide roofing panels in longest practical lengths from ridge to eaves, with no transverse joints except at the junction of ventilators, curbs, and similar openings. Install flashing to assure positive water drainage away from roof penetrations. Locate panel end laps such that fasteners do not engage supports or otherwise restrain the longitudinal thermal movement of panels. Form field-formed seam type system seams in the field with an automatic mechanical seamer approved by the

manufacturer. Attach panels to the structure with concealed clips incorporated into panel seams. Clip attachment shall allow roof to move independently of the structure, except at fixed points as indicated.

3.3.2 Flashings

Provide flashing, related closures and accessories as indicated and as necessary to provide a weathertight installation. Install flashing to ensure positive water drainage away from roof penetrations. Flash and seal the roof at the ridge, eaves and rakes, and projections through the roof. Place closure strips, flashing, and sealing material in an approved manner that will assure complete weathertightness. Details of installation which are not indicated shall be in accordance with the SMACNA 1793, panel manufacturer's approved printed instructions and details, or the approved shop drawings. Allow for expansion and contraction of flashing.

3.3.3 Flashing Fasteners

Fastener spacings shall be in accordance with the panel manufacturer's recommendations and as necessary to withstand the design loads indicated. Install fasteners in roof valleys as recommended by the manufacturer of the panels. Install fasteners in straight lines within a tolerance of 1/2 inch in the length of a bay. Drive exposed penetrating type fasteners normal to the surface and to a uniform depth to seat gasketed washers properly and drive so as not to damage factory applied coating. Exercise extreme care in drilling pilot holes for fastenings to keep drills perpendicular and centered. Do not drill through sealant tape. After drilling, remove metal filings and burrs from holes prior to installing fasteners and washers. Torque used in applying fasteners shall not exceed that recommended by the manufacturer. Remove panels deformed or otherwise damaged by over-torqued fastenings, and provide new panels.

3.3.4 Rib and Ridge Closure/Closure Strips

Set closure/closure strips in joint sealant material and apply sealant to mating surfaces prior to adding panel.

3.4 PROTECTION OF APPLIED ROOFING

Do not permit storing, walking, wheeling, and trucking directly on applied roofing materials. Provide temporary walkways, runways, and platforms of smooth clean boards or planks as necessary to avoid damage to applied roofing materials, and to distribute weight to conform to indicated live load limits of roof construction.

3.5 CLEANING

Clean exposed sheet metal work at completion of installation. Remove metal shavings, filings, nails, bolts, and wires from roofs. Remove grease and oil films, excess sealants, handling marks, contamination from steel wool, fittings and drilling debris and scrub the work clean. Exposed metal surfaces shall be free of dents, creases, waves, scratch marks, solder or weld marks and damage to the finish coating.

3.6 MANUFACTURER'S FIELD INSPECTION

Manufacturer's technical representative shall visit the site as necessary during the installation process to assure panels, flashings, and other

components are being installed in a satisfactory manner. Manufacturer's technical representative shall perform a field inspection during the first 20 squares of roof panel installation and at substantial completion prior to issuance of warranty, as a minimum, and as otherwise requested by the Contracting Officer. Additional inspections shall not exceed one for 100 squares of total roof area with the exception that follow-up inspections of previously noted deficiencies or application errors shall be performed as requested by the Contracting Officer. Each inspection visit shall include a review of the entire installation to date. After each inspection, a report, signed by the manufacturer's technical representative, shall be submitted to the Contracting Officer noting the overall quality of work, deficiencies and any other concerns, and recommended corrective actions in detail. Notify Contracting Officer a minimum of 2 working days prior to site visit by manufacturer's technical representative.

3.7 COMPLETED WORK

Completed work shall be plumb and true without oil canning, dents, ripples, abrasion, rust, staining, or other damage detrimental to the performance or aesthetics of the completed roof assembly.

3.8 INFORMATION CARD

For each roof, provide a typewritten card, laminated in plastic and framed for interior display or a photoengraved 0.032 inch thick aluminum card for exterior display. Card to be 8 1/2 by 11 inches minimum and contain the information listed on Form 1 at end of this section. Install card near point of access to roof, or where indicated.

3.9 FORM ONE

FORM 1 - PREFORMED STEEL STANDING SEAM ROOFING SYSTEM COMPONENTS

1. Contract Number:

2. Building Number & Location:

3. Specification Number:

4. Deck/Substrate Type:

5. Slopes of Deck/Roof Structure:

6. Insulation Type & Thickness:

7. Insulation Manufacturer:

8. Vapor Retarder: ( )Yes ( )No

9. Vapor Retarder Type:

10. Preformed Steel Standing Seam Roofing Description:

a. Manufacturer (Name, Address, & Phone No.):
b. Product Name: c. Width: d. Gage:
e. Base Metal: f. Method of Attachment:

11. Repair of Color Coating:

a. Coating Manufacturer (Name, Address & Phone No.):
b. Product Name:
c. Surface Preparation:
d. Recoating Formula:
e. Application Method:

12. Statement of Compliance or Exception:_____
_____
_____

13. Date Roof Completed:

14. Warranty Period: From_____ To_____

15. Roofing Contractor (Name & Address):

16. Prime Contractor (Name & Address):

Contractor's Signature _____ Date:

Inspector's Signature _____ Date:

-- End of Section --

SECTION 07 92 00

JOINT SEALANTS
08/16

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C1193	(2013) Standard Guide for Use of Joint Sealants
ASTM C1521	(2013) Standard Practice for Evaluating Adhesion of Installed Weatherproofing Sealant Joints
ASTM C509	(2006; R 2015) Elastomeric Cellular Preformed Gasket and Sealing Material
ASTM C734	(2015) Low-Temperature Flexibility of Latex Sealants After Artificial Weathering
ASTM C834	(2017) Standard Specification for Latex Sealants
ASTM C919	(2012; R 2017) Standard Practice for Use of Sealants in Acoustical Applications
ASTM C920	(2014a) Standard Specification for Elastomeric Joint Sealants
ASTM D1056	(2014) Standard Specification for Flexible Cellular Materials - Sponge or Expanded Rubber
ASTM D217	(2017) Standard Test Methods for Cone Penetration of Lubricating Grease
ASTM E84	(2016) Standard Test Method for Surface Burning Characteristics of Building Materials

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS)Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(1989; R 2005) Adhesive and Sealant Applications

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Sealants; G

Primers; G

Bond Breakers; G

Backstops; G

SD-07 Certificates

Indoor Air Quality; G

SD-11 Closeout Submittals

Indoor Air Quality For Interior Sealants

Indoor Air Quality For Interior Floor Joint Sealants

Indoor Air Quality For Interior Acoustical Sealants

Indoor Air Quality For Interior Caulking

1.3 PRODUCT DATA

Include storage requirements, shelf life, curing time, instructions for mixing and application, and accessories. Provide manufacturer's Safety Data Sheets (SDS) for each solvent, primer and sealant material proposed.

1.4 CERTIFICATIONS

1.4.1 Indoor Air Quality Certifications

Submit required indoor air quality certifications in one submittal package.

1.4.1.1 Adhesives and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or

provide validation by other third-party program that products meet the requirements of this paragraph. Sealants and non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) must meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide current product certification documentation from certification body.

1.5 ENVIRONMENTAL CONDITIONS

Apply sealant when the ambient temperature is between 40 and 90 degrees F.

1.6 DELIVERY AND STORAGE

Deliver materials to the jobsite in unopened manufacturers' sealed shipping containers, with brand name, date of manufacture, color, and material designation clearly marked thereon. Label elastomeric sealant containers to identify type, class, grade, and use. Handle and store materials in accordance with manufacturer's printed instructions. Prevent exposure to foreign materials or subjection to sustained temperatures exceeding 90 degrees F or lower than 0 degrees F. Keep materials and containers closed and separated from absorptive materials such as wood and insulation.

1.7 QUALITY ASSURANCE

1.7.1 Compatibility with Substrate

Verify that each sealant is compatible for use with each joint substrate in accordance with sealant manufacturer's printed recommendations for each application.

1.7.2 Joint Tolerance

Provide joint tolerances in accordance with manufacturer's printed instructions.

1.7.3 Adhesion

Provide in accordance with ASTM C1193 or ASTM C1521.

PART 2 PRODUCTS

2.1 PRODUCT SUSTAINABILITY CRITERIA

For products in this section, where applicable and to extent allowed by performance criteria, provide and document the following:

2.1.1 Reduce Volatile Organic Compounds (VOC) (Low-Emitting Materials) for Products

Reduced VOC content is identified for some products.. Other products listed in this section may be available with reduced VOC content; identify those products that meet project requirements for reduced VOC content.

2.2 SEALANTS

Provide sealant products that have been tested, found suitable, and

documented as such by the manufacturer for the particular substrates to which they will be applied.

2.2.1 Interior Sealants

Provide ASTM C834 or ASTM C920, Type S or M, Grade NS, Class 12.5, Use NT. Provide certification of indoor air quality for interior sealants. Location(s) and color(s) of sealant for the following. Note, color "as selected" refers to manufacturer's full range of color options

LOCATION	COLOR
a. Small voids between walls or partitions and adjacent lockers, casework, shelving, door frames, built-in or surface mounted equipment and fixtures, and similar items.	As selected
b. Perimeter of frames at doors, windows, and access panels which adjoin exposed interior concrete and masonry surfaces.	As selected
c. Joints of interior masonry walls and partitions which adjoin columns, pilasters, concrete walls, and exterior walls unless otherwise detailed.	As selected
d. Joints between edge members for acoustical tile and adjoining vertical surfaces.	As selected
e. Interior locations, not otherwise indicated or specified, where small voids exist between materials specified to be painted.	As selected
f. Joints between bathtubs and ceramic tile; joints between shower receptors and ceramic tile; joints formed where non-planar tile surfaces meet.	As selected
g. Joints formed between tile floors and tile base cove; joints between tile and dissimilar materials; joints occurring where substrates change.	As selected
h. Behind escutcheon plates at valve pipe penetrations and showerheads in showers.	As selected

2.2.2 Exterior Sealants

For joints in vertical surfaces, provide ASTM C920, Type S or M, Grade NS, Class 25, Use NT. For joints in horizontal surfaces, provide ASTM C920, Type S or M, Grade P, Class 25, Use T. Provide location(s) and color(s) of sealant as follows. Note, color "as selected" refers to manufacturer's full range of color options:

LOCATION	COLOR
a. Joints and recesses formed where frames and subsills of windows, doors, louvers, and vents adjoin masonry, concrete, or metal frames. Use sealant at both exterior and interior surfaces of exterior wall penetrations.	Match adjacent surface color
b. Joints between new and existing exterior masonry walls.	Match adjacent surface color
c. Masonry joints where shelf angles occur.	Match adjacent surface color
d. Joints in wash surfaces of stonework.	Match adjacent surface color
e. Expansion and control joints.	Match adjacent surface color
f. Interior face of expansion joints in exterior concrete or masonry walls where metal expansion joint covers are not required.	Match adjacent surface color
g. Voids where items pass through exterior walls.	Match adjacent surface color
h. Metal reglets, where flashing is inserted into masonry joints, and where flashing is penetrated by coping dowels.	Match adjacent surface color
i. Metal-to-metal joints where sealant is indicated or specified.	Match adjacent surface color
j. Joints between ends of gravel stops, fasciae, copings, and adjacent walls.	Match adjacent surface color

2.2.3 Floor Joint Sealants

ASTM C920, Type S or M, Grade P, Class 25, Use T. Provide certification of indoor air quality for interior floor joint sealants. Provide location(s) and color(s) of sealant as follows. Note, color "as selected" refers to manufacturer's full range of color options:

LOCATION	COLOR
a. Seats of metal thresholds for exterior doors.	As selected

LOCATION	COLOR
b. Control and expansion joints in floors, slabs, ceramic tile, and walkways.	As selected

2.2.4 Acoustical Sealants

Rubber or polymer based acoustical sealant in accordance with ASTM C919 to have a flame spread of 25 or less and a smoke developed rating of 50 or less when tested in accordance with ASTM E84. Provide non-staining acoustical sealant with a consistency of 250 to 310 when tested in accordance with ASTM D217. Acoustical sealant must remain flexible and adhesive after 500 hours of accelerated weathering as specified in ASTM C734. Provide certification of indoor air quality for interior acoustical sealants.

2.2.5 Preformed Sealants

Provide preformed sealants of polybutylene or isoprene-butylene based pressure sensitive weather resistant tape or bead sealants capable of sealing out moisture, air and dust when installed as recommended by the manufacturer. At temperatures from minus 30 to plus 160 degrees F, sealants must be non-bleeding and have no loss of adhesion.

2.2.5.1 Foam Strip

Provide foam strip of polyurethane foam. Provide foam strip capable of sealing out moisture, air, and dust when installed and compressed in accordance with manufacturer's printed instructions. Service temperature must be minus 40 to plus 275 degrees F. Furnish untreated strips with adhesive to hold them in place. Do not allow adhesive to stain or bleed onto adjacent finishes. Saturate treated strips with butylene waterproofing or impregnate with asphalt.

2.3 PRIMERS

Non-staining, quick drying type and consistency as recommended by the sealant manufacturer for the particular application. Provide primers for interior applications that meet the indoor air quality requirements of the paragraph SEALANTS above.

2.4 BOND BREAKERS

Type and consistency as recommended by the sealant manufacturer to prevent adhesion of the sealant to the backing or to the bottom of the joint. Provide bond breakers for interior applications that meet the indoor air quality requirements of the paragraph SEALANTS above.

2.5 BACKSTOPS

Provide glass fiber roving, neoprene, butyl, polyurethane, or polyethylene foams free from oil or other staining elements as recommended by sealant manufacturer. Provide 25 to 33 percent oversized backing for closed cell and 40 to 50 percent oversized backing for open cell material, unless otherwise indicated. Provide backstop material that is compatible with sealant. Do not use oakum or other types of absorptive materials as backstops.

2.5.1 Rubber

Provide in accordance with ASTM D1056, Type 1, open cell, or Type 2, closed cell, round cross section for cellular rubber sponge backing.

2.5.2 Synthetic Rubber

Provide in accordance with ASTM C509, Option I, Type I preformed rods or tubes for synthetic rubber backing.

2.5.3 Neoprene

Provide in accordance with ASTM D1056, closed cell expanded neoprene cord Type 2, Class C, Grade 2C2 for neoprene backing.

2.6 CLEANING SOLVENTS

Provide type(s) recommended by the sealant manufacturer and in accordance with environmental requirements herein. Protect adjacent aluminum and bronze surfaces from solvents. Provide solvents for interior applications that meet the indoor air quality requirements of the paragraph SEALANTS above.

PART 3 EXECUTION

3.1 SURFACE PREPARATION

Prepare surfaces according to manufacturer's printed installation instructions. Clean surfaces from dirt, frost, moisture, grease, oil, wax, lacquer, paint, or other foreign matter that would destroy or impair adhesion. Remove oil and grease with solvent; thoroughly remove solvents prior to sealant installation. Wipe surfaces dry with clean cloths. When resealing an existing joint, remove existing caulk or sealant prior to applying new sealant. For surface types not listed below, provide in accordance with sealant manufacturer's printed instructions for each specific surface.

3.1.1 Steel Surfaces

Remove loose mill scale by sandblasting or, if sandblasting is impractical or would damage finished work, scraping and wire brushing. Remove protective coatings by sandblasting or using a residue free solvent. Remove resulting debris and solvent residue prior to sealant installation.

3.1.2 Aluminum or Bronze Surfaces

Remove temporary protective coatings from surfaces that will be in contact with sealant. When masking tape is used as a protective coating, remove tape and any residual adhesive prior to sealant application. For removing protective coatings and final cleaning, use non-staining solvents recommended by the manufacturer of the item(s) containing aluminum or bronze surfaces.

3.1.3 Concrete and Masonry Surfaces

Where surfaces have been treated with curing compounds, oil, or other such materials, remove materials by sandblasting or wire brushing. Remove laitance, efflorescence and loose mortar from the joint cavity. Remove

resulting debris prior to sealant installation.

3.1.4 Wood Surfaces

Ensure wood surfaces that will be in contact with sealants are free of splinters, sawdust and other loose particles.

3.2 SEALANT PREPARATION

Do not add liquids, solvents, or powders to sealants. Mix multicomponent elastomeric sealants in accordance with manufacturer's printed instructions.

3.3 APPLICATION

3.3.1 Joint Width-To-Depth Ratios

Acceptable Ratios:

JOINT WIDTH	JOINT DEPTH	
	Minimum	Maximum
For metal, glass, or other nonporous surfaces:		
1/4 inch (minimum)	1/4 inch	1/4 inch
over 1/4 inch	1/2 of width	Equal to width
For wood, concrete, masonry, stone:		
1/4 inch (minimum)	1/4 inch	1/4 inch
over 1/4 inch to 1/2 inch	1/4 inch	Equal to width
over 1/2 inch to 1 inch	1/2 inch	5/8 inch
Over 1 inch	prohibited	

Unacceptable Ratios: Where joints of acceptable width-to-depth ratios have not been provided, clean out joints to acceptable depths and grind or cut to acceptable widths without damage to the adjoining work. Grinding is prohibited at metal surfaces.

3.3.2 Unacceptable Sealant Use

Do not install sealants in lieu of other required building enclosure weatherproofing components such as flashing, drainage components, and joint closure accessories, or to close gaps between walls, floors, roofs, windows, and doors, that exceed acceptable installation tolerances. Remove sealants that have been used in an unacceptable manner and correct building enclosure deficiencies to comply with contract documents requirements.

3.3.3 Masking Tape

Place masking tape on the finished surface on one or both sides of joint

cavities to protect adjacent finished surfaces from primer or sealant smears. Remove masking tape within 10 minutes of joint filling and tooling.

3.3.4 Backstops

Provide backstops dry and free of tears or holes. Tightly pack the back or bottom of joint cavities with backstop material to provide joints in specified depths. Provide backstops where indicated and where backstops are not indicated but joint cavities exceed the acceptable maximum depths specified in JOINT WIDTH-TO-DEPTH RATIOS Table.

3.3.5 Primer

Clean out loose particles from joints immediately prior to application of. Apply primer to joints in concrete masonry units, wood, and other porous surfaces in accordance with sealant manufacturer's printed instructions. Do not apply primer to exposed finished surfaces.

3.3.6 Bond Breaker

Provide bond breakers to surfaces not intended to bond in accordance with, sealant manufacturer's printed instructions for each type of surface and sealant combination specified.

3.3.7 Sealants

Provide sealants compatible with the material(s) to which they are applied. Do not use a sealant that has exceeded its shelf life or has jelled and cannot be discharged in a continuous flow from the sealant gun. Apply sealants in accordance with the manufacturer's printed instructions with a gun having a nozzle that fits the joint width. Work sealant into joints so as to fill the joints solidly without air pockets. Tool sealant after application to ensure adhesion. Apply sealant uniformly smooth and free of wrinkles. Upon completion of sealant application, roughen partially filled or unfilled joints, apply additional sealant, and tool smooth as specified. Apply sealer over sealants in accordance with the sealant manufacturer's printed instructions.

3.4 PROTECTION AND CLEANING

3.4.1 Protection

Protect areas adjacent to joints from sealant smears. Masking tape may be used for this purpose if removed 5 to 10 minutes after the joint is filled and no residual tape marks remain.

3.4.2 Final Cleaning

Upon completion of sealant application, remove remaining smears and stains and leave the work in a clean and neat condition.

a. Masonry and Other Porous Surfaces: Immediately remove fresh sealant that has been smeared on adjacent masonry, rub clean with a solvent, and remove solvent residue, in accordance with sealant manufacturer's

printed instructions. Allow excess sealant to cure for 24 hour then remove by wire brushing or sanding. Remove resulting debris.

b. Metal and Other Non-Porous Surfaces: Remove excess sealant with a solvent moistened cloth. Remove solvent residue in accordance with solvent manufacturer's printed instructions.

-- End of Section --

SECTION 08 11 13

STEEL DOORS AND FRAMES
02/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only.

AMERICAN WELDING SOCIETY (AWS)

AWS D1.1/D1.1M	(2015) Structural Welding Code - Steel

ASTM INTERNATIONAL (ASTM)

ASTM A653/A653M	(2015) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM A879/A879M	(2012) Standard Specification for Steel Sheet, zinc Coated by the Electrolytic Process for Applications Requiring Designation of the Coating Mass on Each Surface
ASTM A924/A924M	(2014) Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process
ASTM C578	(2015) Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation
ASTM C591	(2015) Standard Specification for Unfaced Preformed Rigid Cellular Polyisocyanurate Thermal Insulation
ASTM C612	(2014) Mineral Fiber Block and Board Thermal Insulation
ASTM D2863	(2013) Measuring the Minimum Oxygen Concentration to Support Candle-Like Combustion of Plastics (Oxygen Index)

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)

ANSI/BHMA A156.115	(2014) Hardware Preparation in Steel Doors and Steel Frames

STEEL DOOR INSTITUTE (SDI/DOOR)

SDI/DOOR 111	(2009) Recommended Selection and Usage Guide for Standard Steel Doors, Frames and Accessories

SDI/DOOR 113	(2001; R2006) Standard Practice for Determining the Steady State Thermal Transmittance of Steel Door and Frame Assemblies
SDI/DOOR A250.11	(2001) Recommended Erection Instructions for Steel Frames
SDI/DOOR A250.4	(2011) Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors and Hardware Reinforcing
SDI/DOOR A250.6	(2003; R2009) Recommended Practice for Hardware Reinforcing on Standard Steel Doors and Frames
SDI/DOOR A250.8	(2003; R2008) Recommended Specifications for Standard Steel Doors and Frames

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. The following shall be submitted in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Doors

Frames

Accessories

Show elevations, construction details, metal gages, hardware provisions, method of glazing, and installation details.

Schedule of doors

Schedule of frames

Submit door and frame locations.

SD-03 Product Data

Doors

Frames

Accessories

Submit manufacturer's descriptive literature for doors, frames, and accessories. Include data and details on door construction, panel (internal) reinforcement, insulation, and door edge construction. When "custom hollow metal doors" are provided in lieu of "standard steel doors," provide additional details and data sufficient for comparison to SDI/DOOR A250.8 requirements.

1.3 DELIVERY, STORAGE, AND HANDLING

Deliver doors, frames, and accessories undamaged and with protective wrappings or packaging. Provide temporary steel spreaders securely fastened to the bottom of each welded frame. Store doors and frames on platforms under cover in clean, dry, ventilated, and accessible locations, with 1/4 inch airspace between doors. Remove damp or wet packaging immediately and wipe affected surfaces dry. Replace damaged materials with new.

PART 2 PRODUCTS

2.1 STANDARD STEEL DOORS

SDI/DOOR A250.8, except as specified otherwise. Prepare doors to receive door hardware as specified in Section 08 71 00. Undercut where indicated. Exterior doors shall have top edge closed flush and sealed to prevent water intrusion. Doors shall be 1-3/4 inch thick, unless otherwise indicated.

2.1.1 Classification - Level, Performance, Model:

2.1.1.1 Heavy Duty Doors

SDI/DOOR A250.8, Level 2, physical performance Level B, Model 2, seamless, with core construction as required by the manufacturer for interior doors and for exterior doors, of size(s) and design(s) indicated. Where vertical stiffener cores are required, the space between the stiffeners shall be filled with mineral board insulation.2.2 INSULATED STEEL DOOR SYSTEMS

Door size(s), design, and material shall be as specified for standard steel doors. Insulated steel doors shall have a core of polyurethane foam and an R factor of 10.0 or more (based on a k value of 0.16); face sheets, edges, and frames of galvanized steel not lighter than 23 gage, 16 gage, and 16 gage respectively; magnetic weatherstripping; nonremovable-pin hinges; thermal-break aluminum threshold; and vinyl door bottom. Doors and frames shall receive phosphate treatment, rust-inhibitive primer, and baked acrylic enamel finish. Doors shall have been tested in accordance with SDI/DOOR A250.4. Prepare doors to receive specified hardware.Doors shall be 1-3/4 inch thick. Provide insulated steel doors and frames for all openings.2.3 SOUND RATED STEEL DOORS

Doors shall have a Sound Transmission Class (STC) as indicated on the drawings.2.4 INSULATION CORES

Insulated cores shall be of type specified, and provide an apparent U-factor of .48 in accordance with SDI/DOOR 113 and shall conform to:

a. Rigid Cellular Polyisocyanurate Foam: ASTM C591, Type I or II, foamed-in-place or in board form, with oxygen index of not less than 22 percent when tested in accordance with ASTM D2863; or

b. Rigid Polystyrene Foam Board: ASTM C578, Type I or II; or

c. Mineral board: ASTM C612, Type I.

2.5 STANDARD STEEL FRAMES

SDI/DOOR A250.8, Level 2, except as otherwise specified. Form frames to sizes and shapes indicated, with welded corners or knock-down field-assembled corners. Provide steel frames for doors, unless otherwise indicated.

2.5.1 Welded Frames

Continuously weld frame faces at corner joints. Mechanically interlock or continuously weld stops and rabbets. Grind welds smooth.

Weld frames in accordance with the recommended practice of the Structural Welding Code Sections 1 through 6, AWS D1.1/D1.1M and in accordance with the practice specified by the producer of the metal being welded.

2.5.2 Knock-Down Frames

Design corners for simple field assembly by concealed tenons, splice plates, or interlocking joints that produce square, rigid corners and a tight fit and maintain the alignment of adjoining members. Provide locknuts for bolted connections.2.5.3 Stops and Beads

Form stops and beads from 20 gage steel. Provide for glazed and other openings in standard steel frames. Secure beads to frames with oval-head, countersunk Phillips self-tapping sheet metal screws or concealed clips and fasteners. Space fasteners approximately 12 to 16 inch on center. Miter molded shapes at corners. Butt or miter square or rectangular beads at corners.

2.5.4 Terminated Stops

Where indicated, terminate interior door frame stops 6 inch above floor. Do not terminate stops of frames for lightproof or soundproof, doors.

2.5.5 Anchors

Provide anchors to secure the frame to adjoining construction. Provide steel anchors, zinc-coated or painted with rust-inhibitive paint, not lighter than 18 gage.

2.5.5.1 Wall Anchors

Provide at least three anchors for each jamb. For frames which are more than 7.5 feet in height, provide one additional anchor for each jamb for each additional 2.5 feet or fraction thereof.

a. Masonry: Provide anchors of corrugated or perforated steel straps or 3/16 inch diameter steel wire, adjustable or T-shaped;

b. Stud partitions: Weld or otherwise securely fasten anchors to backs of frames. Design anchors to be fastened to open steel studs by wiring or welding;

c. Completed openings: Secure frames to previously placed concrete or masonry with expansion bolts in accordance with SDI/DOOR 111; and

2.5.5.2 Floor Anchors

Provide floor anchors drilled for 3/8 inch anchor bolts at bottom of each jamb member. Where floor fill occurs, terminate bottom of frames at the indicated finished floor levels and support by adjustable extension clips resting on and anchored to the structural slabs.

2.6 HARDWARE PREPARATION

Provide minimum hardware reinforcing gages as specified in SDI/DOOR A250.6. Drill and tap doors and frames to receive finish hardware. Prepare doors and frames for hardware in accordance with the applicable requirements of SDI/DOOR A250.8 and SDI/DOOR A250.6. For additional requirements refer to ANSI/BHMA A156.115. Drill and tap for surface-applied hardware at the project site. Build additional reinforcing for surface-applied hardware into the door at the factory. Locate hardware in accordance with the requirements of SDI/DOOR A250.8, as applicable. Punch door frames , with the exception of frames that will have weatherstripping or lightproof or soundproof gasketing, to receive a minimum of two rubber or vinyl door silencers on lock side of single doors and one silencer for each leaf at heads of double doors. Set lock strikes out to provide clearance for silencers.

2.7 FINISHES

2.7.1 Hot-Dip Zinc-Coated and Factory-Primed Finish

Fabricate doors and frames from hot dipped zinc coated steel, alloyed type, that complies with ASTM A924/A924Mand ASTM A653/A653M. The coating weight shall meet or exceed the minimum requirements for coatings having 0.4 ounces per square foot, total both sides, i.e., A40. Repair damaged zinc-coated surfaces by the application of zinc dust paint. Thoroughly clean and chemically treat to insure maximum paint adhesion. Factory prime as specified in SDI/DOOR A250.8.

2.7.2 Electrolytic Zinc-Coated Anchors and Accessories

Provide electrolytically deposited zinc-coated steel in accordance with ASTM A879/A879M, Commercial Quality, Coating Class A. Phosphate treat and factory prime zinc-coated surfaces as specified in SDI/DOOR A250.8.

2.8 FABRICATION AND WORKMANSHIP

Finished doors and frames shall be strong and rigid, neat in appearance, and free from defects, waves, scratches, cuts, dents, ridges, holes, warp, and buckle. Molded members shall be clean cut, straight, and true, with joints coped or mitered, well formed, and in true alignment. Dress exposed welded and soldered joints smooth. Design door frame sections for use with the wall construction indicated. Corner joints shall be well formed and in true alignment. Conceal fastenings where practicable. On wraparound frames for masonry partitions, provide a throat opening 1/8 inch larger than the actual masonry thickness. Design other frames in exposed masonry walls or partitions to allow sufficient space between the inside back of trim and masonry to receive caulking compound.

2.8.1 Grouted Frames

For frames to be installed in exterior walls and to be filled with mortar or grout, fill the stops with strips of rigid insulation to keep the grout

out of the stops and to facilitate installation of stop-applied head and jamb seals.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Frames

Set frames in accordance with SDI/DOOR A250.11. Plumb, align, and brace securely until permanent anchors are set. Anchor bottoms of frames with expansion bolts or powder-actuated fasteners. Build in or secure wall anchors to adjoining construction. Where frames require ceiling struts or overhead bracing, anchor frames to the struts or bracing. Backfill frames with mortar. Coat inside of frames with corrosion-inhibiting bituminous material. For frames in exterior walls, ensure that stops are filled with rigid insulation before grout is placed.

3.1.2 Doors

Hang doors in accordance with clearances specified in SDI/DOOR A250.8. After erection and glazing, clean and adjust hardware.

3.2 PROTECTION

Protect doors and frames from damage. Repair damaged doors and frames prior to completion and acceptance of the project or replace with new, as directed. Wire brush rusted frames until rust is removed. Clean thoroughly. Apply an all-over coat of rust-inhibitive paint of the same type used for shop coat.

3.3 CLEANING

Upon completion, clean exposed surfaces of doors and frames thoroughly. Remove mastic smears and other unsightly marks.

-- End of Section --

SECTION 08 33 23

OVERHEAD COILING DOORS
08/15

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)

ASCE 7	(2017) Minimum Design Loads for Buildings and Other Structures

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE FUN IP	(2017) Fundamentals Handbook, I-P Edition

ASME INTERNATIONAL (ASME)

ASME B29.400	(2001; (R 2008) (R 2013) (R 2018)) Combination, "H" Type Mill Chains, and Sprockets

ASTM INTERNATIONAL (ASTM)

ASTM A153/A153M	(2016) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
ASTM A27/A27M	(2017) Standard Specification for Steel Castings, Carbon, for General Application
ASTM A307	(2014; E 2017) Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength
ASTM A36/A36M	(2014) Standard Specification for Carbon Structural Steel
ASTM A48/A48M	(2003; R 2012) Standard Specification for Gray Iron Castings
ASTM A53/A53M	(2018) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
ASTM A653/A653M	(2018) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM A666	(2015) Standard Specification for Annealed

	or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate and Flat Bar
ASTM A780/A780M	(2009; R 2015) Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings
ASTM A924/A924M	(2018) Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process
ASTM B221	(2014) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes
ASTM D2000	(2012; R 2017) Standard Classification System for Rubber Products in Automotive Applications
ASTM E330/E330M	(2014) Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference
ASTM E84	(2018a) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM F568M	(2007) Standard Specification for Carbon and Alloy Steel Externally Threaded Metric Fasteners

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA ICS 2	(2000; R 2005; Errata 2008) Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 V
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures
NEMA MG 1	(2016; SUPP 20162018) Motors and Generators
NEMA ST 1	(1988; R 1994; R 1997) Specialty Transformers (Except General Purpose Type)

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2017; ERTA 1-2 2017; TIA 17-1; TIA 17-2; TIA 17-3; TIA 17-4; TIA 17-5; TIA 17-6; TIA 17-7; TIA 17-8; TIA 17-9; TIA 17-10; TIA 17-11; TIA 17-12; TIA 17-13; TIA 17-14; TIA 17-15; TIA 17-16; TIA 17-17) National Electrical Code

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only.

Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Overhead Coiling Doors; G

Counterbalancing Mechanism; G

Manual Door Operators; G

Electric Door Operators; G

Bottom Bars; G

Guides; G

Mounting Brackets; G

Overhead Drum; G

Hood; G

Installation Drawings; G

SD-03 Product Data

Overhead Coiling Doors; G

Hardware; G

Counterbalancing Mechanism; G

Manual Door Operators; G

Electric Door Operators; G

Fire-Rated Door Assembly; G

SD-05 Design Data

Overhead Coiling Doors; G

Hardware; G

Counterbalancing Mechanism; G

Manual Door Operators; G

Electric Door Operators; G

Fire-Rated Door; G

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals; G

Materials; G

Devices; G

Procedures; G

Manufacture's Brochures; G

Parts Lists; G

SD-11 Closeout Submittals

Warranty; G

1.3 QUALITY CONTROL

Provide sound-retardant door assemblies for the rating listed on the drawings. Provide a permanent label for each door showing the manufacturer's name and address, and the model/serial number of the door.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver doors to the jobsite wrapped in a protective covering with the brands and names clearly marked thereon. Store doors in an adequately ventilated dry location that is free from dirt and dust, water, or other contaminants. Store in a manner that permits easy access for inspection and handling.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Doors to be coiling type, sound-retardant, with interlocking slats, complete with anchoring and door hardware, guides, hood, and operating mechanisms, and designed for use on openings as indicated. Use grease-sealed or self-lubricating bearings for rotating members.

Basis of Design: Insul-Sound/Redi-Storm, STC30 Hurricane-rated, as manufactured by Alpine Overhead Doors Inc., 8 Hulse Rd, East Setauket NY, 11733, 631-473-9300

2.1.1 Design Requirements

2.1.1.1 Overhead Coiling Door Detail Shop Drawings

Provide installation drawings for overhead coiling door assemblies which show: elevations of each door type, shape and thickness of materials, finishes, details of joints and connections, details of guides and fittings, rough opening dimensions, location and description of hardware, anchorage locations, and counterbalancing mechanism and door operator details. Show locations of replaceable fusible links on wiring diagrams for power, signal and controls. Include a schedule showing the location of each door with the drawings.

2.1.2 Performance Requirements

2.1.2.1 Wind Loading

Design and fabricate door assembly to withstand the wind loading pressure of at least 60 pounds per square foot with a maximum deflection of 1/120 of the opening width. Provide test data showing compliance with

ASTM E330/E330M. Sound engineering principles may be used to interpolate or extrapolate test results to door sizes not specifically tested. Ensure complete assembly meets or exceeds the requirements of ASCE 7.

2.1.2.2 Operational Cycle Life

Design all portions of the door, hardware and operating mechanism that are subject to movement, wear, or stress fatigue to operate through a minimum number of 10 cycles per day hour. One complete cycle of door operation is defined as when the door is in the closed position, moves to the fully open position, and returns to the closed position.

2.2 COMPONENTS

2.2.1 Overhead Coiling Doors

2.2.1.1 Curtain Materials and Construction

Provide curtain slats fabricated from Grade A steel sheets conforming to ASTM A653/A653M, with the additional requirement of a minimum yield point of 33,000 psi. Provide sheets, galvanized in accordance with ASTM A653/A653M and ASTM A924/A924M.

Fabricate doors from interlocking cold-rolled slats, with section profiles as specified, designed to withstand the specified wind loading. Ensure the provided slats are continuous without splices for the width of the door.

Provide slats filled with manufacturer's standard acoustic insulation complying with maximum flame-spread and smoke-developed indexes of 75 and 450, respectively, according to ASTM E84. Enclose insulation completely within slat faces on interior surface of slats.

2.2.1.2 Non-Insulated Curtains

Form Curtains from manufacturer's standard shapes of interlocking slats.

2.2.1.3 Insulated Curtains

Form Curtains from manufacturer's standard shapes of interlocking slats. Supply slat system with a minimum R-value of 8 when calculated in accordance with ASHRAE FUN IP. Slats to consist of a urethane or polystyrene core not less than 11/16-inch thick, completely enclosed within metal facings. Ensure the exterior face of slats are the same gauge as specified for curtains. Select an interior face not lighter than 0.0219-inches. The insulated slat assembly requires a flame spread rating of not more than 25 and a smoke development factor of not more than 50 when tested in accordance with ASTM E84.

2.2.1.4 Curtain Bottom Bar

Install curtain bottom bars as pairs of angles from the manufacturer's standard steel, stainless and aluminum extrusions not less than 2.0 by 2.0-inches by 0.188-inch. Ensure steel extrusions conform to ASTM A36/A36M. Stainless steel extrusions conforming to ASTM A666, Type 304. Aluminum extrusions conforming to ASTM B221. Galvanize angles and fasteners in accordance with ASTM A653/A653M and ASTM A924/A924M. Coat welds and abrasions with paint conforming to ASTM A780/A780M.

2.2.1.5 Locks

Provide end and/or wind locks of Grade B cast steel conforming to ASTM A27/A27M, galvanized in accordance with ASTM A653/A653M, ASTM A153/A153M and ASTM A924/A924M. Secure locks at every other curtain slat.

2.2.1.6 Weather Stripping

Ensure weather-stripping at the door-head and jamb is 1/8-inch thick sheet of natural or neoprene rubber with air baffles. Secure weather stripping to the insides of hoods with galvanized-steel fasteners through continuous galvanized-steel pressure bars at least 5/8-inch wide and 1/8-inch thick.

Ensure threshold weather-stripping is 1/8-inch thick sheet natural or neoprene rubber secured to the bottom bars.

Provide weather-stripping of natural or neoprene rubber conforming to ASTM D2000.

2.2.1.7 Locking Devices

Ensure slide bolt engages through slots in tracks for locking by padlock, located on both left and right jamb sides, operable from coil side.

Provide chain lock keeper suitable for a standard padlock.

2.2.1.8 Safety Interlock

Equip power-operated doors with safety interlock switch to disengage power supply when door is locked.

2.2.1.9 Overhead Drum

Fabricate drums from nominal 0.028-inch thick, hot-dip galvanized steel sheet with G90 (Z275) zinc coating, complying with ASTM A653/A653M.

2.2.1.10 Slats

No. 5F, 18 gauge, Grade 40 steel, ASTM A653/A653M galvanized steel zinc coating.

2.2.2 Hardware

Ensure all hardware conforms to ASTM A153/A153M, ASTM A307, ASTM F568M, and ASTM A27/A27M.

2.2.2.1 Guides

Fabricate curtain jamb guides from the manufacturer's standard angles or channels of same material and finish as curtain slats unless otherwise indicated. Provide guides with sufficient depth and strength to retain curtain, and to withstand loading. Ensure curtain operates smoothly. Slot bolt holes for track adjustment.

2.2.2.2 Equipment Supports

Fabricate door-operating equipment supports from the manufacturer's standard steel shapes and plates conforming to ASTM A36/A36M, galvanized

in accordance with ASTM A653/A653M and ASTM A924/A924M. Size the shapes and plates in accordance with the industry standards for the size, weight, and type of door installation.

2.2.2.3 Hood

Provide a hood with a minimum 24-gauge galvanized sheet metal, flanged at top for attachment to header and flanged at bottom to provide longitudinal stiffness. The hood encloses the curtain coil and counterbalance mechanism. Exterior exposure must be approved by door manufacturer.

2.2.3 Counterbalancing Mechanism

Counterbalance doors by means of manufacturer's standard mechanism with an adjustable-tension, steel helical torsion spring mounted, around a steel shaft and contained in a spring barrel connected to top of curtain with barrel rings. Use grease-sealed or self-lubricating bearings for rotating members.

2.2.3.1 Brackets

Provide the manufacturer's standard mounting brackets with one located at each end of the counterbalance barrel conforming to ASTM A48/A48M. Provide brackets of either cast iron or cold-rolled steel.

2.2.3.2 Counterbalance Barrels

Fabricate spring barrel of manufacturer's standard hot-formed, structural-quality, welded or seamless carbon-steel pipe, conforming to ASTM A53/A53M. Ensure the barrel is of sufficient diameter and wall thickness to support rolled-up curtain without distortion of slats. Limit barrel deflection to not more than 0.03 inch per foot of span under full load.

Curtain to be coiled on a pipe of sufficient size to carry door load with deflection not to exceed 0.033 inches per foot of door span and to be correctly balanced by helical springs, oil tempered torsion type. Use cast iron barrel plugs to anchor springs to tension shaft and pipe.

a. Barrel

Provide steel pipe capable of supporting curtain load with maximum deflection of 0.03 inches per foot of width.

b. Spring Balance

Provide an oil-tempered, heat-treated steel helical torsion spring assembly designed for proper balance of door. Ensure that effort to operate manually operated units does not exceed 25 lbs. Provide wheel for applying and adjusting spring torque.

2.2.3.3 Spring Balance

Install one or more oil-tempered, heat-treated steel helical torsion springs within the barrel, capable of producing sufficient torque to assure easy operation of the door curtain. Provide and size springs to counterbalance weight of curtain, with uniform adjustment accessible from outside barrel. Secure ends of springs to barrel and shaft with cast-steel barrel plugs.

2.2.3.4 Torsion Rod for Counter Balance

Fabricate rod from the manufacturer's standard cold-rolled steel, sized to hold fixed spring ends and carry torsional load.

2.2.3.5 Counterbalance Shaft Assembly

a. Barrel

Provide steel pipe capable of supporting the curtain load with maximum deflection of 0.03 inches per foot of width.

b. Spring Balance

Provide an oil-tempered, heat-treated steel helical torsion spring assembly designed for proper balance of door. Ensure that maximum effort to operate does not exceed 25 pounds. Provide wheel for applying and adjusting spring torque.

2.2.4 Electric Door Operators

Provide electrical wiring and door operating controls conforming to the applicable requirements of NFPA 70.

Electric door-operator assemblies needs to be the sizes and capacities recommended and provided by the door manufacturer for specified doors. Furnish complete assemblies with electric motors and factory-prewired motor controls, starter, gear reduction units, solenoid-operated brakes, clutch, remote-control stations, manual or automatic control devices, and accessories as required for proper operation of the doors.

Design the operators so that motors may be removed without disturbing the limit-switch adjustment and affecting the emergency auxiliary operators.

Provide a manual operator of chain-gear mechanisms with a release clutch to permit manual operation of doors in case of power failure. Arrange the emergency manual operator so that it may be put into and out of operation from floor level, and its use does not affect the adjustment of the limit switches. Provide an electrical or mechanical device that automatically disconnects the motor from the operating mechanism when the emergency manual operating mechanism is engaged.

2.2.4.1 Door-Operator Types

Provide an operator mounted to the right or left door head plate with the operator on top of the door-hood assembly and connected to the door drive shaft with drive chain and sprockets. Headroom is required for this type of mounting.

Provide an operator mounted to the right or left door head plate with the operator on coil side of the door-hood assembly and connected to the door drive shaft with drive chain and sprockets. Front clearance is required for this type of mounting.

Provide a through-wall operator which is mounted on other side of wall from coil side of door.

2.2.4.2 Electric Motors

Provide motors which are the high-starting-torque, reversible, constant-duty electrical type with overload protection of sufficient torque and horsepower to move the door in either direction from any position. Ensure they produce a door-travel speed of not less than 8 nor more than 12 inches per second without exceeding the horsepower rating. See Door Schedule for power requirements.

Provide motors which conform to NEMA MG 1 designation, temperature rating, service factor, enclosure type, and efficiency to the requirements specified. Exterior exposure must be approved by manufacturer.

2.2.4.3 Motor Bearings

Select bearings with bronze-sleeve or heavy-duty ball or roller antifriction type with full provisions for the type of thrust imposed by the specific duty load.

Pre-lubricate and factory seal bearings in motors less than 1/2 horsepower.

Equip motors coupled to worm-gear reduction units with either ball or roller bearings.

Equip bearings in motors 1/2 horsepower or larger with lubrication service fittings. Fit lubrication fittings with color-coded plastic or metal dust caps.

In any motor, bearings that are lubricated at the factory for extended duty periods do not need to be lubricated for a given number of operating hours. Display this information on an appropriate tag or label on the motor with instructions for lubrication cycle maintenance.

2.2.4.4 Motor Starters, Controls, and Enclosures

Provide each door motor with: a factory-wired, unfused, disconnect switch; a reversing, across-the-line magnetic starter with thermal overload protection; 120-volt operating coils with a control transformer limit switch; and a safety interlock assembled in a NEMA ICS 6 type enclosure as specified herein. Ensure control equipment conforms to NEMA ICS 2.

Provide adjustable switches, electrically interlocked with the motor controls and set to stop the door automatically at the fully open and fully closed position.

2.2.4.5 Control Enclosures

Provide control enclosures that conform to NEMA ICS 6 for general purpose NEMA Type 1.

2.2.4.6 Transformer

Provide starters with 230/460 to 115 volt control transformers with one secondary fuse when required to reduce the voltage on control circuits to 120 volts or less. Provide a transformer conforming to NEMA ST 1.

2.2.4.7 Safety-Edge Device

Provide each door with a pneumatic safety device extending the full width

of the door and located within a U-section neoprene or rubber astragal, mounted on the bottom rail of the bottom door section. Device needs to immediately stop and reverse the door upon contact with an obstruction in the door opening during downward travel and cause the door to return to full-open position. A safety device is not a substitute for a limit switch.

Connect safety device to the control circuit through a retracting safety cord and reel.

2.2.4.8 Remote-Control Stations

Provide interior remote control stations which are full-guarded, momentary-contact three-button, heavy-duty, surface-mounted NEMA ICS 6 type enclosures as specified. Mark buttons "OPEN," "CLOSE," and "STOP." Ensure the "CLOSE" button requires a constant pressure to maintain the closing motion of the door. When the door is in motion and the "STOP" button is pressed, ensure the door stops instantly and remains in the stopped position. From the stopped position, the door may then be operated in either direction.

Provide exterior control stations which are full-guarded, momentary-contact three-button standard-duty, surface-mounted, weatherproof type, NEMA ICS 6, Type 4 enclosures, key-operated, with the same operating functions as specified herein for interior remote-control stations.

2.2.4.9 Speed-Reduction Units

Provide speed-reduction units consisting of hardened-steel worm and bronze worm gear assemblies running in oil or grease and inside a sealed casing, coupled to the motor through a flexible coupling. Drive shafts need to rotate on ball- or roller-bearing assemblies that are integral with the unit.

Provide minimum ratings of speed reduction units in accordance with AGMA provisions for class of service.

Ground worm gears to provide accurate thread form; machine teeth for all other types of gearing. Surface harden all gears.

Provide antifriction type bearings equipped with oil seals.

2.2.4.10 Chain Drives

Provide roller chains that are a power-transmission series steel roller type conforming to ASME B29.400, with a minimum safety factor of 10 times the design load.

Heat-treat or otherwise harden roller-chain side bars, rollers, pins, and bushings.

Provide high-carbon steel chain sprockets with machine-cut hardened teeth, finished bore and keyseat, and hollow-head setscrews.

2.2.4.11 Brakes

Provide 360-degree shoe brakes or shoe and drum brakes. Ensure the brakes are solenoid-operated and electrically interlocked to the control circuit

to set automatically when power is interrupted.

2.2.4.12 Clutches

Ensure clutches are either the 4-inch diameter, multiple face, externally adjustable friction type or adjustable centrifugal type.

2.2.4.13 Weather/Smoke Seal Sensing Edge

Provide automatic stop control by an automatic sensing switch within neoprene astragal extending the full width of door bottom bar.

Provide an electric sensing edge device. Ensure the door immediately stops downward travel when contact occurs before door fully closes. Provide a self-monitoring wireless sensing edge connection to the motor operator; eliminating the need for a physical traveling electric cord connection between bottom bar sensing edge device and motor operator. Supervised system alters normal door operation; preventing damage, injury or death due to an inoperable sensing edge system.

2.2.5 Surface Finishing

Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes. Noticeable variations in the same metal component are not acceptable. Variations in appearance of adjoining components are acceptable if they are within the range of approved samples and are assembled or installed to minimize contrast.

PART 3 EXECUTION

3.1 INSTALLATION

Install overhead coiling door assembly, anchors and inserts for guides, brackets, motors, switches, hardware, and other accessories in accordance with approved detail drawings and manufacturer's written instructions. Upon completion of installation, ensure doors are free from all distortion.

Install overhead coiling doors, motors, hoods, and operators at the mounting locations as indicated for each door in the contract documents and as required by the manufacturer.

Install overhead coiling doors, switches, and controls along accessible routes in compliance with regulatory requirements for accessibility and as required by the manufacturer.

3.1.1 Field Painted Finish

Ensure field painted steel doors and frames are in accordance with Section 09 90 00 PAINTS AND COATINGS and manufacturer's written instructions. Protect weather stripping from paint. Ensure finishes are free of scratches or other blemishes.

3.2 ADJUSTING AND CLEANING

3.2.1 Acceptance Provisions

After installation, adjust hardware and moving parts. Lubricate bearings and sliding parts as recommended by manufacturer to provide smooth

operating functions for ease movement, free of warping, twisting, or distortion of the door assembly.

Adjust seals to provide weather-tight fit around entire perimeter.

Engage a factory-authorized service representative to perform startup service and checks according to manufacturer's written instructions.

Test the door opening and closing operation when activated by controls or alarm-connected fire-release system. Adjust controls and safeties. Replace damaged and malfunctioning controls and equipment. Reset door-closing mechanism after successful test.

Test and make final adjustment of new doors at no additional cost to the Government.

3.2.1.1 Maintenance and Adjustment

Not more than 90 calendar days after completion and acceptance of the project, examine, lubricate, test, and re-adjust doors as required for proper operation.

3.2.1.2 Cleaning

Clean doors in accordance with manufacturer's approved instructions.

3.3 CLOSEOUT ACTIVITIES

3.3.1 Warranty

Furnish a written guarantee that the helical spring and counterbalance mechanism are free from defects in material and workmanship for not less than two years after completion and acceptance of the project.

Warrant that upon notification by the Government, any defects in material, workmanship, and door operation are immediately correct within the same time period covered by the guarantee, at no cost to the Government.

3.3.2 Operation And Maintenance

Submit 6 copies of the Operation and Maintenance Manuals 30 calendar days prior to testing the Overhead Coiling Door Assemblies. Update and resubmit data for final approval no later than 30 calendar days prior to contract completion.

Submit Operation and Maintenance Manuals for Overhead Coiling Door Assemblies, including the following items:

Materials

Devices

Electric Door Operators

Hood

Counterbalancing Mechanism

Painting

Procedures

Manufacture's Brochures

Parts Lists

Provide operation and maintenance manuals which are consistent with manufacturer's standard brochures, schematics, printed instructions, operating procedures, and safety precautions. Provide test data that is legible and of good quality.

-- End of Section --

SECTION 08 34 73

SOUND CONTROL DOOR ASSEMBLIES
02/15

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN WELDING SOCIETY (AWS)

AWS D1.3/D1.3M	(2008; Errata 2008) Structural Welding Code - Sheet Steel

ASTM INTERNATIONAL (ASTM)

ASTM A1008/A1008M	(2015) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy and High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardened
ASTM A1011/A1011M	(2017a) Standard Specification for Steel Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength
ASTM A108	(2013) Standard Specification for Steel Bar, Carbon and Alloy, Cold-Finished
ASTM A36/A36M	(2014) Standard Specification for Carbon Structural Steel
ASTM A568/A568M	(2014) Standard Specifications for Steel, Sheet, Carbon, Structural, and High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, General Requirements for
ASTM D6386	(2010) Standard Practice for Preparation of Zinc (Hot-Dip Galvanized) Coated Iron and Steel Product and Hardware Surfaces for Painting
ASTM E1289	(2008) Standard Specification for Reference Specimen for Sound Transmission Loss
ASTM E336	(2015) Measurement of Airborne Sound Insulation in Buildings
ASTM E413	(2010) Rating Sound Insulation
ASTM E90	(2009) Standard Test Method for Laboratory

Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Hollow Metal Sound Retardant Doors; G

Door Frames; G

SD-03 Product Data

Hollow Metal Sound Retardant Doors; G

Door Frames; G

Door Hardware; G

Thresholds; G

Astragals; G

SD-06 Test Reports

Wind Loading Tests; G

Water Leakage Tests; G

Acoustical Tests; G

Air Infiltration Tests; G

SD-07 Certificates

Hollow Metal Sound Retardant Doors; G

Door Frames; G

Door Hardware; G

Thresholds; G

Astragals; G

1.3 QUALITY CONTROL

Ensure work within this section is designed and furnished by one manufacturer, who has been engaged in the manufacture of Sound Retardant Metal Door systems for at least five years prior to the start of this work.

Provide acoustic assemblies manufactured by a single source specializing in the production of this type work for a minimum of 5 years.

1.4 DELIVERY, STORAGE, AND HANDLING

Ship all doors in the manufacturer's undamaged individual cartons, securely bundled and wrapped with moisture-resistant covers and stored in accordance with the manufacturer's printed instructions in a dry, clean, and ventilated area.

Deliver and store wood doors in the building following the installation of concrete, terrazzo, plaster, or other wet materials, and only after the building has dried out and has a roof.

Store all materials on planks in a dry location. Store doors and frames vertically with airspace between. Store doors on the edge to eliminate any potential damage to the door bottom seal. Cover all material to protect from damage but in a manner to allow proper circulation.

Perform final adjustment of seals when temperatures and humidity conditions replicate the interior conditions that will exist when the building is occupied.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Provide sound retardant door assemblies of the thickness, width, and height indicated, complete with perimeter seals, seal housings, gasketing, automatic door bottoms, thresholds, door frames, and astragals as required to conform to the specified STC per ASTM E90 and ASTM E1289.

Submit fabrication drawings for Hollow Metal Sound Retardant Doors, and Door Frames.

Submit certificates showing conformance with the referenced standards in this section, and manufacturer's catalog data including STC ratings where applicable, for the following items: Hollow metal sound retardant doors; door frames; door hardware; thresholds; and astragals.

Provide assemblies that are complete with metal frame, sealing system, and Cam-lift hinges (when required).

2.1.1 Design Requirements

2.1.1.1 Door Design

Provide sound Retardant Swinging Doors with sizes as indicated on drawings. No visible seams are permitted on door faces. Provide face gauges, internal sound retardant core and perimeter door edge construction per manufacturer's standard for the specified STC rating. No lead or asbestos is permitted in door construction to achieve STC performance. No lead or asbestos is permitted in door construction to achieve performance requirements.

2.1.1.2 Frame Design

Provide sound Retardant Metal Frames conforming to ASTM A1008/A1008M, not less than 0.0747-inch thick, and free from pitting, scale, stretcher strains, fluting, and surface defects with integral trim and shipped with temporary spreader. Knockdown frames are not acceptable.

Provide frames with 2-inch faces, profiles and dimensions as indicated, with mitered reinforced corners, welded the full depth of frame and trim, with exposed surfaces ground smooth and flush. Close contact edges to hairline joints.

2.1.2 Performance Requirements

2.1.2.1 STC (Sound Transmission Classification) Rating

Provide doors with an STC of at least 50per the door schedule.

2.2 FABRICATION

Provide doors that are minimum 14 gauge, 1-3/4-inch thick with welded, seamless construction. No visible joints are permitted on the exposed faces or edges. Join door skins at vertical edges by continuous welds, ground and dressed smooth to provide a flush finish. Reinforce top and bottom with 16 gauge continuous inverted steel channels spot welded to both faces. Finish both top and bottom to provide a smooth flush condition. Bevel both vertical edges 1/8-inch in 2-inches.

Clean and sand to smooth finish all doors to remove handling and storage marks, raised grain, minor surface marks and abrasions which are to receive a job site finish.

2.2.1 Hollow Metal Sound Retardant Doors

Conform to ASTM A1008/A1008M for door construction utilizing steel facing sheets. Conform stretcher level flatness to ASTM A568/A568M; not less than 0.0598-inch thick; free from pitting, scale, and surface defects; separated by a core construction designed to meet the required STC; and tested and rated in accordance with ASTM E90.

Provide doors that have flush seamless face sheets and vertical edges, with continuous welded and smooth joints. Provide edges that are flush or rabbeted as required for perimeter seals.

Provide door surfaces that are visually flat and free from warp, waviness, and other surface irregularities and defects. Maximum allowable warp or twist-can not exceed 1/8-inch when measured with a 7-foot straightedge along the diagonal and not exceed 1/16-inch when measured with a 7-foot straightedge in the width or in any position along the length of the door.

Provide hardware reinforcement that is steel drilled, tapped to template requirements and welded in place. Provide minimum thicknesses as follows:

a. Butts, 0.1494-inch

b. Lock strike, 0.1196-inch

c. Surface applied hardware 0.0747-inch

Shop paint exposed door surfaces, including surfaces that are galvanized.

Shop paint concealed exterior door surfaces except galvanized surfaces.

Thoroughly clean all mill scale, rust, oil, grease, dirt, and other foreign materials from surfaces before the application of the shop coat of paint.

After cleaning, provide galvanized surfaces free of paint in accordance with ASTM D6386, Method A, B, C, or D.

Apply to clean prepared dry surfaces one shop coat of rust inhibitive metallic oxide or synthetic resin primer by brush, dipping, or other approved method to provide a continuous minimum dry film thickness (dft) of 0.9 mil.

2.3 COMPONENTS

2.3.1 Frames

Construct frames for Sound Retardant Swinging Doors from formed sheet steel or structural shapes and bars. Provide sheet steel that is commercial quality, level, cold rolled steel conforming to ASTM A1008/A1008Mor hot rolled, pickled and oiled steel conforming to ASTM A1011/A1011M. Comply steel shapes with ASTM A36/A36M and steel bars with ASTM A108, Grade 1018.

2.3.2 Hardware Reinforcements

Factory mortise, reinforce, drill and tap frames for all mortise hardware as required by hardware manufacturer's template. Provide necessary reinforcement plates as required for surface mounted hardware; installer to perform all field drilling and tapping. Provide dust cover boxes on all frame mortises. Provide minimum thicknesses as follows:

a. Butts, 3/16-inch

b. Lock strike, 0.1196-inch

c. Surface applied hardware 0.0747-inch

2.3.3 Anchors

Locate frame anchors near the top and bottom of doors and at intermediate points and 24-inches on center. Provide a minimum of three anchors per jamb.

Provide floor anchor clips at each jamb with 2-inch vertical adjustments on increments not exceeding 1/16-inch.

2.3.4 Door Hardware

Provide the following STC related hardware with the door; cam-lift hinges, perimeter seals, astragals, door bottoms, thresholds.

Include on Installation drawings a finish hardware schedule for each door and a hollow metal door frame schedule for each door indicating profile, dimensions, hardware reinforcement, and frame anchorage. Also indicate perimeter seals, door-bottom devices and other hardware items that are assembled in the shop.

Refer to Section 08 71 00 DOOR HARDWARE for remaining hardware requirements.

2.3.5 Thresholds

Provide metal thresholds where indicated. Provide thresholds that are extruded aluminum, 6063-T5 alloy, mill finish, not less than 1/8-inch thick, with integral seal grooves formed to the indicated section.

2.3.6 Astragals

Provide steel astragals for the inactive leaf of each pair of doors, as indicated. Surface mount to the door by welded connections or by countersunk, flat-head screws, within integral groove to receive perimeter seal material.

2.4 TESTS, INSPECTIONS, AND VERIFICATIONS

2.4.1 Sound Transmission Classification

Provide Test reports prepared by a nationally recognized, independent laboratory for Acoustical Tests, Air Infiltration Tests, Wind Loading Tests, and Water Leakage Tests indicating that the sound transmission classification (STC) of the proposed door, based on tests at 16 third-octave band frequencies from 125 to 4,000 hertz, is no less than the specified STC when tested in accordance with ASTM E90, and that the door tested is hung in substantially the type of wall and frame as indicated and is fully operable with hardware and perimeter seals installed.

2.4.2 Cam Lift Hinges

When required to achieve STC, manufacturer to furnish laboratory test data certifying hinges have been cycled a minimum of 1,000,000 while supporting a minimum door weight of 350 pounds.

2.4.3 Guarantee

Provide written guarantee that each door delivered to the project is equal in construction, sound transmission classification (STC), and positive pressure test rating where applicable, with appropriate labeling and markings, to that of the sample door tested. Clearly state in written guarantee that each door assembly, when installed in accordance with the manufacturer's printed instructions, has an in-place STC within 3 decibels of the specimen tested. Submit the following test data and Certificates with the written Guarantee:

a. Wind Loading Tests

b. Water Leakage Tests

c. Acoustical Tests

d. Air Infiltration Tests

PART 3 EXECUTION

3.1 PREPARATION

Upon receipt of material, thoroughly inspect all frames, doors and accessories. Verify quantities and tag numbers according to the packing list provided. Report all discrepancies, deficiencies and/or damages immediately to Contracting Officer.

Prior to installation check all doors and frames for correct size and swing. Verify that frames are plumb, square and aligned without twist in accordance with tolerances published by NAAMM/HMMA and SDI.

3.1.1 Frame Painting and Cleaning

Clean thoroughly all surfaces of all mill scale, rust, oil, grease, dirt, and other foreign materials before the application of the shop coat of paint.

Apply one shop coat of rust inhibitive metallic oxide or synthetic resin primer applied to clean, dry, and prepared surfaces by brush, dipping, or other approved method to provide a continuous minimum dry film thickness of 0.9 mil.

3.2 INSTALLATION

3.2.1 Frame

Install frames plumb and true with not more than 1/32-inch deviation in vertical alignment in 8 feet. Anchor to the wall in accordance with the printed instructions of the manufacturer. Grout frames solid with mortar in masonry, concrete, and plaster wall construction. Spot grout frames in dry wall partitions with mortar at the jamb anchor clips; fill the space between metal frame and stud partition solidly with fiberglass or mineral wool insulation.

Field splices may be required after installation because of shipping limitations. Field weld splices by certified welders per manufacturer's instructions and in accordance with AWS D1.3/D1.3M.

3.2.2 Door

Install and adjust all doors, hardware, and seals in accordance with the approved drawings, hardware schedules, and the printed instructions of the door manufacturer.

Install and adjust perimeter seals and automatic door bottom seals to provide positive compression contact with the entire sealing surface with no gaps, openings, or breaks. Hinges or hardware which distort or pinch the perimeter seal during operation of the door will be rejected.

Install door bottom devices to seal the space between the door bottoms and the finished floor and the space between the seal and seal housing.

Field apply perimeter seal housings with mitered corners and with flush, aligned hairline joints.

Install components to manufacturer's written instructions. Set frames plumb, square, level and at correct elevation. Adjust operable parts for correct clearances and function. Install and adjust perimeter and bottom acoustic seals.

3.3 FIELD QUALITY CONTROL

Provide third party testing in accordance with ASTM E336. Verify in writing that installed product performs no less than five (5) ASTC or NIC rating points below the specified laboratory STC rating. Examine, adjust,

and retest any installation not meeting that criteria until compliance is obtained.

3.3.1 Testing and Performance

Provide assemblies that are identical to those tested at an independent acoustical laboratory qualified under the National Voluntary Laboratory Accreditation Program (NVLAP) by the National Institute for Science and Technology (NIST) in accordance with ASTM E90 and ASTM E413. On test reports include the laboratory name, test report number and date of test.

-- End of Section --

SECTION 08 41 13

ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS
11/16

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ALUMINUM ASSOCIATION (AA)

AA DAF45	(2003; Reaffirmed 2009) Designation System for Aluminum Finishes

AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION (AAMA)

AAMA 1503	(2009) Voluntary Test Method for Thermal Transmittance and Condensation Resistance of Windows, Doors and Glazed Wall Sections
AAMA 501	(2015) Methods of Test for Exterior Walls
AAMA 611	(2014) Voluntary Specification for Anodized Architectural Aluminum
AAMA 800	(2016) Voluntary Specifications and Test Methods for Sealants

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)

ASCE 7	(2017) Minimum Design Loads for Buildings and Other Structures

ASTM INTERNATIONAL (ASTM)

ASTM B221	(2014) Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes
ASTM E1424	(1991; R 2016) Standard Test Method for Determining the Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure and Temperature Differences Across the Specimen
ASTM E1886	(2013a) Standard Test Method for Performance of Exterior Windows, Curtain Walls, Doors, and Impact Protective Systems Impacted by Missile(s) and Exposed to Cyclic Pressure Differentials
ASTM E1996	(2017) Standard Specification for Performance of Exterior Windows, Curtain Walls, Doors, and Impact Protective

	Systems Impacted by Windborne Debris in Hurricanes
ASTM E283	(2004; R 2012) Determining the Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen
ASTM E330/E330M	(2014) Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference
ASTM E331	(2000; R 2016) Standard Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference
ASTM E783	(2002; R 2018) Standard Test Method for Field Measurement of Air Leakage Through Installed Exterior Windows and Doors
ASTM F1642/F1642M	(2017) Standard Test Method for Glazing and Glazing Systems Subject to Airblast Loadings

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)

ANSI/BHMA A156.10	(2017) Power Operated Pedestrian Doors
ANSI/BHMA A156.4	(2013) Door Controls - Closers

INTERNATIONAL CODE COUNCIL (ICC)

ICC IBC	(2018) International Building Code

U.S. GENERAL SERVICES ADMINISTRATION (GSA)

FS TT-P-645	(Rev C) Primer, Paint, Zinc-Molybdate, Alkyd Type

UNDERWRITERS LABORATORIES (UL)

UL 325	(2017) UL Standard for Safety Door, Drapery, Gate, Louver, and Window Operators and Systems

1.2 ADMINISTRATIVE REQUIREMENTS

1.2.1 Pre-Installation Meetings

Conduct a meeting before installation begins to verify the project requirements, substrate conditions, manufacturer's installation instructions, and manufacturer's warranty requirements.

Within 30 days of the Contract Award, submit the following for review and approval by the Contracting Officer:

a. List of product installations

b. Sample warranty

c. Finish and color samples

d. Manufacturer's catalog data

Concurrently submit certified test reports showing compliance with specified performance characteristics and UL 325 for the following:

a. Wind Load (Resistance) in accordance with AAMA 501

b. Deflection in accordance with ASTM F1642/F1642M

c. Condensation Resistance and Thermal Transmittance Performance Requirements in accordance with AAMA 1503

d. Water Infiltration in accordance with ASTM E331

e. Structural Requirements in accordance with ASTM F1642/F1642M

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Sample Warranty

List of Product Installations

SD-02 Shop Drawings

Installation Drawings

Fabrication Drawings

SD-03 Product Data

Finish

SD-04 Samples

Finish and Color Samples

SD-06 Test Reports

Certified Test Reports

Deflection

Air Infiltration

Condensation Resistance and Thermal Transmittance

Water Infiltration

SD-08 Manufacturer's Instructions

Manufacturer's Instructions

SD-11 Closeout Submittals

Manufacturer's Product Warranty

1.4 QUALITY CONTROL

1.4.1 Qualifications

1.4.1.1 Installer Qualifications

Provide documentation of the installer's experience in performing the work specified in this section.

Ensure that the installers have specialized in work similar to that required for this project, and that they are acceptable to product manufacturer.

1.4.1.2 Manufacturer Qualifications

Ensure that manufacturers meet the requirements specified in this section and project drawings.

Ensure that the manufacturer is capable of providing field service representation during construction, approving acceptable installers and approving application methods.

1.4.2 Single-Source Responsibility

When aluminum entrances are part of a building enclosure system, that includes storefront framing, windows, a curtain wall system, and related products, provide building enclosure system products from a single-source manufacturer.

Use a single source manufacturer with sole responsibility for providing design, structural engineering, and custom fabrication for door portal systems and for supplying components, materials, and products. Do not use products provided from numerous sources for assembly at the site. Ensure that the following work items and components are fabricated or supplied by a single source are:

a. Glass as specified in Section 08 81 00 GLAZING.

1.5 DELIVERY, STORAGE, AND HANDLING

1.5.1 Ordering

To avoid construction delays, comply with the manufacturer's lead-time requirements and instructions for ordering.

1.5.2 Packing, Shipping, Handling and Unloading

Deliver materials in the manufacturer's original, unopened, undamaged containers with identification labels intact.

1.5.3 Storage and Protection

Store materials in a way that protects them from exposure to harmful weather conditions. Avoid damaging the storefront material and components during handling. Protect storefront material against damage from elements, construction activities, and other hazards before, during, and after storefront installation.

Do not use adhesive papers or sprayed coatings that become firmly bonded when exposed to sunlight. Do not leave coating residue on surfaces.

1.6 PROJECT / SITE CONDITIONS

1.6.1 Field Measurements

Verify actual measurements or openings by taking field measurements before fabrication; record these measurements on shop drawings. To avoid construction delays, coordinate field measurements, and fabrication schedule with construction progress.

1.7 WARRANTY

Provide a written manufacturer's warranty, executed by a company official, warranting against defects in materials and products for 2 years from the date of shipment. Warrant that the door corner construction is for the life of the project. Provide a written installer's warranty, warranting work to be watertight and free from defective materials, defective workmanship, and glass breakage as a result of defective design, and agreeing to replace components that fail within 2 years.

The warranty states the following:

a. Watertight and airtight system installation is completed within specified tolerances.

b. The completed installation remains free of rattles, wind whistles and noise caused by thermal movement and wind pressure.

c. System is structurally sound and free from distortion.

d. Glass and glazing gaskets will not break or "pop" from frames as a result of design, wind load pressure, movement caused by expansion or contraction, or structural loading.

e. Glazing sealants and gaskets remain free of abnormal deterioration or dislocation as a result of sunlight, weather, or oxidation.

Provide written warranty stating that the organic coating finish will not fade more than 10 percent or show chalking, yellowing, peeling, cracking, pitting, corroding or variations in color, or gloss deterioration beyond the manufacturer's descriptive standards for 5 years from the shipment date and agreeing to promptly correct defects.

Provide a written thermal integrity warranty for 2 years from ship date against thermal barrier system failure resulting from the following:

a. Longitudinal and transverse thermal barrier shrinkage.

b. Thermal barrier cracking.

c. Structural failure of the thermal barrier material.

d. Loss of adhesion or loss of prescribed edge pressure on glazing material, resulting in excessive air and water infiltration.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Provide aluminum entrances, with glass and glazing, door hardware, and components.

Aluminum entrances include impact resistance entrances; medium stile, 3 1/2 inchvertical face dimension, 1 3/4 inchdepth, for interior structural silicone glaze, for high-traffic/impact-resistant applications.:

2.1.1 Design Requirements for Aluminum (Entrances and Components)

Provide a door portal system designed to withstand the following loads without breakage, loss, failure of seals, product deterioration, or other defects.

a. Dead and Live Loads: Determined by ASCE 7 and calculated in accordance with applicable codes.

b. Seismic Loads: Design and install the system to comply with the seismic requirements for the project location in accordance with Section 1613 of the International Building Code, ICC IBC.

c. Wind Loads: Design and install the system so that the effects of wind load acting inward and outward normal to the plane of the wall are in accordance with ASTM E330/E330M.

d. Thermal Loads And Movement:

(1) Ambient Temperature Range: 120 degrees F

(2) Material Surfaces Range: 180 degrees F

e. Water and Air Resistance: Provide weatherstripping, exterior gaskets, sealants, and other accessories to resist water and air penetration.

f. Impact-Protective Systems Provide an impact-protective system in accordance with ASTM E1886ASTM E1996.

2.1.1.1 Material Standard

ASTM B221; 6063-T5 alloy and tempered.

Provide door stile and rail face dimensions of the entrance doors as follows:

Vertical Stile	Top Rail	Bottom Rail
3-1/2 inches	3-1/2 inches	6-1/2 inches

Provide major portions of the door members at 0.125 inches nominal in

thickness and glazing molding at 0.050 inches thick.

2.1.1.2 Sealants

Provide either ethylene propylene diene monomer (EPDM) elastomeric extrusions or thermoplastic elastomer glazing gaskets. Structural silicone sealant is required.

Internal Sealants: Provide sealants that according to the manufacturer will remain permanently elastic, tacky, non-drying, non-migrating, and weather tight.

2.1.1.3 Thermal Barrier

Use a rigid, structural thermal barrier to separate all exterior aluminum from interior aluminum. For purposes of this specification, a structural thermal barrier is defined as a system that transfers shear during bending and, therefore, promotes composite action between the exterior and interior extrusions. Do not use a nonstructural thermal barrier. Ensure that the thermal barrier provides a structural connection between the two sides of the door.

2.2 FABRICATION

Provide the following information when submitting fabrication drawings for custom fabrications:

a. Indicate elevations, detailed design, dimensions, member profiles, joint locations, arrangement of units, and member connections.

b. Show the following items:

(1) Details of special shapes.

(2) Reinforcing.

(3) Anchorage system.

(4) Interfacing with building construction.

(5) Provisions for expansion and contraction.

(6) Thermal breaks.

c. Indicate typical glazing details, locations of various types and thickness of glass and internal sealant requirements as recommended by the sealant manufacturer.

d. Clearly indicate locations of exposed fasteners and joints.

e. Clearly show where and how the manufacturer's system deviates from Contract drawings and these specifications.

2.2.1 Entrance System Fabrication

Provide door corner construction consisting of mechanical clip fastening, SIGMA deep penetration plug welds and 1 1/8 inch long fillet welds inside and outside all four corners. Provide a hook-in type exterior glazing stop with EPDM glazing gaskets reinforced with non-stretchable cord.

Provide an interior glazing stop that is mechanically fastened to the door member and that incorporates a silicone-compatible spacer used with silicone sealant.

Accurately fit and secure joints and corners. Make joints hairline in appearance. Remove burrs and smooth edges. Prepare components with internal reinforcement for door hardware. Arrange fasteners and attachments so that they are concealed from view.

Separate dissimilar metals with protective coating or pre-formed separators in order to prevent contact and corrosion.

2.2.2 Shop Assembly

Fabricate and assemble units with joints only at the intersection of aluminum members with hairline joints; rigidly secure these units, and seal them in accordance with the manufacturer's recommendations.

2.2.2.1 Welding

Conceal welds on aluminum members in accordance with AWS recommendations or methods recommended by the manufacturer. Members showing welding bloom or discoloration on finish or material distortion will be rejected by the Contacting Officer.

2.2.3 Finish

Before fabrication, clean the units and give them a .AA-M-10-C22-A42 bronze (color) anodized finish in accordance with the requirements of the AA DAF45. The finish thickness is A42, 0.7 mil or greater.

a. Color Anodized: Conforming to AA-M12C22A 44 and AAMA 611

(1) Architectural Class I
(2) Sandstone by Kawneer, 0.7 mil minimum thickness

2.2.4 Fabrication Tolerance

Fabricate and assemble units with joints only at intersection of aluminum members with hairline joints; rigidly secure these units, and seal them in accordance with the manufacturer's recommendations.

Fabricate aluminum entrances in accordance with the entrance manufacturer's prescribed tolerances.

2.2.4.1 Material Cuts

Square to 1/32 inch off square, over largest dimension; proportionate amount of 1/32 inch on the two dimensions.

2.2.4.2 Maximum Offset at Consecutive Members

1/64 inch in alignment between two consecutive members in line, end to end.

2.2.4.3 Maximum Offset at Glazing Pocket Corners

1/64 inch between framing members at glazing pocket corners.

2.2.4.4 Joints

Between adjacent members in same assembly: Joints are hairline and square to the adjacent member.

2.2.4.5 Variation

In squaring diagonals for doors and fabricated assemblies: 1/16 inch.

2.2.4.6 Flatness

For doors and fabricated assemblies: plus/minus 1/16 inch of neutral plane.

2.3 MATERIALS

2.3.1 Sealants

Ensure that all sealants conform to AAMA 800.

2.3.2 Glass

Refer to Section 08 81 00 GLAZING.

2.4 ACCESSORIES

2.4.1 Fasteners

Provide stainless steel fasteners in areas where the fasteners are exposed.

Use non-corrosive and compatible fasteners with components being fastened. Do not use exposed fasteners, except where unavoidable for application of hardware.

In areas where fasteners are not exposed, use aluminum, non-magnetic stainless steel, or other materials warranted by the manufacturer.

For exposed locations, provide countersunk Phillips head screws when items with a matching finish are fastened. For concealed locations, provide the manufacturer's standard fasteners.

Provide nuts or washers that have been designed with a means to prevent disengagement; do not deform fastener threads.

2.4.2 Perimeter Anchors

When steel anchors are used, provide insulation between steel material and aluminum material in order to prevent galvanic action.

2.4.2.1 Inserts and Anchorage Devices

Provide manufacturer's standard formed or fabricated assemblies, steel or aluminum, of shapes, plates, bars, or tubes. Shop-coat steel assemblies after fabrication with an alkyd zinc chromate primer complying with FS TT-P-645.

2.4.3 Standard Entrance Hardware

2.4.3.1 Weatherstripping

Provide sill-sweep strips: Provide an EPDM blade gasket sweep strip in an aluminum extrusion applied to the interior exposed surface of the bottom rail with concealed fasteners.

2.4.3.2 Threshold

Provide an extruded aluminum threshold, one piece per door opening, with ribbed surface.

2.4.3.3 Panic Device

Provide the manufacturer's recommended standard panic hardware.

2.4.3.4 Closer

Provide a surface closer in accordance with ANSI/BHMA A156.4.

PART 3 EXECUTION

3.1 EXAMINATION

3.1.1 Site Verification of Conditions

Verify that the condition of substrate previously installed under other sections is acceptable for product installation in accordance with the manufacturer's instructions.

Verify that openings are sized to receive the storefront system and that the sill plate is level in accordance with the manufacturer's acceptable tolerances.

3.2 PREPARATION

Field-verify dimensions before fabricating components for the door portal assembly.

Coordinate the erection of door portal with installation of surrounding glass wall and door assemblies. Ensure that the door portals can provide support and anchorage for assembly components.

3.2.1 Adjacent Surfaces Protection

Protect adjacent work areas and finish surfaces from damage during product installation.

3.2.2 Aluminum Surface Protection

Protect aluminum surfaces from contact with lime, mortar, cement, acids, and other harmful contaminants.

3.3 INSTALLATION

Submit installation drawings for review and approval.

Install the entrance system in accordance with the manufacturer's

instructions and the AAMA storefront and entrance guide specifications manual. Attach the entrance system to the structure, allowing it to be adjusted to accommodate construction tolerances and other irregularities. Provide alignment attachments and shims to permanently fasten the system to the building structure. Align the assembly so that it is plumb and level, and free of warp and twist. Maintain assembly dimensional tolerances aligning with adjacent work.

Set thresholds in a bed of mastic and secure the thresholds. Protect aluminum members in contact with masonry, steel, concrete, or dissimilar materials using nylon pads or a bituminous coating. Shim and brace the aluminum system before anchoring the system to the structure. Verify that weep holes are open, and the metal joints are sealed in accordance with the manufacturer's installation instructions. Seal metal-to-metal joints using a sealant recommended by the system manufacturer.

3.3.1 Tolerances

Ensure that tolerances for wall thickness and other cross-sectional dimensions of entrance members are nominal and in compliance with Aluminum Standards and Data, published by the Aluminum Association.

3.3.2 Adjusting

Adjust operating hardware for smooth operation, and as recommended by the manufacturer.

3.3.3 Related Products Installation Requirements

3.3.3.1 Sealants (Perimeter)

Refer to Section 07 92 00 JOINT SEALANTS.

3.3.3.2 Glass

Refer to Section 08 81 00 GLAZING.

3.4 FIELD QUALITY CONTROL

3.4.1 Air Infiltration

Test air infiltration in accordance with ASTM E783

Submit certified test reports showing compliance with specified performance characteristics as follows:

a. For single-acting offset pivot, butt hung, or continuous geared hinge entrances in the closed and locked position, test the specimen in accordance with ANSI/BHMA A156.10, and ASTM E283 at a pressure differential of 1.57 psf for pairs of doors; ensure that maximum infiltration for a pair of 7 foot by 8 foot entrance doors and frame is 1.2 cfm/square foot.

b. Ensure the maximum allowable infiltration for a completed storefront system does not exceed 0.06 cfm/square foot when tested in accordance with ASTM E1424 at a differential static pressure of 6.24 psf.

3.4.2 Wind Loads

Provide a completed storefront system capable of withstanding wind pressure loads, normal to the wall plane indicated, as follows:

a. Exterior Walls

(1) Positive Pressure: see windload diagram on structural drawings

(2) Negative Pressure: see windload diagram on structural drawings

3.4.3 Deflection

Submit certified test reports showing that the maximum allowable deflection in a member when tested in accordance with ASTM E330/E330M with allowable stress is L/175 or 3/4 inches maximum.

3.5 ADJUSTING AND CLEANING

3.5.1 Protection

Protect the installed product's finish surfaces from damage during construction. Protect the aluminum storefront system from damage from grinding and polishing compounds, plaster, lime, acid, cement, or other harmful contaminants.

3.5.2 Cleaning

Repair or replace damaged installed products. Clean installed products in accordance with manufacturer's instructions before acceptance remove excess mastic, mastic smears, and other foreign materials. Remove construction debris from the project site and legally dispose of this debris.

3.6 WARRANTY

Submit three signed copies of the manufacturer's product warranty for the entrance system as follows:

a. Warranty Period: Five years from Date of Substantial Completion of the project, provided that the Limited Warranty begins no later than six months from the date of shipment by the manufacturer. In addition, support welded door corner construction with a limited lifetime warranty for the life of the door under normal use.

Ensure that the Warranty's language is identical to the "As Approved" version of the sample warranty submitted to and returned from the Contracting Officer.

-- End of Section --

SECTION 08 51 13

ALUMINUM WINDOWS
05/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION (AAMA)

AAMA 907	(2015) Voluntary Specification for Corrosion Resistant Coatings on Carbon Steel Components Used in Windows, Doors and Skylights
AAMA 1302.4	(1973) Specifications for Forced-Entry Resistant Aluminum Prime Windows
AAMA 1503	(2009) Voluntary Test Method for Thermal Transmittance and Condensation Resistance of Windows, Doors and Glazed Wall Sections
AAMA 2605	(2020) Voluntary Specification, Performance Requirements and Test Procedures for Superior Performing Organic Coatings on Aluminum Extrusions and Panels
AAMA/WDMA/CSA 101/I.S.2/A440	(2017) North American Fenestration Standard/Specification for Windows, Doors, and Skylights

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 169	(2013) Climate Data for Building Design Standards

ASTM INTERNATIONAL (ASTM)

ASTM E90	(2009; R2016) Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements
ASTM E413	(2016) Classification for Rating Sound Insulation
ASTM E1300	(2016) Standard Practice for Determining Load Resistance of Glass in Buildings
ASTM E1332	(2016) Standard Classification for Rating Outdoor-Indoor Sound Attenuation

ASTM E1886	(2019) Standard Test Method for Performance of Exterior Windows, Curtain Walls, Doors, and Impact Protective Systems Impacted by Missile(s) and Exposed to Cyclic Pressure Differentials
ASTM E1996	(2017) Standard Specification for Performance of Exterior Windows, Curtain Walls, Doors, and Impact Protective Systems Impacted by Windborne Debris in Hurricanes
ASTM F1642/F1642M	(2017) Standard Test Method for Glazing and Glazing Systems Subject to Airblast Loadings
ASTM F2248	(2012) Standard Practice for Specifying an Equivalent 3-Second Duration Design Loading for Blast Resistant Glazing Fabricated with Laminated Glass
ASTM F2912	(2017) Standard Specification for Glazing and Glazing Systems Subject to Airblast Loadings

NATIONAL FENESTRATION RATING COUNCIL (NFRC)

NFRC 100	(2017) Procedure for Determining Fenestration Product U-Factors
NFRC 200	(2017) Procedure for Determining Fenestration Product Solar Heat Gain Coefficient and Visible Transmittance at Normal Incidence

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 4-010-01	(2018;with Change 1, 2020) DoD Minimum Antiterrorism Standards for Buildings

U.S. DEPARTMENT OF ENERGY (DOE)

Energy Star	(1992; R 2006) Energy Star Energy Efficiency Labeling System (FEMP)

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Windows; G

Fabrication Drawings

SD-03 Product Data

Windows; G

Fasteners; G

Window Performance; G

Thermal-Barrier Windows; G

SD-04 Samples

Finish Sample

Window Sample

SD-05 Design Data

Structural Calculations for Deflection; G

Design Analysis; G

SD-06 Test Reports

Minimum Condensation Resistance Factor

Resistance to Forced Entry

Standard Airblast Test; G

Windborne-Debris-Impact Performance

SD-07 Certificates

Engineer's Qualifications

SD-10 Operation and Maintenance Data

Windows, Data Package 1; G

Submit in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.

Plastic Identification

1.3 QUALITY ASSURANCE

1.3.1 Qualification of Manufacturer

Window manufacturer must specialize in designing and manufacturing the type of aluminum windows specified in this section, and have a minimum of 5 years of documented successful experience. Manufacturer must have the facilities capable of meeting contract requirements, single-source responsibility and warranty.

1.3.2 Shop Drawing Requirements

Take field measurements prior to preparation of drawings and fabrications. Provide drawings that indicate elevations of windows, full-size sections, thickness and gages of metal, fastenings, proposed method of anchoring, size and spacing of anchors, details of construction, method of glazing, and other related items.

1.3.3 Engineer's Qualifications for Blast Design

All blast design calculations must be performed by or under the direct supervision of a registered engineer with a minimum of 5 years experience performing blast design. The engineer performing the blast design must be able to demonstrate experience on similar size projects using similar design methods to meet the requirements outlined in this specification.

1.3.4 Sample Requirements

1.3.4.1 Finish Sample Requirements

Submit color chart of standard factory color coatings when factory-finish color coating is to be provided.

1.3.4.2 Window Sample Requirements

Submit one full-size corner of each window type proposed for use. Where screens or weatherstripping is required, fit sample with such items that are to be used.

1.3.5 Design Data Requirements

Submit calculations to substantiate compliance with deflection requirements and Antiterrorism Performance Requirements. A registered Professional Engineer must provide calculations.

Submit design analysis with calculations showing that the design of each different size and type of aluminum window unit and its anchorage to the structure. meets the requirements of paragraph ANTITERRORISM PERFORMANCE REQUIREMENTS. Calculations verifying the structural performance of each window proposed for use, under the given loads, must be prepared and signed by a registered professional engineer. Reflect the window components and anchorage devices to the structure, as determined by the design analysis, in the shop drawings.

1.3.6 Test Report Requirements

Submit test reports for each type of window attesting that identical windows have been tested and meet the requirements specified herein for conformance to AAMA/WDMA/CSA 101/I.S.2/A440 including test size, and minimum condensation resistance factor (CRF), and, for Antiterrorism windows, in lieu of a Design Analysis, results of a Standard Airblast Test. For Antiterrorism windows, in lieu of a Design Analysis, results of airblast testing, whether by arena test or shock tube, must be included in a test report, providing information in accordance with ASTM F1642/F1642M, as prepared by the independent testing agency performing the test. The test results must demonstrate the ability of each window proposed for use to withstand the airblast loading parameters and achieve the hazard level

rating specified in paragraph STANDARD AIRBLAST TEST METHOD.

1.3.7 Certification

Ensure that construction is performed with products that meet or exceed Energy Star criteria, and be current in their certification.

Each prime window unit must bear the AAMA Label warranting that the product complies with AAMA/WDMA/CSA 101/I.S.2/A440. Certified test reports attesting that the prime window units meet the requirements of AAMA/WDMA/CSA 101/I.S.2/A440, including test size, will be acceptable in lieu of product labeling.

1.4 DELIVERY AND STORAGE

Deliver windows to project site in an undamaged condition. Use care in handling and hoisting windows during transportation and at the jobsite. Store windows and components out of contact with the ground, under a weathertight covering, so as to prevent bending, warping, or otherwise damaging the windows. Repair damaged windows to an "as new" condition as approved. If windows can not be repaired, provide a new unit.

1.5 PLASTIC IDENTIFICATION

Label plastic products provided to indicate their polymeric composition according to the following list. Where products are not labeled, provide product data indicating polymeric information in Operation and Maintenance Manual.

a. Type 1: Polyethylene Terephthalate (PET, PETE).

b. Type 2: High Density Polyethylene (HDPE).

c. Type 3: Vinyl (Polyvinyl Chloride or PVC).

d. Type 4: Low Density Polyethylene (LDPE).

e. Type 5: Polypropylene (PP).

f. Type 6: Polystyrene (PS).

g. Type 7: Other. Use of this code indicates that the package in question is made with a resin other than the six listed above, or is made of more than one resin listed above, and used in a multi-layer combination.

1.6 PERFORMANCE REQUIREMENTS

1.6.1 Wind Loading Design Pressure

Design window components, including mullions, hardware, and anchors, to withstand a wind-loading design pressure of at least 70 pounds per square foot (psf).

1.6.2 Tests

Test windows proposed for use in accordance with AAMA/WDMA/CSA 101/I.S.2/A440 for the particular type and quality window specified.

Perform tests by a nationally recognized independent testing laboratory equipped and capable of performing the required tests. Submit the results of the tests as certified laboratory reports required herein.

Minimum design load for a uniform-load structural test must be 50 psf.

1.7 DRAWINGS

Submit the Fabrication Drawings for aluminum window units showing complete window assembly including hardware, weatherstripping, and subframe assembly details.

1.8 WINDOW PERFORMANCE

Aluminum windows must meet the following performance requirements. Perform testing requirements by an independent testing laboratory or agency.

1.8.1 Structural Performance

Structural test pressures on window units must be for positive load (inward) and negative load (outward). After testing, there will be no glass breakage, permanent damage to fasteners, hardware parts, support arms or actuating mechanisms or any other damage which could cause window to be inoperable. There must be no permanent deformation of any main frame, sash or ventilator member in excess of the requirements established by AAMA/WDMA/CSA 101/I.S.2/A440 for the window types and classification specified in this section.

1.8.2 Antiterrorism Performance Requirements

Windows must meet the antiterrorism performance criteria as specified in the paragraphs below in accordance with UFC 4-010-01. Conformance to the performance requirements must be validated by one of the following methods.

1.8.2.1 Computational Design Analysis Method

Design window assembly to the criteria listed herein. Include computational design analysis calculations verifying the structural performance of each window assembly proposed for use, under the given static equivalent loads.

Design window frames, mullions, sashes, and glazing to the criteria listed herein. Include computational design analysis calculations verifying the structural performance of each window system proposed for use, under the given static equivalent loads.

Anchor window frames to the supporting structure with anchors designed to resist two times (2X) the glazing resistance in accordance with ASTM F2248 and ASTM E1300.

1.8.2.2 Standard Airblast Test Method

As an alternative to the 'Computational Design Analysis Method' and

'Dynamic Design Analysis Method' indicated above, window assembly may be tested for evaluation of hazards generated from airblast loading in accordance with ASTM F1642/F1642M by an independent testing agency regularly engaged in blast testing. For proposed window systems that are of the same type as the tested system but of different size, the test results may be accepted provided the proposed window size is within the range from 25 percent smaller to 10 percent larger in area and aspect ratio of the original qualified tested glazing systems in accordance with ASTM F2912. Proposed window system/assembly of a size outside this range will require testing to evaluate their hazard rating or are certified by the 'Dynamic Design Analysis Method' indicated above. Testing may be by shock tube or arena test. Perform the test on the entire proposed window system/assembly, including, the glazing, its framing/support system, operating devices, and all anchorage devices. Window support system replicate anchorage of the window support system with the method of installation to be used for the project. The minimum airblast loading parameters for the test will be as follows: peak positive pressure of 40 kpa and peak positive phase impulse of 285 kpa. The hazard rating for the proposed window systems, as determined by the rating criteria of ASTM F2912, to provide performance equivalent to or better than a very low; hazard rating (i.e. the "No Break", "No Hazard", "Minimal Hazard", "Very Low Hazard" and “Low Hazard” ratings are acceptable. "High Hazard" ratings are unacceptable. Results of window systems previously tested by test protocols other than ASTM F1642/F1642M may be accepted provided the required loading, hazard level rating, and size limitations stated herein are met.

1.8.3 Air Infiltration

Air infiltration must not exceed the amount established by AAMA/WDMA/CSA 101/I.S.2/A440 for each window type.

1.8.4 Water Penetration

Water penetration must not exceed the amount established by AAMA/WDMA/CSA 101/I.S.2/A440 for each window type.

1.8.5 Thermal Performance

Windows (including frames and glass) will be independently tested and certified with a Solar Heat Gain Coefficient (SHGC) determined according to NFRC 200 procedures and a whole window U-factor determined in accordance with NFRC 100 within the ranges as indicated below according to the ASHRAE 169 Climate Zone of the project location. Provide visual Transmittance (VT) of 0.5 or greater. Submit documentation supporting compliance with Energy Star, FEMP designated, and Passive House qualifications as applicable. Provide proof of Energy Star label for residential aluminum window products.

1.8.6 Sound Attenuation

When tested in accordance with AAMA/WDMA/CSA 101/I.S.2/A440 or the following below, provide a minimum Sound Transmission Class (STC) of 35 in accordance with ASTM E90 and as determined by ASTM E413 or Outside-Indoor Transmission Class (OITC) of 25 in accordance with ASTM E1332 and as determined by ASTM E413 with the window glazed with 1/2 inch air space between two pieces of 1/4 inch.

1.8.7 Windborne-Debris-Impact Performance

Exterior window system including glazing must comply with indicated basis or enhanced protection testing requirements in ASTM E1996 for Wind Zone 1 when tested according to ASTM E1886. Test specimens must be no smaller in width and length than glazing indicated for use on Project and must be installed in same manner as glazing indicated for use on Project.

a. Refer to drawings for classification of window requiring basic or enhanced protection.

b. Large-Missile Test: For glazing located within 30 feet of grade.

1.9 WARRANTY

Provide Manufacturer's standard performance guarantees or warranties that extend beyond a 1 year period.

PART 2 PRODUCTS

2.1 WINDOWS

Provide prime windows that comply with AAMA/WDMA/CSA 101/I.S.2/A440 and the requirements specified herein. In addition to compliance with AAMA/WDMA/CSA 101/I.S.2/A440, window framing members for each individual light of glass must not deflect to the extent that deflection perpendicular to the glass light exceeds L/175 of the glass edge length when subjected to uniform loads at specified design pressures. Provide Structural calculations for deflection to substantiate compliance with deflection requirements. Provide windows of types, performance classes, performance grades, combinations, and sizes indicated or specified. Design windows to accommodate hardware, glass, weatherstripping, screens, and accessories to be furnished. Each window must be a complete factory assembled unit with or without glass installed. Dimensions shown are minimum. Provide windows with insulating glass and thermal break necessary to achieve a minimum Condensation Resistance Factor (CRF) of 60 when tested in accordance with AAMA 1503. Provide manufacturer's standard hardware fabricated from aluminum, stainless steel, carbon steel complying with AAMA 907, or other corrosion-resistant material compatible with adjacent materials; designed to smoothly operate, tightly close, and securely lock windows, and sized to accommodate sash weight and dimensions.

2.1.1 Fixed Windows (F)

Type F-AW- 70 (Performance Grade).

2.1.2 Forced Entry Resistant Windows

In addition to meeting the requirements of AAMA/WDMA/CSA 101/I.S.2/A440, windows designated for resistance to forced entry must conform to the requirements of AAMA 1302.4.

2.1.3 Glass and Glazing

Materials are specified in Section 08 81 00 GLAZING.

2.1.4 Caulking and Sealing

Are specified in Section 07 92 00 JOINT SEALANTS.

2.2 FABRICATION

Fabrication of window units must comply with AAMA/WDMA/CSA 101/I.S.2/A440.

2.2.1 Provisions for Glazing

Design windows and rabbets suitable for glass thickness shown or specified. For minimum antiterrorism windows, attach glazing to its supporting frame using structural silicone sealant or adhesive glazing tape in accordance with ASTM F2248..

2.2.2 Fasteners

Use window manufacturer's standard for windows, trim, and accessories. Self-tapping sheet-metal screws are not acceptable for material more than 1/16 inch thick.

2.2.3 Adhesives

Provide joint sealants as specified in Section 07 92 00 JOINT SEALANTS. For interior application of joint sealants, comply with applicable regulations regarding reduced VOC's, and as specified in Section 07 92 00 JOINT SEALANTS.

2.2.4 Drips and Weep Holes

Provide continuous drips over heads of top ventilators. Where fixed windows adjoin ventilators, drips must be continuous across tops of fixed windows. Provide drips and weep holes as required to return water to the outside.

2.2.5 Combination Windows

Windows used in combination must be factory assembled of the same class and grade. Where factory assembly of individual windows into larger units is limited by transportation considerations, prefabricate, match mark, transport, and field assemble.

2.2.6 Finishes

Comply with NAAMM's "Metal Finishes Manual" for applying and designating finishes. Exposed aluminum surfaces must be factory finished with an organic coating. Color must be as indicated. All windows must have the same finish.

2.2.6.1 Organic Coating

Clean and prime exposed aluminum surfaces. Provide a high-performance finish in accordance with AAMA 2605 .

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Method of Installation

Install in accordance with the window manufacturer's printed instructions and details. Build in windows as the work progresses or install without forcing into prepared window openings. Set windows at proper elevation, location, and reveal; plumb, square, level, and in alignment; and brace, strut, and stay properly to prevent distortion and misalignment. Protect ventilators and operating parts against accumulation of dirt and building materials by keeping ventilators tightly closed and locked to frame. Bed screws or bolts in sill members, joints at mullions, contacts of windows with sills, built-in fins, and subframes in mastic sealant of a type recommended by the window manufacturer. Install and caulk windows in a manner that will prevent entrance of water and wind. Fasten insect screens securely in place.

Any materials that show visual evidence of biological growth due to the presence of moisture must not be installed on the building project.

3.1.2 Dissimilar Materials

Where aluminum surfaces are in contact with, or fastened to masonry, concrete, wood, or dissimilar metals, except stainless steel or zinc, protect the aluminum surface from dissimilar materials as recommended in the Appendix to AAMA/WDMA/CSA 101/I.S.2/A440. Do not coat surfaces in contact with sealants after installation with any type of protective material. Do not apply coatings or lacquers to surfaces to which caulking and glazing components must adhere.

3.1.3 Anchors and Fastenings

Make provision for securing units to each other, to masonry, and to other adjoining construction. Windows installed in masonry walls must have head and jamb members designed to recess into masonry wall not less than 7/16 inch.

3.1.4 Adjustments After Installation

After installation of windows and completion of glazing and field painting, adjust all ventilators and hardware to operate smoothly and to provide weathertight sealing when ventilators are closed and locked. Verify that products are properly installed, connected, and adjusted.

3.2 CLEANING

Clean interior and exterior surfaces of window units of mortar, plaster, paint spattering spots, and other foreign matter to present a neat appearance, to prevent fouling of weathering surfaces and weather-stripping, and to prevent interference with the operation of hardware. Replace all stained, discolored, or abraded windows that cannot be restored to their original condition with new windows.

-- End of Section --

SECTION 08 71 00

DOOR HARDWARE
08/08

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E283	(2004; R 2012) Determining the Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen
ASTM F883	(2013) Padlocks

BUILDERS HARDWARE MANUFACTURERS ASSOCIATION (BHMA)

ANSI/BHMA A156.1	(2013) Butts and Hinges
ANSI/BHMA A156.13	(2012) Mortise Locks & Latches Series 1000
ANSI/BHMA A156.16	(2013) Auxiliary Hardware
ANSI/BHMA A156.18	(2012) Materials and Finishes
ANSI/BHMA A156.2	(2011) Bored and Preassembled Locks and Latches
ANSI/BHMA A156.21	(2009) Thresholds
ANSI/BHMA A156.3	(2008) Exit Devices
ANSI/BHMA A156.4	(2013) Door Controls - Closers
ANSI/BHMA A156.5	(2014) Auxiliary Locks and Associated Products
ANSI/BHMA A156.6	(2010) Architectural Door Trim
ANSI/BHMA A156.7	(2003; R 2009) Template Hinge Dimensions
ANSI/BHMA A156.8	(2010) Door Controls - Overhead Stops and Holders
BHMA A156.15	(2011) Release Devices Closer Holder, Electromagnetic and Electromechanical
BHMA A156.22	(2012) Door Gasketing and Edge Seal Systems

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 101	(2012; Amendment 1 2012) Life Safety Code
NFPA 80	(2013) Standard for Fire Doors and Other Opening Protectives

STEEL DOOR INSTITUTE (SDI/DOOR)

SDI/DOOR A250.8	(2003; R2008) Recommended Specifications for Standard Steel Doors and Frames

UNDERWRITERS LABORATORIES (UL)

UL Bld Mat Dir	(2012) Building Materials Directory

1.2 SUBMITTALS

Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES.

Provide certification letter that all applicable hardware meets the requirements of Federal Specification FF-L-2890B, with Amendment 2 (Feb 25, 2016).
See Memorandum For Record - Security Door Hardware, from the Eglin Base Locksmith, attached as an Appendix.

Note that the door hardware professional supplying the door hardware will meet with the security officer and the Eglin Base locksmith to review the hardware submittal prior to install.

SD-02 Shop Drawings

Hardware schedule; G

Keying system

SD-03 Product Data

Hardware items; G

SD-08 Manufacturer's Instructions

Installation

SD-10 Operation and Maintenance Data

Hardware Schedule items, Data Package 1; G

Submit data package in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.

SD-11 Closeout Submittals

Key Bitting

1.3 HARDWARE SCHEDULE

Prepare and submit hardware schedule in the following form:

Hardware Item	Quantity	Size	Reference Publi-cation Type No.	Finish	Mfr Name and Catalog No.	Key Control Symbols	UL Mark (If fire rated and listed)	BHMA Finish Desig-nation

1.4 KEY BITTING CHART REQUIREMENTS

Submit key bitting charts to the Contracting Officer prior to completion of the work. Include:

a. Complete listing of all keys (AA1, AA2, etc.).

b. Complete listing of all key cuts (AA1-123456, AA2-123458).

c. Tabulation showing which key fits which door.

d. Copy of floor plan showing doors and door numbers.

e. Listing of 20 percent more key cuts than are presently required in each master system.

1.5 QUALITY ASSURANCE

1.5.1 Hardware Manufacturers and Modifications

Provide, as far as feasible, locks, hinges, and closers of one lock, hinge, or closer manufacturer's make. Modify hardware as necessary to provide features indicated or specified.

1.5.2 Key Shop Drawings Coordination Meeting

Prior to the submission of the key shop drawing, the Contracting Officer, Contractor, Door Hardware subcontractor, using Activity and Base Locksmith shall meet to discuss key requirements for the facility.

1.6 DELIVERY, STORAGE, AND HANDLING

Deliver hardware in original individual containers, complete with necessary appurtenances including fasteners and instructions. Mark each individual container with item number as shown in hardware schedule.

PART 2 PRODUCTS

2.1 TEMPLATE HARDWARE

Provide hardware to be applied to metal or to prefinished doors manufactured to template. Promptly furnish template information or templates to door and frame manufacturers. Conform to ANSI/BHMA A156.7 for template hinges. Coordinate hardware items to prevent interference

with other hardware.

2.2 HARDWARE FOR FIRE DOORS AND EXIT DOORS

Provide all hardware necessary to meet the requirements of NFPA 80 for fire doors and NFPA 101 for exit doors, as well as to other requirements indicated, even if such hardware is not specifically mentioned under paragraph entitled "Hardware Schedule." Provide the label of Underwriters Laboratories, Inc. for such hardware listed in UL Bld Mat Dir or labeled and listed by another testing laboratory acceptable to the Contracting Officer.

2.3 HARDWARE ITEMS

Clearly and permanently mark with the manufacturer's name or trademark, hinges, pivots, locks, latches, exit devices, bolts and closers where the identifying mark will be visible after the item is installed. For closers with covers, the name or trademark may be beneath the cover.

2.3.1 Hinges

ANSI/BHMA A156.1, 4-1/2 by 4-1/2 inch unless otherwise indicated. Construct loose pin hinges for exterior doors and reverse-bevel interior doors so that pins will be nonremovable when door is closed. Other antifriction bearing hinges may be provided in lieu of ball-bearing hinges.

2.3.2 Locks and Latches

2.3.2.1 Mortise Locks and Latches

ANSI/BHMA A156.13, Series 1000, Operational Grade 1, Security Grade 2. Provide mortise locks with escutcheons not less than 7 by 2-1/4 inch with a bushing at least 1/4 inch long. Cut escutcheons to suit cylinders and provide trim items with straight, beveled, or smoothly rounded sides, corners, and edges. Install knobs and roses of mortise locks with screwless shanks and no exposed screws.

2.3.2.2 Combination Locks

Heavy-duty, mechanical combination lockset with five pushbuttons, standard-sized knobs, 3/4 inch deadlocking latch, 2-3/4 inch backset. Operate the locks by pressing two or more of the buttons in unison or individually in the proper sequence. Inside knob will operate the latch. Provide a keyed cylinder on the interior to permit setting the combination. Provide a keyed removable-core cylinder on the exterior to permit bypassing the combination. Provide a thumb turn on the interior to activate passage set function, so that outside knob operates latch without using the combination.

2.3.3 Exit Devices

ANSI/BHMA A156.3, Grade 1. Provide adjustable strikes for rim type and vertical rod devices. Provide open back strikes for pairs of doors with mortise and vertical rod devices. Provide touch bars in lieu of conventional crossbars and arms. Provide escutcheons, not less than 7 by 2-1/4 inch.

2.3.4 Exit Locks With Alarm

ANSI/BHMA A156.5, Type E0431 (with full-width horizontal actuating bar) for single doors; Type E0431 (with actuating bar) or E0471 (with actuating bar and top and bottom bolts, both leaves active) for pairs of doors, unless otherwise specified.

2.3.5 Cylinders and Cores

Provide cylinders and cores for new locks, including locks provided under other sections of this specification. Provide cylinders and cores with seven pin tumblers. Provide cylinders from products of one manufacturer, and provide cores from the products of one manufacturer, compatible with "best" locking system in use at Eglin AFB. Rim cylinders, mortise cylinders, and knobs of bored locksets have interchangeable cores which are removable by special control keys. Stamp each interchangeable core with a key control symbol in a concealed place on the core.

2.3.6 Keying System

Provide a master key system for the facility compatible with the Eglin AFB Base keying system. Provide construction interchangeable cores when subcontractors require keys during construction. The Contractor shall coordinate a keying system meeting. The Contractor's Project Manager, Superintendent, Hardware Subcontractor, Contracting Officer, Base Hardware Specialist, Electrical Subcontractor, and the Using Activity shall attend this meeting to establish the keying system for the project. This meeting is intended to verify base limitations, the necessary security, and access control within the facility. The meeting shall produce a marked up copy of the floor plan together, and any master keying or grand master keying.

2.3.7 Lock Trim

Cast, forged, or heavy wrought construction and commercial plain design.

2.3.7.1 Knobs and Roses

Conform to the minimum test requirements of ANSI/BHMA A156.2 and ANSI/BHMA A156.13 for knobs, roses, and escutcheons. For unreinforced knobs, roses, and escutcheons, provide 0.050 inch thickness. For reinforced knobs, roses, and escutcheons, provide outer shell of 0.035 inch thickness, and combined thickness of 0.070 inch, except for knob shanks, which are 0.060 inch thick.

2.3.7.2 Lever Handles

Provide lever handles in lieu of knobs where indicated in paragraph entitled "Hardware Schedule". Conform to the minimum requirements of ANSI/BHMA A156.13 for mortise locks of lever handles for exit devices. Provide lever handle locks with a breakaway feature (such as a weakened spindle or a shear key) to prevent irreparable damage to the lock when force in excess of that specified in ANSI/BHMA A156.13 is applied to the lever handle. Provide lever handles return to within 1/2 inch of the door face.

2.3.8 Keys

Furnish one file key, one duplicate key, and three working keys for each key change and for each master and grand master keying system.

2.3.9 Door Bolts

ANSI/BHMA A156.16. Provide dustproof strikes for bottom bolts, except for doors having metal thresholds. Automatic latching flush bolts: ANSI/BHMA A156.3, Type 25.

2.3.10 Closers

ANSI/BHMA A156.4, Series C02000, Grade 1, with PT 4C. Provide with brackets, arms, mounting devices, fasteners, full size covers, except at storefront mounting, cement cases, and other features necessary for the particular application. Size closers in accordance with manufacturer's recommendations, or provide multi-size closers, Sizes 1 through 6, and list sizes in the Hardware Schedule. Provide manufacturer's 10 year warranty.

2.3.10.1 Identification Marking

Engrave each closer with manufacturer's name or trademark, date of manufacture, and manufacturer's size designation located to be visible after installation.

2.3.11 Overhead Holders

ANSI/BHMA A156.8.

2.3.12 Closer Holder-Release Devices

BHMA A156.15.

2.3.13 Door Protection Plates

ANSI/BHMA A156.6.

2.3.13.1 Sizes of Armor Mop and Kick Plates

2 inch less than door width for single doors; one inch less than door width for pairs of doors. Provide 10 inch kick plates for flush doors. Provide a minimum 36 inch armor plates for flush doors. Provide 6 inch mop plates.

2.3.14 Edge Guards

ANSI/BHMA A156.6, stainless steel, of same height as armor plates. Apply to meeting stiles.

2.3.15 Door Stops and Silencers

ANSI/BHMA A156.16. Silencers Type L03011. Provide three silencers for each single door, two for each pair.

2.3.16 Padlocks

ASTM F883.

2.3.17 Thresholds

ANSI/BHMA A156.21. Use J35100, with vinyl or silicone rubber insert in

face of stop, for exterior doors opening out, unless specified otherwise.

2.3.18 Weather Stripping Gasketing

BHMA A156.22. Provide the type and function designation where specified in paragraph entitled "Hardware Schedule". Provide a set to include head and jamb seals, sweep strips, and, for pairs of doors, astragals. Air leakage of weather stripped doors not to exceed 0.5 cubic feet per minute of air per square foot of door area when tested in accordance with ASTM E283. Provide weather stripping with one of the following:

2.3.18.1 Extruded Aluminum Retainers

Extruded aluminum retainers not less than 0.050 inch wall thickness with vinyl, neoprene, silicone rubber, or polyurethane inserts. Provide clear anodized aluminum.

2.3.18.2 Interlocking Type

Zinc or bronze not less than 0.018 inch thick.

2.3.18.3 Spring Tension Type

Spring bronze or stainless steel not less than 0.008 inch thick.

2.3.19 Soundproofing Gasketing

BHMA A156.22. Include adjustable doorstops at head and jambs and an automatic door bottom per set, both of extruded aluminum, clear (natural) anodized, surface applied, with vinyl fin seals between plunger and housing. Provide doorstops with solid neoprene tube, silicone rubber, or closed-cell sponge gasket. Furnish door bottoms with adjustable operating rod and silicone rubber or closed-cell sponge neoprene gasket. Doorstops mitered at corners. Provide the type and function designation where specified in paragraph entitled "Hardware Sets".

2.3.20 Rain Drips

Extruded aluminum, not less than 0.08 inch thick, clear anodized. Set drips in sealant and fasten with stainless steel screws.

2.3.20.1 Door Rain Drips

Approximately 1-1/2 inch high by 5/8 inch projection. Align bottom with bottom edge of door.

2.3.20.2 Overhead Rain Drips

Approximately 1-1/2 inch high by 2-1/2 inch projection, with length equal to overall width of door frame. Align bottom with door frame rabbet.

2.3.21 Special Tools

Provide special tools, such as spanner and socket wrenches and dogging keys, required to service and adjust hardware items.

2.4 FASTENERS

Provide fasteners of proper type, quality, size, quantity, and finish with

hardware. Provide stainless steel or nonferrous metal fasteners that are exposed to weather. Provide fasteners of type necessary to accomplish a permanent installation.

2.5 FINISHES

ANSI/BHMA A156.18. Provide hardware in BHMA 630 finish (satin stainless steel), unless specified otherwise. Provide items not manufactured in stainless steel in BHMA 626 finish (satin chromium plated) over brass or bronze, except aluminum paint finish for surface door closers, and except BHMA 652 finish (satin chromium plated) for steel hinges. Provide hinges for exterior doors in stainless steel with BHMA 630 finish or chromium plated brass or bronze with BHMA 626 finish. Furnish exit devices in BHMA 626 finish in lieu of BHMA 630 finish except where BHMA 630 is specified under paragraph entitled "Hardware Sets". Match exposed parts of concealed closers to lock and door trim. Match hardware finish for aluminum doors to the doors.

2.6 KEY CABINET AND CONTROL SYSTEM

ANSI/BHMA A156.5, Type required to yield a capacity (number of hooks) 25 percent greater than the number of key changes used for door locks.

PART 3 EXECUTION

3.1 INSTALLATION

Install hardware in accordance with manufacturers' printed installation instructions. Fasten hardware to wood surfaces with full-threaded wood screws or sheet metal screws. Provide machine screws set in expansion shields for fastening hardware to solid concrete and masonry surfaces. Provide toggle bolts where required for fastening to hollow core construction. Provide through bolts where necessary for satisfactory installation.

3.1.1 Weather Stripping Installation

Handle and install weather stripping to prevent damage. Provide full contact, weather-tight seals. Operate doors without binding.

3.1.1.1 Stop-Applied Weather Stripping

Fasten in place with color-matched sheet metal screws not more than 9 inch on center after doors and frames have been finish painted.

3.1.1.2 Interlocking Type Weather Stripping

Provide interlocking, self-adjusting type on heads and jambs and flexible hook type at sills. Nail weather stripping to door 1 inch on center and to heads and jambs at 4 inch on center

3.1.1.3 Spring Tension Type Weather Stripping

Provide spring tension type on heads and jambs. Provide bronze nails with bronze, stainless steel nails with stainless steel. Space nails not more than 1-1/2 inch on center.

3.1.2 Soundproofing Installation

Install as specified for stop-applied weather stripping.

3.1.3 Threshold Installation

Extend thresholds the full width of the opening and notch end for jamb stops. Set thresholds in a full bed of sealant and anchor to floor with cadmium-plated, countersunk, steel screws in expansion sleeves.

3.2 FIRE DOORS AND EXIT DOORS

Install hardware in accordance with NFPA 80 for fire doors, NFPA 101 for exit doors.

3.3 HARDWARE LOCATIONS

SDI/DOOR A250.8, unless indicated or specified otherwise.

a. Kick and Armor Plates: Push side of single-acting doors. Both sides of double-acting doors.

b. Mop Plates: Bottom flush with bottom of door.

3.4 KEY CABINET AND CONTROL SYSTEM

Locate where directed. Tag one set of file keys and one set of duplicate keys. Place other keys in appropriately marked envelopes, or tag each key. Furnish complete instructions for setup and use of key control system. On tags and envelopes, indicate door and room numbers or master or grand master key.

3.5 FIELD QUALITY CONTROL

After installation, protect hardware from paint, stains, blemishes, and other damage until acceptance of work. Submit notice of testing 15 days before scheduled, so that testing can be witnessed by the Contracting Officer. Adjust hinges, locks, latches, bolts, holders, closers, and other items to operate properly. Demonstrate that permanent keys operate respective locks, and give keys to the Contracting Officer. Correct, repair, and finish, as directed, errors in cutting and fitting and damage to adjoining work.

3.6 HARDWARE SETS**Set # 1 Door 100 (Pair Exterior ALSF Entrance Doors - Hurricane-Rated)**
Each to have

1 EA Exit Device EL9947 NL-OP w/ Exterior Pull on Active Leaf ALUM
1 EA Exit Device 9947 EO on Non-Active Leaf ALUM
1 EA Core as required
1 EA Electric Strike
1 EA Card Reader w/ Keypad
1 EA Door Contact
1 EA Power Supply
1 EA Power Transfer

All other hardware shall be supplied by ALSF System manufacturer.

Note: All Doors, Frame, and Hardware shall be Hurricane/Impact-rated.

Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

Set #2 Doors 101, 103 (Single Interior SCWD Restroom Door - Passage Function) Each to have:

1-1/2 PR Butts TA2714 4.5x4.5NRP	630
1 EA Push Plate #70 3"x12"	630
1 EA Pull Plate #102 x 70	630
1 EA Floor Stop 440	630
1 EA Closer 8616 SPA8	AL. LAQ

Set #3 Door 104 (Single Interior SCWD Restroom Door - Privacy Function) Each to have:

1-1/2 PR Butts TA2714 4.5x4.5NRP	630
1 EA Privacy Latchset L9040 w/ Occupancy Indicator	630
1 EA Floor Stop 440	630
1 EA Closer 8616 SPA8	AL. LAQ

Set #4 Door 166, 169, 171 (Single Exterior GHM Store Room Door) Each to have:

1-1/2 PR Butts TA2714 4.5x4.5NRP	630
1 EA Lockset L9080 x ATH (Storage Function)	630
1 EA Cylinder	630
1 EA Electric Strike	630
1 EA Closer 8616 SPA8	AL. LAQ.
1 EA Floor Stop 440	630
1 Set Weatherstripping 303AV	ALUM.
1 EA Sweep 315AN	ALUM.
1 EA Threshold 896	ALUM.
1 EA Drip Strip 17 DKB	ALUM.
1 EA Card Reader	
1 EA Door Contact	
1 EA Power Supply	
1 EA Power Transfer	

Note: All Doors, Frame, and Hardware shall be Hurricane/Impact-rated. Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

Set #5 Doors 113, 120A, 134A, 136A, 147, 161 (Single Exterior GHM Exit Only Doors) Each to have:

1-1/2 PR Butts TA2714 4.5x4.5 NRP	630
1 EA Exit Device 99EO W/ Exit Alarm (Detex ECL600)	630
1 EA Cylinder	630
1 EA Closer 8616 SPA8	AL. LAQ
1 Set Weatherstripping 303AV	ALUM.
1 EA Sweep 315AN	ALUM.
1 EA Threshold 896	ALUM.
1 EA Drip Strip 17 DKB	ALUM.

Note: All Doors, Frame, and Hardware shall be Hurricane/Impact-rated.

Set #6 Doors 106, 107, 108, 109, 110, 112, 114, 115, 116, 117, 121, 123, 124, 125, 126, 127, 128, 135, 136, 137, 138, 139, 140, 145, 148, 149, 149A,

151, 152, 153, 154, 155, 156, 157, 158, 162, 162A, 163, 164, 165 (Single Interior SCWD Office Door)
Each to have:

1-1/2 PR Butts TA2714 4.5x4.5NRP	630
1 EA Lockset L9050 x ATH (Office Function)	630
1 EA Cylinder	630
I EA Electric Strike	630
1 EA Closer 8616 SPA8	AL. LAQ
1 EA Wall Stop 409	630
1 EA Card Reader w/ Keypad	
1 EA Door Contact	
1 EA Power Supply	
1 EA Power Transfer	

Note: Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

Set #7 Door 129 (Pair Interior SCWD Entry/Exit Doors)
Each to have:

3 PR Butts TA2714 4.5x4.5NRP	630
2 EA Exit Device 99L	630
1 EA Cylinder	630
1 EA Electric Strike	630
2 EA Closer 8616 SPA8	AL. LAQ
2 EA Floor Stop 440	630
1 EA Card Reader	
1 EA Door Contact	
1 EA Power Supply	
1 EA Power Transfer	

Note: Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

Set #8 Doors 105, 132, 133, 141, 142, 144, 146, 159 (Single Interior SCWD Storage Room Door)
Each to have:

1-1/2 PR Butts TA2714 4.5x4.5NRP	630
1 EA Lockset L9080 x ATH (Storage Function)	630
1 EA Cylinder	630
1 EA Electric Strike	630
1 EA Closer 8616 SPA8	AL. LAQ
1 EA Wall Stop 409	630
1 EA Card Reader	
1 EA Door Contact	
1 EA Power Supply	
1 EA Power Transfer	

Note: Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

Set #9 Doors 130, 134, 143 (Single Interior GHM Man Trap Door- STC 50)
Each to have:

1-1/2 PR Cam Lift Hinges	630
1 EA High Security Lock (Type II or Type IV)	630

1 EA Cylinder	630
1 EA Electric Strike	630
1 EA Closer 8616 SPA8	AL. LAQ
1 EA Threshold Saddle 418S x 36" x MIL	
1 Set Gasketing (STC Gasketing and Door Bottom by Door Manuf).	
1 EA Wall Stop 409	630
1 EA Card Reader	
1 EA Door Contact	
1 EA Power Supply	
1 EA Power Transfer	

Note: All Doors, Frame, and Hardware shall meet required STC 50 rating. Supplier shall modify, change and/or add hardware as required by the STC Rated Door Manufacturer whose products they will use in order to meet STC requirements. Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

Set #10 Doors 167, 168, 170 (Pair Exterior GHM Store Room Doors) Each to have:

3 PR Butts TA2714 4.5x4.5NRP	630
1 EA Lockset L9080 x ATH (Storage Function)	630
1 EA Cylinder	630
1 EA Electric Strike	630
1 EA Overhead Stop and Hold-Open	AL. LAQ.
2 EA Flush Bolts	630
1 EA Astragal	Grey
2 EA Floor Stop 440	630
2 Set Weatherstripping 303AV	ALUM.
2 EA Sweep 315AN	ALUM.
1 EA Threshold 896 x 72"	ALUM.
2 EA Drip Strip 17 DKB	ALUM.
1 EA Card Reader	
1 EA Door Contact	
1 EA Power Supply	
1 EA Power Transfer	

Note: All Doors, Frame, and Hardware shall be Hurricane/Impact-rated. Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

Set #11 Doors 118, 120, 172, 172A (Single Interior SCWD Entry/Exit Door) Each to have:

1-1/2 PR Butts TA2714 4.5x4.5NRP	630
1 EA Exit Device 99L	630
1 EA Cylinder	630
1 EA Electric Strike	630
1 EA Closer 8616 SPA8	AL. LAQ.
1 EA Floor Stop 440	630
1 EA Card Reader	
1 EA Door Contact	
1 EA Power Supply	
1 EA Power Transfer	

Note: Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

Set #12 Door 159A (Exterior Steel Insulated Overhead Coiling Door)
Each to have:

All hardware shall be provided by the Overhead Coiling Door Manufacturer.

Note: Door, Frame, and Hardware shall be Hurricane/Impact-rated

Set #13 Door 143A (Single Interior GHM Exit Only Door - STC 50)
Each to have:

1-1/2 PR Cam Lift	630
1 EA Exit Device 99EO	630
1 EA Closer 8616 SPA8	AL. LAQ.
1 EA Floor Stop 440	630
1 EA Threshold Saddle 418S x 36" x MIL	
1 Set Gasketing (STC Gasketing and Door Bottom by Door Manufacturer).	

Note: Door, Frame, and Hardware shall meet required STC 50 rating. Supplier shall modify, change and/or add hardware as required by the STC Rated Door Manufacturer whose products they will use in order to meet STC requirements. Coordinate all security hardware with Base Security.

Set #14 Door 131 (Single Interior GHM Office Door - STC 50)
Each to have:

1-1/2 PR Cam Lift Hinges	630
1 EA Lockset L9050 x ATH (Office Function)	630
1 EA Cylinder	630
1 EA Electric Strike	630
1 EA Closer 8616 SPA8	AL. LAQ
1 EA Threshold Saddle 418S x 36" x MIL	
1 Set Gasketing (STC Gasketing and Door Bottom by Door Manuf).	
1 EA Wall Stop 409	630
1 EA Card Reader	
1 EA Door Contact	
1 EA Power Supply	
1 EA Power Transfer	

Note: All Doors, Frame, and Hardware shall meet required STC 50 rating. Supplier shall modify, change and/or add hardware as required by the STC Rated Door Manufacturer whose products they will use in order to meet STC requirements. Coordinate all electrically-operated hardware with Base Security and Electrical Documents.

-- End of Section --

SECTION 08 81 00

GLAZING
05/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ARCHITECTURAL MANUFACTURERS ASSOCIATION (AAMA)

AAMA 800	(2016) Voluntary Specifications and Test Methods for Sealants

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI Z97.1	(2015) Safety Glazing Materials Used in Buildings - Safety Performance Specifications and Methods of Test

ASTM INTERNATIONAL (ASTM)

ASTM C509	(2006; R 2015) Elastomeric Cellular Preformed Gasket and Sealing Material
ASTM C864	(2005; R 2015) Dense Elastomeric Compression Seal Gaskets, Setting Blocks, and Spacers
ASTM C920	(2018) Standard Specification for Elastomeric Joint Sealants
ASTM C1021	(2008; R 2014) Standard Practice for Laboratories Engaged in Testing of Building Sealants
ASTM C1036	(2016) Standard Specification for Flat Glass
ASTM C1048	(2018) Standard Specification for Heat-Strengthened and Fully Tempered Flat Glass
ASTM C1087	(2016) Standard Test Method for Determining Compatibility of Liquid-Applied Sealants with Accessories Used in Structural Glazing Systems
ASTM C1172	(2019) Standard Specification for Laminated Architectural Flat Glass
ASTM C1184	(2014) Standard Specification for Structural Silicone Sealants

ASTM C1281	(2016) Standard Specification for Preformed Tape Sealants for Glazing Applications
ASTM D395	(2016; E 2017) Standard Test Methods for Rubber Property - Compression Set
ASTM D2287	(2012) Nonrigid Vinyl Chloride Polymer and Copolymer Molding and Extrusion Compounds
ASTM E119	(2019) Standard Test Methods for Fire Tests of Building Construction and Materials
ASTM E1300	(2016) Standard Practice for Determining Load Resistance of Glass in Buildings
ASTM E2190	(2010) Standard Specification for Insulating Glass Unit Performance and Evaluation

GLASS ASSOCIATION OF NORTH AMERICA (GANA)

GANA Glazing Manual	(2008) Glazing Manual
GANA Sealant Manual	(2008) Sealant Manual
GANA Standards Manual	(2008) Engineering Standards Manual

INSULATING GLASS MANUFACTURERS ALLIANCE (IGMA)

IGMA TB-1200	(1983; R 2016) Guidelines for Insulating Glass Dimensional Tolerances
IGMA TB-3001	(2001) Guidelines for Sloped Glazing
IGMA TM-3000	(1990; R 2016) North American Glazing Guidelines for Sealed Insulating Glass Units for Commercial & Residential Use

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 251	(2006) Standard Methods of Tests of Fire Resistance of Building Construction and Materials
NFPA 252	(2017) Standard Methods of Fire Tests of Door Assemblies
NFPA 257	(2012; ERTA 2017) Standard on Fire Test for Window and Glass Block Assemblies

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

16 CFR 1201	Safety Standard for Architectural Glazing Materials

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Insulating Glass

Glazing Accessories

Sealants

Joint Backer

SD-07 Certificates

Insulating Glass

SD-08 Manufacturer's Instructions

Setting and Sealing Materials

Glass Setting

SD-11 Closeout Submittals

Warranty for Insulated Glass Units

Energy Efficient Equipment for Residential Windows; S

1.3 SYSTEM DESCRIPTION

Fabricate and install watertight and airtight glazing systems to withstand thermal movement and wind loading without glass breakage, gasket failure, deterioration of glazing accessories, or defects in the work. Glazed panels must comply with the safety standards, in accordance with ANSI Z97.1, and comply with indicated wind/snow loading in accordance with ASTM E1300.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver products to the site in unopened containers, labeled plainly with manufacturers' names and brands. Store glass and setting materials in safe, enclosed dry locations and do not unpack until needed for installation. Handle and install materials in a manner that will protect them from damage.

1.5 ENVIRONMENTAL REQUIREMENTS

Do not start glazing work until the outdoor temperature is above40 degrees F and rising, unless procedures recommended by the glass manufacturer and approved by the Contracting Officer are made to warm the glass and rabbet surfaces. Provide ventilation to prevent condensation of moisture on glazing work during installation. Do not perform glazing work during damp or rainy weather.

1.6 WARRANTY

1.6.1 Warranty for Insulated Glass Units

Warranty insulating glass units against development of material obstruction to vision (such as dust, fogging, or film formation on the inner glass surfaces) caused by failure of the hermetic seal, other than through glass breakage, for a 10-year period following acceptance of the work. Provide new units for any units failing to comply with terms of this warranty within 45 working days after receipt of notice from the Government.

PART 2 PRODUCTS

2.1 PRODUCT SUSTAINABILITY CRITERIA

2.2 GLASS

ASTM C1036, unless specified otherwise. In doors and sidelights, provide safety glazing material conforming to 16 CFR 1201.

2.2.1 Annealed Glass

Annealed glass must be Type I transparent flat type, Class 1 - clear, Quality q3 - glazing select, conforming to ASTM C1036.

2.2.2 Laminated Glass

ASTM C1172, Laminated glass fabricated from two nominal 1/8 inch pieces of Type I, Class 1, Quality Q3, flat annealed clear glass conforming to ASTM C1036. Flat glass to be laminated together with a minimum of 0.030 inch inch thick, clear polyvinyl butyral laminate, conforming to requirements of 16 CFR 1201 and ASTM C1172. The total thickness of nominally 1/4 inches. Color to be bronze.

2.2.3 Tempered Glass

ASTM C1048, Kind FT (fully tempered), Condition A (uncoated), Type I, Class 1 (transparent), Quality q3, conforming to ASTM C1048 and GANA Standards Manual. Color must be clear.

2.2.4 Spandrel Glass

2.2.4.1 Ceramic-Opacified Spandrel Glass

Ceramic-opacified spandrel glass must be Kind HS heat-strengthened transparent flat type, Condition B, coated with a colored ceramic material on No. 2 surface, Quality q3 - glazing select, conforming to ASTM C1048. Color shall match adjacent Building 421.

2.2.5 Fire/Safety Rated Glass

2.2.5.1 Fire Protection Rated Glass

Clear tempered and meet 16 CFR 1201 Category I (under 9 square feet) or II (over 9 square feet) impact safety standard. Glass to make 20 45 minute rating when tested in accordance with NFPA 257 and NFPA 252. Glass to be permanently labeled with appropriate markings.

2.2.5.2 Fire Resistive Rated Glazing

Fire resistive glass must be laminated, with intumescent interlayer, Type I transparent flat type, Class 1-clear and meet 16 CFR 1201 Category I (under 9 square feet) or II (over 9 square feet). Glass must have a 90 minute rating when tested in accordance with ASTM E119 and NFPA 251. Glass must be permanently labeled with appropriate markings.

2.3 INSULATING GLASS UNITS

Two panes of glass separated by a dehydrated airspace, filled with argon gas, and hermetically sealed, conforming to ASTM E2190. Submit performance and compliance documentation for each type of insulating glass.

Dimensional tolerances must be as specified in IGMA TB-1200. Spacer must be black, roll-formed, thin-gauge, C-section steel, with bent or tightly welded or keyed and sealed joints to completely seal the spacer periphery and eliminate moisture and hydrocarbon vapor transmission into airspace through the corners. Primary seal must be compressed polyisobutylene and the secondary seal must be a specially formulated silicone.

The inner light must be ASTM C1172, clear annealed flat glass Type I, Class I, Quality q3 The outer light must be ASTM C1036, Type I, Class 1 (transparent) , Quality q4.

2.4 SETTING AND SEALING MATERIALS

Provide as specified in the GANA Glazing Manual, IGMA TM-3000, IGMA TB-3001, and manufacturer's recommendations, unless specified otherwise herein. Do not use metal sash putty, nonskinning compounds, nonresilient preformed sealers, or impregnated preformed gaskets. Materials exposed to view and unpainted must be gray or neutral color. Sealant testing must be performed by a testing agency qualified according to ASTM C1021.

Submit glass manufacturer's recommendations for setting and sealing materials and for installation of each type of glazing material specified.

2.4.1 Putty and Glazing Compound

Provide glazing compound as recommended by manufacturer for face-glazing metal sash. Putty must be linseed oil type. Do not use putty and glazing compounds with insulating glass or laminated glass.

2.4.2 Glazing Compound

Use for face glazing metal sash. Do not use with insulating glass units or laminated glass.

2.4.3 Sealants

Provide elastomeric sealants.

2.4.3.1 Elastomeric Sealant

ASTM C920, Type S, Grade NS, Class 12.5, Use G. Use for channel or stop glazing metal sash. Sealants must be chemically compatible with setting blocks, edge blocks, and sealing tapes, with sealants used in manufacture of insulating glass units. Color of sealant must be white.

2.4.3.2 Structural Sealant

ASTM C1184, Type S.

2.4.4 Joint Backer

Joint backer must have a diameter size at least 25 percent larger than joint width; type and material as recommended in writing by glass and sealant manufacturer.

2.4.5 Glazing Tapes

2.4.5.1 Back-Bedding Mastic Glazing Tapes

Preformed, butyl-based, 100 percent solids elastomeric tape; nonstaining and nonmigrating in contact with nonporous surfaces; with or without spacer rod as recommended in writing by tape and glass manufacturers for application indicated; and complying with ASTM C1281 and AAMA 800 for products indicated below:

a. AAMA 804.3 tape, where indicated.

b. AAMA 806.3 tape, for glazing applications in which tape is subject to continuous pressure.

c. AAMA 807.3 tape, for glazing applications in which tape is not subject to continuous pressure.

2.4.5.2 Expanded Cellular Glazing Tapes

Closed-cell, PVC foam tapes; factory coated with adhesive on both surfaces; and complying with AAMA 800 for the following types:

a. AAMA 810.1, Type 1, for glazing applications in which tape acts as the primary sealant.

b. AAMA 810.1, Type 2, for glazing applications in which tape is used in combination with a full bead of liquid sealant.

2.4.6 Sealing Tapes

Preformed, semisolid, PVC-based material of proper size and compressibility for the particular condition, complying with ASTM D2287. Use only where glazing rabbet is designed for tape and tape is recommended by the glass or sealant manufacturer. Provide spacer shims for use with compressible tapes. Tapes must be chemically compatible with the product being set.

2.4.7 Setting Blocks and Edge Blocks

Closed-cell neoprene setting blocks must be dense extruded type conforming to ASTM C509 and ASTM D395, Method B, Shore A durometer between 70 and 90. Edge blocking must be Shore A durometer of 50 (plus or minus 5). Provide silicone setting blocks when blocks are in contact with silicone sealant. Profiles, lengths and locations must be as required and recommended in writing by glass manufacturer. Block color must be black.

2.4.8 Glazing Gaskets

Glazing gaskets must be extruded with continuous integral locking projection designed to engage into metal glass holding members to provide a watertight seal during dynamic loading, building movements and thermal movements. Glazing gaskets for a single glazed opening must be continuous one-piece units with factory-fabricated injection-molded corners free of flashing and burrs. Glazing gaskets must be in lengths or units recommended by manufacturer to ensure against pull-back at corners. Provide glazing gasket profiles as recommended by the manufacturer for the intended application.

2.4.8.1 Fixed Glazing Gaskets

Fixed glazing gaskets must be closed-cell (sponge) smooth extruded compression gaskets of cured elastomeric virgin neoprene compounds conforming to ASTM C509, Type 2, Option 1.

2.4.8.2 Wedge Glazing Gaskets

Wedge glazing gaskets must be high-quality extrusions of cured elastomeric virgin neoprene compounds, ozone resistant, conforming to ASTM C864, Option 1, Shore A durometer between 65 and 75.

2.4.8.3 Aluminum Framing Glazing Gaskets

Glazing gaskets for aluminum framing must be permanent, elastic, non-shrinking, non-migrating, watertight and weathertight.

2.4.9 Accessories

Provide as required for a complete installation, including glazing points, clips, shims, angles, beads, and spacer strips. Provide noncorroding metal accessories. Provide primer-sealers and cleaners as recommended by the glass and sealant manufacturers. Use ASTM C1087 to determine whether priming and other specific joint preparation techniques are required to obtain rapid, optimum adhesion of glazing sealants to surface.

PART 3 EXECUTION

Any materials that show visual evidence of biological growth due to the presence of moisture must not be installed on the building project.

3.1 PREPARATION

Preparation, unless otherwise specified or approved, must conform to applicable recommendations in the GANA Glazing Manual, GANA Sealant Manual, IGMA TB-3001, IGMA TM-3000, and manufacturer's recommendations. Determine the sizes to provide the required edge clearances by measuring the actual opening to receive the glass. Grind smooth in the shop glass edges that will be exposed in finish work. Leave labels in place until the installation is approved, except remove applied labels on heat-absorbing glass and on insulating glass units as soon as glass is installed. Securely fix movable items or keep in a closed and locked position until glazing compound has thoroughly set.

3.2 GLASS SETTING

Shop glaze or field glaze items to be glazed using glass of the quality

and thickness specified or indicated. Glazing, unless otherwise specified or approved, must conform to applicable recommendations in the GANA Glazing Manual, GANA Sealant Manual, IGMA TB-3001, IGMA TM-3000, and manufacturer's recommendations. Aluminum windows, wood doors, and wood windows may be glazed in conformance with one of the glazing methods described in the standards under which they are produced, except that face puttying with no bedding will not be permitted. Handle and install glazing materials in accordance with manufacturer's instructions. Use beads or stops which are furnished with items to be glazed to secure the glass in place. Verify products are properly installed, connected, and adjusted.

3.2.1 Sheet Glass

Cut and set with the visible lines or waves horizontal.

3.2.2 Insulating Glass Units

Do not grind, nip, or cut edges or corners of units after the units have left the factory. Springing, forcing, or twisting of units during setting will not be permitted. Handle units so as not to strike frames or other objects. Installation must conform to applicable recommendations of IGMA TB-3001 and IGMA TM-3000.

3.2.3 Installation of Laminated Glass

Sashes which are to receive laminated glass must be weeped to the outside to allow water drainage into the channel.

3.3 CLEANING

Clean glass surfaces and remove labels, paint spots, putty, and other defacement as required to prevent staining. Glass must be clean at the time the work is accepted.

3.4 PROTECTION

Protect glass work immediately after installation. Identify glazed openings with suitable warning tapes, cloth or paper flags, attached with non-staining adhesives. Protect reflective glass with a protective material to eliminate any contamination of the reflective coating. Place protective material far enough away from the coated glass to allow air to circulate to reduce heat buildup and moisture accumulation on the glass. Upon removal, separate protective materials for reuse or recycling. Remove and replace glass units which are broken, chipped, cracked, abraded, or otherwise damaged during construction activities with new units.

-- End of Section --

SECTION 09 06 00

SCHEDULES FOR FINISHES
05/09, CHG 1: 11/13

PART 1 GENERAL

1.1 SUMMARY

This section covers only the color of exterior and interior materials and products that are exposed to view in the finished construction. The word "color", as used herein, includes surface color and pattern. Requirements for quality, product specifications, and method of installation are covered in other appropriate sections of the specifications. Specific locations where the various materials are required are shown on the drawings if not identified in this specification. Items not designated for color in this section may be specified in other sections. When color is not designated for items, propose a color for approval.

PART 2 PRODUCTS

2.1 COLOR SCHEDULE

The color schedule information provided in the following paragraphs lists the colors, patterns and textures required for exterior and interior finishes, including both factory applied and field applied colors. Where color is shown as being specific to one manufacturer, an equivalent color by another manufacturer may be submitted for approval. Manufacturers and materials specified are not intended to limit the selection of equal colors from other manufacturers. In the case of difference between the drawings and specifications, colors identified in this specification govern.

2.2 EXTERIOR FINISHES

Reference drawings for manufacturer and color information.

2.2.1 Exterior Walls

Exterior wall colors apply to exterior wall surfaces including recesses at entrances and projecting vestibules. When applicable, paint conduit to closely match the adjacent surface color. Provide wall colors to match the colors listed below.

2.2.1.1 Metal Wall Panels, Hardware, and Associated Trim

(27769, SEMI-GLOSS TAN) - KINGSPAN SANDSTONE

2.2.2 Exterior Trim

Provide exterior trim to match the colors listed below.

2.2.2.1 Steel Doors and Door Frames

(27769, SEMI-GLOSS TAN) MATCH KAWNEER SANDSTONE

2.2.2.2 Fascia

(27722, SEMI-GLOSS BONE WHITE) - BERRIDGE ALMOND

2.2.2.3 Downspouts and Gutters

(27722, SEMI-GLOSS BONE WHITE) - BERRIDGE ALMOND, Downspouts
(27769, SEMI-GLOSS TAN) - KINGSPAN SANDSTONE

2.2.2.4 Louvers

Match adjacent material in color.

2.2.2.5 Flashings

Match adjacent material in color.

2.2.2.6 Caulking and Sealants

Match adjacent material in color.

2.3 INTERIOR FINISHES

2.3.1 Interior Floor Finishes

Provide flooring materials to match the colors listed below.

2.3.1.1 Carpet (Broadloom)

2.3.1.2 Carpet Tile

CPT-1 MILLIKEN, COLLECTION: CONSEQUENCE 2.0, STYLE: UPSHOT UPS106, COLOR: 107 LAKE, SOLUTION DYED, SIZE: 19.7" x 19.7" x .255" Pile height
WOT-1 MILLIKEN COLLECTION: OBEX LOOP, STYLE: STACK COLOR: SKL 19-133 DARK BLUE, SIZE: 19.7" X 19.7" X .255" pile height.

2.3.1.3 Vinyl Tile

SDT-1: TARKETT, STYLE: iQ GRANIT SD, COLOR: 0726 SIDEWALK,.24" x 24" x .080" THICKNESS

2.3.1.4 Linoleum

2.3.1.5 Luxury Vinyl Tile

LVT-1: TARKETT, COLLECTION: ID LATITUDE, STYLE: WOOD, COLOR: PLWD7523WW ACADIA PINE, SIZE: 6" X 48" X 3 MM, 20 MIL

LVT-2: Tarkett, Collection: Contour, Style: C-Stamped, Color: PCCD 0925-PS Odyssey, Square Edge, Size: 18" x 18" x 3 MM, 32 MIL

2.3.1.6 Porcelain Tile

PT-1: AMERICAN OLEAN, STYLE: UNION, COLOR: UN03 INDUSTRIAL GRAY, SIZE: 12" X 24" X 5/16"
PT 2: AMERICAN OLEAN, STYLE: UNION, COLOR: UN03 INDUSTRIAL GRAY, SIZE: 2" X 3" X 5/16

2.3.1.7 Grout

GR-2: CUSTOM BLDG. PRODUCTS, TYPE: FUSION PRO, COLOR: 09 NATURAL GRAY

2.3.1.8 Transition

SCHULTER, STYLE: RENO, FINISH: SATIN ANODIZED ALUMINUM

2.3.2 Interior Base Finishes

Provide base materials to match the colors listed below.

2.3.2.1 Resilient Base and Moldings

RB-1: TARKETT DURACOVE, THERMOPLASTIC, COLOR: 23 VAPOR GREY, SIZE: 4" HIGH

2.3.2.2 Porcelain Tile

PTB-1 AMERICAN OLEAN STYLE: UNION, COLOR: UN03 INDUSTRIAL GRAY, SIZE: 6" X 12" X 5/16"

2.3.2.3 Grout

GR-1: CUSTOM BLDG, PRODUCTS, TYPE: FUSION PRO, COLOR: 09 NATURAL GRAY

2.3.3 Interior Wall Finishes

Apply interior wall color to the entire wall surface, including reveals, vertical furred spaces and columns, grilles, diffusers, electrical and access panels, and piping and conduit adjacent to wall surfaces unless otherwise specified. Paint items not specified in other paragraphs to match adjacent wall surface. Provide wall materials to match the colors listed below.

2.3.3.1 Paint

P-1: SHERWIN WILLIAMS, COLOR: SW7035 AESTHETIC WHITE
P-3: SHERWIN WILLIAMS, COLOR: SW7649 SILVERPLATE

2.3.3.2 Porcelain Tile

PWT-1: DAL TILE, STYLE: VOLUME 1.0, COLOR: VL75 SONIC WHITE, SIZE: 12" X 24" & 3" X 12" BULLNOSE
PWT-2: DAL TILE, STYLE: VOLUME 1.0, COLOR: VL73 STEREO GREY, SIZ:E 6" X 6"
PWT-3: DAL TILE, STYLE: VOLUME 1.0, COLOR: VL73 STEREO GREY, SIZ:E 12" X 24"

2.3.3.3 Grout

GR-2: CUSTOM BLDG. PRODUCTS, TYPE: FUSION PRO, COLOR: 11 SNOW WHITE

2.3.4 Interior Ceiling Finishes

Apply ceiling colors to ceiling surfaces including soffits, furred down areas, grilles, diffusers, registers, and access panels. In addition, apply ceiling color to joists, underside of roof deck, and conduit and piping where joists and deck are exposed and required to be painted. Provide ceiling materials to match the colors listed below.

2.3.4.1 Acoustical Tile and Grid

ACT-1: ARMSTRONG, STYLE: 1941 ULTIMA, BEVELED TEGULAR, COLOR: WHITE, 24X24X 7/8"
GRID: 15/16", WHITE
ACT-2: ARMSTRONG, STYLE: 607 CERMAGUARD, PERFORATED,SQUARE EDGE, COLOR: WHITE, 24X24X5/8", GRID: 15/16", WHITE

2.3.4.2 Paint (Ceilings)

P-4: SHERWIN WILLIAMS, COLOR: SW7005 PURE WHTE

2.3.4.3 Interior Trim

2.3.4.4 Steel Doors

P-1: SHERWIN WILLIAMS, COLOR: SW7035 AESTHETIC WHITE, SHEEN: SEMI-GLOSS

2.3.4.5 Steel Door Frames

P-1: SHERWIN WILLIAMS, COLOR: SW7035 AESTHETIC WHITE, SHEEN: SEMI-GLOSS

2.3.4.6 Wood Doors

WD-1: MASONITE ARCHITECTURAL, STYLE: ASPIRO, CUT: PLAIN SLICED, SPECIES: WHITE BIRCH, COLOR: NUTMEG

2.3.5 Interior Miscellaneous

Provide miscellaneous items to match the colors listed below.

2.3.5.1 Acoustical Wall Panels

Manu: AVL Systems, Series: Acoustech, Fabric: Guilford / Anchorage 2335, Beveled Edge, Size: 36" x36" x 1" thick

2.3.5.2 Toilet Partitions and Urinal Screens

TP-1: SCRANTON, TYPE: HDPE, COLOR: WHITE, FINISH: ORANGE PEEL

2.3.5.3 Casework

PL-1: FORMICA, PATTERN: WHITE TWILL 9285, FINISH: 58 MATTE

2.3.5.4 Solid Surfacing Material

SSM-1: CORIAN, PATTERN/COLOR: 9208CS WHITE STONE

2.3.5.5 Corner Guards

CG-1: CS GROUP, STYLE: IMPACT RESISTANT PLASTIC, SURFACE MOUNTED, SIZE: 3" X 6' HIGH, COLOR: 934 PEARL

2.3.5.6 Protective Wall Covering/Panel

SWC-1: CS GROUP, STYLE: IMPACT RESISTANT RIGID VINYL SHEET, 4'0" WIDE,

COLOR: 934 PEARL (MATCHING TRIM)
FRP-1: CRANE COMPOSITES, STYLE: SEQUENTIA, TEXTURE: EMBOSSED, COLOR: WHITE

2.3.5.7 Signage Message Color

SG-1: 2/90 SIGN SYSTEMS, SERIES: KLIKLESS, PERMANENT COPY: 208 WHITE, WHITEPAPER INSERT COPY: BLACK

2.3.5.8 Signage Background Color

SG-1: 2/90 SIGN SYSTEMS, SERIES: KLIKLESS, BACKGROUND: 703 COOL GREY

2.3.5.9 Wall Switch Handles and Standard Receptacle Bodies

LIGHT ALMOND

2.3.5.10 Electrical Device Cover Plates

LIGHT ALMOND

2.3.5.11 Shower Wall Kits, Trim and Shower Pan

SSM-2 MANU: IN PRO, STYLE: BIOPRISM SOLID SURFACE, COLOR: P9080 POLAR ICE2.4 PLACEMENT SCHEDULE

Placement of color to be in accordance with the I-601 Finish Schedule, Legend and Tile Elevation.PART 3 EXECUTION

Not Used

-- End of Section --

SECTION 09 22 00

SUPPORTS FOR PLASTER AND GYPSUM BOARD
02/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM A463/A463M	(2010; R 2015) Standard Specification for Steel Sheet, Aluminum-Coated, by the Hot-Dip Process
ASTM A653/A653M	(2015) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM C645	(2014) Nonstructural Steel Framing Members
ASTM C754	(2015) Installation of Steel Framing Members to Receive Screw-Attached Gypsum Panel Products
ASTM C841	(2003; R 2013) Installation of Interior Lathing and Furring
ASTM C847	(2014a) Standard Specification for Metal Lath

NATIONAL ASSOCIATION OF ARCHITECTURAL METAL MANUFACTURERS (NAAMM)

NAAMM EMLA 920	(2009) Guide Specifications for Metal Lathing and Furring

UNDERWRITERS LABORATORIES (UL)

UL Fire Resistance	(2014) Fire Resistance Directory

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Metal support systems

Submit for the erection of metal framing, furring, and ceiling suspension systems. Indicate materials, sizes, thicknesses, and fastenings.

1.3 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the job site and store in ventilated dry locations. Storage area shall permit easy access for inspection and handling. If materials are stored outdoors, stack materials off the ground, supported on a level platform, and fully protected from the weather. Handle materials carefully to prevent damage. Remove damaged items and provide new items.

PART 2 PRODUCTS

2.1 MATERIALS

Provide steel materials for metal support systems with hot-dipped galvanized coating ASTM A653/A653M, G-60; aluminum coating ASTM A463/A463M, T1-25; or a 55-percent aluminum-zinc coating.

2.1.1 Materials for Attachment of Lath

2.1.1.1 Suspended and Furred Ceiling Systems and Wall Furring

ASTM C841, and ASTM C847.

2.1.1.2 Non-loadbearing Wall Framing

NAAMM EMLA 920.

2.1.2 Materials for Attachment of Gypsum Wallboard

2.1.2.1 Suspended and Furred Ceiling Systems

ASTM C645.

2.1.2.2 Nonload-Bearing Wall Framing and Furring

ASTM C645, but not thinner than 0.0179 inch thickness, with 0.0329 inch minimum thickness supporting wall hung items such as cabinetwork, equipment and fixtures 0.0329 inch thickness. The ASTM certified third party testing statement for equivalent thicknesses shall not apply. See contract drawings for specific size information..

2.1.2.3 Furring Structural Steel Columns

ASTM C645. Steel (furring) clips and support angles listed in UL Fire Resistance may be provided in lieu of steel studs for erection of gypsum wallboard around structural steel columns.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Systems for Attachment of Lath

3.1.1.1 Suspended and Furred Ceiling Systems and Wall Furring

ASTM C841, except as indicated otherwise.

3.1.1.2 Non-loadbearing Wall Framing

NAAMM EMLA 920, except provide framing members 16 inches o.c. unless indicated otherwise.

3.1.2 Systems for Attachment of Gypsum Wallboard

3.1.2.1 Suspended and Furred Ceiling Systems

ASTM C754, except provide framing members 16 inches o.c. unless indicated otherwise.

3.1.2.2 Non-loadbearing Wall Framing and Furring

ASTM C754, except as indicated otherwise.

3.1.2.3 Furring Structural Steel Columns

Install studs or galvanized steel clips and support angles for erection of gypsum wallboard around structural steel columns in accordance with the UL Fire Resistance, design number(s) of the fire resistance rating indicated.

3.2 ERECTION TOLERANCES

Provide framing members which will be covered by finish materials such as wallboard, plaster, or ceramic tile set in a mortar setting bed, within the following limits:

a. Layout of walls and partitions: 1/4 inch from intended position;

b. Plates and runners: 1/4 inch in 8 feet from a straight line;

c. Studs: 1/4 inch in 8 feet out of plumb, not cumulative; and

d. Face of framing members: 1/4 inch in 8 feet from a true plane.

Provide framing members which will be covered by ceramic tile set in dry-set mortar, latex-portland cement mortar, or organic adhesive within the following limits:

a. Layout of walls and partitions: 1/4 inch from intended position;

b. Plates and runners: 1/8 inch in 8 feet from a straight line;

c. Studs: 1/8 inch in 8 feet out of plumb, not cumulative; and

d. Face of framing members: 1/8 inch in 8 feet from a true plane.

-- End of Section --

SECTION 09 29 00

GYPSUM BOARD
05/11

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C1002	(2014) Standard Specification for Steel Self-Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs
ASTM C1047	(2014a) Standard Specification for Accessories for Gypsum Wallboard and Gypsum Veneer Base
ASTM C1177/C1177M	(2013) Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing
ASTM C1178/C1178M	(2013) Standard Specification for Glass Mat Water-Resistant Gypsum Backing Panel
ASTM C1396/C1396M	(2014a) Standard Specification for Gypsum Board
ASTM C475/C475M	(2015) Joint Compound and Joint Tape for Finishing Gypsum Board
ASTM C840	(2013) Application and Finishing of Gypsum Board
ASTM C954	(2015) Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness
ASTM D1149	(2007; R 2012) Standard Test Method for Rubber Deterioration - Surface Ozone Cracking in a Chamber
ASTM D412	(2006a; R 2013) Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers - Tension
ASTM D624	(2000; R 2012) Tear Strength of Conventional Vulcanized Rubber and Thermoplastic Elastomers

GYPSUM ASSOCIATION (GA)

GA 214	(2010) Recommended Levels of Gypsum Board Finish
GA 216	(2010) Application and Finishing of Gypsum Panel Products

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Certification

Gypsum Board

Submit documentation indicating percentage of post-industrial and post-consumer recycled content per unit of product. Indicate relative dollar value of recycled content products to total dollar value of products included in project.

Adhesives
Joint Treatment Materials

Submit manufacturer's product data, indicating VOC content.

Environmental Data

SD-07 Certificates

Asbestos Free Materials

Certify that gypsum board types, gypsum backing board types, cementitious backer units, and joint treating materials do not contain asbestos.

1.3 DELIVERY, STORAGE, AND HANDLING

1.3.1 Delivery

Deliver materials in the original packages, containers, or bundles with each bearing the brand name, applicable standard designation, and name of manufacturer, or supplier.

1.3.2 Storage

Keep materials dry by storing inside a sheltered building. Provide adequate ventilation to prevent condensation. Store per manufacturer's recommendations for allowable temperature and humidity range. Gypsum wallboard shall not be stored with materials which have high emissions of volatile organic compounds (VOCs) or other contaminants. Do not store panels near materials that may offgas or emit harmful fumes, such as kerosene heaters, fresh paint, or adhesives.

1.3.3 Handling

Neatly stack gypsum board units flat to prevent sagging or damage to the edges, ends, and surfaces.

1.4 ENVIRONMENTAL CONDITIONS

1.4.1 Temperature

Maintain a uniform temperature of not less than 50 degrees F in the structure for at least 48 hours prior to, during, and following the application of gypsum board, cementitious backer units, and joint treatment materials, or the bonding of adhesives.

1.4.2 Exposure to Weather

Protect gypsum board products from direct exposure to rain, snow, sunlight, and other extreme weather conditions.

1.4.3 Temporary Ventilation

Provide temporary ventilation for work of this section.

PART 2 PRODUCTS

2.1 MATERIALS

Conform to specifications, standards and requirements specified. Provide gypsum board types, and joint treating materials manufactured from asbestos free materials only. Submit Material Safety Data Sheets and manufacturer maintenance instructions for gypsum materials including adhesives.

2.1.1 Gypsum Board

ASTM C1396/C1396M.

2.1.1.1 Regular

48 inch wide, 5/8 inch thick, tapered edges.

2.1.1.2 Type X (Special Fire-Resistant)48 inch wide, 5/8 inch thick,tapered edges.

2.1.2 Glass Mat Water-Resistant Gypsum Tile Backing Board

ASTM C1178/C1178M

2.1.2.1 Regular

48 inch wide, 5/8 inch thick, square edges.

2.1.2.2 Type X (Special Fire-Resistant)

48 inch wide, 5/8 inch thick, square edges.

2.1.3 Glass Mat Covered or Reinforced Gypsum SheathingExceeds physical properties of ASTM C1396/C1396M and ASTM C1177/C1177M. Provide 5/8 inch, gypsum sheathing. Provide gypsum board of with a noncombustible

water-resistant core, with glass mat surfaces embedded to the gypsum core or reinforcing embedded throughout the gypsum core. Warrant gypsum sheathing board for at least twelve months against delamination due to direct weather exposure. Provide continuous, asphalt impregnated, building felt to cover exterior face of sheathing. Seal all joints, seams, and penetrations with compatible sealant. 2.1.3.1 Glass Mat Covered or Reinforced Gypsum Sheathing Sealant

Provide sealant compatible with gypsum sheathing, rubber washers for masonry veneer anchors, and other associated cavity wall components such as anchors and through wall flashing. Provide sealants for gypsum sheathing board edge seams and veneer anchor penetrations recommended by the gypsum sheathing manufacturer and have the following performance requirements:

a. ASTM D412: Tensile Strength, 80 psi
b. ASTM D412: Ultimate Tensile Strength (maximum elongation), 170 psi
c. ASTM D624: Tear Strength, dieB, 27 ppid. ASTM D1149: Joint Movement Capability after 14 Days cure, plus or minus 50 percent.2.1.4 Joint Treatment Materials

ASTM C475/C475M. Use all purpose joint and texturing compound containing inert fillers and natural binders, including lime compound. Pre-mixed compounds shall be free of antifreeze, vinyl adhesives, preservatives, biocides and other slow releasing compounds.

2.1.4.1 Embedding Compound

Specifically formulated and manufactured for use in embedding tape at gypsum board joints and compatible with tape, substrate and fasteners.

2.1.4.2 Finishing or Topping Compound

Specifically formulated and manufactured for use as a finishing compound.

2.1.4.3 All-Purpose Compound

Specifically formulated and manufactured to serve as both a taping and a finishing compound and compatible with tape, substrate and fasteners.

2.1.4.4 Setting or Hardening Type Compound

Specifically formulated and manufactured for use with fiber glass mesh tape.

2.1.4.5 Joint Tape

Use cross-laminated, tapered edge, reinforced paper, or fiber glass mesh tape recommended by the manufacturer.

2.1.5 Fasteners

2.1.5.1 Screws

ASTM C1002, Type "G", Type "S" or Type "W" steel drill screws for fastening gypsum board to gypsum board, wood framing members and steel framing members less than 0.033 inch thick. ASTM C954 steel drill screws for fastening gypsum board to steel framing members 0.033 to 0.112 inch thick. Provide cementitious backer unit screws with a polymer coating.

2.1.6 Accessories

ASTM C1047. Fabricate from corrosion protected steel or plastic designed for intended use. Accessories manufactured with paper flanges are not acceptable. Flanges shall be free of dirt, grease, and other materials that may adversely affect bond of joint treatment. Provide prefinished or job decorated materials.

2.1.7 Water

Provide clean, fresh, and potable water.

PART 3 EXECUTION

3.1 EXAMINATION

3.1.1 Framing and Furring

Verify that framing and furring are securely attached and of sizes and spacing to provide a suitable substrate to receive gypsum board. Do not proceed with work until framing and furring are acceptable for application of gypsum board.

3.2 APPLICATION OF GYPSUM BOARD

Apply gypsum board to framing and furring members in accordance with ASTM C840 or GA 216 and the requirements specified. Apply gypsum board with separate panels in moderate contact; do not force in place. Stagger end joints of adjoining panels. Neatly fit abutting end and edge joints. Use gypsum board of maximum practical length; select panel sizes to minimize waste. Cut out gypsum board to make neat, close, and tight joints around openings. In vertical application of gypsum board, provide panels in lengths required to reach full height of vertical surfaces in one continuous piece. Lay out panels to minimize waste; reuse cutoffs whenever feasible. Surfaces of gypsum board and substrate members may not be bonded together with an adhesive, except where prohibited by fire rating(s). Treat edges of cutouts for plumbing pipes, screwheads, and joints with water-resistant compound as recommended by the gypsum board manufacturer. Provide type of gypsum board for use in each system specified herein as indicated.

3.2.1 Application of Gypsum Board to Steel Framing and Furring

Apply in accordance with ASTM C840, System VIII or GA 216.

3.2.2 Floating Interior Angles

Minimize framing by floating corners with single studs and drywall clips. Locate the attachment fasteners adjacent to ceiling and wall intersections in accordance with ASTM C840, System XII.

3.2.3 Control Joints

Install expansion and contraction joints in ceilings and walls in accordance with ASTM C840, System XIII or GA 216. Fill control joints between studs in fire-rated construction with firesafing insulation to match the fire-rating of construction.

3.3 FINISHING OF GYPSUM BOARD

Tape and finish gypsum board in accordance with ASTM C840, GA 214 and GA 216. Finish plenum areas above ceilings to Level 4 in accordance with GA 214. Finish walls to receive light textures to Level 4 in accordance with GA 214. Unless otherwise specified, finish all gypsum board walls, partitions and ceilings to Level 4 in accordance with GA 214. Provide joint, fastener depression, and corner treatment. Tool joints as smoothly as possible to minimize sanding and dust. Do not use fiber glass mesh tape with conventional drying type joint compounds; use setting or hardening type compounds only. Provide treatment for water-resistant gypsum board as recommended by the gypsum board manufacturer. Protect workers, building occupants, and HVAC systems from gypsum dust.

3.4 SEALING

Seal openings around pipes, fixtures, and other items projecting through gypsum board and cementitious backer units as specified. Apply material with exposed surface flush with gypsum board.

3.5 PATCHING

Patch surface defects in gypsum board to a smooth, uniform appearance, ready to receive finishes.

3.6 WASTE MANAGEMENT

As specified in Waste Management Plan and as follows. Separate clean waste gypsum products from contaminants. Do not include wood, plastic, metal, asphalt-impregnated gypsum board, or any gypsum board coated with glass fiber, vinyl, decorative paper, or other finish. Place in designated area and protect from moisture and contamination.

-- End of Section --

SECTION 09 30 10

CERAMIC, QUARRY, AND GLASS TILING
08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI A108/A118/A136.1	(2019) American National Standard Specifications for theInstallation of Ceramic Tile
ANSI A137.1	(2019) American National Standards Specifications for Ceramic Tile

ASTM INTERNATIONAL (ASTM)

ASTM C33/C33M	(2018) Standard Specification for Concrete Aggregates
ASTM C144	(2018) Standard Specification for Aggregate for Masonry Mortar
ASTM C150/C150M	(2020) Standard Specification for Portland Cement
ASTM C206	(2014) Standard Specification for Finishing Hydrated Lime
ASTM C207	(2018) Standard Specification for Hydrated Lime for Masonry Purposes
ASTM C373	(2018)Standard Test Methods for Determination of Water Absorption and Associated Properties by Vacuum Method for Pressed Ceramic Tiles and Glass Tiles and Boil Method for Extruded Ceramic Tiles and Non-tile Fired Ceramic Whiteware Products
ASTM C648	(2020) Standard Test Method for Breaking Strength of Ceramic Tile
ASTM C847	(2014a) Standard Specification for Metal Lath

GREEN SEAL (GS)

GS-36	(2013) Adhesives for Commercial Use

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(2017) Adhesive and Sealant Applications

TILE COUNCIL OF NORTH AMERICA (TCNA)

TCNA Hdbk	(2017) Handbook for Ceramic, Glass, and Stone Tile Installation

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

36 CFR 1191	Americans with Disabilities Act (ADA) Accessibility Guidelines for Buildings and Facilities; Architectural Barriers Act (ABA) Accessibility Guidelines

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Detail Drawings; G

SD-03 Product Data

Porcelain Tile; G

Recycled Content for Porcelain Tile;

Mosaic Tile;

Recycled Content for Mosaic Tile;

Glazed Ceramic Wall Tile;

Recycled Content for Glazed Ceramic Wall Tile;

Transition Strips;

Metal Strips;

Setting-Bed;

Mortar, Grout, and Adhesive;

Cementitious Backer Units;

Glass-Mat Gypsum Water-Resistant Backing Board;

Waterproof Membrane;

Crack Isolation Membrane;

SD-04 Samples

Tile; G

Accessories; G

Transition Strips; G

Grout; G

SD-07 Certificates

Indoor Air Quality for Adhesives;

Indoor Air Quality for Sealants;

Water Absorption Rates

SD-08 Manufacturer's Instructions

Manufacturer's Approved Cleaning Instructions

SD-10 Operation and Maintenance Data

Porcelain Tile, Data Package 1; G

Mosaic Tile, Data Package 1; G

Glazed Ceramic Wall Tile, Data Package 1; G

Transition Strips, Data Package 1; G

1.3 CERTIFICATIONS

1.3.1 Indoor Air Quality Certifications

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited in this Section.

1.3.2 Water Absorption Rates Certification

Provide certification for each tile type indicating compliance with the

following water absorption (wa) rates per ANSI A137.1 criteria as tested per ASTM C373 requirements.

a. Porcelain: Provide water absorption (wa) of 0.5 percent or less.

b. Porcelain Wall Tile (Non-Vitreous): Provide maximum water absorption (wa) of 0.5 percent.

1.4 QUALITY ASSURANCE

Provide installers having a minimum of two years of experience with a company specializing in performing the type of work described. Each type and color of tile to be provided from a single source. Each type and color of mortar, adhesive, and grout to be provided from the same source.

1.5 DELIVERY, STORAGE, AND HANDLING

Ship tiles in sealed packages and clearly marked with the grade, type of tile, producer identification, and country of origin. Deliver materials to the project site in manufacturer's original unopened containers with seals unbroken and labels and hallmarks intact. Protect materials from weather, and store them under cover in accordance with manufacturer's printed instructions. Store and handle tiles per manufacturer's instructions for gauged porcelain tile and gauged porcelain tile panels/slabs.

1.6 ENVIRONMENTAL REQUIREMENTS

Do not perform ceramic tile work unless the substrate and ambient temperature is at least 50 degrees F and rising. Maintain temperature abo ve 50 degrees F while the work is being performed and for at least 7 days after completion of the work. When temporary heaters are used, ventilate the area to the outside to avoid carbon dioxide damage to new tilework.

1.7 WARRANTY

Provide manufacturer's warranty to repair or replace defective tiling materials and workmanship for a period of one year from date of final acceptance of the work..

1.8 EXTRA MATERIALS

Supply an extra 2 percent of each type tile used in clean and marked cartons.

PART 2 PRODUCTS

2.1 TILE

Provide tiles that comply with ANSI A137.1 and are standard grade tiles, . Provide a minimum breaking strength of 125 lbs. for wall tile and 250 lbs. for floor tile in accordance with ASTM C648. Provide floor tiles with a minimum wet dynamic coefficient of friction (DCOF) value of 0.42 when tested in accordance with ANSI A137.1 requirements. For materials like tile, accessories, and transition strips submit samples of sufficient size to show color range, pattern, type and joints.

Submit manufacturers' descriptive product data for each type of ceramic, quarry and glass tiling indicated. Include manufacturers' literature,

finishes, profiles and thicknesses of materials.

Submit manufacturers' operations and maintenance data for each type of ceramic, quarry and glass tiling indicated in accordance with Section 01 78 23 OPERATIONS AND MAINTENANCE DATA.

2.1.1 Porcelain Tile PT-1

Provide unglazed through body (surface color and pattern go all the way through the tile body) porcelain tile and bullnose base and trim pieces. Provide nominal tile size(s) of 12 by 24 inch 2 by 3 mosaic, & 6 by 12 base and 5/16 inch thick.

2.1.2 Glazed Porcelain Wall Tile PWT-1 & 2

Provide glazed, rectified porcelain wall tile that has square edges and trim with lead-free finish. Provide nominal tile size(s) of 12 by 24, and 10" by 14" by 5/16 inch inch.

2.1.3 Accessories

Provide built-in type accessories of the same materials and finish as the wall tile. Provide accessories as indicated on Drawings.

2.2 SETTING-BED

Submit manufacturer's catalog data. Compose the setting-bed of the following materials:

2.2.1 Aggregate for Concrete Fill

Conform to ASTM C33/C33M for aggregate fill. Do not exceed one-half the thickness of concrete fill for maximum size of coarse aggregate.

2.2.2 Portland Cement

Conform to ASTM C150/C150M for cement, Type I, white for wall mortar and gray for other uses.

2.2.3 Sand

Conform to ASTM C144 for sand.

2.2.4 Hydrated Lime

Conform to ASTM C206 for hydrated lime, Type S or ASTM C207, Type S.

2.2.5 Metal Lath

Conform to ASTM C847 for flat expanded type metal lath, and weighing a minimum 2.5 pound/square yard.

2.3 WATER

Provide potable water.

2.4 MORTAR, GROUT, AND ADHESIVE

Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide aerosol adhesives used on the interior of the building meeting either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of GS-36. For products located on the interior of the building (inside of the weatherproofing system, provide certification or validation of indoor air quality for adhesives. Provide bond coat, mortar, and grout supplied from the same manufacturer.

2.4.1 Dry-Set Portland Cement Mortar

TCNA Hdbk.

2.4.2 Latex-Portland Cement Mortar

TCNA Hdbk.

2.4.3 Epoxy Resin Grout GR-1 & GR-2

TCNA Hdbk. Water cleanable epoxy conforming to ANSI A108/A118/A136.1; provide manufacturer proportioned and packaged kit having hardener, resin and colored filler and horizontal and vertical grade products as applicable. Provide antimicrobial additive designed for prevention of mold and mildew.

2.4.4 Sealants

Comply with applicable regulations regarding toxic and hazardous materials and as specified. Provide sealant that does not change the color or alter the appearance of the grout. Refer to Section 07 92 00 JOINT SEALANTS.

2.5 SUBSTRATES

2.5.1 Cementitious Backer Units

Provide cementitious backer unit, for use as tile substrate as indicated, in accordance with TCNA Hdbk. Furnish 1/2 inch thick cementitious backer units.

2.6 MISCELLANEOUS TRIMS

2.6.1 Transition Strips

Provide satin anodized aluminum transitions between tile and carpet or resilient flooring. Provide types as recommended by flooring manufacturer for both edges and transitions of flooring materials specified. Provide transition strips that comply with 36 CFR 1191requirements.

2.6.2 Metal Strips

Provide extruded square, clear anodized aluminum edging at tile surfaces with exposed outside corners. Provide profiles appropriate for wall

materials as indicated.

2.7 COLOR, TEXTURE, AND PATTERN

Provide color, pattern and texture as specified in Section 09 06 00 SCHEDULES FOR FINISHES..

PART 3 EXECUTION

3.1 PREPARATORY WORK AND WORKMANSHIP

Inspect surface to receive tile in conformance to the requirements of TCNA Hdbk for surface conditions for the type setting bed specified and for workmanship. Provide variations of tiled surfaces that fall within maximum values shown below:

TYPE	WALLS	FLOORS
Dry-Set Mortar	1/8 inch in 8 ft.	1/8 inch in 10 ft.
Organic Adhesives	1/8 inch in 8 ft.	1/16 inch in 3 ft.
Latex-Portland Cement Mortar	1/8 inch in 8 ft.	1/8 inch in 10 ft.
Epoxy	1/8 inch in 8 ft.	1/8 inch in 10 ft.

3.2 GENERAL INSTALLATION REQUIREMENTS

Do not start tile work until roughing in for mechanical and electrical work has been completed and tested, and built-in items requiring membrane waterproofing have been installed and tested. Close space, in which tile is being set, to traffic and other work. Keep closed until tile is firmly set. Do not start floor tile installation in spaces requiring wall tile until after wall tile has been installed. Apply tile in colors and patterns indicated in the area shown on the drawings. Install tile with the respective surfaces in true even planes to the elevations and grades shown. Provide special shapes as required for sills, jambs, recesses, offsets, external corners, and other conditions to provide a complete and neatly finished installation. Solidly back tile bases and coves with mortar. Do not walk or work on newly tiled floors without using kneeling boards or equivalent protection of the tiled surface. Keep traffic off horizontal portland cement mortar installations for at least 72 hours. Keep all traffic off epoxy installed floors for at least 40 hours after grouting, and heavy traffic off for at least 7 days, unless otherwise specifically authorized by manufacturer. Dimension and draw detail drawings at a minimum scale of 1/4 inch = 1 foot. Include drawings of pattern at inside corners, outside corners, termination points and location of all equipment items such as thermostats, switch plates, mirrors and toilet accessories mounted on surface. Submit drawings showing ceramic tile pattern elevations and floor plans. Submit manufacturer's preprinted installation instructions.

Do not install building construction materials that show visual evidence of biological growth.

3.3 INSTALLATION OF SUBSTRATES

3.3.1 Cementitious Backer Units

Install in accordance with manufacturer's written instructions.

3.4 INSTALLATION OF WALL TILE

Install wall tile in accordance with the TCNA Hdbk, and with grout joints as recommended by the manufacturer for the type of tile. Install thinner wall tile flush with thicker wall tile applied on same wall and provide installation materials as recommended by the tile and setting materials manufacturer's to achieve flush installation. Install full height on wall behind each restroom vanity. All other walls in restrooms are Wainscot height of 48". See Drawings.

3.4.1 Dry-Set Mortar and Latex-Portland Cement Mortar

Use dry-set or latex-portland cement to install tile in accordance with TCNA Hdbk. Use latex-portland cement when installing porcelain ceramic tile.

3.4.2 Epoxy Resin Grout

Prepare and install epoxy resin grout in accordance with TCNA Hdbk method.

3.5 INSTALLATION OF FLOOR TILE

Install floor tile in accordance with TCNA Hdbk method and with grout joints as recommended by the manufacturer for the type of tile. Install shower receptors in accordance with TCNA Hdbk method.

3.5.1 Dry-Set and Latex-Portland Cement

Use dry-set or latex-portland cement mortar to install tile directly over properly cured, plane, clean concrete slabs in accordance with TCNA Hdbk method. Use latex-portland cement when installing porcelain ceramic tile.

3.5.2 Waterproof and Crack Isolation Membranes

Install as indicated in accordance with manufacturer's written instructions.

3.6 INSTALLATION OF MISCELLANEOUS TRIMS

3.6.1 Transition Strips

Install transition strips where indicated, in a manner similar to that of the ceramic tile floor and as recommended by the manufacturer. Provide thresholds full width of the opening. Install head joints at ends not exceeding 1/4 inch in width and grouted full.

3.6.2 Metal Trims

Install trim where indicated. Embed anchoring leg in setting mortar in accordance with manufacturer's instructions. During grouting of tile joints, immediately wipe grout from finish surface.

3.7 EXPANSION JOINTS

Form and seal joints as specified in Section 07 92 00 JOINT SEALANTS.

3.7.1 Walls

Provide expansion joints at control joints in backing material. Wherever backing material changes, install an expansion joint to separate the different materials.

3.7.2 Floors

Provide expansion joints over construction joints, control joints, and expansion joints in concrete slabs in accordance with TCNA Hdbk method EJ171 type to suit conditions. Provide expansion joints where tile abuts restraining surfaces such as perimeter walls, curbs and columns and at intervals of 20 to 25 feet each way in large interior floor areas. and 8 to 12 feet each way in large exterior areas or areas exposed to direct sunlight or moisture. Extend expansion joints through setting-beds and fill.

3.8 CLEANING AND PROTECTING

Upon completion, thoroughly clean tile surfaces in accordance with manufacturer's approved cleaning instructions. Do not use acid for cleaning glazed tile. Clean floor tile with resinous grout or with factory mixed grout in accordance with printed instructions of the grout manufacturer. After the grout has set, provide a protective coat of a noncorrosive soap or other approved method of protection for tile wall surfaces. Cover tiled floor areas with building paper before foot traffic is permitted over the finished tile floors. Provide board walkways on tiled floors that are to be continuously used as passageways by workmen. Replace damaged or defective tiles.

-- End of Section --

SECTION 09 51 00

ACOUSTICAL CEILINGS
08/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM A1008/A1008M	(2015) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy and High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardened
ASTM A641/A641M	(2009a; R 2014) Standard Specification for Zinc-Coated (Galvanized) Carbon Steel Wire
ASTM A653/A653M	(2015) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM B633	(2013) Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel
ASTM C423	(2009a) Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method
ASTM C635/C635M	(2013a) Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-In Panel Ceilings
ASTM C636/C636M	(2013) Standard Practice for Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-In Panels
ASTM C834	(2014) Latex Sealants
ASTM E1264	(2014) Acoustical Ceiling Products
ASTM E1414/E1414M	(2011a; E 2014) Airborne Sound Attenuation Between Rooms Sharing a Common Ceiling Plenum
ASTM E1477	(1998a; R 2013) Luminous Reflectance Factor of Acoustical Materials by Use of Integrating-Sphere Reflectometers

ASTM E580/E580M	(2014) Application of Ceiling Suspension Systems for Acoustical Tile and Lay-In Panels in Areas Requiring Moderate Seismic Restraint
ASTM E795	(2005; R 2012) Mounting Test Specimens During Sound Absorption Tests

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 3-310-04	(2013) Seismic Design for Buildings

UNDERWRITERS LABORATORIES (UL)

UL Fire Resistance	(2014) Fire Resistance Directory

1.2 SYSTEM DESCRIPTION

Provide sound controlling units mechanically mounted on a ceiling suspension system for acoustical treatment. The unit size, texture, finish, and color must be as specified. The location and extent of acoustical treatment shall be as shown on the approved detail drawings. Submit drawings showing suspension system, method of anchoring and fastening, details, and reflected ceiling plan. Coordinate with paragraph RECLAMATION PROCEDURES for reclamation of mineral fiber acoustical ceiling panels to be removed from the job site.

Basis of design: Acoustical Ceiling System. ACT1. Armstrong World Industries, Inc. Ultima Beveled Tegular #1941, 24" x 24" x 7/8" thick. Product shall have the following properties: NRC.80, CAC 35. Panels shall have the following characteristics: Class A Fire Rating, .09 Light Reflectance, Type IV, Form 2, Pattern E; Humigard Plus, Bio Block Plus, Certified Low VOC Emissions, 62% Recycled Content. Panels shall also be washable, scratch, impact and soil resistant. Acoustical panels shall provide resistance to sagging in high humidity conditions up to, but not including standing water and outdoor applications. Panels shall contain BioBlock Plus anti-microbial treatment and provide guaranteed resistance against growth of mold/mildew and Gram-positive and Gram-negative odor /stain-causing bacteria for 30 years. Ceiling system shall be installed with A15/16" Grid to maintain 30 year performance Guarantee and Warranty. Color: Grid and Ceiling Tiles shall be White.

ACT-2 ARMSTRONG, STYLE: 607 CERMAGUARD, PERFORATED, SQUARE EDGE, COLOR: WHITE, 24X24X5/8" GRID: 15/16" WHITE

1.2.1 Ceiling Attenuation Class and Test

Provide a ceiling system with an attenuation class (CAC) of 35 when determined in accordance with ASTM E1414/E1414M.

1.2.2 Ceiling Sound Absorption

Determine the Noise Reduction Coefficient (NRC) in accordance with ASTM C423 Test Method.

1.2.3 Light Reflectance

Determine light reflectance factor in accordance with ASTM E1477 Test Method.

1.2.4 Other Submittals Requirements

The following shall be submitted:

a. Manufacturer's data indicating percentage of recycle material in acoustic ceiling tiles to verify affirmative procurement compliance.

b. Total weight and volume quantities of acoustic ceiling tiles with recycle material.

c. Manufacturer's catalog showing UL classification of fire-rated ceilings giving materials, construction details, types of floor and roof constructions to be protected, and UL design number and fire protection time rating for each required floor or roof construction and acoustic ceiling assembly.

d. Reports by an independent testing laboratory attesting that acoustical ceiling systems meet specified fire endurance and sound transmission requirements. Data attesting to conformance of the proposed system to Underwriters Laboratories requirements for the fire endurance rating listed in UL Fire Resistance may be submitted in lieu of test reports.

e. Certificate attesting that the mineral based acoustical units furnished for the project contain recycled material and showing an estimated percent of such material.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Acoustical Ceiling Systems

SD-06 Test Reports

Ceiling Attenuation Class and Test

SD-07 Certificates

Acoustical Units
Acoustic Ceiling Tiles

1.4 DELIVERY, STORAGE. AND HANDLING

Deliver materials to the site in the manufacturer's original unopened containers with brand name and type clearly marked. Carefully handle and store materials in dry, watertight enclosures. Immediately before installation, store acoustical units for not less than 24 hours at the same temperature and relative humidity as the space where they will be installed in order to assure proper temperature and moisture acclimation.

1.5 ENVIRONMENTAL REQUIREMENTS

Maintain a uniform temperature of not less than 60 degrees F nor more than 85 degrees F and a relative humidity of not more than 70 percent for 24 hours before, during, and 24 hours after installation of acoustical units.

1.6 SCHEDULING

Complete and dry interior finish work such as plastering, concrete and terrazzo work before ceiling installation. Complete mechanical, electrical, and other work above the ceiling line; install and start operating heating, ventilating, and air conditioning systems in order to maintain temperature and humidity requirements.

1.7 WARRANTY

Provide manufacturer's standard performance guarantees or warranties that extend beyond a one year period. Include an agreement to repair or replace acoustical panels that fail within the warranty period in the standard performance guarantee or warranty. Failures include, but are not limited to, sagging and warping of panels; rusting and manufacturers defects of grid system.

1.8 EXTRA MATERIALS

Furnish spare tiles, from the same lot as those installed, of each color at the rate of 5 tiles for each 1000 tiles installed.

PART 2 PRODUCTS

2.1 ACOUSTICAL UNITS

Conform acoustical units to ASTM E1264, Class A, and the following requirements:

2.1.1 Affirmative Procurement

Mineral Wool, Cellulose, and Laminated Paperboard used in acoustic ceiling tiles are materials listed in the EPA's Comprehensive Procurement Guidelines (CPG) (http://www.epa.gov/cpg/). EPA's recommended Recovered Materials Content Levels for Mineral Wool, Cellulose, Structural Fiberboard and Laminated Paperboard are:

Product	Material	Percent of Post Consumer Materials	Percent of Total Recovered Materials
Laminate Paperboard	Post Consumer Paper	100	100
Rock Wool	Slag	75	
Cellulose	Post Consumer Paper	75	75

a. The recommended recovered materials content levels are based on the weight (not volume) of materials in the insulating core only.

b. Submit recycled material content data for acoustic ceiling tiles indicating compliance with affirmative procurement.

c. Submit total weight and volume quantities of acoustic ceiling tiles with recycle material.

2.1.2 Units for Exposed-Grid System

2.1.2.1 Type IV

2.1.2.2 Flame Spread

Class A, 25 or less

2.1.2.3 Pattern

E

2.1.2.4 Minimum NRC

0.70 in open office areas; when tested on mounting Type E-400 of ASTM E795.

2.1.2.5 Minimum Light Reflectance Coefficient
LR-1, 0..09 or greater

2.1.2.6 Nominal Size

24 by 24 inch

2.1.2.7 Edge Detail

Beveled Tegular

2.1.2.8 Finish

Factory-applied standard finish. White.

2.1.2.9 Minimum CAC

35

2.2 SUSPENSION SYSTEM

Provide standard exposed-grid standard width flange suspension system conforming to ASTM C635/C635M for intermediate-duty systems. Provide surfaces exposed to view of aluminum or steel with a factory-applied white color baked-enamel finish. Provide wall molding having a flange of not less than 15/16 inch. Provide standard mitered corners. Suspended ceiling framing system must have the capability to support the finished ceiling, light fixtures, air diffusers, and accessories, as shown. Provide a suspension system with a maximum deflection of 1/360 of the span length. Conform seismic details to the guidance in UFC 3-310-04 and ASTM E580/E580M.

2.3 HANGERS

Provide hangers and attachment capable of supporting a minimum 300 pound ultimate vertical load without failure of supporting material or attachment.

2.3.1 Wires

Conform wires to ASTM A641/A641M, Class 1, 0.106 inch in diameter.

2.3.2 Straps

Provide straps of 1 by 3/16 inch galvanized steel conforming to ASTM A653/A653M, with a light commercial zinc coating or ASTM A1008/A1008M with an electrodeposited zinc coating conforming to ASTM B633, Type RS.

2.3.3 Rods

Provide 3/16 inch diameter threaded steel rods, zinc or cadmium coated.

2.3.4 Masonry Anchorage Devices

Comply with ASTM C636/C636M for anchorage devices for machine screws.

2.4 ADHESIVE

Use adhesive as recommended by tile manufacturer.

2.5 FINISHES

Use manufacturer's standard textures, patterns and finishes as specified for acoustical units and suspension system members. Treat ceiling suspension system components to inhibit corrosion.

2.6 COLORS AND PATTERNS

Use colors and patterns for acoustical units and suspension system components as as indicated.

2.7 ACOUSTICAL SEALANT

Conform acoustical sealant to ASTM C834, nonstaining.

PART 3 EXECUTION

3.1 INSTALLATION

Examine surfaces to receive directly attached acoustical units for unevenness, irregularities, and dampness that would affect quality and execution of the work. Rid areas, where acoustical units will be cemented, of oils, form residue, or other materials that reduce bonding capabilities of the adhesive. Complete and dry interior finish work such as plastering, concrete, and terrazzo work before installation. Complete and approve mechanical, electrical, and other work above the ceiling line prior to the start of acoustical ceiling installation. Provide acoustical work complete with necessary fastenings, clips, and other accessories required for a complete installation. Do not expose mechanical fastenings in the finished work. Lay out hangers for each individual room or space. Provide hangers to support framing around beams, ducts, columns, grilles, and other penetrations through ceilings. Keep main runners and carrying channels clear of abutting walls and partitions. Provide at least two main runners for each ceiling span. Wherever required to bypass an object with the hanger wires, install a subsuspension system so that all hanger wires will be plumb.

3.1.1 Suspension System

Install suspension system in accordance with ASTM C636/C636M and as specified herein. Do not suspend hanger wires or other loads from underside of steel decking.

3.1.1.1 Plumb Hangers

Install hangers plumb and not pressing against insulation covering ducts and pipes. Where lighting fixtures are supported from the suspended ceiling system, provide hangers at a minimum of four hangers per fixture and located not more than 6 inch from each corner of each fixture.

3.1.1.2 Splayed Hangers

Where hangers must be splayed (sloped or slanted) around obstructions, offset the resulting horizontal force by bracing, countersplaying, or other acceptable means.

3.1.2 Wall Molding

Provide wall molding where ceilings abut vertical surfaces. Miter corners where wall moldings intersect or install corner caps. Secure wall molding not more than 3 inch from ends of each length and not more than 16 inch on centers between end fastenings. Provide wall molding springs at each acoustical unit in semi-exposed or concealed systems.

3.1.3 Acoustical Units

Install acoustical units in accordance with the approved installation instructions of the manufacturer. Ensure that edges of acoustical units are in close contact with metal supports, with each other, and in true alignment. Arrange acoustical units so that units less than one-half width are minimized. Hold units in exposed-grid system in place with manufacturer's standard hold-down clips, if units weigh less than 1 psf or if required for fire resistance rating. Back-paint field-cut edges of acoustical units exposed to view.

3.1.4 Caulking

Seal all joints around pipes, ducts or electrical outlets penetrating the ceiling. Apply a continuous ribbon of acoustical sealant on vertical web of wall or edge moldings.

3.1.5 Adhesive Application

Wipe back of tile to remove accumulated dust. Daub acoustical units on back side with four equal daubs of adhesive. Apply daubs near corners of tiles. Ensure that contact area of each daub is at least 2 inch diameter in final position. Press units into place, aligning joints and abutting units tight and uniform without differences in joint widths.

3.2 CEILING ACCESS PANELS

Locate ceiling access panels directly under the items which require access.

3.3 CLEANING

Following installation, clean dirty or discolored surfaces of acoustical

units and leave them free from defects. Remove units that are damaged or improperly installed and provide new units as directed.

3.4 RECLAMATION PROCEDURES

Neatly stack ceiling tile, designated for recycling by the Contracting Officer, on 4 by 4 foot pallets not higher than 4 foot. Panels must be completely dry. Shrink wrap and symmetrically stack pallets on top of each other without falling over.

-- End of Section --

SECTION 09 62 38

STATIC-CONTROL FLOORING
08/17, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E648	(2019a) Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source
ASTM F150	(2006; R 2013) Standard Test Method for Electrical Resistance of Conductive and Static Dissipative Resilient Flooring
ASTM F1700	(2020) Standard Specification for Solid Vinyl Floor Tile
ASTM F1861	(2021) Standard Specification for Resilient Wall Base
ASTM F1869	(2016a) Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
ASTM F2170	(2019a) Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes

ELECTROSTATIC DISCHARGE ASSOCIATION (ESD)

ESD S6.1	(2019) Standard for the Protection of Electrostatic Discharge Susceptible Items – Grounding

GREEN SEAL (GS)

GS-36	(2013) Adhesives for Commercial Use

RESILIENT FLOOR COVERING INSTITUTE (RFCI)

FLOORSCORE	FLOORSCORE IAQ Certification

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(2017) Adhesive and Sealant Applications

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SCHEDULING

Schedule static-control flooring work after any other work which would damage the finished surface of the flooring.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Static-Control Resilient Flooring; G

Accessories; G

Adhesives; G

Warranty

SD-04 Samples

Static-Control Resilient Flooring; G

Moldings; G

SD-06 Test Reports

Fire Resistance

Moisture, Alkalinity and Bond

Testing

SD-07 CertificatesIndoor Air Quality for Static-Dissipative Vinyl Tile

SD-08 Manufacturer's Instructions

Static-Control Resilient Flooring; G

SD-10 Operation and Maintenance Data

Static-Control Resilient Flooring; G

1.3.1 Samples

1.3.1.1 Static-Control Resilient Flooring

Submit three samples of each indicated color and type of flooring, base, moldings, and accessories sized a minimum 2-1/2 by 4 inch.

1.3.1.2 Operations and Maintenance Data

a. Submit Data Package 1 in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.

b. Submit three copies of manufacturer's maintenance instructions for each type of flooring material describing recommended type of cleaning equipment and materials, spotting and cleaning methods, and cleaning cycles.

1.4 CERTIFICATIONS

1.4.1 Indoor Air Quality Certifications

1.4.1.1 Floor Covering Materials

Provide Static-Dissipative Vinyl Tile and wall base products certified to meet indoor air quality requirements by FLOORSCORE, UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section.

1.4.1.2 Adhesives

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body.

1.5 EXTRA MATERIALS

Provide extra material from same dye lot for future maintenance. Provide a minimum of 5 percent of total square yards of each flooring and base type, pattern, and color.

1.6 QUALITY ASSURANCE

The flooring manufacturer will approve the Qualifications of Applicator and certify that he/she has a minimum of 3 years of experience in the application of the materials to be used.

1.7 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the building site in original unopened containers bearing the manufacturer's name, style name, pattern color name and number, size, production run, project identification, handling instructions and related information. Observe ventilation and safety procedures specified in the Safety Data Sheets (SDS). Do not store flooring near materials that may off-gas or emit harmful fumes, such as kerosene heaters, fresh paint, or adhesives.

1.7.1 Static-Control Resilient Flooring

Store materials in a clean, dry, secure, and well-ventilated area free from strong contaminant sources and residues with ambient air temperature range as recommended by the manufacturer but not less than 68 degrees F or more than 85 degrees F. Stack materials according to manufacturer's recommendations. Protect materials from the direct flow of heat from hot-air registers, radiators and other heating fixtures and appliances.

1.8 ENVIRONMENTAL CONDITIONS

Provide temporary ventilation during work of this section.

1.8.1 Static-Control Resilient Flooring

Maintain areas in which resilient flooring is to be installed at a temperature range as recommended by the manufacturer but not less than 68 degrees F or more than 85 degrees F for 3 days before application, during application and 2 days after application, unless otherwise directed by the flooring manufacturer for the flooring being installed. Maintain a minimum temperature range as recommended by the manufacturer but not less than 55 degrees F thereafter for the duration of the contract. Provide adequate ventilation to remove moisture from area and to comply with regulations limiting concentrations of hazardous vapors.

1.9 WARRANTY

1.9.1 Static-Control Resilient Flooring

Provide manufacturer's standard performance guarantees or warranties including a five year wear warranty.

PART 2 PRODUCTS

2.1 STATIC-CONTROL RESILIENT FLOORING

2.1.1 Static-Dissipative Resilient Flooring

2.1.1.1 Static-Dissipative Vinyl Tile SDT-1

Static-dissipative vinyl tile must be a homogeneous vinyl product and conform to ASTM F1700. Provide electrical resistance from surface to surface and surface to ground between 1,000,000 ohms (1.0 x 10 to the 6th) and 1,000,000,000 ohms (1.0 x 10 to the 9th) when tested in accordance with ASTM F150. Tile must be 24 inches square and 1/8 inch thick.

2.2 WALL BASE RB-1

2.2.1 Resilient Base

Resilient base must conform to ASTM F1861, Type TP (thermoplastic rubber) Style B (coved - installed with resilient flooring). Provide 4 inch high and a minimum 1/8 inch thick wall base. Provide preformed or job formed corners in matching height, shape, and color.

2.3 ADHESIVES

Provide conductive adhesive as recommended by the manufacturer of the static-control flooring.

Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) that meet either emissions requirements of CDPH SECTION 01350 (use the office or classoom requirements, regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide aerosol adhesives used on the interior of the building that meet either emissions requirements of CDPH SECTION 01350 (use the office or classoom requirements, regardless of space type) or VOC content requirements of GS-36. Provide certification or validation of indoor air quality for adhesives.

2.4 MOLDINGS

Provide heavy duty tapered moldings of clear anodized aluminum and types as recommended by flooring manufacturer for both edges and transitions of flooring materials specified. Provide vertical lip on molding of maximum 1/4 inch. Provide bevel change in level between 1/4 and 1/2 inch with a slope no greater than 1:2.

2.5 MANUFACTURER'S COLOR, PATTERN AND TEXTURE

Provide color, pattern and texture in accordance with Section 09 06 00 SCHEDULES FOR FINISHES. Provide flooring in any one continuous area or replacement of damaged flooring in continuous area from same production run with same shade and pattern.

2.6 FIRE RESISTANCE TESTING REQUIREMENTS

Provide a minimum average critical radiant flux of 0.45 watts per square centimeter for flooring in corridors and exits when tested in accordance with ASTM E648.

PART 3 EXECUTION

3.1 SURFACE PREPARATION

Before any work under this section is begun, defects such as rough or scaling concrete, low spots, high spots, and uneven surfaces must be corrected, and damaged portions of concrete slabs must be repaired in accordance with flooring manufacturer's recommended instructions. Floor must be in a level plane with a maximum variation of 1/8 inch every 10 feet, except where indicated as sloped. Repair cracks and irregularities and prepare the subfloor in accordance with flooring manufacturer's recommended instructions. Curing and sealing compounds should not be used on concrete surfaces to receive flooring unless they have been tested and approved by the flooring manufacturer. In addition, remove paint, varnish, oils, release agents, sealers, waxes, and adhesives, as required by the flooring product in accordance with manufacturer's printed installation instructions. If a curing compound is required, it must be coordinated for compatibility with the flooring adhesive.

3.2 MOISTURE, ALKALINITY AND BOND TESTS

Determine the suitability of the concrete subfloor for receiving the flooring with regard to moisture content and pH level by moisture and alkalinity tests. Conduct moisture testing in accordance with ASTM F1869 or ASTM F2170, unless otherwise recommended by the flooring manufacturer. Conduct alkalinity testing as recommended by the flooring manufacturer. Determine the compatibility of the flooring adhesives to the concrete

floors by a bond test in accordance with the flooring manufacturer's recommendations.

3.3 GENERAL INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

3.4 INSTALLATION OF STATIC-CONTROL RESILIENT TILE FLOORING

Install static-control resilient flooring, ground connections and accessories in accordance with the approved manufacturer's installation instructions. Tile lines and joints must be kept square, symmetrical, tight, and even. Tile at the perimeter of the area to be finished may vary as necessary to maintain full-size tiles in the field, but no perimeter tile may be less than one-half the field tile size, except where irregular shaped rooms make it impossible. Tile must be cut, fitted, and scribed to walls, partitions, and projections after field flooring has been applied. Install grounding strips in accordance with manufacturer's installation instructions. Protect edges of flooring material meeting hard surface flooring with molding and install in accordance with the molding manufacturer's printed instructions.

3.5 INSTALLATION OF WALL BASE

3.5.1 Resilient Base

Install wall base in accordance with manufacturer's printed installation instructions. Prepare and apply adhesives in accordance with manufacturer's printed directions. Tighten base joints and make even with adjacent resilient flooring. Fill voids along the top edge of base at masonry walls with caulk. Roll entire vertical surface of base with hand roller, and press toe of base with a straight piece of wood to ensure proper alignment. Avoid excess adhesive in corners.

3.6 CLEANING AND PROTECTION

The flooring must be cleaned in accordance with the manufacturer's recommendations. Flooring must be protected by a covering of heavy-duty building paper before foot traffic is permitted. Lap and secure edges of kraft paper protection to provide a continuous cover. Boardwalks must be placed over flooring in areas where subsequent building operations might damage the floor. Remove and replace flooring that becomes loose, broken, or curled prior to acceptance, or flooring that does not conform to resistance requirements of ASTM F150.

3.7 TESTING

Test the flooring in accordance with and conform to the requirements of ESD S6.1.

-- End of Section --

SECTION 09 65 00

RESILIENT FLOORING
08/10, CHG 3: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM E648	(2019a) Standard Test Method for Critical Radiant Flux of Floor-Covering Systems Using a Radiant Heat Energy Source
ASTM F710	(2019; E 2020) Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring
ASTM F1482	(2021) Standard Practice for Installation and Preparation of Panel Type Underlayments to Receive Resilient Flooring
ASTM F1861	(2021) Standard Specification for Resilient Wall Base
ASTM F1869	(2016a) Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride
ASTM F2170	(2019a) Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using in situ Probes

GREEN SEAL (GS)

GS-36	(2013) Adhesives for Commercial Use

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(2017) Adhesive and Sealant Applications

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Resilient Flooring and Accessories;

SD-03 Product Data

Resilient Flooring and Accessories;

Adhesives

Luxury Vinyl Tile

Recycled content for Luxury Vinyl Tile; S

Wall Base

SD-04 Samples

Resilient Flooring and Accessories; G

SD-06 Test Reports

Moisture, Alkalinity and Bond Tests; G

SD-07 Certificates

Indoor Air Quality for Luxury Vinyl Tile; S

Indoor Air Quality for Wall Base; S

Indoor Air Quality for Adhesives; S

SD-08 Manufacturer's Instructions

Surface Preparation;

Installation;

SD-10 Operation and Maintenance Data

Resilient Flooring and Accessories;

1.3 CERTIFICATES

1.3.1 Indoor Air Quality

Submit required indoor air quality certifications and validations in one submittal package.

1.3.1.1 Floor Covering Materials

Provide Sheet Vinyl FlooringLuxury Vinyl Tile and Solid Vinyl Tile, and wall base products certified to meet indoor air quality requirements by FLOORSCORE, UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification by other third-party programs. Provide current product certification documentation from certification body.

1.3.1.2 Adhesives, Caulking and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the building site in original unopened containers bearing the manufacturer's name, style name, pattern color name and number, production run, project identification, and handling instructions. Store materials in a clean, dry, secure, and well-ventilated area free from strong contaminant sources and residues with ambient air temperature maintained above 68 degrees F and below 85 degrees F, stacked according to manufacturer's recommendations. Remove resilient flooring products from packaging to allow ventilation prior to installation. Protect materials from the direct flow of heat from hot-air registers, radiators and other heating fixtures and appliances. Observe ventilation and safety procedures specified in the MSDS.

1.5 ENVIRONMENTAL REQUIREMENTS

Maintain areas to receive resilient flooring at a temperature above 68 degrees F and below 85 degrees F for 3 days before application, during application and 2 days after application, unless otherwise directed by the flooring manufacturer for the flooring being installed. Maintain a minimum temperature of 55 degrees F thereafter. Provide adequate ventilation to remove moisture from area and to comply with regulations limiting concentrations of hazardous vapors.

1.6 SCHEDULING

Schedule resilient flooring application after the completion of other work which would damage the finished surface of the flooring.

1.7 WARRANTY

Provide manufacturer's standard performance guarantees or warranties that extend beyond a one year period.

1.8 EXTRA MATERIALS

Provide extra flooring material of each color and pattern at the rate of 5 tiles for each 1000 tiles installed. Provide extra wall base material composed of 20 linear feet of each type, color and pattern. Package all extra materials in original properly marked containers bearing the manufacturer's name, brand name, pattern color name and number, production

run, and handling instructions. Provide extra materials from the same lot as those installed. Leave extra stock at the site in location assigned by Contracting Officer.

PART 2 PRODUCTS

2.1 LUXURY VINYL TILE LVT-1 & LVT-2

Conform to ASTM F1700 Class III printed film with a minimum wear layer thickness 0.020 inch (20 mil)(LVT-1) & .032 (32 mil) (LVT-2) and minimum overall thickness 0.197 inchTypeB (embossed). Provide 6" X 48"(LVT-1) & 18" x 18" (LVT-2) Provide Luxury Vinyl Tile containing a minimum of 35 percent recycled content. Provide data identifying percentage of recycled content for Luxury Vinyl Tile.

2.2 WALL BASE RB-1

Conform to ASTM F1861, Style B (coved - installed with resilient flooring, Provide 4 inch high and a minimum 1/8 inch thick wall base. Provide preformed or job formed corners in matching height, shape, and color.

2.3 MOULDING

Provide tapered mouldings of clear anodized aluminum and types as recommended by flooring manufacturer for both edges and transitions of flooring materials specified. Provide vertical lip on moulding of maximum 1/4 inch. Provide bevel change in level between 1/4 and 1/2 inch with a slope no greater than 1:2.

2.4 ADHESIVES

Provide adhesives for flooring, base and accessories as recommended by the manufacturer and comply with local indoor air quality standards. Submit manufacturer's descriptive data, documentation stating physical characteristics, and mildew and germicidal characteristics. The installer shall confirm the adhesives with the manufacturer as called out in the notes on Sheet I-104.

Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) that meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Provide aerosol adhesives used on the interior of the building that meet either emissions requirements of CDPH SECTION 01350 (use the office or classroom requirements, regardless of space type) or VOC content requirements of GS-36.

2.5 SURFACE PREPARATION MATERIALS

Provide surface preparation materials, such as panel type underlayment, lining felt, and floor crack fillers as recommended by the flooring manufacturer for the subfloor conditions. Comply with ASTM F1482 for panel type underlayment products. e. Plywood: As specified in Section 06 10 00 ROUGH CARPENTRY.

2.6 CAULKING AND SEALANTS

Provide caulking and sealants in accordance with Section 07 92 00 JOINT

SEALANTS.

2.7 MANUFACTURER'S COLOR, PATTERN AND TEXTURE

Provide color, pattern and texture for resilient flooring and accessories in accordance with Section 09 06 00 SCHEDULES FOR FINISHES. Color listed is not intended to limit the selection of equal colors from other manufacturers. Provide flooring in any one continuous area or replacement of damaged flooring in continuous area from same production run with same shade and pattern. Submit scaled drawings indicating patterns (including location of patterns and colors) and dimensions. Submit manufacturer's descriptive data and three samples of each indicated color and type of flooring, base, mouldings, and accessories sized a minimum 2-1/2 by 4 inch.

2.8 FIRE RESISTANCE TESTING REQUIREMENTS

Provide a minimum average critical radiant flux of 0.45 watts per square centimeter for flooring in corridors and exits when tested in accordance with ASTM E648.

PART 3 EXECUTION

3.1 EXAMINATION

Examine and verify that site conditions are in agreement with the design package. Report all conditions that will prevent a proper installation. Do not take any corrective action without written permission from the Government. Work will proceed only when conditions have been corrected and accepted by the installer. Submit manufacturer's printed installation instructions for all flooring materials and accessories, including preparation of substrate, seaming techniques, and recommended adhesives.

3.2 SURFACE PREPARATION

Provide a smooth, true, level plane for surface preparation of the flooring, except where indicated as sloped. Floor to be flat to within 3/16 inch in 10 feet. Prepare subfloor in accordance with flooring manufacturer's recommended instructions. Prepare the surfaces of lightweight concrete slabs (as defined by the flooring manufacturer) as recommended by the flooring manufacturer. Comply with ASTM F710 for concrete subfloor preparation. Floor fills or toppings may be required as recommended by the flooring manufacturer. Install underlayments, when required by the flooring manufacturer, in accordance with manufacturer's recommended printed installation instructions. Comply with ASTM F1482 for panel type underlayments. Before any work under this section is begun, correct all defects such as rough or scaling concrete, chalk and dust, cracks, low spots, high spots, and uneven surfaces. Repair all damaged portions of concrete slabs as recommended by the flooring manufacturer. Remove concrete curing and sealer compounds from the slabs, other than the type that does not adversely affect adhesion. Remove paint, varnish, oils, release agents, sealers, waxes, and adhesives, as required by the flooring product in accordance with manufacturer's printed installation instructions.

3.3 MOISTURE, ALKALINITY AND BOND TESTS

Determine the suitability of the concrete subfloor for receiving the resilient flooring with regard to moisture content and pH level by moisture and alkalinity tests. Conduct moisture testing in accordance

with ASTM F1869 or ASTM F2170, unless otherwise recommended by the flooring manufacturer. Conduct alkalinity testing as recommended by the flooring manufacturer. Determine the compatibility of the resilient flooring adhesives to the concrete floors by a bond test in accordance with the flooring manufacturer's recommendations. Submit copy of test reports for moisture and alkalinity content of concrete slab, and bond test stating date of test, person conducting the test, and the area tested.

3.4 GENERAL INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

3.5 PLACING LUXURY VINYL TILES

Install luxury vinyl tile flooring using glue down installation. Install flooring and accessories in accordance with manufacturer's printed installation instructions. Prepare and apply adhesives in accordance with manufacturer's directions for installation method specified. Keep tile lines and joints square, symmetrical, tight, and even. Keep each floor in true, level plane, except where slope is indicated. Vary edge width as necessary to maintain full-size tiles in the field, no edge tile to be less than one-half the field tile size, except where irregular shaped rooms make it impossible. Cut flooring to fit around all permanent fixtures, built-in furniture and cabinets, pipes, and outlets. Cut, fit, and scribe edge tile to walls and partitions after field flooring has been applied.

3.6 PLACING MOULDING

Provide moulding where flooring termination is higher than the adjacent finished flooring and at transitions between different flooring materials. When required, locate moulding under door centerline. Moulding is not required at doorways where thresholds are provided. Anchor aluminum moulding to floor surfaces as recommended by the manufacturer.

3.7 PLACING WALL BASE

Install wall base in accordance with manufacturer's printed installation instructions. Prepare and apply adhesives in accordance with manufacturer's printed directions. Tighten base joints and make even with adjacent resilient flooring. Fill voids along the top edge of base at masonry walls with caulk. Roll entire vertical surface of base with hand roller, and press toe of base with a straight piece of wood to ensure proper alignment. Avoid excess adhesive in corners.

3.8 CLEANING

Immediately upon completion of installation of flooring in a room or an area, dry and clean the flooring and adjacent surfaces to remove all surplus adhesive. Clean flooring as recommended in accordance with manufacturer's printed maintenance instructions and within the recommended time frame. As required by the manufacturer, apply the recommended number of coats and type of polish and finish in accordance with manufacturer's written instructions.

3.9 PROTECTION

From the time of installation until acceptance, protect flooring from damage as recommended by the flooring manufacturer. Remove and replace flooring which becomes damaged, loose, broken, or curled and wall base which is not tight to wall or securely adhered.

-- End of Section --

SECTION 09 68 00

CARPETING
11/17, CHG 2: 08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF TEXTILE CHEMISTS AND COLORISTS (AATCC)

AATCC 16	(2004; E 2008; E 2010) Colorfastness to Light
AATCC 107	(2013) Colorfastness to Water
AATCC 134	(2016) Electrostatic Propensity of Carpets
AATCC 165	(2013) Colorfastness to Crocking: Textile Floor Coverings - Crockmeter Method
AATCC 174	(2016) Antimicrobial Activity Assessment of New Carpets

ASTM INTERNATIONAL (ASTM)

ASTM D1335	(2017; E 2018) Standard Test Method for Tuft Bind of Pile Yarn Floor Coverings
ASTM D2859	(2016) Standard Test Method for Ignition Characteristics of Finished Textile Floor Covering Materials
ASTM D3278	(1996; R 2011) Flash Point of Liquids by Small Scale Closed-Cup Apparatus
ASTM D5793	(2018) Standard Test Method for Binding Sites Per Unit Length or Width of Pile Yarn Floor Coverings
ASTM D5848	(2020) Standard Test Method for Mass Per Unit Area of Pile Yarn Floor Coverings
ASTM D6859	(2011) Standard Test Method for Pile Thickness of Finished Level Pile Yarn Floor Coverings
ASTM D7330	(2015) Standard Test Method for Assessment of Surface Appearance Change in Pile Floor Coverings Using Standard Reference Scales
ASTM E648	(2019a) Standard Test Method for Critical Radiant Flux of Floor-Covering Systems

Using a Radiant Heat Energy Source

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2010; Version 1.1) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers

CARPET AND RUG INSTITUTE (CRI)

CRI 104	(2015) Carpet Installation Standard for Comnmercial Carpet
CRI GLP QM	(2017) Green Label Plus Quality Manual
CRI Test Method 103	(2015) Standard Test Method for the Evaluation of Texture Appearance Retention of Carpet Standards Program

GREEN SEAL (GS)

GS-36	(2013) Adhesives for Commercial Use

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION (ISO)

ISO 2551	(2020) Textile Floor Coverings and Textile Floor Coverings in Tile Form-Determination of Dimensional Changes Due to the Effects of Varied Water and Heat Conditions and Distortion Out of Plane

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(2017) Adhesive and Sealant Applications

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

16 CFR 1630	Standard for the Surface Flammability of Carpets and Rugs (FF 1-70)

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Installation Drawings; G

SD-03 Product Data

Carpet; G

Recycled Content for Carpeting; S

Moldings; G

SD-04 Samples

Carpet; G

Moldings; G

SD-06 Test Reports

Moisture and Alkalinity Tests; G

SD-08 Manufacturer's Instructions

Surface Preparation

SD-11 Closeout Submittals

Warranty

1.3 CERTIFICATIONS

1.3.1 Indoor Air Quality Certifications

1.3.1.1 Floor Covering Materials

Provide carpet and cushion products certified to meet indoor air quality requirements by UL 2818 (GreenGuard) Gold, SCS Global Services Indoor Advantage Gold, CRI GLP QM or provide certification or validation by other third-party program that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the site in the manufacturer's original wrappings and packages clearly labeled with the manufacturer's name, brand name, size, dye lot number, and related information. Remove materials from packaging and store them in a clean, dry, well ventilated area (100 percent outside air supply, minimum of 1.5 air changes per hour, and no recirculation), protected from damage, soiling, and moisture, and strong contaminant sources and residues, and maintain at a temperature above 60 degrees F for 2 days prior to installation. Do not store carpet or carpet tiles with materials which have high emissions of volatile organic compounds (VOCs) or other contaminants, including paints and adhesives. Do not store carpet near materials that may off gas or emit harmful fumes, such as kerosene heaters, fresh paint, or adhesives.

1.5 AMBIENT CONDITIONS

Maintain areas in which carpeting is to be installed at a temperature above 60 degrees F and below 90 degrees F for 2 days before installation, during installation, and for 2 days after installation. Provide temporary ventilation during work of this section. Maintain a minimum temperature of 55 degrees F thereafter for the duration of the contract.

1.6 WARRANTY

Provide manufacturer's standard performance guarantees or warranties including minimum ten year wear warranty, two year material and workmanship and ten year tuft bind and delamination.

PART 2 PRODUCTS

2.1 CARPET

Furnish first quality carpet that is free of visual blemishes, streaks, poorly dyed areas, fuzzing of pile yarn, spots or stains, and other physical and manufacturing defects. Provide carpet materials and treatments as reasonably nonallergenic and free of other recognized health hazards. Provide a static control construction on all grade carpets which gives adequate durability and performance. Submit manufacturer's catalog data and printed documentation stating physical characteristics, durability, resistance to fading, and flame resistance characteristics for each type of carpet material and installation accessory. Submit manufacturer's Product Data for 1) Carpet, 2) Moldings, and 3) Carpet Cushion. Also, submit Samples of the following:

a. Carpet: Two "Production Quality" samples 18 by 18 inches of each carpet proposed for use, showing quality, pattern, and color specified

b. Moldings: Two samples of each type minimum 12 inches long

2.1.1 Physical Characteristics for Modular Tile and Entrance Carpet

2.1.1.1 Carpet Construction

Tufted CPT-1 & WOT-1

2.1.1.2 Type

Modular tile 19.7" by 19.7" inch square with 0.15 percent growth/shrink rate in accordance with ISO 2551. Entrance 19.7" by 19.7" square mat size.

2.1.1.3 Pile Type

Multilevel loop

2.1.1.4 Pile Fiber

Commercial 100 percent branded (federally registered trademark) nylon continuous filament.

2.1.1.5 Gauge or Pitch

Minimum 1/10 inch in accordance with ASTM D5793

2.1.1.6 Stitches or Rows/Wires

Minimum 1/10 per square inch

2.1.1.7 Surface Pile Weight

Minimum 11 ounces per square yard. This does not include weight of backings. Determine weight in accordance with ASTM D5848.

2.1.1.8 Pile Thickness

Minimum .12 inch in accordance with ASTM D6859

2.1.1.9 Pile Density

Minimum 5739

2.1.1.10 Dye Method

Solution dyed

2.1.1.11 Backing Materials

Provide primary backing materials like PVC-free WellBAC comfort backing. Provide secondary backing to suit project requirements of those customarily used and accepted by the trade for each type of carpet.

2.2 PERFORMANCE REQUIREMENTS

2.2.1 Texture Appearance Retention Rating (TARR)

Provide carpet with a greater than or equal to 3.5 (Severe) TARR traffic level classification in accordance with ASTM D7330 or CRI Test Method 103.

2.2.2 Static Control

Provide static control to permanently regulate static buildup to less than 3.5 kV when tested at 20 percent relative humidity and 70 degrees F in accordance with AATCC 134.

2.2.3 Flammability and Critical Radiant Flux Requirements

Comply with 16 CFR 1630 or ASTM D2859. Provide carpet in corridors and exits with a minimum average critical radiant flux of 0.45 watts per square centimeter when tested in accordance with ASTM E648.

2.2.4 Tuft Bind

Comply with ASTM D1335 for tuft bind force required to pull a tuft or loop free from carpet backing with a minimum 8 pound average force for modular carpet tile.

2.2.5 Colorfastness to Crocking

Comply dry and wet crocking with AATCC 165 and with a Class 4 minimum rating on the AATCC Color Transference Chart for all colors.

2.2.6 Colorfastness to Light

Comply colorfastness to light with AATCC 16, Test Option E "Water-Cooled Xenon-Arc Lamp, Continuous Light" and with a minimum 4 grey scale rating after 40 hours.

2.2.7 Colorfastness to Water

Comply colorfastness to water with AATCC 107 and with a minimum 4.0 gray scale rating and a minimum 4.0 transfer scale rating.

2.2.8 Delamination Strength

Provide delamination strength for tufted carpet with a secondary back of minimum 2.5 lbs/inch.

2.2.9 Antimicrobial

Nontoxic antimicrobial treatment in accordance with AATCC 174 Part I (qualitative), guaranteed by the carpet manufacturer to last the life of the carpet.

2.3 ADHESIVES AND CONCRETE PRIMER

Comply with applicable regulations regarding toxic and hazardous materials. Provide water resistant, mildew resistant, nonflammable, and nonstaining adhesives and concrete primers for carpet installation as required by the carpet manufacturer. Provide release adhesive for modular tile carpet as recommended by the carpet manufacturer. Provide adhesives flashpoint of minimum 140 degrees F in accordance with ASTM D3278. Non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) must meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168. Aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) must meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of GS-36.

2.4 MOLDINGS

Provide carpet moldings where floor covering material changes or carpet edge does not abut a vertical surface. Provide an aluminum molding, pinless clamp-down type, designed for the type of carpet being installed. Provide natural color anodize finish.

2.5 TAPE

Provide tape for seams as recommended by the carpet manufacturer for the type of seam used in broadloom installation. Seam sealant must have a maximum VOC content of no more than 50 grams/liter. Do not use sealants that contain 1,1,1-trichloroethane or toluene.

2.6 COLOR, TEXTURE, AND PATTERN

Provide color, texture, and pattern in accordance with Section 09 06 00 SCHEDULES FOR FINISHES.

PART 3 EXECUTION

3.1 SURFACE PREPARATION

Do not install carpet on surfaces that are unsuitable and will prevent a proper installation. Prepare subfloor in accordance with flooring manufacturer's recommended instructions. Repair holes, cracks, depressions, or rough areas using material recommended by the carpet or adhesive manufacturer. Free floor of any foreign materials and sweep clean. Before beginning work, test subfloor with glue and carpet to determine "open time" and bond. Submit three copies of the manufacturer's printed Installation instructions for the carpet, including Surface Preparation, seaming techniques, and recommended adhesives and tapes.

3.2 MOISTURE AND ALKALINITY TESTS

Test concrete slab for moisture content and excessive alkalinity in accordance with CRI 104/CRI 105. Submit three copies of reports of Moisture and Alkalinity Tests including content of concrete slab stating date of test, person conducting the test, and the area tested.

3.3 PREPARATION OF CONCRETE SUBFLOOR

Do not commence installation of the carpeting until concrete substrate is at least 90 days old. Prepare the concrete surfaces in accordance with the carpet manufacturer's instructions. Match carpet, when required, and adhesives to prevent off-gassing to a type of curing compounds, leveling agents, and concrete sealer.

3.4 INSTALLATION

Isolate area of installation from rest of building. Perform all work by manufacturer's approved installers. Conduct installation in accordance with the manufacturer's printed instructions and CRI 104/CRI 105. Protect edges of carpet meeting hard surface flooring with molding and install in accordance with the molding manufacturer's printed instructions. Use autofoam mothproofing system for wool carpets.Follow ventilation, personal protection, and other safety precautions recommended by the adhesive manufacturer. Continue ventilation during installation and for at least 72 hours following installation. Do not permit traffic or movement of furniture or equipment in carpeted area for 24 hours after installation. Complete other work which would damage the carpet prior to installation of carpet. Submit three copies of Installation Drawings for 1) Carpet, 2) Carpet Cushion, and 3) Moldings indicating areas receiving carpet, carpet types, patterns, direction of pile, location of seams, and locations of edge molding.

Do not install building construction materials that show visual evidence of biological growth.

3.4.1 Modular Tile Installation

Install modular tiles with releasable adhesive and snug joints. Use ashlar installation method. Comply with manufacturer installation instructions for required drying time of releasable adhesive so it sets up properly. Provide accessibility to the subfloor where required. Carpet tile on stairs and sloped surfaces must be installed with a more permanent installation method in accordance with the manufacturer's instructions and with manufacturer recommended adhesives for this application.

3.4.2 Entrance Carpet Installation

Install tiles with releasable adhesive and snug joints. Use monolithic installation method.

3.5 CLEANING AND PROTECTION

Submit three copies of carpet manufacturer's maintenance instructions describing recommended type of cleaning equipment and material, spotting and cleaning methods, and cleaning cycles.

3.5.1 Cleaning

As specified in Section 01 78 00 CLOSEOUT SUBMITTALS. After installation of the carpet, remove debris, scraps, and other foreign matter. Remove soiled spots and adhesive from the face of the carpet with appropriate spot remover. Cut off and remove protruding face yarn. Vacuum carpet clean with a high-efficiency particulate air (HEPA) filtration vacuum.

3.5.2 Protection

Protect the installed carpet from soiling and damage with heavy, reinforced, nonstaining kraft paper, plywood, or hardboard sheets. Lap and secure edges of kraft paper protection to provide a continuous cover. Restrict traffic for at least 48 hours. Remove protective covering when directed by the Contracting Officer.

3.6 REMNANTS

Manage waste as specified in the Waste Management Plan.

3.7 MAINTENANCE

3.7.1 Extra Materials

Provide extra material from same dye lot consisting of uncut carpet tiles for future maintenance. Provide a minimum of three percent of total square yards of each carpet type, pattern, and color.

-- End of Section --

SECTION 09 84 20

ACOUSTICAL WALL PANELS
08/16, CHG 1: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF TEXTILE CHEMISTS AND COLORISTS (AATCC)

AATCC 16	(2004; E 2008; E 2010) Colorfastness to Light

ASTM INTERNATIONAL (ASTM)

ASTM C423	(2009a) Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method
ASTM D5034	(2009; R 2017) Standard Test Method for Breaking Strength and Elongation of Textile Fabrics (Grab Test)
ASTM E84	(2020) Standard Test Method for Surface Burning Characteristics of Building Materials

CALIFORNIA AIR RESOURCES BOARD (CARB)

CARB 93120	(2007) Airborne Toxic Control Measure (ATCM) to Reduce Formaldehyde Emissions from Composite Wood Products

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2010; Version 1.1) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Approved Detail Drawings; G

SD-03 Product Data

Installation

Acoustical Wall Panels; G

Recycled Content for Wood Panels; S

Recycled Content for Fabric Panels; S

Indoor Air Quality for Composite Wood and Agrifiber Products; S

SD-04 Samples

Acoustical Wall Panels; G

SD-07 Certificates

Acoustical Wall Panels

Certified Sustainably Harvested Wood; S

SD-11 Closeout Submittals

Warranty

1.3 DELIVERY, STORAGE, AND HANDLING

Protect materials delivered and placed in storage from the weather, humidity and temperature variations, dirt, dust, or other contaminants.

1.4 WARRANTY

Provide manufacturer's standard performance guarantees or warranties that extend beyond a one year period.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

2.1.1 Design

Provide fabric wrapped mineral / glass-fiber core acoustical wall panel materials in the manufacturer's standard sizes and finishes of the type, design and configuration indicated.

2.1.1.1 Fabric Recycled Content

Fabric Panels must contain a minimum of 50 percent recycled conten. Provide data identifying percentage of recycled content for fabric panels.

Composite wood and agrifiber products must contain no added urea-formaldehyde resins. Products containing composite wood and agrifiber components must meet emissions requirements of either CARB 93120 or CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type). Provide validation of indoor air quality for composite wood and agrifiber products.

2.2 FABRIC COVERED ACOUSTICAL WALL PANELS

Provide acoustical wall panels consisting of prefinished, factory assembled, seamless fabric covered, fiber glass or mineral fiber core system as described below manufactured to the dimensions and configurations shown on the approved detail drawings; submit drawings showing plan locations, elevations and details of method of anchorage, location of doors and other openings, base detail and shape and thickness of materials. Perimeter edges must be non-reinforced. Submit manufacturer's descriptive data and catalog cuts; fabric and vinyl swatches, minimum 18 inches wide by 24 inches long 3 samples of each color range specified; and certificates of compliance from an independent laboratory accredited by the National Laboratory Accreditation Program of the National Institute of Standards. A label or listing from the testing laboratory will be acceptable evidence of compliance. Wall panels must conform to the following:
Basis of Design: Guilford of Maine, 2335 Ancorage/Color: 2017 Slate

2.2.1 Panel Width

Widths must be 36 inches. End panels may vary in width as necessary to cover wall. Panel width must be as detailed.

2.2.2 Panel Height

Heights must be 36 inches. Panel height must be as detailed.

2.2.3 Thickness

1" Nominal.

2.2.4 Fabric Covering

Seamless non-woven, embossed texture, needle punched 100 percent polyester, minimum 11 ounces/linear yard. Tear strength a minimum 25 pounds machine direction and minimum 40 pounds cross-machine direction. Tensile strength a minimum 50 pounds machine direction and minimum 75 pounds cross-machine direction in accordance with ASTM D5034. Stretch fabric covering free of wrinkles and then bond to the edges and back or bond directly to the panel face, edges, and back of panel a minimum distance standard with the manufacturer. Light fastness (fadeometer) approximately 40 hours in accordance with AATCC 16.

2.2.5 Fire Rating for the Complete Composite System

Class A, 200 or less smoke density and flame spread less than 25, when tested in accordance with ASTM E84.

2.2.6 Substrate

Fiber glass or mineral fiber

2.2.7 Noise Reduction Coefficient (NRC) Range

0.80-0.90 ASTM C423

2.2.8 Edge Detail

Beveled edge with fabric wrapped on all four sides.

2.2.9 Core Type

Acoustical/tackable core

2.2.10 Mounting Acoustical Panels

Mount acoustical panels by manufacturer's standard concealed spline.

2.3 COLOR

In accordance with Section 09 06 00 SCHEDULES FOR FINISHES. Color listed is not intended to limit the selection of equal colors from other manufacturers.
Basis of Design: Guilford of Maine - 2335 Anchorage/Color: 2017 Slate

PART 3 EXECUTION

3.1 SURFACE CONDITIONS

Shall be clean, smooth, oil free and prepared in accordance with panel manufacturer's instructions. Do not begin installation until all wet work, such as, plastering, painting, and concrete are completely dry.

3.2 INSTALLATION

Panel installation must be by personnel familiar with and normally engaged in installation of acoustical wall panels. Apply panels in accordance with the manufacturer's installation instructions. Submit manufacturer's installation instructions and recommended cleaning instructions.

3.3 CLEANING

Following installation, clean dirty or stained panel surfaces in accordance with manufacturer's instructions and leave free from defects. Remove and replace panels that are damaged, discolored, or improperly installed.

-- End of Section --

SECTION 09 90 00

PAINTS AND COATINGS
05/11

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN CONFERENCE OF GOVERNMENTAL INDUSTRIAL HYGIENISTS (ACGIH)

ACGIH 0100	(2001; Supplements 2002-2008) Documentation of the Threshold Limit Values and Biological Exposure Indices

ASME INTERNATIONAL (ASME)

ASME A13.1	(2007; R 2013) Scheme for the Identification of Piping Systems

ASTM INTERNATIONAL (ASTM)

ASTM D235	(2002; R 2012) Mineral Spirits (Petroleum Spirits) (Hydrocarbon Dry Cleaning Solvent)
ASTM D4214	(2007; R 2015) Standard Test Method for Evaluating the Degree of Chalking of Exterior Paint Films
ASTM D4263	(1983; R 2012) Indicating Moisture in Concrete by the Plastic Sheet Method
ASTM D4444	(2013) Use and Calibration of Hand-Held Moisture Meters
ASTM D523	(2014) Standard Test Method for Specular Gloss
ASTM D6386	(2010) Standard Practice for Preparation of Zinc (Hot-Dip Galvanized) Coated Iron and Steel Product and Hardware Surfaces for Painting

MASTER PAINTERS INSTITUTE (MPI)

MPI 107	(Oct 2009) Rust Inhibitive Primer (Water-Based)
MPI 11	(Oct 2009) Exterior Latex, Semi-Gloss, MPI Gloss Level 5
MPI 134	(Oct 2009) Galvanized Primer (Waterbased)
MPI 141	(Oct 2009) Interior High Performance Latex

	MPI Gloss Level 5
MPI 145	(Oct 2009) Institutional Low Odor / VOC Interior Latex, MPI Gloss Level 3
MPI 161	(Oct 2009) Exterior W.B. Light Industrial Coating, MPI Gloss Level 3
MPI 163	(Oct 2009) Exterior W.B. Light Industrial Coating, Semi-Gloss, MPI Gloss Level 5
MPI 21	(Oct 2009) Heat Resistant Enamel, Gloss (up to 205 degrees C and 400 degrees F), MPI Gloss Level 6
MPI 23	(Oct 2009) Surface Tolerant Metal Primer
MPI 26	(Oct 2009) Cementitious Galvanized Metal Primer
MPI 47	(Oct 2009) Interior Alkyd, Semi-Gloss, MPI Gloss Level 5
MPI 50	(Oct 2009) Interior Latex Primer Sealer
MPI 52	(Oct 2009) Interior Latex, MPI Gloss Level 3
MPI 79	(Oct 2009) Alkyd Anti-Corrosive Metal Primer
MPI 94	(Oct 2009) Exterior Alkyd, Semi-Gloss, MPI Gloss Level 5
MPI 95	(Oct 2009) Quick Drying Primer for Aluminum

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS SP-01	(2000) Environmentally Preferable Product Specification for Architectural and Anti-Corrosive Paints

THE SOCIETY FOR PROTECTIVE COATINGS (SSPC)

SSPC PA 1	(2000; E 2004) Shop, Field, and Maintenance Painting of Steel
SSPC PA Guide 3	(1982; E 1995) A Guide to Safety in Paint Application
SSPC SP 1	(2015) Solvent Cleaning
SSPC SP 10/NACE No. 2	(2007) Near-White Blast Cleaning
SSPC SP 12/NACE No.5	(2002) Surface Preparation and Cleaning of Metals by Waterjetting Prior to Recoating
SSPC SP 2	(1982; E 2000; E 2004) Hand Tool Cleaning

SSPC SP 3	(1982; E 2004) Power Tool Cleaning
SSPC SP 6/NACE No.3	(2007) Commercial Blast Cleaning
SSPC VIS 3	(2004) Guide and Reference Photographs for Steel Surfaces Prepared by Hand and Power Tool Cleaning

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 385-1-1	(2014) Safety and Health Requirements Manual

U.S. DEPARTMENT OF DEFENSE (DOD)

MIL-STD-101	(2014; Rev C) Color Code for Pipelines and for Compressed Gas Cylinders

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.1000	Air Contaminants

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. The following shall be submitted in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

The current MPI, "Approved Product List" which lists paint by brand, label, product name and product code as of the date of contract award, will be used to determine compliance with the submittal requirements of this specification. The Contractor may choose to use a subsequent MPI "Approved Product List", however, only one list may be used for the entire contract and each coating system is to be from a single manufacturer. All coats on a particular substrate must be from a single manufacturer. No variation from the MPI Approved Products List is acceptable.

Samples of specified materials may be taken and tested for compliance with specification requirements.

In keeping with the intent of Executive Order 13101, "Greening the Government through Waste Prevention, Recycling, and Federal Acquisition", products certified by SCS as meeting SCS SP-01 shall be given preferential consideration over registered products. Products that are registered shall be given preferential consideration over products not carrying any EPP designation.

SD-02 Shop Drawings

Piping identification

Submit color stencil codes

SD-03 Product Data

Environmental Data

Materials

Submit documentation indicating percentage of post-industrial and post-consumer recycled content per unit of product. Indicate relative dollar value of recycled content products to total dollar value of products included in project.

Coating

Manufacturer's Technical Data Sheets

Indicate VOC content.

Sealant

1.3 QUALITY ASSURANCE

1.3.1 Field Samples and Tests

The Contracting Officer may choose up to two coatings that have been delivered to the site to be tested at no cost to the Government. Take samples of each chosen product as specified in the paragraph "Sampling Procedures." Test each chosen product as specified in the paragraph "Testing Procedure." Products which do not conform, shall be removed from the job site and replaced with new products that conform to the referenced specification. Testing of replacement products that failed initial testing shall be at no cost to the Government.

Another required testing is Batch Quality Conformance Testing to prove conformance of the manufacturer's paint to the specified MPI standard. This testing is accomplished before the materials are delivered to the job site. Provide testing for paint products. Test paint products as specified in the paragraph "Testing Procedure".

1.3.1.1 Sampling Procedure

The Contracting Officer will select paint at random from the products that have been delivered to the job site for sample testing. The Contractor shall provide one quart samples of the selected paint materials. The samples shall be taken in the presence of the Contracting Officer, and labeled, identifying each sample. Provide labels in accordance with the paragraph "Packaging, Labeling, and Storage" of this specification.

1.3.1.2 Testing Procedure

Provide Batch Quality Conformance Testing for specified products, as defined by and performed by MPI. As an alternative to Batch Quality Conformance Testing, the Contractor may provide Qualification Testing for specified products above to the appropriate MPI product specification, using the third-party laboratory approved under the paragraph "Qualification Testing" laboratory for coatings. The qualification testing lab report shall include the backup data and summary of the test results. The summary shall list all of the reference specification requirements and the result of each test. The summary shall clearly indicate whether the tested paint meets each test requirement. Note that Qualification Testing may take 4 to 6 weeks to perform, due to the extent

of testing required.

Submit name, address, telephone number, FAX number, and e-mail address of the independent third party laboratory selected to perform testing of coating samples for compliance with specification requirements. Submit documentation that laboratory is regularly engaged in testing of paint samples for conformance with specifications, and that employees performing testing are qualified. If the Contractor chooses MPI to perform the Batch Quality Conformance testing, the above submittal information is not required, only a letter is required from the Contractor stating that MPI will perform the testing.

1.4 REGULATORY REQUIREMENTS

1.4.1 Environmental Protection

In addition to requirements specified elsewhere for environmental protection, provide coating materials that conform to the restrictions of the local Air Pollution Control District and regional jurisdiction. Notify Contracting Officer of any paint specified herein which fails to conform.

1.4.2 Lead Content

Do not use coatings having a lead content over 0.06 percent by weight of nonvolatile content.

1.4.3 Chromate Content

Do not use coatings containing zinc-chromate or strontium-chromate.

1.4.4 Asbestos Content

Materials shall not contain asbestos.

1.4.5 Mercury Content

Materials shall not contain mercury or mercury compounds.

1.4.6 Silica

Abrasive blast media shall not contain free crystalline silica.

1.4.7 Human Carcinogens

Materials shall not contain ACGIH 0100 confirmed human carcinogens (A1) or suspected human carcinogens (A2).

1.5 PACKAGING, LABELING, AND STORAGE

Paints shall be in sealed containers that legibly show the contract specification number, designation name, formula or specification number, batch number, color, quantity, date of manufacture, manufacturer's formulation number, manufacturer's directions including any warnings and special precautions, and name and address of manufacturer. Pigmented paints shall be furnished in containers not larger than 5 gallons. Paints and thinners shall be stored in accordance with the manufacturer's written directions, and as a minimum, stored off the ground, under cover, with sufficient ventilation to prevent the buildup of flammable vapors, and at

temperatures between 40 to 95 degrees F. Do not store paint, polyurethane, varnish, or wood stain products with materials that have a high capacity to adsorb VOC emissions. Do not store paint, polyurethane, varnish, or wood stain products in occupied spaces.

1.6 SAFETY AND HEALTH

Apply coating materials using safety methods and equipment in accordance with the following:

Work shall comply with applicable Federal, State, and local laws and regulations, and with the ACCIDENT PREVENTION PLAN, including the Activity Hazard Analysis as specified in Section 01 35 26 GOVERNMENT SAFETY REQUIREMENTS and in Appendix A of EM 385-1-1. The Activity Hazard Analysis shall include analyses of the potential impact of painting operations on painting personnel and on others involved in and adjacent to the work zone.

1.6.1 Safety Methods Used During Coating Application

Comply with the requirements of SSPC PA Guide 3.

1.6.2 Toxic Materials

To protect personnel from overexposure to toxic materials, conform to the most stringent guidance of:

a. The applicable manufacturer's Material Safety Data Sheets (MSDS) or local regulation.

b. 29 CFR 1910.1000.

c. ACGIH 0100, threshold limit values.

1.7 ENVIRONMENTAL CONDITIONS

Comply, at minimum, with manufacturer recommendations for space ventilation during and after installation. Isolate area of application from rest of building when applying high-emission paints or coatings.

1.7.1 Coatings

Do not apply coating when air or substrate conditions are:

a. Less than 5 degrees F above dew point;

b. Below 50 degrees F or over 95 degrees F, unless specifically pre-approved by the Contracting Officer and the product manufacturer. Under no circumstances shall application conditions exceed manufacturer recommendations.

1.7.2 Post-Application

Vacate space for as long as possible after application. Wait a minimum of 48 hours before occupying freshly painted rooms. Maintain one of the following ventilation conditions during the curing period, or for 72 hours after application:

a. Supply 100 percent outside air 24 hours a day.

b. Supply airflow at a rate of 6 air changes per hour, when outside temperatures are between 55 degrees F and 85 degrees F and humidity is between 30 percent and 60 percent.

c. Supply airflow at a rate of 1.5 air changes per hour, when outside air conditions are not within the range stipulated above.

1.8 SCHEDULING

Allow paint, polyurethane, varnish, and wood stain installations to cure prior to the installation of materials that adsorb VOCs.

1.9 COLOR SELECTION

Colors of finish coats shall be as indicated or specified. Where not indicated or specified, colors shall be selected by the Contracting Officer. Manufacturers' names and color identification are used for the purpose of color identification only. Named products are acceptable for use only if they conform to specified requirements. Products of other manufacturers are acceptable if the colors approximate colors indicated and the product conforms to specified requirements.

Tint each coat progressively darker to enable confirmation of the number of coats.

Color, texture, and pattern of wall coating systems shall be as indicated on drawings.

1.10 LOCATION AND SURFACE TYPE TO BE PAINTED

1.10.1 Painting Included

Where a space or surface is indicated to be painted, include the following unless indicated otherwise.

a. Surfaces behind portable objects and surface mounted articles readily detachable by removal of fasteners, such as screws and bolts.

b. New factory finished surfaces that require identification or color coding and factory finished surfaces that are damaged during performance of the work.

c. Existing coated surfaces that are damaged during performance of the work.

1.10.1.1 Exterior Painting

Includes new surfaces of the building and appurtenances. Also included are existing surfaces .Damaged During Construction.

1.10.1.2 Interior Painting

Includes new surfaces of the building and appurtenances as indicated and existing coated surfaces made bare by cleaning operations. Where a space or surface is indicated to be painted, include the following items, unless indicated otherwise.

a. Exposed columns, girders, beams, joists, and metal deck; and

b. Other contiguous surfaces.

1.10.2 Painting Excluded

Do not paint the following unless indicated otherwise.

a. Surfaces concealed and made inaccessible by panelboards, fixed ductwork, machinery, and equipment fixed in place.

b. Surfaces in concealed spaces. Concealed spaces are defined as enclosed spaces above suspended ceilings, furred spaces, attic spaces, crawl spaces, elevator shafts and chases. Note that secure areas require scheduled finishes continuous to roof above suspended ceilings.

c. Steel to be embedded in concrete.

d. Copper, stainless steel, aluminum, brass, and lead except existing coated surfaces.

e. Hardware, fittings, and other factory finished items.

1.10.3 Mechanical and Electrical Painting

Includes field coating of interior and exterior new surfaces.

a. Where a space or surface is indicated to be painted, include the following items unless indicated otherwise.

(1) Exposed piping, conduit, and ductwork;

(2) Supports, hangers, air grilles, and registers;

(3) Miscellaneous metalwork and insulation coverings.

b. Do not paint the following, unless indicated otherwise:

(1) New zinc-coated, aluminum, and copper surfaces under insulation

(2) New aluminum jacket on piping

(3) New interior ferrous piping under insulation.

1.10.4 Definitions and Abbreviations

1.10.4.1 Qualification Testing

Qualification testing is the performance of all test requirements listed in the product specification. This testing is accomplished by MPI to qualify each product for the MPI Approved Product List, and may also be accomplished by Contractor's third party testing lab if an alternative to Batch Quality Conformance Testing by MPI is desired.

1.10.4.2 Batch Quality Conformance Testing

Batch quality conformance testing determines that the product provided is the same as the product qualified to the appropriate product specification. This testing shall only be accomplished by MPI testing lab.

1.10.4.3 Coating

A film or thin layer applied to a base material called a substrate. A coating may be a metal, alloy, paint, or solid/liquid suspensions on various substrates (metals, plastics, wood, paper, leather, cloth, etc.). They may be applied by electrolysis, vapor deposition, vacuum, or mechanical means such as brushing, spraying, calendaring, and roller coating. A coating may be applied for aesthetic or protective purposes or both. The term "coating" as used herein includes emulsions, enamels, stains, varnishes, sealers, epoxies, and other coatings, whether used as primer, intermediate, or finish coat. The terms paint and coating are used interchangeably.

1.10.4.4 DFT or dft

Dry film thickness, the film thickness of the fully cured, dry paint or coating.

1.10.4.5 DSD

Degree of Surface Degradation, the MPI system of defining degree of surface degradation. Five (5) levels are generically defined under the Assessment sections in the MPI Maintenance Repainting Manual.

1.10.4.6 EPP

Environmentally Preferred Products, a standard for determining environmental preferability in support of Executive Order 13101.

1.10.4.7 EXT

MPI short term designation for an exterior coating system.

1.10.4.8 INT

MPI short term designation for an interior coating system.

1.10.4.9 micron / microns

The metric measurement for 0.001 mm or one/one-thousandth of a millimeter.

1.10.4.10 mil / mils

The English measurement for 0.001 in or one/one-thousandth of an inch, equal to 25.4 microns or 0.0254 mm.

1.10.4.11 mm

The metric measurement for millimeter, 0.001 meter or one/one-thousandth of a meter.

1.10.4.12 MPI Gloss Levels

MPI system of defining gloss. Seven (7) gloss levels (G1 to G7) are generically defined under the Evaluation sections of the MPI Manuals. Traditionally, Flat refers to G1/G2, Eggshell refers to G3, Semigloss refers to G5, and Gloss refers to G6.

Gloss levels are defined by MPI as follows:

Gloss Level	Description	Units at 60 degrees	Units at 85 degrees
G1	Matte or Flat	0 to 5	10 max
G2	Velvet	0 to 10	10 to 35
G3	Eggshell	10 to 25	10 to 35
G4	Satin	20 to 35	35 min
G5	Semi-Gloss	35 to 70	
G6	Gloss	70 to 85	
G7	High Gloss		

Gloss is tested in accordance with ASTM D523. Historically, the Government has used Flat (G1 / G2), Eggshell (G3), Semi-Gloss (G5), and Gloss (G6).

1.10.4.13 MPI System Number

The MPI coating system number in each Division found in either the MPI Architectural Painting Specification Manual or the Maintenance Repainting Manual and defined as an exterior (EXT/REX) or interior system (INT/RIN). The Division number follows the CSI Master Format.

1.10.4.14 Paint

See Coating definition.

1.10.4.15 REX

MPI short term designation for an exterior coating system used in repainting projects or over existing coating systems.

1.10.4.16 RIN

MPI short term designation for an interior coating system used in repainting projects or over existing coating systems.

PART 2 PRODUCTS

2.1 MATERIALS

Conform to the coating specifications and standards referenced in PART 3. Submit manufacturer's technical data sheets for specified coatings and solvents. Comply with applicable regulations regarding toxic and hazardous materials. Paint systems including primers shall be low emitting products with green seal certification.

PART 3 EXECUTION

3.1 PROTECTION OF AREAS AND SPACES NOT TO BE PAINTED

Prior to surface preparation and coating applications, remove, mask, or otherwise protect, hardware, hardware accessories, machined surfaces, radiator covers, plates, lighting fixtures, public and private property, and other such items not to be coated that are in contact with surfaces to be coated. Following completion of painting, workmen skilled in the trades involved shall reinstall removed items. Restore surfaces contaminated by coating materials, to original condition and repair damaged items.

3.2 RESEALING OF EXISTING EXTERIOR JOINTS

3.2.1 Surface Condition

Surfaces shall be clean, dry to the touch, and free from frost and moisture; remove grease, oil, wax, lacquer, paint, defective backstop, or other foreign matter that would prevent or impair adhesion. Where adequate grooves have not been provided, clean out to a depth of 1/2 inch and grind to a minimum width of 1/4 inch without damage to adjoining work. Grinding shall not be required on metal surfaces.

3.2.2 Backstops

In joints more than 1/2 inch deep, install glass fiber roving or neoprene, butyl, polyurethane, or polyethylene foams free of oil or other staining elements as recommended by sealant manufacturer. Backstop material shall be compatible with sealant. Do not use oakum and other types of absorptive materials as backstops.

3.2.3 Primer and Bond Breaker

Install the type recommended by the sealant manufacturer.

3.2.4 Ambient Temperature

Between 38 degrees F and 95 degrees F when applying sealant.

3.2.5 Exterior Sealant

For joints in vertical surfaces, provide ASTM C920, Type S or M, Grade NS, Class 25, Use NT. For joints in horizontal surfaces, provide ASTM C920, Type S or M, Grade P, Class 25, Use T. Color(s) shall be selected by the Contracting Officer. Apply the sealant in accordance with the manufacturer's printed instructions. Force sealant into joints with sufficient pressure to fill the joints solidly. Sealant shall be uniformly smooth and free of wrinkles.3.2.6 Cleaning

Immediately remove fresh sealant from adjacent areas using a solvent recommended by the sealant manufacturer. Upon completion of sealant application, remove remaining smears and stains and leave the work in a clean condition. Allow sealant time to cure, in accordance with manufacturer's recommendations, prior to coating.3.3 SURFACE PREPARATION

Remove dirt, splinters, loose particles, grease, oil, and other foreign matter and substances deleterious to coating performance as specified for each substrate before application of paint or surface treatments. Oil and grease shall be removed prior to mechanical cleaning. Cleaning shall be programmed so that dust and other contaminants will not fall on wet, newly painted surfaces. Exposed ferrous metals such as nail heads on or in contact with surfaces to be painted with water-thinned paints, shall be spot-primed with a suitable corrosion-inhibitive primer capable of preventing flash rusting and compatible with the coating specified for the adjacent areas.

3.3.1 Additional Requirements for Preparation of Surfaces With Existing Coatings

Before application of coatings, perform the following on surfaces covered

by soundly-adhered coatings, defined as those which cannot be removed with a putty knife:

a. Test existing finishes for lead before sanding, scraping, or removing. If lead is present, refer to paragraph Toxic Materials.

b. Wipe previously painted surfaces to receive solvent-based coatings, except stucco and similarly rough surfaces clean with a clean, dry cloth saturated with mineral spirits, ASTM D235. Allow surface to dry. Wiping shall immediately precede the application of the first coat of any coating, unless specified otherwise.

c. Sand existing glossy surfaces to be painted to reduce gloss. Brush, and wipe clean with a damp cloth to remove dust.

d. The requirements specified are minimum. Comply also with the application instructions of the paint manufacturer.

e. Previously painted surfaces damaged during construction shall be thoroughly cleaned of all grease, dirt, dust or other foreign matter.

f. Blistering, cracking, flaking and peeling or other deteriorated coatings shall be removed.

g. Chalk shall be removed so that when tested in accordance with ASTM D4214, the chalk resistance rating is no less than 8.

h. Slick surfaces shall be roughened. Damaged areas such as, but not limited to, nail holes, cracks, chips, and spalls shall be repaired with suitable material to match adjacent undamaged areas.

i. Edges of chipped paint shall be feather edged and sanded smooth.

j. Rusty metal surfaces shall be cleaned as per SSPC requirements. Solvent, mechanical, or chemical cleaning methods shall be used to provide surfaces suitable for painting.

k. New, proposed coatings shall be compatible with existing coatings.

3.3.2 Existing Coated Surfaces with Minor Defects

Sand, spackle, and treat minor defects to render them smooth. Minor defects are defined as scratches, nicks, cracks, gouges, spalls, alligatoring, chalking, and irregularities due to partial peeling of previous coatings. Remove chalking by sanding so that when tested in accordance with ASTM D4214, the chalk rating is not less than 8.

3.3.3 Removal of Existing Coatings

Remove existing coatings from the following surfaces:

a. Surfaces containing large areas of minor defects;

b. Surfaces containing more than 20 percent peeling area; and

c. Surfaces designated by the Contracting Officer, such as surfaces where rust shows through existing coatings.

3.3.4 Substrate Repair

a. Repair substrate surface damaged during coating removal;

b. Sand edges of adjacent soundly-adhered existing coatings so they are tapered as smooth as practical to areas involved with coating removal; and

c. Clean and prime the substrate as specified.

3.4 PREPARATION OF METAL SURFACES

3.4.1 Existing and New Ferrous Surfaces

a. Ferrous Surfaces including Shop-coated Surfaces and Small Areas That Contain Rust, Mill Scale and Other Foreign Substances: Solvent clean or detergent wash in accordance with SSPC SP 1 to remove oil and grease. Where shop coat is missing or damaged, clean according to SSPC SP 2, SSPC SP 3, SSPC SP 6/NACE No.3, or SSPC SP 10/NACE No. 2. Use inhibitor as recommended by coating manufacturer to prevent premature rusting. Shop-coated ferrous surfaces shall be protected from corrosion by treating and touching up corroded areas immediately upon detection.

3.4.2 Final Ferrous Surface Condition:

For tool cleaned surfaces, the requirements are stated in SSPC SP 2 and SSPC SP 3. As a visual reference, cleaned surfaces shall be similar to photographs in SSPC VIS 3.

3.4.3 Galvanized Surfaces

a. New or Existing Galvanized Surfaces With Only Dirt and Zinc Oxidation Products: Clean with solvent, or non-alkaline detergent solution in accordance with SSPC SP 1. If the galvanized metal has been passivated or stabilized, the coating shall be completely removed by brush-off abrasive blast. New galvanized steel to be coated shall not be "passivated" or "stabilized" If the absence of hexavalent stain inhibitors is not documented, test as described in ASTM D6386, Appendix X2, and remove by one of the methods described therein.

b. Galvanized with Slight Coating Deterioration or with Little or No Rusting: Water jetting to SSPC SP 12/NACE No.5 WJ3 to remove loose coating from surfaces with less than 20 percent coating deterioration and no blistering, peeling, or cracking. Use inhibitor as recommended by the coating manufacturer to prevent rusting.

3.4.4 Non-Ferrous Metallic Surfaces

Aluminum and aluminum-alloy, lead, copper, and other nonferrous metal surfaces.

Surface Cleaning: Solvent clean in accordance with SSPC SP 1 and wash with mild non-alkaline detergent to remove dirt and water soluble contaminants.

3.4.5 Existing Surfaces with a Bituminous or Mastic-Type Coating

Remove chalk, mildew, and other loose material by washing with a solution

of 1/2 cup trisodium phosphate, 1/4 cup household detergent, one quart 5 percent sodium hypochlorite solution and 3 quarts of warm water.

3.5 PREPARATION OF CONCRETE AND CEMENTITIOUS SURFACE

3.5.1 Gypsum Board, Plaster, and Stucco

a. Surface Cleaning: Plaster and stucco shall be clean and free from loose matter; gypsum board shall be dry. Remove loose dirt and dust by brushing with a soft brush, rubbing with a dry cloth, or vacuum-cleaning prior to application of the first coat material. A damp cloth or sponge may be used if paint will be water-based.

b. Repair of Minor Defects: Prior to painting, repair joints, cracks, holes, surface irregularities, and other minor defects with patching plaster or spackling compound and sand smooth.

c. Allowable Moisture Content: Latex coatings may be applied to damp surfaces, but not surfaces with droplets of water. Do not apply epoxies to damp surfaces as determined by ASTM D4263. New plaster to be coated shall have a maximum moisture content of 8 percent, when measured in accordance with ASTM D4444, Method A, unless otherwise authorized. In addition to moisture content requirements, allow new plaster to age a minimum of 30 days before preparation for painting.

3.6 APPLICATION

3.6.1 Coating Application

Painting practices shall comply with applicable federal, state and local laws enacted to insure compliance with Federal Clean Air Standards. Apply coating materials in accordance with SSPC PA 1. SSPC PA 1 methods are applicable to all substrates, except as modified herein.

At the time of application, paint shall show no signs of deterioration. Uniform suspension of pigments shall be maintained during application.

Unless otherwise specified or recommended by the paint manufacturer, paint may be applied by brush, roller, or spray. Use trigger operated spray nozzles for water hoses. Rollers for applying paints and enamels shall be of a type designed for the coating to be applied and the surface to be coated. Wear protective clothing and respirators when applying oil-based paints or using spray equipment with any paints.

Paints, except water-thinned types, shall be applied only to surfaces that are completely free of moisture as determined by sight or touch.

Thoroughly work coating materials into joints, crevices, and open spaces. Special attention shall be given to insure that all edges, corners, crevices, welds, and rivets receive a film thickness equal to that of adjacent painted surfaces.

Each coat of paint shall be applied so dry film shall be of uniform thickness and free from runs, drops, ridges, waves, pinholes or other voids, laps, brush marks, and variations in color, texture, and finish. Hiding shall be complete.

Touch up damaged coatings before applying subsequent coats. Interior areas shall be broom clean and dust free before and during the application of

coating material.

a. Drying Time: Allow time between coats, as recommended by the coating manufacturer, to permit thorough drying, but not to present topcoat adhesion problems. Provide each coat in specified condition to receive next coat.

b. Primers, and Intermediate Coats: Do not allow primers or intermediate coats to dry more than 30 days, or longer than recommended by manufacturer, before applying subsequent coats. Follow manufacturer's recommendations for surface preparation if primers or intermediate coats are allowed to dry longer than recommended by manufacturers of subsequent coatings. Each coat shall cover surface of preceding coat or surface completely, and there shall be a visually perceptible difference in shades of successive coats.

c. Finished Surfaces: Provide finished surfaces free from runs, drops, ridges, waves, laps, brush marks, and variations in colors.

d. Thermosetting Paints: Topcoats over thermosetting paints (epoxies and urethanes) should be applied within the overcoating window recommended by the manufacturer.

3.6.2 Mixing and Thinning of Paints

Reduce paints to proper consistency by adding fresh paint, except when thinning is mandatory to suit surface, temperature, weather conditions, application methods, or for the type of paint being used. Obtain written permission from the Contracting Officer to use thinners. The written permission shall include quantities and types of thinners to use.

When thinning is allowed, paints shall be thinned immediately prior to application with not more than 1 pint of suitable thinner per gallon. The use of thinner shall not relieve the Contractor from obtaining complete hiding, full film thickness, or required gloss. Thinning shall not cause the paint to exceed limits on volatile organic compounds. Paints of different manufacturers shall not be mixed.

3.6.3 Two-Component Systems

Two-component systems shall be mixed in accordance with manufacturer's instructions. Any thinning of the first coat to ensure proper penetration and sealing shall be as recommended by the manufacturer for each type of substrate.

3.6.4 Coating Systems

a. Systems by Substrates: Apply coatings that conform to the respective specifications listed in the following Tables:

Table

Division 5. Exterior Metal, Ferrous and Non-Ferrous Paint Table

Division 5. Interior Metal, Ferrous and Non-Ferrous Paint Table

Table
Division 9: Interior Plaster, Gypsum Board, Textured Surfaces
Paint Table

b. Minimum Dry Film Thickness (DFT): Apply paints, primers, varnishes, enamels, undercoats, and other coatings to a minimum dry film thickness of 1.5 mil each coat unless specified otherwise in the Tables. Coating thickness where specified, refers to the minimum dry film thickness.

c. Coatings for Surfaces Not Specified Otherwise: Coat surfaces which have not been specified, the same as surfaces having similar conditions of exposure.

d. Existing Surfaces Damaged During Performance of the Work, Including New Patches In Existing Surfaces: Coat surfaces with the following:

(1) One coat of primer.

(2) One coat of undercoat or intermediate coat.

(3) One topcoat to match adjacent surfaces.

e. Existing Coated Surfaces To Be Painted: Apply coatings conforming to the respective specifications listed in the Tables herein, except that pretreatments, sealers and fillers need not be provided on surfaces where existing coatings are soundly adhered and in good condition. Do not omit undercoats or primers.

3.7 COATING SYSTEMS FOR METAL

Apply coatings of Tables in Division 5 for Exterior and Interior.

a. Apply specified ferrous metal primer on the same day that surface is cleaned, to surfaces that meet all specified surface preparation requirements at time of application.

b. Inaccessible Surfaces: Prior to erection, use one coat of specified primer on metal surfaces that will be inaccessible after erection.

c. Shop-primed Surfaces: Touch up exposed substrates and damaged coatings to protect from rusting prior to applying field primer.

d. Surface Previously Coated with Epoxy or Urethane: Apply MPI 101, 1.5 mils DFT immediately prior to application of epoxy or urethane coatings.

e. Pipes and Tubing: The semitransparent film applied to some pipes and tubing at the mill is not to be considered a shop coat, but shall be overcoated with the specified ferrous-metal primer prior to application of finish coats.

f. Exposed Nails, Screws, Fasteners, and Miscellaneous Ferrous Surfaces. On surfaces to be coated with water thinned coatings, spot prime exposed nails and other ferrous metal with latex primer MPI 107.

3.8 COATING SYSTEMS FOR CONCRETE AND CEMENTITIOUS SUBSTRATES

Apply coatings of Tables in Division 9 for Interior.

3.9 PIPING IDENTIFICATION

Piping Identification, Including Surfaces In Concealed Spaces: Provide in accordance with MIL-STD-101ASME A13.1. Place stenciling in clearly visible locations. On piping not covered by MIL-STD-101ASME A13.1, stencil approved names or code letters, in letters a minimum of 1/2 inch high for piping and a minimum of 2 inches high elsewhere. Stencil arrow-shaped markings on piping to indicate direction of flow using black stencil paint.

3.10 INSPECTION AND ACCEPTANCE

In addition to meeting previously specified requirements, demonstrate mobility of moving components, including swinging and sliding doors, cabinets, and windows with operable sash, for inspection by the Contracting Officer. Perform this demonstration after appropriate curing and drying times of coatings have elapsed and prior to invoicing for final payment.

3.11 WASTE MANAGEMENT

As specified in the Waste Management Plan and as follows. Do not use kerosene or any such organic solvents to clean up water based paints. Properly dispose of paints or solvents in designated containers. Close and seal partially used containers of paint to maintain quality as necessary for reuse. Store in protected, well-ventilated, fire-safe area at moderate temperature. Place materials defined as hazardous or toxic waste in designated containers. Coordinate with manufacturer for take-back program. Set aside scrap to be returned to manufacturer for recycling into new product. When such a service is not available, local recyclers shall be sought after to reclaim the materials. Where local options exist for leftover paint recycling, collect all waste paint by type and provide for delivery to recycling or collection facility for reuse by local organizations.

3.12 PAINT TABLES

All DFT's are minimum values. Acceptable products are listed in the MPI Green Approved Products List, available at http://www.specifygreen.com/APL/ProductIdxByMPInum.asp.

3.12.1 EXTERIOR PAINT TABLES

A.

DIVISION 5: EXTERIOR METAL, FERROUS AND NON-FERROUS PAINT TABLE

STEEL / FERROUS SURFACES

A. New Steel that has been hand or power tool cleaned to SSPC SP 2 or SSPC SP 3

1. Alkyd

STEEL / FERROUS SURFACES
New; MPI EXT 5.1Q-G5 (Semigloss) Existing; MPI REX 5.1D-G5

Primer:	Intermediate:	Topcoat:
MPI 23	MPI 94	MPI 94

System DFT: 5.25 mils

B. New Steel that has been blast-cleaned to SSPC SP 6/NACE No.3:

1. Alkyd
New; MPI EXT 5.1D-G5 (Semigloss) / Existing; MPI REX 5.1D-G5

Primer:	Intermediate:	Topcoat:
MPI 79	MPI 94	MPI 94

System DFT: 5.25 mils

EXTERIOR GALVANIZED SURFACES

A. New Galvanized surfaces:

1. MPI EXT 5.3A-G5 (Semigloss)

Primer:	Intermediate:	Topcoat:
MPI 26	MPI 11	MPI 11

System DFT: 4.5 mils

B. Galvanized surfaces with slight coating deterioration; little or no rusting:

1. Waterborne Light Industrial Coating
MPI REX 5.3J-G5 (Semigloss)

Primer:	Intermediate:	Topcoat:
MPI 134	N/A	MPI 163

System DFT: 4.5 mils

EXTERIOR SURFACES, OTHER METALS (NON-FERROUS)

A. Aluminum, aluminum alloy and other miscellaneous non-ferrous metal items not otherwise specified except hot metal surfaces, roof surfaces, and new prefinished equipment. Match surrounding finish:

1. Alkyd
MPI EXT 5.4F-G5 (Semigloss)

Primer:	Intermediate:	Topcoat:
MPI 95	MPI 94	MPI 94

System DFT: 5 mils

2. Waterborne Light Industrial Coating
MPI EXT 5.4G-G3(Eggshell)

Primer:	Intermediate:	Topcoat:
MPI 95	MPI 161	MPI 161

System DFT: 5 mils

B. Surfaces adjacent to painted surfaces; Mechanical, Electrical, , and miscellaneous metal items not otherwise specified except floors, hot metal surfaces, and new prefinished equipment. Match surrounding finish:

1. Alkyd

EXTERIOR SURFACES, OTHER METALS (NON-FERROUS)
MPI EXT 5.1D-G5 (Semigloss)
Primer: Intermediate: Topcoat:
MPI 79 MPI 94 MPI 94
System DFT: 5.25 mils

2. Waterborne Light Industrial Coating
MPI EXT 5.1C-G5(Semigloss)
Primer: Intermediate: Topcoat:
MPI 79 MPI 163 MPI 163
System DFT: 5 mils

1. Heat Resistant Enamel
MPI EXT 5.2A
Primer: Intermediate: Topcoat:
MPI 21 Surface preparation and number of coats per manufacturer's instructions.
System DFT: Per Manufacturer

A. New stucco, elastomeric system:

.

3.12.2 INTERIOR PAINT TABLES

DIVISION 5: INTERIOR METAL, FERROUS AND NON-FERROUS PAINT TABLE

INTERIOR STEEL / FERROUS SURFACES

A. Metal, Mechanical, Electrical, Fire extinguishing sprinkler systems including valves, conduit, hangers, supports, Surfaces adjacent to painted surfaces (Match surrounding finish), and miscellaneous metal items not otherwise specified except floors, hot metal surfaces, and new prefinished equipment:

1. High Performance Architectural Latex
MPI INT 5.1R-G5 (Semigloss)
Primer: Intermediate: Topcoat:
MPI 79 MPI 141 MPI 141
System DFT: 5 mils

B. Metal in toilets, restrooms, and other high-humidity areas not otherwise specified except floors, hot metal surfaces, and new prefinished equipment:

1. Alkyd (low-odor, low voc)
MPI INT 5.1E-G5 (Semigloss)

INTERIOR STEEL / FERROUS SURFACES

Primer:	Intermediate:	Topcoat:
MPI 79	MPI 47	MPI 47

System DFT: 5.25 mils

DIVISION 9: INTERIOR PLASTER, GYPSUM BOARD, TEXTURED SURFACES PAINT TABLE

A. New Wallboard not otherwise specified:

1. Latex (low-odor/ low voc)

MPI 50	MPI 52	MPI 52

2. Institutional Low Odor / Low VOC Latex
New; MPI INT 9.2M-G3 (Eggshell) / Existing; MPI RIN 9.2M-G3 (Eggshell)

Primer:	Intermediate:	Topcoat:
MPI 50	MPI 145	MPI 145

System DFT: 4 mils

-- End of Section --

SECTION 10 14 00.20

INTERIOR SIGNAGE
08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI Z97.1	(2015) Safety Glazing Materials Used in Buildings - Safety Performance Specifications and Methods of Test

ASTM INTERNATIONAL (ASTM)

ASTM D635	(2018) Standard Test Method for Rate of Burning and/or Extent and Time of Burning of Plastics in a Horizontal Position

INTERNATIONAL CODE COUNCIL (ICC)

ICC/ANSI A117.1	(2009) Accessible and Usable Buildings and Facilities

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 101	(2021) Life Safety Code

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

36 CFR 1191	Americans with Disabilities Act (ADA) Accessibility Guidelines for Buildings and Facilities; Architectural Barriers Act (ABA) Accessibility Guidelines

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Detail Drawings; G

SD-03 Product Data

Room Identification And Directional Signage System; G

Exit Door Tactile Sign; G

SD-04 Samples

Interior Signage; G

Software; G

SD-10 Operation and Maintenance Data

Approved Manufacturer's Instructions; G

Protection and Cleaning; G

1.3 EXTRA MATERIALS

Provide extra stock of the following: changeable message strips for sign type C2. Provide 10 paper inserts and one copy of the software for user produced signs and inserts after project completion and equipment necessary for removal of signage parts and pieces.

1.4 QUALITY ASSURANCE

1.4.1 Samples

Submit interior signage samples of each of the following sign types showing typical quality, workmanship and color: Room Identification. Approved samples may be installed in the work, provided each sample is identified and location recorded.

1.4.2 Detail Drawings

Submit detail drawings showing elevations of each type of sign, dimensions, details and methods of mounting or anchoring, mounting height, shape and thickness of materials, and details of construction. Include a schedule showing the location, each sign type, and message.

1.4.3 Sign Fabricator

Sign Fabricator to follow room number strategies created by designer. The room numbering system to be reviewed and approved by the Contracting Officer and command end users during the shop drawing phase, and prior to fabrication.

1.5 DELIVERY, STORAGE, AND HANDLING

Package materials to prevent damage and deterioration during shipment, handling, storage and installation. Deliver products to the jobsite in manufacturer's original packaging and store in a clean, dry area in accordance with manufacturer's instructions.

1.6 WARRANTY

Provide manufacturer's warranty to repair or replace defective interior signage materials and workmanship for a period of 2 years from date of final acceptance of the work.

PART 2 PRODUCTS

2.1 ROOM IDENTIFICATION AND DIRECTIONAL SIGNAGE SYSTEM SG-1

Provide signs, plaques, directories, and dimensional building letters that are standard products of manufacturers regularly engaged in the manufacture of such products that essentially duplicate signs that have been in satisfactory use at least 2 years prior to bid opening. Obtain signage from a single manufacturer with edges and corners of finished letter forms and graphics true and clean.

2.1.1 Panel Sign Systems

Provide direct print acrylic with applied graphics, sign is fabricated of 0.375 inch acrylic in two layers with smooth edge conforming to ANSI Z97.1 Provide signs that can accept printable message inserts. Provide paper or acetate inserts with a 0.080 inch thick non glare acrylic window to allow sign to be updated.

2.1.2 Standard Room Signs

Provide signs that include tactile letters, symbols and Braille for interior rooms or spaces where the sign is not likely to change over time. Tactile text descriptions are required for pictograms that are provided to identify a permanent room. Examples include interior signs that label restrooms, stairs, room numbers or letters, and room names. These permanent room signs can include paper inserts for updatable information.

2.1.2.1 Tactile Letters, Symbols and Braille

Provide ADA compliant material per 36 CFR 1191 which is raised 1/32 inch from the first surface, has a minimum 5/8 inch in height and is an ADA acceptable font. The color of the tactile letters is required to contrast with the sign face color per ADA standards. The ADA required Braille has a minimum durometer reading of 90. All raised letters, numbers and symbols are to comply.

2.1.3 Directional Signs

Directional signs provide arrows with messages which point to critical destinations such as departments, offices, or other pertinent destinations. These can be a panel sign system with a series of permanently attached messages or a modular system with updatable inserts. Directional signs have header panels with applied or direct print messages.

2.1.4 Message Inserts

Provide updatable message inserts covered with a clear matte 0.015 inch vinyl protective overlay. The insert is typeset message laser printed on paper card stock. Provide two reams of paper and software with message template for creating text and symbols for computers identified for Government production of paper inserts after project completion. Manufacturer is required to offer online ordering capabilities to facilitate and expedite ordering packages of replacement, color-coated paper inserts. Provide sliding inserts that slide horizontally exposing different graphic information as identified on the drawings.

2.1.5 Type of Mounting for Signs

Mount framed plaques with manufacturer's standard (1/6 inch) 1.59 mm thick closed cell vinyl foam with adhesive backing. Adhesive must be transparent, long aging, high tech formulation on two sides of the vinyl foam. Double-faced tape consisting of acrylic adhesive on polyurethane foam used in conjunction with silicone adhesive.

2.1.6 Character Proportions and Heights

Letters and numbers on signs conform to 36 CFR 1191.

2.2 EXIT DOOR TACTILE SIGN

Provide tactile sign with the message EXIT at each exit door that requires an exit sign to conform with NFPA 101. Sign tactile message is to comply with ICC/ANSI A117.1.

2.3 MATERIALS

2.3.1 Fabrication and Manufacture

2.3.1.1 Factory Workmanship

Holes for bolts and screws are drilled or punched. Drilling and punching produces clean, true lines and surfaces. Exposed surfaces of work have a smooth finish; exposed riveting is flush. Conceal fastenings where practicable.

2.3.1.2 Dissimilar Materials

Where dissimilar metals are in contact, protect surfaces prevent galvanic or corrosive action.

2.3.2 Typeface

ADA-ABA compliant font for Room Signs.

2.4 GRAPHICS

Provide signage graphics for modular signs to the following:

2.4.1 Subsurface Copy

Copy is transferred to the back face of clear acrylic sheeting forming the panel face to produce precisely formed opaque image. This method bonds all sign elements (color, graphics, lettering, Braille and substrate) into a single unit.

2.4.2 First Surface Copy Direct Print (Non-Tactile)

Message may be applied to panel using a direct print process. Original art is defined as artwork that is a first generation reproduction of the specified art. Provide clean edges and corners.

2.4.3 Photopolymer

Integral graphics and Braille achieved by photomechanical stratification processes. Provide photopolymer used for ADA compliant graphics of the

type that has a minimum durometer reading of 90. Tactile graphics are raised 1/32 inch from the first surface of plaque by photomechanical stratification process.

2.4.4 Engraved Copy

Machine engrave letters, numbers, symbols, and other graphics into panel sign on face to produce precisely formed copy and sharp images, incised to uniform depth. Melamine plastic engraving stock used for ADA compliant graphic is three-ply lamination contrasting color core meeting ASTM D635.

2.5 COLOR, FINISH, AND CONTRAST

Provide color as specified in Section 09 06 00 SCHEDULES FOR FINISHES; colors listed are not intended to limit the selection of equal colors from other manufacturers. Finish of eggshell, matte, or other non-glare finish for all signs as required in handicapped-accessible buildings.

PART 3 EXECUTION

3.1 PLACEMENT SCHEDULE - Refer to Signage Plan and Schedule

		Text		

3.2 INSTALLATION

Install signs plumb and true and in accordance with approved manufacturer's instructions at locations shown on the detail drawings. Submit operating instructions outlining the step-by-step procedures required for system operation. The instructions include simplified diagrams for the system as installed, the manufacturer's name, model number, service manual, parts list, and brief description of all equipment and their basic operating features. Provide each set permanently bound with a hard cover. The following identification must be inscribed on the covers: "OPERATING AND MAINTENANCE INSTRUCTIONS", name and location of the facility, name of the Contractor, and contract number. Submit in accordance with Section 01 78 23 OPERATING AND MAINTENANCE DATA. Mounting height and mounting location complies with 36 CFR 1191. Install required blocking. Do not install signs on doors or other surfaces until finishes on such surfaces have been installed. Signs installed on glass surfaces are installed with matching blank back-up plates in accordance with manufacturer's instructions.

Do not install items that show visual evidence of biological growth.

3.2.1 Anchorage

Provide anchorage in accordance with approved manufacturer's instructions. Anchorage not otherwise specified or shown includes slotted inserts, expansion shields, and powder-driven fasteners when approved for concrete; toggle bolts and through bolts for masonry; machine carriage bolts for steel; lag bolts and screws for wood. Provide exposed anchor and fastener materials compatible with metal to which applied with

matching color and finish.

a. Signs mounted to painted gypsum board surfaces must be removable for painting maintenance.

b. Mount signs to lay-in ceiling grids with clip connections to ceiling tees.

c. Install signs mounted on metal surfaces with magnetic tape.

d. Install signs mounted on fabric surfaces with hook and loop tape or pin mount.

e. Install signs to workstation panels with panel clips.

3.2.2 Protection and Cleaning

Protect the work against damage during construction. Adjust hardware and electrical equipment for proper operation. Clean glass, frames, and other sign surfaces at completion of signage installation in accordance with the manufacturer's written instructions.

-- End of Section --

SECTION 10 21 13

TOILET COMPARTMENTS
08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ALUMINUM ASSOCIATION (AA)

AA DAF45	(2003; Reaffirmed 2009) Designation System for Aluminum Finishes

ASTM INTERNATIONAL (ASTM)

ASTM A167	(2011) Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
ASTM D7611/D7611M	(2013; E 2014) Standard Practice for Coding Plastic Manufactured Articles for Resin Identification

INTERNATIONAL CODE COUNCIL (ICC)

ICC A117.1 COMM	(2017) Standard And Commentary Accessible and Usable Buildings and Facilities

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage

U.S. GENERAL SERVICES ADMINISTRATION (GSA)

CID A-A-60003	(Basic) Partitions, Toilet, Complete

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

36 CFR 1191	Americans with Disabilities Act (ADA) Accessibility Guidelines for Buildings and Facilities; Architectural Barriers Act (ABA) Accessibility Guidelines

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" " classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Fabrication Drawings

Installation Drawings; G

SD-03 Product Data

Cleaning and Maintenance Instructions

Colors And Finishes

Anchoring Devices and Fasteners

Hardware and Fittings

Brackets

Door Hardware

Toilet Enclosures

Urinal Screens

Pilaster Shoes

Finishes; G

SD-04 Samples

Colors and Finishes; G

Hardware and Fittings

Anchoring Devices and Fasteners

SD-07 Certificates

Warranty

SD-10 Operation and Maintenance Data

Plastic Identification; G

1.3 CERTIFICATIONS

1.3.1 Indoor Air Quality

1.3.1.1 Plastic Products

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or

provide certification or validation by other third-party program that products meet the requirements of this Section. Provide current product certification documentation from certification body.

1.4 REGULATORY REQUIREMENTS

Comply with to ICC A117.1 COMM code for access for the handicapped operation of toilet compartment door and hardware.

1.5 DELIVERY, STORAGE, AND HANDLING

Deliver materials in the manufacturer's original unopened packages with the brand, item identification, and project reference clearly marked. Store components in a dry location that is adequately ventilated; free from dust, water, other contaminants, and damage during delivery, storage, and construction.

1.6 WARRANTY

Provide certification or warranties that toilet partitions will be free of defects in materials, fabrication, finish and installation and will remain so for a period of not less than 3 years after completion.

PART 2 PRODUCTS

2.1 SYSTEM REQUIREMENTS

Provide a complete and usable toilet partition system, including toilet enclosures, room entrance screens, urinal screens, system of panels, hardware, and support components. Furnish the partition system from a single manufacturer, with a standard product as shown in the most recent catalog data. Submit Fabrication Drawings for toilet partitions and urinal screens consisting of fabrication and assembly details to be performed in the factory. Submit manufacturer's Cleaning and Maintenance Instructions in accordance with Section 01 78 23 OPERATIONS AND MAINTENANCE DATA.

2.1.1 Plastic Identification

Verify that plastic products to be incorporated into the project are labeled in accordance with ASTM D7611/D7611M. Where products are not labeled, provide product data indicating polymeric information in the Operation and Maintenance Manual.

Type 1	Polyethylene Terephthalate (PET, PETE)
Type 2	High Density Polyethylene (HDPE)
Type 3	Vinyl (Polyvinyl Chloride or PVC)
Type 4	Low Density Polyethylene (LDPE)
Type 5	Polypropylene (PP)
Type 6	Polystyrene (PS)

Type 1	Polyethylene Terephthalate (PET, PETE)
Type 7	Other. Use of this code indicates that the package in question is made with a resin other than the six listed above, or is made of more than one resin listed above, and used in a multi-layer combination.

2.2 MATERIALS

2.2.1 Solid Polyethylene Panels (Finish 5)

Provide high density polyethylene (HDPE) suitable for exposed application. Waterproof, non-absorbent and graffiti resistant textured surface with a Flame Spread Index of 75 or less, and a Smoke Developed Index of 450 or less.2.2.2 Anchoring Devices and Fasteners

Provide steel anchoring devices and fasteners Conceal all anchoring devices.

2.2.3 Brackets

Wall brackets must be stainless steel, continous panel brackets. Provide stirrup style panel-to-pilaster brackets.

2.2.4 Hardware and Fittings

2.2.4.1 General Requirements

Provide hardware for the toilet partition system that complies with CID A-A-60003 for the specified type and style of partitions. Provide hardware finish highly resistant to alkalis, urine, and other common toilet room acids. Comply with 36 CFR 1191 of latching devices and hinges for handicap compartments; provide chrome-plated steel devices and hinges with door latches that operate without either tight grasping or twisting of the wrist of the operator. Submit three samples of each item, including anchoring devices and fasteners. Approved hardware samples may be installed in the work if properly identified.

Material	Conformance Standard
Corrosion-resistant steel	ASTM A167, Type 302 304

2.2.4.2 Finishes

d. Corrosion-resistant steel with a No. 4 finish.

e. Provide stainless steel with a No. 4 finish.

f. Exposed fasteners that match the hardware and fittings.

2.2.5 Door Hardware

2.2.5.1 Hinges

Provide adjustable hinges to hold in-swinging doors open at any angle up to 90 degrees and outswinging doors up to 10 degrees. Provide self-lubricating hinges with the indicated swing. Hinges must have the following type of return movement:

a. Gravity return movement

2.2.5.2 Latch and Pull

Provide latch and pull that is a combination rubber-faced door strike and keeper equipped with emergency access.

2.2.5.3 Coat Hooks

Provide coat hooks that are combination units with hooks and rubber tipped pins.

2.3 PARTITION PANELS AND DOORS

Provide solid polyethylene toilet partitions and screens with recycled content of 30 percent minimum. Provide data identifying percentage of recycled content for plastic, solid polyethylene partitions and screens.

2.3.1 Toilet Enclosures

Provide toilet enclosures that comply with CID A-A-60003, Type I, Style C, overhead braced. Provide a width of 1 inch. Finish surface of panels solid polyethylene (Finish 5) water resistant; graffiti resistant; non-absorbent; with -1/4 inch radius beveled edges.. Reinforce panels indicated to receive toilet paper holders or grab bars for mounting of the items required. a Provide grab bars to withstand a bending stress, shear stress, shear force, and a tensile force induced by 250 lbf. Grab bars cannot rotate within their fittings.

2.3.2 Urinal Screens

Provide urinal screens that comply with CID A-A-60003, Type III, Style C, overhead braced. Provide finish for surface of screens as solid polyethylene (Finish 5); water resistant; graffiti resistant; non-absorbent with radius beveled edges. Furnish width and height of urinal screens as shown. Provide thickness of 1 inch. Secure wall hung urinal screens with 42 inches long, continuous flanges. Fabricate screens from the same types of panels and pilasters as the toilet partitions. Use corrosion-resistant steel fittings and fasteners.

2.4 OVERHEAD-BRACED PARTITIONS

Pilasters must not be less than 1-1/4 inch thick with face sheets not less than 0.0393 inch thick. Provide anchoring device at the bottom of the pilaster consisting of a channel-shaped floor stirrup fabricated from not less than 0.0635 inch thick material and a leveling bolt. Secure the stirrup to the pilaster with not less than a 3/16 inch bolt and nut after

the pilaster is leveled. Secure the stirrup to the floor with not less than two lead expansion shields and sheetmetal screws. Fabricate overhead brace from a continuous extruded aluminum tube not less than 1 inch wide by 1-1/2 inch high, 0.125 inch wall thickness. Finish is AA-C22A31 in accordance with AA DAF45. Set and secure brace into the top of each pilaster. Provide shoes at pilasters to conceal supports and leveling mechanism.

2.5 PILASTER SHOES

Provide shoes at pilasters to conceal floor-mounted anchorage. Pilaster shoes must be stainless steel or one piece of molded HDPE.

2.6 HARDWARE

Provide hardware for the toilet partition system that complies with CID A-A-60003 for the specified type and style of partitions. Provide stainless steel hardware pre-drilled by manufacturer. Provide latching devices and hinges for handicap compartments complying with 36 CFR1191 and stainless steel door latches that operate without either tight grasping or twisting of the wrist of the operator. Use stainless steel, tamper proof type screws and bolts. Wall mounting brackets mus be continuous, full height, stainless steel, in accordance with toilet compartment manufacturere's instructions. Provide floor-mounted anchorage consisting of corrosion-resistant anchoring assemblies with threaded rods, lock washers, and leveling adjustment nuts at pilasters for structural connection to floor.

2.7 COLORS AND FINISHES

2.7.1 Colors

Provide manufacturer's standard color charts for color of finishes for toilet partitions system components. Submit three samples showing a finished edge on two adjacent sides and core construciton, each not less than 12-inch square.

2.7.2 Finishes

2.7.2.1 Finishes No. 4, No. 5

Provide solid plastic fabricated of polymer resins (polyethylene) formed under high pressure rendering a single component section not less than one inch thick. Colors must extend throughout the panel thickness. Provide exposed finish surfaces: smooth, waterproof, non-absorbent, and resistant to staining and marking with pens, pencils, or other writing devices. Solid plastic partitions must not show any sign of deterioration when immersed in the following chemicals and maintained at a temperature of 80 degrees F for a minimum of 30 days:

Acetic Acid (80 percent)	Hydrochloric Acid (40 percent)
Acetone	Hydrogen Peroxide (30 percent)

Ammonia (liquid)	Isopropyl Alcohol
Ammonia Phosphate	Lactic Acid (25 percent)
Bleach (12 percent)	Lime Sulfur
Borax	Nicotine
Brine	Potassium Bromide
Caustic Soda	Soaps
Chlorine Water	Sodium Bicarbonate
Citric Acid	Trisodium Phosphate
Copper Chloride	Urea; Urine
Core Oils	Vinegar

PART 3 EXECUTION

3.1 PREPARATION

Take field measurements prior to the preparation of drawing and fabrication to ensure proper fits. Verify that field measurements, surfaces, substrates and conditions are as required, and ready to receive work. Verify correct spacing of plumbing fixtures. Verify correct location of built in framing, anchorage, and bracing. Report in writing to Contracting Officer prevailing conditions that adversely affect satisfactory execution of the work of this section. Do not proceed with work until unsatisfactory conditions have been corrected.

3.2 INSTALLATION

Do not install items that show visual evidence of biological growth. Install partitions rigid, straight, plumb, and level, with the panels centered between the fixtures. Provide a panel clearance of not more than 1/2 inch and secure the panels to walls and pilasters with continuous full height wall brackets. Locate wall brackets so that holes for wall bolts occur in masonry or tile joints. Secure panels to pilasters with brackets matching the wall brackets. Provide for adjustment due to minor floor variations. Locate head rail joints at pilaster center lines. Install adjacent components for consistency of line and plane. Equip each door with hinges, one door latch, and one coat hook and bumper. Align hardware to uniform clearance at vertical edges of doors.

c. Secure panels to solid masonry or concrete with lead or brass expansion shields designed for use with not less than 1/4-20 screws, with a shield length of not less than 1-1/2 inches. Provide expansion shields with a load-carrying strength of not less than 600 pounds per anchor.

d. Submit Installation Drawings for toilet partitions, room entrance screens, and urinal screens showing plans, elevations, details of

construction, hardware, reinforcing and blocking, fittings, mountings and escutcheons. Indicate on drawings the type of partition, location, mounting height, cutouts, and reinforcement required for toilet-room accessories.

3.3 OVERHEAD-BRACED PARTITIONS

Secure pilasters to the floor with the anchorage device specified. Make all leveling devices readily accessible for leveling, plumbing, and tightening the installation. Secure overhead brace to the pilaster face with not less than two fasteners per face. Expansion shields have a minimum 2 inch penetration into the concrete slab. Make tops of doors parallel with the overhead brace when doors are in a closed position.

3.4 FINAL ADJUSTMENT

After completion of the installation, make final adjustments to the pilaster-leveling devices, door hardware, and other working parts of the partition assembly. Doors have a uniform vertical edge clearance of approximately 3/16 inch and rest open at approximately 30 degrees when unlatched.

3.5 CLEANING

Touch up baked enamel and powder coat finish with the same color of paint that was used for the finish. Clean all surfaces and adjacent surfaces soiled as a result of the work, in an approved manner compliant with the manufacturer's recommended cleaning and protection from damage procedures until accepted. Remove all equipment, tools, surplus materials, and work debris from the site.

-- End of Section --

SECTION 10 26 00

WALL AND DOOR PROTECTION
08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM D256	(2010; R 2018) Standard Test Methods for Determining the Izod Pendulum Impact Resistance of Plastics
ASTM D543	(2020) Standard Practices for Evaluating the Resistance of Plastics to Chemical Reagents
ASTM D635	(2018) Standard Test Method for Rate of Burning and/or Extent and Time of Burning of Plastics in a Horizontal Position
ASTM E84	(2020) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM G21	(2015) Standard Practice for Determining Resistance of Synthetic Polymeric Materials to Fungi

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2010; Version 1.1) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers

GREEN SEAL (GS)

GS-36	(2013) Adhesives for Commercial Use

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage

SOCIETY OF AUTOMOTIVE ENGINEERS INTERNATIONAL (SAE)

SAE J1545	(2005; R 2014) Instrumental Color Difference Measurement for Exterior Finishes, Textiles and Colored Trim

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(2017) Adhesive and Sealant Applications

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Corner Guards; G

Wall Covering and Panels; G

SD-03 Product Data

Corner Guards; G

Wall Covering and Panels; G

Recycled content for aluminum component of corner guards;

Recycled content for steel component of corner guards; S

SD-04 Samples

Corner Guards; G

Wall Covering and Panels; G

SD-06 Test Reports

Fire Resistance Rating

SD-07 Certificates

Indoor air quality for wall covering/panels; S

Indoor air quality for adhesives; S

SD-10 Operation and Maintenance Data

Corner Guards, Data Package 1; G

Wall Covering and Panels, Data Package 1; G

1.3 CERTIFICATIONS

1.3.1 Indoor Air Quality

1.3.1.1 Wall Covering and Panels

Provide sheet and high impact resistant resilient materials certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party program that products meet the requirements of this section. Provide current product certification documentation from certification body.

1.3.1.2 Adhesives and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party program that products meet the requirements of this section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the project site in manufacturer's original unopened containers with seals unbroken and labels and trademarks intact. Keep materials dry, protected from weather and damage, and stored under cover. Store materials at approximately 70 degrees F for at least 48 hours prior to installation.

1.5 WARRANTY

Provide manufacturer's warranty to repair or replace defective materials and workmanship for a 1 year period of one year from date of final acceptance of the work.

PART 2 PRODUCTS

2.1 STANDARD PRODUCTS

To the maximum extent possible, provide wall and door protection items that are standard products of a single manufacturer and furnished as detailed. Drawings show general configuration of products required, and items differing in minor details from those shown are acceptable.

Submit detailed shop drawings of each wall and door protection item indicated. Include elevations, dimensions, clearances, details of construction and anchorage, and details of joints and connections.

Submit manufacturers' descriptive product data for each wall and door protection item indicated. Include manufacturers' literature, finishes,

profiles and thicknesses of materials.

Submit manufacturers' operations and maintenance data for each wall and door protection item indicated in accordance with Section 01 78 23 OPERATIONS AND MAINTENANCE DATA.

2.1.1 Resilient Material CG-1, SWC-1, SWC-2 & FRP-1

Provide resilient material consisting of high impact resistant extruded acrylic vinyl and fiberglass reinforced plastic conforming to the following:

2.1.1.1 Minimum Impact Resistance

Minimum impact resistance must be 18 ft-lbs/sq. inch when tested in accordance with ASTM D256, (Izod impact, ft-lbs per sq inch notched). Minimum impact resistance must be 49.62 ft-lbs/sq. inch when tested in accordance with ASTM F476.

2.1.1.2 Fire Resistance Rating

Provide the following surface burning characteristics when tested and labeled in accordance with ASTM E84 by a qualified testing agency: maximum flame spread of 25 and a smoke developed rating of 450 or less. Provide material rated as self extinguishing when tested in accordance with ASTM D635. Provide resilient material used for protection on fire rated doors and frames listed by the qualified testing agency performing the tests. Provide resilient material installed on fire rated wood/steel door and frame assemblies tested on similar type assemblies. Test results of material tested on any other combination of door/frame assembly are not acceptable.

2.1.1.3 Integral Color

Provide colored components having integral color and matched in accordance with SAE J1545 to within plus or minus 1.0 on the CIE-LCH scales.

2.1.1.4 Chemical and Stain Resistance

Provide materials resistant to chemicals and stains reagents in accordance with ASTM D543.

2.1.1.5 Fungal and Bacterial Resistance

Provide materials resistant to fungi and bacteria in accordance with ASTM G21, as applicable.

2.2 CORNER GUARDS

2.2.1 Resilient Corner Guards

Provide surface mounted corner guards, radius formed to profile shown. Provide corner guards that extend from floor to ceiling and 6 feet high. Furnish mounting hardware, cushions, and base plates. Provide assembly consisting of a snap-on corner guard formed from high impact resistant resilient material, mounted on a continuous aluminum retainer. Extruded aluminum retainer conforms to ASTM B221, alloy 6063, temper T5 or T6. Provide aluminum components that contain a minimum of 35 percent recycled content. Provide data identifying percentage of recycled content for

aluminum component of corner guards. Furnish factory fabricated end closure caps for top and bottom of surface mounted corner guards. Provide flush mounted corner guards installed in fire rated wall that maintain the rating of the wall. Manufacturer to provide insulating materials that are an integral part of the corner guard system. Provide exposed metal portions of fire rated assemblies with a paintable surface.

2.3 WALL COVERING AND PANELS

Provide wall covering and panels consisting of high impact rigid acrylic vinyl or polyvinyl chloride resilient material. Panel sizes are 4 by 8 feet. Provide wall covering material used on the interior of the building (defined as inside of the weatherproofing system) that meets either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) the VOC content requirements of SCAQMD Rule 1168, or VOC content requirements of GS-36. Provide certification of indoor air quality for wall covering/panels.

2.3.1 Rigid Vinyl Acrylic Wall Covering SWC-1 & SWC-2

2.3.2 High Impact Wall Panels FRP-1

Provide fiberglass reinforced panel in thickness that are 0.09 inch.

2.4 TRIM, FASTENERS AND ANCHORS

Provide vinyl trim, fasteners and anchors for each specific installation as indicated.

2.5 FINISH

Submit samples indicating color and texture of materials requiring color and finish.

2.5.1 Resilient Material Finish

Provide resilient material finish of stipple texture with colors in accordance with SAE J1545.

2.6 ADHESIVES

Provide adhesive for resilient material in accordance with manufacturers recommendations. Provide sealants and non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) that meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) the VOC content requirements of SCAQMD Rule 1168, or VOC content requirements of GS-36. Provide certification of indoor air quality for adhesives.

2.7 COLOR

Provide color as specified in Section 09 06 00 SCHEDULES FOR FINISHES.

PART 3 EXECUTION

3.1 INSTALLATION

Do not install items that show visual evidence of biological growth. Install items on surfaces that are clean, smooth, and free of obstructions.

3.1.1 Corner Guards and Wall Guards

a. Mount guards as indicated and in accordance with manufacturer's written installation instructions.

3.1.2 Wall Coverings and Panels

Install as indicated in accordance with manufacturer's written instructions.

-- End of Section --

SECTION 10 28 13

TOILET ACCESSORIES
08/17

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM C1036 (2016) Standard Specification for Flat Glass

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Finishes; G

Accessory Items; G

SD-04 Samples

Finishes; G

Accessory Items

1.3 DELIVERY, STORAGE, AND HANDLING

Wrap toilet accessories for shipment and storage, then deliver to the jobsite in manufacturer's original packaging, and store in a clean, dry area protected from construction damage and vandalism.

1.4 WARRANTY

Provide manufacturer's standard performance guarantees or warranties that extend beyond a 1 year period.

PART 2 PRODUCTS

2.1 MANUFACTURED UNITS

Provide toilet accessories where indicated in accordance with DRAWING SCHEDULE. Provide each accessory item complete with the necessary mounting plates of sturdy construction with corrosion resistant surface.

Provide stainless steel products listed herein manufactured from materials containing a minimum of 50 percent recycled content. Provide data identifying percentage of recycled content for stainless steel toilet accessories.

2.1.1 Anchors and Fasteners

Provide anchors and fasteners capable of developing a restraining force commensurate with the strength of the accessory to be mounted and suited for use with the supporting construction. Provide tamperproof design exposed fasteners with finish to match the accessory.

2.1.2 Finishes

Except where noted otherwise, provide the following finishes on metal:

Metal	Finish
Stainless steel	No. 4 satin finish
Carbon steel, copper alloy, and brass	Chromium plated, bright

2.2 ACCESSORY ITEMS

Conform to the requirements for accessory items specified below. Submit fasteners proposed for use for each type of wall construction, mounting, operation, and cleaning instructions and one sample of each other accessory proposed for use. Incorporate approved samples into the finished work, provided they are identified and their locations noted. Submit certificate for each type of accessory specified, attesting that the items meet the specified requirements.

2.2.1 Grab Bar (GB)

Provide an 18 gauge, 1-1/4 inch grab bar OD Type 304 stainless steel. Provide form and length for grab bar as indicated. Provide concealed mounting flange. Provide grab with satin finish. Furnish installed bars capable of withstanding a 500 pound vertical load without coming loose from the fastenings and without obvious permanent deformation. Allow 1-1/2 inch space between wall and grab bar.

2.2.2 Mirrors, Glass (MG)

Provide Type I transparent flat type, Class 1-clear glass for mirrors. Glazing Quality q1 1/4 inch thick conforming to ASTM C1036. Coat glass on one surface with silver coating, copper protective coating, and mirror backing paint. Provide highly adhesive pure silver coating of a thickness which provides reflectivity of 83 percent or more of incident light when viewed through 1/4 inch thick glass, free of pinholes or other defects. Provide copper protective coating with pure bright reflective copper, homogeneous without sludge, pinholes or other defects, of proper thickness to prevent "adhesion pull" by mirror backing paint. Provide mirror backing paint with two coats of special scratch and abrasion-resistant paint and baked in uniform thickness to provide a protection for silver and copper coatings which will permit normal cutting and edge fabrication.

2.2.3 Paper Towel Dispenser (PTD)

See Eglin Standard Accessory Appendix E..

2.2.4 Soap Dispenser (SD)

See Eglin Standard Accessory Appendix E.

2.2.5 Toilet Tissue Dispenser (TTD)

See Eglin Standard Accessory Appendix E.

2.2.6 Waste Receptacle (WR)

Provide Satin stainless steel waste receptacle, Basis of Design: Bobrick B-2260, designed for under-counter, free-standing. Provide reusable liner, of the type standard with the receptacle manufacturer. Provide a minimum 13 gallon capacity. Provide with 6" polished stainless, countertop mounted circular waste chute..

2.2.7 Mop and Broom Holder (MH)

Stainless steel with grip jaw cam mechanism securing 4 mop or broom handles. Also includes hooks and storage shelf.

PART 3 EXECUTION

3.1 INSTALLATION

Do not install items that show visual evidence of biological growth. Provide the same finish for the surfaces of fastening devices exposed after installation as the attached accessory. Provide oval exposed screw heads. Install accessories at the location and height indicated. Protect exposed surfaces of accessories with strippable plastic or by other means until the installation is accepted. After acceptance of accessories, remove and dispose of strippable plastic protection. Coordinate accessory manufacturer's mounting details with other trades as their work progresses. Use sealants for brackets, plates, anchoring devices and similar items in showers (a silicone or polysulfide sealant) as they are set to provide a watertight installation. After installation, thoroughly clean exposed surfaces and restore damaged work to its original condition or replace with new work.

3.1.1 Surface Mounted Accessories

Mount on concealed backplates, unless specified otherwise. Conceal fasteners on accessories without backplates. Install accessories with sheet metal screws or wood screws in lead-lined braided jute, PTFE or neoprene sleeves, or lead expansion shields, or with toggle bolts or other approved fasteners as required by the construction. Install backplates in the same manner, or provide with lugs or anchors set in mortar, as required by the construction. Fasten accessories mounted on gypsum board and plaster walls without solid backing into the metal or wood studs or to solid wood blocking secured between wood studs, or to metal backplates secured to metal studs.

3.2 CLEANING

Clean material in accordance with manufacturer's recommendations. Do not

use alkaline or abrasive agents. Take precautions to avoid scratching or marring exposed surfaces.

3.3 SCHEDULE

SEE DRAWINGS.

-- End of Section --

SECTION 10 44 16

FIRE EXTINGUISHERS
11/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 1	(2018) Fire Code
NFPA 10	(2018; TIA 18-1) Standard for Portable Fire Extinguishers
NFPA 101	(2018; TIA 18-1; TIA 18-2; TIA 18-3) Life Safety Code

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.157	(2003) Portable Fire Extinguishers

UNDERWRITERS LABORATORIES (UL)

UL 299	(2012) Dry Chemical Fire Extinguishers

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Fire Extinguishers; G

Accessories; G

CabinetsG

Wall Brackets; G

; GSD-07 Certificates

Fire Extinguishers Certifications; G

Manufacturer's Warranty with Inspection Tag; G

1.3 DELIVERY, STORAGE, AND HANDLING

Protect materials from weather, soil, and damage during delivery, storage, and construction.

Deliver materials in their original packages, containers, or bundles bearing the brand name and the name and type of the material.

1.4 WARRANTY

Guarantee that Fire Extinguishers are free of defects in materials, fabrication, finish, and installation and that they will remain so for a period of not less than 2 years after completion.

Submit the manufacturer's warranty with inspection tag.

1.5 PROJECT SCHEDULE

For fire extinguishers. Coordinate final fire extinguisher schedule with fire protection cabinet schedule to ensure proper fit and function. Use same designations indicated on Drawings.

PART 2 PRODUCTS

Submit fabrication drawings consisting of fabrication and assembly details performed in the factory and product data for the following items: Fire Extinguishers; Accessories, cabinets, Wall Brackets.

2.1 SYSTEM DESCRIPTION

2.1.1 Types

Submit fire extinguishers certifications showing compliance with local codes and regulations.

Provide fire extinguishers conforming to NFPA 10. Provide quantity and placement in compliance with the applicable sections of NFPA 1, NFPA 101, and 29 CFR 1910.157 and as indicated on the drawings.
Provide dry chemical type fire extinguishers compliant with UL 299, 3A:40-B:C.

2.1.2 Material

Provide enameled steel extinguisher shell.

2.1.3 Size

10 pounds extinguishers.

2.1.4 Accessories

Forged brass valve

Fusible plug

Safety release

Antifreeze

Pressure gage

2.2 EQUIPMENT

2.2.1 Cabinets

2.2.1.1 Material

Provide enameled steel cabinets.

2.2.1.2 Type

Provide surface type cabinets, where cabinets are required.

2.2.1.3 Size

Dimension cabinets to accommodate the specified fire extinguishers.

2.2.2 Wall Brackets

Provide wall-hook fire extinguisher wall brackets.

Provide wall bracket and accessories as approved.

2.2.2.1 Identification

Provide lettering complying with authorities having jurisdiction for letter style, size, spacing, and location. Locate as indicated by the drawings.

Identify bracket-mounted fire extinguishers with the words "FIRE EXTINGUISHER" in red letter decals applied to mounting surface.

Orientation: Vertical.

PART 3 EXECUTION

3.1 INSTALLATION

Install Fire Extinguishers where indicated on the drawings. Verify exact locations prior to installation.

Provide extinguishers which are fully charged and ready for operation upon installation. Provide extinguishers complete with Manufacturer's Warranty with Inspection Tag attached.

Install fire extinguishers in locations indicated and in compliance with requirements of authorities having jurisdiction.

Comply with the manufacturer's recommendations for all installations.

3.2 PROTECTION

3.2.1 Repairing

Remove and replace damaged and unacceptable portions of completed work with new work at no additional cost to the Government.

Submit replacement parts list indicating specified items replacement part, replacement cost, and name, address and contact for replacement parts distributor.

3.2.2 Cleaning

Clean all surfaces of the work, and adjacent surfaces which are soiled as a result of the work. Remove from the site all construction equipment, tools, surplus materials and rubbish resulting from the work.

-- End of Section --

SECTION 12 24 13

ROLLER WINDOW SHADES
08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM G21	(2015) Standard Practice for Determining Resistance of Synthetic Polymeric Materials to Fungi

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 701	(2019) Standard Methods of Fire Tests for Flame Propagation of Textiles and Films

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS	SCS Global Services (SCS) Indoor Advantage

UNDERWRITERS LABORATORIES (UL)

UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" or "S" classification are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES

SD-02 Shop Drawings

Detailed Drawings; G

Location Schedule; G

SD-03 Product Data

Window Shades; G

Recycled Content for various fiber components; S

SD-04 Samples

Window Shades; G

SD-06 Test Reports

Flammability Requirements; G

SD-07 Certificates

Indoor Air Quality for roller window shades; S

Qualifications

SD-10 Operation and Maintenance Data

Window Shades, Data Package 1; G

1.3 CERTIFICATES

1.3.1 Indoor Air Quality Certifications

1.3.1.1 Roller Window Shades

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide validation by other third-party program that products meet the requirements of this paragraph. Provide current product certification documentation from certification body.

1.4 QUALITY ASSURANCE

1.4.1 Qualifications

1.4.1.1 Installer's Qualifications

Installer trained and certified by the manufacturer with a minimum of ten years of experience in installing products comparable to those specified in this section.

1.4.2 Flammability Requirements

Passes in accordance with NFPA 701 small and large-scale vertical burn. Materials tested are identical to products proposed for use.

1.4.3 Anti-Microbial Requirements

'No Growth' per ASTM G21 results for fungi ATCC9642, ATCC 9644, ATCC9645.

1.5 DELIVERY, STORAGE, AND HANDLING

Deliver components to the jobsite in the manufacturer's original packaging with the brand or company name, item identification, and project reference clearly marked. Store components in a dry location that is adequately ventilated and free from dust, water, or other contaminants and has easy access for inspection and handling. Store materials flat in a clean dry area with temperature maintained above 50 degrees F. Do not open containers until needed for installation unless verification inspection is required. Handle and store shades in accordance with manufacturer's recommendations.

1.6 WARRANTY

Provide manufacturer's warranty to repair or replace defective materials and workmanship fabrics are warranted for 5 years from date of final acceptance of the work.

PART 2 PRODUCTS

2.1 WINDOW SHADES WS-1

Submit drawings showing plans, elevations, sections, product details, installation details, operational clearances, wiring diagrams and relationship to work. Submit a location schedule showing location, size and quantity of shades. Include the use of same room designations as indicated on the drawings.

Provide product data composed of catalog cuts, brochures, and operating and maintenance instructions on each product to be used. Include styles, profiles and features.

Furnish samples of each type and color of roller shade fabric and roller shade channel. Provide shade material minimum 6 by 6 inches in size. Mark face of material to indicate interior faces.

Submit fire resistance data, flame spread and smoke contribution data.

Provide a fixed shade. Provide brackets that are appropriate for mount. Provide shade cloth meeting the performance described in NFPA 701, small scale test. Treat steel features for corrosion resistance.

Provide Various Fiber Components with a minimum of 60 percent recycled content. Provide data identifying percentage of recycled content for various fiber components.
Provide certification of indoor air quality for roller window shades.

2.1.1 Manually Operated Shades with Single Rollers

2.1.1.1 Rollers

Provide corrosion-resistant steel or extruded-aluminum tubes of diameters and wall thicknesses required to accommodate operating mechanisms and weights and widths of shade bands indicated without deflection. Provide with permanently lubricated drive-end assemblies and idle-end assemblies designed to facilitate removal of shade cloth for service.

a. Shade cloth-to-Roller Attachment: Manufacturer's standard method.

2.1.1.2 Mounting Hardware

Provide corrosion resistant brackets or endcaps compatible with roller assembly, operating mechanism, installation accessories, and mounting location and conditions indicated. Provide hardware that allows for field adjustment or removal of shade roller tube and other operable hardware component without removal of brackets and end or center supports.

2.1.1.3 Shade Cloth

a. Shade Material: Light-filtering fabric: Openness 10 percent.

b. Shade Cloth Bottom (Hem) Bar: Steel or extruded aluminum. Provide shade bar exposed with endcaps and integral light seal at bottom where it meets the sill.

2.1.1.4 Installation Accessories

a. Front Fascia: L-shaped aluminum extrusion to conceal shade roller and hardware that snaps onto end caps without requiring exposed fasteners of any kind. Fascia can be mounted continuously across two or more shade bands. Provide manufacturers standard height fascia as required to conceal roller and shade band assembly when shade is fully open.

b. Endcaps: Extruded aluminum with universal design suitable for mounting to window mullions. Provide size compatible with roller size. Provide end cap covers matching fascia/headbox finish.

2.2 COLOR

Provide color, pattern and texture for metal trim and shade fabric as specified in Section 09 06 00 SCHEDULES FOR FINISHES.

PART 3 EXECUTION

3.1 FIELD MEASUREMENTS

After becoming familiar with details of the work, verify all dimensions in the field, and advise the Contracting Officer of any discrepancy before performing the work.

3.2 ROLLER WINDOW SHADE PLACEMENT SCHEDULE

Refer to the I-104 drawing for window locations and A-601 for the window elevation.

3.3 INSTALLATION

Do not install building construction materials that show visual evidence of biological growth.

Provide roller window shades, complete with necessary brackets, fittings, and hardware.

Perform installation in accordance with the approved detailed drawings and manufacturer's installation instructions. Install units level, plumb, secure, and at proper height and location relative to window units. Provide and install supplementary or miscellaneous items in total, including clips, brackets, or anchorages incidental to or necessary for a sound, secure, and complete installation. Do not start installation until completion of room painting and finishing operations.

3.4 CLEAN-UP

Upon completion of the installation, clean window treatments and exposed components as recommended by manufacturer. Adjust window treatment for form and appearance and proper operating condition. Repair or replace damaged units as directed by the Contracting Officer. Isolate metal parts from direct contact with concrete, mortar, or dissimilar metals. Ensure shades installed in recessed pockets can be removed without disturbing the pocket. The entire shade, when retracted, is contained inside the pocket. For shades installed outside the jambs and mullions, overlap each jamb and mullion 0.75 inch or more when the jamb and mullion sizes permit. Include all hardware, brackets, anchors, fasteners, and accessories necessary for a complete, finished installation.

-- End of Section --

SECTION 21 13 13

WET PIPE SPRINKLER SYSTEMS, FIRE PROTECTION
08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B16.1	(2020) Gray Iron Pipe Flanges and Flanged Fittings Classes 25, 125, and 250
ASME B16.3	(2021) Malleable Iron Threaded Fittings, Classes 150 and 300
ASME B16.4	(2021) Gray Iron Threaded Fittings; Classes 125 and 250
ASME B16.21	(2021) Nonmetallic Flat Gaskets for Pipe Flanges

AMERICAN SOCIETY OF SANITARY ENGINEERING (ASSE)

ASSE 1013	(2021) Performance Requirements for Reduced Pressure Principle Backflow Prevention Assemblies
ASSE 1015	(2021) Performance Requirements for Double Check Backflow Prevention Assemblies

AMERICAN WATER WORKS ASSOCIATION (AWWA)

AWWA C104/A21.4	(2016) Cement-Mortar Lining for Ductile-Iron Pipe and Fittings for Water
AWWA C110/A21.10	(2021) Ductile-Iron and Gray-Iron Fittings
AWWA C111/A21.11	(2017) Rubber-Gasket Joints for Ductile-Iron Pressure Pipe and Fittings
AWWA C203	(2020) Coal-Tar Protective Coatings and Linings for Steel Water Pipelines - Enamel and Tape - Hot-Applied
AWWA M14	(2015) Manual: Recommended Practice for Backflow Prevention and Cross-Connection Control

ASTM INTERNATIONAL (ASTM)

ASTM A47/A47M	(1999; R 2022; E 2022) Standard

	Specification for Ferritic Malleable Iron Castings
ASTM A53/A53M	(2022) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
ASTM A135/A135M	(2021) Standard Specification for Electric-Resistance-Welded Steel Pipe
ASTM A153/A153M	(2016a) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
ASTM A183	(2014; R 2020) Standard Specification for Carbon Steel Track Bolts and Nuts
ASTM A536	(1984; R 2019; E 2019) Standard Specification for Ductile Iron Castings

FM GLOBAL (FM)

FM APP GUIDE	(updated on-line) Approval Guide http://www.approvalguide.com/

INTELLIGENCE COMMUNITY STANDARD (ICS)

ICS 705-1	(2010) Physical and Technical Security Standard for Sensitive Compartmented Information Facilities

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY (MSS)

MSS SP-71	(2018) Gray Iron Swing Check Valves, Flanged and Threaded Ends

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 13	(2022; ERTA 3 2022) Standard for the Installation of Sprinkler Systems
NFPA 13R	(2022) Standard for the Installation of Sprinkler Systems in Low-Rise Residential Occupancies
NFPA 24	(2022) Standard for the Installation of Private Fire Service Mains and Their Appurtenances
NFPA 101	(2021) Life Safety Code
NFPA 291	(2022) Recommended Practice for Fire Flow Testing and Marking of Hydrants
NFPA 1963	(2019) Standard for Fire Hose Connections

NATIONAL INSTITUTE FOR CERTIFICATION IN ENGINEERING TECHNOLOGIES (NICET)

NICET 1014-7	(2012) Program Detail Manual for Certification in the Field of Fire Protection Engineering Technology (Field Code 003) Subfield of Automatic Sprinkler System Layout

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 3-600-01	(2016; with Change 6, 2021) Fire Protection Engineering for Facilities

UNDERWRITERS LABORATORIES (UL)

UL 193	(2016) UL Standard for Safety Alarm Valves for Fire-Protection Service
UL 199	(2020) UL Standard for Safety Automatic Sprinklers for Fire-Protection Service
UL 312	(2022) UL Standard for Safety Check Valves for Fire-Protection Service
UL 405	(2013; Bul. 2020) UL Standard for Safety Fire Department Connection Devices
UL 668	(2004; Reprint Oct 2021) UL Standard for Safety Hose Valves for Fire-Protection Service
UL Fire Prot Dir	(2012) Fire Protection Equipment Directory

1.2 SYSTEM DESCRIPTION

Provide wet pipe sprinkler system(s) in all areas of the building . Except as modified herein, the system must meet the requirements of NFPA 13 and UFC 3-600-01. Pipe sizes which are not indicated on the Contract drawings must be determined by hydraulic calculations.

1.2.1 Hydraulic Design

1.2.1.1 Basis for Calculations

Perform a fire hydrant flow test prior to shop drawing submittal in accordance with NFPA 291. Results must include hydrant elevations relative to the building and hydrant number/identifiers for the tested hydrants, including which were flowed, which had a gauge. This information must be presented in a tabular form if multiple hydrants were flowed. The results must be included with the hydraulic calculations. Hydraulic calculations must be based upon the Hazen-Williams formula with a "C" value noted in NFPA 13 for piping. The minimum residual pressure in a service lateral (lead-in) at the design flow rate must be 20 psi at the inlet to the backflow preventer.

1.2.1.2 Hydraulic Calculations

a. Water supply curves and system requirements must be plotted on

semi-logarithmic graph (N^1.85) paper so as to present a summary of the complete hydraulic calculation.

b. Provide a summary sheet listing sprinklers in the design area and their respective hydraulic reference points, elevations, minimum discharge pressures and minimum flows. Elevations of hydraulic reference points (nodes) must be indicated.

c. Documentation must identify each pipe individually and the nodes connected thereto. Indicate the diameter, length, flow, velocity, friction loss, number and type fittings, total friction loss in the pipe, equivalent pipe length and Hazen-Williams coefficient for each pipe.

d. Where the sprinkler system is supplied by interconnected risers, the sprinkler system must be hydraulically calculated using the hydraulically most demanding single riser. The calculations must not assume the simultaneous use of more than one riser.

e. All calculations must include the backflow preventer manufacturer's stated friction loss at the design flow or 8 psi for double check backflow preventer, whichever is greater.

f. All calculations must be performed back to the actual location of the flow test, taking into account the direction of flow in the service main at the test location.

g. For gridded systems, calculations must show peaking of demand area friction loss to verify that the hydraulically most demanding area is being used. A flow diagram indicating the quantity and direction of flows must be included.

1.2.1.3 Design Criteria

Hydraulically design the system to discharge a minimum density as indicated on the drawings. Hydraulic calculations must be in accordance with the Area/Density Method of NFPA 13. Add an allowance for exterior hose streams of 250 gpm to the sprinkler system demand at the fire hydrant shown on the drawings closest to the point where the water service enters the building .

1.2.2 Sprinkler Coverage

Sprinklers must be uniformly spaced on branch lines. Provide coverage throughout 100 percent of the building. This includes, but is not limited to, telephone rooms, electrical equipment rooms (regardless of the fire resistance rating of the enclosure), boiler rooms, switchgear rooms, transformer rooms, attached electrical vaults and other electrical and mechanical spaces. Coverage per sprinkler must be in accordance with NFPA 13. Provide sprinklers below all obstructions in accordance with NFPA 13. Exceptions are as follows:

a. Sprinklers may be omitted from small rooms which are exempted for specific occupancies in accordance with NFPA 101.

b. Facilities that are designed in accordance with NFPA 13R.

1.2.3 Qualified Fire Protection Engineer (QFPE)

An individual who is a licensed professional engineer (P.E.) who has passed the fire protection engineering written examination administered by the National Council of Examiners for Engineering and Surveying (NCEES) and has relevant fire protection engineering experience. Services of the QFPE must include:

a. Reviewing SD-02, SD-03, and SD-05 submittal packages for completeness and compliance with the provisions of this specification. Working (shop) drawings and calculations must be prepared by, or prepared under the immediate supervision of, the QFPE. The QFPE must affix their professional engineering stamp with signature to the shop drawings, calculations, and material data sheets, indicating approval prior to submitting the shop drawings to the DFPE.

b. Provide a letter documenting that the SD-02, SD-03, and SD-05 submittal package has been reviewed and noting all outstanding comments.

c. Performing in-progress construction surveillance prior to installation of ceilings (rough-in inspection).

d. Witnessing pre-Government and final Government functional performance testing and performing a final installation review.

e. Signing applicable certificates under SD-07.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Partial submittals and submittals not fully complying with NFPA 13 and this specification section must be returned disapproved without review. SD-02, SD-03 and SD-05 must be submitted simultaneously.

Shop drawings (SD-02), product data (SD-03) and calculations (SD-05) must be prepared by the designer and combined and submitted as one complete package. The QFPE must review the SD-02/SD-03/SD-05 submittal package for completeness and compliance with the Contract provisions prior to submission to the Government. The QFPE must provide a Letter of Confirmation that they have reviewed the submittal package for compliance with the contract provisions. This letter must include their professional engineer stamp and signature. Partial submittals and submittals not reviewed by the QFPE must be returned disapproved without review.

Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Qualified Fire Protection Engineer (QFPE); G

Sprinkler System Designer; G

Sprinkler System Installer; G

SD-02 Shop Drawings

Shop Drawing; G

SD-03 Product Data

Pipe; G

Fittings; G

Valves, including gate, check, butterfly, and globe; G

Alarm Valves; G

Relief Valves; G

Sprinklers; G

Pipe Hangers and Supports; G

Sprinkler Alarm Switch; G

Valve Supervisory (Tamper) Switch; G

Fire Department Connection; G

Backflow Prevention Assembly; G

Air Vent; G

Hose Valve; GNameplates; G

SD-05 Design Data

Hydraulic Calculations; G

SD-06 Test Reports

Test Procedures; G

SD-07 Certificates

Verification of Compliant Installation; G

Request for Government Final Test; G

SD-10 Operation and Maintenance Data

Operating and Maintenance (O&M) Instructions; G

Spare Parts Data; G

SD-11 Closeout Submittals

As-built drawings

1.4 QUALITY ASSURANCE

1.4.1 Preconstruction Submittals

Within 36 days of contract award but no less than 14 days prior to commencing work on site, the prime Contractor must submit the following for review and approval. SD-02, SD-03 and SD-05 submittals received prior to the review and approval of the qualifications will be returned Disapproved Without Review.

1.4.1.1 Shop Drawing

Three copies of the shop drawings, no later than 28 days prior to the start of system installation. Working drawings conforming to the requirements prescribed in NFPA 13 and must be no smaller than the Contract Drawings. Each set of drawings must include the following:

a. A descriptive index with drawings listed in sequence by number. A legend sheet identifying device symbols, nomenclature, and conventions used in the package.

b. Floor plans drawn to a scale not less than 1/8-inch equals 1-foot clearly showing locations of devices, equipment, risers, and other details required to clearly describe the proposed arrangement.

c. Actual center-to-center dimensions between sprinklers on branch lines and between branch lines; from end sprinklers to adjacent walls; from walls to branch lines; from sprinkler feed mains, cross mains and branch lines to finished floor and roof or ceiling. A detail must show the dimension from the sprinkler and sprinkler deflector to the ceiling in finished areas.

d. Longitudinal and transverse building sections showing typical branch line and cross main pipe routing, elevation of each typical sprinkler above finished floor and elevation of "cloud" or false ceilings in relation to the building ceilings.

e. Plan and elevation views which establish that the equipment will fit the allotted spaces with clearance for installation and maintenance.

f. Riser layout drawings drawn to a scale of not less than 1/2-inch equals 1-foot to show details of each system component, clearances between each other and from other equipment and construction in the room.

g. Details of each type of riser assembly, pipe hanger, and restraint of underground water main at point-of-entry into the building, and electrical devices and interconnecting wiring. The dimension from the edge of vertical piping to the nearest adjacent wall(s) must be indicated on the drawings when vertical piping is located in stairs or other portions of the means of egress.

h. Details of each type of pipe hanger and related components.

1.4.1.2 Product Data

Three copies of annotated catalog data to show the specific model, type, and size of each item. Catalog cuts must also indicate the NRTL listing. The data must be highlighted to show model, size, options, and other

pertinent information, that are intended for consideration. Data must be adequate to demonstrate compliance with all contract requirements. Product data for all equipment must be combined into a single submittal.

1.4.1.3 Hydraulic Calculations

Calculations must be as outlined in NFPA 13 except that calculations must be performed by computer using software intended specifically for fire protection system design using the design data shown on the drawings.

1.4.1.4 Operating and Maintenance (O&M) Instructions

Submit in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA as supplemented and modified by this specification section.

Provide six manuals and one pdf version on electronic media. The manuals must include the manufacturer's name, model number, parts list, list of parts and tools that should be kept in stock by the owner for routine maintenance, troubleshooting guide, and recommended service organization (including address and telephone number) for each item of equipment.

Submit spare parts data for each different item of material and equipment specified. The data must include a complete list of parts and supplies, and a list of parts recommended by the manufacturer to be replaced after 1-year and 3 years of service. Include a list of special tools and test equipment required for maintenance and testing of the products supplied.

1.4.2 Qualifications

1.4.2.1 Sprinkler System Designer

The sprinkler system designer must be certified as a Level III Technician by National Institute for Certification in Engineering Technologies (NICET) in the Water-Based Systems Layout subfield of Fire Protection Engineering Technology in accordance with NICET 1014-7.

1.4.2.2 Sprinkler System Installer

The sprinkler system installer must be regularly engaged in the installation of the type and complexity of system specified in the contract documents, and must have served in a similar capacity for at least three systems that have performed in the manner intended for a period of not less than 6 months.

1.4.3 Regulatory Requirements

Equipment and material must be listed or approved. Listed or approved, as used in this Section, means listed, labeled or approved by a Nationally Recognized Testing Laboratory (NRTL) such as UL Fire Prot Dir or FM APP GUIDE. The omission of these terms under the description of an item or equipment described must not be construed as waiving this requirement. All listings or approvals by testing laboratories must be from an existing ANSI or UL published standard. The recommended practices stated in the manufacturer's literature or documentation are mandatory requirements.

1.5 DELIVERY, STORAGE, AND HANDLING

Protect all equipment delivered and placed in storage from the weather,

excessive humidity and temperature variations, dirt and dust, or other contaminants. All pipes must be either capped or plugged until installed.

1.6 EXTRA MATERIALS

Spare sprinklers and wrench(es) must be provided as spare parts in accordance with NFPA 13.

PART 2 PRODUCTS

2.1 MATERIALS AND EQUIPMENT

2.1.1 Standard Products

Provide materials, equipment, and devices listed for fire protection service when so required by NFPA 13 or this specification. Select material from one manufacturer, where possible, and not a combination of manufacturers, for a classification of material. Material and equipment must be standard products of a manufacturer regularly engaged in the manufacture of the products for at least 2 years prior to bid.

2.1.2 Nameplates

Major components of equipment must have the manufacturer's name, address, type or style, model or serial number, catalog number, date of installation, installing Contractor's name and address, and the contract number provided on a new name plate permanently affixed to the item or equipment. Nameplates must be etched metal or plastic, permanently attached by screws to control units, panels or adjacent walls.

2.1.3 Identification and Marking

Pipe and fitting markings must include name or identifying symbol of manufacturer and nominal size. Pipe must be marked with ASTM designation. Valves and equipment markings must have name or identifying symbol of manufacturer, specific model number, nominal size, name of device, arrow indicating direction of flow, and position of installation (horizontal or vertical), except if valve can be installed in either position. Markings must be included on the body casting or on an etched or stamped metal nameplate permanently on the valve or cover plate.

2.1.4 Pressure Ratings

Valves, fittings, couplings, alarm switches, and similar devices must be rated for the maximum working pressures that can be experienced in the system, but in no case less than 175 psi.

2.2 UNDERGROUND PIPING COMPONENTS

2.2.1 Pipe

Pipe must comply with NFPA 24. Minimum pipe size is 6 inches. Piping more than 5 feet outside the building walls must comply with Section 33 11 00 WATER UTILITY DISTRIBUTION PIPING. A continuous section of welded stainless steel fire water service piping from a point outside the building perimeter to a flanged fitting at least 1-foot above the finished floor within the building is acceptable.

2.2.2 Fittings and Gaskets

Fittings must be ductile-iron conforming to AWWA C110/A21.10 with cement mortar lining conforming to AWWA C104/A21.4. Gaskets must be suitable in design and size for the pipe with which such gaskets are to be used. Gaskets for ductile-iron pipe joints must conform to AWWA C111/A21.11.

2.2.3 Buried Utility Warning and Identification Tape

Provide detectable aluminum foil plastic backed tape or detectable magnetic plastic tape manufactured specifically for warning and identification of buried piping. Tape must be detectable by an electronic detection instrument. Provide tape, 3 inches minimum width, color coded for the utility involved with warning and identification imprinted in bold block letters continuously and repeatedly over the entire tape length. Warning and identification must read "CAUTION BURIED WATER PIPING BELOW" or similar wording. Use permanent code and letter coloring unaffected by moisture and other substances contained in trench backfill material.

2.3 ABOVEGROUND PIPING COMPONENTS

2.3.1 Steel Piping Components

2.3.1.1 Steel Pipe

Except as modified herein, steel pipe must be black as permitted by NFPA 13 and conform to the applicable provisions of ASTM A53/A53M, ASTM A135/A135M or ASTM A153/A153M.

Steel pipe must be Schedule 40 only.

2.3.1.2 Fittings

Fittings must be welded, threaded, or grooved-end type. Threaded fittings must be cast-iron conforming to ASME B16.4, malleable-iron conforming to ASME B16.3 or ductile-iron conforming to ASTM A536. Plain-end fittings with mechanical couplings, fittings that use steel gripping devices to bite into the pipe, steel press fittings and field welded fittings are not permitted. Fittings, mechanical couplings, and rubber gaskets must be supplied by the same manufacturer. Threaded fittings must use Teflon tape or manufacturer's approved joint compound. Reducing couplings are not permitted except as allowed by NFPA 13.

2.3.1.3 Grooved Mechanical Joints and Fittings

Joints and fittings must be designed for not less than 175 psi service and the product of the same manufacturer. Field welded fittings must not be used. Fitting and coupling housing must be malleable-iron conforming to ASTM A47/A47M, Grade 32510; ductile-iron conforming to ASTM A536, Grade 65-45-12. Rubber gasketed grooved-end pipe and fittings with mechanical couplings are permitted in pipe sizes 2 inches and larger. Gasket must be the flush type that fills the entire cavity between the fitting and the pipe. Nuts and bolts must be heat-treated steel conforming to ASTM A183 and must be cadmium-plated or zinc-electroplated.

2.3.1.4 Flanges

Flanges must conform to NFPA 13 and ASME B16.1. Gaskets must be non-asbestos compressed material in accordance with ASME B16.21, 1/16-inch

thick, and full face or self-centering flat ring type.

2.3.2 Pipe Hangers and Supports

Provide galvanized pipe hangersand supports in accordance with NFPA 13.

2.3.3 Valves

Provide valves of types approved for fire service. Valves must open by counterclockwise rotation.

2.3.3.1 Control Valve

Manually operated sprinkler control/gate valve must be outside stem and yoke (OS&Y) type and must be listed.

2.3.3.2 Check Valves

Check valves must comply with UL 312. Check valves 4 inches and larger must be of the swing type, have a clear waterway and meet the requirements of MSS SP-71, for Type 3 or 4. Inspection plate must be provided on valves larger than 6 inches.

2.3.3.3 Hose Valve

Valve must comply with UL 668.

2.3.4 Alarm Valves

Provide variable pressure type alarm check valve, standard trim piping, pressure gauges, bypass, retarding chamber, testing valves, and main drain, and other components as required for a fully operational system. Alarm valves must comply with UL 193.

2.4 ALARM INITIATING AND SUPERVISORY DEVICES

2.4.1 Sprinkler Alarm Switch

Vane or pressure-type flow switch(es). Connection of switch must be by the fire alarm installer. Vane type alarm actuating devices must have mechanical diaphragm controlled retard device adjustable from 10 to 60 seconds and must instantly recycle.

2.4.2 Valve Supervisory (Tamper) Switch

Switch must be integral to the control valve or suitable for mounting to the type of control valve to be supervised open. The switch must be tamper resistant and contain SPDT (Form C) contacts arranged to transfer upon removal of the housing cover or closure of the valve of more than two rotations of the valve stem.

2.5 BACKFLOW PREVENTION ASSEMBLY

Double-check valve assembly backflow preventer complying with ASSE 1013, ASSE 1015 and AWWA M14. Each check valve must have a drain. Backflow prevention assemblies must have current "Certificate of Approval from the Foundation for Cross-Connection Control and Hydraulic Research, FCCCHR List" and be listed for fire protection use. Listing of the specific make, model, design, and size in the FCCCHR List is acceptable as the

required documentation.

2.5.1 Backflow Preventer Test Connection

Test connection must consist of a series of listed hose valves with 2 1/2-inch National Standard male hose threads with cap and chain.

2.6 FIRE DEPARTMENT CONNECTION

Fire department connection must be projecting type with cast-brass body, matching wall escutcheon lettered "Auto Spkr" with a polished-brass finish. The connection must have individual self-closing clappers, caps with drip drains and chains. Female inlets must have 2 1/2-inch diameter American National Fire Hose Connection Screw Threads (NH) per NFPA 1963. Comply with UL 405.

2.7 SPRINKLERS

Sprinklers must comply with UL 199 and NFPA 13. Sprinklers with internal O-rings are not acceptable. Sprinklers in high heat areas including attic spaces or in close proximity to unit heaters must have temperature classification in accordance with NFPA 13. Extended coverage sprinklers are permitted for loading docks, residential occupancies and high-piled storage applications only.

2.7.1 Pendent Sprinkler

Pendent sprinkler must be quick-response type with nominal K-factor of 5.6 for light hazard and 8.0 for ordinary hazard. Pendent sprinklers must have a polished chrome finish. Assembly must include an integral escutcheon.

2.7.2 Upright Sprinkler

Upright sprinkler must be brass quick-response type and have a nominal K-factor of 5.6 for light hazard areas and 8.0 for ordinary hazard areas..

2.7.3 Concealed Sprinkler

Concealed sprinkler must be chrome-plated quick-response type and have a nominal K-factor of 5.6. Coverplate must be chrome.

2.8 ACCESSORIES

2.8.1 Sprinkler Cabinet

Provide spare sprinklers in accordance with NFPA 13 and must be placed in a suitable metal or plastic cabinet of sufficient size to accommodate all the spare sprinklers and wrenches in designated locations. Spare sprinklers must be representative of, and in proportion to, the number of each type and temperature rating of the sprinklers installed as required by NFPA 13. At least one wrench of each type required must be provided.

2.8.2 Pendent Sprinkler Escutcheon

Escutcheon must be one-piece metallic type with a depth of less than 3/4-inch and suitable for installation on pendent sprinklers. The escutcheon must have a factory finish that matches the pendent sprinkler.

2.8.3 Pipe Escutcheon

Provide split hinge metal plates for piping entering walls, floors, and ceilings in exposed spaces. Provide polished stainless steel plates or chromium-plated finish on copper alloy plates in finished spaces. Provide paint finish on metal plates in unfinished spaces.

2.8.4 Sprinkler Guard

Listed guard must be a steel wire cage designed to encase the sprinkler and protect it from mechanical damage. Guards must be provided on sprinklers located in commuications, mechanical, janitor, and closet rooms.

2.8.5 Relief Valve

Relief valves must be listed and installed at the riser in accordance with NFPA 13.

2.8.6 Air Vent

Air vents must be of the manual type and piped to drain to the building exterior.

2.8.7 Identification Sign

Valve identification sign must be minimum 6 inches wide by 2 inches high with enamel baked finish on minimum 18 gage steel or 0.024-inch aluminum with red letters on a white background or white letters on red background. Wording of sign must include, but not be limited to "main drain", "auxiliary drain", "inspector's test", "alarm test", "alarm line", and similar wording as required to identify operational components. Where there is more than one sprinkler system, signage must include specific details as to the respective system.

PART 3 EXECUTION

3.1 VERIFYING ACTUAL FIELD CONDITIONS

Before commencing work, examine all adjoining work on which the contractor's work that is dependent for perfect workmanship according to the intent of this specification section, and report to the Contracting Officer's Representative a condition that prevents performance of first class work. No "waiver of responsibility" for incomplete, inadequate or defective adjoining work will be considered unless notice has been filed before submittal of a proposal.

3.2 INSTALLATION

The installation must be in accordance with the applicable provisions of NFPA 13, NFPA 24 and publications referenced therein. Locate sprinklers in a consistent pattern with ceiling grid, lights, and air supply diffusers. Install sprinkler system over and under ducts, piping and platforms when such equipment can negatively affect or disrupt the sprinkler discharge pattern and coverage.

a. Piping offsets, fittings, and other accessories required must be furnished to provide a complete installation and to eliminate interference with other construction.

b. Wherever the contractor's work interconnects with work of other trades the Contractor must coordinate with other Contractors to insure all Contractors have the information necessary so that they may properly install all necessary connections and equipment. Identify all work items needing access (dampers and similar equipment) that are concealed above hung ceilings by permanent color coded pins/tabs in the ceiling directly below the item.

c. Provide required supports and hangers for piping, conduit, and equipment so that loading will not exceed allowable loadings of structure. Submittal of a bid must be a deemed representation that the contractor submitting such bid has ascertained allowable loadings and has included in his estimates the costs associated in furnishing required supports.

3.2.1 Waste Removal

At the conclusion of each day's work, clean up and stockpile on site all waste, debris, and trash which may have accumulated during the day as a result of work by the contractor and of his presence on the job. Sidewalks and streets adjoining the property must be kept broom clean and free of waste, debris, trash and obstructions caused by work of the contractor, which will affect the condition and safety of streets, walks, utilities, and property.

3.3 UNDERGROUND PIPING INSTALLATION

The fire protection water main must be laid, and joints anchored, in accordance with NFPA 24. Minimum depth of cover must be 3 feet or the frost line, whichever is deeper. The supply line must terminate inside the building with a flanged piece, the bottom of which must be set not less than 1-foot above the finished floor. A blind flange must be installed temporarily on top of the flanged piece to prevent the entrance of foreign matter into the supply line. A concrete thrust block must be provided at the elbow where the pipe turns up toward the floor. In addition, joints must be anchored in accordance with NFPA 24. Buried steel components must be provided with a corrosion protective coating in accordance with AWWA C203. Piping more than 5 feet outside the building walls must meet the requirements of Section 33 11 00 WATER UTILITY DISTRIBUTION PIPING.

3.4 ABOVEGROUND PIPING INSTALLATION

The methods of fabrication and installation of the aboveground piping must fully comply with the requirements and recommended practices of NFPA 13 and this specification section.

3.4.1 Protection of Piping Against Earthquake Damage

Seismic restraint is not required.

3.4.2 Piping in Exposed Areas

Install exposed piping without diminishing exit access widths, corridors or equipment access. Exposed horizontal piping, including drain piping, must be installed to provide maximum headroom.

3.4.3 Piping in Finished Areas

In areas with suspended or dropped ceilings and in areas with concealed spaces above the ceiling, piping must be concealed above ceilings. Piping must be inspected, hydrostatically tested and approved before being concealed. Risers and similar vertical runs of piping in finished areas must be concealed.

3.4.4 Pendent Sprinklers

a. Drop nipples to pendent sprinklers must consist of minimum 1-inch pipe with a reducing coupling into which the sprinkler must be threaded.

b. Where sprinklers are installed below suspended or dropped ceilings, drop nipples must be cut such that sprinkler ceiling plates or escutcheons are of a uniform depth throughout the finished space. The outlet of the reducing coupling must not extend below the underside of the ceiling.

c. Recessed pendent sprinklers must be installed such that the distance from the sprinkler deflector to the underside of the ceiling must not exceed the manufacturer's listed range and must be of uniform depth throughout the finished area.

d. Pendent sprinklers in suspended ceilings must be located in the center of the tile (plus or minus 2 inches).

3.4.5 Upright Sprinklers

Riser nipples or "sprigs" to upright sprinklers must contain no fittings between the branch line tee and the reducing coupling at the sprinkler.

3.4.6 Pipe Joints

Pipe joints must conform to NFPA 13, except as modified herein. Not more than four threads must show after joint is made up. Welded joints will be permitted, only if welding operations are performed as required by NFPA 13 at the Contractor's fabrication shop, not at the project construction site. Flanged joints must be provided where indicated or required by NFPA 13. Grooved pipe and fittings must be prepared in accordance with the manufacturer's latest published specification according to pipe material, wall thickness and size. Grooved couplings, fittings and grooving tools must be products of the same manufacturer. For copper tubing, pipe and groove dimensions must comply with the tolerances specified by the coupling manufacturer. The diameter of grooves made in the field must be measured using a "go/no-go" gauge, vernier or dial caliper, narrow-land micrometer, or other method specifically approved by the coupling manufacturer for the intended application. Groove width and dimension of groove from end of pipe must be measured and recorded for each change in grooving tool setup to verify compliance with coupling manufacturer's tolerances.

3.4.7 Reducers

Reductions in pipe sizes must be made with one-piece tapered reducing fittings. When standard fittings of the required size are not manufactured, single bushings of the face or hex type will be permitted. Where used, face bushings must be installed with the outer face flush with the face of the fitting opening being reduced. Bushings cannot be used in

elbow fittings, in more than one outlet of a tee, in more than two outlets of a cross, or where the reduction in size is less than 1/2-inch.

3.4.8 Pipe Penetrations

a. Cutting structural members for passage of pipes or for pipe-hanger fastenings will not be permitted. Pipes that must penetrate concrete or masonry walls or concrete floors must be core-drilled and provided with pipe sleeves. Each sleeve must be Schedule 40 galvanized steel, ductile-iron or cast-iron pipe and extend through its respective wall or floor and be cut flush with each wall surface. Sleeves must provide required clearance between the pipe and the sleeve per NFPA 13. The space between the sleeve and the pipe must be firmly packed with mineral wool insulation.

b. In penetrations that are not fire-rated or not a floor penetration, the space between the sleeve and the pipe must be sealed at both ends with plastic waterproof cement that will dry to a firm but pliable mass or with a mechanically adjustable segmented elastomer seal.

c. All penetrations through the boundary of rooms/areas identified as secure space area must meet ICS 705-1.

3.4.9 Escutcheons

Escutcheons must be provided for pipe penetration in finished areas of ceilings, floors and walls. Escutcheons must be securely fastened to the pipe at surfaces through which piping passes.

3.4.10 Inspector's Test Connection

Unless otherwise indicated, the test connection must consist of 1-inch pipe connected to the remote branch line; a test valve located approximately 7 feet above the floor; a smooth bore brass outlet equivalent to the smallest orifice sprinkler used in the system; and a painted metal identification sign affixed to the valve with the words "Inspector's Test". All test connection piping must be inside of the building and penetrate the exterior wall at the location of the discharge orifice only. The discharge orifice must be located outside the building wall no more than 2 feet above finished grade, directed so as not to cause damage to adjacent construction or landscaping during full flow discharge, or to the sanitary sewer. Discharge to the exterior must not interfere with exiting from the facility. Water discharge or runoff must not cross the path of egress from the building. Do not discharge to the roof. Discharge to floor drains, janitor sinks or similar fixtures is not permitted.

Provide concrete splash blocks at all drain and inspector's test connection discharge locations if not discharging to a concrete surface. Splash blocks must be large enough to mitigate erosion and not become dislodged during a full flow of the drain. Ensure all discharged water drains away from the facility and does not cause property damage.

3.4.11 Backflow Preventer

Locate within the building.

Install backflow preventers so that the bottom of the assembly is a minimum of 6 inches above the finished floor/grade. Install vertical

backflow preventers so that the upper operating handwheel is no more than 6 feet above the finished floor/grade. Clearance around control valve handles must be minimum 6 inches above grade/finished floor and away from walls.

3.4.11.1 Test Connection

Provide downstream of the backflow prevention assembly UL 668 hose valves with 2.5-inch National Standard male hose threads with cap and chain. Provide one valve for each 250 gpm of system demand or fraction thereof. Provide a permanent sign in accordance with paragraph entitled "Identification Signs" which reads, "Test Valve". Indicate location of test header. If an exterior connection, provide a control valve inside a heated mechanical room to prevent freezing.

3.4.12 Drains

a. Main drain piping must be provided to discharge at a safe point outside the building, no more than 2 feet above finished grade. Provide a concrete splash block at drain outlet. Discharge to the exterior must not interfere with exiting from the facility. Water discharge or runoff must not cross the path of egress from the building.

b. Auxiliary drains must be provided as required by NFPA 13. Auxiliary drains are permitted to discharge to a floor drain if the drain is sized to accommodate full flow (min 40 gpm). Discharge to service sinks or similar plumbing fixtures is not permitted.

3.4.13 Installation of Fire Department Connection

Connection must be mounted on the exterior wall not lower than 3 feet and not higher than 4 feet above finished grade. The piping between the connection and the check valve must be provided with an automatic drip in accordance with NFPA 13 and piped to drain to the outside or a floor drain within the same room.

3.4.14 Identification Signs

Signs must be affixed to each control valve, inspector test valve, main drain, auxiliary drain, test valve, and similar valves as appropriate or as required by NFPA 13. Main drain test results must be etched into main drain identification sign. Hydraulic design data must be etched into the nameplates and permanently affixed to each sprinkler riser as specified in NFPA 13. Provide labeling on the surfaces of all feed and cross mains to show the pipe function (e.g., "Sprinkler System", "Fire Department Connection", "Standpipe") and normal valve position (e.g. "Normally Open", "Normally Closed"). For pipe sizes 4-inch and larger provide white painted stenciled letters and arrows, a minimum of 2 inches in height and visible from at least two sides when viewed from the floor. For pipe sizes less than 4-inch, provide white painted stenciled letters and arrows, a minimum of 0.75-inch in height and visible from the floor.

3.5 ELECTRICAL

Except as modified herein, electric equipment and wiring must be in accordance with Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Alarm signal wiring connected to the building fire alarm control system must be by the fire alarm installer.

3.6 PAINTING

Color code mark piping red.

3.7 FIELD QUALITY CONTROL

3.7.1 Test Procedures

Submit detailed test procedures, prepared and signed by the NICET Level III Fire Sprinkler Technician, and the representative of the installing company, and reviewed by the QFPE 30 days prior to performing system tests. Detailed test procedures must list all components of the installed system. Test procedures must include sequence of testing, time estimate for each test, and sample test data forms. The test data forms must be in a check-off format (pass/fail with space to add applicable test data; similar to the forms in NFPA 13). The test procedures and accompanying test data forms must be used for the pre-Government testing and the Government final testing.

a. Provide space to identify the date and time of each test. Provide space to identify the names and signatures of the individuals conducting and witnessing each test.

3.7.2 Pre-Government Testing

3.7.2.1 Verification of Compliant Installation

Conduct inspections and tests to ensure that equipment is functioning properly. Tests must meet the requirements of paragraph entitled "Minimum System Tests" and "System Acceptance" as noted in NFPA 13. The Contractor and QFPE must be in attendance at the pre-Government testing to make necessary adjustments. After inspection and testing is complete, provide a signed Verification of Compliant Installation letter by the QFPE that the installation is complete, compliant with the specification and fully operable. The letter must include the names and titles of the witnesses to the pre-Government tests. Provide all completion documentation as required by NFPA 13 and the test reports noted below.

a. NFPA 13 Aboveground Material and Test Certificate

b. NFPA 13 Underground Material and Test Certificate

3.7.2.2 Request for Government Final Test

When the verification of compliant installation has been completed, submit a formal request for Government final test to the Contracting Officers Designated Representative (COR). Government final testing will not be scheduled until the DFPE has received copies of the request for Government final testing and Verification of Compliant Installation letter with all required reports. Government final testing will not be performed until after the connections to the building fire alarm system have been completed and tested to confirm communications are fully functional. Submit request for test at least 15 calendar days prior to the requested test date.

3.7.3 Correction of Deficiencies

If equipment was found to be defective or non-compliant with contract

requirements, perform corrective actions and repeat the tests. Tests must be conducted and repeated if necessary until the system has been demonstrated to comply with all contract requirements.

3.7.4 Government Final Tests

The tests must be performed in accordance with the approved test procedures in the presence of the DFPE. Furnish instruments and personnel required for the tests. The following must be provided at the job site for Government Final Testing:

a. The manufacturer's technical representative.

b. The contractor's Qualified Fire Protection Engineer (QFPE).

c. Marked-up red line drawings of the system as actually installed.

Government Final Tests will be witnessed by the Contracting Officer and the Qualified Fire Protection Engineer (QFPE). At this time, all required tests noted in the paragraph "Minimum System Tests" must be repeated at their discretion.

3.8 MINIMUM SYSTEM TESTS

The system, including the underground water mains, and the aboveground piping and system components, must be tested to ensure that equipment and components function as intended. The underground and aboveground interior piping systems and attached appurtenances subjected to system working pressure must be tested in accordance with NFPA 13 and NFPA 24.

3.8.1 Underground Piping

3.8.1.1 Flushing

Underground piping must be flushed at a minimum of 10 fps in accordance with NFPA 24.

3.8.1.2 Hydrostatic Test

New underground piping must be hydrostatically tested in accordance with NFPA 24.

3.8.2 Aboveground Piping

3.8.2.1 Hydrostatic Test

Aboveground piping must be hydrostatically tested in accordance with NFPA 13. There must be no drop in gauge pressure or visible leakage when the system is subjected to the hydrostatic test. The test pressure must be read from a gauge located at the low elevation point of the system or portion being tested.

3.8.2.2 Backflow Prevention Assembly Forward Flow Test

Each backflow prevention assembly must be tested at system flow demand, including all applicable hose streams, as specified in NFPA 13. The Contractor must provide all equipment and instruments necessary to conduct a complete forward flow test, including 2.5-inch diameter hoses, playpipe nozzles or flow diffusers, calibrated pressure gauges, and pitot tube

gauge. The Contractor must provide all necessary supports to safely secure hoses and nozzles during the test. At the system demand flow, the pressure readings and pressure drop (friction loss) across the assembly must be recorded. A metal placard must be provided on the backflow prevention assembly that lists the pressure readings both upstream and downstream of the assembly, total pressure drop, and the system test flow rate determined during the preliminary testing. The pressure drop must be compared to the manufacturer's data and the readings observed during the final inspections and tests.

3.8.3 Main Drain Flow Test

Following flushing of the underground piping, a main drain test must be made to verify the adequacy of the water supply. Static and residual pressures must be recorded on the certificate specified in paragraph SUBMITTALS.

3.9 SYSTEM ACCEPTANCE

Following acceptance of the system, as-built drawings and O&M manuals must be delivered to the Contracting Officer for review and acceptance. Submit six sets of detailed as-built drawings. The drawings must show the system as installed, including deviations from both the project drawings and the approved shop drawings. These drawings must be submitted within two weeks after the final acceptance test of the system. At least one set of as-built (marked-up) drawings must be provided at the time of, or prior to the final acceptance test.

a. Provide one set of full size paper as-built drawings and schematics. The drawings must be prepared electronically and sized no less than the contract drawings. Furnish one set of CDs or DVDs containing software back-up and CAD based drawings in latest version of AutoCAD and portable document formats of as-built drawings and schematics.

b. Provide operating and maintenance (O&M) instructions.

3.10 ONSITE TRAINING

Conduct a training course for the responding fire department and operating and maintenance personnel as designated by the Contracting Officer. Training must be performed on two separate days (to accommodate different shifts of Fire Department personnel) for a period of 4 hours of normal working time and must start after the system is functionally complete and after the final acceptance test. The on-site training must cover all of the items contained in the approved Operating and Maintenance Instructions.

-- End of Section --

SECTION 22 00 00

PLUMBING, GENERAL PURPOSE
11/15

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR-CONDITIONING, HEATING AND REFRIGERATION INSTITUTE (AHRI)

AHRI 1010	(2002) Self-Contained, Mechanically Refrigerated Drinking-Water Coolers

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI Z21.22/CSA 4.4	(2015; R 2020) Relief Valves for Hot Water Supply Systems

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 90.1 - IP	(2013) Energy Standard for Buildings Except Low-Rise Residential Buildings
ASHRAE 189.1	(2014) Standard for the Design of High-Performance Green Buildings Except Low-Rise Residential Buildings

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME A112.1.2	(2012; R 2017) Air Gaps in Plumbing Systems (For Plumbing Fixtures and Water-Connected Receptors)
ASME A112.6.1M	(1997; R 2017) Floor Affixed Supports for Off-the-Floor Plumbing Fixtures for Public Use
ASME A112.6.3	(2019) Standard for Floor and Trench Drains
ASME A112.18.1/CSA B125.1	(2018) Plumbing Supply Fittings
ASME A112.19.2/CSA B45.1	(2018; ERTA 2018) Standard for Vitreous China Plumbing Fixtures and Hydraulic Requirements for Water Closets and Urinals
ASME A112.19.3/CSA B45.4	(2017; Errata 2017) Stainless Steel Plumbing Fixtures
ASME A112.36.2M	(1991; R 2017) Cleanouts
ASME B1.20.1	(2013; R 2018) Pipe Threads, General Purpose (Inch)

ASME B16.3	(2021) Malleable Iron Threaded Fittings, Classes 150 and 300
ASME B16.5	(2020) Pipe Flanges and Flanged Fittings NPS 1/2 Through NPS 24 Metric/Inch Standard
ASME B16.15	(2018) Cast Copper Alloy Threaded Fittings Classes 125 and 250
ASME B16.18	(2018) Cast Copper Alloy Solder Joint Pressure Fittings
ASME B16.21	(2021) Nonmetallic Flat Gaskets for Pipe Flanges
ASME B16.22	(2018) Standard for Wrought Copper and Copper Alloy Solder Joint Pressure Fittings
ASME B16.50	(2013) Wrought Copper and Copper Alloy Braze-Joint Pressure Fittings
ASME B31.1	(2020) Power Piping
ASME B31.5	(2020) Refrigeration Piping and Heat Transfer Components
ASME B40.100	(2013) Pressure Gauges and Gauge Attachments
ASME BPVC SEC IV	(2017) BPVC Section IV-Rules for Construction of Heating Boilers
ASME BPVC SEC IX	(2017; Errata 2018) BPVC Section IX-Welding, Brazing and Fusing Qualifications
ASME CSD-1	(2021) Control and Safety Devices for Automatically Fired Boilers

AMERICAN SOCIETY OF SANITARY ENGINEERING (ASSE)

ASSE 1001	(2016) Performance Requirements for Atmospheric Type Vacuum Breakers
ASSE 1010	(2004) Performance Requirements for Water Hammer Arresters (ANSI approved 2004)
ASSE 1011	(2004; Errata 2004) Performance Requirements for Hose Connection Vacuum Breakers (ANSI approved 2004)
ASSE 1012	(2009) Performance Requirements for Backflow Preventer with an Intermediate Atmospheric Vent - (ANSI approved 2009)
ASSE 1013	(2021) Performance Requirements for Reduced Pressure Principle Backflow Prevention Assemblies

ASSE 1018	(2001; R 2021) Performance Requirements for Trap Seal Primer Valves - Potable Water Supplied (ANSI Approved 2002
ASSE 1019	(2011; R 2016) Performance Requirements for Wall Hydrant with Backflow Protection and Freeze Resistance
ASSE 1020	(2020) Performance Requirements for Pressure Vacuum Breaker Assemblies

AMERICAN WATER WORKS ASSOCIATION (AWWA)

AWWA 10084	(2017) Standard Methods for the Examination of Water and Wastewater
AWWA B301	(2018) Liquid Chlorine
AWWA C203	(2020) Coal-Tar Protective Coatings and Linings for Steel Water Pipelines - Enamel and Tape - Hot-Applied
AWWA C606	(2015) Grooved and Shouldered Joints
AWWA C651	(2014) Standard for Disinfecting Water Mains
AWWA C652	(2019) Disinfection of Water-Storage Facilities
AWWA C700	(2020) Cold-Water Meters - Displacement Type, Metal Alloy Main Case

AMERICAN WELDING SOCIETY (AWS)

AWS A5.8/A5.8M	(2019) Specification for Filler Metals for Brazing and Braze Welding
AWS B2.2/B2.2M	(2016) Specification for Brazing Procedure and Performance Qualification

ASTM INTERNATIONAL (ASTM)

ASTM A53/A53M	(2022) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
ASTM A105/A105M	(2021) Standard Specification for Carbon Steel Forgings for Piping Applications
ASTM A183	(2014; R 2020) Standard Specification for Carbon Steel Track Bolts and Nuts
ASTM A193/A193M	(2020) Standard Specification for Alloy-Steel and Stainless Steel Bolting Materials for High-Temperature Service and Other Special Purpose Applications

ASTM A515/A515M	(2017) Standard Specification for Pressure Vessel Plates, Carbon Steel, for Intermediate- and Higher-Temperature Service
ASTM A516/A516M	(2017) Standard Specification for Pressure Vessel Plates, Carbon Steel, for Moderate- and Lower-Temperature Service
ASTM A536	(1984; R 2019; E 2019) Standard Specification for Ductile Iron Castings
ASTM B32	(2020) Standard Specification for Solder Metal
ASTM B42	(2020) Standard Specification for Seamless Copper Pipe, Standard Sizes
ASTM B88	(2020) Standard Specification for Seamless Copper Water Tube
ASTM B88M	(2020) Standard Specification for Seamless Copper Water Tube (Metric)
ASTM B117	(2019) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM B306	(2020) Standard Specification for Copper Drainage Tube (DWV)
ASTM B370	(2012; R 2019) Standard Specification for Copper Sheet and Strip for Building Construction
ASTM B813	(2016) Standard Specification for Liquid and Paste Fluxes for Soldering of Copper and Copper Alloy Tube
ASTM C564	(2020a) Standard Specification for Rubber Gaskets for Cast Iron Soil Pipe and Fittings
ASTM C920	(2018) Standard Specification for Elastomeric Joint Sealants
ASTM D2000	(2018) Standard Classification System for Rubber Products in Automotive Applications
ASTM D2235	(2004; R 2016) Standard Specification for Solvent Cement for Acrylonitrile-Butadiene-Styrene (ABS) Plastic Pipe and Fittings
ASTM D2564	(2020) Standard Specification for Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Piping Systems
ASTM D2665	(2014) Standard Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain,

	Waste, and Vent Pipe and Fittings
ASTM D2822/D2822M	(2005; R 2011; E 2011) Standard Specification for Asphalt Roof Cement, Asbestos-Containing
ASTM D2855	(2015) Standard Practice for Making Solvent-Cemented Joints with Poly(Vinyl Chloride) (PVC) Pipe and Fittings
ASTM D3122	(1995; R 2009) Solvent Cements for Styrene-Rubber (SR) Plastic Pipe and Fittings
ASTM D3138	(2004; R 2016) Standard Specification for Solvent Cements for Transition Joints Between Acrylonitrile-Butadiene-Styrene (ABS) and Poly(Vinyl Chloride) (PVC) Non-Pressure Piping Components
ASTM D3139	(2019) Joints for Plastic Pressure Pipes Using Flexible Elastomeric Seals
ASTM D3212	(2020) Standard Specification for Joints for Drain and Sewer Plastic Pipes Using Flexible Elastomeric Seals
ASTM D3311	(2017) Standard Specification for Drain, Waste, and Vent (DWV) Plastic Fittings Patterns
ASTM E1	(2014) Standard Specification for ASTM Liquid-in-Glass Thermometers
ASTM F409	(2017) Standard Specification for Thermoplastic Accessible and Replaceable Plastic Tube and Tubular Fittings
ASTM F477	(2014; R 2021) Standard Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe
ASTM F493	(2020) Standard Specification for Solvent Cements for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe and Fittings
ASTM F891	(2016) Standard Specification for Coextruded Poly (Vinyl Chloride) (PVC) Plastic Pipe with a Cellular Core
ASTM F1760	(2016; R 2020) Standard Specification for Coextruded Poly(Vinyl Chloride) (PVC) Non-Pressure Plastic Pipe Having Reprocessed-Recycled Content

COPPER DEVELOPMENT ASSOCIATION (CDA)

CDA A4015	(2016; 14/17) Copper Tube Handbook

CSA GROUP (CSA)

CSA B45.5-17/IAPMO Z124	(2017; Errata 2017; Errata 2018) Plastic Plumbing Fixtures

INTERNATIONAL ASSOCIATION OF PLUMBING AND MECHANICAL OFFICIALS (IAPMO)

IAPMO PS 117	(2005b) Press Type Or Plain End Rub Gasketed W/ Nail CU & CU Alloy Fittings 4 Install On CU Tubing

INTERNATIONAL CODE COUNCIL (ICC)

ICC A117.1	(2017) Standard And Commentary Accessible and Usable Buildings and Facilities
ICC IPC	(2018) International Plumbing Code

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY (MSS)

MSS SP-25	(2018) Standard Marking System for Valves, Fittings, Flanges and Unions
MSS SP-58	(2018) Pipe Hangers and Supports - Materials, Design and Manufacture, Selection, Application, and Installation
MSS SP-70	(2011) Gray Iron Gate Valves, Flanged and Threaded Ends
MSS SP-72	(2010a) Ball Valves with Flanged or Butt-Welding Ends for General Service
MSS SP-78	(2011) Cast Iron Plug Valves, Flanged and Threaded Ends
MSS SP-80	(2019) Bronze Gate, Globe, Angle and Check Valves
MSS SP-110	(2010) Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends

NACE INTERNATIONAL (NACE)

NACE SP0169	(2013) Control of External Corrosion on Underground or Submerged Metallic Piping Systems

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)
NEMA MG 1	(2018) Motors and Generators

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 90A	(2021) Standard for the Installation of Air Conditioning and Ventilating Systems

NSF INTERNATIONAL (NSF)

NSF 372	(2016) Drinking Water System Components - Lead Content
NSF/ANSI 14	(2020) Plastics Piping System Components and Related Materials
NSF/ANSI 61	(2020) Drinking Water System Components - Health Effects

PLASTIC PIPE AND FITTINGS ASSOCIATION (PPFA)

PPFA Fire Man	(2016) Firestopping: Plastic Pipe in Fire Resistive Construction

PLUMBING AND DRAINAGE INSTITUTE (PDI)

PDI WH 201	(2010) Water Hammer Arresters Standard

SOCIETY OF AUTOMOTIVE ENGINEERS INTERNATIONAL (SAE)

SAE J1508	(2009) Hose Clamp Specifications

U.S. DEPARTMENT OF ENERGY (DOE)

Energy Star	(1992; R 2006) Energy Star Energy Efficiency Labeling System (FEMP)

U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)

PL 93-523	(1974; A 1999) Safe Drinking Water Act

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

10 CFR 430	Energy Conservation Program for Consumer Products
40 CFR 141.80	National Primary Drinking Water Regulations; Control of Lead and Copper; General Requirements
PL 109-58	Energy Policy Act of 2005 (EPAct05)

UNDERWRITERS LABORATORIES (UL)

UL 174	(2004; Reprint Oct 2021) UL Standard for Safety Household Electric Storage Tank Water Heaters

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control

approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Plumbing System

Detail drawings consisting of schedules, performance charts, instructions, diagrams, and other information to illustrate the requirements and operations of systems that are not covered by the Plumbing Code. Detail drawings for the complete plumbing system including piping layouts and locations of connections; dimensions for roughing-in, foundation, and support points; schematic diagrams and wiring diagrams or connection and interconnection diagrams. Detail drawings shall indicate clearances required for maintenance and operation. Where piping and equipment are to be supported other than as indicated, details shall include loadings and proposed support methods. Mechanical drawing plans, elevations, views, and details, shall be drawn to scale.

SD-03 Product Data

Fixtures

List of installed fixtures with manufacturer, model, and flow rate.

Flush Valve Water Closets

Flush Valve Urinals

Wall Hung Lavatories

Countertop Lavatories

Kitchen Sinks

Mop/Service Sinks

Drinking-Water Coolers; G

Plastic Shower Stalls

Water Heaters; G

Pumps; G

Backflow Prevention Assemblies; G

Shower Faucets; G

Welding

A copy of qualified procedures and a list of names and identification symbols of qualified welders and welding operators.

Vibration-Absorbing Features

Details of vibration-absorbing features, including arrangement,

foundation plan, dimensions and specifications.

SD-06 Test Reports

Tests, Flushing and Disinfection

Test reports in booklet form showing all field tests performed to adjust each component and all field tests performed to prove compliance with the specified performance criteria, completion and testing of the installed system. Each test report shall indicate the final position of controls.

Test of Backflow Prevention Assemblies; G.

Certification of proper operation shall be as accomplished in accordance with state regulations by an individual certified by the state to perform such tests. If no state requirement exists, the Contractor shall have the manufacturer's representative test the device, to ensure the unit is properly installed and performing as intended. The Contractor shall provide written documentation of the tests performed and signed by the individual performing the tests.

SD-07 Certificates

Materials and Equipment

Where equipment is specified to conform to requirements of the ASME Boiler and Pressure Vessel Code, the design, fabrication, and installation shall conform to the code.

Bolts

Written certification by the bolt manufacturer that the bolts furnished comply with the specified requirements.

SD-10 Operation and Maintenance Data

Plumbing System

Submit in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.

SD-11 Closeout Submittals

Water-Efficient Products

Energy-Efficient Water Heaters

1.3 STANDARD PRODUCTS

Specified materials and equipment shall be standard products of a manufacturer regularly engaged in the manufacture of such products. Specified equipment shall essentially duplicate equipment that has performed satisfactorily at least two years prior to bid opening. Standard products shall have been in satisfactory commercial or industrial use for 2 years prior to bid opening. The 2-year use shall include applications of equipment and materials under similar circumstances and of similar size. The product shall have been for sale on the commercial

market through advertisements, manufacturers' catalogs, or brochures during the 2 year period.

1.3.1 Alternative Qualifications

Products having less than a two-year field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturer's factory or laboratory tests, can be shown.

1.3.2 Service Support

The equipment items shall be supported by service organizations. Submit a certified list of qualified permanent service organizations for support of the equipment which includes their addresses and qualifications. These service organizations shall be reasonably convenient to the equipment installation and able to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

1.3.3 Manufacturer's Nameplate

Each item of equipment shall have a nameplate bearing the manufacturer's name, address, model number, and serial number securely affixed in a conspicuous place; the nameplate of the distributing agent will not be acceptable.

1.3.4 Modification of References

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word, "shall" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction", or words of similar meaning, to mean the Contracting Officer.

1.3.4.1 Definitions

For the International Code Council (ICC) Codes referenced in the contract documents, advisory provisions shall be considered mandatory, the word "should" shall be interpreted as "shall." Reference to the "code official" shall be interpreted to mean the "Contracting Officer." References to the "permit holder" shall be interpreted to mean the "Contractor."

1.3.4.2 Administrative Interpretations

For ICC Codes referenced in the contract documents, the provisions of Chapter 1, "Administrator," do not apply. These administrative requirements are covered by the applicable Federal Acquisition Regulations (FAR) included in this contract and by the authority granted to the Officer in Charge of Construction to administer the construction of this project. References in the ICC Codes to sections of Chapter 1, shall be applied appropriately by the Contracting Officer as authorized by his administrative cognizance and the FAR.

1.4 DELIVERY, STORAGE, AND HANDLING

Handle, store, and protect equipment and materials to prevent damage before and during installation in accordance with the manufacturer's recommendations, and as approved by the Contracting Officer. Replace

damaged or defective items.

1.5 PERFORMANCE REQUIREMENTS

1.5.1 Welding

Piping shall be welded in accordance with qualified procedures using performance-qualified welders and welding operators. Procedures and welders shall be qualified in accordance with ASME BPVC SEC IX. Welding procedures qualified by others, and welders and welding operators qualified by another employer, may be accepted as permitted by ASME B31.1. The Contracting Officer shall be notified 24 hours in advance of tests, and the tests shall be performed at the work site if practicable. Welders or welding operators shall apply their assigned symbols near each weld they make as a permanent record.

1.5.2 Cathodic Protection and Pipe Joint Bonding

Cathodic protection and pipe joint bonding systems shall be sacrificial anode.

1.6 REGULATORY REQUIREMENTS

Unless otherwise required herein, plumbing work shall be in accordance with ICC IPC. Energy consuming products and systems shall be in accordance with PL 109-58 and ASHRAE 90.1 - IP

1.7 PROJECT/SITE CONDITIONS

The Contractor shall become familiar with details of the work, verify dimensions in the field, and advise the Contracting Officer of any discrepancy before performing any work.

1.8 INSTRUCTION TO GOVERNMENT PERSONNEL

When specified in other sections, furnish the services of competent instructors to give full instruction to the designated Government personnel in the adjustment, operation, and maintenance, including pertinent safety requirements, of the specified equipment or system. Instructors shall be thoroughly familiar with all parts of the installation and shall be trained in operating theory as well as practical operation and maintenance work.

Instruction shall be given during the first regular work week after the equipment or system has been accepted and turned over to the Government for regular operation. The number of man-days (8 hours per day) of instruction furnished shall be as specified in the individual section. When more than 4 man-days of instruction are specified, use approximately half of the time for classroom instruction. Use other time for instruction with the equipment or system.

When significant changes or modifications in the equipment or system are made under the terms of the contract, provide additional instruction to acquaint the operating personnel with the changes or modifications.

1.9 ACCESSIBILITY OF EQUIPMENT

Install all work so that parts requiring periodic inspection, operation, maintenance, and repair are readily accessible. Install concealed valves,

expansion joints, controls, dampers, and equipment requiring access, in locations freely accessible through access doors.

PART 2 PRODUCTS

2.1 PRODUCT SUSTAINABILITY CRITERIA

For products in this section, where applicable and to extent allowed by performance criteria, provide and document the following:

2.1.1 Water-Efficient Products

Provide documentation that the following products meet water efficiency requirements as outlined in this section and when applicable, that they are EPA WaterSense labeled products:

a. Fixtures

b. Flush valve water closets

c. Flush valve urinals

e. Wall hung lavatories

f. Countertop lavatories

g. Kitchen sinks

g. Service sinks

h. Drinking-water coolers

i. Water heaters

k. Pumps

l. Showerheads

2.1.2 Energy-Efficient Water Heaters

Provide documentation that the following products meet energy efficiency requirements as outlined in this section and when applicable, that they are Energy Star certified or FEMP-designated products:

a. Electric Resistance Water Heaters (Residential)

2.2 Materials

Materials for various services shall be in accordance with TABLES I and II. Pipe schedules shall be selected based on service requirements. Pipe fittings shall be compatible with the applicable pipe materials. Plastic pipe, fittings, and solvent cement shall meet NSF/ANSI 14 and shall be NSF listed for the service intended. Pipe threads (except dry seal) shall conform to ASME B1.20.1. Material or equipment containing a weighted average of greater than 0.25 percent lead shall not be used in any potable water system intended for human consumption, and shall be certified in accordance with NSF/ANSI 61, Annex G or NSF 372. In line devices such as water meters, building valves, check valves, meter stops, valves, fittings and back flow preventers shall comply with PL 93-523 and NSF/ANSI 61,

Section 8. End point devices such as drinking water fountains, lavatory faucets, kitchen and bar faucets, residential ice makers, supply stops and end point control valves used to dispense water for drinking must meet the requirements of NSF/ANSI 61, Section 9. Plastic pipe shall not be installed in a pressure piping system in buildings greater than three stories including any basement levels.

2.2.1 Pipe Joint Materials

Solder containing lead shall not be used with copper pipe.

a. Coupling for Steel Pipe: AWWA C606.

c. Couplings for Grooved Pipe: . Copper ASTM A536.

b. Flange Gaskets: Gaskets shall be made of non-asbestos material in accordance with ASME B16.21. Gaskets shall be flat, 1/16 inch thick, and contain Aramid fibers bonded with Styrene Butadiene Rubber (SBR) or Nitro Butadiene Rubber (NBR). Gaskets shall be the full face or self centering flat ring type. Gaskets used for hydrocarbon service shall be bonded with NBR.

c. Brazing Material: Brazing material shall conform to AWS A5.8/A5.8M, BCuP-5.

d. Brazing Flux: Flux shall be in paste or liquid form appropriate for use with brazing material. Flux shall be as follows: lead-free; have a 100 percent flushable residue; contain slightly acidic reagents; contain potassium borides; and contain fluorides.

e. Solder Material: Solder metal shall conform to ASTM B32.

f. Solder Flux: Flux shall be liquid form, non-corrosive, and conform to ASTM B813, Standard Test 1.

g. PTFE Tape: PTFE Tape, for use with Threaded Metal or Plastic Pipe.

h. Rubber Gaskets for Cast-Iron Soil-Pipe and Fittings (hub and spigot type and hubless type): ASTM C564.

i. Rubber Gaskets for Grooved Pipe: ASTM D2000, maximum temperature 230 degrees F.

j. Flexible Elastomeric Seals: ASTM D3139, ASTM D3212 or ASTM F477.

k. Bolts and Nuts for Grooved Pipe Couplings: Heat-treated carbon steel, ASTM A183.

l. Solvent Cement for Transition Joints between ABS and PVC Nonpressure Piping Components: ASTM D3138.

m. Plastic Solvent Cement for ABS Plastic Pipe: ASTM D2235.

n. Plastic Solvent Cement for PVC Plastic Pipe: ASTM D2564 and ASTM D2855.

o. Plastic Solvent Cement for CPVC Plastic Pipe: ASTM F493.

p. Flanged fittings including, but not limited to, flanges, bolts, nuts and bolt patterns shall be in accordance with ASME B16.5 class 150 and shall have the manufacturer's trademark affixed in accordance with MSS SP-25. Flange material shall conform to ASTM A105/A105M. Blind flange material shall conform to ASTM A516/A516M cold service and ASTM A515/A515M for hot service. Bolts shall be high strength or intermediate strength with material conforming to ASTM A193/A193M.

q. Plastic Solvent Cement for Styrene Rubber Plastic Pipe: ASTM D3122.

r. Press fittings for Copper Pipe and Tube: Copper press fittings shall conform to the material and sizing requirements of ASME B16.18 or ASME B16.22 and performance criteria of IAPMO PS 117. Sealing elements for copper press fittings shall be EPDM, FKM or HNBR. Sealing elements shall be factory installed or an alternative supplied fitting manufacturer. Sealing element shall be selected based on manufacturer's approved application guidelines.

s. Copper tubing shall conform to ASTM B88, Type K or L.

2.2.2 Miscellaneous Materials

Miscellaneous materials shall conform to the following:

a. Water Hammer Arrester: PDI WH 201. Water hammer arrester shall be piston type.

b. Copper, Sheet and Strip for Building Construction: ASTM B370.

c. Asphalt Roof Cement: ASTM D2822/D2822M.

d. Hose Clamps: SAE J1508.

b. Supports for Off-The-Floor Plumbing Fixtures: ASME A112.6.1M.

c. Metallic Cleanouts: ASME A112.36.2M.

d. Plumbing Fixture Setting Compound: A preformed flexible ring seal molded from hydrocarbon wax material. The seal material shall be nonvolatile nonasphaltic and contain germicide and provide watertight, gastight, odorproof and verminproof properties.

e. Liquid Chlorine: AWWA B301.

f. Gauges - Pressure and Vacuum Indicating Dial Type - Elastic Element: ASME B40.100.

g. Thermometers: ASTM E1. Mercury shall not be used in thermometers.

2.2.3 Pipe Insulation Material

Insulation shall be as specified in Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS.

2.3 PIPE HANGERS, INSERTS, AND SUPPORTS

Pipe hangers, inserts, and supports shall conform to MSS SP-58.

2.4 VALVES

Valves shall be provided on supplies to equipment and fixtures. Valves 2-1/2 inches and smaller shall be bronze with threaded bodies for pipe and solder-type connections for tubing. Valves 3 inches and larger shall have flanged iron bodies and bronze trim. Pressure ratings shall be based upon the application. Valves shall conform to the following standards:

Description	Standard
Cast-Iron Gate Valves, Flanged and Threaded Ends	MSS SP-70
Ball Valves with Flanged Butt-Welding Ends for General Service	MSS SP-72
Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends	MSS SP-110
Cast-Iron Plug Valves, Flanged and Threaded Ends	MSS SP-78
Bronze Gate, Globe, Angle, and Check Valves	MSS SP-80
Water Heater Drain Valves	ASME BPVC SEC IV, Part HLW-810: Requirements for Potable-Water Heaters Bottom Drain Valve
Trap Seal Primer Valves	ASSE 1018
Temperature and Pressure Relief Valves for Automatically Fired Hot Water Boilers	ASME CSD-1 Safety Code No., Part CW, Article 5

2.4.1 Wall Faucets/Hose Bibb

Wall faucets with vacuum-breaker backflow preventer shall be brass with 3/4 inch male inlet threads, hexagon shoulder, and 3/4 inch hose connection. Faucet handle shall be securely attached to stem.

2.4.2 Wall Hydrants (Frostproof)

ASSE 1019 with vacuum-breaker backflow preventer shall have a nickel-brass or nickel-bronze wall plate or flange with nozzle and detachable key handle. A brass or bronze operating rod shall be provided within a galvanized iron casing of sufficient length to extend through the wall so that the valve is inside the building, and the portion of the hydrant between the outlet and valve is self-draining. A brass or bronze valve with coupling and union elbow having metal-to-metal seat shall be provided. Valve rod and seat washer shall be removable through the face of the hydrant. The hydrant shall have 3/4 inch hose thread on spout and 3/4 inch male pipe thread on inlet.

2.4.3 Relief Valves

Water heaters and hot water storage tanks shall have a combination pressure and temperature (P&T) relief valve. The pressure relief element of a P&T relief valve shall have adequate capacity to prevent excessive pressure buildup in the system when the system is operating at the maximum rate of heat input. The temperature element of a P&T relief valve shall have a relieving capacity which is at least equal to the total input of the heaters when operating at their maximum capacity. Relief valves shall be rated according to ANSI Z21.22/CSA 4.4. Relief valves for systems where the maximum rate of heat input is less than 200,000 Btuh shall have 3/4 inch minimum inlets, and 3/4 inch outlets. Relief valves for systems where the maximum rate of heat input is greater than 200,000 Btuh shall have 1 inch minimum inlets, and 1 inch outlets. The discharge pipe from the relief valve shall be the size of the valve outlet.

2.4.4 Thermostatic Mixing Valves

Provide thermostatic mixing valve for lavatory faucets. Mixing valves, thermostatic type, pressure-balanced or combination thermostatic and pressure-balanced shall be line size and shall be constructed with rough or finish bodies either with or without plating. Each valve shall be constructed to control the mixing of hot and cold water and to deliver water at a desired temperature regardless of pressure or input temperature changes. The control element shall be of an approved type. The body shall be of heavy cast bronze, and interior parts shall be brass, bronze, corrosion-resisting steel or copper. The valve shall be equipped with necessary stops, check valves, unions, and sediment strainers on the inlets. Mixing valves shall maintain water temperature within 5 degrees F of any setting.

2.5 FIXTURES

Fixtures shall be water conservation type, in accordance with ASHRAE 189.1 Section 6.3.2.1 (Plumbing fixtures and Fittings). Fixtures for use by the physically handicapped shall be in accordance with ICC A117.1. Vitreous China, nonabsorbent, hard-burned, and vitrified throughout the body shall be provided. No fixture will be accepted that shows cracks, crazes, blisters, thin spots, or other flaws. Fixtures shall be equipped with appurtenances such as traps, faucets, stop valves, and drain fittings. Each fixture and piece of equipment requiring connections to the drainage system, except grease interceptors, shall be equipped with a trap. Brass expansion or toggle bolts capped with acorn nuts shall be provided for supports, and polished chromium-plated pipe, valves, and fittings shall be provided where exposed to view. Fixtures with the supply discharge below the rim shall be equipped with backflow preventers. Internal parts of flush valves and flushometer valves, pop-up stoppers of lavatory waste drains, and pop-up stoppers may contain acetal resin, fluorocarbon, nylon, acrylonitrile-butadiene-styrene (ABS) or other plastic material, if the material has provided satisfactory service under actual commercial or industrial operating conditions for not less than 2 years. Plastic in contact with hot water shall be suitable for 180 degrees F water temperature.

2.5.1 Flush Valve Water Closets

ASME A112.19.2/CSA B45.1, white vitreous china, siphon jet, elongated bowl, wall mounted, wall outlet. Top of toilet seat height above floor

shall be 14 to 15 inches, except 17 to 19 inches for wheelchair water closets. Provide wax bowl ring including plastic sleeve. Provide white solid plastic elongated open-front seat.

Water flushing volume of the water closet and flush valve combination shall not exceed 1.28 gallons per flush. Water closets must meet the EPA WaterSense product definition specified in http://www.epa.gov/watersense/partners/product_program_specs.html and must be EPA WaterSense labeled products. Provide ASME A112.6.1M concealed chair carriers with vertical steel pipe supports.

Provide large diameter flush valve including angle control-stop valve, vacuum breaker, tail pieces, slip nuts, and wall plates; exposed to view components shall be chromium-plated or polished stainless steel. Flush valves shall be nonhold-open type. Mount flush valves not less than 11 inches above the fixture. Mounted height of flush valve shall not interfere with the hand rail in ADA stalls.

2.5.2 Flush Valve Urinals

ASME A112.19.2/CSA B45.1, white vitreous china, ,wall-mounted, wall outlet, siphon jet, integral trap, and extended side shields. Provide urinal with the rim 17 inches above the floor. Provide urinal with the rim 24 inches above the floor. Water flushing volume of the urinal and flush valve combination shall not exceed 0.5 gallons per flush. Urinals must meet the specifications of http://www.epa.gov/watersense/partners/product_program_specs.html and must be EPA WaterSense labeled products. Provide ASME A112.6.1M concealed chair carriers with vertical steel pipe supports. Provide large diameter flush valve including angle control-stop valve, vacuum breaker, tail pieces, slip nuts, and wall plates; exposed to view components shall be chromium-plated or polished stainless steel. Flush valves shall be nonhold-open type. Mount flush valves not less than 11 inches above the fixture.

2.5.3 Wall Hung Lavatories

ASME A112.19.2/CSA B45.1, white vitreous china, ,straight back type, minimum dimensions of 19 inches, wide by 17 inches front to rear, with supply openings for use with top mounted centerset faucets, and openings for concealed arm carrier installation. Provide aerator with faucet. Water flow rate shall not exceed 0.5 gpm when measured at a flowing water pressure of 60 psi. Lavatory faucets and lavatory faucet accessories must meet the EPA WaterSense product definition specified in http://www.epa.gov/watersense/partners/product_program_specs.html and must be EPA WaterSense labeled products. Provide ASME A112.6.1M concealed chair carriers with vertical steel pipe supports and concealed arms for the lavatory. Mount lavatory with the front rim 34 inches above floor and with 29 inches minimum clearance from bottom of the front rim to floor. Provide top mounted washerless centerset lavatory faucets.

2.5.4 Countertop Lavatories

ASME A112.19.2/CSA B45.1, white vitreous china, ,self-rimming, minimum dimensions of 19 inches wide by 17 inches front to rear, with supply openings for use with top mounted centerset faucets. Furnish template and mounting kit by lavatory manufacturer. Provide aerator with faucet. Water flow rate shall not exceed 0.5 gpm when measured at a flowing water pressure of 60 psi. Lavatory faucets and lavatory faucet accessories must

meet the EPA WaterSense product definition specified in http://www.epa.gov/watersense/partners/product_program_specs.html and must be EPA WaterSense labeled products. Mount counter with the top surface 34 inches above floor and with 29 inches minimum clearance from bottom of the counter face to floor. Provide top mounted washerless centerset lavatory faucets.

2.5.5 Kitchen Sinks

ASME A112.19.3/CSA B45.4, 20 gage stainless steel with integral mounting rim for flush installation, minimum dimensions of 33 inches wide by 21 inches front to rear, two compartments, with undersides fully sound deadened, with supply openings for use with top mounted washerless sink faucets with hose spray, and with 3.5 inch drain outlet. Provide aerator with faucet. Water flow rate shall not exceed 2.2 gpm when measured at a flowing water pressure of 60 psi. Provide stainless steel drain outlets and stainless steel cup strainers. Provide separate 1.5 inch P-trap and drain piping to vertical vent piping from each compartment. Provide top mounted washerless sink faucets with hose spray.

2.5.6 Drinking-Water Coolers

AHRI 1010 with more than a single thickness of metal between the potable water and the refrigerant in the heat exchanger, wall-hung, bubbler style, air-cooled condensing unit, 4.75 gph minimum capacity, stainless steel splash receptor and basin, bottle filler and stainless steel cabinet. Bubblers shall be controlled by push levers or push bars, front mounted or side mounted near the front edge of the cabinet. Bubbler spouts shall be mounted at maximum of 36 inches above floor and at front of unit basin. Spouts shall direct water flow at least 4 inches above unit basin and trajectory parallel or nearly parallel to the front of unit. Provide filters for chlorine in supply piping to faucets. Provide ASME A112.6.1M concealed steel pipe chair carriers.

2.5.7 Plastic Shower Stalls

CSA B45.5-17/IAPMO Z124 four piece white solid acrylic pressure molded fiberglass reinforced plastic shower stalls. Shower stalls shall be scratch resistant, waterproof, and reinforced. Showerhead water flow rate shall not exceed 1.5 gpm when measured at a flowing water pressure of 80 psi. Provide recessed type shower stalls approximately 36 inches wide, 36 inches front to rear, 76 inches high, and 5 inch high curb with shower stall bottom or feet firmly supported by a smooth level floor. Provide PVC shower floor drains and stainless steel strainers. Shower stalls shall meet performance requirements of CSA B45.5-17/IAPMO Z124 and shall be labeled by NAHB Research Foundation, Inc. for compliance. Install shower stall in accordance with the manufacturer's written instructions. Finish installation by covering shower stall attachment flanges with dry-wall in accordance with shower stall manufacturer's recommendation. Provide smooth 100 percent silicone rubber white bathtub caulk between the top, sides, and bottom of shower stalls and bathroom walls and floors.

2.5.8 Precast Terrazzo Mop/Service Sinks

36 inches by 36 inches by 12 inches. Terrazzo shall be made of marble chips cast in white portland cement to produce 3625 psi minimum compressive strength 7 days after casting. Provide floor outlet brass body drain cast integral with terrazzo, with nickel bronze strainers with stainless steel rim guard for mop sink. Chrome plated exposed hot and

cold water faucets ASME A112.18.1/CSA B125.1 wall mounted copper alloy with 3/4 inch hose connection, vacuum breaker and pail hook provided with a mop hanger suitable for four mops.

2.6 BACKFLOW PREVENTERS

Backflow prevention devices must be approved by the State or local regulatory agencies. If there is no State or local regulatory agency requirements, the backflow prevention devices must be listed by the Foundation for Cross-Connection Control & Hydraulic Research, or any other approved testing laboratory having equivalent capabilities for both laboratory and field evaluation of backflow prevention devices and assemblies.

Reduced pressure principle assemblies, double check valve assemblies, atmospheric (nonpressure) type vacuum breakers, and pressure type vacuum breakers shall be meet the above requirements.

Backflow preventers with intermediate atmospheric vent shall conform to ASSE 1012. Reduced pressure principle backflow preventers shall conform to ASSE 1013. Hose connection vacuum breakers shall conform to ASSE 1011. Pipe applied atmospheric type vacuum breakers shall conform to ASSE 1001. Pressure vacuum breaker assembly shall conform to ASSE 1020. Air gaps in plumbing systems shall conform to ASME A112.1.2.

2.7 DRAINS

2.7.1 Floor Drains

Floor drains shall consist of a galvanized body, integral seepage pan, and adjustable perforated or slotted chromium-plated bronze, nickel-bronze, or nickel-brass strainer, consisting of grate and threaded collar. Floor drains shall be cast iron except where metallic waterproofing membrane is installed. Drains shall be of double drainage pattern for embedding in the floor construction. The seepage pan shall have weep holes or channels for drainage to the drainpipe. The strainer shall be adjustable to floor thickness. A clamping device for attaching flashing or waterproofing membrane to the seepage pan without damaging the flashing or waterproofing membrane shall be provided when required. Drains shall be provided with threaded connection. Between the drain outlet and waste pipe, a neoprene rubber gasket conforming to ASTM C564 may be installed, provided that the drain is specifically designed for the rubber gasket compression type joint. Floor drains shall conform to ASME A112.6.3. Provide drain with trap primer connection, trap primer, and connection piping. Primer shall meet ASSE 1018.

2.7.2 Bathtub and Shower Faucets and Drain Fittings

Provide single control pressure equalizing bathtub and shower faucets with body mounted from behind the wall with threaded connections. Provide ball joint self-cleaning shower heads. Provide shower heads which deliver a maximum of 2.0 GPM per ASHRAE 189.1 Section 6.3.2.1 (Plumbing Fixtures and Fittings) requirements. Showerheads must meet the EPA WaterSense product definition specified in http://www.epa.gov/watersense/partners/product_program_specs.html and must be EPA WaterSense labeled products. Provide tubing mounted from behind the wall between bathtub faucets and shower heads and bathtub diverter spouts. Provide separate globe valves or angle valves with union connections in each supply to faucet. Provide trip-lever pop-up drain

fittings for above-the-floor drain installations. The top of drain pop-ups, drain outlets, tub overflow outlet, and; control handle for pop-up drain shall be chromium-plated or polished stainless steel. Linkage between drain pop-up and pop-up control handle at bathtub overflow outlet shall be copper alloy or stainless steel. Provide 1.5 inch copper alloy adjustable tubing with slip nuts and gaskets between bathtub overflow and drain outlet; chromium-plated finish is not required.

2.8 TRAPS

Unless otherwise specified, traps shall be plastic per ASTM F409 or copper-alloy adjustable tube type with slip joint inlet and swivel. Traps shall be without a cleanout. Provide traps with removable access panels for easy clean-out at sinks and lavatories. Tubes shall be copper alloy with walls not less than 0.032 inch thick within commercial tolerances, except on the outside of bends where the thickness may be reduced slightly in manufacture by usual commercial methods. Inlets shall have rubber washer and copper alloy nuts for slip joints above the discharge level. Swivel joints shall be below the discharge level and shall be of metal-to-metal or metal-to-plastic type as required for the application. Nuts shall have flats for wrench grip. Outlets shall have internal pipe thread, except that when required for the application, the outlets shall have sockets for solder-joint connections. The depth of the water seal shall be not less than 2 inches. The interior diameter shall be not more than 1/8 inch over or under the nominal size, and interior surfaces shall be reasonably smooth throughout. A copper alloy "P" trap assembly consisting of an adjustable "P" trap and threaded trap wall nipple with cast brass wall flange shall be provided for lavatories. The assembly shall be a standard manufactured unit and may have a rubber-gasketed swivel joint.

2.9 WATER HEATERS

Water heater types and capacities shall be as indicated. Each gas-fired water heater shall have controls with an adjustable range that includes 120 to 180 degrees F. Hot water systems utilizing recirculation systems shall be tied into building off-hour controls. The thermal efficiencies and standby heat losses shall conform to TABLE III for each type of water heater specified. The only exception is that storage water heaters and hot water storage tanks having more than 500 gallons storage capacity need not meet the standard loss requirement if the tank surface area is insulated to R-12.5 and if a standing light is not used. Plastic materials polyetherimide (PEI) and polyethersulfone (PES) are forbidden to be used for vent piping of combustion gases. A factory pre-charged expansion tank shall be installed on the cold water supply to each water heater. Expansion tanks shall be specifically designed for use on potable water systems and shall be rated for 200 degrees F water temperature and 150 psi working pressure. The expansion tank size and acceptance volume shall be as indicated.

2.9.1 Automatic Storage Type

Heaters shall be complete with control system, temperature gauge, and pressure gauge, and shall have ASME rated combination pressure and temperature relief valve. Automatic storage type heaters must meet the thermal efficiency and stand by loss requirements of the U.S. Department of Energy and the current edition of ASHRAE 90.1 - IP.

2.9.1.1 Electric Type

Electric type water heaters shall conform to UL 174 with dual heating elements. Each element shall be 4.5 KW. The elements shall be wired so that only one element can operate at a time.

2.10 PUMPS

2.10.1 Circulating Pumps

Domestic hot water circulating pumps shall be electrically driven, single-stage, centrifugal, with mechanical seals, suitable for the intended service. Pump and motor shall be supported by the piping on which it is installed. The shaft shall be one-piece, heat-treated, corrosion-resisting steel with impeller and smooth-surfaced housing of bronze.

Motor shall be totally enclosed, fan-cooled and shall have sufficient horsepower for the service required. Each pump motor shall be equipped with an across-the-line magnetic controller in a NEMA 250, Type 1 enclosure with "START-STOP" switch in cover.

Integral size motors shall be premium efficiency type in accordance with NEMA MG 1. Pump motors smaller than 1 hp Fractional horsepower pump motors shall have integral thermal overload protection in accordance with Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Guards shall shield exposed moving parts.

2.11 DOMESTIC WATER SERVICE METER

Cold water meters 2 inches and smaller shall be positive displacement type conforming to AWWA C700. Meter register may be round or straight reading type, as provided by the local utility. Meter shall be provided with a pulse generator, remote readout register and all necessary wiring and accessories.

Provide water meters to monitor use in building consuming indoor and outdoor water as required by DODI 4170.11 (Installation Energy Management). Implement sub-metering when authorized in writing by the installation. Refer to ASHRAE 189.1 Section 7.3.3 (Energy Consumption Management) for subsystem implementation.

Meters must be connected to the base wide energy and utility monitoring and control system (if this system exists) using the installation's advanced metering protocols.

2.12 MISCELLANEOUS PIPING ITEMS

2.12.1 Escutcheon Plates

Provide one piece or split hinge metal plates for piping entering floors, walls, and ceilings in exposed spaces. Provide chromium-plated on copper alloy plates or polished stainless steel finish in finished spaces. Provide paint finish on plates in unfinished spaces.

2.12.2 Pipe Sleeves

Provide where piping passes entirely through walls, roofs, and floors. Sleeves are not required where drain, waste, and vent (DWV) piping passes

through concrete floor slabs located on grade, except where penetrating a membrane waterproof floor.

2.12.2.1 Sleeves in Masonry and Concrete

Provide steel pipe sleeves or schedule 40 PVC plastic pipe sleeves. Sleeves are not required where drain, waste, and vent (DWV) piping passes through concrete floor slabs located on grade. Core drilling of masonry and concrete may be provided in lieu of pipe sleeves when cavities in the core-drilled hole are completely grouted smooth.

2.12.2.2 Sleeves Not in Masonry and Concrete

Provide 26 gage galvanized steel sheet or PVC plastic pipe sleeves.

2.12.3 Pipe Hangers (Supports)

Provide MSS SP-58 Type 1 with adjustable type steel support rods, except as specified or indicated otherwise. Attach to steel joists with Type 19 or 23 clamps and retaining straps. Attach to Steel W or S beams with Type 21, 28, 29, or 30 clamps. Attach to steel angles and vertical web steel channels with Type 20 clamp with beam clamp channel adapter. Attach to horizontal web steel channel and wood with drilled hole on centerline and double nut and washer. Attach to concrete with Type 18 insert or drilled expansion anchor. Provide Type 40 insulation protection shield for insulated piping.

2.12.4 Nameplates

Provide 0.125 inch thick melamine laminated plastic nameplates, black matte finish with white center core, for equipment, gages, thermometers, and valves; valves in supplies to faucets will not require nameplates. Accurately align lettering and engrave minimum of 0.25 inch high normal block lettering into the white core. Minimum size of nameplates shall be 1.0 by 2.5 inches. Key nameplates to a chart and schedule for each system. Frame charts and schedules under glass and place where directed near each system. Furnish two copies of each chart and schedule.

PART 3 EXECUTION

3.1 GENERAL INSTALLATION REQUIREMENTS

Piping located in air plenums shall conform to NFPA 90A requirements. Piping located in shafts that constitute air ducts or that enclose air ducts shall be noncombustible in accordance with NFPA 90A. Installation of plastic pipe where in compliance with NFPA may be installed in accordance with PPFA Fire Man. The plumbing system shall be installed complete with necessary fixtures, fittings, traps, valves, and accessories. Water and drainage piping shall be extended 5 feet outside the building, unless otherwise indicated. A full port ball valve and drain shall be installed on the water service line inside the building approximately 6 inches above the floor from point of entry. Piping shall be connected to the exterior service lines or capped or plugged if the exterior service is not in place. Sewer and water pipes shall be laid in separate trenches, except when otherwise shown. Exterior underground utilities shall be at least 12 inches below the finish grade or as indicated on the drawings. If trenches are closed or the pipes are otherwise covered before being connected to the service lines, the location of the end of each plumbing utility shall be marked with a stake

or other acceptable means. Valves shall be installed with control no lower than the valve body.

3.1.1 Water Pipe, Fittings, and Connections

3.1.1.1 Utilities

The piping shall be extended to fixtures, outlets, and equipment. The hot-water and cold-water piping system shall be arranged and installed to permit draining. The supply line to each item of equipment or fixture, except faucets, flush valves, or other control valves which are supplied with integral stops, shall be equipped with a shutoff valve to enable isolation of the item for repair and maintenance without interfering with operation of other equipment or fixtures. Supply piping to fixtures, faucets, hydrants, shower heads, and flushing devices shall be anchored to prevent movement.

3.1.1.2 Cutting and Repairing

The work shall be carefully laid out in advance, and unnecessary cutting of construction shall be avoided. Damage to building, piping, wiring, or equipment as a result of cutting shall be repaired by mechanics skilled in the trade involved.

3.1.1.3 Protection of Fixtures, Materials, and Equipment

Pipe openings shall be closed with caps or plugs during installation. Fixtures and equipment shall be tightly covered and protected against dirt, water, chemicals, and mechanical injury. Upon completion of the work, the fixtures, materials, and equipment shall be thoroughly cleaned, adjusted, and operated. Safety guards shall be provided for exposed rotating equipment.

3.1.1.4 Mains, Branches, and Runouts

Piping shall be installed as indicated. Pipe shall be accurately cut and worked into place without springing or forcing. Structural portions of the building shall not be weakened. Aboveground piping shall run parallel with the lines of the building, unless otherwise indicated. Branch pipes from service lines may be taken from top, bottom, or side of main, using crossover fittings required by structural or installation conditions. Supply pipes, valves, and fittings shall be kept a sufficient distance from other work and other services to permit not less than 1/2 inch between finished covering on the different services. Bare and insulated water lines shall not bear directly against building structural elements so as to transmit sound to the structure or to prevent flexible movement of the lines. Water pipe shall not be buried in or under floors unless specifically indicated or approved. Changes in pipe sizes shall be made with reducing fittings. Use of bushings will not be permitted except for use in situations in which standard factory fabricated components are furnished to accommodate specific accepted installation practice. Change in direction shall be made with fittings, except that bending of pipe 4 inches and smaller will be permitted, provided a pipe bender is used and wide sweep bends are formed. The center-line radius of bends shall be not less than six diameters of the pipe. Bent pipe showing kinks, wrinkles, flattening, or other malformations will not be acceptable.

3.1.1.5 Pipe Drains

Pipe drains indicated shall consist of 3/4 inch hose bibb with renewable seat and full port ball valve ahead of hose bibb. At other low points, 3/4 inch brass plugs or caps shall be provided. Disconnection of the supply piping at the fixture is an acceptable drain.

3.1.1.6 Expansion and Contraction of Piping

Allowance shall be made throughout for expansion and contraction of water pipe. Each hot-water and hot-water circulation riser shall have expansion loops or other provisions such as offsets and changes in direction where indicated and required. Risers shall be securely anchored as required or where indicated to force expansion to loops. Branch connections from risers shall be made with ample swing or offset to avoid undue strain on fittings or short pipe lengths. Horizontal runs of pipe over 50 feet in length shall be anchored to the wall or the supporting construction about midway on the run to force expansion, evenly divided, toward the ends. Sufficient flexibility shall be provided on branch runouts from mains and risers to provide for expansion and contraction of piping. Flexibility shall be provided by installing one or more turns in the line so that piping will spring enough to allow for expansion without straining. If mechanical grooved pipe coupling systems are provided, the deviation from design requirements for expansion and contraction may be allowed pending approval of Contracting Officer.

3.1.1.7 Commercial-Type Water Hammer Arresters

Commercial-type water hammer arresters shall be provided on hot- and cold-water supplies and shall be located as generally indicated, with precise location and sizing to be in accordance with PDI WH 201. Water hammer arresters, where concealed, shall be accessible by means of access doors or removable panels. Commercial-type water hammer arresters shall conform to ASSE 1010. Vertical capped pipe columns will not be permitted.

3.1.2 Joints

Installation of pipe and fittings shall be made in accordance with the manufacturer's recommendations. Mitering of joints for elbows and notching of straight runs of pipe for tees will not be permitted. Joints shall be made up with fittings of compatible material and made for the specific purpose intended.

3.1.2.1 Threaded

Threaded joints shall have American Standard taper pipe threads conforming to ASME B1.20.1. Only male pipe threads shall be coated with graphite or with an approved graphite compound, or with an inert filler and oil, or shall have a polytetrafluoroethylene tape applied.

3.1.2.2 Mechanical Couplings

Mechanical couplings may be used in conjunction with grooved pipe for aboveground, ferrous or non-ferrous, domestic hot and cold water systems, in lieu of unions, brazed, soldered, welded, flanged, or threaded joints.

Mechanical couplings are permitted in accessible locations including behind access plates. Flexible grooved joints will not be permitted, except as vibration isolators adjacent to mechanical equipment. Rigid

grooved joints shall incorporate an angle bolt pad design which maintains metal-to-metal contact with equal amount of pad offset of housings upon installation to ensure positive rigid clamping of the pipe.

Designs which can only clamp on the bottom of the groove or which utilize gripping teeth or jaws, or which use misaligned housing bolt holes, or which require a torque wrench or torque specifications will not be permitted.

Grooved fittings and couplings, and grooving tools shall be provided from the same manufacturer. Segmentally welded elbows shall not be used. Grooves shall be prepared in accordance with the coupling manufacturer's latest published standards. Grooving shall be performed by qualified grooving operators having demonstrated proper grooving procedures in accordance with the tool manufacturer's recommendations.

The Contracting Officer shall be notified 24 hours in advance of test to demonstrate operator's capability, and the test shall be performed at the work site, if practical, or at a site agreed upon. The operator shall demonstrate the ability to properly adjust the grooving tool, groove the pipe, and to verify the groove dimensions in accordance with the coupling manufacturer's specifications.

3.1.2.3 Unions and Flanges

Unions, flanges and mechanical couplings shall not be concealed in walls, ceilings, or partitions. Unions shall be used on pipe sizes 2-1/2 inches and smaller; flanges shall be used on pipe sizes 3 inches and larger.

3.1.2.4 Grooved Mechanical Joints

Grooves shall be prepared according to the coupling manufacturer's instructions. Grooved fittings, couplings, and grooving tools shall be products of the same manufacturer. Pipe and groove dimensions shall comply with the tolerances specified by the coupling manufacturer. The diameter of grooves made in the field shall be measured using a "go/no-go" gauge, vernier or dial caliper, narrow-land micrometer, or other method specifically approved by the coupling manufacturer for the intended application. Groove width and dimension of groove from end of pipe shall be measured and recorded for each change in grooving tool setup to verify compliance with coupling manufacturer's tolerances. Grooved joints shall not be used in concealed locations.

3.1.2.5 Copper Tube and Pipe

a. Brazed. Brazed joints shall be made in conformance with AWS B2.2/B2.2M, ASME B16.50, and CDA A4015 with flux and are acceptable for all pipe sizes. Copper to copper joints shall include the use of copper-phosphorus or copper-phosphorus-silver brazing metal without flux. Brazing of dissimilar metals (copper to bronze or brass) shall include the use of flux with either a copper-phosphorus, copper-phosphorus-silver or a silver brazing filler metal.

b. Soldered. Soldered joints shall be made with flux and are only acceptable for piping 2 inches and smaller. Soldered joints shall conform to ASME B31.5 and CDA A4015. Soldered joints shall not be used in compressed air piping between the air compressor and the receiver.

3.1.2.6 Plastic Pipe

Acrylonitrile-Butadiene-Styrene (ABS) pipe shall have joints made with solvent cement. PVC and CPVC pipe shall have joints made with solvent cement elastomeric, threading, (threading of Schedule 80 Pipe is allowed only where required for disconnection and inspection; threading of Schedule 40 Pipe is not allowed), or mated flanged.

3.1.2.7 Other Joint Methods

3.1.3 Dissimilar Pipe Materials

Connections between ferrous and non-ferrous copper water pipe shall be made with dielectric unions or flange waterways. Dielectric waterways shall have temperature and pressure rating equal to or greater than that specified for the connecting piping. Waterways shall have metal connections on both ends suited to match connecting piping. Dielectric waterways shall be internally lined with an insulator specifically designed to prevent current flow between dissimilar metals. Dielectric flanges shall meet the performance requirements described herein for dielectric waterways. Connecting joints between plastic and metallic pipe shall be made with transition fitting for the specific purpose.

3.1.4 Corrosion Protection for Buried Pipe and Fittings

Ductile iron, cast iron, and steel pipe, fittings, and joints shall have a protective coating. Additionally, ductile iron, cast iron, and steel pressure pipe shall have a cathodic protection system and joint bonding. The cathodic protection system, protective coating system, and joint bonding for cathodically protected pipe shall be sacrificial anode type . Coatings shall be selected, applied, and inspected in accordance with NACE SP0169 and as otherwise specified. The pipe shall be cleaned and the coating system applied prior to pipe tightness testing. Joints and fittings shall be cleaned and the coating system applied after pipe tightness testing. For tape coating systems, the tape shall conform to AWWA C203 and shall be applied with a 50 percent overlap. Primer utilized with tape type coating systems shall be as recommended by the tape manufacturer.

3.1.5 Pipe Sleeves and Flashing

Pipe sleeves shall be furnished and set in their proper and permanent location.

3.1.5.1 Sleeve Requirements

Unless indicated otherwise, provide pipe sleeves meeting the following requirements:

Secure sleeves in position and location during construction. Provide sleeves of sufficient length to pass through entire thickness of walls, ceilings, roofs, and floors.

A modular mechanical type sealing assembly may be installed in lieu of a waterproofing clamping flange and caulking and sealing of annular space between pipe and sleeve. The seals shall consist of interlocking synthetic rubber links shaped to continuously fill the annular space between the pipe and sleeve using galvanized steel bolts, nuts, and pressure plates. The links shall be loosely assembled with bolts to form

a continuous rubber belt around the pipe with a pressure plate under each bolt head and each nut. After the seal assembly is properly positioned in the sleeve, tightening of the bolt shall cause the rubber sealing elements to expand and provide a watertight seal between the pipe and the sleeve. Each seal assembly shall be sized as recommended by the manufacturer to fit the pipe and sleeve involved.

Sleeves shall not be installed in structural members, except where indicated or approved. Rectangular and square openings shall be as detailed. Each sleeve shall extend through its respective floor, or roof, and shall be cut flush with each surface, except for special circumstances. Pipe sleeves passing through floors in wet areas such as mechanical equipment rooms, lavatories, kitchens, and other plumbing fixture areas shall extend a minimum of 4 inches above the finished floor.

Unless otherwise indicated, sleeves shall be of a size to provide a minimum of 1/4 inch clearance between bare pipe or insulation and inside of sleeve or between insulation and inside of sleeve. Sleeves in bearing walls and concrete slab on grade floors shall be steel pipe or cast-iron pipe. Sleeves in nonbearing walls or ceilings may be steel pipe, cast-iron pipe, galvanized sheet metal with lock-type longitudinal seam, or plastic.

Except as otherwise specified, the annular space between pipe and sleeve, or between jacket over insulation and sleeve, shall be sealed as indicated with sealants conforming to ASTM C920 and with a primer, backstop material and surface preparation as specified in Section 07 92 00 JOINT SEALANTS. The annular space between pipe and sleeve, between bare insulation and sleeve or between jacket over insulation and sleeve shall not be sealed for interior walls which are not designated as fire rated.

Sleeves through below-grade walls in contact with earth shall be recessed 1/2 inch from wall surfaces on both sides. Annular space between pipe and sleeve shall be filled with backing material and sealants in the joint between the pipe and masonry wall as specified above. Sealant selected for the earth side of the wall shall be compatible with dampproofing/waterproofing materials that are to be applied over the joint sealant. Pipe sleeves in fire-rated walls shall be fire stopped with a UL listed system.

3.1.5.2 Flashing Requirements

Pipes passing through roof shall be installed through a 16 ounce copper flashing, each within an integral skirt or flange. Flashing shall be suitably formed, and the skirt or flange shall extend not less than 8 inches from the pipe and shall be set over the roof or floor membrane in a solid coating of bituminous cement. The flashing shall extend up the pipe a minimum of 10 inches. For cleanouts, the flashing shall be turned down into the hub and caulked after placing the ferrule. Pipes passing through pitched roofs shall be flashed, using lead or copper flashing, with an adjustable integral flange of adequate size to extend not less than 8 inches from the pipe in all directions and lapped into the roofing to provide a watertight seal. The annular space between the flashing and the bare pipe or between the flashing and the metal-jacket-covered insulation shall be sealed as indicated. Flashing for dry vents shall be turned down into the pipe to form a waterproof joint. Pipes, up to and including 10 inches in diameter, passing through roof or floor waterproofing membrane may be installed through a cast-iron sleeve with caulking recess, anchor lugs, flashing-clamp device, and pressure ring with brass bolts. Flashing

shield shall be fitted into the sleeve clamping device. Pipes passing through wall waterproofing membrane shall be sleeved as described above. A waterproofing clamping flange shall be installed.

3.1.5.3 Optional Counterflashing

Instead of turning the flashing down into a dry vent pipe, or caulking and sealing the annular space between the pipe and flashing or metal-jacket-covered insulation and flashing, counterflashing may be accomplished by utilizing the following:

a. A standard roof coupling for threaded pipe up to 6 inches in diameter.

b. A tack-welded or banded-metal rain shield around the pipe.

3.1.5.4 Pipe Penetrations of Slab on Grade Floors

Where pipes, fixture drains, floor drains, cleanouts or similar items penetrate slab on grade floors, except at penetrations of floors with waterproofing membrane as specified in paragraphs FLASHING REQUIREMENTS and WATERPROOFING, a groove 1/4 to 1/2 inch wide by 1/4 to 3/8 inch deep shall be formed around the pipe, fitting or drain. The groove shall be filled with a sealant as specified in Section 07 92 00 JOINT SEALANTS.

3.1.5.5 Pipe Penetrations

Provide sealants for all pipe penetrations. All pipe penetrations shall be sealed to prevent infiltration of air, insects, and vermin.

3.1.6 Fire Seal

Where pipes pass through fire walls, fire-partitions, fire-rated pipe chase walls or floors above grade, a fire seal shall be provided.

3.1.7 Supports

3.1.7.1 General

Hangers used to support piping 2 inches and larger shall be fabricated to permit adequate adjustment after erection while still supporting the load. Pipe guides and anchors shall be installed to keep pipes in accurate alignment, to direct the expansion movement, and to prevent buckling, swaying, and undue strain. Piping subjected to vertical movement when operating temperatures exceed ambient temperatures shall be supported by variable spring hangers and supports or by constant support hangers. In the support of multiple pipe runs on a common base member, a clip or clamp shall be used where each pipe crosses the base support member. Spacing of the base support members shall not exceed the hanger and support spacing required for an individual pipe in the multiple pipe run. Threaded sections of rods shall not be formed or bent.

3.1.7.2 Pipe Supports and Structural Bracing, Seismic Requirements

Piping and attached valves shall be supported and braced to resist seismic loads.

3.1.7.3 Pipe Hangers, Inserts, and Supports

Installation of pipe hangers, inserts and supports shall conform to

MSS SP-58 except as modified herein.

a. Types 5, 12, and 26 shall not be used.

b. Type 3 shall not be used on insulated pipe.

c. Type 18 inserts shall be secured to concrete forms before concrete is placed. Continuous inserts which allow more adjustment may be used if they otherwise meet the requirements for type 18 inserts.

d. Type 19 and 23 C-clamps shall be torqued per MSS SP-58 and shall have both locknuts and retaining devices furnished by the manufacturer. Field-fabricated C-clamp bodies or retaining devices are not acceptable.

e. Type 20 attachments used on angles and channels shall be furnished with an added malleable-iron heel plate or adapter.

f. Type 24 may be used only on trapeze hanger systems or on fabricated frames.

g. Type 39 saddles shall be used on insulated pipe 4 inches and larger when the temperature of the medium is 60 degrees F or higher. Type 39 saddles shall be welded to the pipe.

h. Type 40 shields shall:

(1) Be used on insulated pipe less than 4 inches.

(2) Be used on insulated pipe 4 inches and larger when the temperature of the medium is 60 degrees F or less.

(3) Have a high density insert for all pipe sizes. High density inserts shall have a density of 8 pcf or greater.

i. Horizontal pipe supports shall be spaced as specified in MSS SP-58 and a support shall be installed not over 1 foot from the pipe fitting joint at each change in direction of the piping. Pipe supports shall be spaced not over 5 feet apart at valves. Operating temperatures in determining hanger spacing for PVC or CPVC pipe shall be 120 degrees F for PVC and 180 degrees F for CPVC. Horizontal pipe runs shall include allowances for expansion and contraction.

j. Vertical pipe shall be supported at each floor, except at slab-on-grade, at intervals of not more than 15 feet nor more than 8 feet from end of risers, and at vent terminations. Vertical pipe risers shall include allowances for expansion and contraction.

k. Type 35 guides using steel, reinforced polytetrafluoroethylene (PTFE) or graphite slides shall be provided to allow longitudinal pipe movement. Slide materials shall be suitable for the system operating temperatures, atmospheric conditions, and bearing loads encountered. Lateral restraints shall be provided as needed. Where steel slides do not require provisions for lateral restraint the following may be used:

(1) On pipe 4 inches and larger when the temperature of the medium is 60 degrees F or higher, a Type 39 saddle, welded to the pipe, may freely rest on a steel plate.

(2) On pipe less than 4 inches a Type 40 shield, attached to the pipe or insulation, may freely rest on a steel plate.

(3) On pipe 4 inches and larger carrying medium less that 60 degrees F a Type 40 shield, attached to the pipe or insulation, may freely rest on a steel plate.

l. Pipe hangers on horizontal insulated pipe shall be the size of the outside diameter of the insulation. The insulation shall be continuous through the hanger on all pipe sizes and applications.

m. Where there are high system temperatures and welding to piping is not desirable, the type 35 guide shall include a pipe cradle, welded to the guide structure and strapped securely to the pipe. The pipe shall be separated from the slide material by at least 4 inches or by an amount adequate for the insulation, whichever is greater.

n. Hangers and supports for plastic pipe shall not compress, distort, cut or abrade the piping, and shall allow free movement of pipe except where otherwise required in the control of expansion/contraction.

3.1.7.4 Structural Attachments

Attachment to building structure concrete and masonry shall be by cast-in concrete inserts, built-in anchors, or masonry anchor devices. Inserts and anchors shall be applied with a safety factor not less than 5. Supports shall not be attached to metal decking. Supports shall not be attached to the underside of concrete filled floor or concrete roof decks unless approved by the Contracting Officer. Masonry anchors for overhead applications shall be constructed of ferrous materials only.

3.1.8 Welded Installation

Plumbing pipe weldments shall be as indicated. Changes in direction of piping shall be made with welding fittings only; mitering or notching pipe to form elbows and tees or other similar type construction will not be permitted. Branch connection may be made with either welding tees or forged branch outlet fittings. Branch outlet fittings shall be forged, flared for improvement of flow where attached to the run, and reinforced against external strains. Beveling, alignment, heat treatment, and inspection of weld shall conform to ASME B31.1. Weld defects shall be removed and repairs made to the weld, or the weld joints shall be entirely removed and rewelded. After filler metal has been removed from its original package, it shall be protected or stored so that its characteristics or welding properties are not affected. Electrodes that have been wetted or that have lost any of their coating shall not be used.

3.1.9 Pipe Cleanouts

Pipe cleanouts shall be the same size as the pipe except that cleanout plugs larger than 4 inches will not be required. A cleanout installed in connection with cast-iron soil pipe shall consist of a long-sweep 1/4 bend or one or two 1/8 bends extended to the place shown. An extra-heavy cast-brass or cast-iron ferrule with countersunk cast-brass head screw plug shall be caulked into the hub of the fitting and shall be flush with the floor. Cleanouts in connection with other pipe, where indicated, shall be T-pattern, 90-degree branch drainage fittings with cast-brass screw plugs, except plastic plugs shall be installed in plastic pipe. Plugs shall be the same size as the pipe up to and including 4 inches.

Cleanout tee branches with screw plug shall be installed at the foot of soil and waste stacks, at the foot of interior downspouts, on each connection to building storm drain where interior downspouts are indicated, and on each building drain outside the building. Cleanout tee branches may be omitted on stacks in single story buildings with slab-on-grade construction or where less than 18 inches of crawl space is provided under the floor. Cleanouts on pipe concealed in partitions shall be provided with chromium plated bronze, nickel bronze, nickel brass or stainless steel flush type access cover plates. Round access covers shall be provided and secured to plugs with securing screw. Square access covers may be provided with matching frames, anchoring lugs and cover screws. Cleanouts in finished walls shall have access covers and frames installed flush with the finished wall. Cleanouts installed in finished floors subject to foot traffic shall be provided with a chrome-plated cast brass, nickel brass, or nickel bronze cover secured to the plug or cover frame and set flush with the finished floor. Heads of fastening screws shall not project above the cover surface. Where cleanouts are provided with adjustable heads, the heads shall be cast iron.

3.2 WATER HEATERS AND HOT WATER STORAGE TANKS

3.2.1 Relief Valves

No valves shall be installed between a relief valve and its water heater or storage tank. The P&T relief valve shall be installed where the valve actuator comes in contact with the hottest water in the heater. Whenever possible, the relief valve shall be installed directly in a tapping in the tank or heater; otherwise, the P&T valve shall be installed in the hot-water outlet piping. A vacuum relief valve shall be provided on the cold water supply line to the hot-water storage tank or water heater and mounted above and within 6 inches above the top of the tank or water heater.

3.2.2 Heat Traps

Piping to and from each water heater and hot water storage tank shall be routed horizontally and downward a minimum of 2 feet before turning in an upward direction.

3.2.3 Connections to Water Heaters

Connections of metallic pipe to water heaters shall be made with dielectric unions or flanges.

3.2.4 Expansion Tank

A pre-charged expansion tank shall be installed on the cold water supply between the water heater inlet and the cold water supply shut-off valve. The Contractor shall adjust the expansion tank air pressure, as recommended by the tank manufacturer, to match incoming water pressure.

3.3 FIXTURES AND FIXTURE TRIMMINGS

Polished chromium-plated pipe, valves, and fittings shall be provided where exposed to view. Angle stops, straight stops, stops integral with the faucets, or concealed type of lock-shield, and loose-key pattern stops for supplies with threaded, sweat or solvent weld inlets shall be furnished and installed with fixtures. Where connections between copper tubing and faucets are made by rubber compression fittings, a beading tool

shall be used to mechanically deform the tubing above the compression fitting. Exposed traps and supply pipes for fixtures and equipment shall be connected to the rough piping systems at the wall, unless otherwise specified under the item. Floor and wall escutcheons shall be as specified. Drain lines and hot water lines of fixtures for handicapped personnel shall be insulated and do not require polished chrome finish. Plumbing fixtures and accessories shall be installed within the space shown.

3.3.1 Fixture Connections

Where space limitations prohibit standard fittings in conjunction with the cast-iron floor flange, special short-radius fittings shall be provided. Connections between earthenware fixtures and flanges on soil pipe shall be made gastight and watertight with a closet-setting compound or neoprene gasket and seal. Use of natural rubber gaskets or putty will not be permitted. Fixtures with outlet flanges shall be set the proper distance from floor or wall to make a first-class joint with the closet-setting compound or gasket and fixture used.

3.3.2 Flushometer Valves

Flushometer valves shall be secured to prevent movement by anchoring the long finished top spud connecting tube to wall adjacent to valve with approved metal bracket. Flushometer valves for water closets shall be installed 39 inches above the floor, except at water closets intended for use by the physically handicapped where flushometer valves shall be mounted at approximately 30 inches above the floor and arranged to avoid interference with grab bars. In addition, for water closets intended for handicap use, the flush valve handle shall be installed on the wide side of the enclosure.

3.3.3 Height of Fixture Rims Above Floor

Lavatories shall be mounted with rim 31 inches above finished floor. Wall-hung drinking fountains and water coolers shall be installed with rim 42 inches above floor. Wall-hung service sinks shall be mounted with rim 28 inches above the floor. Installation of fixtures for use by the physically handicapped shall be in accordance with ICC A117.1.

3.3.4 Shower Bath Outfits

The area around the water supply piping to the mixing valves and behind the escutcheon plate shall be made watertight by caulking or gasketing.

3.3.5 Fixture Supports

Fixture supports for off-the-floor lavatories, urinals, water closets, and other fixtures of similar size, design, and use, shall be of the chair-carrier type. The carrier shall provide the necessary means of mounting the fixture, with a foot or feet to anchor the assembly to the floor slab. Adjustability shall be provided to locate the fixture at the desired height and in proper relation to the wall. Support plates, in lieu of chair carrier, shall be fastened to the wall structure only where it is not possible to anchor a floor-mounted chair carrier to the floor slab.

3.3.5.1 Support for Solid Masonry Construction

Chair carrier shall be anchored to the floor slab. Where a floor-anchored chair carrier cannot be used, a suitable wall plate shall be imbedded in the masonry wall.

3.3.5.2 Support for Concrete-Masonry Wall Construction

Chair carrier shall be anchored to floor slab. Where a floor-anchored chair carrier cannot be used, a suitable wall plate shall be fastened to the concrete wall using through bolts and a back-up plate.

3.3.5.3 Support for Steel Stud Frame Partitions

Chair carrier shall be used. The anchor feet and tubular uprights shall be of the heavy duty design; and feet (bases) shall be steel and welded to a square or rectangular steel tube upright. Wall plates, in lieu of floor-anchored chair carriers, shall be used only if adjoining steel partition studs are suitably reinforced to support a wall plate bolted to these studs.

3.3.5.4 Support for Wood Stud Construction

Where floor is a concrete slab, a floor-anchored chair carrier shall be used. Where entire construction is wood, wood crosspieces shall be installed. Fixture hanger plates, supports, brackets, or mounting lugs shall be fastened with not less than No. 10 wood screws, 1/4 inch thick minimum steel hanger, or toggle bolts with nut. The wood crosspieces shall extend the full width of the fixture and shall be securely supported.

3.3.5.5 Wall-Mounted Water Closet Gaskets

Where wall-mounted water closets are provided, reinforced wax, treated felt, or neoprene gaskets shall be provided. The type of gasket furnished shall be as recommended by the chair-carrier manufacturer.

3.3.6 Backflow Prevention Devices

Plumbing fixtures, equipment, and pipe connections shall not cross connect or interconnect between a potable water supply and any source of nonpotable water. Backflow preventers shall be installed where indicated and in accordance with ICC IPC at all other locations necessary to preclude a cross-connect or interconnect between a potable water supply and any nonpotable substance. In addition backflow preventers shall be installed at all locations where the potable water outlet is below the flood level of the equipment, or where the potable water outlet will be located below the level of the nonpotable substance. Backflow preventers shall be located so that no part of the device will be submerged. Backflow preventers shall be of sufficient size to allow unrestricted flow of water to the equipment, and preclude the backflow of any nonpotable substance into the potable water system. Bypass piping shall not be provided around backflow preventers. Access shall be provided for maintenance and testing. Each device shall be a standard commercial unit.

3.3.7 Access Panels

Access panels shall be provided for concealed valves and controls, or any item requiring inspection or maintenance. Access panels shall be of sufficient size and located so that the concealed items may be serviced,

maintained, or replaced.

3.3.8 Traps

Each trap shall be placed as near the fixture as possible, and no fixture shall be double-trapped. Traps installed on cast-iron soil pipe shall be cast iron. Traps installed on steel pipe or copper tubing shall be recess-drainage pattern, or brass-tube type. Traps installed on plastic pipe may be plastic conforming to ASTM D3311.

3.3.9 Shower Pans

Before installing shower pan, subfloor shall be free of projections such as nail heads or rough edges of aggregate. Drain shall be a bolt-down, clamping-ring type with weepholes, installed so the lip of the subdrain is flush with subfloor.

3.3.9.1 Plasticized Chlorinated Polyethylene Shower Pans

Corners of plasticized chlorinated polyethylene shower pans shall be folded against the upstand by making a pig-ear fold. Hot-air gun or heat lamp shall be used in making corner folds. Each pig-ear corner fold shall be nailed or stapled 1/2 inch from the upper edge to hold it in place. Nails shall be galvanized large-head roofing nails. On metal framing or studs, approved duct tape shall be used to secure pig-ear fold and membrane. Where no backing is provided between the studs, the membrane slack shall be taken up by pleating and stapling or nailing to studding 1/2 inch from upper edge. To adhere the membrane to vertical surfaces, the back of the membrane and the surface to which it will be applied shall be coated with adhesive that becomes dry to the touch in 5 to 10 minutes, after which the membrane shall be pressed into place. Surfaces to be solvent-welded shall be clean. Surfaces to be joined with xylene shall be initially sprayed and vigorously cleaned with a cotton cloth, followed by final coating of xylene and the joining of the surfaces by roller or equivalent means. If ambient or membrane temperatures are below 40 degrees F the membrane and the joint shall be heated prior to application of xylene. Heat may be applied with hot-air gun or heat lamp, taking precautions not to scorch the membrane. Adequate ventilation and wearing of gloves are required when working with xylene. Membrane shall be pressed into position on the drain body, and shall be cut and fit to match so that membrane can be properly clamped and an effective gasket-type seal provided. On wood subflooring, two layers of 15 pound dry felt shall be installed prior to installation of shower pan to ensure a smooth surface for installation.

3.4 VIBRATION-ABSORBING FEATURES

Mechanical equipment, including compressors and pumps, shall be isolated from the building structure by approved vibration-absorbing features, unless otherwise shown. Each foundation shall include an adequate number of standard isolation units. Each unit shall consist of machine and floor or foundation fastening, together with intermediate isolation material, and shall be a standard product with printed load rating. Piping connected to mechanical equipment shall be provided with flexible connectors.

3.5 WATER METER REMOTE READOUT REGISTER

The remote readout register shall be mounted at the location indicated or

as directed by the Contracting Officer.

3.6 IDENTIFICATION SYSTEMS

3.6.1 Identification Tags

Identification tags made of brass, engraved laminated plastic, or engraved anodized aluminum, indicating service and valve number shall be installed on valves, except those valves installed on supplies at plumbing fixtures. Tags shall be 1-3/8 inch minimum diameter, and marking shall be stamped or engraved. Indentations shall be black, for reading clarity. Tags shall be attached to valves with No. 12 AWG, copper wire, chrome-plated beaded chain, or plastic straps designed for that purpose.

3.6.2 Pipe Color Code Marking

Color code marking of piping shall be as specified in Section 09 90 00 PAINTS AND COATINGS.

3.6.3 Color Coding Scheme for Locating Hidden Utility Components

Scheme shall be provided in buildings having suspended grid ceilings. The color coding scheme shall identify points of access for maintenance and operation of operable components which are not visible from the finished space and installed in the space directly above the suspended grid ceiling. The operable components shall include valves, dampers, switches, linkages and thermostats. The color coding scheme shall consist of a color code board and colored metal disks. Each colored metal disk shall be approximately 3/8 inch in diameter and secured to removable ceiling panels with fasteners. The fasteners shall be inserted into the ceiling panels so that the fasteners will be concealed from view. The fasteners shall be manually removable without tools and shall not separate from the ceiling panels when panels are dropped from ceiling height. Installation of colored metal disks shall follow completion of the finished surface on which the disks are to be fastened. The color code board shall have the approximate dimensions of 3 foot width, 30 inches height, and 1/2 inch thickness. The board shall be made of wood fiberboard and framed under glass or 1/16 inch transparent plastic cover. Unless otherwise directed, the color code symbols shall be approximately 3/4 inch in diameter and the related lettering in 1/2 inch high capital letters. The color code board shall be mounted and located in the mechanical or equipment room.

3.7 ESCUTCHEONS

Escutcheons shall be provided at finished surfaces where bare or insulated piping, exposed to view, passes through floors, walls, or ceilings, except in boiler, utility, or equipment rooms. Escutcheons shall be fastened securely to pipe or pipe covering and shall be satin-finish, corrosion-resisting steel, polished chromium-plated zinc alloy, or polished chromium-plated copper alloy. Escutcheons shall be either one-piece or split-pattern, held in place by internal spring tension or setscrew.

3.8 PAINTING

Painting of pipes, hangers, supports, and other iron work, either in concealed spaces or exposed spaces, is specified in Section 09 90 00 PAINTS AND COATINGS.

3.8.1 Painting of New Equipment

New equipment painting shall be factory applied or shop applied, and shall be as specified herein, and provided under each individual section.

3.8.1.1 Factory Painting Systems

Manufacturer's standard factory painting systems may be provided subject to certification that the factory painting system applied will withstand 125 hours in a salt-spray fog test, except that equipment located outdoors shall withstand 500 hours in a salt-spray fog test. Salt-spray fog test shall be in accordance with ASTM B117, and for that test the acceptance criteria shall be as follows: immediately after completion of the test, the paint shall show no signs of blistering, wrinkling, or cracking, and no loss of adhesion; and the specimen shall show no signs of rust creepage beyond 0.125 inch on either side of the scratch mark.

The film thickness of the factory painting system applied on the equipment shall not be less than the film thickness used on the test specimen. If manufacturer's standard factory painting system is being proposed for use on surfaces subject to temperatures above 120 degrees F, the factory painting system shall be designed for the temperature service.

3.8.1.2 Shop Painting Systems for Metal Surfaces

Clean, pretreat, prime and paint metal surfaces; except aluminum surfaces need not be painted. Apply coatings to clean dry surfaces. Clean the surfaces to remove dust, dirt, rust, oil and grease by wire brushing and solvent degreasing prior to application of paint, except metal surfaces subject to temperatures in excess of 120 degrees F shall be cleaned to bare metal.

Where more than one coat of paint is specified, apply the second coat after the preceding coat is thoroughly dry. Lightly sand damaged painting and retouch before applying the succeeding coat. Color of finish coat shall be aluminum or light gray.

a. Temperatures Less Than 120 Degrees F: Immediately after cleaning, the metal surfaces subject to temperatures less than 120 degrees F shall receive one coat of pretreatment primer applied to a minimum dry film thickness of 0.3 mil, one coat of primer applied to a minimum dry film thickness of one mil; and two coats of enamel applied to a minimum dry film thickness of one mil per coat.

b. Temperatures Between 120 and 400 Degrees F: Metal surfaces subject to temperatures between 120 and 400 degrees F shall receive two coats of 400 degrees F heat-resisting enamel applied to a total minimum thickness of 2 mils.

3.9 TESTS, FLUSHING AND DISINFECTION

3.9.1 Plumbing System

The following tests shall be performed on the plumbing system in accordance with ICC IPC, except that the drainage and vent system final test shall include the smoke test. The Contractor has the option to perform a peppermint test in lieu of the smoke test. If a peppermint test is chosen, the Contractor must submit a testing procedure and reasons for

choosing this option in lieu of the smoke test to the Contracting Officer for approval.

a. Drainage and Vent Systems Test.

b. Building Sewers Tests.

c. Water Supply Systems Tests.

3.9.1.1 Test of Backflow Prevention Assemblies

Backflow prevention assembly shall be tested using gauges specifically designed for the testing of backflow prevention assemblies.

Backflow prevention assembly test gauges shall be tested annually for accuracy in accordance with the requirements of State or local regulatory agencies. If there is no State or local regulatory agency requirements, gauges shall be tested annually for accuracy in accordance with the requirements of University of Southern California's Foundation of Cross Connection Control and Hydraulic Research or the American Water Works Association Manual of Cross Connection (Manual M-14), or any other approved testing laboratory having equivalent capabilities for both laboratory and field evaluation of backflow prevention assembly test gauges. Report form for each assembly shall include, as a minimum, the following:

Data on Device	Data on Testing Firm
Type of Assembly	Name
Manufacturer	Address
Model Number	Certified Tester
Serial Number	Certified Tester No.
Size	Date of Test
Location	
Test Pressure Readings	Serial Number and Test Data of Gauges

If the unit fails to meet specified requirements, the unit shall be repaired and retested.

3.9.1.2 Shower Pans

After installation of the pan and finished floor, the drain shall be temporarily plugged below the weep holes. The floor area shall be flooded with water to a minimum depth of 1 inch for a period of 24 hours. Any drop in the water level during test, except for evaporation, will be reason for rejection, repair, and retest.

3.9.2 Defective Work

If inspection or test shows defects, such defective work or material shall be replaced or repaired as necessary and inspection and tests shall be

repeated. Repairs to piping shall be made with new materials. Caulking of screwed joints or holes will not be acceptable.

3.9.3 System Flushing

3.9.3.1 During Flushing

Before operational tests or disinfection, potable water piping system shall be flushed with potable water. Sufficient water shall be used to produce a water velocity that is capable of entraining and removing debris in all portions of the piping system. This requires simultaneous operation of all fixtures on a common branch or main in order to produce a flushing velocity of approximately 4 fps through all portions of the piping system. In the event that this is impossible due to size of system, the Contracting Officer (or the designated representative) shall specify the number of fixtures to be operated during flushing. Contractor shall provide adequate personnel to monitor the flushing operation and to ensure that drain lines are unobstructed in order to prevent flooding of the facility. Contractor shall be responsible for any flood damage resulting from flushing of the system. Flushing shall be continued until entrained dirt and other foreign materials have been removed and until discharge water shows no discoloration. All faucets and drinking water fountains, to include any device considered as an end point device by NSF/ANSI 61, Section 9, shall be flushed a minimum of 0.25 gallons per 24 hour period, ten times over a 14 day period.

3.9.3.2 After Flushing

System shall be drained at low points. Strainer screens shall be removed, cleaned, and replaced. After flushing and cleaning, systems shall be prepared for testing by immediately filling water piping with clean, fresh potable water. Any stoppage, discoloration, or other damage to the finish, furnishings, or parts of the building due to the Contractor's failure to properly clean the piping system shall be repaired by the Contractor. When the system flushing is complete, the hot-water system shall be adjusted for uniform circulation. Flushing devices and automatic control systems shall be adjusted for proper operation according to manufacturer's instructions. Comply with ASHRAE 90.1 - IP for minimum efficiency requirements. Unless more stringent local requirements exist, lead levels shall not exceed limits established by 40 CFR 141.80 (c)(1). The water supply to the building shall be tested separately to ensure that any lead contamination found during potable water system testing is due to work being performed inside the building.

3.9.4 Operational Test

Upon completion of flushing and prior to disinfection procedures, the Contractor shall subject the plumbing system to operating tests to demonstrate satisfactory installation, connections, adjustments, and functional and operational efficiency. Such operating tests shall cover a period of not less than 8 hours for each system and shall include the following information in a report with conclusion as to the adequacy of the system:

a. Time, date, and duration of test.

b. Water pressures at the most remote and the highest fixtures.

c. Operation of each fixture and fixture trim.

d. Operation of each valve, hydrant, and faucet.

e. Pump suction and discharge pressures.

f. Temperature of each domestic hot-water supply.

g. Operation of each floor drain by flooding with water.

h. Operation of each vacuum breaker and backflow preventer.

3.9.5 Disinfection

After all system components are provided and operational tests are complete, the entire domestic hot- and cold-water distribution system shall be disinfected. Before introducing disinfecting chlorination material, entire system shall be flushed with potable water until any entrained dirt and other foreign materials have been removed.

Water chlorination procedure shall be in accordance with AWWA C651 and AWWA C652 as modified and supplemented by this specification. The chlorinating material shall be hypochlorites or liquid chlorine. The chlorinating material shall be fed into the water piping system at a constant rate at a concentration of at least 50 parts per million (ppm). Feed a properly adjusted hypochlorite solution injected into the system with a hypochlorinator, or inject liquid chlorine into the system through a solution-feed chlorinator and booster pump until the entire system is completely filled.

Test the chlorine residual level in the water at 6 hour intervals for a continuous period of 24 hours. If at the end of a 6 hour interval, the chlorine residual has dropped to less than 25 ppm, flush the piping including tanks with potable water, and repeat the above chlorination procedures. During the chlorination period, each valve and faucet shall be opened and closed several times.

After the second 24 hour period, verify that no less than 25 ppm chlorine residual remains in the treated system. The 24 hour chlorination procedure must be repeated until no less than 25 ppm chlorine residual remains in the treated system.

Upon the specified verification, the system including tanks shall then be flushed with potable water until the residual chlorine level is reduced to less than one part per million. During the flushing period, each valve and faucet shall be opened and closed several times.

Take additional samples of water in disinfected containers, for bacterial examination, at locations specified by the Contracting Officer
Test these samples for total coliform organisms (coliform bacteria, fecal coliform, streptococcal, and other bacteria) in accordance with AWWA 10084. The testing method used shall be EPA approved for drinking water systems and shall comply with applicable local and state requirements.

Disinfection shall be repeated until bacterial tests indicate the absence of coliform organisms (zero mean coliform density per 100 milliliters) in the samples for at least 2 full days. The system will

not be accepted until satisfactory bacteriological results have been obtained.

3.10 POSTED INSTRUCTIONS

Framed instructions under glass or in laminated plastic, including wiring and control diagrams showing the complete layout of the entire system, shall be posted where directed. Condensed operating instructions explaining preventive maintenance procedures, methods of checking the system for normal safe operation, and procedures for safely starting and stopping the system shall be prepared in typed form, framed as specified above for the wiring and control diagrams and posted beside the diagrams. The framed instructions shall be posted before acceptance testing of the systems.

3.11 PERFORMANCE OF WATER HEATING EQUIPMENT

Standard rating condition terms are as follows:

EF = Energy factor, minimum overall efficiency.

ET = Minimum thermal efficiency with 70 degrees F delta T.

SL = Standby loss is maximum (Btu/h) based on a 70 degrees F temperature difference between stored water and ambient requirements.

V = Rated volume in gallons

Q = Nameplate input rate in kW (Btu/h)

3.11.1 Storage Water Heaters

3.11.1.1 Electric

a. Storage capacity of 60 gallons shall have a minimum energy factor (EF) of 0.93 or higher per FEMP requirements.

b. Storage capacity of 60 gallons or more shall have a minimum energy factor (EF) of 0.91 or higher per FEMP requirements.

3.12 TABLES

TABLE I

PIPE AND FITTING MATERIALS FOR DRAINAGE, WASTE, AND VENT PIPING SYSTEMS

Item #	Pipe and Fitting Materials	SERVICE A	SERVICE B	SERVICE C	SERVICE D	SERVICE E	SERVICE F
16	Copper drainage tube, (DWV), ASTM B306	X*	X	X*	X	X	

TABLE I

PIPE AND FITTING MATERIALS FOR DRAINAGE, WASTE, AND VENT PIPING SYSTEMS

Item #	Pipe and Fitting Materials	SERVICE A	SERVICE B	SERVICE C	SERVICE D	SERVICE E	SERVICE F
20	Polyvinyl Chloride plastic drain, waste and vent pipe and fittings, ASTM D2665, ASTM F891, (Sch 40) ASTM F1760	X	X	X	X	X	X

SERVICE:
A - Underground Building Soil, Waste and Storm Drain
B - Aboveground Soil, Waste, Drain In Buildings
C - Underground Vent
D - Aboveground Vent
E - Interior Rainwater Conductors Aboveground
F - Corrosive Waste And Vent Above And Belowground
* - Hard Temper

TABLE II

PIPE AND FITTING MATERIALS FOR PRESSURE PIPING SYSTEMS

Item #	Pipe and Fitting Materials	SERVICE A	SERVICE B	SERVICE C	SERVICE D
1	Malleable-iron threaded fittings:				
	a. Galvanized, ASME B16.3 for use with Item 4a	X	X	X	X
	b. Same as "a" but not galvanized for use with Item 4b			X	
4	Steel pipe:				
	a. Seamless, galvanized, ASTM A53/A53M, Type S, Grade B	X	X	X	X
	b. Seamless, black, ASTM A53/A53M, Type S, Grade B			X	
7	Seamless copper pipe, ASTM B42	X	X		X
8	Seamless copper water tube, ASTM B88, ASTM B88M	X**	X**	X**	X***

TABLE II

PIPE AND FITTING MATERIALS FOR PRESSURE PIPING SYSTEMS

Item #	Pipe and Fitting Materials	SERVICE A	SERVICE B	SERVICE C	SERVICE D
9	Cast bronze threaded fittings, ASME B16.15 for use with Items 5 and 7	X	X		X
10	Wrought copper and bronze solder-joint pressure fittings, ASME B16.22 for use with Items 5, 7 and 8	X	X	X	X
11	Cast copper alloy solder-joint pressure fittings, ASME B16.18 for use with Item 8	X	X	X	X
	SERVICE: A - Cold Water Service Aboveground B - Hot and Cold Water Distribution 180 degrees F Maximum Aboveground C - Compressed Air Lubricated D - Cold Water Service Belowground Indicated types are minimum wall thicknesses. ** - Type L - Hard *** - Type K - Hard temper with brazed joints only or type K-soft temper without joints in or under floors **** - In or under slab floors only brazed joints				

TABLE III

STANDARD RATING CONDITIONS AND MINIMUM PERFORMANCE RATINGS FOR WATER HEATING EQUIPMENT

FUEL	STORAGE CAPACITY GALLONS	INPUT RATING	TEST PROCEDURE	REQUIRED PERFORMANCE
A. STORAGE WATER HEATERS				
Electric	60 max.		10 CFR 430	EF = 0.67

TERMS:

EF = Energy factor, minimum overall efficiency.
ET = Minimum thermal efficiency with 70 degrees F delta T.
SL = Standby loss is maximum Btu/h based on a 70 degree F temperature difference between stored water and ambient requirements.
V = Rated storage volume in gallons
Q = Nameplate input rate in Btu/h

-- End of Section --

SECTION 23 05 93

TESTING, ADJUSTING, AND BALANCING FOR HVAC
11/15

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR MOVEMENT AND CONTROL ASSOCIATION INTERNATIONAL, INC. (AMCA)

AMCA 203	(1990; R 2011) Field Performance Measurements of Fan Systems

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 62.1	(2019; ADD A-G 2021; Errata 3 2021) Ventilation for Acceptable Indoor Air Quality

ASSOCIATED AIR BALANCE COUNCIL (AABC)

AABC MN-1	(2002; 6th ed) National Standards for Total System Balance
AABC MN-4	(1996) Test and Balance Procedures

NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB)

NEBB MASV	(2006) Procedural Standards for Measurements and Assessment of Sound and Vibration
NEBB PROCEDURAL STANDARDS	(2015) Procedural Standards for TAB (Testing, Adjusting and Balancing) Environmental Systems

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)

SMACNA 1780	(2002) HVAC Systems - Testing, Adjusting and Balancing, 3rd Edition
SMACNA 1858	(2004) HVAC Sound And Vibration Manual - First Edition
SMACNA 1972 CD	(2012) HVAC Air Duct Leakage Test Manual - 2nd Edition

1.2 DEFINITIONS

a. AABC: Associated Air Balance Council

b. COTR: Contracting Officer's Technical Representative

c. DALT: Duct air leakage test

d. DALT'd: Duct air leakage tested

e. HVAC: Heating, ventilating, and air conditioning; or heating, ventilating, and cooling

f. NEBB: National Environmental Balancing Bureau

g. Out-of-tolerance data: Pertains only to field acceptance testing of Final DALT or TAB report. When applied to DALT work, this phase means "a leakage rate measured during DALT field acceptance testing which exceeds the leakage rate allowed by SMACNA Leak Test Manual for an indicated duct construction and sealant class." When applied to TAB work this phase means "a measurement taken during TAB field acceptance testing which does not fall within the range of plus 5 to minus 5 percent of the original measurement reported on the TAB Report for a specific parameter."

h. Season of maximum heating load: The time of year when the outdoor temperature at the project site remains within plus or minus 30 degrees Fahrenheit of the project site's winter outdoor design temperature, throughout the period of TAB data recording.

i. Season of maximum cooling load: The time of year when the outdoor temperature at the project site remains within plus or minus 5 degrees Fahrenheit of the project site's summer outdoor design temperature, throughout the period of TAB data recording.

j. Season 1, Season 2: Depending upon when the project HVAC is completed and ready for TAB, Season 1 is defined, thereby defining Season 2. Season 1 could be the season of maximum heating load, or the season of maximum cooling load.

k. Sound measurements terminology: Defined in AABC MN-1, NEBB MASV, or SMACNA 1858 (TABB).

l. TAB: Testing, adjusting, and balancing (of HVAC systems)

m. TAB'd: HVAC Testing/Adjusting/Balancing procedures performed

n. TAB Agency: TAB Firm

o. TAB team field leader: TAB team field leader

p. TAB team supervisor: TAB team engineer

q. TAB team technicians: TAB team assistants

r. TABB: Testing Adjusting and Balancing Bureau

1.2.1 Similar Terms

In some instances, terminology differs between the Contract and the TAB Standard primarily because the intent of this Section is to use the industry standards specified, along with additional requirements listed herein to produce optimal results.

The following table of similar terms is provided for clarification only. Contract requirements take precedent over the corresponding AABC, NEBB, or TABB requirements where differences exist.

SIMILAR TERMS			
Contract Term	AABC Term	NEBB Term	TABB Term
TAB Standard	National Standards for Testing and Balancing Heating, Ventilating, and Air Conditioning Systems	Procedural Standards for Testing, Adjusting and Balancing of Environmental Systems	International Standards for Environmental Systems Balance
TAB Specialist	TAB Engineer	TAB Supervisor	TAB Supervisor
Systems Readiness Check	Construction Phase Inspection	Field Readiness Check & Preliminary Field Procedures	Field Readiness Check & Prelim. Field Procedures

1.3 WORK DESCRIPTION

The work includes duct air leakage testing (DALT) and testing, adjusting, and balancing (TAB) of new heating, ventilating, and cooling (HVAC) air and water distribution systems including equipment and performance data, ducts, and piping which are located within, on, under, between, and adjacent to buildings, including records of existing conditions.

Perform TAB in accordance with the requirements of the TAB procedural standard recommended by the TAB trade association that approved the TAB Firm's qualifications. Comply with requirements of AABC MN-1, NEBB PROCEDURAL STANDARDS, or SMACNA 1780 (TABB) as supplemented and modified by this specification section. All recommendations and suggested practices contained in the TAB procedural standards are considered mandatory.

Conduct DALT and TAB of the indicated existing systems and equipment and submit the specified DALT and TAB reports for approval. Conduct DALT testing in compliance with the requirements specified in SMACNA 1972 CD, except as supplemented and modified by this section. Conduct DALT and TAB work in accordance with the requirements of this section.

1.3.1 Air Distribution Systems

Test, adjust, and balance systems (TAB) in compliance with this section. Obtain Contracting Officer's written approval before applying insulation to exterior of air distribution systems as specified under Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS.

1.3.2 Water Distribution Systems

TAB systems in compliance with this section. Obtain Contracting Officer's written approval before applying insulation to water distribution systems

as specified under Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS. At Contractor's option and with Contracting Officer's written approval, the piping systems may be insulated before systems are TAB'd.

Terminate piping insulation immediately adjacent to each flow control valve, automatic control valve, or device. Seal the ends of pipe insulation and the space between ends of pipe insulation and piping, with waterproof vapor barrier coating.

After completion of work under this section, insulate the flow control valves and devices as specified under Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS.

1.3.3 TAB SCHEMATIC DRAWINGS

Show the following information on TAB Schematic Drawings:

1. A unique number or mark for each piece of equipment or terminal.

2. Air quantities at air terminals.

3. Air quantities and temperatures in air handling unit schedules.

4. Water quantities and temperatures in thermal energy transfer equipment schedules.

5. Water quantities and heads in pump schedules.

6. Water flow measurement fittings and balancing fittings.

7. Ductwork Construction and Leakage Testing Table that defines the DALT test requirements, including each applicable HVAC duct system ID or mark, duct pressure class, duct seal class, and duct leakage test pressure. This table is included in the file for Graphics for Unified Facilities Guide Specifications: http://www.wbdg.org/ffc/dod/unified-facilities-guide-specifications-ufgs/forms-gra

The Testing, Adjusting, and Balancing (TAB) Specialist must review the Contract Plans and Specifications and advise the Contracting Officer of any deficiencies that would prevent the effective and accurate TAB of the system, including records of existing conditions, and systems readiness check. The TAB Specialist must provide a Design Review Report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

Submit three copies of the TAB Schematic Drawings and Report Forms to the Contracting Officer, no later than 21 days prior to the start of TAB field measurements.

1.3.4 Related Requirements

1.4 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Records of Existing Conditions; G

TAB Firm; G

Designation of TAB Team Assistants; G

Designation of TAB Team Engineer; G or TAB Specialist; G

Designation of TAB Team Field Leader; G

SD-02 Shop Drawings

TAB Schematic Drawings and Report Forms; G

SD-03 Product Data

Equipment and Performance Data; G

TAB Related HVAC Submittals; G

A list of the TAB Related HVAC Submittals, no later than 7 days after the approval of the TAB team engineer and assistant.

TAB Procedures; G

Proposed procedures for TAB, submitted with the TAB Schematic Drawings and Report Forms.

Calibration; G

Systems Readiness Check; G

TAB Execution; G

TAB Verification; G

SD-06 Test Reports

Completed Pre-Final DALT Report; G

Certified Final DALT Report; G

TAB Design Review Report; G

TAB Report for Season 1; G

TAB Report for Season 2; G

SD-07 Certificates

Independent TAB Agency and Personnel Qualifications; G

DALT and TAB Submittal and Work Schedule; G

TAB Pre-Field Engineering Report; G

TAB Firm; G

Design Review Report; G

Pre-field DALT Preliminary Notification; G

Advanced Notice for TAB Field Work; G

1.5 QUALITY ASSURANCE

1.5.1 Independent TAB Agency and Personnel Qualifications

To secure approval for the proposed agency, submit information certifying that the TAB agency is a first tier subcontractor who is not affiliated with any other company participating in work on this contract, including design, furnishing equipment, or construction. Further, submit the following, for the agency, to Contracting Officer for approval:

a. Independent AABC or NEBB or TABB TAB agency:

TAB agency: AABC registration number and expiration date of current certification; or NEBB certification number and expiration date of current certification; or TABB certification number and expiration date of current certification.

TAB team supervisor: Name and copy of AABC or NEBB or TABB TAB supervisor certificate and expiration date of current certification.

TAB team field leader: Name and documented evidence that the team field leader has satisfactorily performed full-time supervision of TAB work in the field for not less than 3 years immediately preceding this contract's bid opening date.

TAB team field technicians: Names and documented evidence that each field technician has satisfactorily assisted a TAB team field leader in performance of TAB work in the field for not less than one year immediately preceding this contract's bid opening date.

Current certificates: Registrations and certifications are current, and valid for the duration of this contract. Renew Certifications which expire prior to completion of the TAB work, in a timely manner so that there is no lapse in registration or certification. TAB agency or TAB team personnel without a current registration or current certification are not to perform TAB work on this contract.

b. TAB Team Members: TAB team approved to accomplish work on this contract are full-time employees of the TAB agency. No other personnel is allowed to do TAB work on this contract.

c. Replacement of TAB team members: Replacement of members may occur if each new member complies with the applicable personnel qualifications and each is approved by the Contracting Officer.

1.5.2 TAB Standard

Perform TAB in accordance with the requirements of the standard under which the TAB Firm's qualifications are approved, i.e., AABC MN-1, NEBB PROCEDURAL STANDARDS, or SMACNA 1780 unless otherwise specified

herein. All recommendations and suggested practices contained in the TAB Standard are considered mandatory. Use the provisions of the TAB Standard, including checklists, report forms, etc., as nearly as practical, to satisfy the Contract requirements. Use the TAB Standard for all aspects of TAB, including qualifications for the TAB Firm and Specialist and calibration of TAB instruments. Where the instrument manufacturer calibration recommendations are more stringent than those listed in the TAB Standard, adhere to the manufacturer's recommendations.

All quality assurance provisions of the TAB Standard such as performance guarantees are part of this contract. For systems or system components not covered in the TAB Standard, TAB procedures must be developed by the TAB Specialist. Where new procedures, requirements, etc., applicable to the Contract requirements have been published or adopted by the body responsible for the TAB Standard used (AABC, NEBB, or TABB), the requirements and recommendations contained in these procedures and requirements are considered mandatory, including the latest requirements of ASHRAE 62.1.

1.5.3 Qualifications

1.5.3.1 TAB Firm

The TAB Firm must be either a member of AABC or certified by the NEBB or the TABB and certified in all categories and functions where measurements or performance are specified on the plans and specifications, including building systems commissioning.

Certification must be maintained for the entire duration of duties specified herein. If, for any reason, the firm loses subject certification during this period, the Contractor must immediately notify the Contracting Officer and submit another TAB Firm for approval. Any firm that has been the subject of disciplinary action by either the AABC, the NEBB, or the TABB within the five years preceding Contract Award is not be eligible to perform any duties related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections to be performed by the TAB Firm will be considered invalid if the TAB Firm loses its certification prior to Contract completion and must be performed by an approved successor.

These TAB services are to assist the prime Contractor in performing the quality oversight for which it is responsible. The TAB Firm must be a prime subcontractor of the Contractor and be financially and corporately independent of the mechanical subcontractor, reporting directly to and paid by the Contractor.

1.5.3.2 TAB Specialist

The TAB Specialist must be either a member of AABC,an experienced technician of the Firm certified by the NEBB, or a Supervisor certified by the TABB. The certification must be maintained for the entire duration of duties specified herein. If, for any reason, the Specialist loses subject certification during this period, immediately notify the Contracting Officer and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by either the AABC, the NEBB, or the TABB within the five years preceding Contract Award is not eligible to perform any duties related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections performed by the TAB Specialist will be considered invalid if the TAB

Specialist loses its certification prior to Contract completion and must be performed by the approved successor.

1.5.3.3 TAB Specialist Responsibilities

TAB Specialist responsibilities include all TAB work specified herein and in related sections under his direct guidance. The TAB specialist is required to be onsite on a daily basis to direct TAB efforts. The TAB Specialist must participate in the commissioning process specified in Section 01 91 00.15 10 TOTAL BUILDING COMMISSIONING.

1.5.3.4 TAB Related HVAC Submittals

The TAB Specialist must prepare a list of the submittals from the Contract Submittal Register that relate to the successful accomplishment of all HVAC TAB. Accompany the submittals identified on this list with a letter of approval signed and dated by the TAB Specialist when submitted to the Government. Ensure that the location and details of ports, terminals, connections, etc., necessary to perform TAB are identified on the submittals.

1.5.4 Responsibilities

The Contractor is responsible for ensuring compliance with the requirements of this section. The following delineation of specific work responsibilities is specified to facilitate TAB execution of the various work efforts by personnel from separate organizations. This breakdown of specific duties is specified to facilitate adherence to the schedule listed in the paragraph TAB SUBMITTAL AND WORK SCHEDULE.

1.5.4.1 Contractor

a. TAB personnel: Ensure that the DALT work and the TAB work is accomplished by a group meeting the requirements specified in the paragraph TAB PERSONNEL QUALIFICATION REQUIREMENTS.

b. Pre-DALT/TAB meeting: Attend the meeting with the TAB Supervisor, and ensure that a representative is present for the sheetmetal contractor, mechanical contractor, electrical contractor, and automatic temperature controls contractor.

c. HVAC documentation: Furnish one complete set of the following HVAC-related documentation to the TAB agency:

(1) Contract drawings and specifications

(2) Approved submittal data for equipment

(3) Construction work schedule

(4) Up-to-date revisions and change orders for the previously listed items

d. Submittal and work schedules: Ensure that the schedule for submittals and work required by this section and specified in the paragraph TAB SUBMITTAL AND WORK SCHEDULE is met.

e. Coordination of supporting personnel:

Provide the technical personnel, such as factory representatives or HVAC controls installer required by the TAB field team to support the DALT and the TAB field measurement work.

Provide equipment mechanics to operate HVAC equipment and ductwork mechanics to provide the field designated test ports to enable TAB field team to accomplish the DALT and the TAB field measurement work. Ensure these support personnel are present at the times required by the TAB team, and cause no delay in the DALT and the TAB field work.

Conversely, ensure that the HVAC controls installer has required support from the TAB team field leader to complete the controls check out.

f. Deficiencies: Ensure that the TAB Agency supervisor submits all Design/Construction deficiency notifications directly to the Contracting officer within 3 days after the deficiency is encountered. Further, ensure that all such notification submittals are complete with explanation, including documentation, detailing deficiencies.

g. Prerequisite HVAC work: Complete check out and debugging of HVAC equipment, ducts, and controls prior to the TAB engineer arriving at the project site to begin the TAB work. Debugging includes searching for and eliminating malfunctioning elements in the HVAC system installations, and verifying all adjustable devices are functioning as designed. Include as prerequisite work items, the deficiencies pointed out by the TAB team supervisor in the design review report.

h. Prior to the TAB field team's arrival, ensure completion of the applicable inspections and work items listed in the TAB team supervisor's pre-field engineering report. Do not allow the TAB team to commence TAB field work until all of the following are completed.

(1) HVAC system installations are fully complete.

(2) HVAC prerequisite checkout work lists specified in the paragraph PRE-FIELD TAB ENGINEERING REPORT are completed, submitted, and approved. Ensure that the TAB Agency gets a copy of the approved prerequisite HVAC work checklist.

(3) DALT field checks for all systems are completed.

(4) HVAC system filters are clean for both Season 1 and Season 2 TAB field work.

i. Advance notice: Furnish to the Contracting Officer with advance written notice for the commencement of the DALT field work and for the commencement of the TAB field work.

j. Insulation work: For required DALT work , ensure that insulation is not installed on ducts to be DALT'd until DALT work on the subject ducts is complete. Later, ensure that openings in duct and machinery insulation coverings for TAB test ports are marked, closed and sealed.

1.5.4.2 TAB Agency

Provide the services of a TAB team which complies with the requirements of the paragraph INDEPENDENT TAB AGENCY PERSONNEL QUALIFICATIONS. The work

to be performed by the TAB agency is limited to testing, adjusting, and balancing of HVAC air and water systems to satisfy the requirements of this specification section.

1.5.4.3 TAB Team Supervisor

a. Overall management: Supervise and manage the overall TAB team work effort, including preliminary and technical DALT and TAB procedures and TAB team field work.

b. Pre-DALT/TAB meeting: Attend meeting with Contractor.

c. Design review report: Review project specifications and accompanying drawings to verify that the air systems and water systems are designed in such a way that the TAB engineer can accomplish the work in compliance with the requirements of this section. Verify the presence and location of permanently installed test ports and other devices needed, including gauge cocks, thermometer wells, flow control devices, circuit setters, balancing valves, and manual volume dampers.

d. Support required: Specify the technical support personnel required from the Contractor other than the TAB agency; such as factory representatives for temperature controls or for complex equipment. Inform the Contractor in writing of the support personnel needed and when they are needed. Furnish the notice as soon as the need is anticipated, either with the design review report, or the pre-field engineering report, the during the DALT or TAB field work.

e. Pre-field DALT preliminary notification: Monitor the completion of the duct installation of each system and provide the necessary written notification to the Contracting Officer.

f. Pre-field engineering report: Utilizing the following HVAC-related documentation; contract drawings and specifications, approved submittal data for equipment, up-to-date revisions and change orders; prepare this report.

g. Prerequisite HVAC work checklist: Ensure the Contractor gets a copy of this checklist at the same time as the pre-field engineering report is submitted.

h. Technical assistance for DALT work.

(1) Technical assistance: Provide immediate technical assistance to TAB field team.

(2) DALT field visit: Near the end of the DALT field work effort, visit the contract site to inspect the HVAC installation and the progress of the DALT field work. Conduct a site visit to the extent necessary to verify correct procedures are being implemented and to confirm the accuracy of the Pre-final DALT Report data which has been reported. Also, perform sufficient evaluation to allow the TAB supervisor to issue certification of the final report. Conduct the site visit full-time for a minimum of two 8 hour workdays duration.

i. Final DALT report: Certify the DALT report. This certification includes the following work:

(1) Review: Review the Pre-final DALT report data. From these field reports, prepare the Certified Final DALT report.

(2) TAB Verification: Verify adherence, by the TAB field team, to the procedures specified in this section.

j. Technical Assistance for TAB Work: Provide immediate technical assistance to the TAB field team for the TAB work.

(1) TAB field visit: At the midpoint of the Season 1 and Season 2 TAB field work effort, visit the contract site to inspect the HVAC installation and the progress of the TAB field work. Conduct site visit full-time for a minimum of two 8 hour workdays duration.

(2) TAB field visit: Near the end of the TAB field work effort, visit the contract site to inspect the HVAC installation and the progress of the TAB field work. Conduct site visit full-time for a minimum of two 8 hour workdays duration. Review the TAB final report data and certify the TAB final report.

(1) TAB field visit: Near the end of the TAB field work effort, visit the contract site to inspect the HVAC installation and the progress of the TAB field work. Conduct site visit full-time for a minimum of two 8 hour workdays duration. Review the TAB final report data and certify the TAB final report.

k. Certified TAB report: Certify the TAB report. This certification includes the following work:

(1) Review: Review the TAB field data report. From this field report, prepare the certified TAB report.

(2) Verification: Verify adherence, by the TAB field team, to the TAB plan prescribed by the pre-field engineering report and verify adherence to the procedures specified in this section.

l. Design/Construction deficiencies: Within 3 working days after the TAB Agency has encountered any design or construction deficiencies, the TAB Supervisor must submit written notification directly to the Contracting Officer, with a separate copy to the Contractor, of all such deficiencies. Provide in this submittal a complete explanation, including supporting documentation, detailing deficiencies. Where deficiencies are encountered that are believed to adversely impact successful completion of TAB, the TAB Agency must issue notice and request direction in the notification submittal.

m. TAB Field Check: The TAB team supervisor must attend and supervise TAB field check.

1.5.4.4 TAB Team Field Leader

a. Field manager: Manage, in the field, the accomplishment of the work specified in Part 3, EXECUTION.

b. Full time: Be present at the contract site when DALT field work or TAB field work is being performed by the TAB team; ensure day-to-day TAB team work accomplishments are in compliance with this section.

c. Prerequisite HVAC work: Do not bring the TAB team to the contract

site until a copy of the prerequisite HVAC Checklist, with all work items certified by the Contractor to be working as designed, reaches the office of the TAB Agency.

1.5.5 Test Reports

1.5.5.1 Data from DALT Field Work

Report the data for the Pre-final DALT Report and Certified Final DALT Report in compliance the following requirements:

a. Report format: Submit report data on Air Duct Leakage Test Summary Report Forms as shown on Page 6-2 of SMACNA 1972 CD. In addition, submit in the report, a marked duct shop drawing which identifies each section of duct tested with assigned node numbers for each section. Include node numbers in the completed report forms to identify each duct section. The TAB supervisor must review and certify the report.

b. The TAB supervisor must include a copy of all calculations prepared in determining the duct surface area of each duct test section. In addition,provide the ductwork air leak testing (DALT) reports with a copy(s) of the calibration curve for each of the DALT test orifices used for testing.

c. Instruments: List the types of instruments actually used to measure the data. Include in the listing each instrument's unique identification number, calibration date, and calibration expiration date. Instruments must have been calibrated within one year of the date of use in the field. Instrument calibration must be traceable to the measuring standards of the National Institute of Standards and Technology.

d. Certification: Include the typed name of the TAB supervisor and the dated signature of the TAB supervisor.

1.5.5.2 Certified TAB Reports

Submit: TAB Report for Season 1 and TAB Report for Season 2 in the following manner:

a. Report format: Submit the completed pre-field data forms approved in the pre-field TAB Engineering Report completed by TAB field team, reviewed and certified by the TAB supervisor. Bind the report with a waterproof front and back cover. Include a table of contents identifying by page number the location of each report. Report forms and report data must be typewritten. Handwritten report forms or report data are not acceptable.

b. Temperatures: On each TAB report form reporting TAB work accomplished on HVAC thermal energy transfer equipment, include the indoor and outdoor dry bulb temperature range and indoor and outdoor wet bulb temperature range within which the TAB data was recorded. Include in the TAB report continuous time versus temperature recording data of wet and dry bulb temperatures for the rooms, or zones, as designated in the following list:

(1) Measure and compile data on a continuous basis for the period in which TAB work affecting those rooms is being done.

(2) Measure and record data only after the HVAC systems installations are complete, the systems fully balanced and the HVAC systems controls operating in fully automatic mode.

(3) Data may be compiled using direct digital controls trend logging where available. Otherwise, temporarily install calibrated time versus temperature/humidity recorders for this purpose. The HVAC systems and controls must be fully operational a minimum of 24 hours in advance of commencing data compilation.

c. System Diagrams: Provide updated diagrams with final installed locations of all terminals and devices, any numbering changes, and actual test locations. Use a key numbering system on the diagram which identifies each outlet contained in the outlet airflow report sheets.

d. Static Pressure Profiles: Report static pressure profiles for air duct systems. Report static pressure data for all supply, return, relief, exhaust and outside air ducts for the systems listed. Include the following in the static pressure report data, in addition to AABC/NEBB/TABB required data:

(1) Report supply fan, return fan, relief fan, and exhaust fan inlet and discharge static pressures.

(2) Report static pressure drop across chilled water coils, DX coils, hot water coils, steam coils, electric resistance heating coils and heat reclaim devices installed in unit cabinetry or the system ductwork.

(3) Report static pressure drop across outside air, return air, and supply air automatic control dampers, both proportional and two-position, installed in unit cabinetry.

(4) Report static pressure drop across air filters, acoustic silencers, moisture eliminators, air flow straighteners, air flow measuring stations or other pressure drop producing specialty items installed in unit cabinetry, or in the system ductwork. Examples of these specialty items are smoke detectors, white sound generators, RF shielding, wave guides, security bars, blast valves, small pipes passing through ductwork, and duct mounted humidifiers.

Do not report static pressure drop across duct fittings provided for the sole purpose of conveying air, such as elbows, transitions, offsets, plenums, manual dampers, and branch takes-offs.

(5) Report static pressure drop across outside air and relief/exhaust air louvers.

(6) Report static pressure readings of supply air, return air, exhaust/relief air, and outside air in duct at the point where these ducts connect to each air moving unit and also at the following locations:

Main Duct: Take readings at four locations along the full length of the main duct, 25 percent, 50 percent, 75 percent, and 100 percent of the total duct length.

Branch Main Ducts: Take readings at branch main ducts.

e. Duct Traverses: Report duct traverses for main and branch main supply, return, exhaust, relief and outside air ducts. This includes all ducts, including those which lack 7 1/2 duct diameters upstream and 2 1/2 duct diameters downstream of straight duct unobstructed by duct fittings/offsets/elbows. The TAB Agency must evaluate and report findings on the duct traverses taken. Evaluate the suitability of the duct traverse measurement based on satisfying the qualifications for a pilot traverse plane as defined by AMCA 203, "Field Measurements", Section 8, paragraph 8.3, "Location of Traverse Plane."

f. Instruments: List the types of instruments actually used to measure the tab data. Include in the listing each instrument's unique identification number, calibration date, and calibration expiration date.

Instrumentation, used for taking wet bulb temperature readings must provide accuracy of plus or minus 5 percent at the measured face velocities. Submit instrument manufacturer's literature to document instrument accuracy performance is in compliance with that specified.

g. Certification: Include the typed name of the TAB supervisor and the dated signature of the TAB supervisor.

h. Performance Curves: The TAB Supervisor must include, in the TAB Reports, factory pump curves and fan curves for pumps and fans TAB'd on the job.

i. Calibration Curves: The TAB Supervisor must include, in the TAB Reports, a factory calibration curve for installed flow control balancing valves, flow venturi's and flow orifices TAB'd on the job.

1.6 PROJECT/SITE CONDITIONS

1.6.1 DALT and TAB Services to Obtain Existing Conditions

Conduct DALT and TAB of the indicated existing systems and equipment and submit the specified DALT and TAB reports for approval. Conduct this DALT and TAB work in accordance with the requirements of this section.

1.7 SEQUENCING AND SCHEDULING

1.7.1 DALT and TAB Submittal and Work Schedule

Submit this schedule,and TAB Schematic Drawings, adapted for this particular contract, to the Contracting Officer (CO) for review and approval. Include with the submittal the planned calendar dates for each submittal or work item. Resubmit an updated version for CO approval every 90 calendar days. Compliance with the following schedule is the Contractor's responsibility.

Qualify TAB Personnel: Within 45 calendar days after date of contract award, submit TAB agency and personnel qualifications.

Pre-DALT/TAB Meeting: Within 30 calendar days after the date of approval of the TAB agency and personnel, meet with the COTR.

Design Review Report: Within 60 calendar days after the date of the TAB agency personnel qualifications approval, submit design review report.

Pre-Field DALT Preliminary Notification: On completion of the duct installation for each system, notify the Contracting Officer in writing within 5 days after completion.

Ductwork Selected for DALT: Within 7 calendar days of Pre-Field DALT Preliminary Notification, the COTR will select which of the project ductwork must be DALT'd.

DALT Field Work: Within 48 hours of COTR's selection, complete DALT field work on selected.

Submit Pre-final DALT Report: Within one working day after completion of DALT field work, submit Pre-final DALT Report. Separate Pre-final DALT reports may be submitted to allow phased testing from system to system.

DALT Work Field Check: Upon approval of the Pre-final DALT Report, schedule the COTR's DALT field check work with the Contracting Officer.

Submit Final DALT Report: Within 15 calendar days after completion of successful DALT Work Field Check, submit TAB report.

Pre-Field TAB Engineering Report: Within 15 calendar days after approval of the TAB agency Personnel Qualifications, submit the Pre-Field TAB Engineering Report.

Advanced Notice For TAB Field Work: At a minimum of 115 calendar days prior to CCD, submit prerequisite HVAC work check out list certified as complete, and submit advance notice of commencement of TAB field work.

TAB Field Work: At a minimum of 90 calendar days prior to CCD, accomplish TAB field work.

Submit TAB Report: Within 15 calendar days after completion of TAB field work, submit TAB report.

TAB Field Check: 30 calendar days after Season 1 TAB report is approved by the Contracting Officer, conduct field check.

Complete TAB Work: Prior to CCD, complete all TAB work.

1.7.1.1 TAB Design Review Report

Submit typed report describing omissions and deficiencies in the HVAC system's design that would preclude the TAB team from accomplishing the duct leakage testing work and the TAB work requirements of this section. Provide a complete explanation including supporting documentation detailing the design deficiency. State that no deficiencies are evident if that is the case.

1.7.1.2 Pre-Field DALT Preliminary Notification

Notification: On completion of the installation of each duct system indicated to be DALT'd, notify the Contracting Officer in writing within 7

calendar days after completion.

1.7.1.3 TAB Pre-Field Engineering Report

Submit report containing the following information:

a. Step-by-step TAB procedure:

(1) Strategy: Describe the method of approach to the TAB field work from start to finish. Include in this description a complete methodology for accomplishing each seasonal TAB field work session.

(2) Air System Diagrams: Use the contract drawings and duct fabrication drawings if available to provide air system diagrams in the report showing the location of all terminal outlet supply, return, exhaust and transfer registers, grilles and diffusers. Use a key numbering system on the diagrams which identifies each outlet contained in the outlet airflow report sheets. Show intended locations of all traverses and static pressure readings.

(3) Procedural steps: Delineate fully the intended procedural steps to be taken by the TAB field team to accomplish the required TAB work of each air distribution system and each water distribution system. Include intended procedural steps for TAB work for subsystems and system components.

b. Pre-field data: Submit AABC or NEBB or SMACNA 1780 data report forms with the following pre-field information filled in:

(1) Design data obtained from system drawings, specifications, and approved submittals.

(2) Notations detailing additional data to be obtained from the contract site by the TAB field team.

(3) Designate the actual data to be measured in the TAB field work.

(4) Provide a list of the types of instruments, and the measuring range of each, which are anticipated to be used for measuring in the TAB field work. By means of a keying scheme, specify on each TAB data report form submitted, which instruments will be used for measuring each item of TAB data. If the selection of which instrument to use, is to be made in the field, specify from which instruments the choice will be made. Place the instrument key number in the blank space where the measured data would be entered.

c. Prerequisite HVAC work checkout list: Provide a list of inspections and work items which are to be completed by the Contractor. This list must be acted upon and completed by the Contractor and then submitted and approved by the Contracting Officer prior to the TAB team coming to the contract site.

At a minimum, a list of the applicable inspections and work items listed in the NEBB PROCEDURAL STANDARDS, Section III, "Preliminary TAB Procedures" under paragraphs titled, "Air Distribution System Inspection" and "Hydronic Distribution System Inspection" must be provided for each separate system to be TAB'd.

1.8 WARRANTY

Furnish workmanship and performance warranty for the DALT and TAB system work performed for a period not less than 1 year from the date of Government acceptance of the work; issued directly to the Government. Include provisions that if within the warranty period the system shows evidence of major performance deterioration, or is significantly out of tolerance, resulting from defective TAB or DALT workmanship, the corrective repair or replacement of the defective materials and correction of the defective workmanship is the responsibility of the TAB firm. Perform corrective action that becomes necessary because of defective materials and workmanship while system TAB and DALT is under warranty 7 days after notification, unless additional time is approved by the Contracting Officer. Failure to perform repairs within the specified period of time constitutes grounds for having the corrective action and repairs performed by others and the cost billed to the TAB firm. The Contractor must also provide a 1 year contractor installation warranty.

PART 2 PRODUCTS

Not Used

PART 3 EXECUTION

3.1 WORK DESCRIPTIONS OF PARTICIPANTS

Comply with requirements of this section.

3.2 PRE-DALT/TAB MEETING

Meet with the Contracting Officer's technical representative (COTR) to develop a mutual understanding relative to the details of the DALT work and TAB work requirements. Ensure that the TAB supervisor is present at this meeting. Requirements to be discussed include required submittals, work schedule, and field quality control.

3.3 DALT PROCEDURES

3.3.1 Instruments, Consumables and Personnel

Provide instruments, consumables and personnel required to accomplish the DALT field work. Follow the same basic procedure specified below for TAB Field Work, including maintenance and calibration of instruments, accuracy of measurements, preliminary procedures, field work, workmanship and treatment of deficiencies. Calibrate and maintain instruments in accordance with manufacturer's written procedures.

3.3.2 Advance Notice of Pre-Final DALT Field Work

On completion of the installation of each duct system indicated to be DALT'd, notify the Contracting Officer in writing prior to the COTR's duct selection field visit.

3.3.3 Ductwork To Be DALT'd

From each duct system indicated as subject to DALT, the COTR will randomly select sections of each completed duct system for testing by the Contractor's TAB Firm. The sections selected will not exceed 20 percent of the total measured linear footage of duct systems indicated as subject

to DALT. Sections of duct systems subject to DALT will include 20 percent of main ducts, branch main ducts, branch ducts and plenums for supply, return, exhaust, and plenum ductwork.

It is acceptable for an entire duct system to be DALT'd instead of disassembling that system in order to DALT only the 20 percent portion specified above.

3.3.4 DALT Testing

Perform DALT on the HVAC duct sections of each system as selected by the COTR. Use the duct class, seal class, leakage class and the leak test pressure data indicated on the drawings, to comply with the procedures specified in SMACNA 1972 CD.

In spite of specifications of SMACNA 1972 CD to the contrary, DALT ductwork of construction class of 3-inch water gauge static pressure and below if indicated to be DALT'd. Complete DALT work on the COTR selected ductwork within 48 hours after the particular ductwork was selected for DALT. Separately conduct DALT work for large duct systems to enable the DALT work to be completed in 48 hours.

3.3.5 Completed Pre-Final DALT Report

After completion of the DALT work, prepare a Pre-final DALT Report using the reporting forms specified. TAB team to furnish data required by those data report forms. Prepare the report neatly and legibly; the Pre-final DALT report is the basis for the Final DALT Report. TAB supervisor must review and certify the Pre-final DALT Report and submit this report within one day of completion of DALT field work. Verbally notify the COTR that the field check of the Pre-final DALT Report data can commence.

3.3.6 Quality Assurance - COTR DALT Field Acceptance Testing

In the presence of the COTR and TAB team field leader, verify for accuracy Pre-final DALT Report data selected by the COTR. For each duct system, this acceptance testing shall be conducted on a maximum of 50 percent of the duct sections DALT'd.

Further, if any data on the Pre-final DALT report form for a given duct section is out-of-tolerance, then field acceptance testing shall be conducted on data for one additional duct section, preferably in the same duct system, in the presence of the COTR.

3.3.7 Additional COTR Field Acceptance Testing

If any of the duct sections checked for a given system are determined to have a leakage rate measured that exceeds the leakage rate allowed by SMACNA Leak Test Manual for an indicated duct construction class and sealant class, terminate data checking for that section. The associated Pre-final DALT Report data for the given duct system will be disapproved. Make the necessary corrections and prepare a revised Pre-final DALT Report. Reschedule a field check of the revised report data with the COTR.

3.3.8 Certified Final DALT Report

On successful completion of all field checks of the Pre-final DALT Report data for all systems, the TAB Supervisor is to assemble, review, certify and submit the Final DALT Report to the Contracting Officer for approval.

3.3.9 Prerequisite for TAB Field Work

Do not commence TAB field work prior to the completion and approval, for all systems, of the Final DALT Report.

3.4 TAB PROCEDURES

3.4.1 TAB Field Work

Test, adjust, and balance the HVAC systems until measured flow rates (air and water flow) are within plus or minus 5 percent of the design flow rates as specified or indicated on the contract documents.

That is, comply with the the requirements of AABC MN-1 or SMACNA 1780 (TABB) and SMACNA 1858 (TABB),except as supplemented and modified by this section.

Provide instruments and consumables required to accomplish the TAB work. Calibrate and maintain instruments in accordance with manufacturer's written procedures.

Test, adjust, and balance the HVAC systems until measured flow rates (air and water flow) are within plus or minus 5 percent of the design flow rates as specified or indicated on the contract documents. Conduct TAB work, including measurement accuracy, and sound measurement work in conformance with the AABC MN-1 and AABC MN-4, or NEBB TABES and NEBB MASV, or SMACNA 1780 (used by TABB) and SMACNA 1858 sound measurement procedures, except as supplemented and modified by this section.

3.4.2 Preliminary Procedures

Use the approved pre-field engineering report as instructions and procedures for accomplishing TAB field work. TAB engineer is to locate, in the field, test ports required for testing. It is the responsibility of the sheet metal contractor to provide and install test ports as required by the TAB engineer.

3.4.3 TAB Air Distribution Systems

3.4.3.1 Units With Coils

Report heating and cooling performance capacity tests for hot water, chilled water, DX and steam coils for the purpose of verifying that the coils meet the indicated design capacity. Submit the following data and calculations with the coil test reports:

a. For air handlers with capacities greater than 7.5 tons (90,000 Btu) cooling, such as factory manufactured units, central built-up units and rooftop units, conduct capacity tests in accordance with AABC MN-4, procedure 3.5, "Coil Capacity Testing."

   Do not determine entering and leaving wet and dry bulb temperatures by single point measurement, but by the average of multiple readings in compliance with paragraph 3.5-5, "Procedures", (in subparagraph d.) of AABC MN-4, Procedure 3.5, "Coil Capacity Testing."

   Submit part-load coil performance data from the coil manufacturer converting test conditions to design conditions; use the data for the

purpose of verifying that the coils meet the indicated design capacity in compliance with AABC MN-4, Procedure 3.5, "Coil Capacity Testing," paragraph 3.5.7, "Actual Capacity Vs. Design Capacity" (in subparagraph c.).

b. For units with capacities of 7.5 tons (90,000 Btu) or less, such as fan coil units, duct mounted reheat coils associated with VAV terminal units, and unitary units, such as through-the-wall heat pumps:

Determine the apparent coil capacity by calculations using single point measurement of entering and leaving wet and dry bulb temperatures; submit the calculations with the coil reports.

3.4.3.2 Air Handling Units

Air handling unit systems including fans (air handling unit fans, exhaust fans and winter ventilation fans), coils, ducts, plenums, mixing boxes, terminal units, variable air volume boxes, and air distribution devices for supply air, return air, outside air, mixed air relief air, and makeup air.

3.4.3.3 Makeup Air Units

Makeup air unit systems including fans, coils, ducts, plenums, registers, diffusers, grilles, and louvers for supply air, return air, outside air, and mixed air.

3.4.3.4 Fan Coils

Fan coil unit systems including fans, coils, ducts, plenums, and air distribution devices for supply air, return air, and outside air.

3.4.3.5 Exhaust Fans

Exhaust fan systems including fans, ducts, plenums, grilles, and hoods for exhaust air.

3.4.4 TAB Water Distribution Systems

3.4.4.1 Chilled Water

Chilled water systems including chillers, condensers, cooling towers, pumps, coils, system balance valves and flow measuring devices.

For water chillers, report data as required by AABC, NEBB and TABB standard procedures, including refrigeration operational data.

3.4.4.2 Heating Hot Water

Heating hot water systems including boilers, hot water converters (e.g., heat exchangers), pumps, coils, system balancing valves and flow measuring devices.

3.4.4.3 Dual Temperature Water

Dual temperature water systems including boilers, converters, chillers, condensers, cooling towers, pumps, coils, and system balancing valves, and flow measuring devices.

3.4.5 TAB Work on Performance Tests With Seasonal Limitations

3.4.5.1 Performance Tests

Accomplish proportionate balancing TAB work on the air distribution systems and water distribution systems, in other words, accomplish adjusting and balancing of the air flows and water flows, any time during the duration of this contract, subject to the limitations specified elsewhere in this section. However, accomplish, within the following seasonal limitations, TAB work on HVAC systems which directly transfer thermal energy.

3.4.5.2 Season Of Maximum Load

Visit the contract site for at least two TAB work sessions for TAB field measurements. Visit the contract site during the season of maximum cooling load, the goal being to TAB the operational performance of the heating systems and cooling systems under their respective maximum outdoor environment-caused loading. During the seasonal limitations, TAB the operational performance of the heating systems and cooling systems.

3.4.5.3 Ambient Temperatures

On each tab report form used for recording data, record the outdoor and indoor ambient dry bulb temperature range and the outdoor and indoor ambient wet bulb temperature range within which the report form's data was recorded. Record these temperatures at beginning and at the end of data taking.

3.4.5.4 Water Chillers

Water chillers: For water chillers,report data as required by NEBB Form TAB 15-83, NEBB PROCEDURAL STANDARDS, including refrigeration operational data.

3.4.5.5 Refrigeration Units

For refrigeration compressors/condensers/condensing units,report data as required by NEBB Form TAB 15-83, NEBB PROCEDURAL STANDARDS, including refrigeration operational data.

3.4.5.6 Coils

Report heating and cooling performance capacity tests for , chilled water, DX for the purpose of verifying that the coils meet the indicated design capacity. Submit the following data and calculations with the coil test reports:

a. For Central station air handlers with capacities greater than 7.5 tons (90,000 Btu) cooling, such as factory manufactured units, central built-up units and rooftop units, conduct capacity tests in accordance with AABC MN-4, procedure 3.5, "Coil Capacity Testing."

   Entering and leaving wet and dry bulb temperatures are not determined by single point measurement, but by the average of multiple readings in compliance with paragraph 3.5-5, "Procedures", (in subparagraph d.) of AABC MN-4, Procedure 3.5, "Coil Capacity Testing."

   Submit part-load coil performance data from the coil manufacturer

converting test conditions to design conditions; use the data for the purpose of verifying that the coils meet the indicated design capacity in compliance with AABC MN-4, Procedure 3.5, "Coil Capacity Testing," paragraph 3.5.7, "Actual Capacity Vs. Design Capacity" (in subparagraph c.).

b. For units with capacities of 7.5 tons (90,000 Btu) or less, such as fan coil units, duct mounted reheat coils associated with VAV terminal units, and unitary units, such as through-the-wall heat pumps:

Determine the apparent coil capacity by calculations using single point measurement of entering and leaving wet and dry bulb temperatures; submit the calculations with the coil reports.

3.4.6 Workmanship

Conduct TAB work on the HVAC systems until measured flow rates are within plus or minus 5 percent of the design flow rates as specified or indicated on the contract documents. This TAB work includes adjustment of balancing valves, balancing dampers, and sheaves. Further, this TAB work includes changing out fan sheaves and pump impellers if required to obtain air and water flow rates specified or indicated. If, with these adjustments and equipment changes, the specified or indicated design flow rates cannot be attained, contact the Contracting Officer for direction.

3.4.7 Deficiencies

Strive to meet the intent of this section to maximize the performance of the equipment as designed and installed. However, if deficiencies in equipment design or installation prevent TAB work from being accomplished within the range of design values specified in the paragraph WORKMANSHIP, provide written notice as soon as possible to the Contractor and the Contracting Officer describing the deficiency and recommended correction.

Responsibility for correction of installation deficiencies is the Contractor's. If a deficiency is in equipment design, call the TAB team supervisor for technical assistance. Responsibility for reporting design deficiencies to Contractor is the TAB team supervisor's.

3.4.8 TAB Reports

After completion of the TAB field work, prepare the TAB field data for TAB supervisor's review and certification, using the reporting forms approved in the pre-field engineering report. Data required by those approved data report forms is to be furnished by the TAB team. Except as approved otherwise in writing by the Contracting Officer, the TAB work and thereby the TAB report is considered incomplete until the TAB work is accomplished to within the accuracy range specified in the paragraph WORKMANSHIP.

3.4.9 Quality Assurance - COTR TAB Field Acceptance Testing

3.4.9.1 TAB Field Acceptance Testing

During the field acceptance testing, verify, in the presence of the COTR, random selections of data (water, air quantities, air motion) recorded in the TAB Report. Points and areas for field acceptance testing are to be selected by the COTR. Measurement and test procedures are the same as approved for TAB work for the TAB Report.

Field acceptance testing includes verification of TAB Report data recorded for the following equipment groups:

Group 1: All chillers, boilers, return fans, computer room units, and air handling units (rooftop and central stations).

Group 2: 25 percent of the VAV terminal boxes and associated diffusers and registers.

Group 3: 25 percent of the supply diffusers, registers, grilles associated with constant volume air handling units.

Group 4: 25 percent of the return grilles, return registers, exhaust grilles and exhaust registers.

Group 5: 25 percent of the supply fans, exhaust fans, and pumps.

Further, if any data on the TAB Report for Groups 2 through 5 is found not to fall within the range of plus 5 to minus 5 percent of the TAB Report data, additional group data verification is required in the presence of the COTR. Verify TAB Report data for one additional piece of equipment in that group. Continue this additional group data verification until out-of-tolerance data ceases to be found.

3.4.9.2 Additional COTR TAB Field Acceptance Testing

If any of the acceptance testing measurements for a given equipment group is found not to fall within the range of plus 5 to minus 5 percent of the TAB Report data, terminate data verification for all affected data for that group. The affected data for the given group will be disapproved. Make the necessary corrections and prepare a revised TAB Report. Reschedule acceptance testing of the revised report data with the COTR.

Further, if any data on the TAB Report for a given field acceptance test group is out-of-tolerance, then field test data for one additional field test group as specified herein. Continue this increase field test work until out-of-tolerance data ceases to to be found. This additional field testing is up and above the original 25 percent of the of reported data entries to be field tested.

If there are no more similar field test groups from which to choose, additional field testing from another, but different, type of field testing group must be tested.

3.4.9.3 Prerequisite for Approval

Compliance with the field acceptance testing requirements of this section is a prerequisite for the final Contracting Officer approval of the TAB Report submitted.

3.5 MARKING OF SETTINGS

Upon the final TAB work approval, permanently mark the settings of HVAC adjustment devices including valves, gauges, splitters, and dampers so that adjustment can be restored if disturbed at any time. Provide permanent markings clearly indicating the settings on the adjustment devices which result in the data reported on the submitted TAB report.

3.6 MARKING OF TEST PORTS

The TAB team is to permanently and legibly mark and identify the location points of the duct test ports. If the ducts have exterior insulation, make these markings on the exterior side of the duct insulation. Show the location of test ports on the as-built mechanical drawings with dimensions given where the test port is covered by exterior insulation.

-- End of Section --

SECTION 23 07 00

THERMAL INSULATION FOR MECHANICAL SYSTEMS
02/13, CHG 7: 05/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only. At the discretion of the Government, the manufacturer of any material supplied will be required to furnish test reports pertaining to any of the tests necessary to assure compliance with the standard or standards referenced in this specification.

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 90.1 - IP	(2013) Energy Standard for Buildings Except Low-Rise Residential Buildings

ASTM INTERNATIONAL (ASTM)

ASTM A167	(2011) Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
ASTM A240/A240M	(2020a) Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
ASTM A580/A580M	(2018) Standard Specification for Stainless Steel Wire
ASTM B209	(2014) Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
ASTM C195	(2007; R 2013) Standard Specification for Mineral Fiber Thermal Insulating Cement
ASTM C450	(2008) Standard Practice for Fabrication of Thermal Insulating Fitting Covers for NPS Piping, and Vessel Lagging
ASTM C534/C534M	(2020a) Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form
ASTM C547	(2019) Standard Specification for Mineral Fiber Pipe Insulation
ASTM C552	(2021a) Standard Specification for Cellular Glass Thermal Insulation

ASTM C647	(2008; R 2013) Properties and Tests of Mastics and Coating Finishes for Thermal Insulation
ASTM C755	(2019b) Standard Practice for Selection of Water Vapor Retarders for Thermal Insulation
ASTM C795	(2008; R 2018) Standard Specification for Thermal Insulation for Use in Contact with Austenitic Stainless Steel
ASTM C916	(2020) Standard Specification for Adhesives for Duct Thermal Insulation
ASTM C920	(2018) Standard Specification for Elastomeric Joint Sealants
ASTM C921	(2010; R 2015) Standard Practice for Determining the Properties of Jacketing Materials for Thermal Insulation
ASTM C1126	(2018) Standard Specification for Faced or Unfaced Rigid Cellular Phenolic Thermal Insulation
ASTM C1136	(2021) Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation
ASTM C1710	(2011) Standard Guide for Installation of Flexible Closed Cell Preformed Insulation in Tube and Sheet Form
ASTM D882	(2012) Tensile Properties of Thin Plastic Sheeting
ASTM D2863	(2019) Standard Test Method for Measuring the Minimum Oxygen Concentration to Support Candle-Like Combustion of Plastics (Oxygen Index)
ASTM D5590	(2000; R 2010; E 2012) Standard Test Method for Determining the Resistance of Paint Films and Related Coatings to Fungal Defacement by Accelerated Four-Week Agar Plate Assay
ASTM E84	(2020) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM E96/E96M	(2016) Standard Test Methods for Water Vapor Transmission of Materials
ASTM E2231	(2019) Standard Practice for Specimen Preparation and Mounting of Pipe and Duct Insulation Materials to Assess Surface

Burning Characteristics

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350 (2010; Version 1.1) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers

FM GLOBAL (FM)

FM APP GUIDE (updated on-line) Approval Guide http://www.approvalguide.com/

GREEN SEAL (GS)

GS-36 (2013) Adhesives for Commercial Use

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY (MSS)

MSS SP-58 (2018) Pipe Hangers and Supports - Materials, Design and Manufacture, Selection, Application, and Installation

MIDWEST INSULATION CONTRACTORS ASSOCIATION (MICA)

MICA Insulation Stds (8th Ed) National Commercial & Industrial Insulation Standards

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 90A (2021) Standard for the Installation of Air Conditioning and Ventilating Systems

NFPA 90B (2021) Standard for the Installation of Warm Air Heating and Air Conditioning Systems

SCIENTIFIC CERTIFICATION SYSTEMS (SCS)

SCS SCS Global Services (SCS) Indoor Advantage

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168 (2017) Adhesive and Sealant Applications

TECHNICAL ASSOCIATION OF THE PULP AND PAPER INDUSTRY (TAPPI)

TAPPI T403 OM (2015) Bursting Strength of Paper

U.S. DEPARTMENT OF DEFENSE (DOD)

MIL-A-3316 (1987; Rev C; Am 2 1990) Adhesives, Fire-Resistant, Thermal Insulation

MIL-A-24179 (1969; Rev A; Am 2 1980; Notice 1 1987; Notice 2 2020) Adhesive, Flexible Unicellular-Plastic Thermal Insulation

MIL-PRF-19565	(1988; Rev C) Coating Compounds, Thermal Insulation, Fire- and Water-Resistant, Vapor-Barrier

UNDERWRITERS LABORATORIES (UL)

UL 94	(2013; Reprint May 2021) UL Standard for Safety Tests for Flammability of Plastic Materials for Parts in Devices and Appliances
UL 723	(2018) UL Standard for Safety Test for Surface Burning Characteristics of Building Materials
UL 2818	(2013) GREENGUARD Certification Program For Chemical Emissions For Building Materials, Finishes And Furnishings

1.2 SYSTEM DESCRIPTION

1.2.1 General

Provide field-applied insulation and accessories on mechanical systems as specified herein; factory-applied insulation is specified under the piping, duct or equipment to be insulated. Field applied insulation materials required for use on Government-furnished items as listed in the SPECIAL CONTRACT REQUIREMENTS shall be furnished and installed by the Contractor.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

Submit the three SD types, SD-02 Shop Drawings, SD-03 Product Data, and SD-08 Manufacturer's Instructions at the same time for each system.

SD-02 Shop Drawings

Pipe Insulation Systems and Associated Accessories

Duct Insulation Systems and Associated Accessories

Equipment Insulation Systems and Associated Accessories

SD-03 Product Data

Pipe Insulation Systems; G

Duct Insulation Systems; G

Equipment Insulation Systems; G

SD-04 Samples

Thermal Insulation; G

SD-08 Manufacturer's Instructions

Pipe Insulation Systems; G

Duct Insulation Systems; G

Equipment Insulation Systems; G

1.4 CERTIFICATIONS

1.4.1 Adhesives and Sealants

Provide products certified to meet indoor air quality requirements by UL 2818 (Greenguard) Gold, SCS Global Services Indoor Advantage Gold or provide certification or validation by other third-party programs that products meet the requirements of this Section. Provide current product certification documentation from certification body. When product does not have certification, provide validation that product meets the indoor air quality product requirements cited herein.

1.5 QUALITY ASSURANCE

1.5.1 Installer Qualification

Qualified installers shall have successfully completed three or more similar type jobs within the last 5 years.

1.6 DELIVERY, STORAGE, AND HANDLING

Materials shall be delivered in the manufacturer's unopened containers. Materials delivered and placed in storage shall be provided with protection from weather, humidity, dirt, dust and other contaminants. The Contracting Officer may reject insulation material and supplies that become dirty, dusty, wet, or contaminated by some other means. Packages or standard containers of insulation, jacket material, cements, adhesives, and coatings delivered for use, and samples required for approval shall have manufacturer's stamp or label attached giving the name of the manufacturer and brand, and a description of the material, date codes, and approximate shelf life (if applicable). Insulation packages and containers shall be asbestos free.

PART 2 PRODUCTS

2.1 STANDARD PRODUCTS

Provide materials which are the standard products of manufacturers regularly engaged in the manufacture of such products and that essentially duplicate items that have been in satisfactory use for at least 2 years prior to bid opening. Submit a complete list of materials, including manufacturer's descriptive technical literature, performance data, catalog cuts, and installation instructions. The product number, k-value, thickness and furnished accessories including adhesives, sealants and jackets for each mechanical system requiring insulation shall be included. The product data must be copyrighted, have an identifying or publication number, and shall have been published prior to the issuance date of this solicitation. Materials furnished under this section shall

be submitted together in a booklet.

2.1.1 Insulation System

Provide insulation systems in accordance with the approved MICA National Insulation Standards plates as supplemented by this specification. Provide field-applied insulation for heating, ventilating, and cooling (HVAC) air distribution systems and piping systems that are located within, on, under, and adjacent to buildings; and for plumbing systems. Provide CFC and HCFC free insulation.

2.1.2 Surface Burning Characteristics

Unless otherwise specified, insulation must have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84. Flame spread, and smoke developed indexes, shall be determined by ASTM E84 or UL 723. Test insulation in the same density and installed thickness as the material to be used in the actual construction. Prepare and mount test specimens according to ASTM E2231.

2.2 MATERIALS

Provide insulation that meets or exceed the requirements of ASHRAE 90.1 - IP. Insulation exterior shall be cleanable, grease resistant, non-flaking and non-peeling. Materials shall be compatible and shall not contribute to corrosion, soften, or otherwise attack surfaces to which applied in either wet or dry state. Materials to be used on stainless steel surfaces shall meet ASTM C795 requirements. Calcium silicate shall not be used on chilled or cold water systems. Materials shall be asbestos free. Provide product recognized under UL 94 (if containing plastic) and listed in FM APP GUIDE.

2.2.1 Adhesives

Provide non-aerosol adhesive products used on the interior of the building (defined as inside of the weatherproofing system) that meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168 (HVAC duct sealants must meet limit requirements of "Other" category within SCAQMD Rule 1168 sealants table). Provide aerosol adhesives used on the interior of the building that meet either emissions requirements of CDPH SECTION 01350 (use the office or classroom requirements, regardless of space type) or VOC content requirements of GS-36.

2.2.1.1 Acoustical Lining Insulation Adhesive

Adhesive shall be a nonflammable, fire-resistant adhesive conforming to ASTM C916, Type I.

2.2.1.2 Mineral Fiber Insulation Cement

Cement shall be in accordance with ASTM C195.

2.2.1.3 Lagging Adhesive

Lagging is the material used for thermal insulation, especially around a cylindrical object. This may include the insulation as well as the

cloth/material covering the insulation. To resist mold/mildew, lagging adhesive shall meet ASTM D5590 with 0 growth rating. Lagging adhesives shall be nonflammable and fire-resistant and shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84. Adhesive shall be MIL-A-3316, Class 1, pigmented white and be suitable for bonding fibrous glass cloth to faced and unfaced fibrous glass insulation board; for bonding cotton brattice cloth to faced and unfaced fibrous glass insulation board; for sealing edges of and bonding glass tape to joints of fibrous glass board; for bonding lagging cloth to thermal insulation; or Class 2 for attaching fibrous glass insulation to metal surfaces. Lagging adhesives shall be applied in strict accordance with the manufacturer's recommendations for pipe and duct insulation.

2.2.1.4 Contact Adhesive

Adhesives may be any of, but not limited to, the neoprene based, rubber based, or elastomeric type that have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84. The adhesive shall not adversely affect, initially or in service, the insulation to which it is applied, nor shall it cause any corrosive effect on metal to which it is applied. Any solvent dispersing medium or volatile component of the adhesive shall have no objectionable odor and shall not contain any benzene or carbon tetrachloride. The dried adhesive shall not emit nauseous, irritating, or toxic volatile matters or aerosols when the adhesive is heated to any temperature up to 212 degrees F. The dried adhesive shall be nonflammable and fire resistant. Flexible Elastomeric Adhesive: Comply with MIL-A-24179, Type II, Class I. Provide product listed in FM APP GUIDE.

2.2.2 Caulking

ASTM C920, Type S, Grade NS, Class 25, Use A.

2.2.3 Corner Angles

Nominal 0.016 inch aluminum 1 by 1 inch with factory applied kraft backing. Aluminum shall be ASTM B209, Alloy 3003, 3105, or 5005.

2.2.4 Fittings

Fabricated Fittings are the prefabricated fittings for flexible elastomeric pipe insulation systems in accordance with ASTM C1710. Together with the flexible elastomeric tubes, they provide complete system integrity for retarding heat gain and controlling condensation drip from chilled-water and refrigeration systems. Flexible elastomeric, fabricated fittings provide thermal protection (0.25 k) and condensation resistance (0.05 Water Vapor Transmission factor). For satisfactory performance, properly installed protective vapor retarder/barriers and vapor stops shall be used on high relative humidity and below ambient temperature applications to reduce movement of moisture through or around the insulation to the colder interior surface.

2.2.5 Finishing Cement

ASTM C450: Mineral fiber hydraulic-setting thermal insulating and finishing cement. All cements that may come in contact with Austenitic stainless steel must comply with ASTM C795.

2.2.6 Fibrous Glass Cloth and Glass Tape

Fibrous glass cloth, with 20X20 maximum mesh size, and glass tape shall have maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84. Tape shall be 4 inch wide rolls. Class 3 tape shall be 4.5 ounces/square yard. Elastomeric Foam Tape: Black vapor-retarder foam tape with acrylic adhesive containing an anti-microbial additive.

2.2.7 Staples

Outward clinching type ASTM A167, Type 304 or 316 stainless steel.

2.2.8 Jackets

2.2.8.1 Aluminum Jackets

Aluminum jackets shall be corrugated, embossed or smooth sheet, 0.016 inch nominal thickness; ASTM B209, Temper H14, Temper H16, Alloy 3003, 5005, or 3105. Corrugated aluminum jacket shall not be used outdoors. Aluminum jacket securing bands shall be Type 304 stainless steel, 0.015 inch thick, 1/2 inch wide for pipe under 12 inch diameter and 3/4 inch wide for pipe over 12 inch and larger diameter. Aluminum jacket circumferential seam bands shall be 2 by 0.016 inch aluminum matching jacket material. Bands for insulation below ground shall be 3/4 by 0.020 inch thick stainless steel, or fiberglass reinforced tape. The jacket may, at the option of the Contractor, be provided with a factory fabricated Pittsburgh or "Z" type longitudinal joint. When the "Z" joint is used, the bands at the circumferential joints shall be designed by the manufacturer to seal the joints and hold the jacket in place.

2.2.8.2 Polyvinyl Chloride (PVC) Jackets

Polyvinyl chloride (PVC) jacket and fitting covers shall have high impact strength, ultraviolet (UV) resistant rating or treatment and moderate chemical resistance with minimum thickness 0.030 inch.

2.2.8.3 Vapor Barrier/Weatherproofing Jacket

Vapor barrier/weatherproofing jacket shall be laminated self-adhesive, greater than 3 plies standard grade, silver, white, black and embossed or greater than 8 ply (minimum 2.9 mils adhesive); with 0.0000 permeability when tested in accordance with ASTM E96/E96M, using the water transmission rate test method; heavy duty, white or natural; and UV resistant. Flexible Elastomeric exterior foam with factory applied, UV Jacket made with a cold weather acrylic adhesive. Construction of laminate designed to provide UV resistance, high puncture, tear resistance and excellent Water Vapor Transmission (WVT) rate.

2.2.8.4 Vapor Barrier/Vapor Retarder

Apply the following criteria to determine which system is required.

a. On ducts, piping and equipment located outside shall be equipped with a vapor barrier.

b. Ducts, pipes and equipment that are located inside shall be installed with a vapor retarder where required as stated in paragraph VAPOR RETARDER REQUIRED.

2.2.9 Vapor Retarder Required

ASTM C921, Type I, minimum puncture resistance 50 Beach units on all surfaces except concealed ductwork, where a minimum puncture resistance of 25 Beach units is acceptable. Minimum tensile strength, 35 pounds/inch width. ASTM C921, Type II, minimum puncture resistance 25 Beach units, tensile strength minimum 20 pounds/inch width. Jackets used on insulation exposed in finished areas shall have white finish suitable for painting without sizing. Based on the application, insulation materials that require manufacturer or fabricator applied pipe insulation jackets are cellular glass, when all joints are sealed with a vapor barrier mastic, and mineral fiber. All non-metallic jackets shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84. Flexible elastomerics require (in addition to vapor barrier skin) vapor retarder jacketing for high relative humidity and below ambient temperature applications.

2.2.9.1 White Vapor Retarder All Service Jacket (ASJ)

ASJ is for use on hot/cold pipes, ducts, or equipment indoors or outdoors if covered by a suitable protective jacket. The product shall meet all physical property and performance requirements of ASTM C1136, Type I, except the burst strength shall be a minimum of 85 psi. ASTM D2863 Limited Oxygen Index (LOI) shall be a minimum of 31.

In addition, neither the outer exposed surface nor the inner-most surface contacting the insulation shall be paper or other moisture-sensitive material. The outer exposed surface shall be white and have an emittance of not less than 0.80. The outer exposed surface shall be paintable.

2.2.9.2 Vapor Retarder/Vapor Barrier Mastic Coatings

2.2.9.2.1 Vapor Barrier

The vapor barrier shall be self adhesive (minimum 2 mils adhesive, 3 mils embossed) greater than 3 plies standard grade, silver, white, black and embossed white jacket for use on hot/cold pipes. Permeability shall be less than 0.02 when tested in accordance with ASTM E96/E96M. Products shall meet UL 723 or ASTM E84 flame and smoke requirements and shall be UV resistant.

2.2.9.2.2 Vapor Retarder

The vapor retarder coating shall be fire and water resistant and appropriately selected for either outdoor or indoor service. Color shall be white. The water vapor permeance of the compound shall be in accordance with ASTM C755, Section 7.2.2, Table 2, for insulation type and service conditions. The coating shall be nonflammable, fire resistant type. To resist mold/mildew, coating shall meet ASTM D5590 with 0 growth rating. Coating shall meet MIL-PRF-19565 Type II (if selected for indoor service) and be Qualified Products Database listed. All other application and service properties shall be determined pursuant to ASTM C647.

2.2.9.3 Laminated Film Vapor Retarder

ASTM C1136, Type I, maximum moisture vapor transmission 0.02 perms, minimum puncture resistance 50 Beach units on all surfaces except concealed ductwork; where Type II, maximum moisture vapor transmission

0.02 perms, a minimum puncture resistance of 25 Beach units is acceptable. Vapor retarder shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84. Flexible Elastomeric exterior foam with factory applied UV Jacket. Construction of laminate designed to provide UV resistance, high puncture, tear resistance and an excellent WVT rate.

2.2.9.4 Polyvinylidene Chloride (PVDC) Film Vapor Retarder

The PVDC film vapor retarder shall have a maximum moisture vapor transmission of 0.02 perms, minimum puncture resistance of 150 Beach units, a minimum tensile strength in any direction of 30 lb/inch when tested in accordance with ASTM D882, and a maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84.

2.2.9.5 Polyvinylidene Chloride Vapor Retarder Adhesive Tape

Requirements must meet the same as specified for Laminated Film Vapor Retarder above.

2.2.9.6 Vapor Barrier/Weather Barrier

The vapor barrier shall be greater than 3 ply self adhesive laminate -white vapor barrier jacket- superior performance (less than 0.0000 permeability when tested in accordance with ASTM E96/E96M). Vapor barrier shall meet UL 723 or ASTM E84 25 flame and 50 smoke requirements; and UV resistant. Minimum burst strength 185 psi in accordance with TAPPI T403 OM . Tensile strength 68 lb/inch width (PSTC-1000). Tape shall be as specified for laminated film vapor barrier above.

2.2.10 Vapor Retarder Not Required

ASTM C921, Type II, Class D, minimum puncture resistance 50 Beach units on all surfaces except ductwork, where Type IV, maximum moisture vapor transmission 0.10, a minimum puncture resistance of 25 Beach units is acceptable. Jacket shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84.

2.2.11 Wire

Soft annealed ASTM A580/A580M Type 302, 304 or 316 stainless steel, 16 or 18 gauge.

2.2.12 Insulation Bands

Insulation bands shall be 1/2 inch wide; 26 gauge stainless steel.

2.2.13 Sealants

Sealants shall be chosen from the butyl polymer type, the styrene-butadiene rubber type, or the butyl type of sealants. Sealants shall have a maximum permeance of 0.02 perms based on Procedure B for ASTM E96/E96M, and a maximum flame spread index of 25 and a maximum smoke developed index of 50 when tested in accordance with ASTM E84.

2.3 PIPE INSULATION SYSTEMS

Conform insulation materials to Table 1 and minimum insulation thickness

as listed in Table 2 and meet or exceed the requirements of ASHRAE 90.1 - IP. Limit pipe insulation materials to those listed herein and meeting the following requirements:

2.3.1 Recycled Materials

Provide insulation materials containing the following minimum percentage of recycled material content by weight:

Rock Wool: 75 percent slag of weight
Fiberglass: 20 percent glass cullet
Rigid Foam: 9 percent recovered material
Phenolic Rigid Foam: 9 percent recovered material

2.3.2 Aboveground Cold Pipeline (-30 to 60 deg. F)

Insulation for outdoor, indoor, exposed or concealed applications, shall be as follows:

2.3.2.1 Cellular Glass

ASTM C552, Type II, and Type III. Supply the insulation from the fabricator with (paragraph WHITE VAPOR RETARDER ALL SERVICE JACKET (ASJ)) ASJ vapor retarder and installed with all longitudinal overlaps sealed and all circumferential joints ASJ taped or supply the insulation unfaced from the fabricator and install with all longitudinal and circumferential joints sealed with vapor barrier mastic.

2.3.2.2 Flexible Elastomeric Cellular Insulation

Closed-cell, foam- or expanded-rubber materials containing anti-microbial additive, complying with ASTM C534/C534M, Grade 1, Type I or II. Type I, Grade 1 for tubular materials. Type II, Grade 1, for sheet materials. Type I and II shall have vapor retarder/vapor barrier skin on one or both sides of the insulation, and require an additional exterior vapor retarder covering for high relative humidity and below ambient temperature applications.

2.3.2.3 Mineral Fiber Insulation with Integral Wicking Material (MFIWM)

ASTM C547. Install in accordance with manufacturer's instructions. Do not use in applications exposed to outdoor ambient conditions in climatic zones 1 through 4.

2.3.3 Aboveground Hot Pipeline (Above 60 deg. F)

Insulation for outdoor, indoor, exposed or concealed applications shall meet the following requirements. Supply the insulation with manufacturer's recommended factory-applied jacket/vapor barrier.

2.3.3.1 Mineral Fiber

ASTM C547, Types I, II or III, supply the insulation with manufacturer's recommended factory-applied jacket.

2.3.3.2 Cellular Glass

ASTM C552, Type II and Type III. Supply the insulation with

manufacturer's recommended factory-applied jacket.

2.3.3.3 Flexible Elastomeric Cellular Insulation

Closed-cell, foam- or expanded-rubber materials containing anti-microbial additive, complying with ASTM C534/C534M, Grade 1, Type I or II to 220 degrees F service. Type I for tubular materials. Type II for sheet materials.

2.3.4 Below-ground Pipeline Insulation

For below-ground pipeline insulation, use cellular glass, ASTM C552, type II.

2.4 DUCT INSULATION SYSTEMS

2.4.1 Factory Applied Insulation

Provide factory-applied ASTM C534/C534M Grade 1, Type II, flexible elastomeric closed cell insulation according to manufacturer's recommendations for insulation with insulation manufacturer's standard reinforced fire-retardant vapor barrier, with identification of installed thermal resistance (R) value and out-of-package R value.

2.4.1.1 Rigid Insulation

Calculate the minimum thickness in accordance with ASHRAE 90.1 - IP.

2.4.1.2 Blanket Insulation

Calculate minimum thickness in accordance with ASHRAE 90.1 - IP.

2.4.2 Duct Insulation Jackets

2.4.2.1 All-Purpose Jacket

Provide insulation with insulation manufacturer's standard reinforced fire-retardant jacket with or without integral vapor barrier as required by the service. In exposed locations, provide jacket with a white surface suitable for field painting.

2.4.2.2 Metal Jackets

2.4.2.2.1 Aluminum Jackets

ASTM B209, Temper H14, minimum thickness of 27 gauge (0.016 inch), with factory-applied polyethylene and kraft paper moisture barrier on inside surface. Provide smooth surface jackets for jacket outside dimension 8 inches and larger. Provide corrugated surface jackets for jacket outside dimension 8 inches and larger. Provide stainless steel bands, minimum width of 1/2 inch.

2.4.2.2.2 Stainless Steel Jackets

ASTM A167 or ASTM A240/A240M; Type 304, minimum thickness of 33 gauge (0.010 inch), smooth surface with factory-applied polyethylene and kraft paper moisture barrier on inside surface. Provide stainless steel bands, minimum width of 1/2 inch.

2.4.2.3 Vapor Barrier/Weatherproofing Jacket

Vapor barrier/weatherproofing jacket shall be laminated self-adhesive (minimum 2 mils adhesive, 3 mils embossed) less than 0.0000 permeability, (greater than 3 ply, standard grade, silver, white, black and embossed or greater than 8 ply (minimum 2.9 mils adhesive), heavy duty white or natural).

2.4.3 Weatherproof Duct Insulation

Provide ASTM C534/C534M Grade 1, Type II, flexible elastomeric cellular insulation, and weatherproofing as specified in manufacturer's instruction. Multi-ply, Polymeric Blend Laminate Jacketing: Construction of laminate designed to provide UV resistance, high puncture, tear resistance and an excellent WVT rate.

2.5 EQUIPMENT INSULATION SYSTEMS

Insulate equipment and accessories as specified in Tables 5 and 6. In outside locations, provide insulation 1/2 inch thicker than specified. Increase the specified insulation thickness for equipment where necessary to equal the thickness of angles or other structural members to make a smooth, exterior surface. Submit a booklet containing manufacturer's published installation instructions for the insulation systems. Annotate their installation instructions to indicate which product data. The instructions must be copyrighted, have an identifying or publication number, and shall have been published prior to the issuance date of this solicitation. A booklet is also required by paragraphs titled: Pipe Insulation Systems and Duct Insulation Systems.

PART 3 EXECUTION

3.1 APPLICATION - GENERAL

Apply insulation to unheated and uncooled piping and equipment. Do not compress flexible elastomeric cellular insulation at joists, studs, columns, ducts, and hangers. The insulation must not pull apart after a one hour period; replace any insulation found to pull apart after one hour.

3.1.1 Installation

Except as otherwise specified, material shall be installed in accordance with the manufacturer's written instructions. Insulation materials shall not be applied until specified in other sections of this specification are completed. Material such as rust, scale, dirt and moisture shall be removed from surfaces to receive insulation. Insulation shall be kept clean and dry. Insulation shall not be removed from its shipping containers until the day it is ready to use and shall be returned to like containers or equally protected from dirt and moisture at the end of each workday. Insulation that becomes dirty shall be thoroughly cleaned prior to use. If insulation becomes wet or if cleaning does not restore the surfaces to like new condition, the insulation will be rejected, and shall be immediately removed from the jobsite. Joints shall be staggered on multi layer insulation. Mineral fiber thermal insulating cement shall be mixed with demineralized water when used on stainless steel surfaces. Insulation, jacketing and accessories shall be installed in accordance with MICA Insulation Stds plates except where modified herein or on the drawings.

3.1.2 Firestopping

Where pipes and ducts pass through fire walls, fire partitions, above grade floors, and fire rated chase walls, the penetration shall be sealed with UL listed fire stopping materials. The protection of ducts at point of passage through firewalls must be in accordance with NFPA 90A and/or NFPA 90B. All other penetrations, such as piping, conduit, and wiring, through firewalls must be protected with a material or system of the same hourly rating that is listed by UL, FM, or a NRTL.

3.1.3 Painting and Finishing

Painting shall be as specified in Section 09 90 00 PAINTS AND COATINGS.

3.1.4 Installation of Flexible Elastomeric Cellular Insulation

Install flexible elastomeric cellular insulation with seams and joints sealed with rubberized contact adhesive. Flexible elastomeric cellular insulation shall not be used on surfaces greater than 220 degrees F. Stagger seams when applying multiple layers of insulation. Protect insulation exposed to weather and not shown to have vapor barrier weatherproof jacketing with two coats of UV resistant finish or PVC or metal jacketing as recommended by the manufacturer after the adhesive is dry and cured.

3.1.4.1 Adhesive Application

Apply a brush coating of adhesive to both butt ends to be joined and to both slit surfaces to be sealed. Allow the adhesive to set until dry to touch but tacky under slight pressure before joining the surfaces. Insulation seals at seams and joints shall not be capable of being pulled apart one hour after application. Insulation that can be pulled apart one hour after installation shall be replaced.

3.1.4.2 Adhesive Safety Precautions

Use natural cross-ventilation, local (mechanical) pickup, and/or general area (mechanical) ventilation to prevent an accumulation of solvent vapors, keeping in mind the ventilation pattern must remove any heavier-than-air solvent vapors from lower levels of the workspaces. Gloves and spectacle-type safety glasses are recommended in accordance with safe installation practices.

3.1.5 Welding

No welding shall be done on piping, duct or equipment without written approval of the Contracting Officer. The capacitor discharge welding process may be used for securing metal fasteners to duct.

3.1.6 Pipes/Ducts/Equipment That Require Insulation

Insulation is required on all pipes, ducts, or equipment, except for omitted items as specified.

3.2 PIPE INSULATION SYSTEMS INSTALLATION

Install pipe insulation systems in accordance with the approved MICA Insulation Stds plates as supplemented by the manufacturer's published installation instructions.

3.2.1 Pipe Insulation

3.2.1.1 General

Pipe insulation shall be installed on aboveground hot and cold pipeline systems as specified below to form a continuous thermal retarder/barrier, including straight runs, fittings and appurtenances unless specified otherwise. Installation shall be with full length units of insulation and using a single cut piece to complete a run. Cut pieces or scraps abutting each other shall not be used. Pipe insulation shall be omitted on the following:

a. Pipe used solely for fire protection.

b. Chromium plated pipe to plumbing fixtures. However, fixtures for use by the physically handicapped shall have the hot water supply and drain, including the trap, insulated where exposed.

c. Sanitary drain lines.

d. Air chambers.

e. Adjacent insulation.

f. ASME stamps.

g. Access plates of fan housings.

h. Cleanouts or handholes.

3.2.1.2 Pipes Passing Through Walls, Roofs, and Floors

Pipe insulation shall be continuous through the sleeve.

Provide an aluminum jacket or vapor barrier/weatherproofing self adhesive jacket (minimum 2 mils adhesive, 3 mils embossed) less than 0.0000 permeability, greater than 3 ply standard grade, silver, white, black and embossed with factory applied moisture retarder over the insulation wherever penetrations require sealing.

3.2.1.2.1 Penetrate Interior Walls

The aluminum jacket or vapor barrier/weatherproofing - self adhesive jacket (minimum 2 mils adhesive, 3 mils embossed) less than 0.0000 permeability, greater than 3 plies standard grade, silver, white, black and embossed shall extend 2 inches beyond either side of the wall and shall be secured on each end with a band.

3.2.1.2.2 Penetrating Floors

Extend the aluminum jacket from a point below the backup material to a point 10 inches above the floor with one band at the floor and one not more than 1 inch from the end of the aluminum jacket.

3.2.1.2.3 Penetrating Waterproofed Floors

Extend the aluminum jacket rom below the backup material to a point 2 inches above the flashing with a band 1 inch from the end of the aluminum

jacket.

3.2.1.2.4 Penetrating Exterior Walls

Continue the aluminum jacket required for pipe exposed to weather through the sleeve to a point 2 inches beyond the interior surface of the wall.

3.2.1.2.5 Penetrating Roofs

Insulate pipe as required for interior service to a point flush with the top of the flashing and sealed with flashing sealant. Tightly butt the insulation for exterior application to the top of flashing and interior insulation. Extend the exterior aluminum jacket 2 inches down beyond the end of the insulation to form a counter flashing. Seal the flashing and counter flashing underneath with metal jacketing/flashing sealant.

3.2.1.2.6 Hot Water Pipes Supplying Lavatories or Other Similar Heated Service

Terminate the insulation on the backside of the finished wall. Protect the insulation termination with two coats of vapor barrier coating with a minimum total thickness of 1/16 inch applied with glass tape embedded between coats (if applicable). Extend the coating out onto the insulation 2 inches and seal the end of the insulation. Overlap glass tape seams 1 inch. Caulk the annular space between the pipe and wall penetration with approved fire stop material. Cover the pipe and wall penetration with a properly sized (well fitting) escutcheon plate. The escutcheon plate shall overlap the wall penetration at least 3/8 inches.

3.2.1.2.7 Domestic Cold Water Pipes Supplying Lavatories or Other Similar Cooling Service

Terminate the insulation on the finished side of the wall (i.e., insulation must cover the pipe throughout the wall penetration). Protect the insulation with two coats of weather barrier mastic (breather emulsion type weatherproof mastic impermeable to water and permeable to air) with a minimum total thickness of 1/16 inch. Extend the mastic out onto the insulation 2 inches and shall seal the end of the insulation. The annular space between the outer surface of the pipe insulation and caulk the wall penetration with an approved fire stop material having vapor retarder properties. Cover the pipe and wall penetration with a properly sized (well fitting) escutcheon plate. The escutcheon plate shall overlap the wall penetration by at least 3/8 inches.

3.2.1.3 Pipes Passing Through Hangers

Insulation, whether hot or cold application, shall be continuous through hangers. All horizontal pipes 2 inches and smaller shall be supported on hangers with the addition of a Type 40 protection shield to protect the insulation in accordance with MSS SP-58. Whenever insulation shows signs of being compressed, or when the insulation or jacket shows visible signs of distortion at or near the support shield, insulation inserts as specified below for piping larger than 2 inches shall be installed, or factory insulated hangers (designed with a load bearing core) can be used.

3.2.1.3.1 Horizontal Pipes Larger Than 2 Inches at 60 Degrees F and Above

Supported on hangers in accordance with MSS SP-58, and Section 22 00 00 PLUMBING, GENERAL PURPOSE.

3.2.1.3.2 Horizontal Pipes Larger Than 2 Inches and Below 60 Degrees F

Supported on hangers with the addition of a Type 40 protection shield in accordance with MSS SP-58. An insulation insert of cellular glass, prefabricated insulation pipe hangers, or perlite above 80 degrees F shall be installed above each shield. The insert shall cover not less than the bottom 180-degree arc of the pipe. Inserts shall be the same thickness as the insulation, and shall extend 2 inches on each end beyond the protection shield. When insulation inserts are required in accordance with the above, and the insulation thickness is less than 1 inch, wooden or cork dowels or blocks may be installed between the pipe and the shield to prevent the weight of the pipe from crushing the insulation, as an option to installing insulation inserts. The insulation jacket shall be continuous over the wooden dowel, wooden block, or insulation insert.

3.2.1.3.3 Vertical Pipes

Supported with either Type 8 or Type 42 riser clamps with the addition of two Type 40 protection shields in accordance with MSS SP-58 covering the 360-degree arc of the insulation. An insulation insert of cellular glass or calcium silicate shall be installed between each shield and the pipe. The insert shall cover the 360-degree arc of the pipe. Inserts shall be the same thickness as the insulation, and shall extend 2 inches on each end beyond the protection shield. When insulation inserts are required in accordance with the above, and the insulation thickness is less than 1 inch, wooden or cork dowels or blocks may be installed between the pipe and the shield to prevent the hanger from crushing the insulation, as an option instead of installing insulation inserts. The insulation jacket shall be continuous over the wooden dowel, wooden block, or insulation insert. The vertical weight of the pipe shall be supported with hangers located in a horizontal section of the pipe. When the pipe riser is longer than 30 feet, the weight of the pipe shall be additionally supported with hangers in the vertical run of the pipe that are directly clamped to the pipe, penetrating the pipe insulation. These hangers shall be insulated and the insulation jacket sealed as indicated herein for anchors in a similar service.

3.2.1.3.4 Inserts

Covered with a jacket material of the same appearance and quality as the adjoining pipe insulation jacket, overlap the adjoining pipe jacket 1-1/2 inches, and seal as required for the pipe jacket. The jacket material used to cover inserts in flexible elastomeric cellular insulation shall conform to ASTM C1136, Type 1, and is allowed to be of a different material than the adjoining insulation material.

3.2.1.4 Flexible Elastomeric Cellular Pipe Insulation

Flexible elastomeric cellular pipe insulation shall be tubular form for pipe sizes 6 inches and less. Grade 1, Type II sheet insulation used on pipes larger than 6 inches shall not be stretched around the pipe. On pipes larger than 12 inches, the insulation shall be adhered directly to the pipe on the lower 1/3 of the pipe. Seams shall be staggered when applying multiple layers of insulation. Sweat fittings shall be insulated with miter-cut pieces the same size as on adjacent piping. Screwed fittings shall be insulated with sleeved fitting covers fabricated from miter-cut pieces and shall be overlapped and sealed to the adjacent pipe insulation. Type II requires an additional exterior vapor

retarder/barrier covering for high relative humidity and below ambient temperature applications.

3.2.1.5 Pipes in high abuse areas.

In high abuse areas such as janitor closets and traffic areas in equipment rooms, kitchens, and mechanical rooms, aluminum or flexible laminate cladding (comprised of elastomeric, plastic or metal foil laminate) laminated self-adhesive (minimum 2 mils adhesive, 3 mils embossed) vapor barrier/weatherproofing jacket, - less than 0.0000 permeability; (greater than 3 ply, standard grade, silver, white, black and embossed) aluminum jackets shall be utilized. Pipe insulation to the 6 foot level shall be protected.

3.2.1.6 Pipe Insulation Material and Thickness

Pipe insulation materials must be as listed in Table 1 and must meet or exceed the requirements of ASHRAE 90.1 - IP.

TABLE 1

Insulation Material for Piping

Service					
	Material	Specification	Type	Class	VR/VB Req'd
Chilled Water (Supply & Return, Dual Temperature Piping, 40 F nominal)					
	Cellular Glass	ASTM C552	II	2	Yes
	Flexible Elastomeric Cellular	ASTM C534/C534M	I		Yes
	Mineral Fiber with Wicking MaterialDo not use in applications exposed to outdoor ambient conditions in climatic zones 1 through 4.	ASTM C547	I		Yes
Heating Hot Water Supply & Return, Heated Oil (Max 250 F)					
	Mineral Fiber	ASTM C547	I	1	No
	Cellular Glass	ASTM C552	II	2	No
	Flexible Elastomeric Cellular	ASTM C534/C534M	I	2	No
Cold Domestic Water Piping, Makeup Water & Drinking Fountain Drain Piping					
	Cellular Glass	ASTM C552	II	2	No
	Flexible Elastomeric Cellular	ASTM C534/C534M	I		No
Hot Domestic Water Supply & Recirculating Piping (Max 200 F)					
	Mineral Fiber	ASTM C547	I	1	No
	Cellular Glass	ASTM C552	II	2	No

TABLE 1

Insulation Material for Piping

	Material	Specification	Type	Class	VR/VB Req'd
Service					
	Flexible Elastomeric Cellular	ASTM C534/C534M	I		No
Refrigerant Suction Piping (35 degrees F nominal)					
	Flexible Elastomeric Cellular	ASTM C534/C534M	I		No
	Cellular Glass	ASTM C552	II	1	Yes
Compressed Air Discharge, Steam and Condensate Return (201 to 250 Degrees F					
	Cellular Glass	ASTM C552	II		No
	Mineral Fiber	ASTM C547	I	1	No
	Flexible Elastomeric Cellular	ASTM C534/C534M	I	2	No
Exposed Lavatory Drains, Exposed Domestic Water Piping & Drains to Areas for Handicapped Personnel					
	Flexible Elastomeric Cellular	ASTM C534/C534M	I		No
Horizontal Roof Drain Leaders (Including Underside of Roof Drain Fittings)					
	Flexible Elastomeric Cellular	ASTM C534/C534M	I		No
	Faced Phenolic Foam	ASTM C1126	III		Yes
	Cellular Glass	ASTM C552	III		Yes
Condensate Drain Located Inside Building					
	Cellular Glass	ASTM C552	II	2	No
	Flexible Elastomeric Cellular	ASTM C534/C534M	I		No
Note: VR/VB = Vapor Retarder/Vapor Barrier					

TABLE 2

Piping Insulation Thickness (inch)
Do not use integral wicking material in Chilled water applications exposed to outdoor ambient conditions in climatic zones 1 through 4.

Service						
	Material	Tube And Pipe Size (inch)				
		<1	1-<1.5	1.5-<4	4-<8	> or = >8
Chilled Water (Supply & Return, Dual Temperature Piping, 40 Degrees F nominal)						
	Cellular Glass	1.5	2	2	2.5	3
	Mineral Fiber with Wicking Material	1	1.5	1.5	2	2
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A
Chilled Water (Supply & Return, Dual Temperature Piping, 40 Degrees F nominal)						
	Cellular Glass	1.5	1.5	1.5	1.5	2
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A
	Mineral Fiber with Wicking Material	1	1.5	1.5	2	2
Heating Hot Water Supply & Return, Heated Oil (Max 250 F)						
	Mineral Fiber	1.5	1.5	2	2	2
	Cellular Glass	2	2.5	3	3	3
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A
Cold Domestic Water Piping, Makeup Water & Drinking Fountain Drain Piping						
	Cellular Glass	1.5	1.5	1.5	1.5	1.5
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A
Hot Domestic Water Supply & Recirculating Piping (Max 200 F)						
	Mineral Fiber	1	1	1	1.5	1.5
	Cellular Glass	1.5	1.5	1.5	2	2
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A
Refrigerant Suction Piping (35 degrees F nominal)						

TABLE 2

Piping Insulation Thickness (inch)
Do not use integral wicking material in Chilled water applications exposed to outdoor ambient conditions in climatic zones 1 through 4.

Service						
	Material	Tube And Pipe Size (inch)				
		<1	1-<1.5	1.5-<4	4-<8	> or = >8
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A
	Cellular Glass	1.5	1.5	1.5	1.5	1.5
Compressed Air Discharge, Steam and Condensate Return (201 to 250 Degrees F						
	Mineral Fiber	1.5	1.5	2	2	2
		1.5*	2*	2.5*	3*	3.5*
	Cellular Glass	2	2.5	3	3	3
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A
Exposed Lavatory Drains, Exposed Domestic Water Piping & Drains to Areas for Handicapped Personnel						
	Flexible Elastomeric Cellular	0.5	0.5	0.5	0.5	0.5
Horizontal Roof Drain Leaders (Including Underside of Roof Drain Fittings)						
	Cellular Glass	1.5	1.5	1.5	1.5	1.5
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A
Condensate Drain Located Inside Building						
	Cellular Glass	1.5	1.5	1.5	1.5	1.5
	Flexible Elastomeric Cellular	1	1	1	N/A	N/A

3.2.2 Aboveground Cold Pipelines

The following cold pipelines for minus 30 to plus 60 degrees F, shall be insulated in accordance with Table 2 except those piping listed in subparagraph Pipe Insulation in PART 3 as to be omitted. This includes but is not limited to the following:

a. Make-up water.

b. Horizontal and vertical portions of interior roof drains.

c. Refrigerant suction lines.

d. Chilled water.

f. Air conditioner condensate drains.

h. Exposed lavatory drains and domestic water lines serving plumbing fixtures for handicap persons.

i. Domestic cold and chilled drinking water.

3.2.2.1 Insulation Material and Thickness

Insulation thickness for cold pipelines shall be determined using Table 2.

3.2.2.2 Factory or Field applied Jacket

Insulation shall be covered with a factory applied vapor retarder jacket/vapor barrier or field applied seal welded PVC jacket or greater than 3 ply laminated self-adhesive (minimum 2 mils adhesive, 3 mils embossed) vapor barrier/weatherproofing jacket - less than 0.0000 permeability, standard grade, sliver, white, black and embossed for use with Mineral Fiber, Cellular Glass, and Phenolic Foam Insulated Pipe. Insulation inside the building, to be protected with an aluminum jacket or greater than 3ply vapor barrier/weatherproofing self-adhesive (minimum 2 mils adhesive, 3 mils embossed) product, less than 0.0000 permeability, standard grade, Embossed Silver, White & Black, shall have the insulation and vapor retarder jacket installed as specified herein. The aluminum jacket or greater than 3ply vapor barrier/weatherproofing self-adhesive (minimum 2 mils adhesive, 3 mils embossed) product, less than 0.0000 permeability, standard grade, embossed silver, White & Black, shall be installed as specified for piping exposed to weather, except sealing of the laps of the aluminum jacket is not required. In high abuse areas such as janitor closets and traffic areas in equipment rooms, kitchens, and mechanical rooms, aluminum jackets or greater than 3ply vapor barrier/weatherproofing self-adhesive (minimum 2 mils adhesive, 3 mils embossed) product, less than 0.0000 permeability, standard grade, embossed silver, white & black, shall be provided for pipe insulation to the 6 ft level.

3.2.2.3 Installing Insulation for Straight Runs Hot and Cold Pipe

Apply insulation to the pipe with tight butt joints. Seal all butted joints and ends with joint sealant and seal with a vapor retarder coating, greater than 3 ply laminate jacket - less than 0.0000 perm adhesive tape or PVDC adhesive tape.

3.2.2.3.1 Longitudinal Laps of the Jacket Material

Overlap not less than 1-1/2 inches. Provide butt strips 3 inches wide for circumferential joints.

3.2.2.3.2 Laps and Butt Strips

Secure with adhesive and staple on 4 inch centers if not factory self-sealing. If staples are used, seal in accordance with paragraph

STAPLES below. Note that staples are not required with cellular glass systems.

3.2.2.3.3 Factory Self-Sealing Lap Systems

May be used when the ambient temperature is between 40 and 120 degrees F during installation. Install the lap system in accordance with manufacturer's recommendations. Use a stapler only if specifically recommended by the manufacturer. Where gaps occur, replace the section or repair the gap by applying adhesive under the lap and then stapling.

3.2.2.3.4 Staples

Coat all staples, including those used to repair factory self-seal lap systems, with a vapor retarder coating or PVDC adhesive tape or greater than 3 ply laminate jacket - 0.0000 perm adhesive tape. Coat all seams, except those on factory self-seal systems, with vapor retarder coating or PVDC adhesive tape or greater than 3 ply laminate jacket - less than 0.0000 perm adhesive tape.

3.2.2.3.5 Breaks and Punctures in the Jacket Material

Patch by wrapping a strip of jacket material around the pipe and secure it with adhesive, staple, and coat with vapor retarder coating or PVDC adhesive tape or greater than 3 ply laminate jacket - less than 0.0000 perm adhesive tape. Extend the patch not less than 1-1/2 inches past the break.

3.2.2.3.6 Penetrations Such as Thermometers

Fill the voids in the insulation and seal with vapor retarder coating or PVDC adhesive tape or greater than 3 ply laminate jacket - less than 0.0000 perm adhesive tape.

3.2.2.3.7 Flexible Elastomeric Cellular Pipe Insulation

Install by slitting the tubular sections and applying them onto the piping or tubing. Alternately, whenever possible slide un-slit sections over the open ends of piping or tubing. Secure all seams and butt joints and seal with adhesive. When using self seal products only the butt joints shall be secured with adhesive. Push insulation on the pipe, never pulled. Stretching of insulation may result in open seams and joints. Clean cut all edges. Rough or jagged edges of the insulation are not be permitted. Use proper tools such as sharp knives. Do not stretch Grade 1, Type II sheet insulation around the pipe when used on pipe larger than 6 inches. On pipes larger than 12 inches, adhere sheet insulation directly to the pipe on the lower 1/3 of the pipe.

3.2.2.4 Insulation for Fittings and Accessories

a. Pipe insulation shall be tightly butted to the insulation of the fittings and accessories. The butted joints and ends shall be sealed with joint sealant and sealed with a vapor retarder coating or PVDC adhesive tape or greater than 3 ply laminate jacket - less than 0.0000 perm adhesive tape.

b. Precut or preformed insulation shall be placed around all fittings and accessories. Insulation shall be the same insulation as the pipe insulation, including same density, thickness, and thermal

conductivity. Where precut/preformed is unavailable, rigid preformed pipe insulation sections may be segmented into the shape required. Insulation of the same thickness and conductivity as the adjoining pipe insulation shall be used. If nesting size insulation is used, the insulation shall be overlapped 2 inches or one pipe diameter.

c. Upon completion of insulation installation on flanges, unions, valves, anchors, fittings and accessories, terminations, seams, joints and insulation not protected by factory vapor retarder jackets or PVC fitting covers shall be protected with PVDC or greater than 3 ply laminate jacket - less than 0.0000 perm adhesive tape or two coats of vapor retarder coating with a minimum total thickness of 1/16 inch, applied with glass tape embedded between coats. Tape seams shall overlap 1 inch. The coating shall extend out onto the adjoining pipe insulation 2 inches. Fabricated insulation with a factory vapor retarder jacket shall be protected with either greater than 3 ply laminate jacket - less than 0.0000 perm adhesive tape, standard grade, silver, white, black and embossed or PVDC adhesive tape or two coats of vapor retarder coating with a minimum thickness of 1/16 inch and with a 2 inch wide glass tape embedded between coats. Where fitting insulation butts to pipe insulation, the joints shall be sealed with a vapor retarder coating and a 4 inch wide ASJ tape which matches the jacket of the pipe insulation.

d. Anchors attached directly to the pipe shall be insulated for a sufficient distance to prevent condensation but not less than 6 inches from the insulation surface.

e. Insulation shall be marked showing the location of unions, strainers, and check valves.

3.2.2.5 Optional PVC Fitting Covers

At the option of the Contractor, premolded, one or two piece PVC fitting covers may be used in lieu of the vapor retarder and embedded glass tape. Factory precut or premolded insulation segments shall be used under the fitting covers for elbows. Insulation segments shall be the same insulation as the pipe insulation including same density, thickness, and thermal conductivity. The covers shall be secured by PVC vapor retarder tape, adhesive, seal welding or with tacks made for securing PVC covers. Seams in the cover, and tacks and laps to adjoining pipe insulation jacket, shall be sealed with vapor retarder tape to ensure that the assembly has a continuous vapor seal.

3.2.3 Aboveground Hot Pipelines

3.2.3.1 General Requirements

All hot pipe lines above 60 degrees F, except those piping listed in subparagraph Pipe Insulation in PART 3 as to be omitted, shall be insulated in accordance with Table 2. This includes but is not limited to the following:

a. Domestic hot water supply & re-circulating system.

c. Condensate & compressed air discharge.

d. Hot water heating.

Insulation shall be covered, in accordance with manufacturer's recommendations, with a factory applied Type I jacket or field applied aluminum where required or seal welded PVC.

3.2.3.2 Insulation for Fittings and Accessories

Pipe insulation shall be tightly butted to the insulation of the fittings and accessories. The butted joints and ends shall be sealed with joint sealant. Insulation shall be marked showing the location of unions, strainers, check valves and other components that would otherwise be hidden from view by the insulation.

3.2.3.2.1 Precut or Preformed

Place precut or preformed insulation around all fittings and accessories. Insulation shall be the same insulation as the pipe insulation, including same density, thickness, and thermal conductivity.

3.2.3.2.2 Rigid Preformed

Where precut/preformed is unavailable, rigid preformed pipe insulation sections may be segmented into the shape required. Insulation of the same thickness and conductivity as the adjoining pipe insulation shall be used. If nesting size insulation is used, the insulation shall be overlapped 2 inches or one pipe diameter. Elbows insulated using segments shall conform to MICA Tables 12.20 "Mitered Insulation Elbow".

3.2.4 Piping Exposed to Weather

Piping exposed to weather shall be insulated and jacketed as specified for the applicable service inside the building. After this procedure, a laminated self-adhesive (minimum 2 mils adhesive, 3 mils embossed) vapor barrier/weatherproofing jacket - less than 0.0000 permeability (greater than 3 ply, standard grade, silver, white, black and embossed aluminum jacket, stainless steel or PVC jacket shall be applied.

PVC jacketing requires no factory-applied jacket beneath it, however an all service jacket shall be applied if factory applied jacketing is not furnished. Flexible elastomeric cellular insulation exposed to weather shall be treated in accordance with paragraph INSTALLATION OF FLEXIBLE ELASTOMERIC CELLULAR INSULATION in PART 3.

3.2.4.1 Aluminum Jacket

The jacket for hot piping may be factory applied. The jacket shall overlap not less than 2 inches at longitudinal and circumferential joints and shall be secured with bands at not more than 12 inch centers. Longitudinal joints shall be overlapped down to shed water and located at 4 or 8 o'clock positions. Joints on piping 60 degrees F and below shall be sealed with metal jacketing/flashing sealant while overlapping to prevent moisture penetration. Where jacketing on piping 60 degrees F and below abuts an un-insulated surface, joints shall be caulked to prevent moisture penetration. Joints on piping above 60 degrees F shall be sealed with a moisture retarder.

3.2.4.2 Insulation for Fittings

Flanges, unions, valves, fittings, and accessories shall be insulated and finished as specified for the applicable service. Two coats of breather

emulsion type weatherproof mastic (impermeable to water, permeable to air) recommended by the insulation manufacturer shall be applied with glass tape embedded between coats. Tape overlaps shall be not less than 1 inch and the adjoining aluminum jacket not less than 2 inches. Factory preformed aluminum jackets may be used in lieu of the above. Molded PVC fitting covers shall be provided when PVC jackets are used for straight runs of pipe. PVC fitting covers shall have adhesive welded joints and shall be weatherproof laminated self-adhesive (minimum 2 mils adhesive, 3 mils embossed) vapor barrier/weatherproofing jacket - less than 0.0000 permeability, (greater than 3 ply, standard grade, silver, white, black and embossed, and UV resistant.

3.2.4.3 PVC Jacket

PVC jacket shall be ultraviolet resistant and adhesive welded weather tight with manufacturer's recommended adhesive. Installation shall include provision for thermal expansion.

3.2.4.4 Stainless Steel Jackets

ASTM A167 or ASTM A240/A240M; Type 304, minimum thickness of 33 gauge (0.010 inch), smooth surface with factory-applied polyethylene and kraft paper moisture barrier on inside surface. Provide stainless steel bands, minimum width of 1/2 inch.

3.2.5 Below Ground Pipe Insulation

Below ground pipes shall be insulated in accordance with Table 2, except as precluded in subparagraph Pipe Insulation in PART 3. This includes, but is not limited to the following:

b. Domestic hot water.

c. Heating hot water.

f. Condensate.

3.2.5.1 Type of Insulation

Below ground pipe shall be insulated with Cellular Glass insulation, in accordance with manufacturer's instructions for application with thickness as determined from Table 2 (whichever is the most restrictive).

3.2.5.2 Installation of Below ground Pipe Insulation

a. Bore surfaces of the insulation shall be coated with a thin coat of gypsum cement of a type recommended by the insulation manufacturer. Coating thickness shall be sufficient to fill surface cells of insulation. Mastic type materials shall not be used for this coating. Note that unless this is for a cyclic application (i.e., one that fluctuates between high and low temperature on a daily process basis) there is no need to bore coat the material.

b. Stainless steel bands, 3/4 inch wide by 0.020 inch thick shall be used to secure insulation in place. A minimum of two bands per section of insulation shall be applied. As an alternate, fiberglass reinforced tape may be used to secure insulation on piping up to 12 inches in diameter. A minimum of two bands per section of insulation shall be applied.

c. Insulation shall terminate at anchor blocks but shall be continuous through sleeves and manholes.

d. At point of entry to buildings, underground insulation shall be terminated 2 inches inside the wall or floor, shall butt tightly against the aboveground insulation and the butt joint shall be sealed with high temperature silicone sealant and covered with fibrous glass tape.

e. Provision for expansion and contraction of the insulation system shall be made in accordance with the insulation manufacturer's recommendations.

f. Flanges, couplings, valves, and fittings shall be insulated with factory pre-molded, prefabricated, or field-fabricated sections of insulation of the same material and thickness as the adjoining pipe insulation. Insulation sections shall be secured as recommended by the manufacturer.

g. Insulation, including fittings, shall be finished with three coats of asphaltic mastic, with 6 by 5.5 mesh synthetic reinforcing fabric embedded between coats. Fabric shall be overlapped a minimum of 2 inches at joints. Total film thickness shall be a minimum of 3/16 inch. As an alternate, a prefabricated bituminous laminated jacket, reinforced with internal reinforcement mesh, shall be applied to the insulation. Jacketing material and application procedures shall match manufacturer's written instructions. Vapor barrier - less than 0.0000 permeability self adhesive (minimum 2 mils adhesive, 3 mils embossed) jacket greater than 3 ply, standard grade, silver, white, black and embossed or greater than 8 ply (minimum 2.9 mils adhesive), heavy duty, white or natural). Application procedures shall match the manufacturer's written instructions.

h. At termination points, other than building entrances, the mastic and cloth or tape shall cover the ends of insulation and extend 2 inches along the bare pipe.

3.3 DUCT INSULATION SYSTEMS INSTALLATION

Install duct insulation systems in accordance with the approved MICA Insulation Stds plates as supplemented by the manufacturer's published installation instructions. Duct insulation minimum thickness and insulation level must be as listed in Table 3 and must meet or exceed the requirements of ASHRAE 90.1 - IP.

Except for oven hood exhaust duct insulation, corner angles shall be installed on external corners of insulation on ductwork in exposed finished spaces before covering with jacket. Air conditioned spaces shall be defined as those spaces directly supplied with cooled conditioned air (or provided with a cooling device such as a fan-coil unit) and heated conditioned air (or provided with a heating device such as a unit heater, radiator or convector).

3.3.1 Duct Insulation Minimum Thickness

Duct insulation minimum thickness in accordance with Table 4.

Table 4 - Minimum Duct Insulation (inches)	
Cold Air Ducts	2.0
Relief Ducts	1.5
Fresh Air Intake Ducts	1.5
Warm Air Ducts	2.0
Relief Ducts	1.5
Fresh Air Intake Ducts	1.5

3.3.2 Insulation and Vapor Retarder/Vapor Barrier for Cold Air Duct

Insulation and vapor retarder/vapor barrier shall be provided for the following cold air ducts and associated equipment.

a. Supply ducts.

b. Return air ducts.

c. Relief ducts.

d. Flexible run-outs (field-insulated).

e. Plenums.

f. Duct-mounted coil casings.

g. Coil headers and return bends.

h. Coil casings.

i. Fresh air intake ducts.

j. Filter boxes.

k. Mixing boxes (field-insulated).

l. Supply fans (field-insulated).

m. Site-erected air conditioner casings.

n. Ducts exposed to weather.

o. Combustion air intake ducts.

Insulation for rectangular ducts shall be flexible type where concealed, minimum density 3/4 pcf, and rigid type where exposed, minimum density 3 pcf. Insulation for both concealed or exposed round/oval ducts shall be flexible type, minimum density 3/4 pcf or a semi rigid board, minimum density 3 pcf, formed or fabricated to a tight fit, edges beveled and joints tightly butted and staggered. Insulation for all exposed ducts shall be provided with either a white, paint-able, factory-applied Type I jacket or a field applied vapor retarder/vapor barrier jacket coating finish as specified, the total field applied dry film thickness shall be

approximately 1/16 inch. Insulation on all concealed duct shall be provided with a factory-applied Type I or II vapor retarder/vapor barrier jacket. Duct insulation shall be continuous through sleeves and prepared openings except firewall penetrations. Duct insulation terminating at fire dampers, shall be continuous over the damper collar and retaining angle of fire dampers, which are exposed to unconditioned air and which may be prone to condensate formation. Duct insulation and vapor retarder/vapor barrier shall cover the collar, neck, and un-insulated surfaces of diffusers, registers and grills. Vapor retarder/vapor barrier materials shall be applied to form a complete unbroken vapor seal over the insulation. Sheet Metal Duct shall be sealed in accordance with Section 23 30 00 HVAC AIR DISTRIBUTION.

3.3.2.1 Installation on Concealed Duct

a. For rectangular, oval or round ducts, flexible insulation shall be attached by applying adhesive around the entire perimeter of the duct in 6 inch wide strips on 12 inch centers.

b. For rectangular and oval ducts, 24 inches and larger insulation shall be additionally secured to bottom of ducts by the use of mechanical fasteners. Fasteners shall be spaced on 16 inch centers and not more than 16 inches from duct corners.

c. For rectangular, oval and round ducts, mechanical fasteners shall be provided on sides of duct risers for all duct sizes. Fasteners shall be spaced on 16 inch centers and not more than 16 inches from duct corners.

d. Insulation shall be impaled on the mechanical fasteners (self stick pins) where used and shall be pressed thoroughly into the adhesive. Care shall be taken to ensure vapor retarder/vapor barrier jacket joints overlap 2 inches. The insulation shall not be compressed to a thickness less than that specified. Insulation shall be carried over standing seams and trapeze-type duct hangers.

e. Where mechanical fasteners are used, self-locking washers shall be installed and the pin trimmed and bent over.

f. Jacket overlaps shall be secured with staples and tape as necessary to ensure a secure seal. Staples, tape and seams shall be coated with a brush coat of vapor retarder coating or PVDC adhesive tape or greater than 3 ply laminate (minimum 2 mils adhesive, 3 mils embossed) - less than 0.0000 perm adhesive tape.

g. Breaks in the jacket material shall be covered with patches of the same material as the vapor retarder jacket. The patches shall extend not less than 2 inches beyond the break or penetration in all directions and shall be secured with tape and staples. Staples and tape joints shall be sealed with a brush coat of vapor retarder coating or PVDC adhesive tape or greater than 3 ply laminate (minimum 2 mils adhesive, 3 mils embossed) - less than 0.0000 perm adhesive tape.

h. At jacket penetrations such as hangers, thermometers, and damper operating rods, voids in the insulation shall be filled and the penetration sealed with a brush coat of vapor retarder coating or PVDC adhesive tape greater than 3 ply laminate (minimum 2 mils adhesive, 3 mils embossed) - less than 0.0000 perm adhesive tape.

i. Insulation terminations and pin punctures shall be sealed and flashed with a reinforced vapor retarder coating finish or tape with a brush coat of vapor retarder coating.. The coating shall overlap the adjoining insulation and un-insulated surface 2 inches. Pin puncture coatings shall extend 2 inches from the puncture in all directions.

j. Where insulation standoff brackets occur, insulation shall be extended under the bracket and the jacket terminated at the bracket.

3.3.2.2 Installation on Exposed Duct Work

a. For rectangular ducts, rigid insulation shall be secured to the duct by mechanical fasteners on all four sides of the duct, spaced not more than 12 inches apart and not more than 3 inches from the edges of the insulation joints. A minimum of two rows of fasteners shall be provided for each side of duct 12 inches and larger. One row shall be provided for each side of duct less than 12 inches. Mechanical fasteners shall be as corrosion resistant as G60 coated galvanized steel, and shall indefinitely sustain a 50 lb tensile dead load test perpendicular to the duct wall.

b. Form duct insulation with minimum jacket seams. Fasten each piece of rigid insulation to the duct using mechanical fasteners. When the height of projections is less than the insulation thickness, insulation shall be brought up to standing seams, reinforcing, and other vertical projections and shall not be carried over. Vapor retarder/barrier jacket shall be continuous across seams, reinforcing, and projections. When height of projections is greater than the insulation thickness, insulation and jacket shall be carried over. Apply insulation with joints tightly butted. Neatly bevel insulation around name plates and access plates and doors.

c. Impale insulation on the fasteners; self-locking washers shall be installed and the pin trimmed and bent over.

d. Seal joints in the insulation jacket with a 4 inch wide strip of tape. Seal taped seams with a brush coat of vapor retarder coating.

e. Breaks and ribs or standing seam penetrations in the jacket material shall be covered with a patch of the same material as the jacket. Patches shall extend not less than 2 inches beyond the break or penetration and shall be secured with tape and stapled. Staples and joints shall be sealed with a brush coat of vapor retarder coating.

f. At jacket penetrations such as hangers, thermometers, and damper operating rods, the voids in the insulation shall be filled and the penetrations sealed with a flashing sealant.

g. Insulation terminations and pin punctures shall be sealed and flashed with a reinforced vapor retarder coating finish. The coating shall overlap the adjoining insulation and un-insulated surface 2 inches. Pin puncture coatings shall extend 2 inches from the puncture in all directions.

h. Oval and round ducts, flexible type, shall be insulated with factory Type I jacket insulation with minimum density of 3/4 pcf, attached as in accordance with MICA standards.

3.3.3 Insulation for Warm Air Duct

Insulation and vapor barrier shall be provided for the following warm air ducts and associated equipment:.

a. Supply ducts.

b. Return air ducts.

c. Relief air ducts

d. Flexible run-outs (field insulated).

e. Plenums.

f. Duct-mounted coil casings.

g. Coil-headers and return bends.

h. Coil casings.

i. Fresh air intake ducts.

j. Filter boxes.

k. Mixing boxes.

l. Supply fans.

m. Site-erected air conditioner casings.

n. Ducts exposed to weather.

o. Exhaust ducts passing through concealed spaces exhausting conditioned air.

Insulation for rectangular ducts shall be flexible type where concealed, and rigid type where exposed. Insulation on exposed ducts shall be provided with a white, paint-able, factory-applied Type II jacket, or finished with adhesive finish. Flexible type insulation shall be used for round ducts, with a factory-applied Type II jacket. Insulation on concealed duct shall be provided with a factory-applied Type II jacket. Adhesive finish where indicated to be used shall be accomplished by applying two coats of adhesive with a layer of glass cloth embedded between the coats. The total dry film thickness shall be approximately 1/16 inch. Duct insulation shall be continuous through sleeves and prepared openings. Duct insulation shall terminate at fire dampers and flexible connections.

3.3.3.1 Installation on Concealed Duct

a. For rectangular, oval and round ducts, insulation shall be attached by applying adhesive around the entire perimeter of the duct in 6 inch wide strips on 12 inch centers.

b. For rectangular and oval ducts 24 inches and larger, insulation shall be secured to the bottom of ducts by the use of mechanical fasteners. Fasteners shall be spaced on 18 inch centers and not more than 18 inches from duct corner.

c. For rectangular, oval and round ducts, mechanical fasteners shall be provided on sides of duct risers for all duct sizes. Fasteners shall be spaced on 18 inch centers and not more than 18 inches from duct corners.

d. The insulation shall be impaled on the mechanical fasteners where used. The insulation shall not be compressed to a thickness less than that specified. Insulation shall be carried over standing seams and trapeze-type hangers.

e. Self-locking washers shall be installed where mechanical fasteners are used and the pin trimmed and bent over.

f. Insulation jacket shall overlap not less than 2 inches at joints and the lap shall be secured and stapled on 4 inch centers.

3.3.3.2 Installation on Exposed Duct

a. For rectangular ducts, the rigid insulation shall be secured to the duct by the use of mechanical fasteners on all four sides of the duct, spaced not more than 16 inches apart and not more than 6 inches from the edges of the insulation joints. A minimum of two rows of fasteners shall be provided for each side of duct 12 inches and larger and a minimum of one row for each side of duct less than 12 inches.

b. Duct insulation with factory-applied jacket shall be formed with minimum jacket seams, and each piece of rigid insulation shall be fastened to the duct using mechanical fasteners. When the height of projection is less than the insulation thickness, insulation shall be brought up to standing seams, reinforcing, and other vertical projections and shall not be carried over the projection. Jacket shall be continuous across seams, reinforcing, and projections. Where the height of projections is greater than the insulation thickness, insulation and jacket shall be carried over the projection.

c. Insulation shall be impaled on the fasteners; self-locking washers shall be installed and pin trimmed and bent over.

d. Joints on jacketed insulation shall be sealed with a 4 inch wide strip of tape and brushed with vapor retarder coating.

e. Breaks and penetrations in the jacket material shall be covered with a patch of the same material as the jacket. Patches shall extend not less than 2 inches beyond the break or penetration and shall be secured with adhesive and stapled.

f. Insulation terminations and pin punctures shall be sealed with tape and brushed with vapor retarder coating.

g. Oval and round ducts, flexible type, shall be insulated with factory Type I jacket insulation, minimum density of 3/4 pcf attached by staples spaced not more than 16 inches and not more than 6 inches from the degrees of joints. Joints shall be sealed in accordance with item "d." above.

3.3.4 Ducts Handling Air for Dual Purpose

For air handling ducts for dual purpose below and above 60 degrees F,

ducts shall be insulated as specified for cold air duct.

3.3.5 Insulation for Evaporative Cooling Duct

Evaporative cooling supply duct located in spaces not evaporatively cooled, shall be insulated. Material and installation requirements shall be as specified for duct insulation for warm air duct.

3.3.6 Duct Test Holes

After duct systems have been tested, adjusted, and balanced, breaks in the insulation and jacket shall be repaired in accordance with the applicable section of this specification for the type of duct insulation to be repaired.

3.3.7 Duct Exposed to Weather

3.3.7.1 Installation

Ducts exposed to weather shall be insulated and finished as specified for the applicable service for exposed duct inside the building. After the above is accomplished, the insulation shall then be further finished as detailed in the following subparagraphs.

3.3.7.2 Round Duct

Laminated self-adhesive (minimum 2 mils adhesive, 3 mils embossed) vapor barrier/weatherproofing jacket - Less than 0.0000 permeability, (greater than 3 ply, standard grade, silver, white, black and embossed or greater than 8 ply, heavy duty, white and natural) membrane shall be applied overlapping material by 3 inches no bands or caulking needed - see manufacturer's recommended installation instructions. Aluminum jacket with factory applied moisture retarder shall be applied with the joints lapped not less than 3 inches and secured with bands located at circumferential laps and at not more than 12 inch intervals throughout. Horizontal joints shall lap down to shed water and located at 4 or 8 o'clock position. Joints shall be sealed with metal jacketing sealant to prevent moisture penetration. Where jacketing abuts an un-insulated surface, joints shall be sealed with metal jacketing sealant.

3.3.7.3 Fittings

Fittings and other irregular shapes shall be finished as specified for rectangular ducts.

3.3.7.4 Rectangular Ducts

Two coats of weather barrier mastic reinforced with fabric or mesh for outdoor application shall be applied to the entire surface. Each coat of weatherproof mastic shall be 1/16 inch minimum thickness. The exterior shall be a metal jacketing applied for mechanical abuse and weather protection, and secured with screws or vapor barrier/weatherproofing jacket less than 0.0000 permeability greater than 3 ply, standard grade, silver, white, black, and embossed or greater than 8 ply, heavy duty white and natural. Membrane shall be applied overlapping material by 3 inches. No bands or caulking needed-see manufacturing recommend installation instructions.

3.4 EQUIPMENT INSULATION SYSTEMS INSTALLATION

Install equipment insulation systems in accordance with the approved MICA Insulation Stds plates as supplemented by the manufacturer's published installation instructions.

3.4.1 General

Removable insulation sections shall be provided to cover parts of equipment that must be opened periodically for maintenance including vessel covers, fasteners, flanges and accessories. Equipment insulation shall be omitted on the following:

a. Hand-holes.

b. Boiler manholes.

c. Cleanouts.

d. ASME stamps.

e. Manufacturer's nameplates.

f. Duct Test/Balance Test Holes.

3.4.2 Insulation for Cold Equipment

Cold equipment below 60 degrees F: Insulation shall be furnished on equipment handling media below 60 degrees F including the following:

a. Pumps.

b. Refrigeration equipment parts that are not factory insulated.

c. Drip pans under chilled equipment.

d. Cold water storage tanks.

e. Water softeners.

f. Duct mounted coils.

g. Cold and chilled water pumps.

h. Pneumatic water tanks.

i. Roof drain bodies.

j. Air handling equipment parts that are not factory insulated.

k. Expansion and air separation tanks.

3.4.2.1 Insulation Type

Insulation shall be suitable for the temperature encountered. Material and thicknesses shall be as shown in Table 5:

TABLE 5		
Insulation Thickness for Cold Equipment (inches)		
Equipment handling media at indicated temperature		
	Material	Thickness (inches)
35 to 60 degrees F		
	Cellular Glass	1.5
	Flexible Elastomeric Cellular	1
1 to 34 degrees F		
	Cellular Glass	3
	Flexible Elastomeric Cellular	1.5
Minus 30 to 0 degrees F		
	Cellular Glass	3.5
	Flexible Elastomeric Cellular	1.75

3.4.2.2 Pump Insulation

a. Insulate pumps by forming a box around the pump housing. The box shall be constructed by forming the bottom and sides using joints that do not leave raw ends of insulation exposed. Joints between sides and between sides and bottom shall be joined by adhesive with lap strips for rigid mineral fiber and contact adhesive for flexible elastomeric cellular insulation. The box shall conform to the requirements of MICA Insulation Stds plate No. 49 when using flexible elastomeric cellular insulation. Joints between top cover and sides shall fit tightly forming a female shiplap joint on the side pieces and a male joint on the top cover, thus making the top cover removable.

b. Exposed insulation corners shall be protected with corner angles.

c. Upon completion of installation of the insulation, including removable sections, two coats of vapor retarder coating shall be applied with a layer of glass cloth embedded between the coats. The total dry thickness of the finish shall be 1/16 inch. A parting line shall be provided between the box and the removable sections allowing the removable sections to be removed without disturbing the insulation coating. Flashing sealant shall be applied to parting line, between equipment and removable section insulation, and at all penetrations.

3.4.2.3 Other Equipment

a. Insulation shall be formed or fabricated to fit the equipment. To ensure a tight fit on round equipment, edges shall be beveled and joints shall be tightly butted and staggered.

b. Insulation shall be secured in place with bands or wires at intervals as recommended by the manufacturer but not more than 12 inch centers except flexible elastomeric cellular which shall be adhered with contact adhesive. Insulation corners shall be protected under wires and bands with suitable corner angles.

c. Cellular glass shall be installed in accordance with manufacturer's instructions. Joints and ends shall be sealed with joint sealant, and sealed with a vapor retarder coating.

d. Insulation on heads of heat exchangers shall be removable. Removable section joints shall be fabricated using a male-female shiplap type joint. The entire surface of the removable section shall be finished by applying two coats of vapor retarder coating with a layer of glass cloth embedded between the coats. The total dry thickness of the finish shall be 1/16 inch.

e. Exposed insulation corners shall be protected with corner angles.

f. Insulation on equipment with ribs shall be applied over 6 by 6 inches by 12 gauge welded wire fabric which has been cinched in place, or if approved by the Contracting Officer, spot welded to the equipment over the ribs. Insulation shall be secured to the fabric with J-hooks and 2 by 2 inches washers or shall be securely banded or wired in place on 12 inch centers.

3.4.2.4 Vapor Retarder/Vapor Barrier

Upon completion of installation of insulation, penetrations shall be caulked. Two coats of vapor retarder coating or vapor barrier jacket shall be applied over insulation, including removable sections, with a layer of open mesh synthetic fabric embedded between the coats. The total dry thickness of the finish shall be 1/16 inch. Flashing sealant or vapor barrier tape shall be applied to parting line between equipment and removable section insulation.

3.4.3 Insulation for Hot Equipment

Insulation shall be furnished on equipment handling media above 60 degrees F including the following:

a. Converters.

b. Heat exchangers.

c. Hot water generators.

d. Water heaters.

e. Pumps handling media above 130 degrees F.

g. Hot water storage tanks.

h. Air separation tanks.

i. Surge tanks.

j. Flash tanks.

l. Unjacketed boilers or parts of boilers.

m. Boiler flue gas connection from boiler to stack (if inside).

n. Induced draft fans.

p. Condensate receivers.

3.4.3.1 Insulation

Insulation shall be suitable for the temperature encountered. Shell and tube-type heat exchangers shall be insulated for the temperature of the shell medium.

Insulation thickness for hot equipment shall be determined using Table 6:

TABLE 6

Insulation Thickness for Hot Equipment (inches)

Equipment handling steam or media at indicated pressure or temperature limit		
	Material	Thickness (inches)
15 psig or 250 degrees F		
	Rigid Mineral Fiber	2
	Flexible Mineral Fiber	2
	Calcium Silicate/Perlite	4
	Cellular Glass	3
	Faced Phenolic Foam	1.5
	Flexible Elastomeric Cellular (<200 F)	1
200psig or 400 degrees F		
	Rigid Mineral Fiber	3
	Flexible Mineral Fiber	3
	Calcium Silicate/Perlite	4
	Cellular Glass	4
600 degrees F		
	Rigid Mineral Fiber	5
	Flexible Mineral Fiber	6
	Calcium Silicate/Perlite	6
	Cellular Glass	6

TABLE 6		
Insulation Thickness for Hot Equipment (inches)		
Equipment handling steam or media at indicated pressure or temperature limit		
	Material	Thickness (inches)
600 degrees F: Thickness necessary to limit the external temperature of the insulation to 120 F. Heat transfer calculations shall be submitted to substantiate insulation and thickness selection.		

3.4.3.2 Insulation of Pumps

Insulate pumps by forming a box around the pump housing. The box shall be constructed by forming the bottom and sides using joints that do not leave raw ends of insulation exposed. Bottom and sides shall be banded to form a rigid housing that does not rest on the pump. Joints between top cover and sides shall fit tightly. The top cover shall have a joint forming a female shiplap joint on the side pieces and a male joint on the top cover, making the top cover removable. Two coats of Class I adhesive shall be applied over insulation, including removable sections, with a layer of glass cloth embedded between the coats. A parting line shall be provided between the box and the removable sections allowing the removable sections to be removed without disturbing the insulation coating. The total dry thickness of the finish shall be 1/16 inch. Caulking shall be applied to parting line of the removable sections and penetrations.

3.4.3.3 Other Equipment

a. Insulation shall be formed or fabricated to fit the equipment. To ensure a tight fit on round equipment, edges shall be beveled and joints shall be tightly butted and staggered.

b. Insulation shall be secured in place with bands or wires at intervals as recommended by the manufacturer but not greater than 12 inch centers except flexible elastomeric cellular which shall be adhered. Insulation corners shall be protected under wires and bands with suitable corner angles.

c. On high vibration equipment, cellular glass insulation shall be set in a coating of bedding compound as recommended by the manufacturer, and joints shall be sealed with bedding compound. Mineral fiber joints shall be filled with finishing cement.

d. Insulation on heads of heat exchangers shall be removable. The removable section joint shall be fabricated using a male-female shiplap type joint. Entire surface of the removable section shall be finished as specified.

e. Exposed insulation corners shall be protected with corner angles.

f. On equipment with ribs, such as boiler flue gas connection, draft fans, and fly ash or soot collectors, insulation shall be applied over 6 by 6 inch by 12 gauge welded wire fabric which has been cinched in

place, or if approved by the Contracting Officer, spot welded to the equipment over the ribs. Insulation shall be secured to the fabric with J-hooks and 2 by 2 inch washers or shall be securely banded or wired in place on 12 inch (maximum) centers.

g. On equipment handling media above 600 degrees F, insulation shall be applied in two or more layers with joints staggered.

h. Upon completion of installation of insulation, penetrations shall be caulked. Two coats of adhesive shall be applied over insulation, including removable sections, with a layer of glass cloth embedded between the coats. The total dry thickness of the finish shall be 1/16 inch. Caulking shall be applied to parting line between equipment and removable section insulation.

3.4.4 Equipment Handling Dual Temperature Media

Below and above 60 degrees F: equipment handling dual temperature media shall be insulated as specified for cold equipment.

3.4.5 Equipment Exposed to Weather

3.4.5.1 Installation

Equipment exposed to weather shall be insulated and finished in accordance with the requirements for ducts exposed to weather in paragraph DUCT INSULATION INSTALLATION.

3.4.5.2 Optional Panels

At the option of the Contractor, prefabricated metal insulation panels may be used in lieu of the insulation and finish previously specified. Thermal performance shall be equal to or better than that specified for field applied insulation. Panels shall be the standard catalog product of a manufacturer of metal insulation panels. Fastenings, flashing, and support system shall conform to published recommendations of the manufacturer for weatherproof installation and shall prevent moisture from entering the insulation. Panels shall be designed to accommodate thermal expansion and to support a 250 pound walking load without permanent deformation or permanent damage to the insulation. Exterior metal cover sheet shall be aluminum and exposed fastenings shall be stainless steel or aluminum.

-- End of Section --

SECTION 23 09 00

INSTRUMENTATION AND CONTROL FOR HVAC
02/19, CHG 3: 05/21

PART 1 GENERAL

1.1 SUMMARY

Provide a complete Direct Digital Control (DDC) system suitable for the control of the heating, ventilating and air conditioning (HVAC) and other building-level systems as indicated and shown and in accordance with Section 23 09 13 INSTRUMENTATION AND CONTROL DEVICES FOR HVAC, Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS for BACnet or Niagara BACnet systems, and other referenced Sections.

1.1.1 Proprietary Systems

1.1.1.1 Proprietary Systems Exempted From Open Protocol Requirements

The following systems are specifically exempted from the open protocol requirements of Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS:

a. A simple split (DX) system consisting of a single indoor unit and a single outdoor unit from the same manufacturer.

b. Systems in Table I (previously approved by the designer in accordance with UFC 3-410-02).

TABLE I: Systems Approved to Use Proprietary Communications

System	Type (Multi-Split/VRF or Chiller/Boiler Plant)	Proprietary Multi-Split Engineering Tool Software Required (for Multi-Split/VRF only)

c. A system (not already shown Table I) of multiple boilers or multiple chillers communicating with a proprietary network for which an approved request has been obtained and for which: all units are from the same manufacturer, they are all co-located in the same room, the network connecting them is fully contained in that room, and the units are operating using a common "plant" sequence of operation which stages the units in a manner that requires operational parameters be shared between them and which cannot be accomplished with a single lead-lag command from a third-party controller.

1.1.1.2 Implementation of Proprietary Systems

For proprietary systems exempted from open protocol requirements, a proprietary network and DDC hardware communicating via proprietary

protocol are permitted. For these systems a building control network meeting the requirements of Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS must also be provided, along with a gateway or interface to connect the proprietary system to the open building control network.

The proprietary system gateway or interface must provide the required functionaliality as shown on the points schedule. Scheduling, alarming, trending, overrides, network inputs, network outputs and other protocol related requirements must be met on the open protocol control system as specified in Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS.

1.1.1.3 Proprietary Multi-Split Engineering Tool Software

For each permitted proprietary systems in Table 1 shown as requiring Proprietary Multi-Split Engineering Tool Software, provide the software needed to replace a unit and configure the replacement. Submit hard copies of the software user manuals with the software submittal.

Submit Proprietary Multi-Split Engineering Tool Software on CD-ROM as a Technical Data Package.

1.1.2 System Requirements

Provide systems meeting the requirements this Section and other Sections referenced by this Section, and which have the following characteristics:

a. The system implements the control sequences of operation shown in the Contract Drawings using DDC hardware to control mechanical and electrical equipment

b. The system meet the requirements of this specification as a stand-alone system and does not require connection to any other system.

c. Control sequences reside in DDC hardware in the building. The building control network is not dependent upon connection to a Utility Monitoring and Control System (UMCS) Front End or to any other system for performance of control sequences. To the greatest extent practical, the hardware performs control sequences without reliance on the building network, unless otherwise pre-approved by the Contracting Officer.

d. The hardware is installed such that individual control equipment can be replaced by similar control equipment from other equipment manufacturers with no loss of system functionality.

e. All necessary documentation, configuration information, programming tools, programs, drivers, and other software are licensed to and otherwise remain with the Government such that the Government or their agents are able to perform repair, replacement, upgrades, and expansions of the system without subsequent or future dependence on the Contractor, Vendor or Manufacturer.

f. Sufficient documentation and data, including rights to documentation and data, are provided such that the Government or their agents can execute work to perform repair, replacement, upgrades, and expansions of the system without subsequent or future dependence on the Contractor, Vendor or Manufacturer.

g. Hardware is installed and configured such that the Government or their agents are able to perform repair, replacement, and upgrades of individual hardware without further interaction with the Contractor, Vendor or Manufacturer.

h. All Niagara Framework components have an unrestricted interoperability license with a Niagara Compatibility Statement (NiCS) following the Tridium Open NiCS Specification and have a value of "ALL" for "Station Compatibility In", "Station Compatibility Out", "Tool Compatibility In" and "Tool Compatibility Out". Note that this will result in the following entries in the license file:
accept.station.in="*"
accept.station.out="*"
accept.wb.in="*"
accept.wb.out="*"

1.1.3 End to End Accuracy

Select products, install and configure the system such that the maximum error of a measured value as read from the DDC Hardware over the network is less than the maximum allowable error specified for the sensor or instrumentation.

1.1.4 Verification of Dimensions

After becoming familiar with all details of the work, verify all dimensions in the field, and advise the Contracting Officer of any discrepancy before performing any work.

1.1.5 Drawings

The Government will not indicate all offsets, fittings, and accessories that may be required on the drawings. Carefully investigate the mechanical, electrical, and finish conditions that could affect the work to be performed, arrange such work accordingly, and provide all work necessary to meet such conditions.

1.2 RELATED SECTIONS

Related work specified elsewhere:

a. Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS for BACnet systems with or without Niagara Framework.

b. Section 23 09 13 INSTRUMENTATION AND CONTROL DEVICES FOR HVAC

c. Section 01 91 00.15 10 TOTAL BUILDING COMMISSIONING

1.3 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 135	(2020; Errata 1-2 2021) BACnet—A Data Communication Protocol for Building Automation and Control Networks
ASHRAE FUN IP	(2021) Fundamentals Handbook, I-P Edition

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE C62.41	(1991; R 1995) Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code
NFPA 90A	(2021) Standard for the Installation of Air Conditioning and Ventilating Systems

TRIDIUM, INC (TRIDIUM)

Niagara Framework	(2012) NiagaraAX User's Guide
Tridium Open NiCS	(2005) Understanding the NiagaraAX Compatibility Statement (NiCS)

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 3-410-02	(2018; with Change 2, 2021) Direct Digital Control for HVAC and Other Building Control Systems

UNDERWRITERS LABORATORIES (UL)

UL 5085-3	(2006; Reprint Nov 20121) Low Voltage Transformers - Part 3: Class 2 and Class 3 Transformers

1.4 DEFINITIONS

The following list of definitions includes terms used in Sections referenced by this Section and are included here for completeness.The definitions contained in this Section may disagree with how terms are defined or used in other documents, including documents referenced by this Section. The definitions included here are the authoritative definitions for this Section and all Sections referenced by this Section.

After each term the protocol related to that term is included in parenthesis.

1.4.1 Alarm Generation (All protocols)

Alarm Generation is the monitoring of a value, comparison of the value to alarm conditions and the creation of an alarm when the conditions set for the alarm are met. Note that this does NOT include delivery of the alarm to the final destination (such as a user interface).

1.4.2 Building Automation and Control Network (BACnet) (BACnet)

The term BACnet is used in two ways. First meaning the BACnet Protocol Standard - the communication requirements as defined by ASHRAE 135 including all annexes and addenda. The second to refer to the overall technology related to the ASHRAE 135 protocol.

1.4.3 BACnet Advanced Application Controller (B-AAC) (BACnet)

A hardware device BTL Listed as a B-AAC, which is required to support BACnet Interoperability Building Blocks (BIBBs) for scheduling and alarming, but is not required to support as many BIBBs as a B-BC.

1.4.4 BACnet Application Specific Controller (B-ASC) (BACnet)

A hardware device BTL Listed as a B-ASC, with fewer BIBB requirements than a B-AAC. It is intended for use in a specific application.

1.4.5 BACnet Building Controller (B-BC) (BACnet)

A hardware device BTL Listed as a B-BC. A general-purpose, field-programmable device capable of carrying out a variety of building automation and control tasks including control and monitoring via direct digital control (DDC) of specific systems and data storage for trend information, time schedules, and alarm data. Like the other BTL Listed controller types (B-AAC, B-ASC etc.) a B-BC device is required to support the server ("B") side of the ReadProperty and WriteProperty services, but unlike the other controller types it is also required to support the client ("A") side of these services. Communication between controllers requires that one of them support the client side and the other support the server side, so a B-BC is often used when communication between controllers is needed.

1.4.6 BACnet Broadcast Management Device (BBMD) (BACnet)

A communications device, typically combined with a BACnet router. A BBMD forwards BACnet broadcast messages to BACnet/IP devices and other BBMDs connected to the same BACnet/IP network. Each IP subnet that is part of a BACnet/IP network must have at least one BBMD. Note there are additional restrictions when multiple BBMDs share an IP subnet.

1.4.7 BACnet/IP (BACnet)

An extension of BACnet, Annex J, defines the use of a reserved UDP socket to transmit BACnet messages over IP networks. A BACnet/IP network is a collection of one or more IP subnets that share the same BACnet network number. See also paragraph BACNET BROADCAST MANAGEMENT DEVICE.

1.4.8 BACnet Internetwork (BACnet)

Two or more BACnet networks, connected with BACnet routers. In a BACnet

Internetwork, there exists only one message path between devices.

1.4.9 BACnet Interoperability Building Blocks (BIBBs) (BACnet)

A BIBB is a collection of one or more ASHRAE 135 Services intended to define a higher level of interoperability. BIBBs are combined to build the BACnet functional requirements for a device in a specification. Some BIBBs define additional requirements (beyond requiring support for specific services) in order to achieve a level of interoperability. For example, the BIBB DS-V-A (Data Sharing-View-A), which would typically be used by a front-end, not only requires the client to support the ReadProperty Service, but also provides a list of data types (Object / Properties) which the client must be able to interpret and display for the user.

In the BIBB shorthand notation, -A is the client side and -B is the server side.

The following is a list of some BIBBs used by this or referenced Sections:	
DS-COV-A	Data Sharing-Change of Value (A side)
DS-COV-B	Data Sharing-Change of Value (B side)
NM-RC-B	Network Management-Router Configuration (B side)
DS-RP-A	Data Sharing-Read Property (A side)
DS-RP-B	Data Sharing-Read Property (B side)
DS-RPM-A	Data Sharing-Read Property Multiple (A Side)
DS-RPM-B	Data Sharing-Read Property Multiple (B Side)
DS-WP-A	Data Sharing-Write Property (A Side)
DM-TS-B	Device Management-Time Synchronization (B Side)
DM-UTC-B	Device Management-UTC Time Synchronization (B Side)
DS-WP-B	Data Sharing-Write Property (B side)
SCHED-E-B	Scheduling-External (B side)
DM-OCD-B	Device Management-Object Creation and Deletion (B side)
AE-N-I-B	Alarm and Event-Notification Internal (B Side)
AE-N-E-B	Alarm and Event-Notification External (B Side)
T-VMT-I-B	Trending-Viewing and Modifying Trends Internal (B Side)
T-VMT-E-B	Trending-Viewing and Modifying Trends External (B Side)

1.4.10 BACnet Network (BACnet)

In BACnet, a portion of the control Internetwork consisting of one or more segments connected by repeaters. Networks are separated by routers.

1.4.11 BACnet Operator Display (B-OD) (BACnet)

A basic operator interface with limited capabilities relative to a B-OWS. It is not intended to perform direct digital control. A B-OD profile could be used for LCD devices, displays affixed to BACnet devices, handheld terminals or other very simple user interfaces.

1.4.12 BACnet Segment (BACnet)

One or more physical segments interconnected by repeaters (ASHRAE 135).

1.4.13 BACnet Smart Actuator (B-SA) (BACnet)

A simple actuator device with limited resources intended for specific applications.

1.4.14 BACnet Smart Sensor (B-SS) (BACnet)

A simple sensing device with limited resources.

1.4.15 BACnet Testing Laboratories (BTL) (BACnet)

Established by BACnet International to support compliance testing and interoperability testing activities and consists of BTL Manager and the BTL Working Group (BTL-WG). BTL also publishes Implementation Guidelines.

1.4.16 BACnet Testing Laboratories (BTL) Listed (BACnet)

A device that has been listed by BACnet Testing Laboratory. Devices may be certified to a specific device profile, in which case the listing indicates that the device supports the required capabilities for that profile, or may be listed as "other".

1.4.17 Binary (All protocols)

A two-state system where an "ON" condition is represented by a high signal level and an "OFF" condition is represented by a low signal level. 'Digital' is sometimes used interchangeably with 'binary'.

1.4.18 Broadcast (BACnet)

Unlike most messages, which are intended for a specific recipient device, a broadcast message is intended for all devices on the network.

1.4.19 Building Control Network (BCN) (All protocols)

The network connecting all DDC Hardware within a building (or specific group of buildings).

1.4.20 Building Point of Connection (BPOC) (All protocols)

A FPOC for a Building Control System. (This term is being phased out of use in preference for FPOC but is still used in some specifications and criteria. When it was used, it typically referred to a piece of control

hardware. The current FPOC definition typically refers instead to IT hardware.)

1.4.21 Commandable (All protocols)

See Overridable.

1.4.22 Commandable Objects (BACnet)

Commandable Objects have a Commandable Property, Priority_Array, and Relinquish_Default Property as defined in ASHRAE 135, Clause 19.2, Command Prioritization.

1.4.23 Configurable (All protocols)

A property, setting, or value is configurable if it can be changed via hardware settings on the device, via the use of engineering software or over the control network from the front end, and is retained through (after) loss of power.

In a non-Niagara Framework BACnet system, a property, setting, or value is configurable if it can be changed via one or more of:

1) via BACnet services (including proprietary BACnet services)
2) via hardware settings on the device

In a Niagara Framework BACnet system, a property, setting, or value is configurable if it can be changed via one or more of:

1) via BACnet services (including proprietary BACnet services)
2) via hardware settings on the device
3) via the Niagara Framework

Note this is more stringent than the ASHRAE 135 definition.

1.4.24 Control Logic Diagram (All protocols)

A graphical representation of control logic for multiple processes that make up a system.

1.4.25 Device (BACnet)

A Digital Controller that contains a BACnet Device Object and uses BACnet to communicate with other devices.

1.4.26 Device Object (BACnet)

Every BACnet device requires one Device Object, whose properties represent the network visible properties of that device. Every Device Object requires a unique Object Identifier number on the BACnet Internetwork. This number is often referred to as the device instance or device ID.

1.4.27 Device Profile (BACnet)

A collection of BIBBs determining minimum BACnet capabilities of a device, defined in ASHRAE 135. Standard device profiles include BACnet Advanced Workstations (B-AWS), BACnet Building Controllers (B-BC), BACnet Advanced Application Controllers (B-AAC), BACnet Application Specific Controllers (B-ASC), BACnet Smart Actuator (B-SA), and BACnet Smart Sensor (B-SS).

1.4.28 Digital Controller (All protocols)

An electronic controller, usually with internal programming logic and digital and analog input/output capability, which performs control functions.

1.4.29 Direct Digital Control (DDC) (All protocols)

Digital controllers performing control logic. Usually the controller directly senses physical values, makes control decisions with internal programs, and outputs control signals to directly operate switches, valves, dampers, and motor controllers.

1.4.30 Field Point of Connection (FPOC) (All protocols)

The FPOC is the point of connection between the UMCS IP Network and the field control network (either an IP network, a non-IP network, or a combination of both). The hardware at this location which provides the connection is generally an IT device such as a switch, IP router, or firewall.

In general, the term "FPOC Location" means the place where this connection occurs, and "FPOC Hardware" means the device that provides the connection. Sometimes the term "FPOC" is used to mean either and its actual meaning (i.e. location or hardware) is determined by the context in which it is used.

1.4.31 Fox Protocol (Niagara Framework)

The protocol used for communication between components in the Niagara Framework. By default, Fox uses TCP port 1911.

1.4.32 Gateway (All protocols)

A device that translates from one protocol application data format to another. Devices that change only the transport mechanism of the protocol - "translating" from TP/FT-10 to Ethernet/IP or from BACnet MS/TP to BACnet over IP for example - are not gateways as the underlying data format does not change. Gateways are also called Communications Bridges or Protocol Translators.

A Niagara Framework Supervisory Gateway is one type of Gateway.

1.4.33 IEEE 802.3 Ethernet (All protocols)

A family of local-area-network technologies providing high-speed networking features over various media, typically Cat 5, 5e or Cat 6 twisted pair copper or fiber optic cable.

1.4.34 Internet Protocol (IP, TCP/IP, UDP/IP) (All protocols)

A communication method, the most common use is the World Wide Web. At the lowest level, it is based on Internet Protocol (IP), a method for conveying and routing packets of information over various LAN media. Two common protocols using IP are User Datagram Protocol (UDP) and Transmission Control Protocol (TCP). UDP conveys information to well-known "sockets" without confirmation of receipt. TCP establishes connections, also known as "sessions", which have end-to-end confirmation and guaranteed sequence of delivery.

1.4.35 Input/Output (I/O) (All protocols)

Physical inputs and outputs to and from a device, although the term sometimes describes network or "virtual" inputs or outputs. See also "Points".

1.4.36 I/O Expansion Unit (All protocols)

An I/O expansion unit provides additional point capacity to a digital controller

1.4.37 IP subnet (All protocols)

A group of devices which share a defined range IP addresses. Devices on a common IP subnet can share data (including broadcasts) directly without the need for the traffic to traverse an IP router.

1.4.38 JACE (Niagara Framework)

Java Application Control Engine. See paragraph NIAGARA FRAMEWORK SUPERVISORY GATEWAY

1.4.39 Local-Area Network (LAN) (All protocols)

A communication network that spans a limited geographic area and uses the same basic communication technology throughout.

1.4.40 Local Display Panels (LDPs) (All protocols)

A DDC Hardware with a display and navigation buttons, and must provide display and adjustment of points as shown on the Points Schedule and as indicated.

1.4.41 MAC Address (All protocols)

Media Access Control address. The physical device address that identifies a device on a Local Area Network.

1.4.42 Master-Slave/Token-Passing (MS/TP) (BACnet)

Data link protocol as defined by the BACnet standard. Multiple speeds (data rates) are permitted by the BACnet MS/TP standard.

1.4.43 Monitoring and Control (M&C) Software (All protocols)

The UMCS 'front end' software which performs supervisory functions such as alarm handling, scheduling and data logging and provides a user interface for monitoring the system and configuring these functions.

1.4.44 Network Number (BACnet)

A site-specific number assigned to each network. This network number must be unique throughout the BACnet Internetwork.

1.4.45 Niagara Framework (Niagara Framework)

A set of hardware and software specifications for building and utility control owned by Tridium Inc. and licensed to multiple vendors. The

Framework consists of front end (M&C) software, web based clients, field level control hardware, and engineering tools. While the Niagara Framework is not adopted by a recognized standards body and does not use an open licensing model, it is sufficiently well-supported by multiple HVAC vendors to be considered a de-facto Open Standard.

1.4.46 Niagara Framework Supervisory Gateway (Niagara Framework)

DDC Hardware component of the Niagara Framework. A typical Niagara architecture has Niagara specific supervisory gateways at the IP level and other (non-Niagara specific) controllers on field networks (TP/FT-10, MS/TP, etc.) beneath the Niagara supervisory gateways. The Niagara specific controllers function as a gateway between the Niagara framework protocol (Fox) and the field network beneath. These supervisory gateways may also be used as general purpose controllers and also have the capability to provide a web-based user interface.

Note that different vendors refer to this component by different names. The most common name is "JACE"; other names include (but are not limited to)"EC-BOS", "FX-40", "TMN", "SLX" and "UNC".

1.4.47 Object (BACnet)

An ASHRAE 135 Object. The concept of organizing BACnet information into standard components with various associated Properties. Examples include Analog Input objects and Binary Output objects.

1.4.48 Object Identifier (BACnet)

A grouping of two Object properties: Object Type (e.g. Analog Value, Schedule, etc.) and Object Instance (in this case, a number). Object Identifiers must be unique within a device.

1.4.49 Object Instance (BACnet)

See paragraph OBJECT IDENTIFIER

1.4.50 Object Properties (BACnet)

Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.

1.4.51 Operator Configurable (All protocols)

Operator configurable values are values that can be changed from a single common front end user interface across multiple vendor systems.

For Niagara Framework Systems, a property, setting, or value is Operator Configurable when it is configurable from a Niagara Framework Front End.

For non Niagara-based BACnet systems, a property, setting, or value in a device is Operator Configurable when it is Configurable and is either:

a. a Writable Property of a Standard BACnet Object; or

b. a Property of a Standard BACnet Object that is Writable when Out_Of_Service is TRUE and Out_Of_Service is Writable.

1.4.52 Override (All protocols)

Changing the value of a point outside of the normal sequence of operation where the change has priority over the sequence and where there is a mechanism for releasing the change such that the point returns to the normal value. Overrides persist until released or overridden at the same or higher priority but are not required to persist through a loss of power. Overrides are often used by operators to change values, and generally originate at a user interface (workstation or local display panel).

1.4.53 Packaged Equipment (All protocols)

Packaged equipment is a single piece of equipment provided by a manufacturer in a substantially complete and operable condition, where the controls (DDC Hardware) are factory installed, and the equipment is sold and shipped from the manufacturer as a single entity. Disassembly and reassembly of a large piece of equipment for shipping does not prevent it from being packaged equipment. Package units may require field installation of remote sensors. Packaged equipment is also called a "packaged unit".

Note industry may use the term "Packaged System" to mean a collection of equipment that is designed to work together where each piece of equipment is packaged equipment and there is a network that connects the equipment together. A "packaged system" of this type is NOT packaged equipment; it is a collection of packaged equipment, and each piece of equipment must individually meet specification requirements.

1.4.54 Packaged Unit (All protocols)

See packaged equipment.

1.4.55 Performance Verification Test (PVT) (All protocols)

The procedure for determining if the installed BAS meets design criteria prior to final acceptance. The PVT is performed after installation, testing, and balancing of mechanical systems. Typically the PVT is performed by the Contractor in the presence of the Government.

1.4.56 Physical Segment (BACnet)

A single contiguous medium to which BACnet devices are attached (ASHRAE 135).

1.4.57 Polling (All protocols)

A device periodically requesting data from another device.

1.4.58 Points (All protocols)

Physical and virtual inputs and outputs. See also paragraph INPUT/OUTPUT (I/O).

1.4.59 Proportional, Integral, and Derivative (PID) Control Loop (All protocols)

Three parameters used to control modulating equipment to maintain a setpoint. Derivative control is often not required for HVAC systems

(leaving "PI" control).

1.4.60 Proprietary (BACnet)

Within the context of BACnet, any extension of or addition to object types, properties, PrivateTransfer services, or enumerations specified in ASHRAE 135. Objects with Object_Type values of 128 and above are Proprietary Objects. Properties with Property_Identifier of 512 and above are proprietary Properties.

1.4.61 Protocol Implementation Conformance Statement (PICS) (BACnet)

A document, created by the manufacturer of a device, which describes which portions of the BACnet standard may be implemented by a given device. ASHRAE 135 requires that all ASHRAE 135 devices have a PICS, and also defines a minimum set of information that must be in it. A device as installed for a specific project may not implement everything in its PICS.

1.4.62 Repeater (All protocols)

A device that connects two control network segments and retransmits all information received on one side onto the other.

1.4.63 Router (All protocols)

A device that connects two ASHRAE 135 networks and controls traffic between the two by retransmitting signals received from one side onto the other based on the signal destination. Routers are used to subdivide a BACnet internetwork and to limit network traffic.

1.4.64 Segment (All protocols)

A 'single' section of a control network that contains no repeaters or routers. There is generally a limit on the number of devices on a segment, and this limit is dependent on the topology/media and device type.

1.4.65 Standard BACnet Objects (BACnet)

Objects with Object_Type values below 128 and specifically enumerated in Clause 21 of ASHRAE 135. Objects which are not proprietary. See paragraph PROPRIETARY.

1.4.66 Standard BACnet Properties (BACnet)

Properties with Property_Identifier values below 512 and specifically enumerated in Clause 21 of ASHRAE 135. Properties which are not proprietary. See Proprietary.

1.4.67 Standard BACnet Services (BACnet)

ASHRAE 135 services other than ConfirmedPrivateTransfer or UnconfirmedPrivateTransfer. See paragraph PROPRIETARY.

1.4.68 UMCS (All protocols)

UMCS stands for Utility Monitoring and Control System. The term refers to all components by which a project site monitors, manages, and controls real-time operation of HVAC and other building systems. These components

include the UMCS "front-end" and all field building control systems connected to the front-end. The front-end consists of Monitoring and Control Software (user interface software), browser-based user interfaces and network infrastructure.

The network infrastructure (the "UMCS Network"), is an IP network connecting multiple building or facility control networks to the Monitoring and Control Software.

1.4.69 UMCS Network (All protocols)

The UMCS Network connects multiple building or facility control networks to the Monitoring and Control Software.

1.4.70 Writable Property (BACnet)

A Property is Writable when it can be changed through the use of one or more of the WriteProperty services defined in ASHRAE 135, Clause 15 regardless of the value of any other Property. Note that in the ASHRAE 135 standard, some Properties may be writable when the Out of Service Property is TRUE; for purposes of this Section, Properties that are only writable when the Out of Service Property is TRUE are not considered to be Writable.

1.5 PROJECT SEQUENCING

TABLE II: PROJECT SEQUENCING lists the sequencing of submittals as specified in paragraph SUBMITTALS (denoted by an 'S' in the 'TYPE' column) and activities as specified in PART 3 EXECUTION (denoted by an 'E' in the 'TYPE' column). TABLE II does not specify overall project milestone and completion dates.

a. Sequencing for Submittals: The sequencing specified for submittals is the deadline by which the submittal must be initially submitted to the Government. Following submission there will be a Government review period as specified in Section 01 33 00 SUBMITTAL PROCEDURES. If the submittal is not accepted by the Government, revise the submittal and resubmit it to the Government within 14 days of notification that the submittal has been rejected. Upon resubmittal there will be an additional Government review period. If the submittal is not accepted the process repeats until the submittal is accepted by the Government.

b. Sequencing for Activities: The sequencing specified for activities indicates the earliest the activity may begin.

c. Abbreviations: In TABLE II the abbreviation AAO is used for 'after approval of' and 'ACO' is used for 'after completion of'.

TABLE II. PROJECT SEQUENCING

ITEM #	TYPE	DESCRIPTION	SEQUENCING (START OF ACTIVITY OR DEADLINE FOR SUBMITTAL)
1	S	Existing Conditions Report	
2	S	DDC Contractor Design Drawings	

TABLE II. PROJECT SEQUENCING

ITEM #	TYPE	DESCRIPTION	SEQUENCING (START OF ACTIVITY OR DEADLINE FOR SUBMITTAL)
3	S	Manufacturer's Product Data	
4	S	Pre-construction QC Checklist	
5	E	Install Building Control System	AAO #1 thru #4
6	E	Start-Up and Start-Up Testing	ACO #5
7	S	Post-Construction QC Checklist	ACO #6
8	S	Programming Software Configuration Software Niagara Framework Engineering Tool Niagara Framework Wizards	ACO #6
9	S	Draft As-Built Drawings	ACO #6
10	S	Start-Up Testing Report	ACO #6
11	S	PVT Procedures	before schedule start of #12 and AAO #10
12	E	Execute PVT	AAO #9 and #11
13	S	PVT Report	ACO #12
14	S	Controller Application Programs Controller Configuration Settings Niagara Framework Supervisory Gateway Backups	AAO #13

TABLE II. PROJECT SEQUENCING			
ITEM #	TYPE	DESCRIPTION	SEQUENCING (START OF ACTIVITY OR DEADLINE FOR SUBMITTAL)
15	S	Final As-Built Drawings	AAO #13
16	S	O&M Instructions	AAO #15
17	S	Training Documentation	AAO #10 and before scheduled start of #18
18	E	Training	AAO #16 and #17
19	S	Closeout QC Checklist	ACO #18

1.6 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

DDC Contractor Design Drawings; G

Draft As-Built Drawings; G

Final As-Built Drawings; G

SD-03 Product Data

Programming Software; G

Controller Application Programs; G

Configuration Software; G

Controller Configuration Settings; G

Proprietary Multi-Split Engineering Tool Software; G

Manufacturer's Product Data; G

Niagara Framework Supervisory Gateway Backups; G

SD-05 Design Data

Boiler Or Chiller Plant Gateway Request

SD-06 Test Reports

Existing Conditions Report

Pre-Construction Quality Control (QC) Checklist; G

Post-Construction Quality Control (QC) Checklist; G

Start-Up Testing Report; G

PVT Procedures; G

PVT Report; G

SD-10 Operation and Maintenance Data

Operation and Maintenance (O&M) Instructions; G

Training Documentation; G

SD-11 Closeout Submittals

Enclosure Keys; G

Password Summary Report; G

Closeout Quality Control (QC) Checklist; G

1.7 DATA PACKAGE AND SUBMITTAL REQUIREMENTS

Technical data packages consisting of technical data and computer software (meaning technical data which relates to computer software) which are specifically identified in this project and which may be defined/required in other specifications must be delivered strictly in accordance with the CONTRACT CLAUSES and in accordance with the Contract Data Requirements List, DD Form 1423. Data delivered must be identified by reference to the particular specification paragraph against which it is furnished. All submittals not specified as technical data packages are considered 'shop drawings' under the Federal Acquisition Regulation Supplement (FARS) and must contain no proprietary information and be delivered with unrestricted rights.

1.8 SOFTWARE FOR DDC HARDWARE AND GATEWAYS

Provide all software related to the programming and configuration of DDC Hardware and Gateways as indicated. License all Software to the project site. The term "controller" as used in these requirements means both DDC Hardware and Gateways.

1.8.1 Configuration Software

For each type of controller, provide the configuration tool software in accordance with Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS. Submit hard copies of the software user manuals for each software with the software submittal.

Submit Configuration Software on CD-ROM as a Technical Data Package.

1.8.2 Controller Configuration Settings

For each controller, provide copies of the installed configuration settings as source code compatible with the configuration tool software for that controller in accordance with Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS.

Submit Controller Configuration Settings on CD-ROM as a Technical Data Package. Include on the CD-ROM a list or table of contents clearly indicating which files are associated with each device. Submit 2 copies of the Controller Configuration Settings CD-ROM.

1.8.3 Programming Software

For each type of programmable controller, provide the programming software in accordance with Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS. Submit hard copies of software user manuals for each software with the software submittal.

Submit Programming Software on CD-ROM as a Technical Data Package.

1.8.4 Controller Application Programs

For each programmable controller, provide copies of the application program as source code compatible with the programming software for that controller in accordance with Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS.

Submit Controller Application Programs on CD-ROM as a Technical Data Package. Include on the CD-ROM a list or table of contents clearly indicating which application program is associated with each device. Submit 2 copies of the Controller Application Programs CD-ROM.

1.8.5 Niagara Framework Supervisory Gateway Backups

For each Niagara Framework Supervisory Gateway, provide a backup of all software within the Niagara Framework Supervisory Gateway, including configuration settings. This backup must be sufficient to allow the restoration of the Niagara Framework Supervisory Gateway or the replacement of the Niagara Framework Supervisory Gateway.

Submit backups for each Niagara Framework Supervisory Gateway on CD-ROM as a Technical Data Package. Mark each backup indicating clearly the source Niagara Framework Supervisory Gateway.

1.9 BOILER OR CHILLER PLANT GATEWAY REQUEST

If requesting the use of a gateway to a boiler or chiller plant as indicated in paragraph Proprietary Systems Exempted From Open Protocol Requirements, submit a Boiler or Chiller Plant Gateway Request describing the configuration of the boilers or chillers including model numbers for equipment and controllers, the sequence of operation for the units, and a justification for the need to operate the units on a shared non-BACnet network.

1.10 QUALITY CONTROL CHECKLISTS

The QC Checklist for BACnet Systems in APPENDIX A of this Section must be completed by the Contractor's Chief Quality Control (QC) Representative

and submitted as indicated.

The QC Checklist for Niagara Framework Based BACnet Systems in APPENDIX A of this Section must be completed by the Contractor's Chief Quality Control (QC) Representative and submitted as indicated.

The QC Representative must verify each item indicated and initial in the space provided to indicate that the requirement has been met. The QC Representative must sign and date the Checklist prior to submission to the Government.

1.10.1 Pre-Construction Quality Control (QC) Checklist

Complete items indicated as Pre-Construction QC Checklist items in the QC Checklist. Submit four copies of the Pre-Construction QC Checklist.

1.10.2 Post-Construction Quality Control (QC) Checklist

Complete items indicated as Post-Construction QC Checklist items in the QC Checklist. Submit four copies of the Post-Construction QC Checklist.

1.10.3 Closeout Quality Control (QC) Checklist

Complete items indicated as Closeout QC Checklist items in the QC Checklist. Submit four copies of the Closeout QC Checklist.

PART 2 PRODUCTS

Provide products meeting the requirements of Section 23 09 13 INSTRUMENTATION AND CONTROL DEVICES FOR HVAC, Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS for BACnet or Niagara BACnet systems, other referenced Sections, and this Section.

2.1 GENERAL PRODUCT REQUIREMENTS

Units of the same type of equipment must be products of a single manufacturer. Each major component of equipment must have the manufacturer's name and address, and the model and serial number in a conspicuous place. Materials and equipment must be standard products of a manufacturer regularly engaged in the manufacturing of these and similar products. The standard products must have been in a satisfactory commercial or industrial use for two years prior to use on this project. The two year use must include applications of equipment and materials under similar circumstances and of similar size. DDC Hardware not meeting the two-year field service requirement is acceptable provided it has been successfully used by the Contractor in a minimum of two previous projects. The equipment items must be supported by a service organization. Items of the same type and purpose must be identical, including equipment, assemblies, parts and components.

2.2 PRODUCT DATA

Provide manufacturer's product data sheets documenting compliance with product specifications for each product provided under Section 23 09 13 INSTRUMENTATION AND CONTROL DEVICES FOR HVAC, Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS, or this Section. Provide product data for all products in a single indexed compendium, organized by product type.

For all BACnet hardware: for each manufacturer, model and version (revision) of DDC Hardware provide the Protocol Implementation Conformance Statement (PICS) in accordance with Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS.

Submit Manufacturer's Product Data on CD-ROM.

2.3 OPERATION ENVIRONMENT

Unless otherwise specified, provide products rated for continuous operation under the following conditions:

a. Pressure: Pressure conditions normally encountered in the installed location.

b. Vibration: Vibration conditions normally encountered in the installed location.

c. Temperature:

(1) Products installed indoors: Ambient temperatures in the range of 32 to 112 degrees F and temperature conditions outside this range normally encountered at the installed location.

(2) Products installed outdoors or in unconditioned indoor spaces: Ambient temperatures in the range of -35 to +151 degrees F and temperature conditions outside this range normally encountered at the installed location.

d. Humidity: 10 to 95 percent relative humidity, noncondensing and humidity conditions outside this range normally encountered at the installed location.

2.4 WIRELESS CAPABILITY

For products incorporating any wireless capability (including but not limited to radio frequency (RF), infrared and optical), provide products for which wireless capability can be permanently disabled at the device. Optical and infrared capabilities may be disabled via a permanently affixed opaque cover plate.

2.5 ENCLOSURES

Enclosures supplied as an integral (pre-packaged) part of another product are acceptable. Provide two Enclosure Keys for each lockable enclosure on a single ring per enclosure with a tag identifying the enclosure the keys operate. Provide enclosures meeting the following minimum requirements:

2.5.1 Outdoors

For enclosures located outdoors, provide enclosures meeting NEMA 250 requirements.

2.5.2 Mechanical and Electrical Rooms

For enclosures located in mechanical or electrical rooms, provide enclosures meeting NEMA 250 requirements.

2.5.3 Other Locations

For enclosures in other locations including but not limited to occupied spaces, above ceilings, and in plenum returns, provide enclosures meeting NEMA 250 Type 1 requirements.

2.6 WIRE AND CABLE

Provide wire and cable meeting the requirements of NFPA 70 and NFPA 90A in addition to the requirements of this specification and referenced specifications.

2.6.1 Terminal Blocks

For terminal blocks which are not integral to other equipment, provide terminal blocks which are insulated, modular, feed-through, clamp style with recessed captive screw-type clamping mechanism, suitable for DIN rail mounting, and which have enclosed sides or end plates and partition plates for separation.

2.6.2 Control Wiring for Binary Signals

For Control Wiring for Binary Signals, provide 18 AWG copper or thicker wire rated for 300-volt service.

2.6.3 Control Wiring for Analog Signals

For Control Wiring for Analog Signals, provide 18 AWG or thicker, copper, single- or multiple-twisted wire meeting the following requirements:

a. minimum 2 inch lay of twist

b. 100 percent shielded pairs

c. at least 300-volt insulation

d. each pair has a 20 AWG tinned-copper drain wire and individual overall pair insulation

e. cables have an overall aluminum-polyester or tinned-copper cable-shield tape, overall 20 AWG tinned-copper cable drain wire, and overall cable insulation.

2.6.4 Power Wiring for Control Devices

For 24-volt circuits, provide insulated copper 18 AWG or thicker wire rated for 300 VAC service. For 120-volt circuits, provide 14 AWG or thicker stranded copper wire rated for 600-volt service.

2.6.5 Transformers

Provide UL 5085-3 approved transformers. Select transformers sized so that the connected load is no greater than 80 percent of the transformer rated capacity.

PART 3 EXECUTION

3.1 EXISTING CONDITIONS

3.1.1 Existing Conditions Survey

Perform a field survey, including testing and inspection of the equipment to be controlled and submit an Existing Conditions Report documenting the current status and its impact on the Contractor's ability to meet this specification. For those items considered nonfunctional, document the deficiency in the report including explanation of the deficiencies and estimated costs to correct the deficiencies. As part of the report, define the scheduled need date for connection to existing equipment. Make written requests and obtain Government approval prior to disconnecting any controls and obtaining equipment downtime.

Submit four copies of the Existing Conditions Report.

3.1.2 Existing Equipment Downtime

Make written requests and obtain Government approval prior to disconnecting any controls and obtaining equipment downtime.

3.1.3 Existing Control System Devices

Inspect, calibrate, and adjust as necessary to place in proper working order all existing devices which are to be reused.

3.2 INSTALLATION

Fully install and test the control system in accordance Section 23 09 13 INSTRUMENTATION AND CONTROL DEVICES FOR HVAC, Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS for BACnet or Niagara BACnet systems, and this Section.

3.2.1 Dielectric Isolation

Provide dielectric isolation where dissimilar metals are used for connection and support. Install control system in a matter that provides clearance for control system maintenance by maintaining access space required to calibrate, remove, repair, or replace control system devices. Install control system such that it does not interfere with the clearance requirements for mechanical and electrical system maintenance.

3.2.2 Penetrations in Building Exterior

Make all penetrations through and mounting holes in the building exterior watertight.

3.2.3 Device Mounting Criteria

Install devices in accordance with the manufacturer's recommendations and as indicated and shown. Provide a weathershield for all devices installed outdoors. Provide clearance for control system maintenance by maintaining access space required to calibrate, remove, repair, or replace control system devices. Provide clearance for mechanical and electrical system maintenance; do not not interfere with the clearance requirements for mechanical and electrical system maintenance.

3.2.4 Labels and Tags

Key all labels and tags to the unique identifiers shown on the As-Built drawings. For labels exterior to protective enclosures provide engraved plastic labels mechanically attached to the enclosure or DDC Hardware. Labels inside protective enclosures may be attached using adhesive, but must not be hand written. For tags, provide plastic or metal tags mechanically attached directly to each device or attached by a metal chain or wire.

a. Label all Enclosures and DDC Hardware.

b. Tag Airflow measurement arrays (AFMA) with flow rate range for signal output range, duct size, and pitot tube AFMA flow coefficient.

c. Tag duct static pressure taps at the location of the pressure tap

3.2.5 Surge Protection

3.2.5.1 Power-Line Surge Protection

Protect equipment connected to AC circuits to withstand power-line surges in accordance with IEEE C62.41. Do not use fuses for surge protection.

3.2.5.2 Surge Protection for Transmitter and Control Wiring

Protect DDC hardware against or provided DDC hardware capable of withstanding surges induced on control and transmitter wiring installed outdoors and as shown. Protect equipment against the following two waveforms:

a. A waveform with a 10-microsecond rise time, a 1000-microsecond decay time and a peak current of 60 amps.

b. A waveform with an 8-microsecond rise time, a 20-microsecond decay time and a peak current of 500 amperes.

3.2.6 Basic Cybersecurity Requirements

3.2.6.1 Passwords

For all devices with a password, change the password from the default password. Do not use the same password for more than one device. Provide a Password Summary Report documenting the password for each device and describing the procedure to change the password for each device.

Provide two hardcopies of the Password Summary Report, each copy in its own sealed envelope.

3.2.6.2 Wireless Capability

Unless otherwise indicated, disable wireless capability (including but not limited to radio frequency (RF), infrared and optical) for all devices with wireless capability. Optical and infrared capabilities may be disabled via a permanently affixed opaque cover plate. Password protecting a wireless connections does not meet this requirement; the wireless capability must be disabled.

3.2.6.3 IP Network Physical Security

Install all IP Network media in conduit. Install all IP devices including but not limited to IP-enabled DDC hardware and IP Network Hardware in lockable enclosures.

3.3 DRAWINGS AND CALCULATIONS

Provide drawings in the form and arrangement indicated and shown. Use the same abbreviations, symbols, nomenclature and identifiers shown. Assign a unique identifier as shown to each control system element on a drawing. When packaging drawings, group schedules by system. When space allows, it is permissible to include multiple schedules for the same system on a single sheet. Except for drawings covering all systems, do not put information for different systems on the same sheet.

Submit hardcopy drawings on 36 by 24 inches sheets, and electronic drawings in PDF and in AutoCAD format. In addition, submit electronic drawings in editable Excel format for all drawings that are tabular, including but not limited to the Point Schedule and Equipment Schedule.

a. Submit DDC Contractor Design Drawings consisting of each drawing indicated with pre-construction information depicting the intended control system design and plans. Submit DDC Contractor Design Drawings as a single complete package: four hard copies and four copies on CD-ROM.

b. Submit Draft As-Built Drawings consisting of each drawing indicated updated with as-built data for the system prior to PVT. Submit Draft As-Built Drawings as a single complete package: four hard copies and four copies on CD-ROM.

c. Submit Final As-Built Drawings consisting of each drawing indicated updated with all final as-built data. Final As-Built Drawings as a single complete package: four hard copies and four copies on CD-ROM.

3.3.1 Sample Drawings

Sample drawings in electronic format are available at the Whole Building Design Guide page for this section: http://www.wbdg.org/ffc/dod/unified-facilities-guide-specifications-ufgs/ufgs-23-09-00 These drawings may prove useful in demonstrating expected drawing formatting and example content and are provided for illustrative purposes only. Note that these drawings do not meet the content requirements of this Section and must be completed to meet project requirements.

3.3.2 Drawing Index and Legend

Provide an HVAC Control System Drawing Index showing the name and number of the building, military site, State or other similar designation, and Country. In the Drawing Index, list all Contractor Design Drawings, including the drawing number, sheet number, drawing title, and computer filename when used. In the Design Drawing Legend, show and describe all symbols, abbreviations and acronyms used on the Design Drawings. Provide a single Index and Legend for the entire drawing package.

3.3.3 Thermostat and Occupancy Sensor Schedule

Provide a thermostat and occupancy sensor schedule containing each

thermostat's unique identifier, room identifier and control features and functions as shown. Provide a single thermostat and occupancy sensor schedule for the entire project.

3.3.4 Valve Schedule

Provide a valve schedule containing each valve's unique identifier, size, flow coefficient Kv (Cv), pressure drop at specified flow rate, spring range, positive positioner range, actuator size, close-off pressure to torque data, dimensions, and access and clearance requirements data. In the valve schedule include actuator selection data supported by calculations of the force required to move and seal the valve, access and clearance requirements. Provide a single valve schedule for the entire project.

3.3.5 Damper Schedule

Provide a damper schedule containing each damper's unique identifier, type (opposed or parallel blade), nominal and actual sizes, orientation of axis and frame, direction of blade rotation, actuator size and spring ranges, operation rate, positive positioner range, location of actuators and damper end switches, arrangement of sections in multi-section dampers, and methods of connecting dampers, actuators, and linkages. Include the AMCA 511 maximum leakage rate at the operating static-pressure differential for each damper in the Damper Schedule. Provide a single damper schedule for the entire project.

3.3.6 Project Summary Equipment Schedule

Provide a project summary equipment schedule containing the manufacturer, model number, part number and descriptive name for each control device, hardware and component provided under this specification. Provide a single project equipment schedule for the entire project.

3.3.7 Equipment Schedule

Provide system equipment schedules containing the unique identifier, manufacturer, model number, part number and descriptive name for each control device, hardware and component provided under this specification. Provide a separate equipment schedule for each HVAC system.

3.3.8 Occupancy Schedule

Provide an occupancy schedule drawing containing the same fields as the occupancy schedule Contract Drawing with Contractor updated information. Provide a single occupancy schedule for the entire project.

3.3.9 DDC Hardware Schedule

Provide a single DDC Hardware Schedule for the entire project and including following information for each device.

3.3.9.1 DDC Hardware Identifier

The Unique DDC Hardware Identifier for the device.

3.3.9.2 HVAC System

The system "name" used to identify a specific system (the name used on the

system schematic drawing for that system).

3.3.9.3 BACnet Device Information

3.3.9.3.1 Device Object Identifier

The Device Object Identifier: The Object_Identifier of the Device Object

3.3.9.3.2 Network Number

The Network Number for the device.

3.3.9.3.3 MAC Address

The MAC Address for the device

3.3.9.3.4 BTL Listing

The BTL Listing of the device. If the device is listed under multiple BTL Profiles, indicate the profile that matches the use and configuration of the device as installed.

3.3.9.3.5 Proprietary Services Information

If the device uses non-standard ASHRAE 135 services as defined and permitted in Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS, indicate that the device uses non-standard services and include a description of all non-standard services used. Describe usage and content such that a device from another vendor can interoperate with the device using the non-standard service. Provide descriptions with sufficient detail to allow a device from a different manufacturer to be programmed to both read and write the non-standard service request:

a. read: interpret the data contained in the non-standard service and;

b. write: given similar data, generate the appropriate non-standard service request.

3.3.9.3.6 Alarming Information

Indicate whether the device is used for alarm generation, and which types of alarm generation the device implements: intrinsic, local algorithmic, remote algorithmic.

3.3.9.3.7 Scheduling Information

Indicate whether the device is used for scheduling.

3.3.9.3.8 Trending Information

Indicate whether the device is used for trending, and indicate if the device is used to trend local values, remote values, or both.

3.3.9.4 Niagara Station ID

The Niagara Station ID for each Niagara Framework Supervisory Gateway

3.3.10 Points Schedule

Provide a Points Schedule in tabular form for each HVAC system, with the indicated columns and with each row representing a hardware point, network point or configuration point in the system.

a. When a Points Schedule was included in the Contract Drawing package, use the same fields as the Contract Drawing with updated information in addition to the indicated fields.

b. When Point Schedules are included in the contract package, items requiring contractor verification or input have been shown in angle brackets ("<" and ">"), such as <___> for a required entry or <value> for a value requiring confirmation. Complete all items in brackets as well as any blank cells. Do not modify values which are not in brackets without approval.

Points Schedule Columns must include:

3.3.10.1 Point Name

The abbreviated name for the point using the indicated naming convention.

3.3.10.2 Description

A brief functional description of the point such as "Supply Air Temperature".

3.3.10.3 DDC Hardware Identifier

The Unique DDC Hardware Identifier shown on the DDC Hardware Schedule and used across all drawings for the DDC Hardware containing the point.

3.3.10.4 Settings

The value and units of any setpoints, configured setpoints, configuration parameters, and settings related to each point.

3.3.10.5 Range

The range of values, including units, associated with the point, including but not limited to a zone temperature setpoint adjustment range, a sensor measurement range, occupancy values for an occupancy input, or the status of a safety.

3.3.10.6 Input or Output (I/O) Type

The type of input or output signal associated with the point. Use the following abbreviations for entries in this column:

a. AI: The value comes from a hardware (physical) Analog Input

b. AO: The value is output as a hardware (physical) Analog Output

c. BI: The value comes from a hardware (physical) Binary Input

d. BO: The value is output as a hardware (physical) Binary Output

e. PULSE: The value comes from a hardware (physical) Pulse Accumulator

Input

f. NET-IN: The value is provided from the network (generally from another device). Use this entry only when the value is received from another device as part of scheduling or as part of a sequence of operation, not when the value is received on the network for supervisory functions such as trending, alarming, override or display at a user interface.

g. NET-OUT: The value is provided to another controller over the network. Use this entry only when the value is transmitted to another device as part of scheduling or as part of a sequence of operation, not when the value is transmitted on the network for supervisory functions such as trending, alarming, override or display at a user interface.

3.3.10.7 Object and Property Information

The Object Type and Instance Number for the Object associated with the point. If the value of the point is not in the Present_Value Property, then also provide the Property ID for the Property containing the value of the point. Any point that is displayed at the front end or on an LDP, is trended, is used by another device on the network, or has an alarm condition must be documented here.

3.3.10.8 Niagara Station ID

The Niagara Station ID of the Niagara Framework Supervisory Gateway the point is mapped into.

3.3.10.9 Network Data Exchange Information (Gets Data From, Sends Data To)

Provide the DDC Hardware Identifier of other DDC Hardware the point is shared with.

3.3.10.10 Override Information (Object Type and Instance Number)

For each point requiring an Override and not residing in a Niagara Framework Supervisory Gateway, indicate if the Object for the point is Commandable or, if the use of a separate Object was specifically approved by the Contracting Officer, provide the Object Type and Instance Number of the Object to be used in overriding the point.

3.3.10.11 Trend Object Information

For each point requiring a trend, indicate if the trend is Local or Remote, the trend Object type and the trend Object instance number. For remote trends provide the DDC Hardware Identifier for the device containing the trend Object in the Points Schedule notes.

3.3.10.12 Alarm Information

Indicate the Alarm Generation Type, Event Enrollment Object Instance Number, and Notification Class Object Instance Number for each point requiring an alarm. (Note that not all alarms will have Event Enrollment Objects.)

For Niagara BACnet systems: Indicate the Alarm Generation Type and Notification Class Object Instance Number for each point requiring an

alarm. (Note that not all alarms will have a Notification Class Object.)

3.3.10.13 Configuration Information

Indicate the means of configuration associated with each point. For points in a Niagara Framework Supervisory Gateway, indicate the point within the Niagara Framework Supervisory Gateway used to configure the value. For other points:

a. For Operator Configurable Points indicate BACnet Object and Property information (Name, Type, Identifiers) containing the configurable value. Indicate whether the property is writable always, or only when Out_Of_Service is TRUE.

b. For Configurable Points indicate the BACnet Object and Property information as for Operator Configurable points, or identification of the configurable settings from within the engineering software for the device or identification of the hardware settings on the device.

3.3.11 Riser Diagram

The Riser Diagram of the Building Control Network may be in tabular form, and must show all DDC Hardware and all Network Hardware, including network terminators. For each item, provide the unique identifier, common descriptive name, physical sequential order (previous and next device on the network), room identifier and location within room. A single riser diagram must be submitted for the entire system.

3.3.12 Control System Schematics

Provide control system schematics in the same form as the control system schematic Contract Drawing with Contractor updated information. Provide a control system schematic for each HVAC system.

3.3.13 Sequences of Operation Including Control Logic Diagrams

Provide HVAC control system sequence of operation and control logic diagrams in the same format as the Contract Drawings. Within these drawings, refer to devices by their unique identifiers. Submit sequences of operation and control logic diagrams for each HVAC system

3.3.14 Controller, Motor Starter and Relay Wiring Diagram

Provide controller wiring diagrams as functional wiring diagrams which show the interconnection of conductors and cables to each controller and to the identified terminals of input and output devices, starters and package equipment. Show necessary jumpers and ground connections and the labels of all conductors. Identify sources of power required for control systems and for packaged equipment control systems back to the panel board circuit breaker number, controller enclosures, magnetic starter, or packaged equipment control circuit. Show each power supply and transformer not integral to a controller, starter, or packaged equipment. Show the connected volt-ampere load and the power supply volt-ampere rating. Provide wiring diagrams for each HVAC system.

3.4 CONTROLLER TUNING

Tune each controller in a manner consistent with that described in the ASHRAE FUN IP and in the manufacturer's instruction manual. Tuning must

consist of adjustment of the proportional, integral, and where applicable, the derivative (PID) settings to provide stable closed-loop control. Each loop must be tuned while the system or plant is operating at a high gain (worst case) condition, where high gain can generally be defined as a low-flow or low-load condition. Upon final adjustment of the PID settings, in response to a change in controller setpoint, the controlled variable must settle out at the new setpoint with no more than two (2) oscillations above and below setpoint. Upon settling out at the new setpoint the controller output must be steady. With the exception of naturally slow processes such as zone temperature control, the controller must settle out at the new setpoint within five (5) minutes. Set the controller to its correct setpoint and record and submit the final PID configuration settings with the O&M Instructions and on the associated Points Schedule.

3.5 START-UP

3.5.1 Start-Up Test

Perform the following startup tests for each control system to ensure that the described control system components are installed and functioning per this specification.

Adjust, calibrate, measure, program, configure, set the time schedules, and otherwise perform all necessary actions to ensure that the systems function as indicated and shown in the sequence of operation and other contract documents.

3.5.1.1 Systems Check

An item-by-item check must be performed for each HVAC system

3.5.1.1.1 Step 1 - System Inspection

With the system in unoccupied mode and with fan hand-off-auto switches in the OFF position, verify that power and main air are available where required and that all output devices are in their failsafe and normal positions. Inspect each local display panel and each M&C Client to verify that all displays indicate shutdown conditions.

3.5.1.1.2 Step 2 - Calibration Accuracy Check

Perform a two-point accuracy check of the calibration of each HVAC control system sensing element and transmitter by comparing the value from the test instrument to the network value provided by the DDC Hardware. Use digital indicating test instruments, such as digital thermometers, motor-driven psychrometers, and tachometers. Use test instruments with accuracy at least twice as accurate as the specified sensor accuracy and with calibration traceable to National Institute of Standards and Technology standards. Check one the first check point in the bottom one-third of the sensor range, and the second in the top one-third of the sensor range. Verify that the sensing element-to-DDC readout accuracies at two points are within the specified product accuracy tolerances, and if not recalibrate or replace the device and repeat the calibration check.

3.5.1.1.3 Step 3 - Actuator Range Check

With the system running, apply a signal to each actuator through the DDC Hardware controller. Verify proper operation of the actuators and

positioners for all actuated devices and record the signal levels for the extreme positions of each device. Vary the signal over its full range, and verify that the actuators travel from zero stroke to full stroke within the signal range. Where applicable, verify that all sequenced actuators move from zero stroke to full stroke in the proper direction, and move the connected device in the proper direction from one extreme position to the other. For valve actuators and damper actuators, perform the actuator range check under normal system pressures.

3.5.1.2 Weather Dependent Test

Perform weather dependent test procedures in the appropriate climatic season.

3.5.2 Start-Up Testing Report

Submit 4 copies of the Start-Up Testing Report. The report may be submitted as a Technical Data Package documenting the results of the tests performed and certifying that the system is installed and functioning per this specification, and is ready for the Performance Verification Test (PVT).

3.6 PERFORMANCE VERIFICATION TEST (PVT)

3.6.1 PVT Procedures

Prepare PVT Procedures explaining step-by-step, the actions and expected results that will demonstrate that the control system performs in accordance with the sequences of operation, and other contract documents. Submit 4 copies of the PVT Procedures. The PVT Procedures may be submitted as a Technical Data Package.

3.6.1.1 Sensor Accuracy Checks

Include a one-point accuracy check of each sensor in the PVT procedures.

3.6.1.2 Endurance Test

Include a one-week endurance test as part of the PVT during which the system is operated continuously.

Use the building control system BACnet Trend Log or Trend Log Multiple Objects to trend all points shown as requiring a trend on the Point Schedule for the entire endurance test. If insufficient buffer capacity exists to trend the entire endurance test, upload trend logs during the course of the endurance test to ensure that no trend data is lost.

Use the building control system Niagara Trend Log Objects to trend all points shown as requiring a trend on the Point Schedule for the entire endurance test. If insufficient buffer capacity exists to trend the entire endurance test, upload trend logs during the course of the endurance test to ensure that no trend data is lost.

3.6.1.3 PVT Equipment List

Include in the PVT procedures a control system performance verification test equipment list that lists the equipment to be used during performance

verification testing. For each piece of equipment, include manufacturer name, model number, equipment function, the date of the latest calibration, and the results of the latest calibration

3.6.2 PVT Execution

Demonstrate compliance of the control system with the contract documents. Using test plans and procedures approved by the Government, software capable of reading and writing COV Notification Subscriptions, Notification Class Recipient List Properties, event enrollments, demonstrate all physical and functional requirements of the project. Show, step-by-step, the actions and results demonstrating that the control systems perform in accordance with the sequences of operation. Do not start the performance verification test until after receipt of written permission by the Government, based on Government approval of the PVT Plan and Draft As-Builts and completion of balancing. UNLESS GOVERNMENT WITNESSING OF A TEST IS SPECIFICALLY WAIVED BY THE GOVERNMENT, PERFORM ALL TESTS WITH A GOVERNMENT WITNESS. Do not conduct tests during scheduled seasonal off periods of base heating and cooling systems. If the system experiences any failures during the endurance test portion of the PVT, repair the system repeat the endurance test portion of the PVT until the system operates continuously and without failure for the specified endurance test period.

3.6.3 PVT Report

Prepare and submit a PVT report documenting all tests performed during the PVT and their results. Include all tests in the PVT procedures and any additional tests performed during PVT. Document test failures and repairs conducted with the test results.

Submit four copies of the PVT Report. The PVT Report may be submitted as a Technical Data Package.

3.7 OPERATION AND MAINTENANCE (O&M) INSTRUCTIONS

Provide HVAC control System Operation and Maintenance Instructions which include:

a. "Data Package 3" as indicated in Section 01 78 23 OPERATION AND MAINTENANCE DATA for each piece of control equipment.

b. "Data Package 4" as described in Section 01 78 23 OPERATION AND MAINTENANCE DATA for all air compressors.

c. HVAC control system sequences of operation formatted as indicated.

d. Procedures for the HVAC system start-up, operation and shut-down including the manufacturer's supplied procedures for each piece of equipment, and procedures for the overall HVAC system.

e. As-built HVAC control system detail drawings formatted as indicated.

f. Routine maintenance checklist. Provide the routine maintenance checklist arranged in a columnar format, where the first column lists all installed devices, the second column states the maintenance activity or that no maintenance required, the third column states the frequency of the maintenance activity, and the fourth column is used

for additional comments or reference.

g. Qualified service organization list, including at a minimum company name, contact name and phone number.

h. Start-Up Testing Report.

i. Performance Verification Test (PVT) Procedures and Report.

Submit 2 copies of the Operation and Maintenance Instructions, indexed and in booklet form. The Operation and Maintenance Instructions may be submitted as a Technical Data Package.

3.8 MAINTENANCE AND SERVICE

Provide services, materials and equipment as necessary to maintain the entire system in an operational state as indicated for a period of one year from the date of final acceptance of the project. Minimize impacts on facility operations.

a. The integration of the system specified in this section into a Utility Monitoring and Control System must not, of itself, void the warranty or otherwise alter the requirement for the one year maintenance and service period. Integration into a UMCS includes but is not limited to establishing communication between devices in the control system and the front end or devices in another system.

b. The changing of configuration properties must not, of itself, void the warranty or otherwise alter the requirement for the one year maintenance and service period.

3.8.1 Description of Work

Provide adjustment and repair of the system including the manufacturer's required sensor and actuator (including transducer) calibration, span and range adjustment.

3.8.2 Personnel

Use only service personnel qualified to accomplish work promptly and satisfactorily. Advise the Government in writing of the name of the designated service representative, and of any changes in personnel.

3.8.3 Scheduled Inspections

Perform two inspections at six-month intervals and provide work required. Perform inspections in June and December. During each inspection perform the indicated tasks:

a. Perform visual checks and operational tests of equipment.

b. Clean control system equipment including interior and exterior surfaces.

c. Check and calibrate each field device. Check and calibrate 50 percent of the total analog inputs and outputs during the first inspection. Check and calibrate the remaining 50 percent of the analog inputs and outputs during the second major inspection. Certify analog test instrumentation accuracy to be twice the specified accuracy of the

device being calibrated. Randomly check at least 25 percent of all binary inputs and outputs for proper operation during the first inspection. Randomly check at least 25 percent of the remaining binary inputs and outputs during the second inspection. If more than 20 percent of checked inputs or outputs failed the calibration check during any inspection, check and recalibrate all inputs and outputs during that inspection.

d. Run system software diagnostics and correct diagnosed problems.

e. Resolve any previous outstanding problems.

3.8.4 Scheduled Work

This work must be performed during regular working hours, Monday through Friday, excluding Federal holidays.

3.8.5 Emergency Service

The Government will initiate service calls when the system is not functioning properly. Qualified personnel must be available to provide service to the system. A telephone number where the service supervisor can be reached at all times must be provided. Service personnel must be at the site within 24 hours after receiving a request for service. The control system must be restored to proper operating condition as required per Section 01 78 00 CLOSEOUT SUBMITTALS.

3.8.6 Operation

After performing scheduled adjustments and repairs, verify control system operation as demonstrated by the applicable tests of the performance verification test.

3.8.7 Records and Logs

Keep dated records and logs of each task, with cumulative records for each major component, and for the complete system chronologically. Maintain a continuous log for all devices, including initial analog span and zero calibration values and digital points. Keep complete logs and provide logs for inspection onsite, demonstrating that planned and systematic adjustments and repairs have been accomplished for the control system.

3.8.8 Work Requests

Record each service call request as received and include its location, date and time the call was received, nature of trouble, names of the service personnel assigned to the task, instructions describing what has to be done, the amount and nature of the materials to be used, the time and date work started, and the time and date of completion. Submit a record of the work performed within 5 days after work is accomplished.

3.8.9 System Modifications

Submit recommendations for system modification in writing. Do not make system modifications, including operating parameters and control settings, without prior approval of the Government.

3.9 TRAINING

Conduct a training course for 2 operating staff members designated by the Government in the maintenance and operation of the system, including specified hardware and software. Conduct 32 hours of training at the project site within 30 days after successful completion of the performance verification test. The Government reserves the right to make audio and visual recordings (using Government supplied equipment)of the training sessions for later use. Provide audiovisual equipment and other training materials and supplies required to conduct training. A training day is defined as 8 hours of classroom instruction, including two 15 minute breaks and excluding lunchtime, Monday through Friday, during the daytime shift in effect at the training facility.

3.9.1 Training Documentation

Prepare training documentation consisting of:

a. Course Attendee List: Develop the list of course attendees in coordination with and signed by the Controls shop supervisor.

b. Training Manuals: Provide training manuals which include an agenda, defined objectives for each lesson, and a detailed description of the subject matter for each lesson. When presenting portions of the course material by audiovisuals, deliver copies of those audiovisuals as a part of the printed training manuals.

3.9.2 Training Course Content

For guidance in planning the required instruction, assume that attendees will have a high school education, and are familiar with HVAC systems. During the training course, cover all of the material contained in the Operating and Maintenance Instructions, the layout and location of each controller enclosure, the layout of one of each type of equipment and the locations of each, the location of each control device external to the panels, the location of the compressed air station, preventive maintenance, troubleshooting, diagnostics, calibration, adjustment, commissioning, tuning, and repair procedures. Typical systems and similar systems may be treated as a group, with instruction on the physical layout of one such system. Present the results of the performance verification test and the Start-Up Testing Report as benchmarks of HVAC control system performance by which to measure operation and maintenance effectiveness.

3.9.3 Training Documentation Submittal Requirements

Submit hardcopy training manuals and all training materials on CD-ROM. Provide one hardcopy manual for each trainee on the Course Attendee List and 2 additional copies for archive at the project site. Provide 2 copies of the Course Attendee List with the archival copies. Training Documentation may be submitted as a Technical Data Package.

APPENDIX A

QC CHECKLIST FOR BACNET SYSTEMS		
This checklist is not all-inclusive of the requirements of this specification and should not be interpreted as such. Instructions: Initial each item in the space provided (|____|) verifying that the requirement has been met.		
This checklist is for (circle one:) Pre-Construction QC Checklist Submittal Post-Construction QC Checklist Submittal Close-out QC Checklist Submittal		
Items verified for Pre-Construction, Post-Construction and Closeout QC Checklist Submittals:		
1	All DDC Hardware is numbered on Control System Schematic Drawings.	|____|
2	Signal lines on Control System Schematic are labeled with the signal type.	|____|
3	Local Display Panel (LDP) Locations are shown on Control System Schematic drawings.	|____|
Items verified for Post-Construction and Closeout QC Checklist Submittals:		
4	All sequences are performed as specified using DDC Hardware.	|____|
5	Training schedule and course attendee list has been developed and coordinated with shops and submitted.	|____|
Items verified for Closeout QC Checklist Submittal:		
6	Final As-built Drawings, including all Points Schedule drawings, accurately represent the final installed system.	|____|
7	Programming software has been submitted for all programmable controllers.	|____|
8	All software has been licensed to the Government.	
9	O&M Instructions have been completed and submitted.	|____|
10	Training course has been completed.	|____|

	QC CHECKLIST FOR BACNET SYSTEMS	
11	All DDC Hardware is installed on a BACnet ASHRAE 135 network using either MS/TP in accordance with Clause 9 or IP in accordance with Annex J.	|____|
12	All DDC Hardware is BTL listed.	|____|
13	Communication between DDC Hardware is only via BACnet using standard services, except as specifically permitted by the specification. Non-standard services have been fully documented in the DDC Hardware Schedule.	|____|
14	Scheduling, Alarming, and Trending have been implemented using the standard BACnet Objects for these functions.	|____|
15	All Properties indicated as required to be Writable are Writable and Overrides have been provided as indicated	|____|
	_____ _____	
	(QC Representative Signature) (Date)	

QC CHECKLIST FOR NIAGARA FRAMEWORK BASED BACNET SYSTEMS		
This checklist is not all-inclusive of the requirements of this specification and should not be interpreted as such. Instructions: Initial each item in the space provided (|____|) verifying that the requirement has been met.		
This checklist is for (circle one:) Pre-Construction QC Checklist Submittal Post-Construction QC Checklist Submittal Close-out QC Checklist Submittal		
Items verified for Pre-Construction, Post-Construction and Closeout QC Checklist Submittals:		
1	All DDC Hardware is numbered on Control System Schematic Drawings.	|____|
2	Signal lines on Control System Schematic are labeled with the signal type.	|____|
3	Local Display Panel (LDP) Locations are shown on Control System Schematic drawings.	|____|

QC CHECKLIST FOR NIAGARA FRAMEWORK BASED BACNET SYSTEMS

Items verified for Post-Construction and Closeout QC Checklist Submittals:

4	All sequences are performed as specified using DDC Hardware.		|____|
5	Training schedule and course attendee list has been developed and coordinated with shops and submitted.		|____|

Items verified for Closeout QC Checklist Submittal:

6	Final As-built Drawings, including all Points Schedule drawings, accurately represent the final installed system.		|____|
7	Programming software has been submitted for all programmable controllers.		|____|
8	All software has been licensed to the Government.		
9	O&M Instructions have been completed and submitted.		|____|
10	Training course has been completed.		|____|
11	All DDC Hardware is installed on a BACnet ASHRAE 135 network using either MS/TP in accordance with Clause 9 or IP in accordance with Annex J.		|____|
12	All DDC Hardware is BTL listed.		|____|
13	Communication between DDC Hardware is only via BACnet using standard services, except as specifically permitted by the specification. Non-standard services have been fully documented in the DDC Hardware Schedule.		|____|
14	Scheduling, Alarming, and Trending have been implemented using Niagara Framework objects and services, and BACnet Instrinsic Alarming as indicated.		|____|
15	All Properties indicated as required to be Writable are Writable and Overrides have been provided as indicated		|____|

_____ _____

(QC Representative Signature) (Date)

-- End of Section --

SECTION 23 09 13

INSTRUMENTATION AND CONTROL DEVICES FOR HVAC
11/15, CHG 2: 05/21

PART 1 GENERAL

1.1 SUMMARY

This section provides for the instrumentation control system components excluding direct digital controllers, network controllers, gateways etc. that are necessary for a completely functional automatic control system. When combined with a Direct Digital Control (DDC) system, the Instrumentation and Control Devices covered under this section must be a complete system suitable for the control of the heating, ventilating and air conditioning (HVAC) and other building-level systems as specified and indicated.

a. Install hardware to perform the control sequences as specified and indicated and to provide control of the equipment as specified and indicated.

b. Install hardware such that individual control equipment can be replaced by similar control equipment from other equipment manufacturers with no loss of system functionality.

c. Install and configure hardware such that the Government or their agents are able to perform repair, replacement, and upgrades of individual hardware without further interaction with the installing Contractor.

1.1.1 Verification of Dimensions

After becoming familiar with all details of the work, verify all dimensions in the field, and advise the Contracting Officer of any discrepancy before performing any work.

1.1.2 Drawings

The Government will not indicate all offsets, fittings, and accessories that may be required on the drawings. Carefully investigate the mechanical, electrical, and finish conditions that could affect the work to be performed, arrange such work accordingly, and provide all work necessary to meet such conditions.

1.2 RELATED SECTIONS

Related work specified elsewhere.

Section 23 30 00 HVAC AIR DISTRIBUTION

Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC

Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM

1.3 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR MOVEMENT AND CONTROL ASSOCIATION INTERNATIONAL, INC. (AMCA)

AMCA 500-D	(2018) Laboratory Methods of Testing Dampers for Rating
AMCA 511	(2010; R 2016) Certified Ratings Program for Air Control Devices

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI C12.1	(2014; Errata 2016) Electric Meters - Code for Electricity Metering

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B16.15	(2018) Cast Copper Alloy Threaded Fittings Classes 125 and 250
ASME B16.18	(2018) Cast Copper Alloy Solder Joint Pressure Fittings
ASME B16.22	(2018) Standard for Wrought Copper and Copper Alloy Solder Joint Pressure Fittings
ASME B16.26	(2018) Standard for Cast Copper Alloy Fittings for Flared Copper Tubes
ASME B16.34	(2021) Valves - Flanged, Threaded and Welding End
ASME B40.100	(2013) Pressure Gauges and Gauge Attachments

ASTM INTERNATIONAL (ASTM)

ASTM A269/A269M	(2015; R 2019) Standard Specification for Seamless and Welded Austenitic Stainless Steel Tubing for General Service
ASTM A536	(1984; R 2019; E 2019) Standard Specification for Ductile Iron Castings
ASTM B32	(2020) Standard Specification for Solder Metal
ASTM B75/B75M	(2020) Standard Specification for Seamless Copper Tube
ASTM B88	(2020) Standard Specification for Seamless Copper Water Tube
ASTM D635	(2018) Standard Test Method for Rate of Burning and/or Extent and Time of Burning

	of Plastics in a Horizontal Position
ASTM D638	(2014) Standard Test Method for Tensile Properties of Plastics
ASTM D792	(2013) Density and Specific Gravity (Relative Density) of Plastics by Displacement
ASTM D1238	(2013) Melt Flow Rates of Thermoplastics by Extrusion Plastometer
ASTM D1693	(2015) Standard Test Method for Environmental Stress-Cracking of Ethylene Plastics

FLUID CONTROLS INSTITUTE (FCI)

FCI 70-2	(2021) Control Valve Seat Leakage

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 142	(2007; Errata 2014) Recommended Practice for Grounding of Industrial and Commercial Power Systems - IEEE Green Book

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI C12.20	(2015; E 2018) Electricity Meters - 0.1, 0.2, and 0.5 Accuracy Classes
NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)
NEMA/ANSI C12.10	(2011; R 2021) Physical Aspects of Watthour Meters - Safety Standard

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code
NFPA 90A	(2021) Standard for the Installation of Air Conditioning and Ventilating Systems

UNDERWRITERS LABORATORIES (UL)

UL 94	(2013; Reprint May 2021) UL Standard for Safety Tests for Flammability of Plastic Materials for Parts in Devices and Appliances
UL 555	(2006; Reprint Aug 2016) UL Standard for Safety Fire Dampers
UL 555S	(2014; Reprint Oct 2020) UL Standard for Safety Smoke Dampers

UL 1820	(2004; Reprint May 2013) UL Standard for Safety Fire Test of Pneumatic Tubing for Flame and Smoke Characteristics
UL 5085-3	(2006; Reprint Nov 20121) Low Voltage Transformers - Part 3: Class 2 and Class 3 Transformers

1.4 SUBMITTALS

Submittal requirements are specified in Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

1.5 DELIVERY AND STORAGE

Store and protect products from the weather, humidity, and temperature variations, dirt and dust, and other contaminants, within the storage condition limits published by the equipment manufacturer.

1.6 INPUT MEASUREMENT ACCURACY

Select, install and configure sensors, transmitters and DDC Hardware such that the maximum error of the measured value at the input of the DDC hardware is less than the maximum allowable error specified for the sensor or instrumentation.

PART 2 PRODUCTS

2.1 EQUIPMENT

2.1.1 General Requirements

All products used to meet this specification must meet the indicated requirements, but not all products specified here will be required by every project. All products must meet the requirements both Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC and this Section.

2.1.2 Operation Environment Requirements

Unless otherwise specified, provide products rated for continuous operation under the following conditions:

2.1.2.1 Pressure

Pressure conditions normally encountered in the installed location.

2.1.2.2 Vibration

Vibration conditions normally encountered in the installed location.

2.1.2.3 Temperature

a. Products installed indoors: Ambient temperatures in the range of 32 to 112 degrees F and temperature conditions outside this range normally encountered at the installed location.

b. Products installed outdoors or in unconditioned indoor spaces: Ambient temperatures in the range of -35 to +151 degrees F and temperature

conditions outside this range normally encountered at the installed location.

2.1.2.4 Humidity

10 to 95 percent relative humidity, non-condensing and also humidity conditions outside this range normally encountered at the installed location.

2.2 WEATHERSHIELDS

Provide weathershields constructed of galvanized steel painted white, unpainted aluminum, aluminum painted white, or white PVC.

2.3 TUBING

2.3.1 Copper

Provide ASTM B75/B75M or ASTM B88 rated tubing meeting the following requirements:

a. For tubing 0.375 inch outside diameter and larger provide tubing with minimum wall thickness equal to ASTM B88, Type M

b. For tubing less than 0.375 inch outside diameter provide tubing with minimum wall thickness of 0.025 inch

c. For exposed tubing and tubing for working pressures greater than 30 psig provide hard copper tubing.

d. Provide fittings which are ASME B16.18 or ASME B16.22 solder type using ASTM B32 95-5 tin-antimony solder, or which are ASME B16.26 compression type.

2.3.2 Stainless Steel

For stainless steel tubing provide tubing conforming to ASTM A269/A269M

2.3.3 Plastic

Provide plastic tubing with the burning characteristics of linear low-density polyethylene tubing which is self-extinguishing when tested in accordance with ASTM D635, has UL 94 V-2 flammability classification or better, and which withstands stress cracking when tested in accordance with ASTM D1693. Provide plastic-tubing bundles with Mylar barrier and flame-retardant polyethylene jacket.

2.3.4 Polyethylene Tubing

Provide flame-resistant, multiple polyethylene tubing in flame-resistant protective sheath with mylar barrier, or unsheathed polyethylene tubing in rigid metal, intermediate metal, or electrical metallic tubing conduit for areas where tubing is exposed. Single, unsheathed, flame-resistant polyethylene tubing may be used where concealed in walls or above ceilings and within control panels. Do not provide polyethylene tubing for smoke removal systems, or for systems with working pressures over 30 psig. Provide compression or brass barbed push-on type fittings. Provide extruded seamless polyethylene tubing conforming to the following:

a. Minimum Burst Pressure Requirements: 100 psig at 75 degrees F to 25 psig at 150 degrees F.

b. Stress Crack Resistance: ASTM D1693, 200 hours minimum.

c. Tensile Strength (Minimum): ASTM D638, 1100 psi.

d. Flow Rate (Average): ASTM D1238, 0.30 decigram per minute.

e. Density (Average): ASTM D792, 57.5 pounds per cubic feet.

f. Burn rate: ASTM D635

g. Flame Propagation: UL 1820, less than 5 feet ASTM D635

h. Average Optical Density: UL 1820, less than 0.15 ASTM D635

2.4 WIRE AND CABLE

Provide wire and cable meeting the requirements of NFPA 70 and NFPA 90A in addition to the requirements of this specification and referenced specifications.

2.4.1 Terminal Blocks

For terminal blocks which are not integral to other equipment, provide terminal blocks which are insulated, modular, feed-through, clamp style with recessed captive screw-type clamping mechanism, suitable for DIN rail mounting, and which have enclosed sides or end plates and partition plates for separation.

2.4.2 Control Wiring for Binary Signals

For Control Wiring for Binary Signals, provide 18 AWG copper or thicker wire rated for 300-volt service.

2.4.3 Control Wiring for Analog Signals

For Control Wiring for Analog Signals, provide 18 AWG or thicker, copper, single- or multiple-twisted wire meeting the following requirements:

a. minimum 2 inch lay of twist

b. 100 percent shielded pairs

c. at least 300-volt insulation

d. each pair has a 20 AWG tinned-copper drain wire and individual overall pair insulation

e. cables have an overall aluminum-polyester or tinned-copper cable-shield tape, overall 20 AWG tinned-copper cable drain wire, and overall cable insulation.

2.4.4 Power Wiring for Control Devices

For 24-volt circuits, provide insulated copper 18 AWG or thicker wire rated for 300 VAC service. For 120-volt circuits, provide 14 AWG or thicker stranded copper wire rated for 600-volt service.

2.4.5 Transformers

Provide UL 5085-3 approved transformers. Select transformers sized so that the connected load is no greater than 80 percent of the transformer rated capacity.

2.5 AUTOMATIC CONTROL VALVES

Provide valves with stainless-steel stems and stuffing boxes with extended necks to clear the piping insulation. Provide valves with bodies meeting ASME B16.34 or ASME B16.15 pressure and temperature class ratings based on the design operating temperature and 150 percent of the system design operating pressure. Unless otherwise specified or indicated, provide valves meeting FCI 70-2 Class III leakage rating. Provide valves rated for modulating or two-position service as indicated, which close against a differential pressure indicated as the Close-Off pressure and which are Normally-Open, Normally-Closed, or Fail-In-Last-Position as indicated.

2.5.1 Valve Type

2.5.1.1 Liquid Service 150 Degrees F or Less

Use either globe valves or ball valves except that butterfly valves may be used for sizes 4 inch and larger.

2.5.1.2 Liquid Service Above 150 Degrees F

a. Two-position valves: Use either globe valves or ball valves except that butterfly valves may be used for sizes 4 inch and larger.

b. Modulating valves: Use globe valves except that butterfly valves may be used for sizes 4 inch and larger.

2.5.1.3 Steam Service

Use globe valves except that butterfly valves may be used for sizes 4 inch and larger.

2.5.2 Valve Flow Coefficient and Flow Characteristic

2.5.2.1 Two-Way Modulating Valves

Provide the valve coefficient (Cv) indicated. Provide equal-percentage flow characteristic for liquid service except for butterfly valves. Provide linear flow characteristic for steam service except for butterfly valves.

2.5.2.2 Three-Way Modulating Valves

Provide the valve coefficient (Cv) indicated. Provide linear flow characteristic with constant total flow throughout full plug travel.

2.5.3 Two-Position Valves

Use full line size full port valves with maximum available (Cv).

2.5.4 Globe Valves

2.5.4.1 Liquid Service Not Exceeding 150 Degrees F

a. Valve body and body connections:

(1) valves 1-1/2 inches and smaller: brass or bronze body, with threaded or union ends

(2) valves from 2 inches to 3 inches inclusive: brass, bronze, or iron bodies. 2 inch valves with threaded connections; 2-1/2 to 3 inches valves with flanged connections

b. Internal valve trim: Brass or bronze.

c. Stems: Stainless steel.

d. Provide valves compatible with a solution of 50 percent ethylene or propylene glycol.

2.5.4.2 Liquid Service Not Exceeding 250 Degrees F

a. Valve body and body connections:

(1) valves 1-1/2 inches and smaller: brass or bronze body, with threaded or union ends

(2) valves from 2 inches to 3 inches inclusive: brass, bronze, or iron bodies. 2 inch valves with threaded connections; 2-1/2 to 3 inches valves with flanged connections

b. Internal trim: Type 316 stainless steel including seats, seat rings, modulation plugs, valve stems, and springs.

c. Provide valves with non-metallic parts suitable for a minimum continuous operating temperature of 250 degrees F or 50 degrees F above the system design temperature, whichever is higher.

d. Provide valves compatible with a solution of 50 percent ethylene or propylene glycol

2.5.5 Ball Valves

2.5.5.1 Liquid Service Not Exceeding 150 Degrees F

a. Valve body and connections:

(1) valves 1-1/2 inches and smaller: bodies of brass or bronze, with threaded or union ends

(2) valves from 2 inches to 3 inches inclusive: bodies of brass, bronze, or iron. 2 inch valves with threaded connections; valves from 2-1/2 to 3 inches with flanged connections.

b. Ball: Stainless steel or nickel-plated brass or chrome-plated brass.

c. Seals: Reinforced Teflon seals and EPDM O-rings.

d. Stem: Stainless steel, blow-out proof.

e. Provide valves compatible with a solution of 50 percent ethylene or propylene glycol.

2.5.6 Butterfly Valves

Provide butterfly valves which are threaded lug type suitable for dead-end service and modulation to the fully-closed position, with carbon-steel bodies or with ductile iron bodies in accordance with ASTM A536. Provide butterfly valves with non-corrosive discs, stainless steel shafts supported by bearings, and EPDM seats suitable for temperatures from -20 to +250 degrees F. Provide valves with rated Cv of the Cv at 70 percent (60 degrees) open position. Provide valves meeting FCI 70-2 Class VI leakage rating.

2.5.7 Pressure Independent Control Valves (PICV)

Provide pressure independent control valves which include a regulator valve which maintains the differential pressure across a flow control valve. Pressure independent control valves must accurately control the flow from 0-100 percent full rated flow regardless of changes in the piping pressure and not vary the flow more than plus or minus 5 percent at any given flow control valve position when the PICV differential pressure lies between the manufacturer's stated minimum and maximum. The rated minimum differential pressure for steady flow must not exceed 5 psid across the PICV. Provide either globe or ball type valves meeting the indicated requirements for globe and ball valves. Provide valves with a flow tag listing full rated flow and minimum required pressure drop. Provide valves with factory installed Pressure/Temperature ports ("Pete's Plugs") to measure the pressure drop to determine the valve flow rate.

2.5.8 Duct-Coil and Terminal-Unit-Coil Valves

For duct or terminal-unit coils provide control valves with either screw type or solder-type ends. Provide flare nuts for each flare-type end valve.

2.6 DAMPERS

2.6.1 Damper Assembly

Provide single damper sections with blades no longer than 48 inches and which are no higher than 72 inches and damper blade width of 8 inches or less. When larger sizes are required, combine damper sections. Provide dampers made of steel, or other materials where indicated and with assembly frames constructed of 0.07 inch minimum thickness galvanized steel channels with mitered and welded corners. Steel channel frames constructed of 0.06 inch minimum thickness are acceptable provided the corners are reinforced.

a. Flat blades must be made rigid by folding the edges. Blade-operating linkages must be within the frame so that blade-connecting devices within the same damper section must not be located directly in the air stream.

b. Damper axles must be 1/2 inch minimum, plated steel rods supported in the damper frame by stainless steel or bronze bearings. Blades mounted vertically must be supported by thrust bearings.

c. Provide dampers which do not exceed a pressure drop through the damper of 0.04 inches water gauge at 1000 ft/min in the wide-open position. Provide dampers with frames not less than 2 inch in width. Provide dampers which have been tested in accordance with AMCA 500-D.

2.6.2 Operating Linkages

For operating links external to dampers, such as crank arms, connecting rods, and line shafting for transmitting motion from damper actuators to dampers, provide links able to withstand a load equal to at least 300 percent of the maximum required damper-operating force without deforming. Rod lengths must be adjustable. Links must be brass, bronze, zinc-coated steel, or stainless steel. Working parts of joints and clevises must be brass, bronze, or stainless steel. Adjustments of crank arms must control the open and closed positions of dampers.

2.6.3 Damper Types

2.6.3.1 Flow Control Dampers

Provide parallel-blade or opposed blade type dampers for outside air, return air, relief air, exhaust, face and bypass dampers as indicated on the Damper Schedule. Blades must have interlocking edges. The channel frames of the dampers must be provided with jamb seals to minimize air leakage. Unless otherwise indicated, dampers must meet AMCA 511 Class 1A requirements. Outside air damper seals must be suitable for an operating temperature range of -40 to +167 degrees F. Dampers must be rated at not less than 2000 ft/min air velocity.

2.6.3.2 Mechanical Rooms and Other Utility Space Ventilation Dampers

Provide utility space ventilation dampers as indicated. Unless otherwise indicated provide AMCA 511 class 3 dampers. Provide dampers rated at not less than 1500 ft/min air velocity.

2.6.3.3 Smoke Dampers

Provide smoke-damper and actuator assemblies which meet the current requirements of NFPA 90A, UL 555, and UL 555S. For combination fire and smoke dampers provide dampers rated for 250 degrees F Class II leakage per UL 555S.

2.7 SENSORS AND INSTRUMENTATION

Unless otherwise specified, provide sensors and instrumentation which incorporate an integral transmitter. Sensors and instrumentation, including their transmitters, must meet the specified accuracy and drift requirements at the input of the connected DDC Hardware's analog-to-digital conversion.

2.7.1 Analog and Binary Transmitters

Provide transmitters which match the characteristics of the sensor. Transmitters providing analog values must produce a linear 4-20 mAdc, 0-10 Vdc signal corresponding to the required operating range and must have zero and span adjustment. Transmitters providing binary values must have dry contacts rated at 1A at 24 Volts AC.

2.7.2 Temperature Sensors

Provide the same sensor type throughout the project. Temperature sensors may be provided without transmitters. Where transmitters are used, the range must be the smallest available from the manufacturer and suitable for the application such that the range encompasses the expected range of temperatures to be measured. The end to end accuracy includes the combined effect of sensitivity, hysteresis, linearity and repeatability between the measured variable and the end user interface (graphic presentation) including transmitters if used.

2.7.2.1 Sensor Accuracy and Stability of Control

2.7.2.1.1 Conditioned Space Temperature

Plus or minus 0.5 degree F over the operating range.

2.7.2.1.2 Unconditioned Space Temperature

a. Plus or minus 1 degree F over the range of 30 to 131 degrees F AND

b. Plus or minus 4 degrees F over the rest of the operating range.

2.7.2.1.3 Duct Temperature

Plus or minus 0.5 degree F

2.7.2.1.4 Outside Air Temperature

a. Plus or minus 2 degrees F over the range of -30 to +130 degrees F AND

b. Plus or minus 1 degree F over the range of 30 to 130 degrees F.

2.7.2.1.5 High Temperature Hot Water

Plus or minus 3.6 degrees F.

2.7.2.1.6 Chilled Water

Plus or minus 0.8 degrees F over the range of 35 to 65 degrees F.

2.7.2.1.7 Dual Temperature Water

Plus or minus 2 degrees F.

2.7.2.1.8 Heating Hot Water

Plus or minus 2 degrees F.

2.7.2.1.9 Condenser Water

Plus or minus 2 degrees F.

2.7.2.2 Transmitter Drift

The maximum allowable transmitter drift: 0.25 degrees F per year.

2.7.2.3 Point Temperature Sensors

Point Sensors must be encapsulated in epoxy, series 300 stainless steel, anodized aluminum, or copper.

2.7.2.4 Temperature Sensor Details

2.7.2.4.1 Room Type

Provide the sensing element components within a decorative protective cover suitable for surrounding decor.

2.7.2.4.2 Duct Probe Type

Ensure the probe is long enough to properly sense the air stream temperature.

2.7.2.4.3 Duct Averaging Type

Continuous averaging sensors must be one foot in length for each 1 square foot of duct cross-sectional area, and a minimum length of 5 feet.

2.7.2.4.4 Pipe Immersion Type

For pipes with larger than 3 inch diameter, provide minimum 3 inch immersion. For pipes with less than 3 inch diameter, provide immersion at least half the diameter of the pipe. Provide each sensor with a corresponding pipe-mounted sensor well, unless indicated otherwise. Sensor wells must be stainless steel when used in steel piping, and brass when used in copper piping.

2.7.2.4.5 Outside Air Type

Provide the sensing element rated for outdoor use

2.7.3 Relative Humidity Sensor

Relative humidity sensors must use bulk polymer resistive or thin film capacitive type non-saturating sensing elements capable of withstanding a saturated condition without permanently affecting calibration or sustaining damage. The sensors must include removable protective membrane filters. Where required for exterior installation, sensors must be capable of surviving below freezing temperatures and direct contact with moisture without affecting sensor calibration. When used indoors, the sensor must be capable of being exposed to a condensing air stream (100 percent relative humidity) with no adverse effect to the sensor's calibration or other harm to the instrument. The sensor must be of the wall-mounted or duct-mounted type, as required by the application, and must be provided with any required accessories. Sensors used in duct high-limit applications must have a bulk polymer resistive sensing element. Duct-mounted sensors must be provided with a duct probe designed to protect the sensing element from dust accumulation and mechanical damage. Relative humidity (RH) sensors must measure relative humidity over a range of 0 percent to 100 percent with an accuracy of plus or minus 2 percent. RH sensors must function over a temperature range of 40 to 135 degrees F and must not drift more than 1 percent per year.

2.7.4 Carbon Dioxide (CO2) Sensors

Provide photometric type CO2 sensors with integral transducers and linear output. Carbon dioxide (CO2) sensors must measure CO2 concentrations between 0 to 2000 parts per million (ppm) using non-dispersible infrared (NDIR) technology with an accuracy of plus or minus 50 ppm and a maximum response time of 1 minute. The sensor must be rated for operation at ambient air temperatures within the range of 32 to 122 degrees F and relative humidity within the range of 20 to 95 percent (non-condensing). The sensor must have a maximum drift of 2 percent per year. The sensor chamber must be manufactured with a non-corrosive material that does not affect carbon dioxide sample concentration. Duct mounted sensors must be provided with a duct probe designed to protect the sensing element from dust accumulation and mechanical damage. The sensor must have a calibration interval no less than 5 years.

2.7.5 Differential Pressure Instrumentation

2.7.5.1 Differential Pressure Sensors

Provide Differential Pressure Sensors with ranges as indicated or as required for the application. Pressure sensor ranges must not exceed the high end range indicated on the Points Schedule by more than 50 percent. The over pressure rating must be a minimum of 150 percent of the highest design pressure of either input to the sensor. The accuracy must be plus or minus 1 percent of full scale. The sensor must have a maximum drift of 2 percent per year

2.7.5.2 Differential Pressure Switch

Provide differential pressure switches with a user-adjustable setpoint which are sized for the application such that the setpoint is between 25 percent and 75 percent of the full range. The over pressure rating must be a minimum of 150 percent of the highest design pressure of either input to the sensor. The switch must have two sets of contacts and each contact must have a rating greater than it's connected load. Contacts must open or close upon rise of pressure above the setpoint or drop of pressure below the setpoint as indicated.

2.7.6 Flow Sensors

2.7.6.1 Airflow Measurement Array (AFMA)

2.7.6.1.1 Airflow Straightener

Provide AFMAs which contain an airflow straightener if required by the AFMA manufacturer's published installation instructions. The straightener must be contained inside a flanged sheet metal casing, with the AFMA located as specified according to the published recommendation of the AFMA manufacturer. In the absence of published documentation, provide airflow straighteners if there is any duct obstruction within 5 duct diameters upstream of the AFMA. Air-flow straighteners, where required, must be constructed of 0.125 inch aluminum honeycomb and the depth of the straightener must not be less than 1.5 inches.

2.7.6.1.2 Resistance to Airflow

The resistance to air flow through the AFMA, including the airflow straightener must not exceed 0.085 inch water gauge at an airflow of 2,000

fpm. AFMA construction must be suitable for operation at airflows of up to 5000 fpm over a temperature range of 40 to 120 degrees F.

2.7.6.1.3 Outside Air Temperature

In outside air measurement or in low-temperature air delivery applications, provide an AFMA certified by the manufacturer to be accurate as specified over a temperature range of -20 to +120 degrees F .

2.7.6.1.4 Pitot Tube AFMA

Each Pitot Tube AFMA must contain an array of velocity sensing elements. The velocity sensing elements must be of the multiple pitot tube type with averaging manifolds. The sensing elements must be distributed across the duct cross section in the quantity and pattern specified or recommended by the published installation instructions of the AFMA manufacturer.

a. Pitot Tube AFMAs for use in airflows over 600 fpm must have an accuracy of plus or minus 5 percent over a range of 500 to 2500 fpm.

b. Pitot Tube AFMAs for use in airflows under 600 fpm must have an accuracy of plus or minus 5 percent over a range of 125 to 2500 fpm.

2.7.6.1.5 Electronic AFMA

Each electronic AFMA must consist of an array of velocity sensing elements of the resistance temperature detector (RTD) or thermistor type. The sensing elements must be distributed across the duct cross section in the quantity and pattern specified or recommended by the published application data of the AFMA manufacturer. Electronic AFMAs must have an accuracy of plus or minus 5 percent over a range of 125 to 5,000 fpm and the output must be temperature compensated over a range of 32 to 212 degrees F.

2.7.6.1.6 Fan Inlet Measurement Devices

Fan inlet measurement devices cannot be used unless indicated on the drawings or schedules.

2.7.6.2 Orifice Plate

Orifice plate must be made of an austenitic stainless steel sheet of 0.125 inch nominal thickness with an accuracy of plus or minus 1 percent of full flow. The orifice plate must be flat within 0.002 inches. The orifice surface roughness must not exceed 20 micro-inches. The thickness of the cylindrical face of the orifice must not exceed 2 percent of the pipe inside diameter or 12.5 percent of the orifice diameter, whichever is smaller. The upstream edge of the orifice must be square and sharp. Where orifice plates are used, concentric orifice plates must be used in all applications except steam flow measurement in horizontal pipelines.

2.7.6.3 Flow Nozzle

Flow nozzle must be made of austenitic stainless steel with an accuracy of plus or minus 1 percent of full flow. The inlet nozzle form must be elliptical and the nozzle throat must be the quadrant of an ellipse. The thickness of the nozzle wall and flange must be such that distortion of the nozzle throat from strains caused by the pipeline temperature and pressure, flange bolting, or other methods of installing the nozzle in the pipeline must not cause the accuracy to degrade beyond the specified

limit. The outside diameter of the nozzle flange or the design of the flange facing must be such that the nozzle throat must be centered accurately in the pipe.

2.7.6.4 Venturi Tube

Venturi tube must be made of cast iron or cast steel and must have an accuracy of plus or minus 1 percent of full flow. The throat section must be lined with austenitic stainless steel. Thermal expansion characteristics of the lining must be the same as that of the throat casting material. The surface of the throat lining must be machined to a plus or minus 50 micro inch finish, including the short curvature leading from the converging entrance section into the throat.

2.7.6.5 Annular Pitot Tube

Annular pitot tube must be made of austenitic stainless steel with an accuracy of plus or minus 2 percent of full flow and a repeatability of plus or minus 0.5 percent of measured value. The unit must have at least one static port and no less than four total head pressure ports with an averaging manifold.

2.7.6.6 Insertion Turbine Flowmeter

Provide dual axial turbine flowmeter with all installation hardware necessary to enable insertion and removal of the meter without system shutdown. All parts must meet or exceed the pressure classification of the pipe system it is installed in. Insertion Turbine Flowmeter accuracy must be plus or minus 0.5 percent of rate at calibrated velocity., within plus or minus of rate over a 10:1 turndown and within plus or minus 2 percent of rate over a 50:1 turndown. Repeatability must be plus or minus 0.25 percent of reading. The meter flow sensing element must operate over a range suitable for the installed location with a pressure loss limited to 1 percent of operating pressure at maximum flow rate. The flowmeter ,must include either dry contact pulse outputs, 4-20mA, 0-10Vdc or 0-5Vdc outputs. The turbine rotor assembly must be constructed of Series 300 stainless steel and use Teflon seals.

2.7.6.7 Vortex Shedding Flowmeter

Vortex Shedding Flowmeter accuracy must be within plus or minus 0.8 percent of the actual reading over the range of the meter. Steam meters must contain density compensation by direct measurement of temperature. Mass flow inferred from specified steam pressure are not acceptable. The flow meter body must be made of austenitic stainless steel and include a weather tight NEMA 4X electronics enclosure. The vortex shedding flowmeter body must not require removal from the piping in order to replace the shedding sensor.

2.7.6.8 Ultrasonic Flow Meter

Provide Ultrasonic Flow Meters complete with matched transducers, self aligning installation hardware and transducer cables. Ultrasonic transducers must be optimized for the specific pipe and process conditions for the application. The flow meter accuracy must plus or minus 1 percent of rate from 0 to 40 ft/sec. The flowmeter must include either dry contact pulse outputs, 4-20mA, 0-10Vdc or 0-5Vdc output.

2.7.6.9 Insertion Magnetic Flow Meter

Provide insertion type magnetic flowmeters with all installation hardware necessary to enable insertion and removal of the meter without system shutdown. All parts must meet or exceed the pressure classification of the pipe system it is installed in. Flowmeter accuracy must be no greater than plus or minus 1 percent of rate from 2 to 20 feet/sec. Wetted material parts must be 300 series stainless steel. The flowmeter must include either dry contact pulse outputs, 4-20mA, 0-10Vdc or 0-5Vdc outputs.

2.7.6.10 Positive Displacement Flow Meter

The flow meter must be a direct reading, gerotor, nutating disc or vane type displacement device rated for liquid service as indicated. A counter must be mounted on top of the meter, and must consist of a non-resettable mechanical totalizer for local reading, and a pulse transmitter for remote reading. The totalizer must have a six digit register to indicate the volume passed through the meter in gallons, and a sweep-hand dial to indicate down to 0.25 gallons. The pulse transmitter must have a hermetically sealed reed switch which is activated by magnets fixed on gears of the counter. The meter must have a bronze body with threaded or flanged connections as required for the application. Output accuracy must be plus or minus 2 percent of the flow range. The maximum pressure drop at full flow must be 5 psig.

2.7.6.11 Flow Meters, Paddle Type

Sensor must be non-magnetic, with forward curved impeller blades designed for water containing debris. Sensor accuracy must be plus or minus 1 percent of rate of flow, minimum operating flow velocity must be 1 foot per second. Sensor repeatability and linearity must be plus or minus 1 percent. Materials which will be wetted must be made from non-corrosive materials and must not contaminate water. The sensor must be rated for installation in pipes of 3 to 40 inch diameters. The transmitter housing must be a NEMA 250 Type 4 enclosure.

2.7.6.12 Flow Switch

Flow switch must have a repetitive accuracy of plus or minus 10 percent of actual flow setting. Switch actuation must be adjustable over the operating flow range, and must be sized for the application such that the setpoint is between 25 percent and 75 percent of the full range.. The switch must have Form C snap-action contacts, rated for the application. The flow switch must have non flexible paddle with magnetically actuated contacts and be rated for service at a pressure greater than the installed conditions. Flow switch for use in sewage system must be rated for use in corrosive environments encountered.

2.7.6.13 Gas Flow Meter

Gas flow meter must be diaphragm or bellows type (gas positive displacement meters) for flows up to 2500 SCFH and axial flow turbine type for flows above 2500 SCFH, designed specifically for natural gas supply metering, and rated for the pressure, temperature, and flow rates of the installation. Meter must have a minimum turndown ratio of 10 to 1 with an accuracy of plus or minus 1 percent of actual flow rate. The meter index must include a direct reading mechanical totalizing register and electrical impulse dry contact output for remote monitoring. The

electrical impulse dry contact output must not require field adjustment or calibration. The electrical impulse dry contact output must have a minimum resolution of 100 cubic feet of gas per pulse and must not exceed 15 pulses per second at the design flow.

2.7.7 Electrical Instruments

Provide Electrical Instruments with an input range as indicated or sized for the application. Unless otherwise specified, AC instrumentation must be suitable for 60 Hz operation.

2.7.7.1 Current Transducers

Current transducers must accept an AC current input and must have an accuracy of plus or minus 0.5 percent of full scale. The device must have a means for calibration. Current transducers for variable frequency applications must be rated for variable frequency operation.

2.7.7.2 Current Sensing Relays (CSRs)

Current sensing relays (CSRs) must provide a normally-open contact with a voltage and amperage rating greater than its connected load. Current sensing relays must be of split-core design. The CSR must be rated for operation at 200 percent of the connected load. Voltage isolation must be a minimum of 600 volts. The CSR must auto-calibrate to the connected load or be adjustable and field calibrated. Current sensors for variable frequency applications must be rated for variable frequency operation.

2.7.7.3 Voltage Transducers

Voltage transducers must accept an AC voltage input and have an accuracy of plus or minus 0.25 percent of full scale. The device must have a means for calibration. Line side fuses for transducer protection must be provided.

2.7.7.4 Energy Metering

2.7.7.4.1 Watt or Watthour Transducers

Watt transducers must measure voltage and current and must output kW or kWh or both kW and kWh as indicated. kW outputs must have an accuracy of plus or minus 0.5 percent over a power factor range of 0.1 to 1. kWh outputs must have an accuracy of plus or minus 0.5 percent over a power factor range of 0.1 to 1.

2.7.7.4.2 Watthour Revenue Meter (with and without Demand Register)

All Watthour revenue meters must measure voltage and current and must be in accordance with ANSI C12.1 with an ANSI C12.20 Accuracy class of 0.5 and must have pulse initiators for remote monitoring of Watthour consumption. Pulse initiators must consist of form C contacts with a current rating not to exceed two amperes and voltage not to exceed 500 V, with combinations of VA not to exceed 100 VA, and a life rating of one billion operations. Meter sockets must be in accordance with NEMA/ANSI C12.10. Watthour revenue meters with demand registers must output instantaneous demand in addition to the pulse initiators.

2.7.7.4.3 Hydronic BTU Meters

The BTU meter is to be supplied with wall mount hardware and be capable of being installed remote from the flow meter. The BTU meter must include an LCD display for local indication of energy rate and for display of parameters and settings during configuration. Each BTU meter must be factory configured for its specific application and be completely field configurable by the user via a front panel keypad (no special interface device or computer required). The unit must output Energy Rate, Energy Total, Flow Rate, Supply Temperature, and Return Temperature. An integral transmitter is to provide a linear analog or configurable pulse output signal representing the energy rate; and the signal must be compatible with building automation system DDC Hardware to which the output is connected.

2.7.8 pH Sensor

The sensor must be suitable for applications and chemicals encountered in water treatment systems of boilers, chillers and condenser water systems. Construction, wiring, fittings and accessories must be corrosion and chemical resistant with fittings for tank or suspension installation. Housing must be polyvinylidene fluoride with O-rings made of chemical resistant materials which do not corrode or deteriorate with extended exposure to chemicals. The sensor must be encapsulated. Periodic replacement must not be required for continued sensor operation. Sensors must use a ceramic junction and pH sensitive glass membrane capable of withstanding a pressure of 100 psig at 150 degrees F. The reference cell must be double junction configuration. Sensor range must be 0 to 12 pH, stability 0.05, sensitivity 0.02, and repeatability of plus or minus 0.05 pH value, response of 90 percent of full scale in one second and a linearity of 99 percent of theoretical electrode output measured at 76 degrees F.

2.7.9 Occupancy Sensors

Occupancy sensors must have occupancy-sensing sensitivity adjustment and an adjustable off-delay timer with a setpoint of 15 minutes. Adjustments accessible from the face of the unit are preferred. Occupancy sensors must be rated for operation in ambient air temperatures ranging from 40 to 95 degrees F or temperatures normally encountered in the installed location. Sensors integral to wall mount on-off light switches must have an auto-off switch. Wall switch sensors must be decorator style and must fit behind a standard decorator type wall plate. All occupancy sensors, power packs, and slave packs must be UL listed. In addition to any outputs required for lighting control, the occupancy sensor must provide an output for the HVAC control system.

2.7.9.1 Passive Infrared (PIR) Occupancy Sensors

PIR occupancy sensors must have a multi-level, multi-segmented viewing lens and a conical field of view with a viewing angle of 180 degrees and a detection of at least 20 feet unless otherwise indicated or specified. PIR Sensors must provide field-adjustable background light-level adjustment with an adjustment range suitable to the light level in the sensed area, room or space. PIR sensors must be immune to false triggering from RFI and EMI.

2.7.9.2 Ultrasonic Occupancy Sensors

Ultrasonic sensors must operate at a minimum frequency 32 kHz and must be designed to not interfere with hearing aids.

2.7.9.3 Dual-Technology Occupancy Sensor (PIR and Ultrasonic)

Dual-Technology Occupancy Sensors must meet the requirements of both PIR and Ultrasonic Occupancy Sensors.

2.7.10 Vibration Switch

Vibration switch must be solid state, enclosed in a NEMA 250 Type 4 or Type 4X housing with sealed wire entry. Unit must have two independent sets of Form C switch contacts with one set to shutdown equipment upon excessive vibration and a second set for monitoring alarm level vibration. The vibration sensing range must be a true rms reading, suitable for the application. The unit must include either displacement response for low speed or velocity response for high speed application. The frequency range must be at least 3 Hz to 500 Hz. Contact time delay must be 3 seconds. The unit must have independent start-up and running delay on each switch contact. Alarm limits must be adjustable and setpoint accuracy must be plus or minus 10 percent of setting with repeatability of plus or minus 2 percent.

2.7.11 Conductivity Sensor

Sensor must include local indicating meter and must be suitable for measurement of conductivity of water in boilers, chilled water systems, condenser water systems, distillation systems, or potable water systems as indicated. Sensor must sense from 0 to 10 microSeimens per centimeter (µS/cm) for distillation systems, 0 to 100 µS/cm for boiler, chilled water, and potable water systems and 0 to 1000 µS/cm for condenser water systems. Contractor must field verify the ranges for particular applications and adjust the range as required. The output must be temperature compensated over a range of 32 to 212 degrees F. The accuracy must be plus or minus 2 percent of the full scale reading. Sensor must have automatic zeroing and must require no periodic maintenance or recalibration.

2.7.12 Compressed Air Dew Point Sensor

Sensor must be suitable for measurement of dew point from -40 +80 degrees F over a pressure range of 0 to 150 psig. The transmitter must provide both dry bulb and dew point temperatures on separate outputs. The end to end accuracy of the dew point must be plus or minus 5 degrees F and the dry bulb must be plus or minus 1 degree F. Sensor must be automatic zeroing and must require no normal maintenance or periodic recalibration.

2.7.13 Temperature Switch

2.7.13.1 Duct Mount Temperature Low Limit Safety Switch (Freezestat)

Duct mount temperature low limit switches (Freezestats) must be manual reset, low temperature safety switches at least 1 foot long per square foot of coverage which must respond to the coldest 18 inch segment with an accuracy of plus or minus 3.6 degrees F. The switch must have a field-adjustable setpoint with a range of at least 30 to 50 degrees F. The switch must have two sets of contacts, and each contact must have a

rating greater than its connected load. Contacts must open or close upon drop of temperature below setpoint as indicated and must remain in this state until reset.

2.7.13.2 Pipe Mount Temperature Limit Switch (Aquastat)

Pipe mount temperature limit switches (aquastats) must have a field adjustable setpoint between 60 and 90 degrees F, an accuracy of plus or minus 3.6 degrees F and a 10 degrees F fixed deadband. The switch must have two sets of contacts, and each contact must have a rating greater than its connected load. Contacts must open or close upon change of temperature above or below setpoint as indicated.

2.7.14 Damper End Switches

Each end switch must be a hermetically sealed switch with a trip lever and over-travel mechanism. The switch enclosure must be suitable for mounting on the duct exterior and must permit setting the position of the trip lever that actuates the switch. The trip lever must be aligned with the damper blade.

End switches integral to an electric damper actuator are allowed as long as at least one is adjustable over the travel of the actuator.

2.7.15 Air Quality Sensors

Provide full spectrum air quality sensors using a hot wire element based on the Taguchi principle. The sensor must monitor a wide range of gaseous volatile organic components common in indoor air contaminants like paint fumes, solvents, cigarette smoke, and vehicle exhaust. The sensor must automatically compensate for temperature and humidity, have span and calibration potentiometers, operate on 24 VDC power with output of 0-10 VDC, and have a service rating of 32 to 140 degrees F and 5 to 95 percent relative humidity.

2.8 INDICATING DEVICES

All indicating devices must display readings in English (inch-pound) units.

2.8.1 Thermometers

Provide bi-metal type thermometers at locations indicated. Thermometers must have either 9 inch long scales or 3.5 inch diameter dials, with insertion, immersion, or averaging elements. Provide matching thermowells for pipe-mounted installations. Select scale ranges suitable for the intended service, with the normal operating temperature near the scale's midpoint. The thermometer's accuracy must be plus or minus 2 percent of the scale range.

2.8.1.1 Piping System Thermometers

Piping system thermometers must have brass, malleable iron or aluminum alloy case and frame, clear protective face, permanently stabilized glass tube with indicating-fluid column, white face, black numbers, and a 9 inch scale. Piping system thermometers must have an accuracy of plus or minus 1 percent of scale range. Thermometers for piping systems must have rigid stems with straight, angular, or inclined pattern. Thermometer stems must have expansion heads as required to prevent breakage at extreme temperatures. On rigid-stem thermometers, the space between bulb and stem

must be filled with a heat-transfer medium.

2.8.1.2 Air-Duct Thermometers

Air-duct thermometers must have perforated stem guards and 45-degree adjustable duct flanges with locking mechanism.

2.8.2 Pressure Gauges

Provide pipe-mounted pressure gauges at the locations indicated. Gauges must conform to ASME B40.100 and have a 4 inch diameter dial and shutoff cock. Select scale ranges suitable for the intended service, with the normal operating pressure near the scale's midpoint. The gauge's accuracy must be plus or minus 2 percent of the scale range.

Gauges must be suitable for field or panel mounting as required, must have black legend on white background, and must have a pointer traveling through a 270-degree arc. Gauge range must be suitable for the application with an upper end of the range not to exceed 150 percent of the design upper limit. Accuracy must be plus or minus 3 percent of scale range. Gauges must meet requirements of ASME B40.100.

2.8.3 Low Differential Pressure Gauges

Gauges for low differential pressure measurements must be a minimum of 3.5 inch (nominal) size with two sets of pressure taps, and must have a diaphragm-actuated pointer, white dial with black figures, and pointer zero adjustment. Gauge range must be suitable for the application with an upper end of the range not to exceed 150 percent of the design upper limit. Accuracy must be plus or minus two percent of scale range.

2.8.4 Pressure Gauges for Pneumatic Controls

Gauges must sufficient scale to display the full range of expected pressures with 1 psi graduations.

2.9 OUTPUT DEVICES

2.9.1 Actuators

Actuators must be electric (electronic) . All actuators must be normally open (NO), normally closed (NC) or fail-in-last-position (FILP) as indicated. Normally open and normally closed actuators must be of mechanical spring return type. Electric actuators must have an electronic cut off or other means to provide burnout protection if stalled. Actuators must have a visible position indicator. Electric actuators must provide position feedback to the controller as indicated. Actuators must smoothly and fully open or close the devices to which they are applied. Electric actuators must have a full stroke response time in both directions of 90 seconds or less at rated load. Electric actuators must be of the foot-mounted type with an oil-immersed gear train or the direct-coupled type. Where multiple electric actuators operate from a common signal, the actuators must provide an output signal identical to its input signal to the additional devices. All actuators must be rated for their operating environment. Actuators used outdoors must be designed and rated for outdoor use. Actuators under continuous exposure to water, such as those used in sumps, must be submersible.

Actuators incorporating an integral network connection are considered DDC

Hardware and must meet the DDC Hardware requirements of Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS.

2.9.1.1 Valve Actuators

Valve actuators must provide shutoff pressures and torques as indicated on the Valve Schedule.

2.9.1.2 Damper Actuators

Damper actuators must provide the torque necessary per damper manufacturer's instructions to modulate the dampers smoothly over its full range of operation and torque must be at least 6 inch-pounds/1 square foot of damper area for opposed blade dampers and 9 inch-pounds/1 square foot of damper area for parallel blade dampers.

2.9.1.3 Electric Actuators

Each actuator must have distinct markings indicating the full-open and full-closed position Each actuator must deliver the torque required for continuous uniform motion and must have internal end switches to limit the travel, or be capable of withstanding continuous stalling without damage. Actuators must function properly within 85 to 110 percent of rated line voltage. Provide actuators with hardened steel running shafts and gears of steel or copper alloy. Fiber or reinforced nylon gears may be used for torques less than 16 inch-pounds..

a. Two-position actuators must be single direction, spring return, or reversing type. Two position actuator signals may either be the control power voltage or line voltage as needed for torque or appropriate interlock circuits.

b. Modulating actuators must be capable of stopping at any point in the cycle, and starting in either direction from any point. Actuators must be equipped with a switch for reversing direction, and a button to disengage the clutch to allow manual adjustments. Provide the actuator with a hand crank for manual adjustments, as applicable. Modulating actuator input signals can either be a 4 to 20 mAdc or a 0-10 VDC signal.

c. Floating or pulse width modulation actuators are acceptable for non-fail safe applications unless indicated otherwise provided that the floating point control (timed actuation) must have a scheduled re-calibration of span and position no more than once a day and no less than once a week. The schedule for the re-calibration should not affect occupied conditions and be staggered between equipment to prevent falsely loading or unloading central plant equipment.

2.9.2 Relays

Relays must have contacts rated for the intended application, indicator light, and dust proof enclosure. The indicator light must be lit when the coil is energized and off when coil is not energized.

Control relay contacts must have utilization category and ratings selected for the application. Each set of contacts must incorporate a normally open (NO), normally closed (NC) and common contact. Relays must be rated for a minimum life of one million operations.

2.10 USER INPUT DEVICES

User Input Devices, including potentiometers, switches and momentary contact push-buttons. Potentiometers must be of the thumb wheel or sliding bar type. Momentary Contact Push-Buttons may include an adjustable timer for their output. User input devices must be labeled for their function.

2.11 MULTIFUNCTION DEVICES

Multifunction devices are products which combine the functions of multiple sensor, user input or output devices into a single product. Unless otherwise specified, the multifunction device must meet all requirements of each component device. Where the requirements for the component devices conflict, the multifunction device must meet the most stringent of the requirements.

2.11.1 Current Sensing Relay Command Switch

The Current Sensing Relay portion must meet all requirements of the Current Sensing Relay input device. The Command Switch portion must meet all requirements of the Relay output device except that it must have at least one normally-open (NO) contact.

Current Sensing Relays used for Variable Frequency Drives must be rated for Variable Frequency applications unless installed on the source side of the drive. If used in this situation, the threshold for showing status must be set to allow for the VFD's control power when the drive is not enabled and provide indication of operation when the drive is enabled at minimum speed.

2.11.2 Space Sensor Module

Space Sensor Modules must be multifunction devices incorporating a temperature sensor and one or more of the following as specified and indicated on the Space Sensor Module Schedule:

a. A temperature indicating device.

b. A User Input Device which must adjust a temperature setpoint output.

c. A User Input Momentary Contact Button and an output to the control system indicating zone occupancy.

d. A three position User Input Switch labeled to indicate heating, cooling and off positions ('HEAT-COOL-OFF' switch) and providing corresponding outputs to the control system.

e. A two position User Input Switch labeled with 'AUTO' and 'ON' positions and providing corresponding output to the control system..

f. A multi-position User Input Switch with 'OFF' and at least two fan speed positions and providing corresponding outputs to the control system.

Space Sensor Modules cannot contain mercury (Hg).

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 General Installation Requirements

Perform the installation under the supervision of competent technicians regularly employed in the installation of DDC systems.

3.1.1.1 Device Mounting Criteria

All devices must be installed in accordance with manufacturer's recommendations and as specified and indicated. Control devices to be installed in piping and ductwork must be provided with required gaskets, flanges, thermal compounds, insulation, piping, fittings, and manual valves for shutoff, equalization, purging, and calibration. Strap-on temperature sensing elements must not be used except as specified. Spare thermowells must be installed adjacent to each thermowell containing a sensor and as indicated. Devices located outdoors must have a weathershield.

3.1.1.2 Labels and Tags

Match labels and tags to the unique identifiers indicated on the As-Built drawings. Label all enclosures and instrumentation. Tag all sensors and actuators in mechanical rooms. Tag airflow measurement arrays to show flow rate range for signal output range, duct size, and pitot tube AFMA flow coefficient. Tag duct static pressure taps at the location of the pressure tap. Provide plastic or metal tags, mechanically attached directly to each device or attached by a metal chain or wire. Labels exterior to protective enclosures must be engraved plastic and mechanically attached to the enclosure or instrumentation. Labels inside protective enclosures may attached using adhesive, but must not be hand written.

3.1.2 Weathershield

Provide weathershields for sensors located outdoors. Install weathershields such that they prevent the sun from directly striking the sensor and prevent rain from directly striking or dripping onto the sensor. Install weather shields with adequate ventilation so that the sensing element responds to the ambient conditions of the surroundings. When installing weathershields near outside air intake ducts, install them such that normal outside air flow does not cause rainwater to strike the sensor.

3.1.3 Room Instrument Mounting

Mount room instruments, including but not limited to wall mounted non-adjustable space sensor modules and sensors located in occupied spaces, 48 inches above the floor unless otherwise indicated. Install adjustable devices to be ADA compliant unless otherwise indicated on the Room Sensor Schedule:

a. Space Sensor Modules for Fan Coil Units may be either unit or wall mounted but not mounted on an exterior wall.

b. Wall mount all other Space Sensor Modules.

3.1.4 Indication Devices Installed in Piping and Liquid Systems

Provide snubbers for gauges in piping systems subject to pulsation. For gauges for steam service use pigtail fittings with cock. Install thermometers and temperature sensing elements in liquid systems in thermowells. Provide spare Pressure/Temperature Ports (Pete's Plug) for all temperature and pressure sensing elements installed in liquid systems for calibration/testing.

3.1.5 Occupancy Sensors

Provide a sufficient quantity of occupancy sensors to provide complete coverage of the area (room or space). Occupancy sensors are to be ceiling mounted. Install occupancy sensors in accordance with NFPA 70 requirements and the manufacturer's instructions. Do not locate occupancy sensors within 6 feet of HVAC outlets or heating ducts, or where they can "see" beyond any doorway. Installation above doorway(s) is preferred. Do not use ultrasonic sensors in spaces containing ceiling fans. Install sensors to detect motion to within 2 feet of all room entrances and to not trigger due to motion outside the room. Set the off-delay timer to 15 minutes unless otherwise indicated. Adjust sensors prior to beneficial occupancy, but after installation of furniture systems, shelving, partitions, etc. For each controlled area, provide one hundred percent coverage capable of detecting small hand-motion movements, accommodating all occupancy habits of single or multiple occupants at any location within the controlled room.

3.1.6 Switches

3.1.6.1 Temperature Limit Switch

Provide a temperature limit switch (freezestat) to sense the temperature at the location indicated. Provide a sufficient number of temperature limit switches (freezestats) to provide complete coverage of the duct section but no less than 1 foot in length per square foot of cross sectional area. Install manual reset limit switches in approved, accessible locations where they can be reset easily. Install temperature limit switch (freezestat) sensing elements in a side-to-side (not top-to-bottom) serpentine pattern with the relay section at the highest point and in accordance with the manufacturer's installation instructions.

3.1.6.2 Hand-Off Auto Switches

Wire safety controls such as smoke detectors and freeze protection thermostats to protect the equipment during both hand and auto operation.

3.1.7 Temperature Sensors

Install temperature sensors in locations that are accessible and provide a good representation of sensed media. Installations in dead spaces are not acceptable. Calibrate and install sensors according to manufacturer’s instructions. Select sensors only for intended application as designated or recommended by manufacturer.

3.1.7.1 Room Temperature Sensors

Mount the sensors on interior walls to sense the average room temperature at the locations indicated. Avoid locations near heat sources such as copy machines or locations by supply air outlet drafts. Mount the center

of all user-adjustable sensors 48 inches above the floor to meet ADA requirements. Non user-adjustable sensors can be mounted as indicated in paragraph ROOM INSTRUMENT MOUNTING.

3.1.7.2 Duct Temperature Sensors

3.1.7.2.1 Probe Type

Place tip of the sensor in the middle of the airstream or in accordance with manufacturer's recommendations or instructions.Provide a gasket between the sensor housing and the duct wall. Seal the duct penetration air tight. When installed in insulated duct, provide enclosure or stand off fitting to accommodate the thickness of duct insulation to allow for maintenance or replacement of the sensor and wiring terminations. Seal the duct insulation penetration vapor tight.

3.1.7.2.2 Averaging Type

Weave the sensing element in a serpentine fashion from side to side perpendicular to the flow, across the duct or air handler cross-section, using durable non-metal supports in accordance with manufacturer's installation instructions. Avoid tight radius bends or kinking of the sensing element. Prevent contact between the sensing element and the duct or air handler internals. Provide a duct access door at the sensor location. The access door must be hinged on the side, factory insulated, have cam type locks, and be as large as the duct will permit, maximum 18 by 18 inches. For sensors inside air handlers, the sensors must be fully accessible through the air handler's access doors without removing any of the air handler's internals.

3.1.7.3 Immersion Temperature Sensors

Provide thermowells for sensors measuring piping, tank, or pressure vessel temperatures. Locate wells to sense continuous flow conditions. Do not install wells using extension couplings. When installed on insulated piping, provide stand enclosure or stand off fitting to accommodate the thickness of the pipe insulation and allow for maintenance or replacement of the sensor or wiring terminations. Where piping diameters are smaller than the length of the wells, provide wells in piping at elbows to sense flow across entire area of well. Wells must not restrict flow area to less than 70 percent of pipe area. Increase piping size as required to avoid restriction. Provide the sensor well with a heat-sensitive transfer agent between the sensor and the well interior ensuring contact between the sensor and the well.

3.1.7.4 Outside Air Temperature Sensors

Provide outside air temperature sensors on the building's north side with a protective weather shade that does not inhibit free air flow across the sensing element, and protects the sensor from snow, ice, and rain. Location must not be near exhaust hoods and other areas such that it is not influenced by radiation or convection sources which may affect the reading. Provide a shield to shade the sensor from direct sunlight.

3.1.8 Air Flow Measurement Arrays (AFMA)

Locate Outside Air AFMAs downstream from the Outside Air filters.

Install AFMAs with the manufacturer's recommended minimum distances

between upstream and downstream disturbances. Airflow straighteners may be used to reduce minimum distances as recommended by the AFMA manufacturer.

3.1.9 Duct Static Pressure Sensors

Locate the duct static pressure sensing tap at 75 percent of the distance between the first and last air terminal units . If the transmitter output is a 0-10Vdc signal, locate the transmitter in the same enclosure as the air handling unit (AHU) controller for the AHU serving the terminal units. If a remote duct static pressure sensor is to be used, run the signal wire back to the controller for the air handling unit.

3.1.10 Relative Humidity Sensors

Install relative humidity sensors in supply air ducts at least 10 feet downstream of humidity injection elements.

3.1.11 Meters

3.1.11.1 Flowmeters

Install flowmeters to ensure minimum straight unobstructed piping for at least 10 pipe diameters upstream and at least 5 pipe diameters downstream of the flowmeter, and in accordance with the manufacturer's installation instructions.

3.1.11.2 Energy Meters

Locate energy meters as indicated. Connect each meter output to the DDC system, to measure both instantaneous demand/energy and other variables as indicated.

3.1.12 Dampers

3.1.12.1 Damper Actuators

Provide spring return actuators which fail to a position that protects the served equipment and space on all control dampers related to freeze protection or force protection. For all outside, makeup and relief dampers provide dampers which fail closed. Terminal fan coil units, terminal VAV units, convectors, and unit heaters nay be non-spring return unless indicated otherwise. Do not mount actuators in the air stream. Do not connect multiple actuators to a common drive shaft. Install actuators so that their action seal the damper to the extent required to maintain leakage at or below the specified rate and so that they move the blades smoothly throughout the full range of motion.

3.1.12.2 Damper Installation

Install dampers straight and true, level in all planes, and square in all dimensions. Dampers must move freely without undue stress due to twisting, racking (parallelogramming), bowing, or other installation error. External linkages must operate smoothly over the entire range of motion, without deformation or slipping of any connecting rods, joints or brackets that will prevent a return to it's normal position. Blades must close completely and leakage must not exceed that specified at the rated static pressure. Provide structural support for multi-section dampers. Acceptable methods of structural support include but are not limited to

U-channel, angle iron, corner angles and bolts, bent galvanized steel stiffeners, sleeve attachments, braces, and building structure. Where multi-section dampers are installed in ducts or sleeves, they must not sag due to lack of support. Do not use jackshafts to link more than three damper sections. Do not use blade to blade linkages. Install outside and return air dampers such that their blades direct their respective air streams towards each other to provide for maximum mixing of air streams.

3.1.13 Valves

Install the valves in accordance with the manufacturer's instructions.

3.1.13.1 Valve Actuators

Provide spring return actuators on all control valves where freeze protection is required. Spring return actuators for terminal fan coil units, terminal VAV units, convectors, and unit heaters are not required unless indicated otherwise.

3.1.14 Thermometers and Gauges

3.1.14.1 Thermometers

Mount devices to allow reading while standing on the floor or ground, as applicable.

3.1.15 Wire and Cable

Provide complete electrical wiring for the Control System, including wiring to transformer primaries. Wire and Cable must be installed without splices between control devices and in accordance with NFPA 70 and NFPA 90A. Instrumentation grounding must be installed per the device manufacturer's instructions and as necessary to prevent ground loops, noise, and surges from adversely affecting operation of the system. Test installed ground rods as specified in IEEE 142. Cables and conductor wires must be tagged at both ends, with the identifier indicated on the shop drawings. Electrical work must be as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM and as indicated. Wiring external to enclosures must be run in raceways, except low-voltage control and low-voltage network wiring may be installed as follows:

a. plenum rated cable in suspended ceilings over occupied spaces may be run without raceways

b. nonmetallic-sheathed cables or metallic-armored cables may be installed as permitted by NFPA 70.

Install control circuit wiring not in raceways in a neat and safe manner. Wiring must not use the suspended ceiling system (including tiles, frames or hangers) for support. Where conduit or raceways are required, control circuit wiring must not run in the same conduit/raceway as power wiring over 50 volts. Run all circuits over 50 volts in conduit, metallic tubing, covered metal raceways, or armored cable.

3.1.16 Copper Tubing

Provide hard-drawn copper tubing in exposed areas and either hard-drawn or annealed copper tubing in concealed areas. Use only tool-made bends. Use only brass or copper solder joint type fittings, except for connections

to apparatus. For connections to apparatus use brass compression type fittings.

3.1.17 Plastic Tubing

Install plastic tubing within covered raceways or conduit except when otherwise specified. Do not use plastic tubing for applications where the tubing could be subjected to a temperature exceeding 130 degrees F. For fittings, use brass or acetal resin of the compression or barbed push-on type for instrument service. Except in walls and exposed locations, plastic multitube instrument tubing bundle without conduit or raceway protection may be used where a number of air lines run to the same points, provided the multitube bundle is enclosed in a protective sheath, is run parallel to the building lines and is adequately supported as specified.

-- End of Section --

SECTION 23 09 23.02

BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS
02/19, CHG 1: 02/20

PART 1 GENERAL

1.1 SUMMARY

Provide a complete Direct Digital Control (DDC) system suitable for the control of the heating, ventilating and air conditioning (HVAC) and other building-level systems as specified and shown and in accordance with Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

1.1.1 System Requirements

Provide a system meeting the requirements of both Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC and this Section and with the following characteristics:

a. Except for Gateways, the control system must be an open implementation of BACnet technology using ASHRAE 135 and Fox as the communications protocols. The system must use standard ASHRAE 135 Objects and Properties and the Niagara Framework. The system must use standard ASHRAE 135 Services and the Niagara Framework exclusively for communication over the network. Gateways to packaged units must communicate with other DDC hardware using ASHRAE 135 or the Fox protocol exclusively and may communicate with packaged equipment using other protocols. The control system must be installed such that any two ASHRAE 135 devices on the Internetwork can communicate using standard ASHRAE 135 Services.

b. Install and configure control hardware to provide ASHRAE 135 Objects and Properties or Niagara Framework Objects as indicated and as needed to meet the requirements of this specification.

c. Use Niagara Framework hardware and software exclusively for scheduling, trending, and communication with a front end (UMCS). Use Niagara Framework or standard BACnet Objects and services for alarming. Use the Fox protocol for all communication between Niagara Framework Supervisory Gateways; use the ASHRAE 135 protocol for all other building communication.

d. Use Niagara Framework Version 4.0 or later.

1.1.2 Verification of Specification Requirements

Review all specifications related to the control system installation and advise the Contracting Officer of any discrepancies before performing any work. If Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC or any other Section referenced in this specification is not included in the project specifications advise the Contracting Officer and either obtain the missing Section or obtain Contracting Officer approval before performing any work.

1.2 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 135	(2020; Errata 1-2 2021) BACnet—A Data Communication Protocol for Building Automation and Control Networks

BACNET INTERNATIONAL (BTL)

BTL Guide	(v.49; 2017) BACnet Testing Laboratory Implementation Guidelines

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 802.3	(2018) Ethernet

TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA)

TIA-485	(1998a; R 2012) Electrical Characteristics of Generators and Receivers for Use in Balanced Digital Multipoint Systems

TRIDIUM, INC (TRIDIUM)

Niagara Framework	(2012) NiagaraAX User's Guide
Tridium Open NiCS	(2005) Understanding the NiagaraAX Compatibility Statement (NiCS)

U.S. FEDERAL COMMUNICATIONS COMMISSION (FCC)

FCC Part 15	Radio Frequency Devices (47 CFR 15)

UNDERWRITERS LABORATORIES (UL)

UL 916	(2015; Reprint Sep 2021) UL Standard for Safety Energy Management Equipment

1.3 DEFINITIONS

For definitions related to this section, see Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

1.4 SUBMITTALS

Submittal requirements related to this Section are specified in Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

PART 2 PRODUCTS

All products used to meet this specification must meet the indicated requirements, but not all products specified here will be required by every project. All products must meet the requirements both Section

23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC and this Section.

2.1 NETWORK HARDWARE

2.1.1 BACnet Router

All BACnet Routers must be BACnet/IP Routers and must perform layer 3 routing of ASHRAE 135 packets over an IP network in accordance with ASHRAE 135 Annex J and Clause 6. The router must provide the appropriate connection to the IP network and connections to one or more ASHRAE 135 MS/TP networks. Devices used as BACnet Routers must meet the requirements for DDC Hardware, and except for Niagara Framework Supervisory Gateways, devices used as BACnet routers must support the NM-RC-B BIBB.

2.1.2 BACnet Gateways

In addition to the requirements for DDC Hardware, the BACnet Gateway must be a Niagara Framework Supervisory Gateway or must meet the following requirements:

a. It must perform bi-directional protocol translation from one non-ASHRAE 135 protocol to ASHRAE 135. BACnet Gateways must incorporate a network connection to an ASHRAE 135 network (either BACnet over IP in accordance with Annex J or MS/TP) and a separate connection appropriate for the non-ASHRAE 135 protocol and media.

b. It must retain its configuration after a power loss of an indefinite time, and must automatically return to their pre-power loss state once power is restored.

c. It must allow bi-directional mapping of data between the non-ASHRAE 135 protocol and Standard Objects as defined in ASHRAE 135. It must support the DS-RP-B BIBB for Objects requiring read access and the DS-WP-B BIBB for Objects requiring write access.

d. It must support the DS-COV-B BIBB.

Although Gateways must meet DDC Hardware requirements , except for Niagara Framework Supervisory Gateways, they are not DDC Hardware and must not be used when DDC Hardware is required. (Niagara Framework Supervisory Gateways are both Gateways and DDC Hardware.)

2.1.3 Ethernet Switch

Ethernet Switches must autoconfigure between 10,100 and 1000 megabits per second (MBPS).

2.2 CONTROL NETWORK WIRING

a. BACnet MS/TP communications wiring must be in accordance with ASHRAE 135. The wiring must use shielded, three wire (twisted-pair with reference) cable with characteristic impedance between 100 and 120 ohms. Distributed capacitance between conductors must be less than 30 pF per foot.

b. Building Control Network Backbone IP Network must use Ethernet media. Ethernet cables must be CAT-5e at a minimum and meet all requirements of IEEE 802.3.

2.3 DIRECT DIGITAL CONTROL (DDC) HARDWARE

2.3.1 General Requirements

All DDC Hardware must meet the following requirements:

a. It must be locally powered and must incorporate a light to indicate the device is receiving power.

b. It must conform to the BTL Guide

c. It must be BACnet Testing Laboratory (BTL) Listed.

d. The Manufacturer's Product Data submittal for each piece of DDC Hardware must include the Protocol Implementation Conformance Statement (PICS) for that hardware as specified in Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

e. It must communicate and be interoperable in accordance with ASHRAE 135 and have connections for BACnet IP or MS/TP control network wiring.

f. Other than devices controlling terminal units or functioning solely as a BACnet Router, it must support DS-COV-B, DS-RPM-A and DS-RPM-B BIBBs.

g. Devices supporting the DS-RP-A BIBB must also support the DS-COV-A BIBB.

h. Application programs, configuration settings and communication information must be stored in a manner such that they persist through loss of power:

(1) Application programs must persist regardless of the length of time power is lost.

(2) Configured settings must persist for any loss of power less than 2,500 hours.

(3) Communication information, including but not limited to COV subscriptions, event reporting destinations, Notification Class Object settings, and internal communication settings, must persist for any loss of power less than 2,500 hours.

i. Internal Clocks:

(1) Clocks in DDC Hardware incorporating a Clock must continue to function for 120 hours upon loss of power to the DDC Hardware.

(2) DDC Hardware incorporating a Clock must support the DM-TS-B or DM-UTC-B BIBB.

j. It must have all functionality indicated and required to support the application (Sequence of Operation or portion thereof) in which it is used, including but not limited to providing Objects or Niagara Framework Points as specified and as indicated on the Points Schedule.

k. In addition to these general requirements and the DDC Hardware Input-Output (I/O) Function requirements, all DDC Hardware must also meet any additional requirements for the application in which it is

used (e.g. scheduling, alarming, trending, etc.).

l. It must meet FCC Part 15 requirements and have UL 916 or equivalent safety listing.

m. Except for Niagara Framework Supervisory Gateways, Device must support Commandable Objects to support Override requirements as detailed in PART 3 EXECUTION

n. User interfaces which allow for modification of Properties or settings must be password-protected.

o. Devices communicating BACnet MS/TP must meet the following requirements:

(1) Must have a configurable Max_Master Property.

(2) DDC Hardware other than hardware controlling a single terminal unit must have a configurable Max_Info_Frames Property.

(3) Must respond to any valid request within 50 msec with either the appropriate response or with a response of "Reply Postponed".

(4) Must use twisted pair with reference and shield (3-wire media) wiring.

p. Devices communicating BACnet/IP must use UDP Port 0xBAC0. Devices with configurable UDP Ports must default to 0xBAC0.

q. All Device IDs, Network Numbers, and BACnet MAC addresses of devices must be fully configurable without limitation, except MS/TP MAC addresses may be limited by ASHRAE 135 requirements.

r. Except for Niagara Framework Supervisory Gateways, DDC Hardware controlling a single terminal unit must have:

(1) Objects (including the Device Object) with an Object Name Property of at least 8 characters in length.

(2) A configurable Device Object Name.

(3) A configurable Device Object Description Property at least 16 characters in length.

s. Except for Objects in either Niagara Framework Supervisory Gateways or DDC Hardware controlling a single terminal unit, all Objects (including Device Objects) must:

(1) Have a configurable Object Name Property of at least 12 characters in length.

(2) Have a configurable Object Description Property of at least 24 characters in length.

t. For programmable DDC Hardware, provide and license to the project site all programming software required to program the Hardware in accordance with Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

u. For programmable DDC Hardware, provide copies of the installed

application programs (all software that is not common to every controller of the same manufacturer and model) as source code compatible with the supplied programming software in accordance with Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC. The submitted application program must be the complete application necessary for controller to function as installed and be sufficient to allow replacement of the installed controller with another controller of the same type.

2.3.2 Hardware Input-Output (I/O) Functions

DDC Hardware incorporating hardware input-output (I/O) functions must meet the following requirements:

2.3.2.1 Analog Inputs

DC Hardware analog inputs (AIs) must be implemented using ASHRAE 135 Analog Input Objects and perform analog to digital (A-to-D) conversion with a minimum resolution of 8 bits plus sign or better as needed to meet the accuracy requirements specified in Section 23 09 00. Signal conditioning including transient rejection must be provided for each analog input. Analog inputs must be capable of being individually calibrated for zero and span. Calibration via software scaling performed as part of point configuration is acceptable. The AI must incorporate common mode noise rejection of at least 50 dB from 0 to 100 Hz for differential inputs, and normal mode noise rejection of at least 20 dB at 60 Hz from a source impedance of 10,000 ohms.

2.3.2.2 Analog Outputs

DDC Hardware analog outputs (AOs) must be implemented using ASHRAE 135 Analog Output Objects and perform digital to analog (D-to-A) conversion with a minimum resolution of 8 bits plus sign, and output a signal with a range of 4-20 mAdc or 0-10 Vdc. Analog outputs must be capable of being individually calibrated for zero and span. Calibration via software scaling performed as part of point configuration is acceptable. DDC Hardware with Hand-Off-Auto (H-O-A) switches for analog outputs must provide for overriding the output through the range of 0 percent to 100 percent

2.3.2.3 Binary Inputs

DDC Hardware binary inputs (BIs) must be implemented using ASHRAE 135 Binary Input Objects and accept contact closures and must ignore transients of less than 5 milli-second duration. Protection against a transient 50VAC must be provided.

2.3.2.4 Binary Outputs

DDC Hardware binary outputs (BOs) must be implemented using ASHRAE 135 Binary Output Objects and provide relay contact closures or triac outputs for momentary and maintained operation of output devices. DDC Hardware with H-O-A switches for binary outputs must provide for overriding the output open or closed.

2.3.2.4.1 Relay Contact Closures

Closures must have a minimum duration of 0.1 second. Relays must provide at least 180V of isolation. Electromagnetic interference suppression must

be provided on all output lines to limit transients to 50 Vac. Minimum contact rating must be 0.5 amperes at 24 Vac.

2.3.2.4.2 Triac Outputs

Triac outputs must provide at least 180 V of isolation. Minimum contact rating must be 0.5 amperes at 24 Vac.

2.3.2.5 Pulse Accumulator

DDC Hardware pulse accumulators must be implemented using either an ASHRAE 135 Accumulator Object or an ASHRAE 135 Analog Value Object where the Present_Value is the totalized pulse count. Pulse accumulators must accept contact closures, ignore transients less than 5 msec duration, protect against
transients of 50 VAC, and accept rates of at least 20 pulses per second.

2.3.2.6 ASHRAE 135 Objects for Hardware Inputs and Outputs

The requirements for use of ASHRAE 135 objects for hardware input and outputs includes devices where the hardware sensor or actuator is integral to the controller (e.g. a VAV box with integral damper actuator, a smart sensor, a VFD, etc.)

2.3.2.7 Integrated H-O-A Switches

Where integrated H-O-A switches are provided on hardware outputs, controller must provide means of monitoring position or status of H-O-A switch. This feedback may be provided via the Niagara Framework or via any valid BACnet method, including the use of proprietary Objects, Properties, or Services.

2.3.3 Local Display Panel (LDP)

The Local Display Panels (LDPs) must be DDC Hardware with a display and navigation buttons or a touch screen display, and must provide display and adjustment of Niagara Framework points or ASHRAE 135 Properties as indicated on the Points Schedule and as specified. LDPs must be either BTL Listed as a B-OD, B-OWS, B-AWS, or be an integral part of another piece of DDC Hardware listed as a B-BC. For LDPs listed as B-OWS or B-AWS, the hardware must be BTL listed and the product must come factory installed with all applications necessary for the device to function as an LDP.

The adjustment of values using display and navigation buttons must be password protected.

2.3.4 Expansion Modules and Tethered Hardware

A single piece of DDC Hardware may consist of a base unit and also:

a. An unlimited number of hardware expansion modules, where the individual hardware expansion modules are designed to directly connect, both mechanically and electrically, to the base unit hardware. The expansion modules must be commercially available as an optional add-on to the base unit.

b. A single piece of hardware connected (tethered) to a base unit by a single cable where the cable carries a proprietary protocol between

the base unit and tethered hardware. The tethered hardware must not contain control logic and be commercially available as an optional add-on to the base unit as a single package.

Note that this restriction on tethered hardware does not apply to sensors or actuators using standard binary or analog signals (not a communications protocol); sensors or actuators using standard binary or analog signals are not considered part of the DDC Hardware.

Hardware capable of being installed stand-alone, or without a separate base unit, is DDC Hardware and must not be used as expansion modules or tethered hardware.

2.3.5 Supervisory Control Requirements

2.3.5.1 Alarm Generation Hardware

Non-Niagara Framework DDC Hardware used for alarm generation must meet the following requirements:

a. Device must support the AE-N-I-B BIBB

b. The Recipient_List Property must be Writable for all Notification Class Objects used for alarm generation.

c. For all Objects implementing Intrinsic Alarming, the following Properties must be Writable:

(1) Time_Delay
(2) High_Limit
(3) Low_Limit
(4) Deadband
(5) Event_Enable
(6) If the issue date of this project specification is after 1 January 2016, Time_Delay_Normal must be writable.

d. It is preferred, but not required, that devices support the DM-OCD-B BIBB on all Notification Class Objects. It is also preferred, but not required that devices supporting the DM-OCD-B BIBB accept any valid value as an initial value for properties of Notification Class Objects.

2.3.6 Niagara Framework Supervisory Gateway

Any device implementing the Niagara Framework is a Niagara Framework Supervisory Gateway and must meet these requirements. In addition to the general requirements for all DDC Hardware, Niagara Framework Supervisory Gateway Hardware must:

a. Be direct digital control hardware.

b. Have an unrestricted interoperability license and its Niagara Compatibility Statement (NiCS) must follow the Tridium Open NiCS Specification.

c. Manage communications between a field control network and the Niagara Framework Monitoring and Control Software, and between itself and other Niagara Framework Supervisory Gateways. Niagara Framework Supervisory Gateway Hardware must use Fox protocol for communication with other Niagara Framework Components, regardless of the manufacturer of the other components.

d. Be fully programmable using the Niagara Framework Engineering Tool and must support the following:

(1) Time synchronization, Calendar, and Scheduling using Niagara Scheduling Objects

(2) Alarm generation and routing using the Niagara Alarm Service

(3) Trending using the Niagara History Service and Niagara Trend Log Objects

(4) Integration of field control networks using the Niagara Framework Engineering Tool

(5) Configuration of integrated field control system using the Niagara Framework Engineering Tool when supported by the field control system

e. Meet the following minimum hardware requirements:

(1) One 10/100 Mbps Ethernet Port

(2) One or more MS/TP ports.

f. Provide access to field control network data and supervisory functions via web interface and support a minimum of 16 simultaneous users. Note: implementation of this capability may not be required on all projects.

g. Submit a backup of each Niagara Framework Supervisory Gateway as specified in Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC. The backup must be sufficient to restore a Niagara Framework Supervisory Gateway to the final as-built condition such that a new Niagara Framework Supervisory Gateway loaded with the backup is indistinguishable in functionality from the original.

2.4 NIAGARA FRAMEWORK ENGINEERING TOOL

The Niagara Framework Engineering Tool must be Niagara Workbench or an equivalent Niagara Framework engineering tool software must:

a. Have an unrestricted interoperability license and its Niagara Compatibility Statement (NiCS) must follow the Tridium Open NiCS Specification.

b. Be capable of performing network configuration for Niagara Framework Supervisory Gateways and Niagara Framework Monitoring and Control Software.

c. Be capable of programming and configuring of Niagara Framework Supervisory Gateways and Niagara Framework Monitoring and Control Software.

d. Be capable of discovery of Niagara Framework Supervisory Gateways and all points mapped into each Niagara Framework Supervisory Gateway and making these points accessible to Niagara Framework Monitoring and Control Software.

PART 3 EXECUTION

3.1 CONTROL SYSTEM INSTALLATION3.1.1 Niagara Framework Engineering Tool

Provide a Niagara Framework Engineering Tool.

3.1.2 Building Control Network (BCN)

Install the Building Control Network (BCN) as a single BACnet Internetwork consisting of a single IP network as the BCN Backbone and zero or more BACnet MS/TP networks. Note that in some cases there may only be a single device on the BCN Backbone.

Except for the IP Network and as permitted for the non-BACnet side of Gateways, use exclusively ASHRAE 135 networks.

3.1.2.1 Building Control Network IP Backbone

Install IP Network Cabling in conduit. Install Ethernet Switches in lockable enclosures. Install the Building Control Network (BCN) IP Backbone such that it is available at the Facility Point of Connection (FPOC) location. When the FPOC location is a room number, provide sufficient additional media to ensure that the Building Control Network (BCN) IP Backbone can be extended to any location in the room.

Use UDP port 0xBAC0 for all BACnet traffic on the IP network. (Note that in a Niagara Framework system there may not be BACnet traffic on the IP Network)

3.1.2.2 BACnet MS/TP Networks

When using MS/TP, provide MS/TP networks in accordance with ASHRAE 135 and in accordance with the ASHRAE 135 figure "Mixed Devices on 3-Conductor Cable with Shield" (Figure 9-1.4 in the 2012 version of ASHRAE 135). Ground the shield at the BACnet Router and at no other point. Ground the reference wire at the BACnet Router through a 100 ohm resistor and do not ground it at any other point. In addition:

a. Provide each segment in a doubly terminated bus topology in accordance with TIA-485.

b. Provide each segment with 2 sets of network bias resistors in accordance with ASHRAE 135, with one set of resistors at each end of the MS/TP network.

c. Use 3 wire (twisted pair and reference) with shield media for all MS/TP media installed inside. Use fiber optic isolation in accordance with ASHRAE 135 for all MS/TP media installed outside buildings, or between multiple buildings.

d. For 18 AWG cable, use segments with a maximum length of 4000 ft. When using greater distances or different wire gauges comply with the electrical specifications of TIA-485.

e. For each controller that does not use the reference wire provide transient suppression at the network connection of the controller if the controller itself does not incorporate transient suppression.

f. Install no more than 32 devices on each MS/TP segment. Do not use

MS/TP to MS/TP routers.

g. Connect each MS/TP network to the BCN backbone via a Niagara Framework Supervisory Gateway configured as a BACnet Router.

h. For BACnet Routers, configure the MS/TP MAC address to 0. Assign MAC Addresses to other devices consecutively beginning at 1, with no gaps.

i. Configure the Max_Master Property of all devices to be 31.

3.1.2.3 Building Control Network (BCN) Installation

Provide a building control network meeting the following requirements:

a. Install all DDC Hardware connected to the Building Control Network.

b. Where multiple pieces of DDC Hardware are used to execute one sequence, install all DDC Hardware executing that sequence on a single MS/TP network dedicated to that sequence.

c. Traffic between BACnet networks must be exclusively via BACnet routers.

d. Use the Fox protocol for all traffic both originating and terminating at Niagara Framework components. Use the Fox protocol for all traffic originating or terminating at a Niagara Framework UMCS (including traffic to or from a future UMCS). All other traffic, including traffic between ASHRAE 135 devices and traffic between Niagara Framework Supervisory Gateways and ASHRAE 135 devices must be in accordance with ASHRAE 135.

3.1.3 DDC Hardware

Install all DDC Hardware that connects to an IP network in lockable enclosure. Install other DDC Hardware that is not in suspended ceilings in lockable enclosures. For all DDC hardware with a user interface, coordinate with site to determine proper passwords and configure passwords into device.

a. Except for zone sensors (thermostats), install all Tethered Hardware within 6 feet of its base unit.

b. Install and configure all BTL-Listed devices in a manner consistent with their BTL Listing such that the device as provided still meets all requirements necessary for its BTL Listing.

c. Install and configure all BTL-Listed devices in a manner consistent with the BTL Device Implementation Guidelines such that the device as provided meets all those Guidelines.

3.1.3.1 Device Identifiers, Network Addresses, and IP addresses

a. Do not use any Device Identifier or Network Number already used by another BACnet system at the project site. Coordinate Device IDs and Network Numbers with the installation. The installation POC is Base Control Shops.

3.1.3.2 ASHRAE 135 Object Name Property and Object Description Property

Configure the Object_Names and Object_Descriptions properties of all

ASHRAE 135 Objects (including Device Objects) as indicated on the Points Schedule (Point Name and Point Description) and as specified. At a minimum:

a. Except for DDC Hardware controlling a single terminal unit, configure the Object_Name and Object_Description properties of all Objects (including Device Objects) as indicated on the Points Schedule and as specified.

b. In DDC Hardware controlling a single terminal unit, configure the Device Object_Name and Device Object_Description as indicated on the Points Schedule and as specified.

When Points Schedule entries exceed the length limitations in the device, provide recommended alternatives for approval.

3.1.3.3 Niagara Framework Point Names and Descriptions

Configure the names and descriptions of all Points in Niagara Framework Supervisory Gateways as indicated on the Points Schedule and as specified.

3.1.3.4 Niagara Station IDs

Ensure that Niagara Station IDs of new Niagara Framework Supervisory Gateways are maintained as unique within UMCS front-end, including ensuring they do not conflict with any existing Niagara Station ID.

3.1.3.5 Hand-Off-Auto (H-O-A) Switches

Provide Hand-Off-Auto (H-O-A) switches for all DDC Hardware analog outputs and binary outputs used for control of systems as specified and as indicated on the Points Schedule. Provide H-O-A switches that are integral to the controller hardware, an external device co-located with (in the same enclosure as) the controller, integral to the controlled equipment, or an external device co-located with (in the same enclosure as) the controlled equipment.

a. For H-O-A switches integral to DDC Hardware, meet the requirements specified in paragraph DIRECT DIGITAL CONTROL (DDC) HARDWARE.

b. For external H-O-A switches used for binary outputs, provide for overriding the output open or closed.

c. For eternal H-O-A switches used for analog outputs, provide for overriding through the range of 0 percent to 100 percent.

3.1.3.6 Local Display Panels

Provide LDPs to display and override values of points in a Niagara Framework Supervisory Gateway or ASHRAE 135 Object Properties as indicated on the Points Schedule. Install LDPs displaying points for anything other than a terminal unit in the same room as the equipment. Install LDPs displaying points for only terminal units in a mechanical room central to the group of terminal units it serves. For LDPs using WriteProperty to commandable objects to implement an override, write values with priority 9.

3.1.3.7 MS/TP Slave Devices

Configure all MS/TP devices as Master devices. Do not configure any

devices to act as slave devices.

3.1.3.8 Change of Value (COV) and Read Property

a. To the greatest extent possible, configure all devices to support the SubscribeCOV service (the DS-COV-B BIBB). At a minimum, all devices supporting the DS-RP-B BIBB, other than devices controlling only a single terminal unit, must be configured to support the DS-COV-B BIBB.

b. Whenever supported by the server side, configure client devices to use the DS-COV-A BIBB.

3.1.3.9 Occupancy Modes

Use the following correspondence between value and occupancy mode whenever an occupancy state or value is required:

a. OCCUPIED mode: a value of one
b. UNOCCUPIED mode: a value of two
c. WARM-UP/COOL-DOWN (PRE-OCCUPANCY) mode: a value of three

Note that elsewhere in this Section the Schedule Object is required to also support a value of four, which is reserved for future use. Also note that the behavior of a system in each of these occupancy modes is indicated in the sequence of operation for the system.

3.1.3.10 Use of BACnet Objects

Except as specifically indicated for Niagara Framework Objects, Use only standard non-proprietary ASHRAE 135 Objects and services to accomplish the project scope of work as follows:

a. Use Analog Input or Analog Output Objects for all analog hardware I/O. Do not use Analog Value Object for analog hardware I/O) .

b. Use Binary Input or Binary Output Objects for all binary hardware I/O. Do not use Binary Value Objects for binary hardware I/O.

c. Use Analog Value Objects for analog setpoints.

d. Use Accumulator Objects or Analog Value Objects for pulse inputs.

e. For occupancy modes, use Multistate Value Objects and the correspondence between value and occupancy mode specified in paragraph OCCUPANCY MODES.

f. Use a combination of Niagara Framework Alarm Extensions and Alarm Services, Intrinsic Alarming, and Notification Class Objects for alarm generation.

g. For all other points shown on the Points Schedule as requiring an ASHRAE 135 Object, use the Object type shown on the Points Schedule or, if no Object Type is shown, use a standard Object appropriate to the point.

3.1.3.10.1 Niagara Framework Objects

Points in the Niagara Framework Supervisory Gateway, even if used in a sequence or are shown on the Points Schedule, are not required to be

exposed as BACnet Objects unless they are required to be available on the network by another device or sequence of operation (i.e. there is some other reason they are needed).

Use a Niagara Framework Supervisory Gateway as specified for all scheduling and trending. Use a Niagara Framework Supervisory Gateway as specified for all alarming except for intrinsic alarming.

3.1.3.11 Use of Standard BACnet Services

Except as noted in this paragraph, for all DDC Hardware (including Niagara Frameworks Supervisory Gateways when communicating with non-Niagara Framework DDC Hardware) use Standard BACnet Services as defined in this specification (which excludes some ASHRAE 135 services) exclusively for application control functionality and communication.

DDC Hardware that cannot meet this requirement may use non-standard services provided they can provide identical functionality using Standard BACnet Services when communicating with BACnet devices from a different vendor. When implementing non-standard services, document all non-standard services in the DDC Hardware Schedule as specified and as specified in Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

3.1.3.12 Device Application Configuration

a. For every property, setting or value shown on the Points Schedule or otherwise indicated as Configurable, provide a value that is retained through loss of power and can be changed via one or more of:

(1) BACnet services (including proprietary services)

(2) Hardware settings on the device

(3) The Niagara Framework

b. For every property, setting or value in non-Niagara Framework Hardware shown on the Points Schedule or otherwise indicated as Operator Configurable, provide a value that is retained through loss of power and can be changed via one or more of:

(1) A Writable Property of a standard BACnet Object

(2) A Property of a standard BACnet Object that is Writable when Out_Of_Service is TRUE and Out_Of_Service is Writable.

(3) Using some other method supported by a Niagara Framework Supervisory Gateway

c. Configure Niagara Framework Supervisory Gateways such that the property, setting or value is configurable from a Niagara Framework Front End.

d. For every property, setting or value in a Niagara Framework Supervisory Gateway which is shown on the Points Schedule or otherwise indicated as Operator Configurable, configure the value to be configurable from within the Niagara Framework such that it can be configured from a system graphic page at a Niagara Framework Front End.

3.1.3.13 Niagara Framework Engineering Tool

Use the Niagara Framework Engineering Tool to fully discover the field control system and make all field control system information available to the Niagara Framework Supervisory Gateway. Ensure that all points on the points schedule are available to the front end via the Fox protocol.

3.1.4 Scheduling, Alarming, Trending, and Overrides

3.1.4.1 Scheduling

Configure schedules in Niagara Framework Supervisory Gateway using Niagara Schedule Objects as indicated on the Points Schedule and as specified. When the schedule is controlling occupancy modes in DDC Hardware other than a Niagara Framework Supervisory Gateway use the indicated correspondence between value and occupancy mode.

Provide a separate schedule for each AHU including it's associated Terminal Units and for each stand-alone Terminal Unit (those not dependent upon AHU service) or group of stand-alone Terminal Units acting according to a common schedule.

3.1.4.2 Alarm Configuration

Configure alarm generation and management as indicated on the Points Schedule and as specified. Configure alarm generation in Niagara Framework Supervisory Gateways using Niagara Framework Alarm Extensions and Alarm Services or in other DDC Hardware (not Niagara Framework Supervisory Gateways) using ASHRAE 135 Intrinsic Alarming. Configure alarm management and routing for all alarms, including those generated via intrinsic alarming in other devices, in the Niagara Framework Supervisory Gateway such that the alarms are able to be accessed from the Niagara Framework Front End.

Where Intrinsic Alarming is used, configure intrinsic alarming as specified in paragraph "Configuration of ASHRAE 135 Intrinsic Alarm Generation". Configure a Niagara Framework Supervisory Gateway to provide a means to configure the intrinsic alarm parameters such that the Intrinsic Alarm is configurable from the front end via the Niagara Framework.

3.1.4.3 Configuration of ASHRAE 135 Intrinsic Alarm Generation

Intrinsic alarm generation must meet the following requirements:

Configure alarm generation as indicated on the Points Schedule and as specified using Intrinsic Alarming in accordance with ASHRAE 135 or Algorithmic Alarming in accordance with ASHRAE 135. Alarm generation must meet the following requirements:

a. Send alarm events as Alarms (not Events).

b. Use the ConfirmedNotification Service for alarm events.

c. For alarm generation, support two priority levels for alarms: critical and non-critical. Configure the Priority of Notification Class Objects to use Priority 112 for critical and 224 for non-critical alarms.

d. Number of Notification Class Objects for Alarm Generation:

(1) If the device implements non-critical alarms, or if any Object in the device supports Intrinsic Alarms, then provide a single Notification Class Object specifically for (shared by) all non-critical alarms.

(2) If the device implements critical alarms, provide a single Notification Class Object specifically for (shared by) all critical alarms.

(3) If the device implements both critical and non-critical alarms, provide both Notification Class Objects (one for critical, one for non-critical).

(4) If the device controls equipment other than a single terminal unit, provide both Notification Class Objects (one for critical, one for non-critical) even if no alarm generation is required at time of installation.

e. For all intrinsic alarms configure the Limit_Enable Property to set both HighLimitEnable and LowLimitEnable to TRUE. If the specified alarm conditions are for a single-sided alarm (only High_Limit used or only Low_Limit used) assign a value to the unused limit such that the unused alarm condition will not occur.

f. For all objects supporting intrinsic alarming, even if no alarm generation is required during installation, configure the following Properties as follows:

(1) Notification_Class to point to the non-Critical Notification Class Object in that device.

(2) Limit_Enable to enable both the HighLimitEnable and LowLimitEnable

(3) Notify_Type to Alarm

g. Configure the Recipient_List Property of the Notification Class Object to point to the Niagara Framework Supervisory Gateway managing the alarm.

3.1.4.4 Trending

Perform all trending using a Niagara Framework Supervisory Gateway using Niagara Framework History Extensions and Niagara Framework History Service exclusively.

3.1.4.5 Overrides

Provide an override for each point shown on the Points Schedule as requiring an override. Use the Niagara Framework for all overrides to points in Niagara Framework Supervisory Gateways. For overrides to other points, provide an override to a point in a Niagara Framework Supervisory Gateway via the Niagara Framework where the Niagara Framework Supervisory Gateway overrides the other point as specified.

Unless otherwise approved, provide Commandable Objects to support all Overrides in non-Niagara Framework Supervisory Gateway DDC Hardware. With specific approval from the Contracting Officer, Overrides for points which are not hardware outputs and which are in DDC hardware controlling a

single terminal unit may support overrides via an additional Object provided for the override. No other means of implementing Overrides may be used.

a. Where Commandable Objects are used, ensure that WriteProperty service requests with a Priority of 10 or less take precedence over the SEQUENCE VALUE and that WriteProperty service request with a priority of 11 or more have a lower precedence than the SEQUENCE VALUE.

b. For devices implementing overrides via additional Objects, provide Objects which are NOT Written to as part of the normal Sequence of Operations and are Writable when Out_Of_Service is TRUE and Out_Of_Service is Writable. Use this point as an Override of the normal value when Out_Of_Service is TRUE and the normal value otherwise. Note these Objects may be modified as part of the sequence via local processes, but must not be modified by local processes when Out_Of_Service is TRUE.

3.1.5 BACnet Gateways

The requirements in this paragraph do not themselves permit the installation of hardware not meeting the other requirements of this section. Except for proprietary systems specifically indicated in Section 23 09 00, all control hardware installed under this project must meet the requirements of this specification, including the control hardware providing the network interface for a package unit or split system specified under another section. Only use gateways to connect to pre-existing control devices, and to proprietary systems specifically permitted by Section 23 09 00.

3.1.5.1 General Gateway Requirements

Provide BACnet Gateways to connect non-BACnet control hardware in accordance with the following:

a. Configure gateways to map writable data points in the controlled equipment to Writable Properties of Standard Objects, or to Niagara Framework points, as indicated in the Points Schedule and as specified.

b. Configure gateway to map readable data points in the controlled equipment to Readable Properties of Standard Objects, or to Niagara Framework points, as indicated in the Points Schedule and as specified.

c. Configure gateway to support the DS-COV-B BIBB for all points mapped to BACnet Objects.

d. Do not use non-BACnet control hardware for controlling built-up units or any other equipment that was not furnished with factory-installed controls. (Note: A Niagara Framework Supervisory Gateway is BACnet control hardware.)

e. Do not use non-BACnet control hardware for system scheduling functions.

f. Each gateway must communicate with and perform protocol translation for non-BACnet control hardware controlling one and only one package unit or a single non-BACnet system specifically permitted by Section 23 09 00.

g. Connect one network port on the gateway to the Building Control

Backbone IP Network or to a BACnet MS/TP network and the other port to the single piece of controlled equipment or the non-BACnet system specifically permitted by Section 23 09 00..

h. For gateways to existing package units or simple split systems, non-BACnet network wiring connecting the gateway to the package unit must not exceed 10 feet in length and must connect to exactly two devices: the controlled equipment (packaged unit) or split system interface and the gateway.

-- End of Section --

SECTION 23 21 23

HYDRONIC PUMPS
08/17

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B1.1	(2003; R 2018) Unified Inch Screw Threads (UN and UNR Thread Form)

ASTM INTERNATIONAL (ASTM)

ASTM A123/A123M	(2017) Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products
ASTM A307	(2021) Standard Specification for Carbon Steel Bolts, Studs, and Threaded Rod 60 000 PSI Tensile Strength

HYDRAULIC INSTITUTE (HI)

HI 1.1-1.2	(2014) Rotodynamic (Centrifugal) Pump for Nomenclature and Definitions
HI 1.3	(2013) Rotodynamic (Centrifugal) Pump Applications
HI 9.6.4	(2009) Rotodynamic Pumps for Vibration Analysis and Allowable Values
HI ANSI/HI 2.1-2.2	(2014) Rotodynamic Vertical Pumps of Radial, Mixed, and Axial Flow Types for Nomenclature and Definitions
HI ANSI/HI 9.6.3	(2017) Rotodynamic Pumps - Guideline for Operating Regions - B120
HI ANSI/HI 14.6	(2011) Rotodynamic Pumps for Hydraulic Performance Acceptance Tests - A136

INTERNATIONAL CODE COUNCIL (ICC)

ICC IGCC	(2018) International Green Construction Code

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA MG 1	(2018) Motors and Generators

NEMA Z535.4	(2011; R 2017) Product Safety Signs and Labels

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code

NSF INTERNATIONAL (NSF)

NSF 372	(2016) Drinking Water System Components - Lead Content

SOCIETY FOR PROTECTIVE COATINGS (SSPC)

SSPC Paint 21	(1982; E 2004) White or Colored Silicone Alkyd Paint (Type I, High Gloss and Type II, Medium Gloss)
SSPC Paint 25	(1997; E 2004) Zinc Oxide, Alkyd, Linseed Oil Primer for Use Over Hand Cleaned Steel, Type I and Type II

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

29 CFR 1910.219	Mechanical Power Transmission Apparatus

UNDERWRITERS LABORATORIES (UL)

UL 778	(2016; Reprint Jun 2021) UL Standard for Safety Motor-Operated Water Pumps

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

System Coordination; G

SD-03 Product Data

Instructions; G

Equipment Data; G

Training Period; G

SD-06 Test Reports

Factory Tests

Field Quality Control

SD-07 Certificates

Manufacturer's Representative

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals; G

Training; G

1.3 QUALITY ASSURANCE

1.3.1 Manufacturer Services

Provide the services of a manufacturer's representative experienced in the installation, adjustment, and operation of the equipment specified. The representative must supervise the installation, adjustment, testing of the equipment, and conduct training.

Submit the names and qualifications of the manufacturer's representative and training engineers and written certification from the manufacturer that the representative and trainers are technically qualified.

1.3.2 Standard Products

Provide material and equipment which are the standard products of a manufacturer regularly engaged in the manufacture of such products and that essentially duplicate equipment that has been in satisfactory HVAC operation at least 2 years prior to issuance of this solicitation. Support equipment with a service organization that is reasonably convenient to the jobsite. Pumps and motors of the same types must each be the product of one manufacturer.

1.3.3 Conformance with Agency Requirements

Where materials or equipment are specified to be an approved type, attach the seal or label of approval from a nationally recognized testing agency, adequately equipped and competent to perform such services. A written certificate from the testing agency must accompany the materials or equipment and be submitted stating that the items have been tested and that they conform to the applicable requirements of the specifications and to the standards listed herein. The certificate must indicate the methods of testing used by the testing agency. In lieu of a certificate from a testing agency, published catalog specification data, accompanied by the manufacturer's certified statement to the effect that the items are in accordance with the applicable requirements of the specifications and the referenced standards, will be considered and may be acceptable as evidence that the items conform with agency requirements.

1.4 DELIVERY, STORAGE, AND HANDLING

Protect equipment, delivered and designated for storage, from the weather, humidity and temperature variations, dirt and dust, or other contaminants.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Hydronic pumps used for heating and air conditioning applications are

defined by the type of impeller, number of impellers, type of casing, method of connection to the driver, and mounting position. Provide centrifugal water pumps of the types indicated and specified. Use an electric motor driving unit for each pump as indicated and specified.

2.1.1 Selection Criteria

Select pumps at a point within the maximum efficiency for a given impeller casing combination. Deviations within 3 percent of maximum efficiency are permissible, provided the lesser efficiency is not less than the scheduled efficiency in the construction design documents. Pumps having impeller diameters larger or smaller than manufacturer's published maximum and minimum impeller diameters for a given impeller casing combination will be rejected. Pump performance data, as shown in performance curves, must be based on factory tests using precision instrumentation and exacting procedures as detailed in HI ANSI/HI 14.6.

2.1.2 System Coordination

Submit drawings containing complete wiring and piping schematic diagrams and any other details required to demonstrate that the system has been coordinated and will properly function as a unit. Show the proposed layout and anchorage of equipment and appurtenances, and equipment relationship to other parts of the work including clearances for maintenance and operation. Provide a complete listing of equipment, materials and miscellaneous components including mechanical seals, bearings, and couplings.

2.1.3 Safety Requirements

Fully enclose or guard couplings, projecting set-screws, keys, and other rotating parts, that pose an entangling hazards..

2.2 MATERIALS AND EQUIPMENT

2.2.1 Nameplates

Securely affix a standard nameplate to pumps and motors in a conspicuous place showing the manufacturer's name, address, type or style, model, serial number, and catalog number. In addition, for each pump show the capacity in gpm at rated speed in rpm and total head in feet of water. For each electric motor show at least the minimum information required by NEMA MG 1. Show such other information as the manufacturer may consider necessary to complete identification on the nameplate. Pumps must be listed and labeled by UL, and comply with UL 778 for pumps not using universal motors rated more than 250 volts such as circulating pumps.

2.2.2 Framed Instructions

Submit proposed diagrams, instructions, and other sheets, prior to posting. Post approved wiring and control diagrams showing the complete layout of the entire system, including equipment, piping valves, and control sequence, framed under glass or in approved laminated plastic, where directed. Provide condensed operating instructions explaining preventive maintenance procedures, methods of checking the system for normal safe operation, and procedures for safely starting and stopping the system, framed as specified above for the wiring and control diagrams, and posted beside the diagrams. Post the framed instructions before acceptance testing of the systems.

2.2.3 Pump Characteristic

Construct hydronic water pumps in accordance with HI 1.1-1.2 and HI ANSI/HI 2.1-2.2. The pumps must be capable of discharging quantities at total discharge heads measured at the discharge flange, between the following limits:

Operate pumps at optimum efficiencies to produce the most economical pumping system under the conditions encountered and size to make optimum match with the system head curve as shown. Pumps must furnish not less than 150 percent of rated capacity at a total discharge head of not less than 65 percent of total rated head. The shutoff total head must not be greater than 120 percent of total rated head. Operate pumps at specified system fluid temperatures without vapor binding and cavitation. Operate pumps to HI ANSI/HI 9.6.3 standard for Preferred Operationg Region (POR).

2.2.4 Pump Drivers

Provide electric motors as indicated for each pump and in compliance with Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

2.2.5 Equipment Data

Submit manufacturer's descriptive data and technical literature, performance charts and curves for all impeller sizes for a given casing, catalog cuts, and installation instructions. Provide spare parts data for each different item of material and equipment specified, after approval of the detail drawings and not later than 1 months prior to the date of beneficial occupancy. Include a complete list of parts and supplies, with current unit prices and local source of supply with contact information.

Submit catalog information, certified pumps curves, rated capacities, final impeller dimensions, and accessories provided for the product indicated. Indicate operating point of each pump on curves. Furnish pump curves for each pump and combination of pumps designed to operate in parallel. The pump curve must show as a minimum; bhp, flow, total dynamic head, efficiency, NPSH, impeller diameter and system curve (individually and in combination for each pump operating in a parallel application). Select pumps operating in parallel operation to cross the system curve when operating individually.

2.3 HYDRONIC PUMPS

Provide centrifugal, designed for HVAC service in the following configurations:

Configuration	Pump No.
Circulator	CP-1
Base-Mounted, Close Coupled, End Suction	CHWP-1 & CHWP-2

2.3.1 Circulator

Provide pumps with capacities as indicated of a horizontal, in-line, three piece oil lubricated or wet rotor circulator type specifically designed

for quiet operation. Suitable for 225 degrees F operation at 125 psig working pressure. The pump must be single stage with flanged or union piping connections. The pump internals must be capable of being serviced without disturbing piping connections.

a. The three piece pump must be composed of three separable components a motor, bearing assembly, and cast iron lead free bronze certified in accordance with NSF 372 pump end (wet end). The motor shaft must be connected to the pump shaft via a replaceable flexible coupler.

b. Wet rotor circulator for potable water service must be lead content certified in accordance with NSF 372.

2.3.1.1 Seal Assembly

Pump must be equipped with an internally flushed mechanical seal assembly. Seal assembly must have a brass housing, Buna bellows and seat gasket, stainless steel spring, and be of a carbon ceramic design with the carbon face rotating against a stationary ceramic face.

2.3.1.2 Motor Mount

To ensure alignment, mount the motor to the bearing assembly via a bolted motor bracket assembly. Use a replaceable resilient rubber motor mount to assist in aligning the motor shaft with the pump shaft.

2.3.1.3 Motors

Motors must meet scheduled horsepower, speed, voltage, and enclosure design. Motors must be drip proof, maintenance free, premium efficiency and meet NEMA MG 1 specifications.

2.3.2 Base-Mounted, Close Coupled, End Suction

Provide pumps with capacities as indicated. Pump must be base mounted, close coupled, single stage, end suction design capable of being serviced without disturbing piping connections.

2.3.2.1 Casing

Provide pump volute of Class 30 cast iron suitable for 175 psig working pressure. Include vent, drain and gauge tappings.

2.3.2.2 Seal Assembly

Seal off the liquid cavity at the motor shaft by an internally flushed mechanical seal or a positive pressure external seal flushing line with ceramic seal seat and carbon seal ring, suitable for continuous operation at 225 degrees F. A replaceable shaft sleeve of bronze alloy must completely cover the wetted area under the seal.

2.3.2.3 Impeller

Provide cast bronze or 304 stainless steel impeller, enclosed type, hydraulically and dynamically balanced to HI 9.6.4 balance grade G6.3, keyed to shaft and secured by a locking capscrew.

2.3.2.4 Motor

Electric Motors must comply with NEMA MG 1 and be the horsepower, and voltage indicated. Motor enclosure must be totally enclosed fan cooled. provide with heavy duty grease lubricated ball bearings completely adequate for the maximum load for which the motor and pump impeller is designed. Motor must be non-overloading at any point on the pump curve and premium efficiency. Provide motor efficiencies as shown in the ICC IGCC standard. Totally enclosed fan cooled motor efficiencies must be as shown in NEMA MG 1.

2.3.3 Cooling Coil Condensate Pump Units

Provide pumps with capacities as indicated. Cooling Coil Condensate Pump Unit must be a packaged unit including a corrosion-resistant pump, plastic tank with cover, and automatic controls. Include field installed check valve and a 72 inch minimum, electrical power cord with plug for 120V/1PH/60HZ electrical service.

2.3.3.1 Motor

Electric motor must comply with NEMA MG 1 and be the size, voltage and enclosure indicated. Provide heavy duty grease lubricated ball bearings completely adequate for the maximum load for which the motor is designed.

2.4 ELECTRICAL WORK

Provide electrical motor driven equipment specified herein complete with motors, motor starters, and controls. Provide electric equipment and wiring in accordance with Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Electrical characteristics must be as indicated. Provide motor starters complete with properly sized thermal overload protection in each phase and other appurtenances necessary for the motor control specified. Each motor must be of sufficient capacity to drive the equipment at the specified capacity without exceeding the nameplate rating of the motor when operating at proper electrical system voltage and frequency. Manual or automatic control and protective or signal devices required for the operation herein specified and any control wiring required for controls and devices but not indicated must be provided under this section of the specifications.

2.5 ELECTRICAL EQUIPMENT

Provide electrical equipment in conformance with Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Provide electrical motor driven equipment herein specified complete with motors, motor starters, and controls. Motor controls, equipment, and wiring must be in accordance with NFPA 70.

2.5.1 Electric Motors

Drive each electric motor-driven pump by a continuous-duty electric motor with enclosure type for specific service as defined in paragraph HYDRONIC PUMPS. Motor must have a 1.5 service factor. Provide synchronous motors having normal-starting-torque and low-starting-current characteristics, and of sufficient size so that the nameplate horsepower rating will not be exceeded throughout the entire published pump characteristic curve. Integral size motors must be the premium efficiency type in accordance with NEMA MG 1. Pump electric motor efficiencies must meet or exceed the requirements of the ICC IGCC standard. Motor bearings must provide smooth

operations under the conditions encountered for the life of the motor. Provide adequate thrust bearing in the motor to carry the weight of all rotating parts plus the hydraulic thrust and be capable of withstanding upthrust imposed during pump starting and under variable pumping head conditions specified. Motors must be rated as scheduled volts, as scheduled phase, 60 Hz and such rating must be stamped on the nameplate. Provide motors in conformance with NEMA MG 1.

2.5.2 Control Equipment

Automatically controlled pumps must have three-position "MANUAL-OFF-AUTOMATIC" selector switch in cover. Provide additional controls or protective devices as indicated. Install a pump low-water cutoff on the suction pipe and must shut the pump off when the water level in the well reaches the level shown.

2.6 EQUIPMENT APPURTENANCES

2.6.1 Attachments

Furnish all necessary bolts, nuts, washers, bolt sleeves, and other types of attachments with the equipment for the installation of the equipment. Bolts conform to the requirements of ASTM A307 and hexagonal nuts of the same quality as the bolts used. Threads must be clean-cut and conform to ASME B1.1. Bolts, nuts, and washers specified to be galvanized or not otherwise indicated or specified, must be zinc coated after being threaded, by the hot-dip process conforming to ASTM A123/A123M as appropriate. Bolts, nuts, and washers specified or indicated to be stainless steel must be Type 316.

2.6.2 Equipment Guards

Provide equipment driven by open shafts, belts, chains, or gears with all-metal guards enclosing the drive mechanism. Secure guards in position with steel braces or straps that permit easy removal for servicing the equipment. Coupler guards must comply with current national safety standards including 29 CFR 1910.219 and NEMA Z535.4. Provide guards with gaps no greater than 0.250 inches, safety orange in color, and have an NEMA Z535.4 compliant warning label.

2.6.3 Tools

Furnish a complete set of all special tools which may be necessary for the adjustment, operation, maintenance, and disassembly of all equipment. Special tools are considered to be those tools which because of their limited use are not normally available, but which are necessary for the particular equipment. Special tools must be high-grade, smooth, forged, alloy, tool steel. Furnish one pressure grease gun for each type of grease required. Deliver all tools at the same time as the equipment to which they pertain. Properly store and safeguard such tools until completion of the work, at which time deliver them to the Contracting Officer.

2.7 FINISHES

All motors, pump casings, and similar parts of equipment must be thoroughly cleaned, primed, and given two finish coats of paint at the factory in accordance with the recommendations of the manufacturer. Give ferrous surfaces not to be painted a shop coat of grease or other suitable

rust-resistant coating.

2.8 FACTORY TESTS

Pumps must be tested by the manufacturer or a nationally recognized testing agency in compliance with HI 1.3. Submit certified test results.

PART 3 EXECUTION

3.1 EXAMINATION

After becoming familiar with all details of the work, verify all dimensions in the field and advise the Contracting Officer of any discrepancy before performing the work.

3.2 INSTALLATION

Install each pump and motor in accordance with the written instructions of the manufacturer and under the direct supervision of the manufacturer's representative. Provide access space around the device for servicing no less than the minimum recommended by the manufacturer.

3.3 FIELD QUALITY CONTROL

After installation of the pumping units and appurtenances, including coupling guard, is complete, carry out operating tests to assure that the pumping installation operates properly. Make arrangements to have the manufacturer's representatives present when field equipment tests are made. Give each pumping unit a running field test in the presence of the Contracting Officer for a minimum of 2 hours. Operate each pumping unit at its rated capacity or such other point on its head-capacity curve selected by the Contracting Officer. Provide an accurate and acceptable method of measuring the discharge flow. Tests must assure that the units and appurtenances have been installed correctly, that there is no objectionable heating, vibration, or noise from any parts, and that all manual and automatic controls function properly. If any deficiencies are revealed during any tests, correct such deficiencies and reconduct the tests.

Submit test reports in booklet form showing all field tests performed to adjust each component and all field tests performed to prove compliance with the specified performance criteria, upon completion and testing of the installed system. Each test report must indicate the final position of controls.

3.4 FIELD PAINTING

Do not paint stainless steel, galvanized steel, and nonferrous surfaces.

3.4.1 Touch-up painting

Factory painted items requiring touching up in the field must be thoroughly cleaned of all foreign material, and primed and topcoated with the manufacturer's standard factory finish.

3.4.2 Exposed Ferrous Surfaces

Paint exposed ferrous surfaces with two coats of enamel paint conforming to SSPC Paint 21. Solvent clean factory primed surfaces before painting.

Surfaces that have not been factory primed must be prepared and primed with one coat of SSPC Paint 25 or in accordance with the enamel paint manufacturer's recommendations.

3.5 CLOSEOUT ACTIVITIES

3.5.1 Operation and Maintenance Manuals

Submit one complete set at the time the tests procedure is submitted; remaining sets before the contract is completed. Permanently bind each in a hard cover. Inscribe the following identification on the covers: the words "OPERATING AND MAINTENANCE INSTRUCTIONS," name and location of the building, name of the Contractor, and contract number. Place flysheets before instructions covering each subject. Use 8-1/2 by 11 inches paper for instruction sheets, with large sheets of drawings folded in.

Include, but do not limit to, the following in the Instructions:

a. System layout showing piping, valves, and controls.

b. Approved wiring and control diagrams including variable frequency drives.

c. A control sequence describing startup, operation, and shutdown.

d. Operating and maintenance instructions for each piece of equipment, including task list for routine maintenance, routine inspections, intermediate inspections, and annual inspections; lubrication instructions; and troubleshooting guide.

e. Manufacturer's bulletins, cuts, and descriptive data; and parts list and recommended spare parts.

3.5.2 Training

Upon completion of the work, and at a time designated by the Contracting Officer, provide the services of one or more competent engineers for a training period of not less than 8 hours to instruct a representative of the Government in the contents of the operation and maintenance manuals for the equipment furnished under these specifications. These field instructions must cover all the items contained in the bound instructions. Submit the training course curriculum and training instructions 14 days prior to the start of training.

-- End of Section --

SECTION 23 23 00

REFRIGERANT PIPING
10/07

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR-CONDITIONING, HEATING AND REFRIGERATION INSTITUTE (AHRI)

AHRI 710 I-P	(2009) Performance Rating of Liquid-Line Driers
AHRI 720	(2002) Refrigerant Access Valves and Hose Connectors
AHRI 750 I-P	(2016) Performance Rating of Thermostatic Refrigerant Expansion Valves
ANSI/AHRI 760	(2007) Performance Rating of Solenoid Valves for Use With Volatile Refrigerants

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 15 & 34	(2013) ASHRAE Standard 34-2016 Safety Standard for Refrigeration Systems/ASHRAE Standard 34-2016 Designation and Safety Classification of Refrigerants-ASHRAE Standard 34-2016
ASHRAE 17	(2015) Method of Testing Capacity of Thermostatic Refrigerant Expansion Valves

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B1.20.1	(2013; R 2018) Pipe Threads, General Purpose (Inch)
ASME B16.3	(2021) Malleable Iron Threaded Fittings, Classes 150 and 300
ASME B16.5	(2020) Pipe Flanges and Flanged Fittings NPS 1/2 Through NPS 24 Metric/Inch Standard
ASME B16.9	(2018) Factory-Made Wrought Buttwelding Fittings
ASME B16.11	(2016) Forged Fittings, Socket-Welding and Threaded
ASME B16.21	(2021) Nonmetallic Flat Gaskets for Pipe

Flanges

ASME B16.22 (2018) Standard for Wrought Copper and Copper Alloy Solder Joint Pressure Fittings

ASME B16.26 (2018) Standard for Cast Copper Alloy Fittings for Flared Copper Tubes

ASME B31.1 (2020) Power Piping

ASME B31.5 (2020) Refrigeration Piping and Heat Transfer Components

ASME B31.9 (2020) Building Services Piping

ASME B40.100 (2013) Pressure Gauges and Gauge Attachments

AMERICAN WELDING SOCIETY (AWS)

AWS A5.8/A5.8M (2019) Specification for Filler Metals for Brazing and Braze Welding

AWS BRH (2007; 5th Ed) Brazing Handbook

AWS D1.1/D1.1M (2020) Structural Welding Code - Steel

AWS Z49.1 (2012) Safety in Welding and Cutting and Allied Processes

ASTM INTERNATIONAL (ASTM)

ASTM A53/A53M (2022) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless

ASTM A193/A193M (2020) Standard Specification for Alloy-Steel and Stainless Steel Bolting Materials for High-Temperature Service and Other Special Purpose Applications

ASTM A653/A653M (2020) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

ASTM B32 (2020) Standard Specification for Solder Metal

ASTM B62 (2017) Standard Specification for Composition Bronze or Ounce Metal Castings

ASTM B75/B75M (2020) Standard Specification for Seamless Copper Tube

ASTM B117 (2019) Standard Practice for Operating Salt Spray (Fog) Apparatus

ASTM B280 (2020) Standard Specification for Seamless

	Copper Tube for Air Conditioning and Refrigeration Field Service
ASTM B813	(2016) Standard Specification for Liquid and Paste Fluxes for Soldering of Copper and Copper Alloy Tube
ASTM D520	(2000; R 2011) Zinc Dust Pigment
ASTM D3308	(2012; R 2017) Standard Specification for PTFE Resin Skived Tape
ASTM E84	(2020) Standard Test Method for Surface Burning Characteristics of Building Materials

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY (MSS)

MSS SP-58	(2018) Pipe Hangers and Supports - Materials, Design and Manufacture, Selection, Application, and Installation

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Refrigerant Piping System; G

SD-03 Product Data

Refrigerant Piping System
Qualifications
Refrigerant Piping Tests

SD-06 Test Reports

Refrigerant Piping Tests

SD-10 Operation and Maintenance Data

Maintenance; G
Operation and Maintenance Manuals; G

1.3 QUALITY ASSURANCE

1.3.1 Qualifications

Submit 2 copies of qualified procedures, and list of names and identification symbols of qualified welders and welding operators, prior to non-factory welding operations.

1.3.2 Contract Drawings

Because of the small scale of the drawings, it is not possible to indicate all offsets, fittings, and accessories that may be required. Carefully investigate the plumbing, fire protection, electrical, structural and finish conditions that would affect the work to be performed and arrange such work accordingly, furnishing required offsets, fittings, and accessories to meet such conditions.

1.4 DELIVERY, STORAGE, AND HANDLING

Protect stored items from the weather, humidity and temperature variations, dirt and dust, or other contaminants. Proper protection and care of all material both before and during installation is the Contractor's responsibility. Replace any materials found to be damaged at the Contractor's expense. During installation, cap piping and similar openings to keep out dirt and other foreign matter.

1.5 MAINTENANCE

1.5.1 General

Submit Data Package 2 plus operation and maintenance data complying with the requirements of Section 01 78 23 OPERATION AND MAINTENANCE DATA and as specified herein.

PART 2 PRODUCTS

2.1 STANDARD COMMERCIAL PRODUCTS

a. Provide materials and equipment which are standard products of a manufacturer regularly engaged in the manufacturing of such products, that are of a similar material, design and workmanship and that have been in satisfactory commercial or industrial use for 2 years prior to bid opening.

b. The 2 year use shall include applications of equipment and materials under similar circumstances and of similar size. The 2 years experience shall be satisfactorily completed by a product which has been sold or is offered for sale on the commercial market through advertisements, manufacturer's catalogs, or brochures. Products having less than a 2 year field service record will be acceptable if a certified record of satisfactory field operation, for not less than 6000 hours exclusive of the manufacturer's factory tests, can be shown.

c. Products shall be supported by a service organization. System components shall be environmentally suitable for the indicated locations. Submit a certified list of qualified permanent service organizations for support of the equipment which includes their addresses and qualifications. The service organizations shall be reasonably convenient to the equipment installation and be able to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

d. Exposed equipment moving parts, parts that produce high operating temperature, parts which may be electrically energized, and parts that may be a hazard to operating personnel shall be insulated, fully enclosed, guarded, or fitted with other types of safety devices. Install safety devices so that proper operation of equipment is not

impaired. Welding and cutting safety requirements shall be in accordance with AWS Z49.1.

e. Manufacturer's standard catalog data, at least 2 weeks prior to the purchase or installation of a particular component, highlighted to show material, size, options, performance charts and curves, etc. in adequate detail to demonstrate compliance with contract requirements. Include in the data manufacturer's recommended installation instructions and procedures. Provide data for the following components as a minimum:

(1) Piping and Fittings
(2) Valves
(3) Piping Accessories
(4) Pipe Hangers, Inserts, and Supports

2.2 ELECTRICAL WORK

Electrical equipment and wiring shall be in accordance with Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Field wiring shall be in accordance with manufacturer's instructions.

2.3 REFRIGERANT PIPING SYSTEM

Refrigerant piping, valves, fittings, and accessories shall be in accordance with ASHRAE 15 & 34 and ASME B31.5, except as specified herein. Refrigerant piping, valves, fittings, and accessories shall be compatible with the fluids used and capable of withstanding the pressures and temperatures of the service. Refrigerant piping, valves, and accessories used for refrigerant service shall be cleaned, dehydrated, and sealed (capped or plugged) prior to shipment from the manufacturer's plant. Submit drawings, at least 2 weeks prior to beginning construction, provided in adequate detail to demonstrate compliance with contract requirements. Drawings shall consist of:

a. Piping layouts which identify all valves and fittings.

b. Plans and elevations which identify clearances required for maintenance and operation.

2.4 PIPE, FITTINGS AND END CONNECTIONS (JOINTS)

2.4.1 Steel Pipe

Steel pipe for refrigerant service shall conform to ASTM A53/A53M, Schedule 40, Type E or S, Grades A or B. Type F pipe shall not be used.

2.4.1.1 Welded Fittings and Connections

Butt-welded fittings shall conform to ASME B16.9. Socket-welded fittings shall conform to ASME B16.11. Welded fittings shall be identified with the appropriate grade and marking symbol. Welded valves and pipe connections (both butt-welds and socket-welds types) shall conform to ASME B31.9.

2.4.1.2 Threaded Fittings and Connections

Threaded fitting shall conform to ASME B16.3. Threaded valves and pipe connections shall conform to ASME B1.20.1.

2.4.1.3 Flanged Fittings and Connections

Flanges shall conform to ASME B16.5, Class 150. Gaskets shall be nonasbestos compressed material in accordance with ASME B16.21, 1/16 inch thickness, full face or self-centering flat ring type. This gaskets shall contain aramid fibers bonded with styrene butadeine rubber (SBR) or nitrile butadeine rubber (NBR). Bolts, nuts, and bolt patterns shall conform to ASME B16.5. Bolts shall be high or intermediate strength material conforming to ASTM A193/A193M.

2.4.2 Copper Tubing

Copper tubing shall conform to ASTM B280 annealed or hard drawn as required. Copper tubing shall be soft annealed where bending is required and hard drawn where no bending is required. Soft annealed copper tubing shall not be used in sizes larger than 1-3/8 inches. Joints shall be brazed except that joints on lines 7/8 inchand smaller may be flared. Cast copper alloy fittings for flared copper tube shall conform to ASME B16.26 and ASTM B62. Wrought copper and bronze solder-joint pressure fittings shall conform to ASME B16.22 and ASTM B75/B75M. Joints and fittings for brazed joint shall be wrought-copper or forged-brass sweat fittings. Cast sweat-type joints and fittings shall not be allowed for brazed joints. Brass or bronze adapters for brazed tubing may be used for connecting tubing to flanges and to threaded ends of valves and equipment.

2.4.3 Solder

Solder shall conform to ASTM B32, grade Sb5, tin-antimony alloy for service pressures up to 150 psig. Solder flux shall be liquid or paste form, non-corrosive and conform to ASTM B813.

2.4.4 Brazing Filler Metal

Filler metal shall conform to AWS A5.8/A5.8M, Type BAg-5 with AWS Type 3 flux, except Type BCuP-5 or BCuP-6 may be used for brazing copper-to-copper joints.

2.5 VALVES

Valves shall be designed, manufactured, and tested specifically for refrigerant service. Valve bodies shall be of brass, bronze, steel, or ductile iron construction. Valves 1 inch and smaller shall have brazed or socket welded connections. Valves larger than 1 inch shall have butt welded end connections. Threaded end connections shall not be used, except in pilot pressure or gauge lines where maintenance disassembly is required and welded flanges cannot be used. Internal parts shall be removable for inspection or replacement without applying heat or breaking pipe connections. Valve stems exposed to the atmosphere shall be stainless steel or corrosion resistant metal plated carbon steel. Direction of flow shall be legibly and permanently indicated on the valve body. Control valve inlets shall be fitted with integral or adapted strainer or filter where recommended or required by the manufacturer. Purge, charge and receiver valves shall be of manufacturer's standard configuration.

2.5.1 Refrigerant Stop Valves

Valve shall be the globe or full-port ball type with a back-seating stem

especially packed for refrigerant service. Valve packing shall be replaceable under line pressure. Valve shall be provided with a wrench operator and a seal cap. Valve shall be the straight or angle pattern design as indicated.

2.5.2 Check Valves

Valve shall be the swing or lift type as required to provide positive shutoff at the differential pressure indicated. Valve shall be provide with resilient seat.

2.5.3 Liquid Solenoid Valves

Valves shall comply with ANSI/AHRI 760 and be suitable for continuous duty with applied voltages 15 percent under and 5 percent over nominal rated voltage at maximum and minimum encountered pressure and temperature service conditions. Valves shall be direct-acting or pilot-operating type, packless, except that packed stem, seal capped, manual lifting provisions shall be furnished. Solenoid coils shall be moisture-proof, UL approved, totally encapsulated or encapsulated and metal jacketed as required. Valves shall have safe working pressure of 400 psi and a maximum operating pressure differential of at least 200 psi at 85 percent rated voltage. Valves shall have an operating pressure differential suitable for the refrigerant used.

2.5.4 Expansion Valves

Valve shall conform to AHRI 750 I-P and ASHRAE 17. Valve shall be the diaphragm and spring-loaded type with internal or external equalizers, and bulb and capillary tubing. Valve shall be provided with an external superheat adjustment along with a seal cap. Internal equalizers may be utilized where flowing refrigerant pressure drop between outlet of the valve and inlet to the evaporator coil is negligible and pressure drop across the evaporator is less than the pressure difference corresponding to 2 degrees F of saturated suction temperature at evaporator conditions. Bulb charge shall be determined by the manufacturer for the application and such that liquid will remain in the bulb at all operating conditions. Gas limited liquid charged valves and other valve devices for limiting evaporator pressure shall not be used without a distributor or discharge tube or effective means to prevent loss of control when bulb becomes warmer than valve body. Pilot-operated valves shall have a characterized plug to provide required modulating control. A de-energized solenoid valve may be used in the pilot line to close the main valve in lieu of a solenoid valve in the main liquid line. An isolatable pressure gauge shall be provided in the pilot line, at the main valve. Automatic pressure reducing or constant pressure regulating expansion valves may be used only where indicted or for constant evaporator loads.

2.5.5 Safety Relief Valves

Valve shall be the two-way type, unless indicated otherwise. Valve shall bear the ASME code symbol. Valve capacity shall be certified by the National Board of Boiler and Pressure Vessel Inspectors. Valve shall be of an automatically reseating design after activation.

2.5.6 Evaporator Pressure Regulators, Direct-Acting

Valve shall include a diaphragm/spring assembly, external pressure adjustment with seal cap, and pressure gauge port. Valve shall maintain a

constant inlet pressure by balancing inlet pressure on diaphragm against an adjustable spring load. Pressure drop at system design load shall not exceed the pressure difference corresponding to a 2 degrees F change in saturated refrigerant temperature at evaporator operating suction temperature. Spring shall be selected for indicated maximum allowable suction pressure range.

2.5.7 Refrigerant Access Valves

Refrigerant access valves and hose connections shall be in accordance with AHRI 720.

2.6 PIPING ACCESSORIES

2.6.1 Filter Driers

Driers shall conform to AHRI 710 I-P. Sizes 5/8 inch and larger shall be the full flow, replaceable core type. Sizes 1/2 inch and smaller shall be the sealed type. Cores shall be of suitable desiccant that will not plug, cake, dust, channel, or break down, and shall remove water, acid, and foreign material from the refrigerant. Filter driers shall be constructed so that none of the desiccant will pass into the refrigerant lines. Minimum bursting pressure shall be 1,500 psi.

2.6.2 Sight Glass and Liquid Level Indicator

2.6.2.1 Assembly and Components

Assembly shall be pressure- and temperature-rated and constructed of materials suitable for the service. Glass shall be borosilicate type. Ferrous components subject to condensation shall be electro-galvanized.

2.6.2.2 Gauge Glass

Gauge glass shall include top and bottom isolation valves fitted with automatic checks, and packing followers; red-line or green-line gauge glass; elastomer or polymer packing to suit the service; and gauge glass guard.

2.6.2.3 Bull's-Eye and Inline Sight Glass Reflex Lens

Bull's-eye and inline sight glass reflex lens shall be provided for dead-end liquid service. For pipe line mounting, two plain lenses in one body suitable for backlighted viewing shall be provided.

2.6.2.4 Moisture Indicator

Indicator shall be a self-reversible action, moisture reactive, color changing media. Indicator shall be furnished with full-color-printing tag containing color, moisture and temperature criteria. Unless otherwise indicated, the moisture indicator shall be an integral part of each corresponding sight glass.

2.6.3 Vibration Dampeners

Dampeners shall be of the all-metallic bellows and woven-wire type.

2.6.4 Flexible Pipe Connectors

Connector shall be a composite of interior corrugated phosphor bronze or Type 300 Series stainless steel, as required for fluid service, with exterior reinforcement of bronze, stainless steel or monel wire braid. Assembly shall be constructed with a safety factor of not less than 4 at 300 degrees F. Unless otherwise indicated, the length of a flexible connector shall be as recommended by the manufacturer for the service intended.

2.6.5 Strainers

Strainers used in refrigerant service shall have brass or cast iron body, Y-or angle-pattern, cleanable, not less than 60-mesh noncorroding screen of an area to provide net free area not less than ten times the pipe diameter with pressure rating compatible with the refrigerant service. Screens shall be stainless steel or monel and reinforced spring-loaded where necessary for bypass-proof construction.

2.6.6 Pressure and Vacuum Gauges

Gauges shall conform to ASME B40.100 and shall be provided with throttling type needle valve or a pulsation dampener and shut-off valve. Gauge shall be a minimum of 3-1/2 inches in diameter with a range from 0 psig to approximately 1.5 times the maximum system working pressure. Each gauge range shall be selected so that at normal operating pressure, the needle is within the middle-third of the range.

2.6.7 Temperature Gauges

Temperature gauges shall be the industrial duty type and be provided for the required temperature range. Gauges shall have Fahrenheit scale in 2 degrees graduations scale (black numbers) on a white face. The pointer shall be adjustable. Rigid stem type temperature gauges shall be provided in thermal wells located within 5 feet of the finished floor. Universal adjustable angle type or remote element type temperature gauges shall be provided in thermal wells located 5 to 7 feet above the finished floor. Remote element type temperature gauges shall be provided in thermal wells located 7 feet above the finished floor.

2.6.7.1 Stem Cased-Glass

Stem cased-glass case shall be polished stainless steel or cast aluminum, 9 inches long, with clear acrylic lens, and non-mercury filled glass tube with indicating-fluid column.

2.6.7.2 Bimetallic Dial

Bimetallic dial type case shall be not less than 3-1/2 inches, stainless steel, and shall be hermetically sealed with clear acrylic lens. Bimetallic element shall be silicone dampened and unit fitted with external calibrator adjustment. Accuracy shall be one percent of dial range.

2.6.7.3 Liquid-, Solid-, and Vapor-Filled Dial

Liquid-, solid-, and vapor-filled dial type cases shall be not less than 3-1/2 inches, stainless steel or cast aluminum with clear acrylic lens. Fill shall be nonmercury, suitable for encountered cross-ambients, and

connecting capillary tubing shall be double-braided bronze.

2.6.7.4 Thermal Well

Thermal well shall be identical size, 1/2 or 3/4 inch NPT connection, brass or stainless steel. Where test wells are indicated, provide captive plug-fitted type 1/2 inch NPT connection suitable for use with either engraved stem or standard separable socket thermometer or thermostat. Mercury shall not be used in thermometers. Extended neck thermal wells shall be of sufficient length to clear insulation thickness by 1 inch.

2.6.8 Pipe Hangers, Inserts, and Supports

Pipe hangers, inserts, guides, and supports shall conform to MSS SP-58.

2.6.9 Escutcheons

Escutcheons shall be chromium-plated iron or chromium-plated brass, either one piece or split pattern, held in place by internal spring tension or set screws.

2.7 FABRICATION

2.7.1 Factory Coating

Unless otherwise specified, equipment and component items, when fabricated from ferrous metal, shall be factory finished with the manufacturer's standard finish, except that items located outside of buildings shall have weather resistant finishes that will withstand 500 hours exposure to the salt spray test specified in ASTM B117 using a 5 percent sodium chloride solution. Immediately after completion of the test, the specimen shall show no signs of blistering, wrinkling, cracking, or loss of adhesion and no sign of rust creepage beyond 1/8 inch on either side of the scratch mark. Cut edges of galvanized surfaces where hot-dip galvanized sheet steel is used shall be coated with a zinc-rich coating conforming to ASTM D520, Type I.

2.7.2 Factory Applied Insulation

Refrigerant suction lines between the cooler and each compressor shall be insulated with not less than 3/4 inch thick unicellular plastic foam. Factory insulated items installed outdoors are not required to be fire-rated. As a minimum, factory insulated items installed indoors shall have a flame spread index no higher than 75 and a smoke developed index no higher than 150. Factory insulated items (no jacket) installed indoors and which are located in air plenums, in ceiling spaces, and in attic spaces shall have a flame spread index no higher than 25 and a smoke developed index no higher than 50. Flame spread and smoke developed indexes shall be determined by ASTM E84. Insulation shall be tested in the same density and installed thickness as the material to be used in the actual construction. Material supplied by a manufacturer with a jacket shall be tested as a composite material. Jackets, facings, and adhesives shall have a flame spread index no higher than 25 and a smoke developed index no higher than 50 when tested in accordance with ASTM E84.

PART 3 EXECUTION

3.1 EXAMINATION

Submit a letter, at least 2 weeks prior to beginning construction, including the date the site was visited, conformation of existing conditions, and any discrepancies found before performing any work.

3.2 INSTALLATION

Pipe and fitting installation shall conform to the requirements of ASME B31.1. Cut pipe accurately to measurements established at the jobsite, and work into place without springing or forcing, completely clearing all windows, doors, and other openings. Cutting or other weakening of the building structure to facilitate piping installation are not permitted without written approval. Cut pipe or tubing square, removeremoved by reaming, and permit free expansion and contraction without causing damage to the building structure, pipe, joints, or hangers.

3.2.1 Directional Changes

Make changes in direction with fittings, except that bending of pipe 4 inches and smalleris permitted, provided a pipe bender is used and wide weep bends are formed. Mitering or notching pipe or other similar construction to form elbows or tees is not permitted. The centerline radius of bends shall not be less than 6 diameters of the pipe. Bent pipe showing kinks, wrinkles, flattening, or other malformations will not be accepted.

3.2.2 Functional Requirements

Piping shall be installed 1/2 inch/10 feet of pipe in the direction of flow to ensure adequate oil drainage. Open ends of refrigerant lines or equipment shall be properly capped or plugged during installation to keep moisture, dirt, or other foreign material out of the system. Piping shall remain capped until installation. Equipment piping shall be in accordance with the equipment manufacturer's recommendations and the contract drawings. Equipment and piping arrangements shall fit into space allotted and allow adequate acceptable clearances for installation, replacement, entry, servicing, and maintenance.

3.2.3 Fittings and End Connections

3.2.3.1 Threaded Connections

Make threaded connections with tapered threads and make tight with PTFE tape complying with ASTM D3308 or equivalent thread-joint compound applied to the male threads only. Show not more than three threads after the joint is made.

3.2.3.2 Brazed Connections

Perform brazing in accordance with AWS BRH, except as modified herein. During brazing, fill the pipe and fittings with a pressure regulated inert gas, such as nitrogen, to prevent the formation of scale. Before brazing copper joints, clean both the outside of the tube and the inside of the fitting with a wire fitting brush until the entire joint surface is bright and clean. Do not use brazing flux. Remove surplus brazing material at all joints. Make steel tubing joints in accordance with the

manufacturer's recommendations. Paint joints in steel tubing with the same material as the baked-on coating within 8 hours after joints are made. Protect tubing against oxidation during brazing by continuous purging of the inside of the piping using nitrogen. Support piping prior to brazing and do not spring or force.

3.2.3.3 Welded Connections

Welded joints in steel refrigerant piping shall be fusion-welded. Branch connections shall be made with welding tees or forged welding branch outlets. Pipe shall be thoroughly cleaned of all scale and foreign matter before the piping is assembled. During welding the pipe and fittings shall be filled with an inert gas, such as nitrogen, to prevent the formation of scale. Beveling, alignment, heat treatment, and inspection of weld shall conform to ASME B31.1. Weld defects shall be removed and rewelded at no additional cost to the Government. Electrodes shall be stored and dried in accordance with AWS D1.1/D1.1M or as recommended by the manufacturer. Electrodes that have been wetted or that have lost any of their coating shall not be used.

3.2.3.4 Flared Connections

When flared connections are used, a suitable lubricant shall be used between the back of the flare and the nut in order to avoid tearing the flare while tightening the nut.

3.2.3.5 Flanged Connections

When steel refrigerant piping is used, union or flange joints shall be provided in each line immediately preceding the connection to each piece of equipment requiring maintenance, such as compressors, coils, chillers, control valves, and other similar items. Flanged joints shall be assembled square end tight with matched flanges, gaskets, and bolts. Gaskets shall be suitable for use with the refrigerants to be handled.

3.2.4 Valves

3.2.4.1 General

Refrigerant stop valves shall be installed on each side of each piece of equipment such as compressors condensers, evaporators, receivers, and other similar items in multiple-unit installation, to provide partial system isolation as required for maintenance or repair. Stop valves shall be installed with stems horizontal unless otherwise indicated. Ball valves shall be installed with stems positioned to facilitate operation and maintenance. Isolating valves for pressure gauges and switches shall be external to thermal insulation. Safety switches shall not be fitted with isolation valves. Filter dryers having access ports may be considered a point of isolation. Purge valves shall be provided at all points of systems where accumulated noncondensable gases would prevent proper system operation. Valves shall be furnished to match line size, unless otherwise indicated or approved.

3.2.4.2 Expansion Valves

Expansion valves shall be installed with the thermostatic expansion valve bulb located on top of the suction line when the suction line is less than 2-1/8 inches in diameter and at the 4 o'clock or 8 o'clock position on lines larger than 2-1/8 inches. The bulb shall be securely fastened with

two clamps. The bulb shall be insulated. The bulb shall installed in a horizontal portion of the suction line, if possible, with the pigtail on the bottom. If the bulb must be installed in a vertical line, the bulb tubing shall be facing up.

3.2.4.3 Valve Identification

Each system valve, including those which are part of a factory assembly, shall be tagged. Tags shall be in alphanumeric sequence, progressing in direction of fluid flow. Tags shall be embossed, engraved, or stamped plastic or nonferrous metal of various shapes, sized approximately 1-3/8 inch diameter, or equivalent dimension, substantially attached to a component or immediately adjacent thereto. Tags shall be attached with nonferrous, heavy duty, bead or link chain, 14 gauge annealed wire, nylon cable bands or as approved. Tag numbers shall be referenced in Operation and Maintenance Manuals and system diagrams.

3.2.5 Vibration Dampers

Vibration damper shall be provided in the suction and discharge lines on spring mounted compressors. Vibration dampers shall be installed parallel with the shaft of the compressor and shall be anchored firmly at the upstream end on the suction line and the downstream end in the discharge line.

3.2.6 Strainers

Strainers shall be provided immediately ahead of solenoid valves and expansion devices. Strainers may be an integral part of an expansion valve.

3.2.7 Filter Dryer

A liquid line filter dryer shall be provided on each refrigerant circuit located such that all liquid refrigerant passes through a filter dryer. Dryers shall be sized in accordance with the manufacturer's recommendations for the system in which it is installed. Dryers shall be installed such that it can be isolated from the system, the isolated portion of the system evacuated, and the filter dryer replaced. Dryers shall be installed in the horizontal position except replaceable core filter dryers may be installed in the vertical position with the access flange on the bottom.

3.2.8 Sight Glass

A moisture indicating sight glass shall be installed in all refrigerant circuits down stream of all filter dryers and where indicated. Site glasses shall be full line size.

3.2.9 Discharge Line Oil Separator

Discharge line oil separator shall be provided in the discharge line from each compressor. Oil return line shall be connected to the compressor as recommended by the compressor manufacturer.

3.2.10 Accumulator

Accumulators shall be provided in the suction line to each compressor.

3.2.11 Flexible Pipe Connectors

Connectors shall be installed perpendicular to line of motion being isolated. Piping for equipment with bidirectional motion shall be fitted with two flexible connectors, in perpendicular planes. Reinforced elastomer flexible connectors shall be installed in accordance with manufacturer's instructions. Piping guides and restraints related to flexible connectors shall be provided as required.

3.2.12 Temperature Gauges

Temperature gauges shall be located specifically on, but not limited to the following: the liquid line leaving a receiver and the suction line at each evaporator or liquid cooler. Thermal wells for insertion thermometers and thermostats shall extend beyond thermal insulation surface not less than 1 inch.

3.2.13 Pipe Hangers, Inserts, and Supports

Pipe hangers, inserts, and supports shall conform to MSS SP-58, except as modified herein. Pipe hanger types 5, 12, and 26 shall not be used. Hangers used to support piping 2 inches and larger shall be fabricated to permit adequate adjustment after erection while still supporting the load. Piping subjected to vertical movement, when operating temperatures exceed ambient temperatures, shall be supported by variable spring hangers and supports or by constant support hangers.

3.2.13.1 Hangers

Do not use Type 3 on insulated piping. Type 24 may be used only on trapeze hanger systems or on fabricated frames.

3.2.13.2 Inserts

Secure Type 18 inserts to concrete forms before concrete is placed. Continuous inserts which allow more adjustments may be used if they otherwise meet the requirements for Type 18 inserts.

3.2.13.3 C-Clamps

Torque Type 19 and 23 C-clamps in accordance with MSS SP-58 and have both locknuts and retaining devices, furnished by the manufacturer. Field-fabricated C-clamp bodies or retaining devices are not acceptable.

3.2.13.4 Angle Attachments

Type 20 attachments used on angles and channels shall be furnished with an added malleable-iron heel plate or adapter.

3.2.13.5 Saddles and Shields

Where Type 39 saddle or Type 40 shield are permitted for a particular pipe attachment application, the Type 39 saddle, connected to the pipe, shall be used on all pipe 4 inches and larger when the temperature of the medium is 60 degrees F or higher. Type 40 shields shall be used on all piping less than 4 inches and all piping 4 inches and larger carrying medium less than 60 degrees F. A high density insulation insert of cellular glass shall be used under the Type 40 shield for piping 2 inches and larger.

3.2.13.6 Horizontal Pipe Supports

Horizontal pipe supports shall be spaced as specified in MSS SP-58 and a support shall be installed not over 1 foot from the pipe fitting joint at each change in direction of the piping. Pipe supports shall be spaced not over 5 feet apart at valves.

3.2.13.7 Vertical Pipe Supports

Vertical pipe shall be supported at each floor, except at slab-on-grade, and at intervals of not more than 15 feet not more than 8 feet from end of risers, and at vent terminations.

3.2.13.8 Pipe Guides

Type 35 guides using, steel, reinforced polytetrafluoroethylene (PTFE) or graphite slides shall be provided where required to allow longitudinal pipe movement. Lateral restraints shall be provided as required. Slide materials shall be suitable for the system operating temperatures, atmospheric conditions, and bearing loads encountered.

3.2.13.9 Steel Slides

Where steel slides do not require provisions for restraint of lateral movement, an alternate guide method may be used. On piping 4 inches and larger, a Type 39 saddle shall be used. On piping under 4 inches, a Type 40 protection shield may be attached to the pipe or insulation and freely rest on a steel slide plate.

3.2.13.10 High Temperature Guides with Cradles

Where there are high system temperatures and welding to piping is not desirable, then the Type 35 guide shall include a pipe cradle, welded to the guide structure and strapped securely to the pipe. The pipe shall be separated from the slide material by at least 4 inches, or by an amount adequate for the insulation, whichever is greater.

3.2.13.11 Multiple Pipe Runs

In the support of multiple pipe runs on a common base member, a clip or clamp shall be used where each pipe crosses the base support member. Spacing of the base support members shall not exceed the hanger and support spacing required for an individual pipe in the multiple pipe run.

3.2.13.12 Structural Attachments

Attachment to building structure concrete and masonry shall be by cast-in concrete inserts, built-in anchors, or masonry anchor devices. Inserts and anchors shall be applied with a safety factor not less than 5. Supports shall not be attached to metal decking. Masonry anchors for overhead applications shall be constructed of ferrous materials only. Structural steel brackets required to support piping, headers, and equipment, but not shown, shall be provided under this section.

3.2.14 Pipe Alignment Guides

Pipe alignment guides shall be provided where indicated for expansion loops, offsets, and bends and as recommended by the manufacturer for expansion joints, not to exceed 5 feet on each side of each expansion

joint, and in lines 4 inches or smaller not more than 2 feet on each side of the joint.

3.2.15 Pipe Anchors

Anchors shall be provided wherever necessary or indicated to localize expansion or to prevent undue strain on piping. Anchors shall consist of heavy steel collars with lugs and bolts for clamping and attaching anchor braces, unless otherwise indicated. Anchor braces shall be installed in the most effective manner to secure the desired results using turnbuckles where required. Supports, anchors, or stays shall not be attached where they will injure the structure or adjacent construction during installation or by the weight of expansion of the pipeline. Where pipe and conduit penetrations of vapor barrier sealed surfaces occur, these items shall be anchored immediately adjacent to each penetrated surface, to provide essentially zero movement within penetration seal. Detailed drawings of pipe anchors shall be submitted for approval before installation.

3.2.16 Piping and Tubing Buried Under Buildings

Run underground piping and tubing installed beneath buildings installed within a water tight plastic conduit. Extend casing or encasement system at least 4 inches outside the building, and provide the pipe with spacers and end bushings to seal at both ends to prevent the entrance of water and/or the escape of gas. Extend a vent line from the annular space above grade outside to a point where gas will not be a hazard, and terminate in a rain/insect-resistant fitting.

3.2.17 Building Surface Penetrations

Sleeves shall not be installed in structural members except where indicated or approved. Sleeves in nonload bearing surfaces shall be galvanized sheet metal, conforming to ASTM A653/A653M, Coating Class G-90, 20 gauge. Sleeves in load bearing surfaces shall be uncoated carbon steel pipe, conforming to ASTM A53/A53M, Schedule 30. Sealants shall be applied to moisture and oil-free surfaces and elastomers to not less than 1/2 inch depth. Sleeves shall not be installed in structural members.

3.2.17.1 Refrigerated Space

Refrigerated space building surface penetrations shall be fitted with sleeves fabricated from hand-lay-up or helically wound, fibrous glass reinforced polyester or epoxy resin with a minimum thickness equal to equivalent size Schedule 40 steel pipe. Sleeves shall be constructed with integral collar or cold side shall be fitted with a bonded slip-on flange or extended collar. In the case of masonry penetrations where sleeve is not cast-in, voids shall be filled with latex mixed mortar cast to shape of sleeve and flange/external collar type sleeve shall be assembled with butyl elastomer vapor barrier sealant through penetration to cold side surface vapor barrier overlap and fastened to surface with masonry anchors. Integral cast-in collar type sleeve shall be flashed with not less than 4 inches of cold side vapor barrier overlap of sleeve surface. Normally noninsulated penetrating round surfaces shall be sealed to sleeve bore with mechanically expandable seals in vapor tight manner and remaining warm and cold side sleeve depth shall be insulated with not less than 4 inches of foamed-in-place rigid polyurethane or foamed-in-place silicone elastomer. Vapor barrier sealant shall be applied to finish warm side insulation surface. Warm side of penetrating surface shall be

insulated beyond vapor barrier sealed sleeve insulation for a distance which prevents condensation. Wires in refrigerated space surface penetrating conduit shall be sealed with vapor barrier plugs or compound to prevent moisture migration through conduit and condensation therein.

3.2.17.2 General Service Areas

Each sleeve shall extend through its respective wall, floor, or roof, and shall be cut flush with each surface. Pipes passing through concrete or masonry wall or concrete floors or roofs shall be provided with pipe sleeves fitted into place at the time of construction. Sleeves shall be of such size as to provide a minimum of 1/4 inch all-around clearance between bare pipe and sleeves or between jacketed-insulation and sleeves. Except in pipe chases or interior walls, the annular space between pipe and sleeve or between jacket over-insulation and sleeve shall be sealed.

3.2.17.3 Waterproof Penetrations

Pipes passing through roof or floor waterproofing membrane shall be installed through a 17 ounce copper sleeve, or a 0.032 inch thick aluminum sleeve, each within an integral skirt or flange. Flashing sleeve shall be suitably formed, and skirt or flange shall extend not less than 8 inches from the pipe and be set over the roof or floor membrane in a troweled coating of bituminous cement. The flashing sleeve shall extend up the pipe a minimum of 2 inches above the roof or floor penetration. The annular space between the flashing sleeve and the bare pipe or between the flashing sleeve and the metal-jacket-covered insulation shall be sealed as indicated. Penetrations shall be sealed by either one of the following methods.

3.2.17.3.1 Waterproofing Clamping Flange

Pipes up to and including 10 inches in diameter passing through roof or floor waterproofing membrane may be installed through a cast iron sleeve with caulking recess, anchor lugs, flashing clamp device, and pressure ring with brass bolts. Waterproofing membrane shall be clamped into place and sealant shall be placed in the caulking recess.

3.2.17.3.2 Modular Mechanical Type Sealing Assembly

In lieu of a waterproofing clamping flange and caulking and sealing of annular space between pipe and sleeve or conduit and sleeve, a modular mechanical type sealing assembly may be installed. Seals shall consist of interlocking synthetic rubber links shaped to continuously fill the annular space between the pipe/conduit and sleeve with corrosion protected carbon steel bolts, nuts, and pressure plates. Links shall be loosely assembled with bolts to form a continuous rubber belt around the pipe with a pressure plate under each bolt head and each nut. After the seal assembly is properly positioned in the sleeve, tightening of the bolt shall cause the rubber sealing elements to expand and provide a watertight seal rubber sealing elements to expand and provide a watertight seal between the pipe/conduit seal between the pipe/conduit and the sleeve. Each seal assembly shall be sized as recommended by the manufacturer to fit the pipe/conduit and sleeve involved. The Contractor electing to use the modular mechanical type seals shall provide sleeves of the proper diameters.

3.2.17.4 Fire-Rated Penetrations

Penetration of fire-rated walls, partitions, and floors shall be sealed.

3.2.17.5 Escutcheons

Finished surfaces where exposed piping, bare or insulated, pass through floors, walls, or ceilings, except in boiler, utility, or equipment rooms, shall be provided with escutcheons. Where sleeves project slightly from floors, special deep-type escutcheons shall be used. Escutcheon shall be secured to pipe or pipe covering.

3.2.18 Access Panels

Access panels shall be provided for all concealed valves, vents, controls, and items requiring inspection or maintenance. Access panels shall be of sufficient size and located so that the concealed items may be serviced and maintained or completely removed and replaced.

3.2.19 Field Applied Insulation

Field installed insulation shall be as specified in Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS, except as defined differently herein.

3.2.20 Identification Tags

Provide identification tags made of brass, engraved laminated plastic or engraved anodized aluminum indicating service and item number on all valves and dampers. Tags shall be 1-3/8 inch minimum diameter and marking shall be stamped or engraved. Indentations shall be black for reading clarity. Tags shall be attached to valves with No. 12 AWG copper wire, chrome-plated beaded chain or plastic straps designed for that purpose.

3.3 CLEANING AND ADJUSTING

Clean uncontaminated system(s) by evacuation and purging procedures currently recommended by refrigerant and refrigerant equipment manufacturers, and as specified herein, to remove small amounts of air and moisture. Systems containing moderate amounts of air, moisture, contaminated refrigerant, or any foreign matter shall be considered contaminated systems. Restoring contaminated systems to clean condition including disassembly, component replacement, evacuation, flushing, purging, and re-charging, shall be performed using currently approved refrigerant and refrigeration manufacturer's procedures. Restoring contaminated systems shall be at no additional cost to the Government as determined by the Contracting Officer. Water shall not be used in any procedure or test.

3.4 TRAINING COURSE

a. Submit a schedule, at least 2 weeks prior to the date of the proposed training course, which identifies the date, time, and location for the training. Conduct a training course for min. 2 members of the operating staff as designated by the Contracting Officer. The training period shall consist of a total 8 hours of normal working time and start after the system is functionally completed but prior to final acceptance tests.

b. The field posted instructions shall cover all of the items contained in the approved operation and maintenance manuals as well as demonstrations of routine maintenance operations.

c. Submit 6 complete copies of an operation manual in bound 8 1/2 by 11 inch booklets listing step-by-step procedures required for system startup, operation, abnormal shutdown, emergency shutdown, and normal shutdown at least 4 weeks prior to the first training course. The booklets shall include the manufacturer's name, model number, and parts list. The manuals shall include the manufacturer's name, model number, service manual, and a brief description of all equipment and their basic operating features.

d. Submit 6 complete copies of maintenance manual in bound 8 1/2 x 11 inch booklets listing routine maintenance procedures, possible breakdowns and repairs, and a trouble shooting guide. The manuals shall include piping layouts and simplified wiring and control diagrams of the system as installed.

3.5 REFRIGERANT PIPING TESTS

After all components of the refrigerant system have been installed and connected, subject the entire refrigeration system to pneumatic, evacuation, and startup tests as described herein. Submit a schedule, at least 2 weeks prior to the start of related testing, for each test. Identify the proposed date, time, and location for each test. Conduct tests in the presence of the Contracting Officer. Water and electricity required for the tests will be furnished by the Government. Provide all material, equipment, instruments, and personnel required for the test. Provide the services of a qualified technician, as required, to perform all tests and procedures indicated herein. Field tests shall be coordinated with Section 23 05 93 TESTING, ADJUSTING, AND BALANCING OF HVAC SYSTEMS. Submit 6 copies of the tests report in bound 8 1/2 by 11 inch booklets documenting all phases of the tests performed. The report shall include initial test summaries, all repairs/adjustments made, and the final test results.

3.5.1 Preliminary Procedures

Prior to pneumatic testing, equipment which has been factory tested and refrigerant charged as well as equipment which could be damaged or cause personnel injury by imposed test pressure, positive or negative, shall be isolated from the test pressure or removed from the system. Safety relief valves and rupture discs, where not part of factory sealed systems, shall be removed and openings capped or plugged.

3.5.2 Pneumatic Test

Pressure control and excess pressure protection shall be provided at the source of test pressure. Valves shall be wide open, except those leading to the atmosphere. Test gas shall be dry nitrogen, with minus 70 degree F dewpoint and less than 5 ppm oil. Test pressure shall be applied in two stages before any refrigerant pipe is insulated or covered. First stage test shall be at 10 psi with every joint being tested with a thick soap or color indicating solution. Second stage tests shall raise the system to the minimum refrigerant leakage test pressure specified in ASHRAE 15 & 34 with a maximum test pressure 25 percent greater. Pressure above 100 psig shall be raised in 10 percent increments with a pressure acclimatizing period between increments. The initial test pressure shall be recorded

along with the ambient temperature to which the system is exposed. Final test pressures of the second stage shall be maintained on the system for a minimum of 24 hours. At the end of the 24 hour period, the system pressure will be recorded along with the ambient temperature to which the system is exposed. A correction factor of 0.3 psi will be allowed for each degree F change between test space initial and final ambient temperature, plus for increase and minus for a decrease. If the corrected system pressure is not exactly equal to the initial system test pressure, then the system shall be investigated for leaking joints. To repair leaks, the joint shall be taken apart, thoroughly cleaned, and reconstructed as a new joint. Joints repaired by caulking, remelting, or back-welding/brazing shall not be acceptable. Following repair, the entire system shall be retested using the pneumatic tests described above. The entire system shall be reassembled once the pneumatic tests are satisfactorily completed.

3.5.3 Evacuation Test

Following satisfactory completion of the pneumatic tests, the pressure shall be relieved and the entire system shall be evacuated to an absolute pressure of 300 micrometers. During evacuation of the system, the ambient temperature shall be higher than 35 degrees F. No more than one system shall be evacuated at one time by one vacuum pump. Once the desired vacuum has been reached, the vacuum line shall be closed and the system shall stand for 1 hour. If the pressure rises over 500 micrometers after the 1 hour period, then the system shall be evacuated again down to 300 micrometers and let set for another 1 hour period. The system shall not be charged until a vacuum of at least 500 micrometers is maintained for a period of 1 hour without the assistance of a vacuum line. If during the testing the pressure continues to rise, check the system for leaks, repair as required, and repeat the evacuation procedure. During evacuation, pressures shall be recorded by a thermocouple-type, electronic-type, or a calibrated-micrometer type gauge.

3.5.4 System Charging and Startup Test

Following satisfactory completion of the evacuation tests, the system shall be charged with the required amount of refrigerant by raising pressure to normal operating pressure and in accordance with manufacturer's procedures. Following charging, the system shall operate with high-side and low-side pressures and corresponding refrigerant temperatures, at design or improved values. The entire system shall be tested for leaks. Fluorocarbon systems shall be tested with halide torch or electronic leak detectors.

3.5.5 Refrigerant Leakage

If a refrigerant leak is discovered after the system has been charged, the leaking portion of the system shall immediately be isolated from the remainder of the system and the refrigerant pumped into the system receiver or other suitable container. Under no circumstances shall the refrigerant be discharged into the atmosphere.

3.5.6 Contractor's Responsibility

At all times during the installation and testing of the refrigeration system, take steps to prevent the release of refrigerants into the atmosphere. The steps shall include, but not be limited to, procedures which will minimize the release of refrigerants to the atmosphere and the

use of refrigerant recovery devices to remove refrigerant from the system and store the refrigerant for reuse or reclaim. At no time shall more than 3 ounces of refrigerant be released to the atmosphere in any one occurrence. Any system leaks within the first year shall be repaired in accordance with the requirements herein at no cost to the Government including material, labor, and refrigerant if the leak is the result of defective equipment, material, or installation.

-- End of Section --

SECTION 23 30 00

HVAC AIR DISTRIBUTION
05/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR MOVEMENT AND CONTROL ASSOCIATION INTERNATIONAL, INC. (AMCA)

AMCA 201	(2002; R 2011) Fans and Systems
AMCA 210	(2016) Laboratory Methods of Testing Fans for Aerodynamic Performance Rating
AMCA 300	(2014) Reverberant Room Method for Sound Testing of Fans
AMCA 301	(2014) Methods for Calculating Fan Sound Ratings from Laboratory Test Data
AMCA 500-D	(2018) Laboratory Methods of Testing Dampers for Rating

AMERICAN BEARING MANUFACTURERS ASSOCIATION (ABMA)

ABMA 9	(2015) Load Ratings and Fatigue Life for Ball Bearings
ABMA 11	(2014) Load Ratings and Fatigue Life for Roller Bearings

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 62.1	(2019; ADD A-G 2021; Errata 3 2021) Ventilation for Acceptable Indoor Air Quality
ASHRAE 70	(2006; R 2021) Method of Testing the Performance of Air Outlets and Inlets
ASHRAE 90.1 - IP	(2013) Energy Standard for Buildings Except Low-Rise Residential Buildings

ASTM INTERNATIONAL (ASTM)

ASTM A53/A53M	(2022) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
ASTM A123/A123M	(2017) Standard Specification for Zinc

	(Hot-Dip Galvanized) Coatings on Iron and Steel Products
ASTM A167	(2011) Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
ASTM A924/A924M	(2020) Standard Specification for General Requirements for Steel Sheet, Metallic-Coated by the Hot-Dip Process
ASTM B117	(2019) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM B766	(1986; R 2015) Standard Specification for Electrodeposited Coatings of Cadmium
ASTM C553	(2013; R 2019) Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications
ASTM D520	(2000; R 2011) Zinc Dust Pigment
ASTM D1654	(2008; R 2016; E 2017) Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments
ASTM D3359	(2017) Standard Test Methods for Rating Adhesion by Tape Test
ASTM E2016	(2020) Standard Specification for Industrial Woven Wire Cloth

CALIFORNIA DEPARTMENT OF PUBLIC HEALTH (CDPH)

CDPH SECTION 01350	(2010; Version 1.1) Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources using Environmental Chambers

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA MG 1	(2018) Motors and Generators
NEMA MG 10	(2017) Energy Management Guide for Selection and Use of Fixed Frequency Medium AC Squirrel-Cage Polyphase Induction Motors
NEMA MG 11	(1977; R 2012) Energy Management Guide for Selection and Use of Single Phase Motors

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 90A	(2021) Standard for the Installation of Air Conditioning and Ventilating Systems

NFPA 701	(2019) Standard Methods of Fire Tests for Flame Propagation of Textiles and Films

SHEET METAL AND AIR CONDITIONING CONTRACTORS' NATIONAL ASSOCIATION (SMACNA)

SMACNA 1966	(2020) HVAC Duct Construction Standards Metal and Flexible, 4th Edition
SMACNA 1981	(2008) Seismic Restraint Manual Guidelines for Mechanical Systems, 3rd Edition

SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT (SCAQMD)

SCAQMD Rule 1168	(2017) Adhesive and Sealant Applications

U.S. DEPARTMENT OF DEFENSE (DOD)

MIL-STD-101	(2014; Rev C) Color Code for Pipelines and for Compressed Gas Cylinders

UNDERWRITERS LABORATORIES (UL)

UL 6	(2007; Reprint Sep 2019) UL Standard for Safety Electrical Rigid Metal Conduit-Steel
UL 181	(2013; Reprint Apr 2017) UL Standard for Safety Factory-Made Air Ducts and Air Connectors
UL 705	(2017; Reprint Aug 2021) UL Standard for Safety Power Ventilators
UL Bld Mat Dir	(updated continuously online) Building Materials Directory

1.2 SYSTEM DESCRIPTION

Furnish ductwork, piping offsets, fittings, and accessories as required to provide a complete installation. Coordinate the work of the different trades to avoid interference between piping, equipment, structural, and electrical work. Provide complete, in place, all necessary offsets in piping and ductwork, and all fittings, and other components, required to install the work as indicated and specified.

1.2.1 Mechanical Equipment Identification

The number of charts and diagrams must be equal to or greater than the number of mechanical equipment rooms. Where more than one chart or diagram per space is required, mount these in edge pivoted, swinging leaf, extruded aluminum frame holders which open to 170 degrees.

1.2.1.1 Charts

Provide chart listing of equipment by designation numbers and capacities such as flow rates, pressure and temperature differences, heating and cooling capacities, horsepower, pipe sizes, and voltage and current characteristics.

1.2.1.2 Diagrams

Submit proposed diagrams, at least 2 weeks prior to start of related testing. provide neat mechanical drawings provided with extruded aluminum frame under 1/8-inch glass or laminated plastic, system diagrams that show the layout of equipment, piping, and ductwork, and typed condensed operation manuals explaining preventative maintenance procedures, methods of checking the system for normal, safe operation, and procedures for safely starting and stopping the system. After approval, post these items where directed.

1.2.2 Service Labeling

Label equipment, including fans, air handlers, terminal units, etc. with labels made of self-sticking, plastic film designed for permanent installation. Provide labels in accordance with the typical examples below:

SERVICE	LABEL AND TAG DESIGNATION
Air handling unit Number	AHU -
Control and instrument air	CONTROL AND INSTR.
Exhaust Fan Number	EF -
Fan Coil Unit Number	FCU -

Identify similar services with different temperatures or pressures. Where pressures could exceed 125 pounds per square inch, gage, include the maximum system pressure in the label. Label and arrow piping in accordance with the following:

a. Each point of entry and exit of pipe passing through walls.

b. Each change in direction, i.e., elbows, tees.

c. In congested or hidden areas and at all access panels at each point required to clarify service or indicated hazard.

d. In long straight runs, locate labels at distances within eyesight of each other not to exceed 75 feet. All labels must be visible and legible from the primary service and operating area.

For Bare or Insulated Pipes	
for Outside Diameters of	Lettering
1/2 thru 1-3/8 inch	1/2 inch
1-1/2 thru 2-3/8 inch	3/4 inch

For Bare or Insulated Pipes	
for Outside Diameters of	Lettering
2-1/2 inch and larger	1-1/4 inch

1.2.3 Color Coding

Color coding of all piping systems must be in accordance with MIL-STD-101.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Detail Drawings; G

SD-03 Product Data

Metallic Flexible Duct

Insulated Nonmetallic Flexible Duct Runouts

Duct Connectors

Duct Access Doors; G

Manual Balancing Dampers; G

Diffusers

Registers and Grilles

Louvers

Air Vents

In-Line Centrifugal Fans

Panel Type Power Wall Ventilators

Test Procedures

Diagrams; G

Indoor Air Quality for Duct Sealants; S

SD-06 Test Reports

Performance Tests; G

Damper Acceptance Test; G

SD-08 Manufacturer's Instructions

Manufacturer's Installation Instructions

Operation and Maintenance Training

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals; G

Manual Balancing Dampers; G

In-Line Centrifugal Fans; G

Panel Type Power Wall Ventilators; G

SD-11 Closeout Submittals

Indoor Air Quality During Construction; S

1.4 QUALITY ASSURANCE

Except as otherwise specified, approval of materials and equipment is based on manufacturer's published data.

a. Where materials and equipment are specified to conform to the standards of the Underwriters Laboratories, the label of or listing with reexamination in UL Bld Mat Dir, and UL 6 is acceptable as sufficient evidence that the items conform to Underwriters Laboratories requirements. In lieu of such label or listing, submit a written certificate from any nationally recognized testing agency, adequately equipped and competent to perform such services, stating that the items have been tested and that the units conform to the specified requirements. Outline methods of testing used by the specified agencies.

b. Where materials or equipment are specified to be constructed or tested, or both, in accordance with the standards of the ASTM International (ASTM), the ASME International (ASME), or other standards, a manufacturer's certificate of compliance of each item is acceptable as proof of compliance.

c. Conformance to such agency requirements does not relieve the item from compliance with other requirements of these specifications.

d. Where products are specified to meet or exceed the specified energy efficiency requirement of FEMP-designated or ENERGY STAR covered product categories, equipment selected must have as a minimum the efficiency rating identified under "Energy-Efficient Products" at http://femp.energy.gov/procurement.

1.4.1 Prevention of Corrosion

Protect metallic materials against corrosion. Provide rust-inhibiting treatment and standard finish for the equipment enclosures. Do not use aluminum in contact with earth, and where connected to dissimilar metal. Protect aluminum by approved fittings, barrier material, or treatment. Provide hot-dip galvanized ferrous parts such as anchors, bolts, braces, boxes, bodies, clamps, fittings, guards, nuts, pins, rods, shims, thimbles, washers, and miscellaneous parts not of corrosion-resistant

steel or nonferrous materials in accordance with ASTM A123/A123M for exterior locations and cadmium-plated in conformance with ASTM B766 for interior locations.

1.4.2 Asbestos Prohibition

Do not use asbestos and asbestos-containing products.

1.4.3 Detail Drawings

Submit detail drawings showing equipment layout, including assembly and installation details and electrical connection diagrams; ductwork layout showing the location of all supports and hangers, typical hanger details, gauge reinforcement, reinforcement spacing rigidity classification, and static pressure and seal classifications. Include any information required to demonstrate that the system has been coordinated and functions properly as a unit on the drawings and show equipment relationship to other parts of the work, including clearances required for operation and maintenance. Submit drawings showing bolt-setting information, and foundation bolts prior to concrete foundation construction for all equipment indicated or required to have concrete foundations. Submit function designation of the equipment and any other requirements specified throughout this Section with the shop drawings.

1.4.4 Test Procedures

Conduct performance tests as required in Section 23 05 93 Testing, Adjusting and Balancing for HVAC and Section 23 09 00 Instrumentation and Control for HVAC.

1.5 DELIVERY, STORAGE, AND HANDLING

Protect stored equipment at the jobsite from the weather, humidity and temperature variations, dirt and dust, or other contaminants. Additionally, cap or plug all pipes until installed.

PART 2 PRODUCTS

2.1 STANDARD PRODUCTS

Provide components and equipment that are "standard products" of a manufacturer regularly engaged in the manufacturing of products that are of a similar material, design and workmanship. "Standard products" is defined as being in satisfactory commercial or industrial use for 2 years before bid opening, including applications of components and equipment under similar circumstances and of similar size, satisfactorily completed by a product that is sold on the commercial market through advertisements, manufacturers' catalogs, or brochures. Products having less than a 2-year field service record are acceptable if a certified record of satisfactory field operation, for not less than 6000 hours exclusive of the manufacturer's factory tests, can be shown. Provide equipment items that are supported by a service organization. In product categories covered by ENERGY STAR or the Federal Energy Management Program, provide equipment that is listed on the ENERGY STAR Qualified Products List or that meets or exceeds the FEMP-designated Efficiency Requirements.

2.2 IDENTIFICATION PLATES

In addition to standard manufacturer's identification plates, provide

engraved laminated phenolic identification plates for each piece of mechanical equipment. Identification plates are to designate the function of the equipment. Submit designation with the shop drawings. Provide identification plates that are layers, black-white-black, engraved to show white letters on black background. Letters must be upper case. Identification plates that are 1-1/2-inches high and smaller must be 1/16-inch thick, with engraved lettering 1/8-inch high; identification plates larger than 1-1/2-inches high must be 1/8-inch thick, with engraved lettering of suitable height. Identification plates 1-1/2-inches high and larger must have beveled edges. Install identification plates using a compatible adhesive.

2.3 EQUIPMENT GUARDS AND ACCESS

Fully enclose or guard belts, pulleys, chains, gears, couplings, projecting setscrews, keys, and other rotating parts exposed to personnel contact according to OSHA requirements. Properly guard or cover with insulation of a type specified, high temperature equipment and piping exposed to contact by personnel or where it creates a potential fire hazard.

2.4 ELECTRICAL WORK

a. Provide motors, controllers, integral disconnects, contactors, and controls with their respective pieces of equipment, except controllers indicated as part of motor control centers. Provide electrical equipment, including motors and wiring, as specified in Section 26 20 00INTERIOR DISTRIBUTION SYSTEM. Provide manual or automatic control and protective or signal devices required for the operation specified and control wiring required for controls and devices specified, but not shown. For packaged equipment, include manufacturer provided controllers with the required monitors and timed restart.

b. For single-phase motors, provide high-efficiency type, fractional-horsepower alternating-current motors, including motors that are part of a system, in accordance with NEMA MG 11. Provide premium efficiency type integral size motors in accordance with NEMA MG 1.

c. For polyphase motors, provide squirrel-cage medium induction motors, including motors that are part of a system , and that meet the efficiency ratings for premium efficiency motors in accordance with NEMA MG 1. Select premium efficiency polyphase motors in accordance with NEMA MG 10.

d. Provide motors in accordance with NEMA MG 1 and of sufficient size to drive the load at the specified capacity without exceeding the nameplate rating of the motor. Provide motors rated for continuous duty with the enclosure specified. Provide motor duty that allows for maximum frequency start-stop operation and minimum encountered interval between start and stop. Provide motor torque capable of accelerating the connected load within 20 seconds with 80 percent of the rated voltage maintained at motor terminals during one starting period. Provide motor starters complete with thermal overload protection and other necessary appurtenances. Fit motor bearings with grease supply fittings and grease relief to outside of the enclosure.

e. Where two-speed or variable-speed motors are indicated, solid-state

variable-speed controllers are allowed to accomplish the same function. Use solid-state variable-speed controllers for motors rated 10 hp or less and adjustable frequency drives for larger motors.

2.5 ANCHOR BOLTS

Provide anchor bolts for equipment placed on concrete equipment pads or on concrete slabs. Bolts to be of the size and number recommended by the equipment manufacturer and located by means of suitable templates. Installation of anchor bolts must not degrade the surrounding concrete.

2.6 SEISMIC ANCHORAGE

Anchor equipment in accordance with applicable seismic criteria for the area and as defined in SMACNA 1981

2.7 PAINTING

Paint equipment units in accordance with approved equipment manufacturer's standards unless specified otherwise. Field retouch only if approved. Otherwise, return equipment to the factory for refinishing.

2.8 INDOOR AIR QUALITY

Provide equipment and components that comply with the requirements of ASHRAE 62.1 unless more stringent requirements are specified herein.

2.9 DUCT SYSTEMS

2.9.1 Metal Ductwork

Provide metal ductwork construction, including all fittings and components, that complies with SMACNA 1966, as supplemented and modified by this specification .

a. Provide radius type elbows with a centerline radius of 1.5 times the width or diameter of the duct where space permits. Otherwise, elbows having a minimum radius equal to the width or diameter of the duct or square elbows with factory fabricated turning vanes are allowed.

b. Provide ductwork that meets the requirements of Seal Class A.

c. Provide sealants that conform to fire hazard classification specified in Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS and are suitable for the range of air distribution and ambient temperatures to which it is exposed. Do not use pressure sensitive tape as a sealant. Provide duct sealant products that meet either emissions requirements of CDPH SECTION 01350 (limit requirements for either office or classroom spaces regardless of space type) or VOC content requirements of SCAQMD Rule 1168 (HVAC duct sealants are classified as "Other" within the SCAQMD Rule 1168 sealants table). Provide validation of indoor air quality for duct sealants.

d. Make spiral lock seam duct, and flat oval with duct sealant and lock with not less than 3 equally spaced drive screws or other approved methods indicated in SMACNA 1966. Apply the sealant to the exposed male part of the fitting collar so that the sealer is on the inside of the joint and fully protected by the metal of the duct fitting. Apply one brush coat of the sealant over the outside of the joint to at least

2 inch band width covering all screw heads and joint gap. Dents in the male portion of the slip fitting collar are not acceptable.

e. Fabricate outdoor air intake ducts and plenums with watertight soldered or brazed joints and seams.

2.9.1.1 Metallic Flexible Duct

a. Provide duct that conforms to UL 181 and NFPA 90A with factory-applied insulation, vapor barrier, and end connections. Provide duct assembly that does not exceed 25 for flame spread and 50 for smoke developed. Provide ducts designed for working pressures of 2 inches water gauge positive and 1.5 inches water gauge negative. Provide flexible round duct length that does not exceed 5 feet. Secure connections by applying adhesive for 2 inches over rigid duct, apply flexible duct 2 inches over rigid duct, apply metal clamp, and provide minimum of three No. 8 sheet metal screws through clamp and rigid duct.

b. Inner duct core: Provide interlocking spiral or helically corrugated flexible core constructed of zinc-coated steel, aluminum, or stainless steel; or constructed of inner liner of continuous galvanized spring steel wire helix fused to continuous, fire-retardant, flexible vapor barrier film, inner duct core.

c. Insulation: Provide inner duct core that is insulated with mineral fiber blanket type flexible insulation, minimum of 1 inch thick. Provide insulation covered on exterior with manufacturer's standard fire retardant vapor barrier jacket for flexible round duct.

2.9.1.2 Insulated Nonmetallic Flexible Duct Runouts

Use flexible duct runouts only where indicated. Runout length is indicated on the drawings, and is not to exceed 5 feet. Provide runouts that are preinsulated, factory fabricated, and that comply with NFPA 90A and UL 181. Provide either field or factory applied vapor barrier. Provide not less than 20 ounce glass fabric duct connectors coated on both sides with neoprene. Where coil induction or high velocity units are supplied with vertical air inlets, use a streamlined, vaned and mitered elbow transition piece for connection to the flexible duct or hose. Provide a die-stamped elbow and not a flexible connector as the last elbow to these units other than the vertical air inlet type. Insulated flexible connectors are allowed as runouts. Provide insulated material and vapor barrier that conform to the requirements of Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS. Do not expose the insulation material surface to the air stream.

2.9.1.3 General Service Duct Connectors

Provide a flexible duct connector approximately 6 inches in width where sheet metal connections are made to fans or where ducts of dissimilar metals are connected. For round/oval ducts, secure the flexible material by stainless steel or zinc-coated, iron clinch-type draw bands. For rectangular ducts, install the flexible material locked to metal collars using normal duct construction methods. Provide a composite connector system that complies with NFPA 701 and is classified as "flame-retardent fabrics" in UL Bld Mat Dir.

2.9.2 Duct Access Doors

Provide hinged access doors conforming to SMACNA 1966 in ductwork and plenums where indicated and at all air flow measuring primaries, automatic dampers, fire dampers, coils, thermostats, and other apparatus requiring service and inspection in the duct system. Provide access doors upstream and downstream of air flow measuring primaries and heating and cooling coils. Provide doors that are a minimum 15 by 18 inches, unless otherwise shown. Where duct size does not accommodate this size door, make the doors as large as practicable. Equip doors 24 by 24 inches or larger with fasteners operable from inside and outside the duct. Use insulated type doors in insulated ducts.

2.9.3 Manual Balancing Dampers

Furnish manual balancing dampers with accessible operating mechanisms. Use chromium plated operators (with all exposed edges rounded) in finished portions of the building. Provide manual volume control dampers that are operated by locking-type quadrant operators. Install dampers that are 2 gauges heavier than the duct in which installed. Unless otherwise indicated, provide opposed blade type multileaf dampers with maximum blade width of 12 inches. Provide access doors or panels for all concealed damper operators and locking setscrews. Provide stand-off mounting brackets, bases, or adapters not less than the thickness of the insulation when the locking-type quadrant operators for dampers are installed on ducts to be thermally insulated, to provide clearance between the duct surface and the operator. Provide stand-off mounting items that are integral with the operator or standard accessory of the damper manufacturer.

2.9.4 Air Supply And Exhaust Air Dampers

Provide outdoor air supply and exhaust air dampers that have a maximum leakage rate when tested in accordance with AMCA 500-D as required by ASHRAE 90.1 - IP, including maximum Damper Leakage for:

a. Climate Zone 2 the maximum damper leakage at 1.0 inch w.g. for motorized dampers is 2 cfm per square foot of damper area and non-motorized dampers are not allowed.

2.9.5 Plenums and Casings for Field-Fabricated Units

2.9.5.1 Plenum and Casings

Fabricate and erect plenums and casings as shown in SMACNA 1966, as applicable. Construct system casing of not less than 16 gauge galvanized sheet steel. Furnish cooling coil drain pans with 1 inch threaded outlet to collect condensation from the cooling coils. Fabricate drain pans from not lighter than 16 gauge steel, galvanized after fabrication or of 18 gauge corrosion-resisting sheet steel conforming to ASTM A167, Type 304, welded and stiffened. Thermally insulate drain pans exposed to the atmosphere to prevent condensation. Coat insulation with a flame resistant waterproofing material. Provide separate drain pans for each vertical coil section, and a separate drain line for each pan. Size pans to ensure capture of entrained moisture on the downstream-air side of the coil. Seal openings in the casing, such as for piping connections, to prevent air leakage. Size the water seal for the drain to maintain a pressure of at least 2 inch water gauge greater than the maximum negative pressure in the coil space.

2.9.5.2 Casing

Terminate casings at the curb line and bolt each to the curb using galvanized angle, as indicated in SMACNA 1966.

2.9.5.3 Access Doors

Provide access doors in each section of the casing. Weld doorframes in place, gasket each door with neoprene, hinge with minimum of two brass hinges, and fasten with a minimum of two brass tension fasteners operable from inside and outside of the casing. Where possible, make doors 36 by 18 inches and locate them 18 inches above the floor. Where the space available does not accommodate doors of this size, use doors as large as the space accommodates. Swing doors so that fan suction or pressure holds doors in closed position, airtight. Provide a push-button station, located inside the casing, to stop the supply.

2.9.5.4 Factory-Fabricated Insulated Sheet Metal Panels

Factory-fabricated components are allowed for field-assembled units, provided all requirements specified for field-fabricated plenums and casings are met. Provide panels of modular design, pretested for structural strength, thermal control, condensation control, and acoustical control. Seal and insulate panel joints. Provide and gasket access doors to prevent air leakage. Provide panel construction that is not less than 20 gauge galvanized sheet steel, assembled with fasteners treated against corrosion. Provide standard length panels that deflect not more than 1/2 inch under operation. Construct details, including joint sealing, not specifically covered, as indicated in SMACNA 1966. Construct the plenums and casings to withstand the specified internal pressure of the air systems.

2.9.5.5 Duct Liner

Unless otherwise specified, duct liner is not permitted.

2.9.6 Diffusers, Registers, and Grilles

Provide factory-fabricated units of aluminum that distribute the specified quantity of air evenly over space intended without causing noticeable drafts, air movement faster than 50 fpm in occupied zone, or dead spots anywhere in the conditioned area. Provide outlets for diffusion, spread, throw, and noise level as required for specified performance. Certify performance according to ASHRAE 70. Provide sound rated and certified inlets and outlets according to ASHRAE 70. Provide sound power level as indicated. Provide diffusers and registers with volume damper with accessible operator, unless otherwise indicated; or if standard with the manufacturer, an automatically controlled device is acceptable. Provide opposed blade type volume dampers for all registers.

2.9.6.1 Diffusers

Provide diffuser types indicated. Furnish ceiling mounted units with anti-smudge devices, unless the diffuser unit minimizes ceiling smudging through design features. Provide diffusers with air deflectors of the type indicated. Install ceiling mounted units with rims tight against ceiling. Provide sponge rubber gaskets between ceiling and surface mounted diffusers for air leakage control. Provide suitable trim for

flush mounted diffusers. For connecting the duct to diffuser, provide duct collar that is airtight. Provide return or exhaust units that are similar to supply diffusers.

2.9.6.2 Registers and Grilles

Provide units that are four-way directional-control type, except provide return and exhaust registers that are fixed horizontal or vertical louver type similar in appearance to the supply register face. Furnish registers with sponge-rubber gasket between flanges and wall or ceiling. Install wall supply registers at least 6 inches below the ceiling unless otherwise indicated. Locate return and exhaust registers 6 inches above the floor unless otherwise indicated. Achieve four-way directional control by a grille face which can be rotated in 4 positions or by adjustment of horizontal and vertical vanes. Provide grilles as specified for registers, without volume control damper.

2.9.7 Louvers

Provide louvers for installation in exterior walls that are associated with the air supply and distribution system as specified in Section 07 60 00 FLASHING AND SHEET METAL.

2.9.8 Air Vents

Fabricate air vents, penthouses, and goosenecks from galvanized steel or aluminum sheets with galvanized or aluminum structural shapes. Provide sheet metal thickness, reinforcement, and fabrication that conform to SMACNA 1966. Accurately fit and secure louver blades to frames. Fold or bead edges of louver blades for rigidity and baffle these edges to exclude driving rain. Provide air vents, penthouses, and goosenecks with bird screen.

2.9.9 Bird Screens and Frames

Provide bird screens that conform to ASTM E2016, No. 2 mesh, aluminum or stainless steel. Provide "medium-light" rated aluminum screens. Provide "light" rated stainless steel screens. Provide removable type frames fabricated from either stainless steel or extruded aluminum.

2.10 AIR SYSTEMS EQUIPMENT

2.10.1 Fans

Test and rate fans according to AMCA 210. Calculate system effect on air moving devices in accordance with AMCA 201 where installed ductwork differs from that indicated on drawings. Install air moving devices to minimize fan system effect. Where system effect is unavoidable, determine the most effective way to accommodate the inefficiencies caused by system effect on the installed air moving device. The sound power level of the fans must not exceed 85 dBA when tested according to AMCA 300 and rated in accordance with AMCA 301. Provide all fans with an AMCA seal. Connect fans to the motors directly. Provide fans with personnel screens or guards on both suction and supply ends, except that the screens need not be provided, unless otherwise indicated, where ducts are connected to the fan. Provide fan and motor assemblies with vibration-isolation supports or mountings as indicated. Use vibration-isolation units that are standard products with published loading ratings. Select each fan to produce the capacity required at the fan static pressure indicated.

Provide sound power level as indicated. Obtain the sound power level values according to AMCA 300. Provide standard AMCA arrangement, rotation, and discharge as indicated. Provide power ventilators that conform to UL 705 and have a UL label.

2.10.1.1 In-Line Centrifugal Fans

Provide in-line fans with centrifugal backward inclined blades, stationary discharge conversion vanes, and adjustable motor mounts. Mount fans in a welded tubular casing. Provide a fan that axially flows the air in and out. Streamline inlets with conversion vanes to eliminate turbulence and provide smooth discharge air flow. Enclose and isolate fan bearings and drive shafts from the air stream. Provide precision, self aligning ball or roller type fan bearings that are sealed against dust and dirt and are permanently lubricated. Provide L50 rated bearing life at not less than 200,000 hours as defined by ABMA 9 and ABMA 11. Provide motors with totally enclosed enclosure. Provide magnetic motor starters across-the-line with general-purpose enclosures.

2.10.1.2 Panel Type Power Wall Ventilators

Provide propeller type fans, assembled on a reinforced metal panel with venturi opening spun into panel. Provide direct driven fans. Provide fans with wall mounting collar. Provide lubricated bearings. Equip fans with wheel and motor side metal or wire guards which have a corrosion-resistant finish. Provide totally enclosed fan cooled type motor enclosure. Install motor operated backdraft dampers where indicated.

2.11 FACTORY PAINTING

Factory paint new equipment, which are not of galvanized construction. Paint with a corrosion resisting paint finish according to ASTM A123/A123M or ASTM A924/A924M. Clean, phosphatize and coat internal and external ferrous metal surfaces with a paint finish which has been tested according to ASTM B117, ASTM D1654, and ASTM D3359. Submit evidence of satisfactory paint performance for a minimum of 125 hours for units to be installed indoors and 500 hours for units to be installed outdoors. Provide rating of failure at the scribe mark that is not less than 6, average creepage not greater than 1/8 inch. Provide rating of the inscribed area that is not less than 10, no failure. On units constructed of galvanized steel that have been welded, provide a final shop docket of zinc-rich protective paint on exterior surfaces of welds or welds that have burned through from the interior according to ASTM D520 Type I.

Field paint factory painting that has been damaged prior to acceptance by the Contracting Officer in compliance with the requirements of paragraph FIELD PAINTING OF MECHANICAL EQUIPMENT.

2.12 SUPPLEMENTAL COMPONENTS/SERVICES

2.12.1 Refrigerant Piping

The requirements for refrigerant piping are specified in Section 23 23 00 REFRIGERANT PIPING.

2.12.2 Condensate Drain Lines

Provide and install condensate drainage for each item of equipment that generates condensate in accordance with Section 22 00 00 PLUMBING, GENERAL

PURPOSE except as modified herein.

2.12.3 Backflow Preventers

The requirements for backflow preventers are specified in Section 22 00 00 PLUMBING, GENERAL PURPOSE.

2.12.4 Insulation

The requirements for shop and field applied insulation are specified in Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS.

2.12.5 Controls

The requirements for controls are specified in Section 23 05 93 TESTING, ADJUSTING, AND BALANCING OF HVAC SYSTEMS and Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

PART 3 EXECUTION

3.1 EXAMINATION

After becoming familiar with all details of the work, verify all dimensions in the field, and advise the Contracting Officer of any discrepancy before performing the work.

3.2 INSTALLATION

a. Install materials and equipment in accordance with the requirements of the contract drawings and approved manufacturer's installation instructions. Accomplish installation by workers skilled in this type of work. Perform installation so that there is no degradation of the designed fire ratings of walls, partitions, ceilings, and floors.

b. No installation is permitted to block or otherwise impede access to any existing machine or system. Install all hinged doors to swing open a minimum of 120 degrees. Provide an area in front of all access doors that clears a minimum of 3 feet. In front of all access doors to electrical circuits, clear the area the minimum distance to energized circuits as specified in OSHA Standards, part 1910.333 (Electrical-Safety Related work practices)and an additional 3 feet.

c. Except as otherwise indicated, install emergency switches and alarms in conspicuous locations. Mount all indicators, to include gauges, meters, and alarms in order to be easily visible by people in the area.

3.2.1 Condensate Drain Lines

Provide water seals in the condensate drain from all units. Provide a depth of each seal of 2 inches plus the number of inches, measured in water gauge, of the total static pressure rating of the unit to which the drain is connected. Provide water seals that are constructed of 2 tees and an appropriate U-bend with the open end of each tee plugged. Provide pipe cap or plug cleanouts where indicated. Connect drains indicated to connect to the sanitary waste system using an indirect waste fitting. Insulate air conditioner drain lines as specified in Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS.

3.2.2 Equipment and Installation

Provide frames and supports for tanks, compressors, pumps, valves, air handling units, fans, coils, dampers, and other similar items requiring supports. Floor mount or ceiling hang air handling units as indicated. Anchor and fasten as detailed. Set floor-mounted equipment on not less than 6 inch concrete pads or curbs doweled in place unless otherwise indicated. Make concrete foundations heavy enough to minimize the intensity of the vibrations transmitted to the piping, duct work and the surrounding structure, as recommended in writing by the equipment manufacturer. In lieu of a concrete pad foundation, build a concrete pedestal block with isolators placed between the pedestal block and the floor. Make the concrete foundation or concrete pedestal block a mass not less than three times the weight of the components to be supported. Provide the lines connected to the pump mounted on pedestal blocks with flexible connectors. Submit foundation drawings as specified in paragraph DETAIL DRAWINGS. Provide concrete for foundations as specified in Section 03 30 00 CAST-IN-PLACE CONCRETE.

3.2.3 Access Panels

Install access panels for concealed valves, vents, controls, dampers, and items requiring inspection or maintenance of sufficient size, and locate them so that the concealed items are easily serviced and maintained or completely removed and replaced.

3.2.4 Flexible Duct

Install pre-insulated flexible duct in accordance with the latest printed instructions of the manufacturer to ensure a vapor tight joint. Provide hangers, when required to suspend the duct, of the type recommended by the duct manufacturer and set at the intervals recommended.

3.2.5 Metal Ductwork

Install according to SMACNA 1966 unless otherwise indicated. Install duct supports for sheet metal ductwork according to SMACNA 1966, unless otherwise specified. Do not use friction beam clamps indicated in SMACNA 1966. Anchor risers on high velocity ducts in the center of the vertical run to allow ends of riser to move due to thermal expansion. Erect supports on the risers that allow free vertical movement of the duct. Attach supports only to structural framing members and concrete slabs. Do not anchor supports to metal decking unless a means is provided and approved for preventing the anchor from puncturing the metal decking. Where supports are required between structural framing members, provide suitable intermediate metal framing. Where C-clamps are used, provide retainer clips.

3.2.6 Dust Control

To prevent the accumulation of dust, debris and foreign material during construction, perform temporary dust control protection. Protect the distribution system (supply and return) with temporary seal-offs at all inlets and outlets at the end of each day's work. Keep temporary protection in place until system is ready for startup.

3.2.7 Insulation

Provide thickness and application of insulation materials for ductwork,

piping, and equipment according to Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS. Externally insulate outdoor air intake ducts and plenums up to the point where the outdoor air reaches the conditioning unit.

3.2.8 Duct Test Holes

Provide holes with closures or threaded holes with plugs in ducts and plenums as indicated or where necessary for the use of pitot tube in balancing the air system. Plug insulated duct at the duct surface, patched over with insulation and then marked to indicate location of test hole if needed for future use.

3.3 EQUIPMENT PADS

Provide equipment pads to the dimensions shown or, if not shown, to conform to the shape of each piece of equipment served with a minimum 6 -inch margin around the equipment and supports. Allow equipment bases and foundations, when constructed of concrete or grout, to cure a minimum of 14 calendar days before being loaded.

3.4 CUTTING AND PATCHING

Install work in such a manner and at such time that a minimum of cutting and patching of the building structure is required. Make holes in exposed locations, in or through existing floors, by drilling and smooth by sanding. Use of a jackhammer is permitted only where specifically approved. Make holes through masonry walls to accommodate sleeves with an iron pipe masonry core saw.

3.5 CLEANING

Thoroughly clean surfaces of piping and equipment that have become covered with dirt, plaster, or other material during handling and construction before such surfaces are prepared for final finish painting or are enclosed within the building structure. Before final acceptance, clean mechanical equipment, including piping, ducting, and fixtures, and free from dirt, grease, and finger marks. When the work area is in an occupied space such as office, laboratory or warehouse protect all furniture and equipment from dirt and debris. Incorporate housekeeping for field construction work which leaves all furniture and equipment in the affected area free of construction generated dust and debris; and, all floor surfaces vacuum-swept clean.

3.6 PENETRATIONS

Provide sleeves and prepared openings for duct mains, branches, and other penetrating items, and install during the construction of the surface to be penetrated. Cut sleeves flush with each surface. Place sleeves for round duct 15 inches and smaller. Build framed, prepared openings for round duct larger than 15 inches and square, rectangular or oval ducts. Sleeves and framed openings are also required where grilles, registers, and diffusers are installed at the openings. Provide one inch clearance between penetrating and penetrated surfaces except at grilles, registers, and diffusers. Pack spaces between sleeve or opening and duct or duct insulation with mineral fiber conforming with ASTM C553, Type 1, Class B-2.

3.6.1 Sleeves

Fabricate sleeves, except as otherwise specified or indicated, from 20

gauge thick mill galvanized sheet metal. Where sleeves are installed in bearing walls or partitions, provide black steel pipe conforming with ASTM A53/A53M, Schedule 20.

3.6.2 Framed Prepared Openings

Fabricate framed prepared openings from 20 gauge galvanized steel, unless otherwise indicated.

3.6.3 Insulation

Provide duct insulation in accordance with Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS continuous through sleeves and prepared openings except firewall penetrations. Terminate duct insulation at fire dampers and flexible connections. For duct handling air at or below 60 degrees F, provide insulation continuous over the damper collar and retaining angle of fire dampers, which are exposed to unconditioned air.

3.6.4 Closure Collars

Provide closure collars of a minimum 4 inches wide, unless otherwise indicated, for exposed ducts and items on each side of penetrated surface, except where equipment is installed. Install collar tight against the surface and fit snugly around the duct or insulation. Grind sharp edges smooth to prevent damage to penetrating surface. Fabricate collars for round ducts 15 inches in diameter or less from 20 gauge galvanized steel. Fabricate collars for square and rectangular ducts, or round ducts with minimum dimension over 15 inches from 18 gauge galvanized steel. Fabricate collars for square and rectangular ducts with a maximum side of 15 inches or less from 20 gauge galvanized steel. Install collars with fasteners a maximum of 6 inches on center. Attach to collars a minimum of 4 fasteners where the opening is 12 inches in diameter or less, and a minimum of 8 fasteners where the opening is 20 inches in diameter or less.

3.6.5 Firestopping

Where ducts pass through fire-rated walls, fire partitions, and fire rated chase walls, seal the penetration with UL listed fire stopping materials.

3.7 FIELD PAINTING OF MECHANICAL EQUIPMENT

Clean, pretreat, prime and paint metal surfaces; except aluminum surfaces need not be painted. Apply coatings to clean dry surfaces. Clean the surfaces to remove dust, dirt, rust, oil and grease by wire brushing and solvent degreasing prior to application of paint, except clean to bare metal on metal surfaces subject to temperatures in excess of 120 degrees F. Where more than one coat of paint is specified, apply the second coat after the preceding coat is thoroughly dry. Lightly sand damaged painting and retouch before applying the succeeding coat. Provide aluminum or light gray finish coat.

3.7.1 Temperatures less than 120 degrees F

Immediately after cleaning, apply one coat of pretreatment primer applied to a minimum dry film thickness of 0.3 mil, one coat of primer applied to a minimum dry film thickness of one mil; and two coats of enamel applied to a minimum dry film thickness of one mil per coat to metal surfaces subject to temperatures less than 120 degrees F.

3.7.2 Finish Painting

The requirements for finish painting of items only primed at the factory, and surfaces not specifically noted otherwise, are specified in Section 09 90 00 PAINTS AND COATINGS.

3.8 IDENTIFICATION SYSTEMS

Provide identification tags made of brass, engraved laminated plastic, or engraved anodized aluminum, indicating service and item number on all valves and dampers. Provide tags that are 1-3/8 inch minimum diameter with stamped or engraved markings. Make indentations black for reading clarity. Attach tags to valves with No. 12 AWG 0.0808-inch diameter corrosion-resistant steel wire, copper wire, chrome-plated beaded chain or plastic straps designed for that purpose.

3.9 DAMPER ACCEPTANCE TEST

Submit the proposed schedule, at least 2 weeks prior to the start of test. Operate all fire dampers and smoke dampers under normal operating conditions, prior to the occupancy of a building to determine that they function properly. Test each fire damper equipped with fusible link by having the fusible link cut in place. Test dynamic fire dampers with the air handling and distribution system running. Reset all fire dampers with the fusible links replaced after acceptance testing. To ensure optimum operation and performance, install the damper so it is square and free from racking.

3.10 TESTING, ADJUSTING, AND BALANCING

The requirements for testing, adjusting, and balancing are specified in Section 23 05 93 TESTING, ADJUSTING AND BALANCING FOR HVAC. Begin testing, adjusting, and balancing only when the air supply and distribution, including controls, has been completed, with the exception of performance tests.

3.11 PERFORMANCE TESTS

Conduct performance tests as required in Section 23 05 93 Testing, Adjusting and Balancing for HVAC and Section 23 09 00 Instrumentation and Control for HVAC.

3.12 CLEANING AND ADJUSTING

Wipe equipment clean, with no traces of oil, dust, dirt, or paint spots. Provide temporary filters prior to startup of all fans that are operated during construction, and provide new filters after all construction dirt has been removed from the building, and the ducts, plenums, casings, and other items specified have been vacuum cleaned. Perform and document that proper "Indoor Air Quality During Construction" procedures have been followed; provide documentation showing that after construction ends, and prior to occupancy, new filters were provided and installed. Maintain system in this clean condition until final acceptance. Properly lubricate bearings with oil or grease as recommended by the manufacturer. Tighten belts to proper tension. Adjust control valves and other miscellaneous equipment requiring adjustment to setting indicated or directed. Adjust fans to the speed indicated by the manufacturer to meet specified conditions. Maintain all equipment installed under the contract until close out documentation is received, the project is completed and the

building has been documented as beneficially occupied.

3.13 OPERATION AND MAINTENANCE

3.13.1 Operation and Maintenance Manuals

Submit six manuals at least 2 weeks prior to field training. Submit data complying with the requirements specified in Section 01 78 23 OPERATION AND MAINTENANCE DATA. Submit Data Package 3 for the items/units listed under SD-10 Operation and Maintenance Data

3.13.2 Operation And Maintenance Training

Conduct a training course for the members of the operating staff as designated by the Contracting Officer. Make the training period consist of a total of 8 hours of normal working time and start it after all work specified herein is functionally completed and the Performance Tests have been approved. Conduct field instruction that covers all of the items contained in the Operation and Maintenance Manuals as well as demonstrations of routine maintenance operations. Submit the proposed On-site Training schedule concurrently with the Operation and Maintenance Manuals and at least 14 days prior to conducting the training course.

-- End of Section --

SECTION 23 64 10

WATER CHILLERS, VAPOR COMPRESSION TYPE
11/16, CHG 2: 08/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR-CONDITIONING, HEATING AND REFRIGERATION INSTITUTE (AHRI)

AHRI 550/590 I-P	(2015; ERTA 2016) Performance Rating Of Water-Chilling and Heat Pump Water-Heating Packages Using the Vapor Compression Cycle

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ANSI/ASHRAE 15 & 34	(2013) ANSI/ASHRAE Standard 15-Safety Standard for Refrigeration Systems and ANSI/ASHRAE Standard 34-Designation and Safety Classification of Refrigerants

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME BPVC SEC VIII D1	(2019) BPVC Section VIII-Rules for Construction of Pressure Vessels Division 1

AMERICAN WELDING SOCIETY (AWS)

AWS Z49.1	(2012) Safety in Welding and Cutting and Allied Processes

ASTM INTERNATIONAL (ASTM)

ASTM B117	(2019) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM D520	(2000; R 2011) Zinc Dust Pigment
ASTM E84	(2020) Standard Test Method for Surface Burning Characteristics of Building Materials

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA MG 1	(2018) Motors and Generators
NEMA MG 11	(1977; R 2012) Energy Management Guide for Selection and Use of Single Phase Motors

1.2 SUBMITTALS

Government approval is required for submittals with a "G" or "S"

classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Water Chiller; G

Verification of Dimensions

Demonstrations

SD-07 Certificates

Refrigeration System; G

SD-08 Manufacturer's Instructions

Water Chiller - Installation Instructions; G

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals; G

1.3 SAFETY REQUIREMENTS

Exposed moving parts, parts that produce high operating temperature, parts which may be electrically energized, and parts that may be a hazard to operating personnel must be insulated, fully enclosed, guarded, or fitted with other types of safety devices. Safety devices must be installed so that proper operation of equipment is not impaired. Welding and cutting safety requirements must be in accordance with AWS Z49.1.

1.4 DELIVERY, STORAGE, AND HANDLING

Stored items must be protected from the weather, humidity and temperature variations, dirt and dust, or other contaminants. Proper protection and care of all material both before and during installation will be the Contractor's responsibility. Any materials found to be damaged must be replaced at the Contractor's expense. During installation, piping and similar openings must be capped to keep out dirt and other foreign matter.

1.5 PROJECT REQUIREMENTS

1.5.1 Verification of Dimensions

The Contractor must become familiar with all details of the work, verify all dimensions in the field, and advise the Contracting Officer of any discrepancy before performing any work.

PART 2 PRODUCTS

2.1 STANDARD COMMERCIAL PRODUCTS

Materials and equipment will be standard Commercial cataloged products of a manufacturer regularly engaged in the manufacturing of such products, which are of a similar material, design and workmanship. These products must have a two year record of satisfactory field service prior to bid opening. The two year record of service must include applications of

equipment and materials under similar circumstances and of similar size. Products having less than a two year record of satisfactory field service will be acceptable if a certified record of satisfactory field service for not less than 6000 hours can be shown. The 6000 hour service record must not include any manufacturer's prototype or factory testing. Satisfactory field service must have been completed by a product that has been, and presently is being sold or offered for sale on the commercial market through the following copyrighted means: advertisements, manufacturer's catalogs, or brochures.

2.2 MANUFACTURER'S STANDARD NAMEPLATES

Major equipment including chillers, compressors, compressor drivers, condensers, water coolers, receivers, refrigerant leak detectors, heat exchanges, fans, and motors must have the manufacturer's name, address, type or style, model or serial number, and catalog number on a plate secured to the item of equipment. Plates must be durable and legible throughout equipment life. Plates must be fixed in prominent locations with nonferrous screws or bolts.

2.3 ELECTRICAL WORK

a. Provide motors, controllers, integral disconnects, contactors, and controls with their respective pieces of equipment, except controllers indicated as part of motor control centers. Provide electrical equipment, including motors and wiring, as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Manual or automatic control and protective or signal devices required for the operation specified and control wiring required for controls and devices specified, but not shown, must be provided. For packaged equipment, the manufacturer must provide controllers including the required monitors and timed restart.

b. For single-phase motors, provide high-efficiency type, fractional-horsepower alternating-current motors, including motors that are part of a system, in accordance with NEMA MG 11.

c. For polyphase motors, provide squirrel-cage medium induction motors, including motors that are part of a system, and that meet the efficiency ratings for premium efficiency motors in accordance with NEMA MG 1.

d. Provide motors in accordance with NEMA MG 1 and of sufficient size to drive the load at the specified capacity without exceeding the nameplate rating of the motor. Motors must be rated for continuous duty with the enclosure specified. Motor duty requirements must allow for maximum frequency start-stop operation and minimum encountered interval between start and stop. Motor torque must be capable of accelerating the connected load within 20 seconds with 80 percent of the rated voltage maintained at motor terminals during one starting period. Provide motor starters complete with thermal overload protection and other necessary appurtenances. Motor enclosure type may be either TEAO or TEFC.

2.4 SELF-CONTAINED WATER CHILLERS, VAPOR COMPRESSION TYPE

Unless necessary for delivery purposes, units must be assembled, leak-tested, charged (refrigerant and oil), and adjusted at the factory. In lieu of delivery constraints, a chiller may be assembled, leak-tested,

charged (refrigerant and oil), and adjusted at the job site by a factory representative. Unit components delivered separately must be sealed and charged with a nitrogen holding charge. Parts weighing 50 pounds or more which must be removed for inspection, cleaning, or repair, such as motors, gear boxes, cylinder heads, casing tops, condenser, and cooler heads, must have lifting eyes or lugs. Chiller must be provided with a single point wiring connection for incoming power supply.

2.4.1 Scroll, Reciprocating, or Rotary Screw Type

Chiller must be certified for performance per AHRI 550/590 I-P. If specified performance is outside of the Application Rating Conditions of AHRI 550/590 I-P, Table 2 then the chiller's performance must be rated in accordance with AHRI 550/590 I-P. Chiller must conform to ANSI/ASHRAE 15 & 34. As a minimum, chiller must include the following components as defined in paragraph CHILLER COMPONENTS.

a. Refrigerant and oil

b. Structural base

c. Chiller refrigerant circuit

d. Controls package

e. Scroll, reciprocating, or rotary screw compressor

f. Compressor driver, electric motor

g. Compressor driver connection

h. Water cooler (evaporator)

i. Air-cooled condenser coil

2.5 CHILLER COMPONENTS

2.5.1 Refrigerant and Oil

Refrigerants must be one of the fluorocarbon gases. Refrigerants must have number designations and safety classifications in accordance with ANSI/ASHRAE 15 & 34. CFC-based refrigerants are prohibited. Refrigerants must have an Ozone Depletion Potential (ODP) no greater than 0.0, with the exception of R-123. Provide SDS sheets for all refrigerants.

2.5.2 Structural Base

Chiller and individual chiller components must be provided with a factory-mounted structural steel base (welded or bolted) or support legs. Chiller and individual chiller components must be isolated from the building structure by means of molded neoprene isolation pads.

2.5.3 Chiller Refrigerant Circuit

Chiller refrigerant circuit must be completely piped and factory leak tested in accordance with ANSI/ASHRAE 15 & 34. For multicompressor units, not less than 2 independent refrigerant circuits must be provided. Circuit must include as a minimum a combination filter and drier, combination sight glass and moisture indicator, an electronic or

thermostatic expansion valve with external equalizer or float valve, charging ports, compressor service valves for field-serviceable compressors, and superheat adjustment.

2.5.4 Controls Package

Provide chillers with a complete factory-mounted, microprocessor based operating and safety control system. Controls package must contain as a minimum a digital display, an on-auto-off switch, motor starters, disconnect switches, power wiring, and control wiring. Controls package must provide operating controls, monitoring capabilities, programmable setpoints, safety controls, and interfaces with Siemens controls.

2.5.4.1 Operating Controls

Chiller must be provided with the following adjustable operating controls as a minimum.

a. Leaving chilled water temperature control

b. Adjustable timer or automated controls to prevent a compressor from short cycling

c. Automatic lead/lag controls (adjustable) for multi-compressor units

d. Load limiting

e. System capacity control to adjust the unit capacity in accordance with the system load and the programmable setpoints. Controls must automatically re-cycle the chiller on power interruption.

f. Startup and head pressure controls to allow system operation at all ambient temperatures down to 20 degrees F.

g. Fan sequencing for air-cooled condenser

2.5.4.2 Monitoring Capabilities

During normal operations, the control system must be capable of monitoring and displaying the following operating parameters. Access and operation of display must not require opening or removing any panels or doors.

a. Entering and leaving chilled water temperatures

b. Entering and leaving chilled water pressure

c. Entering and leaving condenser water pressure. Condenser water flow

d. Self diagnostic

e. Operation status

f. Operating hours

g. Number of starts

h. Compressor status (on or off)

i. Compressor load (percent)

j. Refrigerant discharge and suction pressures

k. Magnetic bearing levitation status (if applicable)

m. Oil pressure

n. Condenser water entering and leaving temperatures

2.5.4.3 Configurable Setpoints

The control system must be capable of being configured directly at the unit's interface panel. The programmable setpoints must include the following as a minimum:

a. Leaving Chilled Water Temperature

b. Leaving Condenser Water Temperature

c. Time Clock/Calendar Date

2.5.4.4 Safety Controls with Manual Reset

Chiller must be provided with the following safety controls which automatically shutdown the chiller and which require manual reset.

a. Low chilled water temperature protection

b. High condenser refrigerant discharge pressure protection

c. Low evaporator pressure protection

d. Chilled water flow detection

e. High motor winding temperature protection

f. Low oil flow protection if applicable

k. Motor current overload and phase loss protection

2.5.4.5 Safety Controls with Automatic Reset

Chiller must be provided with the following safety controls which automatically shutdown the chiller and which provide automatic reset.

a. Over/under voltage protection

b. Chilled water flow interlock

e. Phase reversal protection2.5.4.6 Remote Alarm

During the initiation of a safety shutdown, a chiller's control system must be capable of activating a remote alarm bell. In coordination with the chiller, the Contractor must provide an alarm circuit (including transformer if applicable) and a minimum 4 inch diameter alarm bell. Alarm circuit must activate bell in the event of machine shutdown due to the chiller's monitoring of safety controls. The alarm bell must not sound for a chiller that uses low-pressure cutout as an operating control.

2.5.4.7 Utility Monitoring and Control System Interface

Provide a Utility Monitoring and Control System (UMCS) interface to existing Siemens BAS. The interface must provide all system operating conditions, capacity controls, and safety shutdown conditions as network points. In addition, the following points must be overridable via the network interface:

a. Unit Start/Stop

b. Leaving Chilled Water Temperature Setpoint

c. Leaving Condenser Water Temperature Setpoint

2.5.5 Compressor(s)

2.5.5.1 Scroll Compressor(s)

Compressors must be of the hermetically sealed design. Compressors must be mounted on vibration isolators to minimize vibration and noise. Rotating parts must be statically and dynamically balanced at the factory to minimize vibration. Lubrication system must be centrifugal pump type equipped with a means for determining oil level and an oil charging valve. Crankcase oil heater must be provided.

2.5.6 Compressor Driver, Electric Motor

Components such as motors, starters, variable speed drives and wiring must be in accordance with paragraph ELECTRICAL WORK. Motor starter and/or Variable frequency drive must be unit mounted as indicated with starter and/or variable frequency drive type, wiring, and accessories coordinated with the chiller manufacturer.

2.5.7 Air-Cooled Condenser Coil

Condenser coil must be of the extended-surface fin-and-tube type and must be constructed of seamless copper tubes with compatible copper or aluminum fins. Fins must be soldered or mechanically bonded to the tubes and installed in a metal casing. Coils must be circuited and sized for a minimum of 5 degrees F subcooling and full pumpdown capacity. Coil must be factory leak and pressure tested after assembly in accordance with ANSI/ASHRAE 15 & 34. Coil shall be factory coated with a sea coast coating.

2.5.8 Receivers

Receiver must bear a stamp certifying compliance with ASME BPVC SEC VIII D1 and must meet the requirements of ANSI/ASHRAE 15 & 34. Inner surfaces must be thoroughly cleaned by sandblasting or other approved means. Each receiver must have a storage capacity not less than 20 percent in excess of that required for the fully-charged system. Each receiver must be equipped with inlet, outlet drop pipe, drain plug, purging valve, relief valves of capacity and setting required by ANSI/ASHRAE 15 & 34, and two bull's eye liquid-level sight glasses. Sight glasses must be in the same vertical plane, 90 degrees apart, perpendicular to the axis of the receiver, and not over 3 inches horizontally from the drop pipe measured along the axis of the receiver. In lieu of bull's eye sight glass, external gauge glass with metal glass guard and automatic closing stop valves may be provided.

2.6 ACCESSORIES

2.6.1 Refrigerant Relief Valve/Rupture Disc Assembly

The assembly must be a combination pressure relief valve and rupture disc designed for refrigerant usage. The assembly must be in accordance with ASME BPVC SEC VIII D1 and ANSI/ASHRAE 15 & 34. The assembly must be provided with a pressure gauge assembly which will provide local indication if a rupture disc is broken. Rupture disc must be the non-fragmenting type.

2.7 FABRICATION

2.7.1 Factory Coating

Unless otherwise specified, equipment and component items, when fabricated from ferrous metal, must be factory finished with the manufacturer's standard finish, except that items located outside of buildings must have weather resistant finishes that will withstand 500 hours exposure to the salt spray test specified in ASTM B117 using a 5 percent sodium chloride solution. Immediately after completion of the test, the specimen must show no signs of blistering, wrinkling, cracking, or loss of adhesion and no sign of rust creepage beyond 1/8 inch on either side of the scratch mark. Cut edges of galvanized surfaces where hot-dip galvanized sheet steel is used must be coated with a zinc-rich coating conforming to ASTM D520, Type I.

2.7.2 Factory Applied Insulation

Chiller must be provided with factory installed insulation on surfaces subject to sweating including the water cooler, suction line piping, economizer, and cooling lines. Insulation on heads of coolers may be field applied, however it must be installed to provide easy removal and replacement of heads without damage to the insulation. Where motors are the gas-cooled type, factory installed insulation must be provided on the cold-gas inlet connection to the motor per manufacturer's standard practice. Factory insulated items installed outdoors are not required to be fire-rated. As a minimum, factory insulated items installed indoors must have a flame spread index no higher than 75 and a smoke developed index no higher than 150. Factory insulated items (no jacket) installed indoors and which are located in air plenums, in ceiling spaces, and in attic spaces must have a flame spread index no higher than 25 and a smoke developed index no higher than 50. Flame spread and smoke developed indexes must be determined by ASTM E84. Insulation must be tested in the same density and installed thickness as the material to be used in the actual construction. Material supplied by a manufacturer with a jacket must be tested as a composite material. Jackets, facings, and adhesives must have a flame spread index no higher than 25 and a smoke developed index no higher than 50 when tested in accordance with ASTM E84.

2.8 SUPPLEMENTAL COMPONENTS/SERVICES

2.8.1 Temperature Controls

Chiller control packages must be fully coordinated with and integrated into the existing air-conditioning system.

PART 3 EXECUTION

3.1 INSTALLATION

Installation of water chiller systems including materials, installation, workmanship, fabrication, assembly, erection, examination, inspection, and testing must be in accordance with the manufacturer's written installation instructions, including the following:

(1) Water chiller - installation instructions

3.1.1 Installation Instructions

Provide manufacturer's standard catalog data, at least 2 weeks prior to the purchase or installation of a particular component, highlighted to show features such as materials, dimensions, options, performance and efficiency. Data must include manufacturer's recommended installation instructions and procedures. Data must be adequate to demonstrate compliance with contract requirements.

3.1.2 Certificates

Where the system, components, or equipment are specified to comply with requirements of AGA, NFPA, ARI, ASHRAE, ASME, or UL, proof of such compliance must be provided. The label or listing of the specified agency must be acceptable evidence. In lieu of the label or listing, a written certificate from an approved, nationally recognized testing organization equipped to perform such services, stating that the items have been tested and conform to the requirements and testing methods of the specified agency may be submitted. When performance requirements of this project's drawings and specifications vary from standard ARI rating conditions, computer printouts, catalog, or other application data certified by ARI or a nationally recognized laboratory as described above must be included. If ARI does not have a current certification program that encompasses such application data, the manufacturer may self certify that his application data complies with project performance requirements in accordance with the specified test standards.

3.1.3 Operation and Maintenance Manuals

Provide four complete copies of an operation manual in bound 8 1/2 by 11 inch booklets listing step-by-step procedures required for system startup, operation, abnormal shutdown, emergency shutdown, and normal shutdown at least 2 weeks prior to the first training course. The booklets must include the manufacturer's name, model number, and parts list. The manuals must include the manufacturer's name, model number, service manual, and a brief description of all equipment and their basic operating features. Four complete copies of maintenance manual in bound 8 1/2 by 11 inch booklets listing routine maintenance procedures, possible breakdowns and repairs, and a trouble shooting guide. The manuals must include piping and equipment layouts and simplified wiring and control diagrams of the system as installed.

3.1.4 Refrigeration System

3.1.4.1 Equipment

Refrigeration equipment and the installation thereof must conform to ANSI/ASHRAE 15 & 34. Necessary supports must be provided for all

equipment, appurtenances, and pipe as required, including frames or supports for compressors, pumps, condensers, water coolers, and similar items.

3.1.5 Field Applied Insulation

Field installed insulation must be as specified in Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS, except as defined differently herein.

3.2 CLEANING AND ADJUSTING

Equipment must be wiped clean, with all traces of oil, dust, dirt, or paint spots removed. Provide temporary filters for all fans that are operated during construction. Perform and document that proper procedures have been followed; this includes providing documentation showing that after construction ends, and prior to occupancy, new filters were provided and installed. System must be maintained in this clean condition until final acceptance. Bearings must be properly lubricated with oil or grease as recommended by the manufacturer. Belts must be tightened to proper tension. Control valves and other miscellaneous equipment requiring adjustment must be adjusted to setting indicated or directed. Fans must be adjusted to the speed indicated by the manufacturer to meet specified conditions. At least one week before the official equipment warranty start date, all condenser coils on air-cooled water chillers and split-system water chillers must be cleaned in accordance with the chiller manufacturer's instructions. This work covers two coil cleanings. The condenser coils must be cleaned with an approved coil cleaner by a service technician, factory trained by the chiller manufacturer. The condenser coil cleaner must not have any detrimental affect on the materials or protective coatings on the condenser coils. Testing, adjusting, and balancing must be as specified in Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC.

3.3 DEMONSTRATIONS

Contractor must conduct a training course for the operating staff as designated by the Contracting Officer. The training period must consist of a total 8 hours of normal working time and start after the system is functionally completed but prior to final acceptance tests. The training course must cover all of the items contained in the approved operation and maintenance manuals as well as demonstrations of routine maintenance operations.

Provide a schedule, at least 2 weeks prior to the date of the proposed training course, which identifies the date, time, and location for the training.

-- End of Section --

SECTION 23 64 26

CHILLED, CHILLED-HOT, AND CONDENSER WATER PIPING SYSTEMS
08/09, CHG 5: 11/19

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI Z21.22/CSA 4.4	(2015; R 2020) Relief Valves for Hot Water Supply Systems

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B1.20.1	(2013; R 2018) Pipe Threads, General Purpose (Inch)
ASME B16.1	(2020) Gray Iron Pipe Flanges and Flanged Fittings Classes 25, 125, and 250
ASME B16.3	(2021) Malleable Iron Threaded Fittings, Classes 150 and 300
ASME B16.9	(2018) Factory-Made Wrought Buttwelding Fittings
ASME B16.11	(2016) Forged Fittings, Socket-Welding and Threaded
ASME B16.18	(2018) Cast Copper Alloy Solder Joint Pressure Fittings
ASME B16.21	(2021) Nonmetallic Flat Gaskets for Pipe Flanges
ASME B16.22	(2018) Standard for Wrought Copper and Copper Alloy Solder Joint Pressure Fittings
ASME B16.26	(2018) Standard for Cast Copper Alloy Fittings for Flared Copper Tubes
ASME B16.39	(2020) Standard for Malleable Iron Threaded Pipe Unions; Classes 150, 250, and 300
ASME B31.9	(2020) Building Services Piping
ASME B40.100	(2013) Pressure Gauges and Gauge Attachments

AMERICAN SOCIETY OF SANITARY ENGINEERING (ASSE)

ASSE 1003	(2020) Performance Requirements for Water Pressure Reducing Valves for Domestic Water Distribution Systems - (ANSI approved 2010)

AMERICAN WATER WORKS ASSOCIATION (AWWA)

AWWA C606	(2015) Grooved and Shouldered Joints

AMERICAN WELDING SOCIETY (AWS)

AWS A5.8/A5.8M	(2019) Specification for Filler Metals for Brazing and Braze Welding
AWS BRH	(2007; 5th Ed) Brazing Handbook
AWS D1.1/D1.1M	(2020) Structural Welding Code - Steel
AWS Z49.1	(2012) Safety in Welding and Cutting and Allied Processes

ASTM INTERNATIONAL (ASTM)

ASTM A47/A47M	(1999; R 2022; E 2022) Standard Specification for Ferritic Malleable Iron Castings
ASTM A53/A53M	(2022) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
ASTM A106/A106M	(2019a) Standard Specification for Seamless Carbon Steel Pipe for High-Temperature Service
ASTM A183	(2014; R 2020) Standard Specification for Carbon Steel Track Bolts and Nuts
ASTM A536	(1984; R 2019; E 2019) Standard Specification for Ductile Iron Castings
ASTM A653/A653M	(2020) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM A733	(2016) Standard Specification for Welded and Seamless Carbon Steel and Austenitic Stainless Steel Pipe Nipples
ASTM B32	(2020) Standard Specification for Solder Metal
ASTM B42	(2020) Standard Specification for Seamless Copper Pipe, Standard Sizes
ASTM B62	(2017) Standard Specification for

	Composition Bronze or Ounce Metal Castings
ASTM B75/B75M	(2020) Standard Specification for Seamless Copper Tube
ASTM B88	(2020) Standard Specification for Seamless Copper Water Tube
ASTM B117	(2019) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM B813	(2016) Standard Specification for Liquid and Paste Fluxes for Soldering of Copper and Copper Alloy Tube
ASTM D520	(2000; R 2011) Zinc Dust Pigment
ASTM D2000	(2018) Standard Classification System for Rubber Products in Automotive Applications
ASTM D3308	(2012; R 2017) Standard Specification for PTFE Resin Skived Tape
ASTM E84	(2020) Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM F1007	(2018) Standard Specification for Pipeline Expansion Joints of the Packed Slip Type for Marine Application
ASTM F1120	(1987; R 2019) Standard Specification for Circular Metallic Bellows Type Expansion Joints for Piping Applications
ASTM F1199	(1988; R 2019) Cast (All Temperatures and Pressures) and Welded Pipe Line Strainers (150 psig and 150 degrees F Maximum)

EXPANSION JOINT MANUFACTURERS ASSOCIATION (EJMA)

EJMA Stds	(2015) (10th Ed) EJMA Standards

HYDRAULIC INSTITUTE (HI)

HI 1.1-1.2	(2014) Rotodynamic (Centrifugal) Pump for Nomenclature and Definitions

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY (MSS)

MSS SP-25	(2018) Standard Marking System for Valves, Fittings, Flanges and Unions
MSS SP-58	(2018) Pipe Hangers and Supports - Materials, Design and Manufacture, Selection, Application, and Installation
MSS SP-67	(2017; Errata 1 2017) Butterfly Valves

MSS SP-69	(2003; Notice 2012) Pipe Hangers and Supports - Selection and Application (ANSI Approved American National Standard)
MSS SP-70	(2011) Gray Iron Gate Valves, Flanged and Threaded Ends
MSS SP-71	(2018) Gray Iron Swing Check Valves, Flanged and Threaded Ends
MSS SP-72	(2010a) Ball Valves with Flanged or Butt-Welding Ends for General Service
MSS SP-78	(2011) Cast Iron Plug Valves, Flanged and Threaded Ends
MSS SP-80	(2019) Bronze Gate, Globe, Angle and Check Valves
MSS SP-85	(2011) Gray Iron Globe & Angle Valves Flanged and Threaded Ends
MSS SP-110	(2010) Ball Valves Threaded, Socket-Welding, Solder Joint, Grooved and Flared Ends

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)
NEMA MG 1	(2018) Motors and Generators
NEMA MG 11	(1977; R 2012) Energy Management Guide for Selection and Use of Single Phase Motors

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 90A	(2021) Standard for the Installation of Air Conditioning and Ventilating Systems

1.2 SYSTEM DESCRIPTION

Provide the water systems having the minimum service (design) temperature-pressure rating indicated. Provision of the piping systems, including materials, installation, workmanship, fabrication, assembly, erection, examination, inspection, and testing shall be in accordance with the required and advisory provisions of ASME B31.9 except as modified or supplemented by this specification section or design drawings. This specification section covers the water systems piping which is located within, on, and adjacent to building(s) within the building(s) 5 foot line.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Grooved Mechanical Connections For Steel; G

Grooved Mechanical Connections For Copper; G

Calibrated Balancing Valves; G

Pump Discharge Valve; G

Pressure Relief Valve; G

Expansion Joints; G

Combination Strainer and Pump Suction Diffuser; G

Expansion Tanks; G

Air Separator Tanks; G

SD-06 Test Reports

Piping Welds NDE Report

Pressure Tests Reports; G

Report shall be provided in bound 8-1/2 by 11 inch booklets. In the reports, document all phases of the tests performed. Include initial test summaries, all repairs/adjustments made, and the final test results.

SD-10 Operation and Maintenance Data

Requirements for data packages are specified Section 01 78 23 OPERATION AND MAINTENANCE DATA, except as supplemented and modified by this specification section.

Submit spare parts data for each different item of equipment specified, with operation and maintenance data packages. Include a complete list of parts and supplies, with current unit prices and source of supply, a recommended spare parts list for 1 year of operation, and a list of the parts recommended by the manufacturer to be replaced on a routine basis.

Submit a list of qualified permanent service organizations with operation and maintenance data packages. Include service organization addresses and service area or expertise. The service organizations shall be reasonably convenient to the equipment installation and be able to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

Calibrated Balancing Valves, Data Package 3; G

Pump Discharge Valve, Data Package 2; G

Water Pressure Reducing Valve, Data Package 3; G

Pressure Relief Valve, Data Package 2; G

Expansion Joints, Data Package 2; G

Pumps, Data Package 3; G

Combination Strainer and Pump Suction Diffuser, Data Package 2; G

Expansion Tanks, Data Package 2; G

Air Separator Tanks, Data Package 2; G

1.4 MODIFICATIONS TO REFERENCES

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word, "shall" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction", or words of similar meaning, to mean the Contracting Officer.

1.4.1 Definitions

For the International Code Council (ICC) Codes referenced in the contract documents, advisory provisions shall be considered mandatory, the word "should" shall be interpreted as "shall." Reference to the "code official" shall be interpreted to mean the "Contracting Officer." For Navy owned property, references to the "owner" shall be interpreted to mean the "Contracting Officer." For leased facilities, references to the "owner" shall be interpreted to mean the "lessor." References to the "permit holder" shall be interpreted to mean the "Contractor."

1.4.2 Administrative Interpretations

For ICC Codes referenced in the contract documents, the provisions of Chapter 1, "Administrator," do not apply. These administrative requirements are covered by the applicable Federal Acquisition Regulations (FAR) included in this contract and by the authority granted to the Officer in Charge of Construction to administer the construction of this project. References in the ICC Codes to sections of Chapter 1, shall be applied appropriately by the Contracting Officer as authorized by his administrative cognizance and the FAR.

1.5 SAFETY REQUIREMENTS

Exposed moving parts, parts that produce high operating temperature, parts which may be electrically energized, and parts that may be a hazard to operating personnel shall be insulated, fully enclosed, guarded, or fitted with other types of safety devices. Safety devices shall be installed so that proper operation of equipment is not impaired.

1.6 DELIVERY, STORAGE, AND HANDLING

Protect stored items from the weather, humidity and temperature variations, dirt and dust, or other contaminants. Proper protection and care of all material both before and during installation shall be the Contractor's responsibility. Any materials found to be damaged shall be replaced at the Contractor's expense. During installation, cap piping and similar openings to keep out dirt and other foreign matter. Any porous materials found to be contaminated with mold or mildew will be replaced at

the Contractor's expense. Non-porous materials found to be contaminated with mold or mildew will be disinfected and cleaned prior to installation.

1.7 PROJECT/SITE CONDITIONS

1.7.1 Verification of Dimensions

The Contractor shall become familiar with all details of the work, verify all dimensions in the field, and advise the Contracting Officer of any discrepancy before performing any work.

1.7.2 Drawings

Because of the small scale of the drawings, it is not possible to indicate all offsets, fittings, and accessories that may be required. The Contractor shall carefully investigate the plumbing, fire protection, electrical, structural and finish conditions that would affect the work to be performed and shall arrange such work accordingly, furnishing required offsets, fittings, and accessories to meet such conditions.

1.7.3 Accessibility

Install all work so that parts requiring periodic inspection, operation, maintenance, and repair are readily accessible. Install concealed valves, expansion joints, controls, dampers, and equipment requiring access, in locations freely accessible through access doors.

PART 2 PRODUCTS

2.1 STANDARD COMMERCIAL PRODUCTS

Materials and equipment shall be standard products of a manufacturer regularly engaged in the manufacturing of such products, which are of a similar material, design and workmanship. The standard products shall have been in satisfactory commercial or industrial use for 2 years prior to bid opening.

The two year use shall include applications of equipment and materials under similar circumstances and of similar size. The 2 years experience shall be satisfactorily completed by a product which has been sold or is offered for sale on the commercial market through advertisements, manufacturer's catalogs, or brochures.

Products having less than a 2 year field service record shall be acceptable if a certified record of satisfactory field operation, for not less than 6000 hours exclusive of the manufacturer's factory tests, can be shown. System components shall be environmentally suitable for the indicated locations.

2.2 STEEL PIPING

Water piping shall be steel pipe or copper tubing. Provide steel piping with a ANSI/ASME Class 125 service rating, which for 150 degrees F, the pressure rating is 175 psig.

2.2.1 Pipe

Steel pipe, conform to ASTM A53/A53M, Schedule 40, Type E or S, Grades A or B. Do not use Type F pipe.

2.2.2 Fittings and End Connections (Joints)

Piping and fittings 1 inch and smaller shall have threaded connections. Piping and fittings larger than 1 inch and smaller than 3 inches shall have either threaded, grooved, or welded connections. Piping and fittings 3 inches and larger shall have grooved, welded, or flanged connections. The manufacturer of each fitting shall be permanently identified on the body of the fitting in accordance with MSS SP-25.

2.2.2.1 Threaded Connections

Use threaded valves and pipe connections conforming to ASME B1.20.1. Used threaded fitting conforming to ASME B16.3. Use threaded unions conforming to ASME B16.39. Use threaded pipe nipples conforming to ASTM A733.

2.2.2.2 Flanged Connections

Flanges shall conform to ASME B16.1, Class 125. Gaskets shall be nonasbestos compressed material in accordance with ASME B16.21, 1/16 inch thickness, full face or self-centering flat ring type. These gaskets shall contain aramid fibers bonded with styrene butadeine rubber (SBR) or nitrile butadeine rubber (NBR). Bolts, nuts, and bolt patterns shall conform to ASME B16.1.

2.2.2.3 Welded Connections

Welded valves and pipe connections (both butt-welds and socket-welds types) shall conform to ASME B31.9. Butt-welded fittings shall conform to ASME B16.9. Socket-welded fittings shall conform to ASME B16.11. Welded fittings shall be identified with the appropriate grade and marking symbol.

2.2.2.4 Grooved Mechanical Connections For Steel

Rigid grooved mechanical connections may only be used in serviceable aboveground locations where the temperature of the circulating medium does not exceed 230 degrees F. Flexible grooved connections shall be used only as a flexible connector with grooved pipe system. Unless otherwise specified, grooved piping components shall meet the corresponding criteria specified for the similar welded, flanged, or threaded component specified herein.

Each grooved mechanical joint shall be a system, including coupling housing, gasket, fasteners, all furnished by the same manufacturer. Joint installation shall be in compliance with joint manufacturer's written instructions.

Use fitting and coupling houses of malleable iron conforming to ASTM A47/A47M, Grade 32510; ductile iron conforming to ASTM A536, Grade 65-45-12; or steel conforming ASTM A106/A106M, Grade B or ASTM A53/A53M. Use gaskets of molded synthetic rubber with central cavity, pressure responsive configuration and conforming to ASTM D2000 Grade No. 2CA615A15B44F17Z for circulating medium up to 230 degrees F or Grade No. M3BA610A15B44Z for circulating medium up to 200 degrees F. Grooved mechanical connections shall conform to AWWA C606. Coupling nuts and bolts shall be steel and shall conform to ASTM A183. Pipe connections and fittings shall be the product of the same manufacturer. Provide joint installation be in compliance with joint manufacturer's written instructions.

2.3 COPPER TUBING

Provide copper tubing and fittings with a ANSI/ASME Class 125 service rating, which for 150 degrees F., the pressure rating is 175 psig.

2.3.1 Tube

Use copper tube conforming to ASTM B88, Type L for aboveground tubing, and Type K for buried tubing.

2.3.2 Fittings and End Connections (Solder and Flared Joints)

Wrought copper and bronze solder joint pressure fittings, including unions ands flanges, shall conform to ASME B16.22 and ASTM B75/B75M. Provide adapters as required. Cast copper alloy solder-joint pressure fittings , including unions and flanges, shall conform to ASME B16.18. Cast copper alloy fittings for flared copper tube shall conform to ASME B16.26 and ASTM B62. ASTM B42 copper pipe nipples with threaded end connections shall conform to ASTM B42.

Copper tubing of sizes larger than 4 inches shall have brazed joints. Brass or bronze adapters for brazed tubing may be used for connecting tubing to flanges and to threaded ends of valves and equipment.

Extracted brazed tee joints may be used if produced with an acceptable tool and installed in accordance with tool manufacturer's written procedures.

2.3.3 Grooved Mechanical Connections For Copper

Rigid grooved mechanical connections may only be used in serviceable aboveground locations where the temperature of the circulating medium does not exceed 230 degrees F. Flexible grooved connections shall be used only as a flexible connector with grooved pipe system. Unless otherwise specified, grooved piping components shall meet the corresponding criteria specified for the similar welded, flanged, or threaded component specified herein.

Each grooved mechanical joint shall be a system, including coupling housing, gasket, fasteners, all furnished by the same manufacturer. Joint installation shall be in compliance with joint manufacturer's written instructions.

Grooved fitting and mechanical coupling housing shall be ductile iron conforming to ASTM A536. Provide gaskets for use in grooved joints shall constructed of molded synthetic polymer of pressure responsive design and shall conform to ASTM D2000 for circulating medium up to 230 degrees F. Provide grooved joints in conformance with AWWA C606.

2.3.4 Solder

Provide solder in conformance with ASTM B32, grade Sb5, tin-antimony alloy. Solder flux shall be liquid or paste form, non-corrosive and conform to ASTM B813.

2.3.5 Brazing Filler Metal

Filler metal shall conform to AWS A5.8/A5.8M, Type BAg-5 with AWS Type 3

flux, except Type BCuP-5 or BCuP-6 may be used for brazing copper-to-copper joints.

2.4 VALVES

Provide valves with a ANSI/ASME Class 125 service rating, which for 150 degrees F, the pressure rating is 175 psig.

Valves in sizes larger than 1 inch and used on steel pipe systems, may be provided with rigid grooved mechanical joint ends. Such grooved end valves shall be subject to the same requirements as rigid grooved mechanical joints and fittings and, shall be furnished by the same manufacturer as the grooved pipe joint and fitting system.

2.4.1 Gate Valve

Gate valves 2-1/2 inches and smaller shall conform to MSS SP-80 Class 125 and shall be bronze with wedge disc, rising stem and threaded, soldered, or flanged ends. Gate valves 3 inches and larger shall conform to MSS SP-70, Class 125, cast iron with bronze trim, outside screw and yoke, and flanged or threaded ends.

2.4.2 Globe and Angle Valve

Globe and angle valves 2-1/2 inches and smaller shall conform to MSS SP-80, Class 125. Globe and angle valves 3 inches and larger shall conform to MSS SP-85, Class 125.

2.4.3 Check Valve

Check valves 2-1/2 inches and smaller shall conform to MSS SP-80. Check valves 3 inches and larger shall conform to MSS SP-71, Class 125.

2.4.4 Butterfly Valve

Butterfly valves shall conform to MSS SP-67, Type 1 and shall be either the wafer or lug type. Valves smaller than 8 inches shall have throttling handles with a minimum of two locking positions. Valves 8 inches and larger shall have totally enclosed manual gear operators with adjustable balance return stops and position indicators.

2.4.5 Plug Valve

Plug valves 2 inches and larger shall conform to MSS SP-78, have flanged or threaded ends, and have cast iron bodies with bronze trim. Valves 2 inches and smaller shall be bronze with NPT connections for black steel pipe and brazed connections for copper tubing. Valve shall be lubricated, non-lubricated, or tetrafluoroethylene resin-coated type. Valve shall be resilient, double seated, trunnion mounted with tapered lift plug capable of 2-way shutoff. Valve shall operate from fully open to fully closed by rotation of the handwheel to lift and turn the plug. Valves 8 inches or larger shall be provided with manual gear operators with position indicators.

2.4.6 Ball Valve

Full port design. Ball valves 1/2 inch and larger shall conform to MSS SP-72 or MSS SP-110 and shall be cast iron or bronze with threaded, soldered, or flanged ends. Valves 8 inches or larger shall be provided

with manual gear operators with position indicators. Ball valves may be provided in lieu of gate valves.

2.4.7 Square Head Cocks

Provide copper alloy or cast-iron body with copper alloy plugs, suitable for 125 psig water working pressure.

2.4.8 Calibrated Balancing Valves

Copper alloy or cast iron body, copper alloy or stainless internal working parts. Provide valve calibrated so that flow can be determined when the temperature and pressure differential across valve is known. Valve shall have an integral pointer which registers the degree of valve opening. Valve shall function as a service valve when in fully closed position. Valve shall be constructed with internal seals to prevent leakage and shall be supplied with preformed insulation.

Provide valve bodies with tapped openings and pipe extensions with positive shutoff valves outside of pipe insulation. The pipe extensions shall be provided with quick connecting hose fittings for a portable differential pressure meter connections to verify the pressure differential. Provide metal tag on each valve showing the gallons per minute flow for each differential pressure reading. In lieu of the balancing valve with integral metering connections, a ball valve or plug valve with a separately installed orifice plate or venturi tube may be used for balancing.

2.4.9 Pump Discharge Valve

Valve shall shall perform the functions of a nonslam check valve, a manual balancing valve, and a shutoff. Valve shall be of cast iron or ductile iron construction with bronze and/or stainless steel accessories. Provide an integral pointer on the valve which registers the degree of valve opening. Flow through the valve shall be manually adjustable from bubble tight shutoff to full flow. Valves smaller than 2 inches shall have NPT connections. Valves 2 inches and larger shall have flanged or grooved end connections. Valve design shall allow the back seat for the stem to be replaced in the field under full line pressure.

2.4.10 Water Pressure Reducing Valve

Valve, ASSE 1003 for water service, copper alloy body.

2.4.11 Pressure Relief Valve

Valve shall prevent excessive pressure in the piping system when the piping system reaches its maximum heat buildup. Valve, ANSI Z21.22/CSA 4.4 and shall have cast iron bodies with corrosion resistant internal working parts. The discharge pipe from the relief valve shall be the size of the valve outlet unless otherwise indicated.

2.4.12 Float Valve

Angle patternor Globe pattern. Valve bodies 3 inches nominal pipe size and smaller shall be bronze. Valve bodies larger than 3 inches shall be cast iron or bronze. Steel parts shall be corrosion resistant. Where float rods are extended for tank applications, extension shall be properly supported and guided to avoid bending of float rod or stressing of valve

pilot linkage.

2.4.13 Drain Valves

Valves, MSS SP-80 gate valves. Valve shall be manually-operated, 3/4 inch pipe size and above with a threaded end connection. Provide valve with a water hose nipple adapter. Freeze-proof type valves shall be provided in installations exposed to freezing temperatures.

2.4.14 Air Venting Valves

Manually-operated general service type air venting valves, brass or bronze valves that are furnished with threaded plugs or caps. Automatic type air venting shall be the ball-float type with brass/bronze or brass bodies, 300 series corrosion-resistant steel float, linkage and removable seat. Air venting valves on water coils shall have not less than 1/8 inch threaded end connections. Air venting valves on water mains shall have not less than 3/4 inch threaded end connections. Air venting valves on all other applications shall have not less than 1/2 inch threaded end connections.

2.4.15 Vacuum Relief Valves

ANSI Z21.22/CSA 4.4

2.5 PIPING ACCESSORIES

2.5.1 Strainer

Strainer, ASTM F1199, except as modified and supplemented in this specification. Strainer shall be the cleanable, basket or "Y" type, the same size as the pipeline. Strainer bodies shall be fabricated of cast iron with bottoms drilled, and tapped. Provide blowoff outlet with pipe nipple, gate valve, and discharge pipe nipple. The bodies shall have arrows clearly cast on the sides indicating the direction of flow.

Provide strainer with removable cover and sediment screen. The screen shall be made of minimum 22 gauge brass sheet, with small perforations numbering not less than 400 per square inch to provide a net free area through the basket of at least 3.30 times that of the entering pipe. The flow shall be into the screen and out through the perforations.

2.5.2 Cyclonic Separator

Metal- bodied, with removal capability of removing solids 45 microns/325 mesh in size and heavier than 1.20 specific gravity, maximum pressure drop of 5 psid, with cleanout connection.

2.5.3 Combination Strainer and Pump Suction Diffuser

Angle type body with removable strainer basket and internal straightening vanes, a suction pipe support, and a blowdown outlet and plug. Strainer shall be in accordance with ASTM F1199, except as modified and supplemented by this specification. Unit body shall have arrows clearly cast on the sides indicating the direction of flow.

Strainer screen shall be made of minimum 22 gauge brass sheet, with small perforations numbering not less than 400 per square inch to provide a net free area through the basket of at least 3.30 times that of the entering

pipe. Flow shall be into the screen and out through the perforations. Provide an auxiliary disposable fine mesh strainer which shall be removed 30 days after start-up. Provide warning tag for operator indicating scheduled date for removal.

Casing shall have connection sizes to match pump suction and pipe sizes, and be provided with adjustable support foot or support foot boss to relieve piping strains at pump suction. Provide unit casing with blowdown port and plug. Provide a magnetic insert to remove debris from system.

2.5.4 Flexible Pipe Connectors

Provide flexible stainless steel piping connectors with single braid. Equip flanged assemblies with limit bolts to restrict maximum travel to the manufacturer's standard limits. Unless otherwise indicated, the length of the flexible connectors shall be as recommended by the manufacturer for the service intended. Internal sleeves or liners, compatible with circulating medium, shall be provided when recommended by the manufacturer. Provide covers to protect the bellows where indicated.

2.5.5 Pressure and Vacuum Gauges

Gauges, ASME B40.100 with throttling type needle valve or a pulsation dampener and shut-off valve. Provide gauges with 4.5 inch dial, brass or aluminum case, bronze tube, and siphon. Gauge shall have a range from 0 psig to approximately 1.5 times the maximum system working pressure. Each gauge range shall be selected so that at normal operating pressure, the needle is within the middle-third of the range.

2.5.6 Temperature Gauges

Temperature gauges, shall be the industrial duty type and be provided for the required temperature range. Provide gauges with fixed thread connection, dial face gasketed within the case; and an accuracy within 2 percent of scale range. Gauges shall have Fahrenheit scale in 2 degree graduations scale (black numbers) on a white face. Rigid stem type temperature gauges shall be provided in thermal wells located within 5 feet of the finished floor. Universal adjustable angle type or remote element type temperature gauges shall be provided in thermal wells located 5 to 7 feet above the finished floor or in locations indicated. Remote element type temperature gauges shall be provided in thermal wells located 7 feet above the finished floor or in locations indicated.

2.5.6.1 Stem Cased-Glass

Stem cased-glass case shall be polished stainless steel or cast aluminum, 9 inches long, with clear acrylic lens, and non-mercury filled glass tube with indicating-fluid column.

2.5.6.2 Bimetallic Dial

Bimetallic dial type case shall be not less than 3-1/2 inches, stainless steel, and shall be hermetically sealed with clear acrylic lens. Bimetallic element shall be silicone dampened and unit fitted with external calibrator adjustment.

2.5.6.3 Liquid-, Solid-, and Vapor-Filled Dial

Liquid-, solid-, and vapor-filled dial type cases shall be not less than

3-1/2 inches, stainless steel or cast aluminum with clear acrylic lens. Fill shall be nonmercury, suitable for encountered cross-ambients, and connecting capillary tubing shall be double-braided bronze.

2.5.6.4 Thermal Well

Thermal well shall be identical size, 1/2 or 3/4 inch NPT connection, brass or stainless steel. Where test wells are indicated, provide captive plug-fitted type 1/2 inch NPT connection suitable for use with either engraved stem or standard separable socket thermometer or thermostat. Mercury shall not be used in thermometers. Extended neck thermal wells shall be of sufficient length to clear insulation thickness by 1 inch.

2.5.7 Pipe Hangers, Inserts, and Supports

Pipe hangers, inserts, guides, and supports: to MSS SP-58 and MSS SP-69.

2.5.8 Escutcheons

Provide one piece or split hinge metal plates for piping entering floors, walls, and ceilings in exposed spaces. Secure plates in place by internal spring tension or set screws. Provide polished stainless steel plates or chromium-plated finish on copper alloy plates in finished spaces. Provide paint finish on metal plates in unfinished spaces.

2.5.9 Expansion Joints

2.5.9.1 Slip-Tube Type

Slip-tube expansion joints, ASTM F1007, Class I or II. Joints shall be provided with internally-externally alignment guides, injected semi-plastic packing, and service outlets. End connections shall be flanged or beveled for welding as indicated. Initial settings shall be made in accordance with the manufacturer's recommendations to compensate for ambient temperature at time of installation. Pipe alignment guides shall be installed as recommended by the joint manufacturer.

2.5.9.2 Flexible Ball Type

Flexible ball expansion joints shall be capable of 360 degrees rotation plus 15 degrees angular flex movement. Joints shall be constructed of carbon steel with the exterior spherical surface of carbon steel balls plated with a minimum 5 mils of hard chrome in accordance with EJMA Stds. Joint end connections shall be threaded for piping 2 inches or smaller. Joint end connections larger than 2 inches shall be grooved, flanged, or beveled for welding. Provide joint with pressure-molded composition gaskets suitable for continuous operation at twice design temperature.

2.5.9.3 Bellows Type

Bellows expansion type joints, ASTM F1120 with Type 304 stainless steel corrugated bellows, reinforced with equalizing rings, internal sleeves, and external protective covers. Joint end connections shall be grooved, flanged, or beveled for welding. Guiding of piping on both sides of expansion joint shall be in accordance with the published recommendations of the manufacturer of the expansion joint.

2.6 PUMPS

Pumps shall be the electrically driven, non-overloading, centrifugal type which conform to HI 1.1-1.2. Pumps shall be selected at or within 5 percent of peak efficiency. Pump curve shall rise continuously from maximum capacity to shutoff. Pump motor shall conform to NEMA MG 1, be open , and have sufficient horsepower for the service required. Pump motor shall have the required capacity to prevent overloading with pump operating at any point on its characteristic curve. Pump speed shall not exceed 3,600 rpm, except where the pump head is less than 60 feet of water, the pump speed shall not exceed 1,750 rpm. Pump motor shall be equipped with an across-the-line magnetic controller in a NEMA 250, Type 1 enclosure with "START-STOP" switch in the cover.

2.6.1 Construction

Each pump casing shall be designed to withstand the discharge head specified plus the static head on system plus 50 percent of the total, but not less than 125 psig. Pump casing and bearing housing shall be close grained cast iron. High points in the casing shall be provided with manual air vents; low points shall be provided with drain plugs. Provide threaded suction and discharge pressure gage tapping with square-head plugs.

Impeller shall be statically and dynamically balanced. Impeller, impeller wearing rings, glands, casing wear rings, and shaft sleeve shall be bronze. Shaft shall be carbon or alloy steel, turned and ground. Bearings shall be ball-bearings, roller-bearings, or oil-lubricated bronze-sleeve type bearings, and be efficiently sealed or isolated to prevent loss of oil or entrance of dirt or water.

Base-mounted pump, coupling guard, and motor shall each be bolted to a fabricated steel base which shall have bolt holes for securing base to supporting surface. Pump shall be accessible for servicing without disturbing piping connections. Shaft seals shall be mechanical-seals or stuffing-box type.

2.6.2 Mechanical Shaft Seals

Seals shall be single, inside mounted, end-face-elastomer bellows type with stainless steel spring, brass or stainless steel seal head, carbon rotating face, and tungsten carbide or ceramic sealing face. Glands shall be bronze and of the water-flush design to provide lubrication flush across the face of the seal. Bypass line from pump discharge to flush connection in gland shall be provided, with filter or cyclone particle separator in line.

2.6.3 Stuffing-Box Type Seals

Stuffing box shall include minimum 4 rows of square, impregnated TFE (Teflon) or graphite cord packing and a bronze split-lantern ring. Packing gland shall be bronze interlocking split type.

2.7 EXPANSION TANKS

Tank shall be welded steel, constructed for, and tested to pressure-temperature rating of 125 psi at 150 degrees F. Provide tanks precharged to the minimum operating pressure. Tank shall have a replaceable polypropylene or butyl lined diaphragm which keeps the air

charge separated from the water; shall be the captive air type.

Tanks shall accommodate expanded water of the system generated within the normal operating temperature range, limiting this pressure increase at all components in the system to the maximum allowable pressure at those components. Each tank air chamber shall be fitted with a drain, fill, an air charging valve, and system connections. Tank shall be supported by steel legs or bases for vertical installation or steel saddles for horizontal installations. The only air in the system shall be the permanent sealed-in air cushion contained within the expansion tank.

2.8 AIR SEPARATOR TANKS

External air separation tank shall have an internal design constructed of stainless steel and suitable for creating the required vortex and subsequent air separation. Tank shall be steel, constructed for, and tested to pressure-temperature rating of 125 psi at 150 degrees F. Tank shall have tangential inlets and outlets connections, threaded for 2 inches and smaller and flanged for sizes 2-1/2 inches and larger. Air released from a tank shall be vented as indicated. Tank shall be provided with a blow-down connection.

2.9 ELECTRICAL WORK

Provide motors, controllers, integral disconnects, contactors, and controls with their respective pieces of equipment, except controllers indicated as part of motor control centers. Provide electrical equipment, including motors and wiring, as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Manual or automatic control and protective or signal devices required for the operation specified and control wiring required for controls and devices specified, but not shown, shall be provided. For packaged equipment, the manufacturer shall provide controllers including the required monitors and timed restart.

Provide high efficiency type, single-phase, fractional-horsepower alternating-current motors, including motors that are part of a system, in accordance with NEMA MG 11.

Provide polyphase, squirrel-cage medium induction motors, including motors that are part of a system, that meet the efficiency ratings for premium efficiency motors in accordance with NEMA MG 1. Provide motors in accordance with NEMA MG 1 and of sufficient size to drive the load at the specified capacity without exceeding the nameplate rating of the motor.

Motors shall be rated for continuous duty with the enclosure specified. Motor duty requirements shall allow for maximum frequency start-stop operation and minimum encountered interval between start and stop. Motor torque shall be capable of accelerating the connected load within 20 seconds with 80 percent of the rated voltage maintained at motor terminals during one starting period. Provide motor starters complete with thermal overload protection and other necessary appurtenances. Motor bearings shall be fitted with grease supply fittings and grease relief to outside of the enclosure.

Provide variable frequency drives for motors as specified in Section 26 29 23 ADJUSTABLE SPEED DRIVE (ASD) SYSTEMS UNDER 600 VOLTS.

2.10 PAINTING OF NEW EQUIPMENT

New equipment painting shall be factory applied or shop applied, and shall be as specified herein, and provided under each individual section.

2.10.1 Factory Painting Systems

Manufacturer's standard factory painting systems may be provided. The factory painting system applied will withstand 125 hours in a salt-spray fog test, except that equipment located outdoors shall withstand 500 hours in a salt-spray fog test.

Salt-spray fog test shall be in accordance with ASTM B117, and for that test, the acceptance criteria shall be as follows: immediately after completion of the test, the paint shall show no signs of blistering, wrinkling, or cracking, and no loss of 0.125 inch on either side of the scratch mark. The film thickness of the factory painting system applied on the equipment shall not be less than the film thickness used on the test specimen.

If manufacturer's standard factory painting system is being proposed for use on surfaces subject to temperatures above 120 degrees F, the factory painting system shall be designed for the temperature service.

2.10.2 Shop Painting Systems for Metal Surfaces

Clean, retreat, prime and paint metal surfaces; except aluminum surfaces need not be painted. Apply coatings to clean dry surfaces. Clean the surfaces to remove dust, dirt, rust, oil and grease by wire brushing and solvent degreasing prior to application of paint, except metal surfaces subject to temperatures in excess of 120 degrees F shall be cleaned to bare metal.

Where hot-dip galvanized steel has been cut, resulting surfaces with no galvanizing shall be coated with a zinc-rich coating conforming to ASTM D520, Type I.

Where more than one coat of paint is specified, apply the second coat after the preceding coat is thoroughly dry. Lightly sand damaged painting and retouch before applying the succeeding coat. Color of finish coat shall be aluminum or light gray.

a. Temperatures Less Than 120 Degrees F: Immediately after cleaning, the metal surfaces subject to temperatures less than 120 degrees F shall receive one coat of pretreatment primer applied to a minimum dry film thickness of 0.3 mil, one coat of primer applied to a minimum dry film thickness of one mil; and two coats of enamel applied to a minimum dry film thickness of one mil per coat.

b. Temperatures Between 120 and 400 degrees F: Metal surfaces subject to temperatures between 120 and 400 degrees F shall receive two coats of 400 degrees F heat-resisting enamel applied to a total minimum thickness of 2 mils.

c. Temperatures Greater Than 400 degrees F: Metal surfaces subject to temperatures greater than 400 degrees F shall receive two coats of 600 degrees F heat-resisting paint applied to a total minimum dry film thickness of 2 mils.

2.11 FACTORY APPLIED INSULATION

Factory insulated items installed outdoors are not required to be fire-rated. As a minimum, factory insulated items installed indoors shall have a flame spread index no higher than 25 and a smoke developed index no higher than 150. Factory insulated items (no jacket) installed indoors and which are located in air plenums, in ceiling spaces, and in attic spaces shall have a flame spread index no higher than 25 and a smoke developed index no higher than 50. Flame spread and smoke developed indexes shall be determined by ASTM E84.

Insulation shall be tested in the same density and installed thickness as the material to be used in the actual construction. Material supplied by a manufacturer with a jacket shall be tested as a composite material. Jackets, facings, and adhesives shall have a flame spread index no higher than 25 and a smoke developed index no higher than 50 when tested in accordance with ASTM E84.

2.12 NAMEPLATES

Major equipment including pumps, pump motors, expansion tanks, and air separator tanks shall have the manufacturer's name, type or style, model or serial number on a plate secured to the item of equipment. The nameplate of the distributing agent will not be acceptable. Plates shall be durable and legible throughout equipment life and made of anodized aluminum. Plates shall be fixed in prominent locations with nonferrous screws or bolts.

2.13 RELATED COMPONENTS/SERVICES

2.13.1 Field Applied Insulation

Requirements for field installed insulation is specified in Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS, except as supplemented and modified by this specification section.

PART 3 EXECUTION

3.1 INSTALLATION

Cut pipe accurately to measurements established at the jobsite, and work into place without springing or forcing, completely clearing all windows, doors, and other openings. Cutting or other weakening of the building structure to facilitate piping installation is not permitted without written approval. Cut pipe or tubing square, remove burrs by reaming, and fashion to permit free expansion and contraction without causing damage to the building structure, pipe, joints, or hangers.

Notify the Contracting Officer in writing at least 15 calendar days prior to the date the connections are required. Obtain approval before interrupting service. Furnish materials required to make connections into existing systems and perform excavating, backfilling, compacting, and other incidental labor as required. Furnish labor and tools for making actual connections to existing systems.

3.1.1 Welding

Provide welding work specified this section for piping systems in conformance with ASME B31.9, as modified and supplemented by this

specification section and the accompanying drawings. The welding work includes: qualification of welding procedures, welders, welding operators, brazers, brazing operators, and nondestructive examination personnel; maintenance of welding records, and examination methods for welds.

3.1.1.1 Examination of Piping Welds

Conduct non-destructive examinations (NDE) on piping welds and brazing and verify the work meets the acceptance criteria specified in ASME B31.9. NDE on piping welds covered by ASME B31.9 is visual inspection only. Submit a piping welds NDE report meeting the requirements specified in ASME B31.9.

3.1.1.2 Welding Safety

Welding and cutting safety requirements shall be in accordance with AWS Z49.1.

3.1.2 Directional Changes

Make changes in direction with fittings, except that bending of pipe 4 inches and smaller is permitted, provided a pipe bender is used and wide weep bends are formed. Mitering or notching pipe or other similar construction to form elbows or tees is not permitted. The centerline radius of bends shall not be less than 6 diameters of the pipe. Bent pipe showing kinks, wrinkles, flattening, or other malformations is not acceptable.

3.1.3 Functional Requirements

Pitch horizontal supply mains down in the direction of flow as indicated. The grade shall not be less than 1 inch in 40 feet. Reducing fittings shall be used for changes in pipe sizes. Cap or plug open ends of pipelines and equipment during installation to keep dirt or other foreign materials out of the system.

Pipe not otherwise specified shall be uncoated. Connections to appliances shall be made with malleable iron unions for steel pipe 2-1/2 inches or less in diameter, and with flanges for pipe 3 inches and above in diameter. Connections between ferrous and copper piping shall be electrically isolated from each other with dielectric waterways or flanges.

Piping located in air plenums shall conform to NFPA 90A requirements. Pipe and fittings installed in inaccessible conduits or trenches under concrete floor slabs shall be welded. Equipment and piping arrangements shall fit into space allotted and allow adequate acceptable clearances for installation, replacement, entry, servicing, and maintenance. Electric isolation fittings shall be provided between dissimilar metals.

3.1.4 Fittings and End Connections

3.1.4.1 Threaded Connections

Threaded connections shall be made with tapered threads and made tight with PTFE tape complying with ASTM D3308 or equivalent thread-joint compound applied to the male threads only. Not more than three threads shall show after the joint is made.

3.1.4.2 Brazed Connections

Brazing, AWS BRH, except as modified herein. During brazing, the pipe and fittings shall be filled with a pressure regulated inert gas, such as nitrogen, to prevent the formation of scale. Before brazing copper joints, both the outside of the tube and the inside of the fitting shall be cleaned with a wire fitting brush until the entire joint surface is bright and clean. Do not use brazing flux. Surplus brazing material shall be removed at all joints. Steel tubing joints shall be made in accordance with the manufacturer's recommendations. Piping shall be supported prior to brazing and not be sprung or forced.

3.1.4.3 Welded Connections

Branch connections shall be made with welding tees or forged welding branch outlets. Pipe shall be thoroughly cleaned of all scale and foreign matter before the piping is assembled. During welding, the pipe and fittings shall be filled with an inert gas, such as nitrogen, to prevent the formation of scale. Beveling, alignment, heat treatment, and inspection of weld shall conform to ASME B31.9. Weld defects shall be removed and rewelded at no additional cost to the Government. Electrodes shall be stored and dried in accordance with AWS D1.1/D1.1M or as recommended by the manufacturer. Electrodes that have been wetted or that have lost any of their coating shall not be used.

3.1.4.4 Grooved Mechanical Connections

Prepare grooves in accordance with the coupling manufacturer's instructions. Pipe and groove dimensions shall comply with the tolerances specified by the coupling manufacturer. The diameter of grooves made in the field shall be measured using a "go/no-go" gauge, vernier or dial caliper, or narrow-land micrometer, or other method specifically approved by the coupling manufacturer for the intended application. Groove width and dimension of groove from end of pipe shall be measured and recorded for each change in grooving tool setup to verify compliance with coupling manufacturer's tolerances. Grooved joints shall not be used in concealed locations, such as behind solid walls or ceilings, unless an access panel is shown on the drawings for servicing or adjusting the joint.

3.1.4.5 Flared Connections

When flared connections are used, a suitable lubricant shall be used between the back of the flare and the nut in order to avoid tearing the flare while tightening the nut.

3.1.4.6 Flanges and Unions

Except where copper tubing is used, union or flanged joints shall be provided in each line immediately preceding the connection to each piece of equipment or material requiring maintenance such as coils, pumps, control valves, and other similar items. Flanged joints shall be assembled square end tight with matched flanges, gaskets, and bolts. Gaskets shall be suitable for the intended application.

3.1.5 Valves

Isolation gate or ball valves shall be installed on each side of each piece of equipment, at the midpoint of all looped mains, and at any other points indicated or required for draining, isolating, or sectionalizing

purpose. Isolation valves may be omitted where balancing cocks are installed to provide both balancing and isolation functions. Each valve except check valves shall be identified. Valves in horizontal lines shall be installed with stems horizontal or above.

3.1.6 Air Vents

Air vents shall be provided at all high points, on all water coils, and where indicated to ensure adequate venting of the piping system.

3.1.7 Drains

Drains shall be provided at all low points and where indicated to ensure complete drainage of the piping. Drains shall be accessible, and shall consist of nipples and caps or plugged tees unless otherwise indicated.

3.1.8 Flexible Pipe Connectors

Connectors shall be attached to components in strict accordance with the latest printed instructions of the manufacturer to ensure a vapor tight joint. Hangers, when required to suspend the connectors, shall be of the type recommended by the flexible pipe connector manufacturer and shall be provided at the intervals recommended.

3.1.9 Temperature Gauges

Temperature gauges shall be located on coolant supply and return piping at each heat exchanger, on condenser water piping entering and leaving a condenser, at each automatic temperature control device without an integral thermometer, and where indicated or required for proper operation of equipment. Thermal wells for insertion thermometers and thermostats shall extend beyond thermal insulation surface not less than 1 inch.

3.1.10 Pipe Hangers, Inserts, and Supports

Pipe hangers, inserts, and supports shall conform to MSS SP-58 and MSS SP-69, except as supplemented and modified in this specification section. Pipe hanger types 5, 12, and 26 shall not be used. Hangers used to support piping 2 inches and larger shall be fabricated to permit adequate adjustment after erection while still supporting the load. Piping subjected to vertical movement, when operating temperatures exceed ambient temperatures, shall be supported by variable spring hangers and supports or by constant support hangers.

3.1.10.1 Hangers

Type 3 shall not be used on insulated piping. Type 24 may be used only on trapeze hanger systems or on fabricated frames.

3.1.10.2 Inserts

Type 18 inserts shall be secured to concrete forms before concrete is placed. Continuous inserts which allow more adjustments may be used if they otherwise meet the requirements for Type 18 inserts.

3.1.10.3 C-Clamps

Type 19 and 23 C-clamps shall be torqued per MSS SP-69 and have both locknuts and retaining devices, furnished by the manufacturer.

Field-fabricated C-clamp bodies or retaining devices are not acceptable.

3.1.10.4 Angle Attachments

Type 20 attachments used on angles and channels shall be furnished with an added malleable-iron heel plate or adapter.

3.1.10.5 Saddles and Shields

Where Type 39 saddle or Type 40 shield are permitted for a particular pipe attachment application, the Type 39 saddle, connected to the pipe, shall be used on all pipe 4 inches and larger when the temperature of the medium is 60 degrees F or higher. Type 40 shields shall be used on all piping less than 4 inches and all piping 4 inches and larger carrying medium less than 60 degrees F. A high density insulation insert of cellular glass shall be used under the Type 40 shield for piping 2 inches and larger.

3.1.10.6 Horizontal Pipe Supports

Horizontal pipe supports shall be spaced as specified in MSS SP-69 and a support shall be installed not over 1 foot from the pipe fitting joint at each change in direction of the piping. Pipe supports shall be spaced not over 5 feet apart at valves.

3.1.10.7 Vertical Pipe Supports

Vertical pipe shall be supported at each floor, except at slab-on-grade, and at intervals of not more than 15 feet, not more than 8 feet from end of risers, and at vent terminations.

3.1.10.8 Pipe Guides

Type 35 guides using, steel, reinforced polytetrafluoroethylene (PTFE) or graphite slides shall be provided where required to allow longitudinal pipe movement. Lateral restraints shall be provided as required. Slide materials shall be suitable for the system operating temperatures, atmospheric conditions, and bearing loads encountered.

3.1.10.9 Steel Slides

Where steel slides do not require provisions for restraint of lateral movement, an alternate guide method may be used. On piping 4 inches and larger, a Type 39 saddle shall be used. On piping under 4 inches, a Type 40 protection shield may be attached to the pipe or insulation and freely rest on a steel slide plate.

3.1.10.10 Multiple Pipe Runs

In the support of multiple pipe runs on a common base member, a clip or clamp shall be used where each pipe crosses the base support member. Spacing of the base support members shall not exceed the hanger and support spacing required for an individual pipe in the multiple pipe run.

3.1.10.11 Seismic Requirements

Piping and attached valves shall be supported and braced to resist seismic loads as shown on the drawings. Structural steel required for reinforcement to properly support piping, headers, and equipment but not shown shall be provided under this section.

3.1.10.12 Structural Attachments

Attachment to building structure concrete and masonry shall be by cast-in concrete inserts, built-in anchors, or masonry anchor devices. Inserts and anchors shall be applied with a safety factor not less than 5. Supports shall not be attached to metal decking. Supports shall not be attached to the underside of concrete filled floors or concrete roof decks unless approved by the Contracting Officer. Masonry anchors for overhead applications shall be constructed of ferrous materials only. Structural steel brackets required to support piping, headers, and equipment, but not shown, shall be provided under this section.

3.1.11 Pipe Alignment Guides

Pipe alignment guides shall be provided where indicated for expansion loops, offsets, and bends and as recommended by the manufacturer for expansion joints, not to exceed 5 feet on each side of each expansion joint, and in lines 4 inches or smaller not more than 2 feet on each side of the joint.

3.1.12 Pipe Anchors

Anchors shall be provided where indicated. Unless indicated otherwise, anchors shall comply with the requirements specified. Anchors shall consist of heavy steel collars with lugs and bolts for clamping and attaching anchor braces, unless otherwise indicated. Anchor braces shall be installed in the most effective manner to secure the desired results using turnbuckles where required.

Supports, anchors, or stays shall not be attached where they will injure the structure or adjacent construction during installation or by the weight of expansion of the pipeline. Where pipe and conduit penetrations of vapor barrier sealed surfaces occur, these items shall be anchored immediately adjacent to each penetrated surface, to provide essentially zero movement within penetration seal.

3.1.13 Building Surface Penetrations

Sleeves shall not be installed in structural members except where indicated or approved. Except as indicated otherwise piping sleeves shall comply with requirements specified. Sleeves in nonload bearing surfaces shall be galvanized sheet metal, conforming to ASTM A653/A653M, Coating Class G-90, 20 gauge. Sleeves in load bearing surfaces shall be uncoated carbon steel pipe, conforming to ASTM A53/A53M, Standard weight. Sealants shall be applied to moisture and oil-free surfaces and elastomers to not less than 1/2 inch depth. Sleeves shall not be installed in structural members.

3.1.13.1 General Service Areas

Each sleeve shall extend through its respective wall, floor, or roof, and shall be cut flush with each surface. Pipes passing through concrete or masonry wall or concrete floors or roofs shall be provided with pipe sleeves fitted into place at the time of construction. Sleeves shall be of such size as to provide a minimum of 1/4 inch all-around clearance between bare pipe and sleeves or between jacketed-insulation and sleeves. Except in pipe chases or interior walls, the annular space between pipe and sleeve or between jacket over-insulation and sleeve shall be sealed.

3.1.13.2 Waterproof Penetrations

Pipes passing through roof or floor waterproofing membrane shall be installed through a .17 ounce copper sleeve, or a 0.032 inch thick aluminum sleeve, each within an integral skirt or flange.

Flashing sleeve shall be suitably formed, and skirt or flange shall extend not less than 8 inches from the pipe and be set over the roof or floor membrane in a troweled coating of bituminous cement. The flashing sleeve shall extend up the pipe a minimum of 2 inches above the roof or floor penetration. The annular space between the flashing sleeve and the bare pipe or between the flashing sleeve and the metal-jacket-covered insulation shall be sealed as indicated. Penetrations shall be sealed by either one of the following methods.

a. Waterproofing Clamping Flange: Pipes up to and including 10 inches in diameter passing through roof or floor waterproofing membrane may be installed through a cast iron sleeve with caulking recess, anchor lugs, flashing clamp device, and pressure ring with brass bolts. Waterproofing membrane shall be clamped into place and sealant shall be placed in the caulking recess.

b. Modular Mechanical Type Sealing Assembly: In lieu of a waterproofing clamping flange, a modular mechanical type sealing assembly may be installed. Seals shall consist of interlocking synthetic rubber links shaped to continuously fill the annular space between the pipe/conduit and sleeve with corrosion protected carbon steel bolts, nuts, and pressure plates. Links shall be loosely assembled with bolts to form a continuous rubber belt around the pipe with a pressure plate under each bolt head and each nut.

   After the seal assembly is properly positioned in the sleeve, tightening of the bolt shall cause the rubber sealing elements to expand and provide a watertight seal rubber sealing elements to expand and provide a watertight seal between the pipe/conduit seal between the pipe/conduit and the sleeve. Each seal assembly shall be sized as recommended by the manufacturer to fit the pipe/conduit and sleeve involved. The Contractor electing to use the modular mechanical type seals shall provide sleeves of the proper diameters.

3.1.13.3 Fire-Rated Penetrations

Penetration of fire-rated walls, partitions, and floors shall be sealed with an UL rated firestopping system.

3.1.13.4 Escutcheons

Finished surfaces where exposed piping, bare or insulated, pass through floors, walls, or ceilings, except in boiler, utility, or equipment rooms, shall be provided with escutcheons. Where sleeves project slightly from floors, special deep-type escutcheons shall be used. Escutcheon shall be secured to pipe or pipe covering.

3.1.14 Access Panels

Access panels shall be provided where indicated for all concealed valves, vents, controls, and additionally for items requiring inspection or maintenance. Access panels shall be of sufficient size and located so

that the concealed items may be serviced and maintained or completely removed and replaced.

3.2 ELECTRICAL INSTALLATION

Install electrical equipment in accordance with NFPA 70 and manufacturers instructions.

3.3 CLEANING AND ADJUSTING

Pipes shall be cleaned free of scale and thoroughly flushed of all foreign matter. A temporary bypass shall be provided for all water coils to prevent flushing water from passing through coils. Strainers and valves shall be thoroughly cleaned. Prior to testing and balancing, air shall be removed from all water systems by operating the air vents. Temporary measures, such as piping the overflow from vents to a collecting vessel shall be taken to avoid water damage during the venting process. Air vents shall be plugged or capped after the system has been vented. Control valves and other miscellaneous equipment requiring adjustment shall be adjusted to setting indicated or directed.

3.4 FIELD TESTS

Field tests shall be conducted in the presence of the QC Manager or his designated representative to verify systems compliance with specifications. Any material, equipment, instruments, and personnel required for the test shall be provided by the Contractor.

3.4.1 Equipment and Component Isolation

Prior to testing, equipment and components that cannot withstand the tests shall be properly isolated.

3.4.2 Pressure Tests

Each piping system shall be hydrostatically tested at a pressure not less than 188 psig for period of time sufficient to inspect every joint in the system and in no case less than 2 hours. Test pressure shall be monitored by a currently calibrated test pressure gauge. Leaks shall be repaired and piping retested until test requirements are met. No leakage or reduction in gage pressure shall be allowed.

Leaks shall be repaired by rewelding or replacing pipe or fittings. Caulking of joints will not be permitted. Concealed and insulated piping shall be tested in place before concealing.

Submit for approval pressure tests reports covering the above specified piping pressure tests; describe the systems tested, test results, defects found and repaired, and signature of the pressure tests' director. Obtain approval from the QC Manager before concealing piping or applying insulation to tested and accepted piping.

3.4.3 Related Field Inspections and Testing

3.4.3.1 Piping Welds

Examination of Piping Welds is specified in the paragraph EXAMINATION OF PIPING WELDS (above).

3.4.3.2 HVAC TAB

Requirements for testing, adjusting, and balancing (TAB) of HVAC water piping, and associated equipment is specified in Section 23 05 93 TESTING, ADJUSTING, AND BALANCING FOR HVAC.

-- End of Section --

SECTION 23 73 13.00 40

MODULAR INDOOR CENTRAL-STATION AIR-HANDLING UNITS
05/17

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR MOVEMENT AND CONTROL ASSOCIATION INTERNATIONAL, INC. (AMCA)

AMCA 99	(2016) Standards Handbook
AMCA 211	(2013; Rev 2017) Certified Ratings Program Product Rating Manual for Fan Air Performance
AMCA 300	(2014) Reverberant Room Method for Sound Testing of Fans

AIR-CONDITIONING, HEATING AND REFRIGERATION INSTITUTE (AHRI)

AHRI 430 I-P	(2014) Performance Rating of Central Station Air-handling Unit Supply Fans
AHRI 880 I-P	(2011) Performance Rating of Air Terminals

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ASHRAE 51	(2016) Laboratory Methods of Testing Fans for Aerodynamic Performance Rating
ASHRAE 52.2	(2017) Method of Testing General Ventilation Air-Cleaning Devices for Removal Efficiency by Particle Size

ASTM INTERNATIONAL (ASTM)

ASTM A653/A653M	(2020) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION (ISO)

ISO 21940-11	(2016) Mechanical vibration -- Rotor balancing -- Part 11: Procedures and Tolerances for Rotors with Rigid Behavior

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA MG 1	(2018) Motors and Generators

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 90A	(2021) Standard for the Installation of Air Conditioning and Ventilating Systems

UNDERWRITERS LABORATORIES (UL)

UL 900	(2015) Standard for Air Filter Units

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Installation Drawings; G

Fabrication and Connection Drawings; G

SD-03 Product Data

Equipment and Performance Data; G

Sample Warranty; G

Air Filter Gauges; G

SD-06 Test Reports

Final Test Reports; G

SD-07 Certificates

List of Product Installations

Certificates of Conformance; G

Unit Cabinet

Fan

Drain Pans

Insulation

Spare Parts

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals

SD-11 Closeout Submittals

Warranty

1.3 QUALITY CONTROL

Submit a list of product installations for air-handling units showing a minimum of five installed units, similar to those proposed for use, that have been in successful service for at least 5 years. Provide a list that includes the purchaser, address of installation, service organization, and date of installation.

1.3.1 Certification of Conformance

Submit certificates of conformance for the following items, showing conformance with the referenced standards contained in this section:

a. Unit Cabinet

b. Fan

c. Drain Pans

d. Insulation

e. Plenums

f. Spare Parts

1.3.2 Sample Warranty

Submit samples of warranty language concurrently with Certificates for review and approval by the Contracting Officer.

Submit a sample warranty for the following items:

a. Unit Cabinet

b. Fan

c. Drain Pans

d. Insulation

e. Plenums

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver, handle, and store equipment and accessories in a manner that prevents damage or deformity. Provide temporary skids under units.

1.5 WARRANTY

Final acceptance is dependent upon providing the warranty, based on approved sample warranty, to the Contracting Officer, along with final test reports. Ensure that the warranty is valid for at least 2 years from the date of project closeout, showing Government as the warranty recipient.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Submit equipment and performance data for air-handling units, including

use life, total static pressure and coil face area classifications, and performance ratings.

Submit all required fabrication and connection drawings and obtain approval from the Contracting Officer before the start of work shown on these drawings.

Submit drawings and manuals that include a spare parts data sheet, with manufacture's recommended stock levels.

2.2 COMPONENTS

2.2.1 Air-Handling Unit (AHU)

Provide a central-station type, factory-fabricated, and sectionally assembled AHU. Provide AHU that includes components and auxiliaries in accordance with AHRI 430 I-P. Balance the AHU fan and motor according to ISO 21940-11.

Ensure that the total static pressure and coil face area classification conforms to AMCA 99.

Fans with enlarged outlets are not permitted.

2.2.2 Unit Cabinet

2.2.2.1 Class A and Class B Cabinets

Provide an AHU cabinet suitable for the pressure class shown and has leaktight joints, closures, penetrations, and access provisions. Provide a cabinet that does not expand or contract perceptibly when fans are starting or stopping and that does not pulsate during operation. Reinforce cabinet surfaces with deflections in excess of 0.004167 of unsupported span before acceptance. Stiffen pulsating panels, which produce low-frequency noise due to diaphragming of unstable panel walls, to raise the natural frequency to an easily attenuated level. Fabricate the enclosure from continuous hot-dipped-galvanized steel no lighter than 20 gauge thickness, to match the industry standard. Provide mill-galvanized sheet-metal that conforms to ASTM A653/A653M and that is coated with not less than 1.25 ounces of zinc per square foot of a two-sided surface. Provide mill-rolled structural-steel that is hot-dip-galvanized or primed and painted. Corrosion-protect cut edges, burns, and scratches in galvanized surfaces. Provide primed and painted black carbon steel cabinet construction that complies with this specification.

Provide removable panels to access the interior of the unit cabinet. Provide seams that are welded, bolted, or gasketed and sealed with a rubber-based mastic. Make entire cabinet floor and ceiling hot-dipped-galvanized steel. Provide removable access doors on both sides of all access, filter, and fan sections for inspection and maintenance.

2.2.2.2 Class C Cabinets

Provide an AHU cabinet that is suitable for the pressure class shown and has leaktight joints, closures, penetrations, and access provisions. Provide a cabinet that does not expand or contract perceptibly when the fans are starting or stopping and that does not pulsate during operation. Reinforce cabinet surfaces with deflections in excess of 0.002778 of

unsupported span before acceptance by the Contracting Officer. Stiffen pulsating panels, which produce low-frequency noise due to diaphragming of unstable panel walls, to raise the natural frequency to an easily attenuated level. Provide the enclosure that is fabricated from mill-galvanized or primed and painted carbon sheet steel. Provide mill-galvanized sheet metal that conforms to ASTM A653/A653M and that is coated with not less than 1.25 ounces of zinc per square foot of a two-sided surface. Provide mill-rolled structural steel that is hot-dip galvanized or primed and painted. Corrosion-protect edges, burns, and scratches in galvanized surfaces. Provide primed and painted black carbon steel cabinet construction that complies with this specification.

Provide removable panels to access the interior of the unit cabinet. Provide seams that are welded, bolted, or gasketed and sealed with a rubber-based mastic. Make the entire cabinet floor and ceiling hot-dipped galvanized steel. Provide removable access doors on both sides of all access, filter, and fan sections for inspection and maintenance.

2.2.2.3 Cabinet Construction

Where the cabinet size is such that personnel access is possible, strengthen the cabinet floor to permit entry without damaging any component. Hinge and latch the access doors and panels sufficiently close together to preclude leaks caused by distortion, and effectively gasket.

Interior surfaces of cabinets that are constructed of intact mill-galvanized steel require no further protection.

Provide cabinets with exterior surfaces constructed of mill-galvanized-steel that are prepared by a phosphatizing treatment, and painted with two coats of manufacturer's standard enamel finish in a color selected by the Contracting Officer.

Provide cabinets and casings that are double-walled with 2 inch insulation. Provide a galvanized interior wall.

Weigh the fan and motor assembly at the AHU manufacturer's factory for isolator selection. Statically and dynamically balance fan section assemblies, including fan wheels, shafts, bearings, drives, belts, isolation bases, and isolators. Allow isolators to free-float when performing fan balance. Measure vibration at each fan shaft bearing in horizontal, vertical, and axial directions.

Factory install all motors on slide bases to permit adjustment of belt tension.

Provide heavy-duty, open drip-proof, three-phase fan motors, operable at 460 volts (V), 60 hertz (Hz). Provide high-efficiency motors.

2.2.3 Fan

Ensure that fan wheels are dynamically and statically balanced at the factory. Provide a fan with RPM that is 25 percent less than the first critical speed. Provide a fan shaft that is solid, ground and polished steel and coated with a rust inhibitor. Provide V-belt-driven fans that are designed for 50 percent overload capacity. For variable air volume AHUs that are provided with variable-frequency drives, have their fans balanced over the entire range of operation (20 percent to 100 percent RPM). Balancing fans of only 100 percent design of RPM is not acceptable

for AHUs to be used with variable-frequency drives.

Mount fans on isolation bases. Internally mount motors on the same isolation bases and internally isolate fans and motors. Install flexible canvas ducts or a vibration absorbent fan discharge seal between the fan and casings to ensure complete isolation. Provide flexible canvas ducts that comply with NFPA 90A.

Provide an overall fan-section depth that is equal to or greater than the manufacturer's free-standing fan.

Locate the fan inlet where it provides not less than one-half fan-wheel diameter clearance from the cabinet wall or the adjacent fan inlet where double wheels are permitted.

Mount the AHU fan drive external to the casing.

Install the AHU fan motor and drive inside the fan cabinet. Provide a motor that conforms to NEMA MG 1 and is installed on an adjustable base. Provide an access door of adequate size for servicing the motor and drive. Provide a belt guard inside the cabinet or interlock the access door with the supply fan so that power to the fan is interrupted when the access door is opened.

2.2.4 Drain Pans

Provide intermediate-coil, 3 inch deep drip pans for each tiered coil bank.

Extend the top pan 12 inches beyond the face of the coil, and extend the bottom pan not less than 24 inches beyond the face of the coil. Where more than two pans are used, make the pan extension proportional. Make adequate supports from the same type of material as the pans or from hot-dip galvanized angle iron with isolation at the interface. Use 22-gauge, AISI Type 304, corrosion-resistant steel for pan material, with silver-soldered joints. Minimum size of the drain opening is 1-1/4 inches. Pipe the pan to the drain.

Extend the integral cabinet drain pan under all areas where condensate is collected and make it watertight with welded or brazed joints, piped to the drain. Provide corrosion protection in condensate collection areas, and insulate against sweating. Provide minimum 14-gauge sheet metal; however 16-gauge double-drain-pan construction is also acceptable.

Provide cooling coil ends that are enclosed by the cabinet and are factory insulated against sweating or drain to a drain pan.

Provide drain pans that are double-pan construction, thermally isolated from the exterior casing with 1 inch thick fiberglass insulation. Provide drain pans that slope to the drain and drain substantially dry by gravity alone when the drains are open.

Provide pans that have a double slope to the drain point.

2.2.5 Insulation

Provide a unit that is internally fitted at the factory with a sound-attenuating, thermal-attenuating, fibrous-glass material not less than 2 inches thick. Ensure that the insulation precludes any condensation on any exterior cabinet surface under conditions that are

normal to the unit's installed location. Provide acoustic treatment that attenuates fan noise in compliance with specified noise criteria. Apply material to the entire cabinet with waterproof adhesives and permanent fasteners. Provide adhesive and insulating material in accordance with NFPA 90A.

2.2.6 Coils

2.2.6.1 Coil Section

Provide a coil section that encases cooling coils and drain pipes. Arrange coils for horizontal air flow. Provide intermediate drain pans for multiple-coils installation. Completely enclose coil headers with the insulated casing with only the connections extending through the cabinet.

2.2.6.2 Coil Pressure and Temperature Ratings

Ensure that the coils are designed for the following fluid operating pressures and temperatures:

SERVICE	PRESSURE	TEMPERATURE
Chilled Water	200 PSI	40 degrees F

Provide coils that are air-pressure-tested under water at the following minimum pressures:

SERVICE	PRESSURE
Water (chilled)	250 PSI

2.2.6.3 Coil Casings

Provide coils that are factory-tested, dehydrated, vacuum-tested, purged with inert gas, and sealed before shipped to the job site.

Provide stainless-steel casings. Provide cast iron, brass, or copper coil headers. Fit water coil headers with 0.25 inch ips spring-loaded plug drains and vent petcocks. Provide automatic air vents with ball-type isolation valves for each coil that is piped to the drain pan.

2.2.6.4 Chilled Water Coils

Provide 0.625 inch outside diameter copper tubing for coils. Provide fins that are aluminum and mechanically bonded by tubing expansion with a maximum spacing of 12 fins per 1 inch unless otherwise noted. Provide coils that have supply and return connections on the same end. Provide a maximum of four coil rows.

2.2.6.5 Drainable Coils

Provide self-draining coils that have a drain point at the end of every tube and are pitched to that point. Drain provisions include drained headers, U-bends with integral plugs, or nonferrous plugs in cast-iron headers. Provide tubes that drain substantially dry by gravity alone when the drains and vents are open.

2.2.7 Eliminators

Provide eliminators that are SMACNA three-break, hooked-edge design, constructed of reinforced 16 gauge galvanized steel with assembled brazed joints. Provide easily removable eliminator sections for cleaning from the side of the AHU without requiring partial or complete disassembly of the AHU casing.

2.2.8 Filters

2.2.8.1 Filter Housing

Provide factory-fabricated filter sections of the same construction and finish as the unit casings. Provide filter sections that have filter guides and full height, double-wall, hinged, and removable access doors for filter removal. Provide air sealing gaskets to prevent air bypass around filters. Provide visible identification on media frames showing the model number and airflow direction. Where a filter bank is indicated or required, provide a means of sealing to prevent bypass of unfiltered air. Ensure that the filters perform in accordance with ASHRAE 52.2.

2.2.8.2 Replaceable Air Filters

Select filters conforming to UL 900, Class 1. Ensure that when clean filters are exposed to flame, the filters do not contribute fuel when attacked by flame and emit only negligible amount of smoke. Provide permanent frames with replaceable media, 1 inch thickness, size as indicated.

2.2.8.3 Outside Air Filters

Provide an extended-surface, factory-assembled air filters with supported cartridges. Provide extended surface filter units fabricated for disposal when the dust-load limit is reached as indicated by maximum (final) pressure drop.

Filter Classification: UL-approved for Class 1 or 2 conforming to UL 900.

Filter Grades, Nominal Efficiency and Application:

a. Grade B: 80 to 85 percent nominal efficiency outfitter

b. Grade D: 25 to 30 percent nominal efficiency prefilter

Filter Media: Grade B Supported (Rigid Pleated) Type: Provide media that is composed of high-density glass fibers. Use fastening methods to maintain pleat shape, seal aluminum separators in a proper enclosing frame to ensure that there is no air leakage for the life of filter. Staples and stays are prohibited.

Grade D Type: Provide media that is composed of synthetic/natural fibers. Bond a metal grid backing to the air leaving side of the media to maintain uniform pleat shape and stability for proper airflow and maximum dust loading. Provide a media frame that is constructed of high-strength, moisture-resistant fiber or beverage board. Bond the pleated media pack on all four edges to ensure that there is no air leakage for the life of the filter. Staples and stays are prohibited.

Filter Efficiency and Arrestance: Determine the efficiency and arrestance

of filters in accordance with ASHRAE 52.2 Standard Atmospheric dust spot efficiency and synthetic dust weight arrestance that is not less than the following:

	Initial Efficiency (Percent)	Average Efficiency (Percent)	Final Efficiency (Percent)
Grade B	58	79	98
Grade D	Less than 20	22	89

Maximum initial and final resistance and inches of water gauge for each filter cartridge when operated at a face velocity of 500-feet per minute are as follows:

	Initial Resistance	Final Resistance
Grade B, Rigid Pleated	0.60	1.00
Grade D, 2-inches deep	0.32	0.70

Dust-Holding Capacity: When tested to 1.00 inch w.g. at 500 feet per minute face velocity, provide a dust-holding capacity from each 24 inch by 24 inch (face area) filter that is at least equal to the values listed below. For other filter sizes, provide a dust-holding capacity that is proportionally higher or lower.

Grade B, Rigid Pleated 6.17 ounces
Grade D, 2 inches Deep 2.29 ounces
Grade D, 4 inches Deep 10.58 ounces

Minimum Media Area: Provide a minimum net effective area in square feet for each 24 inch by 24 inch (face area) filter at 500 feet per minute face velocity of at least the values listed below. For other filter sizes, provide a net effective media that is proportionally higher or lower.

Grade B, Rigid Pleated 57.0
Grade D, 2-inches Deep 14.8

2.2.8.4 Air Filter Gauges

Provide manometer air filter gauges of the inclined tube differential type that have solid acrylic plastic construction with a built-in level vial and with an adjustable mirror-polished scale. Equip gauges with vent valves for zeroing and over-pressure safety traps. Ensure that the gauge range is adequate for the particular installation.

Provide one air filter gauge at each filter bank.

PART 3 EXECUTION

3.1 PREPARATION

Coordinate the size and location of concrete equipment pads, variable frequency drives, control, and electrical requirements.

3.2 INSTALLATION

Install equipment in accordance with the manufacturer's recommendations.

Provide installation drawings in accordance with referenced standards in this section.

3.2.1 Temporary Construction Filters

Have temporary construction filters in place during normal building construction whenever the AHUs are run for general ventilation, building dehumidification, or other purposes during construction. Install two layers of blanket filter at a time. Replace temporary construction filters as required during construction and after duct system cleaning is completed.

After systems have been cleaned and temporary construction filters are removed, and before test and balance operations are started, install a set of final filters. Avoid loading the filter with construction dust; do not have final filters in place while general building construction is taking place. Clean the permanent filter bank before testing and balancing.

The maximum number of coil rows is four. Maximum number of fins per inch is ten.

Provide variable air volume (VAV) terminal units that are certified by AHRI 880 I-P and UL-listed.

3.3 FIELD QUALITY CONTROL

3.3.1 Vibration Analyzer

Use an Fast Fourier Transform (FFT) analyzer to measure vibration levels. The following characteristics are required: A dynamic range greater than 70 dB; a minimum of 400-line resolution; a frequency response range of 5 Hz to 10 KHz(300-600000 cpm); the capacity to perform ensemble averaging, the capability to use a Hanning window; auto-ranging frequency amplitude; a minimum amplitude accuracy over the selected frequency range of plus or minus 20 percent or plus or minus 1.5 dB.

Use an accelerometer, either stud-mounted or mounted using a rare earth, low-mass magnet and sound disk (or finished surface) with the FFT analyzer to collect data. Ensure that the mass of the accelerometer and its mounting have minimal influence on the frequency response of the system over the selected measurement range.

3.3.2 Acceptance

Before final acceptance, use dial-indicator gauges to demonstrate that the fan and motor are aligned as specified.

Before final acceptance, verify conformance to specifications using vibration analysis. Ensure that the maximum vibration levels are 0.075 inches per second at 1 times run speed and at fan/blade frequency, and 0.04 inches per second at other multiples of run speed.

3.3.3 AHU Testing

Conduct performance test and rate the AHU and components in accordance

with AMCA 211, AMCA 300, and ASHRAE 51. Provide AHU ratings in accordance with AHRI 430 I-P.

Provide final test reports to the Contracting Officer. Provide reports with a cover letter/sheet clearly marked with the system name, date, and the words "Final Test Reports - Forward to the Systems Engineer/Condition Monitoring Office/Predictive Testing Group for inclusion in the Maintenance Database."

Perform AHU start-up in the presence of the Contracting Officer.

3.4 CLOSEOUT ACTIVITIES

3.4.1 Operation And Maintenance

Submit operation and maintenance manuals before testing the AHUs. Update and resubmit data for final approval no later than 30 calendar days before contract completion.

3.4.2 Acceptance

With the warranty, provide a cover letter/sheet clearly marked with the system name, date, and the words "Equipment Warranty" - "Forward to the Systems Engineer/Condition Monitoring Office/Predictive Testing Group for inclusion in the Maintenance Database."

-- End of Section --

SECTION 23 81 23

COMPUTER ROOM AIR CONDITIONING UNITS
11/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AIR-CONDITIONING, HEATING AND REFRIGERATION INSTITUTE (AHRI)

AHRI 410	(2001; Addendum 1 2002; Addendum 2 2005; Addendum 3 2011) Forced-Circulation Air-Cooling and Air-Heating Coils
AHRI 1360	(2017) Performance Rating of Computer and Data Processing Room Air Conditioners
ANSI/AHRI 460	(2005) Performance Rating of Remote Mechanical-Draft Air-Cooled Refrigerant Condensers
ANSI/AHRI 520	(2004) Performance Rating of Positive Displacement Condensing Units

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS (ASHRAE)

ANSI/ASHRAE 15 & 34	(2013) ANSI/ASHRAE Standard 15-Safety Standard for Refrigeration Systems and ANSI/ASHRAE Standard 34-Designation and Safety Classification of Refrigerants
ASHRAE 52.2	(2017) Method of Testing General Ventilation Air-Cleaning Devices for Removal Efficiency by Particle Size
ASHRAE 62.1	(2019; ADD A-G 2021; Errata 3 2021) Ventilation for Acceptable Indoor Air Quality
ASHRAE 90.1 - IP	(2013) Energy Standard for Buildings Except Low-Rise Residential Buildings
ASHRAE 127	(2020) Method of Testing for Rating Computer and Data Processing Room Unitary Air-Conditioners

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B31.1	(2020) Power Piping
ASME B31.5	(2020) Refrigeration Piping and Heat Transfer Components

ASTM INTERNATIONAL (ASTM)

ASTM B117	(2019) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM C1338	(2014) Standard Test Method for Determining Fungi Resistance of Insulation Materials and Facings
ASTM D5864	(2011) Standard Test Method for Determining Aerobic Aquatic Biodegradation of Lubricants or Their Components
ASTM D6081	(1998; R 2014) Aquatic Toxicity Testing of Lubricants: Sample Preparation and Results Interpretation

ETL TESTING LABORATORIES (ETL)

ETL DLP	(updated continuously) ETL Listed Mark Directory

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE C2	(2017; Errata 1-2 2017; INT 1 2017) National Electrical Safety Code

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA MG 1	(2018) Motors and Generators
NEMA MG 10	(2017) Energy Management Guide for Selection and Use of Fixed Frequency Medium AC Squirrel-Cage Polyphase Induction Motors
NEMA MG 11	(1977; R 2012) Energy Management Guide for Selection and Use of Single Phase Motors

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code

U.S. ARMY CORPS OF ENGINEERS (USACE)

EM 1110-2-1424	(2016) Engineering and Design -- Lubricants and Hydraulic Fluids

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

40 CFR 82	Protection of Stratospheric Ozone

UNDERWRITERS LABORATORIES (UL)

UL 181	(2013; Reprint Apr 2017) UL Standard for Safety Factory-Made Air Ducts and Air

Connectors

UL Elec Equip Dir (2011) Electrical Appliance and Utilization Equipment Directory

1.2 DEFINITIONS

Computer Room Air Conditioner (CRAC): A single, self-contained unit or split-system unit designed and manufactured specifically for temperature and humidity control of data processing environments.

Cold Aisle: The aisle between or adjacent to rows of racks from which the computing equipment draws cool air.

Hot Aisle: The aisle between or adjacent to rows of racks to which the computing equipment ejects hot air.

Rack: Telecommunications support frame that can consist of post-and-frame or full cabinet construction. Racks are provided under Section 27 10 00 BUILDING TELECOMMUNICATIONS CABLING SYSTEM.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Computer Room Air Conditioner; G

Small Computer Room Air Conditioners; G

Space Temperature Control System Drawings; G

Filters

Refrigerants; G

Leak Detection; G

SD-06 Test Reports

Manufacturer's Factory Test Plans; G

Factory Test Reports; G

Field Test Schedule; G

Manufacturer's Field Test Plans; G

Field Test Reports; G

SD-07 Certificates

Certificate of Specification Compliance; G

Credentials of the Manufacturer's Field Test Representative; G

Ozone Depleting Substances Technician Certification

Certified List Of Qualified Permanent Service Organizations

SD-08 Manufacturer's Instructions

Installation Manual for Each Type of CRAC

SD-10 Operation and Maintenance Data

Computer Room Air Conditioner Operation and Maintenance Data, Data Package 4; G

SD-11 Closeout Submittals

Indoor Air Quality During Construction; G

1.4 REFRIGERANTS

Refrigerants must have an Ozone Depletion Potential (ODP) no greater than 0.0. CFC-based refrigerants are prohibited. HCFCs and Halons are not permitted. Provide SDS sheets for all refrigerants.

1.5 QUALIFICATIONS

1.5.1 Ozone Depleting Substances Technician Certification

All technicians working on equipment that contain ozone depleting refrigerants must be certified as a Section 608 Technician to meet requirements in 40 CFR 82, Subpart F. Provide copies of technician certifications to the Contracting Officer at least 14 calendar days prior to work on any equipment containing these refrigerants.

1.6 QUALIFICATIONS

1.6.1 Material and Equipment Qualifications

Provide materials and equipment that are standard products of manufacturers regularly engaged in the manufacturer of such products, which are of a similar material, design, and workmanship. Standard products must have been in satisfactory commercial or industrial use for two years prior to bid opening. The two-year use must include applications of equipment and materials under similar circumstances and of similar size. The product must have been for sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the two-year period.

1.6.2 Alternative Equipment Qualifications

Products having less than a two-year field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturer's factory or laboratory tests, can be shown.

1.6.3 Service Support

The equipment items must be supported by service organizations. Submit a certified list of qualified permanent service organizations for support of

the equipment which includes their addresses and qualifications. These service organizations must be reasonably convenient to the equipment installation and able to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

1.6.4 Manufacturer's Nameplate

For each item of equipment, provide a nameplate bearing the manufacturer's name, address, model number, and serial number securely affixed in a conspicuous place; the nameplate of the distributing agent will not be acceptable.

1.6.5 Modification of References

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word, "must" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction", or words of similar meaning, to mean the Contracting Officer.

1.6.5.1 Definitions

For the International Code Council (ICC) Codes referenced in the contract documents, advisory provisions must be considered mandatory, the word "should" is interpreted as "must." Reference to the "code official" must be interpreted to mean the "Contracting Officer."

1.6.5.2 Administrative Interpretations

For ICC Codes referenced in the contract documents, the provisions of Chapter 1, "Administrator," do not apply. These administrative requirements are covered by the applicable Federal Acquisition Regulations (FAR) included in this contract and by the authority granted to the Officer in Charge of Construction to administer the construction of this project. References in the ICC Codes to sections of Chapter 1, must be applied appropriately by the Contracting Officer as authorized by his administrative cognizance and the FAR.

1.7 PROJECT REQUIREMENTS

1.7.1 Verification of Dimensions

Become familiar with the details of the work, verify all dimensions in the field, and provide adequate clearance for all connections and service access. Notify the Contracting Officer of any discrepancy before performing any work.

1.7.2 Energy Efficiency

Provide equipment with minimum efficiencies as required by ASHRAE 90.1 - IP.

1.8 DELIVERY, STORAGE, AND HANDLING

Handle, store, and protect equipment and materials to prevent damage before and during installation in accordance with the manufacturer's recommendations, and as approved by the Contracting Officer. Replace damaged or defective items.

PART 2 PRODUCTS

2.1 COMPUTER ROOM AIR CONDITIONER (CRAC)

Provide complete working CRACs, designed, and factory assembled, and factory tested. Equipment must be listed in UL Elec Equip Dir or ETL DLP for computer room application. CRACs must have a minimum sensible coefficient of performance in accordance with ASHRAE 127. CRACs must include room cabinet and frame, fan section, filter section, cooling coil, reheat coil, humidifier, compressors, condensers, controls, and, interconnecting piping internal to the CRAC. Provide units rated in accordance with AHRI 1360.

2.1.1 Unit Airflow Configuration

2.1.1.1 Upflow Units

The CRAC must draw return air in at the bottom or sides of the cabinet and discharge supply air at the top of the cabinet.

2.1.2 Cabinet and Frame

2.1.2.1 Unit Frame

Unit frame must be manufactured of welded steel tubes and must be mill-galvanized or coated with an epoxy finish.

2.1.2.2 Unit Cabinet

Exterior panels must be steel sheet, minimum of 20 gage, mill-galvanized or coated with a corrosion-inhibiting epoxy finish in manufacturer's standard color. Mill galvanized sheet metal must be coated with not less than 1.25 ounces of zinc per square foot of two-sided surface. Mill rolled structural steel must be hot-dip galvanized or primed and painted. Cut edges, burns and scratches in hot-dip galvanized surfaces must be coated with galvanizing repair coating. Manufacturer's standard cabinet materials and finishes will be acceptable if equivalent to the above requirements and approved by the Contracting Officer.

Provide removable panel for access to controls without interrupting airflow. Panels must be gasketed to prevent air leakage under system operating pressure and must be removable for service access without the use of special tools.

2.1.3 Fan Section

Provide fan(s) and fan motor(s) as integral, factory installed components of the CRAC.

2.1.3.1 Fan Wheel

The supply air fan must be AMCA certified. Provide steel, backward curved, plenum/plug type fan wheel. The fan must be statically and dynamically balanced. The fan must have self-aligning, permanently lubricated ball bearings with a minimum life span of 100,000 hours. Assess potential effects of lubricant on aquatic organisms in accordance with ASTM D6081 and submit aquatic toxicity reports. Assess biodegradation in accordance with ASTM D5864. In accordance with EM 1110-2-1424 Chapter 8, aquatic toxicity shall exceed 1,000 ppm at LL50

and biodegradation shall exceed 60 percent conversion of carbon to carbon dioxide in 28 days.

2.1.3.2 Motor and Drive

Provide fan wheel directly coupled to motor shaft.

Provide electronically commutated motor with integrated electronic control board and direct microprocessor control signaling for speed control.

2.1.4 Cooling Coil

Provide AHRI 410 coil and slope for drainage. Coil must be manufactured of seamless copper tubes with plate aluminum fins. Indoor and outdoor coils must be matched and from same manufacturer. Each coil, in the production process, must be individually tested at 320 psi with compressed air under water and verified to be air tight. Factory dehydrate and seal each coil after testing and prior to evaluation and charging. Provide DX coil complete with a distributor and thermostatic expansion valve with external equalizer. Provide condensate drain pan of minimum 22 gage Type 304 stainless steel with nonferrous connections, internal trap, and a condensate pump system complete with integral pump discharge check valve, integral float switch, reservoir, and pump and motor assembly.

2.1.5 Filters

Provide UL listed 2 inches thick deep pleated fiberglass throwaway type filters. Provide filtration media with a Minimum Efficiency Reporting Value (MERV) of 13 as determined by ASHRAE 52.2. Provide one complete spare filter bank set per unit for installation prior to final acceptance testing covered in Part 3 of this section.

2.1.6 Reheat Coil

Provide electric reheat coils with low watts density. The electric reheat coils must be enclosed in 304 stainless steel tubes and 304 stainless steel fins. Provide modulating control of the electric reheat coils by multiple stages or Silicon Controlled Rectifier (SCR). Provide UL or ETL listed safety switches to protect system from overheating.

2.1.7 Humidifier

Humidifier section must include liquid-level control, emergency overflow and automatic water supply system factory pre-piped for final connection. Provide stainless steel evaporator pan with water high level and low level alarms. Arrange system to be cleanable and serviceable. Provide water chemistry requirements with humidifier submittal data.

Provide infrared type humidifier, including high intensity quartz lamps mounted above and out of water supply.

2.1.8 Compressor

Provide compressor that is direct drive, scroll type capable of operating at partial load conditions. Compressor must be capable of continuous operation down to the lowest step of unloading as specified. Provide compressors of 7.5 tons and larger with capacity reduction devices to produce automatic capacity reduction of at least 50 percent. If standard with the manufacturer, two or more compressors may be used in lieu of a

single compressor with unloading capabilities, in which case the compressors operate in sequence, and each compressor has an independent refrigeration circuit through the condenser and evaporator. Start each compressor in the unloaded position. Provide compressors complete with vibration isolation, suction and discharge service valves, high and low pressure safety switches, protection against short cycling, and built-in overload protection. Provide refrigeration circuits including hot gas mufflers, liquid-line filter-drier, refrigerant sight glass, lubrication pump, and moisture indicator, externally equalized expansion valve, and liquid-line solenoid valve factory connected with refrigeration copper tubing.

2.1.8.1 Refrigeration Circuit

Provide field-installed refrigerant tubing for split systems in accordance with Section 23 23 00 REFRIGERANT PIPING.

Refrigerant-containing components must comply with ANSI/ASHRAE 15 & 34 and be factory tested, cleaned, dehydrated, charged with nitrogen and sealed. Provide refrigerant charging valves and connections, and pumpdown valves for each circuit.

2.1.9 Condenser

Provide condenser circuit pre-piped with start-up and head pressure controls to maintain system operation at ambient temperatures down to 20 degrees F.

Provide an integral factory wired and tested control panel for each condenser. The factory control board must control each condenser fan speed individually to optimize overall system performance.

2.1.9.1 Air-cooled Condenser

Provide remote air-cooled condenser arranged for vertical air discharge, designed and manufactured specifically for permanent outdoor installation. Condenser performance must be rated in accordance with ANSI/AHRI 460. Condenser must have head pressure control to allow unit operation down to 0 degrees F.

2.1.9.1.1 Condenser Fans

Provide direct-driven propeller fans with factory balanced aluminum blades and equipped with fan guards. Provide electronically commutated fan motors with totally enclosed enclosures.

2.1.9.1.2 Condenser Coils

Air-cooled condenser coils must be seamless copper tubes with plate type aluminum fins with coating as described in paragraph CORROSION PROTECTION FOR COASTAL INSTALLATIONS. The coils, in the production process, must be pressure tested with compressed air at 300 psig under water and verified to be leak-free. Factory dehydrate and seal each coil after testing and prior to evaluation and charging.

2.1.9.1.3 Unit Casing

Provide air-cooled condenser casings and mounting legs manufactured from aluminum or galvanized steel with manufacturer's standard

corrosion-resistant finish coating as described in paragraph CORROSION PROTECTION FOR COASTAL INSTALLATIONS.

2.2 SMALL COMPUTER ROOM AIR CONDITIONERS

Provide complete working CRACs, designed and factory assembled. Equipment must be listed in UL Elec Equip Dir or ETL DLP for computer room application. CRACs must have a minimum sensible coefficient of performance in accordance with ASHRAE 127. CRACs must include room cabinet and frame, fan, filter, cooling coil, compressors, condensers, controls, and, interconnecting piping internal to the CRAC. Provide units rated in accordance with AHRI 1360. Provide all refrigerant piping in accordance with Section 23 23 00 REFRIGERANT PIPING.

2.2.1 System Configuration

Split System Air Cooled: Provide an indoor unit for ducted concealed application, an outdoor condensing unit, and interconnecting refrigerant piping. Unit must consist of a direct expansion system evaporator and an outdoor, air cooled condensing unit.

2.2.2 Evaporator Cabinet Construction

Provide cabinet and chassis constructed of heavy gauge galvanized steel with all service access from a single side of the unit. Mounting brackets must be integral to the cabinet. Internal cabinet insulation must meet ASHRAE 62.1 requirements for Mold Growth, Humidity & Erosion, tested per UL 181 and ASTM C1338 standards.

2.2.3 Air Distribution Components

Provide direct-drive fan assembly equipped with double-inlet blower, self-aligning ball bearings and lifetime lubrication. Fan motor must be permanent-split capacitor, high-efficiency type, equipped with two speeds for airflow modulation. The microprocessor controller must use the lower fan speed for precise dehumidification control. Fan speed must also be user selectable from the wall controller. System must be suitable for supply and return air plenum or ducted supply and return air distribution. Provide filter rack designed to accept 4 inch thick filters. Provide pleated filters with a MERV 8 rating in accordance with ASHRAE 52.2.

2.2.4 Direct Expansion System Evaporator Components

The evaporator section must include evaporator coil, thermostatic expansion valve and filter drier. The evaporator coil must be constructed of copper tubes and aluminum fins. Provide an externally equalized thermostatic expansion valve to control refrigerant flow. The refrigerant piping must be spun-closed and filled with a nitrogen holding charge. Evaporator and condensing unit must be field piped using copper lines, brazed, evacuated and field charged with R-407C refrigerant. The evaporator unit can be coupled directly with the condensing unit or mounted remote to the condensing unit. The coil assembly must be mounted in a condensate drain pan with an internally trapped drain line. The evaporator drain pan must include a factory-installed float switch to shut down the evaporator upon high water condition.

2.2.5 Outdoor, Air-Cooled Condensing Unit

Provide condensing unit rated in accordance with ANSI/AHRI 520 and designed for permanent outdoor installation. Provide removable panels for access to all components. Condensing unit components must include condenser coil, direct drive propeller fan, scroll compressor, high-pressure switch, refrigerant receiver, head pressure control valve, hot gas bypass system, and liquid line solenoid valve. Unit casing and chassis must be constructed of heavy gauge galvanized steel.

Provide hot gas bypass to reduce compressor cycling and improve operation under low-load conditions. The hot gas bypass must be completely contained in the condensing unit. Field installed third refrigerant line is not acceptable. Hot gas bypass must be automatically deactivated upon a call for dehumidification. Provide a high pressure switch to protect the unit from abnormal refrigerant pressure conditions and deactivate the compressor and annunciate an alarm at the wall controller. The blower must continue to circulate air. The wall controller must be used to manually restart the compressor function after the automatic pressure switch resets. Three high head pressure alarms in a rolling 12-hour period must lock out the manual restart feature until power is cycled to the evaporator unit. A pressure balancing valve must be factory installed to reduce the chance of high pressure cut-out due to excessive refrigerant migration to the receiver due to changing outdoor temperatures during off-cycles. The refrigerant piping must be spun-closed and filled with a nitrogen holding charge. Evaporator and condensing unit must be field piped using copper lines, brazed, evacuated and field charged with R-407C refrigerant. Condensing unit must be designed for 95 degrees F ambient and be capable of operation to 0 degrees F. Condensing unit must operate at a sound level less than 58 dbA. The condensing coil must be constructed of copper tubes and aluminum fins.

2.2.6 Electric Reheat

Provide factory mounted, 304/304 stainless steel, finned-tubular electric resistance heater. Reheat must be controlled by the integral unit controls to maintain room dry bulb temperature when dehumidification is required. Provide UL listed safety switch to protect the system from overheating. Provide a factory mounted ground current detector to shut-down the entire unit if a ground fault in the reheat system is detected. Provide Silicon Controlled Rectifier (SCR) controller to proportionally control the reheat elements to maintain the selected room temperature.

2.2.7 Controls

Provide remote mounted color touchscreen display for each unit. Provide remote mounted temperature and humidity sensors for each unit. Controls must be organized by menus with minimum menu selection of: Alarms, Event Log, Graphics, and Status Overview. The Graphics menu must display a minimum of the following: zone temperature and humidity, zone setpoints, fan status. Controls must include a control system interface. The control system interface must meet DDC Hardware requirements of Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS.

2.3 INSTRUMENTATION AND CONTROLS

2.3.1 Unit Level Controls

Provide factory installed components and wiring to control a unit's basic functions and space ambient conditions including humidification and dehumidification at one factory installed and tested station. Controller modules must provide automatic centralized control of computer room critical equipment, simplifying emergency switching and unit testing. When the module recognizes an alarm condition, it must automatically switch to a stand-by device. User must be able to program a switching delay to allow time to correct emergency conditions. Provide modules with capability to balance the runtime of all connected air units. Provide clear, simplified instructions for programming and configuration of controllers, minimizing the chances of operator error. Provide an electronic temperature and humidity recorder, integral or external to the unit, readable to specified control accuracy, complete with supplies required for one year of operation. Controls must include a control system interface to an HVAC control system. The control system interface must meet DDC Hardware requirements of Section 23 09 23.02 BACNET DIRECT DIGITAL CONTROL FOR HVAC AND OTHER BUILDING CONTROL SYSTEMS.

2.3.1.1 Display Panel

Display panel must include the following minimum data: power on, power off, unit in alarm, description of alarm, filter status, room temperature, room relative humidity, event log, service contact information, and unit run hours. Display must have capability to set up password protection.

Provide the following minimum externally accessible controls at the unit: start and stop total system functions, silence audible alarm, main power disconnect.

2.3.1.2 Alarms

Display alarms on unit display panel. Alarm for the following: high and low space temperature, high and low space humidity, dirty filters, loss of airflow, compressor high head pressure, custom alarms as indicated on the controls drawings, humidifier problems, and leak detection. Provide field accessible local audible alarm with silence pushbutton. Provide push-to-test lamps or all-lamp test pushbutton. CRACs must have local devices which provide signals for remote audible and visual alarming capability for the above specified alarm conditions.

2.3.1.3 Leak Detection

Provide spot moisture detection system for each computer room. Leak detection must be designed for installation on the subfloor below the raised floor of the computer room. Leak detection system must interface with the associated CRAC control panel to alarm upon detection of moisture on the subfloor.

2.3.1.4 Factory Wired Components

Provide CRAC manufacturer's remote room temperature sensor and room humidity sensor. Sensors must meet the requirements of Section 23 09 13 INSTRUMENTATION AND CONTROL DEVICES FOR HVAC.

Provide factory wired discharge air temperature sensor. Sensors must meet

the requirements of Section 23 09 13 INSTRUMENTATION AND CONTROL DEVICES FOR HVAC.

2.3.2 Supervisory CRAC Controls

In addition to stand alone controls, provide devices to network together all CRACs in each computer room. The network device must integrate all data for each CRAC, as required under stand alone controls, and display it on any connected CRAC's display panel. The network device must optimize the operation of all connected CRACs to minimize energy use. The network device must balance runtime across all connected units. The network device must automatically switch to a standby unit upon detection of failure of a duty unit. Provide all control wiring among CRACs and network devices as required to meet this specification.

2.4 CORROSION PROTECTION FOR COASTAL INSTALLATIONS

Provide the polyelastomer or phenolic finish coating system on exterior coils, exterior casings, interior coils exposed to outdoor air, and interior casings exposed to outdoor air. The coating system must not reduce the HVAC equipment's performance rating.

Finish coating must be applied at the premises of the HVAC equipment manufacturer or at the premises of the coating manufacturer or his authorized applicator. Provide finish coating in colors gray, or aluminum, or ivory. All components of the special finish coating systems, including primers and intermediate coats, must be applied by immersion dip-coating or spray-coating in accordance with coating manufacturer's written procedures.

If special finish coatings are applied at the finish coating manufacturer's (or his authorized applicator's) premises, the equipment to be finish coated must be transported to and from the finish coating manufacturer's premises by the Contractor. The finish-coating manufacturer must be responsible for necessary disassembly of the HVAC equipment and re-assembly of final finish coated equipment.

Submit for approval a Certificate of Specification Compliance provided by the finish coating system manufacturer. Requirements for certificate include:

a. Name of firm that provided the finish coating system.

b. Project title and Navy construction contract number.

c. Listing of the pieces of equipment that were finish coated by this firm.

d. Certificate must certify that the finish coating materials and application procedures employed conform to the contract specifications.

e. Date of final inspection by this firm and printed name and signature of the inspector.

f. Printed name and signature of the officer of the firm that is responsible for firm's certification program.

2.4.1 Polyelastomer Finish Coating System

2.4.1.1 Heat Exchanger Coil (Including Evaporator Coil) Surfaces

a. Acrylic polymer resin primer: 1 mil minimum dry film thickness.

b. Polyelastomer resin top coating: 3 coats, 1.5 mils minimum total dry film thickness.

c. In lieu of coating, provide copper tubes and copper fins

2.4.1.2 Uninsulated Interior Surfaces and Exterior Surfaces

Polyelastomer resin: 3 coats, 4 to 6 mils minimum total dry film thickness.

2.4.1.3 Insulated Interior Surfaces

Vinyl: 2 to 10 mils minimum dry film thickness.

2.4.2 Phenolic Finish Coating System

Provide a resin base thermosetting phenolic finish.

2.4.2.1 Heat Exchanger Coil (Including Evaporator Coil) Surfaces

a. Apply phenolic finish to the entire coil. Provide a minimum of two coats. Total minimum dry film thickness must be 3 mils.

b. In lieu of coating, provide coil of copper tubes and copper fins

2.4.2.2 Uninsulated Interior Surfaces and Exterior Surfaces

Amine cured epoxy phenolic finish: 6 to 7 mils minimum total dry film thickness.

2.4.2.3 Insulated Interior Surfaces

Polyester or Vinyl Ester finish: 2 to 10 mils minimum dry film thickness.

2.5 FACTORY PAINTING SYSTEMS

Provide manufacturer's standard factory painting. Certify that the factory painting system applied will withstand 125 hours in a salt-spray fog test, except that equipment located outdoors must withstand 500 hours in a salt-spray fog test. Salt-spray fog test must be in accordance with ASTM B117, and for that test the acceptance criteria must be as follows: immediately after completion of the test, the paint must show no signs of blistering, wrinkling, or cracking, and no loss of adhesion; and the specimen must show no signs of rust creepage beyond 0.125 inch on either side of the scratch mark.

The film thickness of the factory painting system applied on the equipment must not be less than the film thickness used on the test specimen. The factory painting system must be designed for the anticipated temperature service.

2.6 ELECTRICAL

Provide an integral electrical panel of similar construction to the unit cabinet. Within the electrical panel, provide a single point power connection terminal block and fused disconnect switch,. The electrical panel must provide at least 65,000 amp Short Circuit Current Rating (SCCR). Refer to electrical drawing for Short Circuit Current Rating (SCCR).

2.6.1 Electrical Motors, Controllers, Contactors, and Disconnects

Provide motors, controllers, disconnects and contactors with their respective pieces of equipment. Motors, controllers, disconnects and contactors must conform to and have electrical connections provided under Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Provide internal wiring for components of packaged equipment as an integral part of the equipment. Extended voltage range motors will not be permitted. Controllers and contactors must have a maximum of 120 volt control circuits, and must have auxiliary contacts for use with the controls provided. When motors and equipment provided are larger than sizes indicated, the cost of additional electrical service and related work must be included under the section that specified that motor or equipment. Power wiring and conduit for field installed equipment must be provided under and conform to the requirements of Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

2.6.2 Electrical Installations

Conform to IEEE C2, NFPA 70, and requirements specified herein.

2.6.2.1 New Work

Provide electrical components of mechanical equipment, such as motors, motor starters (except starters/controllers which are indicated as part of a motor control center), control or push-button stations, float or pressure switches, solenoid valves, integral disconnects, and other devices functioning to control mechanical equipment, as well as control wiring and conduit for circuits rated 100 volts or less, to conform with the requirements of the section covering the mechanical equipment. Extended voltage range motors are not to be permitted. The interconnecting power wiring and conduit, control wiring rated 120 volts (nominal) and conduit, the motor control equipment forming a part of motor control centers, and the electrical power circuits must be provided under Division 26, except internal wiring for components of package equipment must be provided as an integral part of the equipment. When motors and equipment provided are larger than sizes indicated, provide any required changes to the electrical service as may be necessary and related work as a part of the work for the section specifying that motor or equipment.

2.6.2.2 Modifications to Existing Systems

Where existing mechanical systems and motor-operated equipment require modifications, provide electrical components under Division 26.

2.6.2.3 High Efficiency Motors

2.6.2.3.1 High Efficiency Single-Phase Motors

Unless otherwise specified, single-phase fractional-horsepower alternating-current motors must be high efficiency types corresponding to

the applications listed in NEMA MG 11.

2.6.2.3.2 High Efficiency Polyphase Motors

Unless otherwise specified, polyphase motors must be selected based on high efficiency characteristics relative to the applications as listed in NEMA MG 10. Additionally, polyphase squirrel-cage medium induction motors with continuous ratings must meet or exceed energy efficient ratings in accordance with Table 12-6C of NEMA MG 1.

2.6.2.4 Three-Phase Motor Protection

Provide controllers for motors rated 1 horsepower and larger with electronic phase-voltage monitors designed to protect motors from phase-loss, undervoltage, and overvoltage. Provide protection for motors from immediate restart by a time adjustable restart relay.

2.6.3 Electrical Control Wiring

Provide control wiring under Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC. Provide control wiring under this section in accordance with NFPA 70 and Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Provide Space temperature control system drawings which include point-to-point electrical wiring diagrams.

2.7 FIRE PROTECTION DEVICES

The requirements for duct smoke detectors are specified in Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

2.8 SOURCE QUALITY CONTROL

Provide factory test plans, factory test schedules, factory tests and factory test reports on each of the CRACs;.

2.8.1 Manufacturer's Factory Test Plans

For each CRAC, submit a factory test plan which when followed during factory testing shall verify that the performance scheduled on the drawings is met by the produced CRAC models.

The manufacturer shall perform factory tests on the actual CRACs produced for this project. The test reports shall document the performance tests conducted on the factory assembled computer room air conditioning units. Performance testing on the individual computer room air conditioning unit components, not factory assembled, is not acceptable.

Submit the required test plans for review and approval to the Contracting Officer at least 90 calendar days before scheduled factory test date.

2.8.1.1 Test Procedure

Indicate in each test plan the factory acceptance test procedures. Procedures shall be structured to test all modes of operation to confirm that the controls are performing in accordance with the intended sequence of control.

Controllers shall be verified to be properly calibrated and have the proper set point to provide stable control of their respective equipment.

Include in each test plan a detailed step-by-step procedure for testing automatic controls provided by the manufacturer.

2.8.1.2 Performance Variables

Each test plan shall list performance variables that are required to be measured or tested as part of the field test. Include in the performance variables list the performance indicated on the equipment schedules on the contract design drawings.

Manufacturer must provide with each test procedure a description of acceptable performance results that shall be verified. Manufacturer shall identify the acceptable limits or tolerances within which each tested performance variable shall acceptably operate.

2.8.1.3 Test Configuration

Plans shall indicate that tests are to be performed for a minimum of four continuous hours. If test period is interrupted, the four hour test period shall be started over. Each test plan shall be job specific and shall address the particular CRACs and particular conditions which exist with this contract. Generic or general preprinted test procedures are not acceptable.

2.8.1.4 Tested Variables

Plans shall provide for air side testing which includes verification of the airflow, total static pressure; fan drive motor KW, amperage and RPM; and fan RPM. Provide entering air temperatures equal to those indicated on the CRAC schedules.

2.8.1.5 Thermal Testing

Plans shall provide thermal testing with temperatures equal to those indicated on the CRAC schedules. Thermal testing shall verify CRAC heating, sensible cooling, total cooling, and humidifying performance scheduled on the contract drawings.

2.8.1.6 Specialized Components

Include procedures for field testing and field adjusting specialized components, such as hot gas bypass control valves, or pressure valves.

2.8.1.7 Factory Test For Sound Pressure Level

Determine the A-weighted sound pressure level for the indoor portion of each of the CRACs.

Each unit shall be mounted on a floor duplicating of the installation configuration indicated on the contract drawings. Unit shall be located at least 5 feet 6 inches from test room walls. No other equipment shall be operating in the test room during sound level testing of subject unit. Background sound levels shall be at least 10 dB below lowest sound pressure level measured on subject unit. Testing shall be conducted by using an ANSI Type 1 or 2 sound level meter located 3.3 feet from the unit under test and 3.3 feet above raised floor. Measure and record A-weighted sound pressure level on all four sides of unit.

2.8.1.8 Factory Tests Reporting Forms

Each test plan shall include the required test reporting forms to be completed by the Contractor's testing representatives. Submit factory test reports, referencing each tested CRAC serial number, and receive approval before delivery of CRAC to the project site.

2.8.2 Factory Tests

Conduct the factory testing in compliance with the Contracting Officer approved manufacturer's field test plan, and in accordance with additional field testing requirements specified herein. Record the required data using the test reporting forms approved of the approved field test plan. Conduct the test for each CRAC for the continuous test period in the approved test plan. A CRAC shutdown before the continuous test period is completed shall result in the test period being started again and run for the required duration.

2.8.3 Deficiency Resolution

The test requirements shall be acceptably met; deficiencies identified during the tests shall be corrected in compliance with the manufacturer's recommendations and corrections tested as specified in the paragraph FACTORY TEST PLANS.

2.8.4 Factory Test Reports

Use the test reporting forms approved in the factory test plan. Final test report forms shall be typed including data entries and remarks. Completed test report forms for each CRAC shall be reviewed, approved, and signed by the Manufacturer's test director.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 CRAC System

Installation of each CRAC system including equipment, materials, installation, workmanship, fabrication, assembly, erection, examination, inspection, and testing, must be in accordance with ASME B31.1, ASME B31.5, NFPA 70, as modified and supplemented by the requirements of this section and the CRAC manufacturer's written installation instructions.

Install all work so that parts requiring periodic inspection, operation, maintenance, and repair are readily accessible. Install concealed valves, expansion joints, controls, dampers, and equipment requiring access, in locations freely accessible through access doors.

3.1.2 Installation Instructions

Provide a manufacturer's installation manual for each type of CRAC.

3.1.3 Operation and Maintenance Data

Submit Computer Room Air Conditioner Operation and Maintenance Data in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.

3.1.4 Connections to Existing Systems

Notify the Contracting Officer in writing at least 15 calendar days prior to the date the connections are required. Obtain approval before interrupting service. Provide materials required to make connections into existing systems and perform excavating, backfilling, compacting, and other incidental labor as required. Provide labor and tools for making actual connections to existing systems.

3.2 FIELD QUALITY CONTROL

Upon completion and before final acceptance of work, test each CRAC subsystem in service to demonstrate compliance with the contract requirements, including field testing specified below. Adjust controls and balance systems prior to final acceptance of completed systems. Test controls through every cycle of operation. Test safety controls to demonstrate performance of required function. Correct defects in work provided and repeat tests. Provide steam, fuel, water, electricity, instruments, connecting devices, and personnel for tests. Flush and clean piping before placing in operation. Clean equipment, piping, strainers, and ducts. Prior to commencement of field testing, remove all filters and provide new filters. Perform and document that proper Indoor Air Quality During Construction procedures have been followed; this includes providing documentation showing that after construction ends, and prior to occupancy, new filters were provided.

3.3 FIELD TESTING

Provide field test plans, field test schedules, field tests and field test reports on each of the CRACs. Field test each CRAC for Contracting Officer acceptance in accordance with the CRAC manufacturer's approved field test plan.

3.3.1 Manufacturer's Field Test Plans

Submit field test plans developed by the manufacturer for each CRAC; submit the field test plans along with the factory test plans specified herein before. Field test plans developed by the installing Contractor, or the equipment sales agency furnishing the CRAC, will not be acceptable.

The Contracting Officer will review and approve the field test plan for each of the listed CRACs prior to commencement of field testing of the equipment. The approved field test plans must be followed for the field tests of the CRAC and test reporting.

3.3.1.1 Coordinated Testing

Indicate in each field test plan when work required by this section requires coordination with test work required by other specification sections. Provide test procedures for the simultaneous or integrated testing of: CRAC controls which interlock and interface with controls factory prewired; and external controls for the CRAC provided under Section 23 09 00 INSTRUMENTATION AND CONTROL FOR HVAC.

3.3.1.2 Prerequisite Testing

Each CRAC for which performance testing is dependent upon the completion of the work covered by Section 23 05 93 TESTING, ADJUSTING AND BALANCING FOR HVAC must have that work completed as a prerequisite to testing work

under this section. Indicate in each field test plan when such prerequisite work is required.

3.3.1.3 Test Procedure

Indicate in each field test plan the CRAC manufacturer's published start-up, and field acceptance test procedures. Include in each test plan a detailed step-by-step procedure for testing automatic controls provided by the manufacturer.

Procedures must be structured to test the controls through all modes of control to confirm that the controls are performing with the intended sequence of control.

Controllers must be verified to be properly calibrated and have the proper set point to provide stable control of their respective equipment.

3.3.1.4 Performance Variables

Each test plan must list performance variables that are required to be measured or tested as part of the field test.

Include, in the listed performance variables, requirements indicated on the CRAC schedules on the design drawings. Manufacturer must provide, with each test procedure, a description of acceptable results that have been verified.

Manufacturer must identify the acceptable limits or tolerances within which each tested performance variable must acceptably operate.

3.3.1.5 Test Configuration

Plans must indicate that tests are to be performed for a minimum of four continuous hours. If test period is interrupted, the four hour test period must be started over. Each test plan must be job specific and must address the particular CRACs and particular conditions which exist with this contract. Generic or general preprinted test procedures are not acceptable.

3.3.1.6 Tested Variables

Plans must provide for air side testing which includes verification of the airflow, total static pressure; fan drive motor KW, amperage and RPM; and fan RPM. Provide entering air temperatures equal to those indicated on the CRAC schedules.

3.3.1.7 Thermal Testing

Plans must provide thermal testing with temperatures equal to those indicated on the CRAC schedules. Thermal testing must verify CRAC heating, sensible cooling, total cooling, and humidifying performance scheduled on the contract drawings.

3.3.1.8 Specialized Components

Include procedures for field testing and field adjusting specialized components, such as hot gas bypass control valves, or pressure valves.

3.3.1.9 Field Test Reporting Forms

Each test plan must include the required test reporting forms to be completed by the Contractor's testing representatives.

3.3.2 Field Test Schedule

Notify the Contracting Officer in writing at least 30 calendar days prior to the testing. Within 30 calendar days after acceptable completion of testing, submit each test report for the review and approval of the Contracting Officer.

3.3.3 Manufacturer's Test Representative

Provide a factory trained field test representative authorized by the CRAC manufacturer to oversee the complete execution of the field testing. This test representative must also review, approve, and sign the completed field test report. Signatures must be accompanied by the person's name typed.

Submit credentials of the manufacturer's field test representative proposed, including current telephone number, to the Contracting Officer for review and approval. Submit these credentials with the written advance notice of the field tests.

3.3.4 Field Tests

Conduct the field testing in compliance with the Contracting Officer approved manufacturer's field test plan, and in accordance with additional field testing requirements specified herein. Record the required data using the test reporting forms approved of the approved field test plan. Conduct the test for each CRAC for a continuous 24-hour test period. A CRAC shutdown before the continuous 24-hour test period is completed must result in the 24-hour test period being started again and run for the required duration.

3.3.5 Deficiency Resolution

The test requirements must be acceptably met; deficiencies identified during the tests must be corrected in compliance with the manufacturer's recommendations. Corrections must be tested again in compliance with the requirements specified in the paragraph FIELD TEST PLANS.

3.3.6 Field Test Reports

Use the test reporting forms approved in the field test plan. Final test report forms must be typed, including data entries and remarks. Completed test report forms for each CRAC must be reviewed, approved, and signed by the Contractor's test director and the QC manager.

3.4 INSTRUCTION TO GOVERNMENT PERSONNEL

Provide the services of competent instructors to give full instruction to the designated Government personnel in the adjustment, operation, and maintenance, including pertinent safety requirements, of the specified equipment or system. Instructors must be thoroughly familiar with all parts of the installation and must be trained in operating theory as well as practical operation and maintenance work.

Instruction must be given during the first regular work week after the equipment or system has been accepted and turned over to the Government for regular operation. Provide 4 hours of training for each type of CRAC specified.

-- End of Section --

SECTION 23 82 19.00 40

FAN COIL UNITS
05/17

PART 1 GENERAL

Section 23 30 00 HVAC AIR DISTRIBUTION applies to work specified in this section.

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ACOUSTICAL SOCIETY OF AMERICA (ASA)

ASA S12.23	(1989; R 2016) Method for the Designation of Sound Power Emitted by Machinery and Equipment

AIR-CONDITIONING, HEATING AND REFRIGERATION INSTITUTE (AHRI)

AHRI 440	(2008) Performance Rating of Room Fan-Coils

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION (ISO)

ISO 1940-1	(2003; R 2008) Mechanical Vibration - Balance Quality Requirements for Rotors in a Constant (Rigid) State - Part 1: Specification and Verification of Balance Tolerances

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA MG 1	(2018) Motors and Generators

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 90A	(2021) Standard for the Installation of Air Conditioning and Ventilating Systems

U.S. DEPARTMENT OF DEFENSE (DOD)

MIL-STD-810	(2019; Rev H) Environmental Engineering Considerations and Laboratory Tests

UNDERWRITERS LABORATORIES (UL)

UL 1995	(2015) UL Standard for Safety Heating and Cooling Equipment
UL Bld Mat Dir	(updated continuously online) Building Materials Directory

1.2 SUBMITTALS

Government approval is required for submittals with a "G" classification. Submittals not having a "G" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Fabrication Drawings; G

Installation Drawings; G

SD-03 Product Data

Equipment and Performance Data; G

Coils; G

Casing; G

Enclosure; G

Motors; G

Fan; G

Drain Pans; G

Filters; G

Controls; G

Vibration Isolation; G

SD-04 Samples

Manufacturer's Standard Color Chart; G

SD-07 Certificates

List of Product Installations

Certificates of Conformance

SD-10 Operation and Maintenance Data

Operation and Maintenance Manuals

SD-11 Closeout Submittals

Warranty

1.3 QUALITY ASSURANCE

Submit a list of product installations for fan coil units showing a minimum of five installed units, similar to those proposed for use, that have been in successful service for a minimum of 5 years. Include the name of the purchaser, address of installation, name of service

organization, and date of installation.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Provide a base unit complete with galvanized casing, a water coil assembly with an auxiliary water or steam heating-coil, valve and piping package, drain pans, air filter, fan motor, and motor control. Ensure that the sound power level, as measured in decibels at 10 to the minus 12 watt at the fan operating speed selected to meet the specified capacity, does not exceed the following values at the midfrequency of each octave band:

OCTAVE BANDS					
	3rd	4th	5th	6th	7th
Frequency (hertz)	250	500	1,000	2,000	4,000
Power Level (decibels)	60	55	53	50	48

Obtain values for sound power level for these units in accordance with the test procedures specified in ASA S12.23. Sound power values apply to units provided with factory-fabricated cabinet enclosures and standard grilles. Values obtained for the standard cabinet models are acceptable for concealed models without the need for separate tests, provided there is no variation between models as to the coil configuration, blowers, motor speeds, and relative arrangement of parts. Fasten each unit securely to the building structure. Ensure that the capacity of the units is as indicated. Ensure that room fan coil units are certified as complying with AHRI 440 and meet the requirements of UL 1995.

2.2 COMPONENTS

Provide a list of material and equipment including the manufacturer's style or catalog numbers, specification and drawing reference numbers, and warranty information.

Submit fabrication drawings for fan coil units including the fabrication and assembly details performed in the factory.

Submit equipment and performance data for fan coil units including information on the service life, system functional flows, safety features, and mechanical automated details. Also submit curves indicating that the equipment response and performance characteristics, including vibration isolation have been tested and certified. Submit certificates of conformance for the following:

a. Enclosure

b. Casing

c. Fan

d. Coils

e. Drain Pans

f. Filters

g. Motors

h. Controls

Submit product data for vibration isolation components.

Submit the manufacturer's standard color chart, indicating the manufacturer's standard color selections and finishes for fan coil units.

2.2.1 Enclosure

Construct an enclosure of 18-gage or heavier steel, properly reinforced and braced. Ensure that the front panel of the enclosure is removable. Ensure that discharge louvers are four-way adjustable and are designed to properly distribute air throughout the conditioned space. Ensure that ferrous surfaces are galvanized or treated with a rust-inhibiting finish. Ensure that exposed enclosure corners and edges are rounded. Ensure that discharge louvers are mounted in a top panel that can be removed to allow for coil cleaning. Ensure that access doors are hinged and provided for all piping and control compartments. Ensure that the finish is in the manufacturer's standard color, as selected by the Contracting Officer.

2.2.2 Casing

Ensure that the interior of the casing is acoustically and thermally insulated with insulation that is not less than 1/2-inch thick, that conforms to NFPA 90A, and that is fastened with waterproof and fire-resistant adhesive.

2.2.3 Fan

Provide a centrifugal fan made of galvanized steel or aluminum. In lieu of metal, fabricate or mold the wheels and scrolls from reinforced nonmetallic compounds certified to have passed the low-temperature, high-temperature, temperature-shock, and sand and dust tests for ground equipment, as outlined in MIL-STD-810. Ensure that the fan passes tests without showing characteristics that indicate deformation, cracking, corrosion, or loss of balance. Ensure that surfaces are smooth, that assemblies are accessible for maintenance, and that disassembly and reassembly are done by mechanical fastening devices, not adhesives. After the fan is assembled in the unit, ensure that the fan was dynamically and statically balanced to ISO 1940-1 standards at the factory.

2.2.4 Coils

Ensure that the water coil was constructed with not less than 1/2-inch outside diameter (OD) seamless copper tubing with copper or aluminum plate fins mechanically bonded or soldered to the tubes. Ensure that the coil construction includes at least 5/8-inch OD female solder connectors, an accessory piping package with terminal connections for control valves, and manual air vents on returns. Make provisions for coil removal.

2.2.5 Drain Pans

Size and locate drain pans to collect condensed water dripping from any item within the unit enclosure. Do not construct drain pans of stainless steel that is lighter than 20-gage and thermally insulated to prevent

condensation. Coat the thermal insulation with a waterproofing compound. Provide a copper drain connection in the drain pan that is no less than 3/4-inch National Pipe Thread (NPT) or 5/8-inch OD. Ensure that the drain pan slopes not less than 1/8-inch per foot to the drain.

2.2.6 Filters

For each unit, provide filters that are glass fiber throwaway or permanent and washable, with a 1 inch nominal thickness, in conformance with UL Bld Mat Dir. Ensure that filters can be removed without tools.

2.2.7 Motors

Provide permanent split-capacitor motors that are direct connected, two-bearing, and built-in overload protection, and that conform to NEMA MG 1. Mount motors on a resilient base. Furnish motors with three built-in speeds and with four insulated leads (common, high, medium, and low) that terminate in a control-junction box.

When specified, provide a solid-state variable speed controller capable of not less than 50 percent speed reduction in lieu of step speed control.

2.2.8 Controls

Provide a unit with factory-installed control valves furnished by the automatic temperature-control manufacturer.

Ensure that the motor speed-control switch provides for speed selection, has an off position, and is mounted for convenient use from an access door.

PART 3 EXECUTION

3.1 INSTALLATION

Install equipment in accordance with the manufacturer's recommendations. Set the dampers in a fixed position to provide outside air in the quantity scheduled.

Submit installation drawings for fan coil systems in accordance with referenced standards in this section.

Contain thermal and acoustical insulation within a double-walled enclosure or seal the insulation with a moistureproof coating impervious.

Install the controls in a unit-mounted control panel. Provide remote-mounted controllers where indicated.

3.2 FIELD QUALITY CONTROL

Hydrostatically the test coils at 250 pounds per square inch (psi) or under water at 250 psi air pressure. Ensure that the coils are suitable for 200 psi working pressure.

3.3 CLOSEOUT ACTIVITIES

Submit six copies of the operation and maintenance manuals at least 30 calendar days before the fan coil units are tested. Update and resubmit data for final approval no later than 30 calendar days before contract completion.

Submit the manufacturer's standard warranty to the Contracting Officer.

-- End of Section --

SECTION 26 20 00

INTERIOR DISTRIBUTION SYSTEM
08/19, CHG 3: 11/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI C12.1	(2014; Errata 2016) Electric Meters - Code for Electricity Metering

ASTM INTERNATIONAL (ASTM)

ASTM B1	(2013) Standard Specification for Hard-Drawn Copper Wire
ASTM B8	(2011; R 2017) Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
ASTM D709	(2017) Standard Specification for Laminated Thermosetting Materials

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 81	(2012) Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System
IEEE 100	(2000; Archived) The Authoritative Dictionary of IEEE Standards Terms
IEEE C2	(2017; Errata 1-2 2017; INT 1 2017) National Electrical Safety Code

INTERNATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)

NETA ATS	(2021) Standard for Acceptance Testing Specifications for Electrical Power Equipment and Systems

NATIONAL ELECTRICAL CONTRACTORS ASSOCIATION (NECA)

NECA NEIS 1	(2015) Standard for Good Workmanship in Electrical Construction

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI C12.7	(2014) Requirements for Watthour Meter Sockets

ANSI C80.1	(2020) American National Standard for Electrical Rigid Steel Conduit (ERSC)
ANSI C80.3	(2020) American National Standard for Electrical Metallic Tubing (EMT)
ANSI C80.5	(2020) American National Standard for Electrical Rigid Aluminum Conduit
NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)
NEMA ICS 1	(2000; R 2015) Standard for Industrial Control and Systems: General Requirements
NEMA ICS 2	(2000; R 2020) Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 V
NEMA ICS 4	(2015) Application Guideline for Terminal Blocks
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures
NEMA KS 1	(2013) Enclosed and Miscellaneous Distribution Equipment Switches (600 V Maximum)
NEMA MG 1	(2018) Motors and Generators
NEMA MG 10	(2017) Energy Management Guide for Selection and Use of Fixed Frequency Medium AC Squirrel-Cage Polyphase Induction Motors
NEMA MG 11	(1977; R 2012) Energy Management Guide for Selection and Use of Single Phase Motors
NEMA RN 1	(2005; R 2013) Polyvinyl-Chloride (PVC) Externally Coated Galvanized Rigid Steel Conduit and Intermediate Metal Conduit
NEMA ST 20	(2014) Dry-Type Transformers for General Applications
NEMA TC 2	(2020) Standard for Electrical Polyvinyl Chloride (PVC) Conduit
NEMA TC 3	(2021) Polyvinyl Chloride (PVC) Fittings for Use With Rigid PVC Conduit and Tubing
NEMA VE 1	(2017) Metal Cable Tray Systems
NEMA WD 1	(1999; R 2020) Standard for General Color Requirements for Wiring Devices
NEMA WD 6	(2016) Wiring Devices Dimensions Specifications

NEMA Z535.4	(2011; R 2017) Product Safety Signs and Labels

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code
NFPA 70E	(2021) Standard for Electrical Safety in the Workplace
NFPA 780	(2020) Standard for the Installation of Lightning Protection Systems

TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA)

TIA-568.1	(2020e) Commercial Building Telecommunications Infrastructure Standard
TIA-569	(2019e) Telecommunications Pathways and Spaces
TIA-607	(2019d) Generic Telecommunications Bonding and Grounding (Earthing) for Customer Premises

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

10 CFR 431	Energy Efficiency Program for Certain Commercial and Industrial Equipment
29 CFR 1910.147	The Control of Hazardous Energy (Lock Out/Tag Out)
29 CFR 1910.303	Electrical, General

UNDERWRITERS LABORATORIES (UL)

UL 1	(2005; Reprint Jan 2020) UL Standard for Safety Flexible Metal Conduit
UL 6	(2007; Reprint Sep 2019) UL Standard for Safety Electrical Rigid Metal Conduit-Steel
UL 6A	(2008; Reprint Mar 2021) UL Standard for Safety Electrical Rigid Metal Conduit - Aluminum, Red Brass, and Stainless Steel
UL 20	(2018; Reprint Jan 2021) UL Standard for Safety General-Use Snap Switches
UL 44	(2018; Reprint May 2021) UL Standard for Safety Thermoset-Insulated Wires and Cables
UL 50	(2015) UL Standard for Safety Enclosures for Electrical Equipment, Non-Environmental Considerations

UL 67	(2018; Reprint Jul 2020) UL Standard for Safety Panelboards
UL 83	(2017; Reprint Mar 2020) UL Standard for Safety Thermoplastic-Insulated Wires and Cables
UL 360	(2013; Reprint Aug 2021) UL Standard for Safety Liquid-Tight Flexible Metal Conduit
UL 467	(2013; Reprint Jun 2017) UL Standard for Safety Grounding and Bonding Equipment
UL 486A-486B	(2018; Reprint May 2021) UL Standard for Safety Wire Connectors
UL 486C	(2018; Reprint May 2021) UL Standard for Safety Splicing Wire Connectors
UL 489	(2016; Rev 2019) UL Standard for Safety Molded-Case Circuit Breakers, Molded-Case Switches and Circuit-Breaker Enclosures
UL 498	(2017; Reprint Sep 2021) UL Standard for Safety Attachment Plugs and Receptacles
UL 506	(2017) UL Standard for Safety Specialty Transformers
UL 508	(2018; Reprint Jul 2021) UL Standard for Safety Industrial Control Equipment
UL 510	(2020) UL Standard for Safety Polyvinyl Chloride, Polyethylene and Rubber Insulating Tape
UL 514A	(2013; Reprint Aug 2017) UL Standard for Safety Metallic Outlet Boxes
UL 514B	(2012; Reprint May 2020) Conduit, Tubing and Cable Fittings
UL 514C	(2014; Reprint Feb 2020) UL Standard for Safety Nonmetallic Outlet Boxes, Flush-Device Boxes, and Covers
UL 651	(2011; Reprint Mar 2020) UL Standard for Safety Schedule 40, 80, Type EB and A Rigid PVC Conduit and Fittings
UL 674	(2011; Reprint Dec 2020) UL Standard for Safety Electric Motors and Generators for Use in Hazardous (Classified) Locations
UL 797	(2007; Reprint Mar 2021) UL Standard for Safety Electrical Metallic Tubing -- Steel
UL 869A	(2006; Reprint Jun 2020) Reference

	Standard for Service Equipment
UL 943	(2016; Reprint Feb 2018) UL Standard for Safety Ground-Fault Circuit-Interrupters
UL 984	(1996; Reprint Sep 2005) Hermetic Refrigerant Motor-Compressors
UL 1063	(2017) UL Standard for Safety Machine-Tool Wires and Cables
UL 1203	(2013; Reprint Mar 2021) UL Standard for Safety Explosion-Proof and Dust-Ignition-Proof Electrical Equipment for Use in Hazardous (Classified) Locations
UL 1242	(2006; Reprint Aug 2020) Standard for Electrical Intermediate Metal Conduit -- Steel
UL 1283	(2017) UL Standard for Safety Electromagnetic Interference Filters
UL 1449	(2021) UL Standard for Safety Surge Protective Devices
UL 1660	(2019) Liquid-Tight Flexible Nonmetallic Conduit
UL 1699	(2017; Reprint Nov 2020) UL Standard for Safety Arc-Fault Circuit-Interrupters
UL 2043	(2013) Fire Test for Heat and Visible Smoke Release for Discrete Products and Their Accessories Installed in Air-Handling Spaces

1.2 DEFINITIONS

Unless otherwise specified or indicated, electrical and electronics terms used in these specifications, and on the drawings, are as defined in IEEE 100.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Panelboards; G

Transformers; G

Cable Trays; G

SD-03 Product Data

Receptacles; G

Circuit Breakers; G

Switches; G

Transformers; G

Motor Controllers; G

Manual Motor Starters; G

Metering; G

CATV Outlets; G

Secondary Bonding Busbar; G

Surge Protective Devices; G

Cable Trays; G

SD-05 Design Data

Cable Tray Design; G

SD-06 Test Reports

600-volt Wiring Test; G

Grounding System Test; G

Transformer Tests; G

Ground-fault Receptacle Test; G

SD-10 Operation and Maintenance Data

Electrical Systems, Data Package 5; G

1.4 QUALITY ASSURANCE

1.4.1 Fuses

Submit coordination data as specified in paragraph, FUSES of this section.

1.4.2 Regulatory Requirements

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word, "must" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction," or words of similar meaning, to mean the Contracting Officer. Provide equipment, materials, installation, and workmanship in accordance with NFPA 70 unless more stringent requirements are specified or indicated. NECA NEIS 1 shall be considered the minimum standard for workmanship.

1.4.3 Standard Products

Provide materials and equipment that are products of manufacturers regularly engaged in the production of such products which are of equal material, design and workmanship and:

a. Have been in satisfactory commercial or industrial use for 2 years prior to bid opening including applications of equipment and materials under similar circumstances and of similar size.

b. Have been on sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the 2-year period.

c. Where two or more items of the same class of equipment are required, provide products of a single manufacturer; however, the component parts of the item need not be the products of the same manufacturer unless stated in this section.

1.4.3.1 Alternative Qualifications

Products having less than a 2-year field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturers' factory or laboratory tests, is furnished.

1.4.3.2 Material and Equipment Manufacturing Date

Products manufactured more than 3 years prior to date of delivery to site are not acceptable.

1.5 MAINTENANCE

1.5.1 Electrical Systems

Submit operation and maintenance data in accordance with Section 01 78 23, OPERATION AND MAINTENANCE DATA and as specified herein. Submit operation and maintenance manuals for electrical systems that provide basic data relating to the design, operation, and maintenance of the electrical distribution system for the building. Include the following:

a. Single line diagram of the "as-built" building electrical system.

b. Schematic diagram of electrical control system (other than HVAC, covered elsewhere).

c. Manufacturers' operating and maintenance manuals on active electrical equipment.

1.6 WARRANTY

Provide equipment items supported by service organizations that are reasonably convenient to the equipment installation in order to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

PART 2 PRODUCTS

2.1 MATERIALS AND EQUIPMENT

As a minimum, meet requirements of UL, where UL standards are established for those items, and requirements of NFPA 70 for all materials, equipment, and devices.

2.2 CONDUIT AND FITTINGS

Conform to the following:

2.2.1 Rigid Metallic Conduit

2.2.1.1 Rigid, Threaded Zinc-Coated Steel Conduit

ANSI C80.1, UL 6.

2.2.1.2 Rigid Aluminum Conduit

ANSI C80.5, UL 6A.

2.2.2 Rigid Nonmetallic Conduit

PVC Type EPC-40, and EPC-80 in accordance with NEMA TC 2,UL 651.

2.2.3 Intermediate Metal Conduit (IMC)

UL 1242, zinc-coated steel only.

2.2.4 Electrical, Zinc-Coated Steel Metallic Tubing (EMT)

UL 797, ANSI C80.3.

2.2.5 Plastic-Coated Rigid Steel and IMC Conduit

NEMA RN 1, Type 40(40 mils thick).

2.2.6 Flexible Metal Conduit

UL 1, limited to 6 feet.

2.2.6.1 Liquid-Tight Flexible Metal Conduit, Steel

UL 360, limited to 6 feet.

2.2.7 Fittings for Metal Conduit, EMT, and Flexible Metal Conduit

UL 514B. Ferrous fittings: cadmium- or zinc-coated in accordance with UL 514B.

2.2.7.1 Fittings for Rigid Metal Conduit and IMC

Threaded-type. Split couplings unacceptable.

2.2.7.2 Fittings for EMT

Steel compression type.

2.2.8 Fittings for Rigid Nonmetallic Conduit

NEMA TC 3 for PVC, and UL 514B.

2.2.9 Liquid-Tight Flexible Nonmetallic Conduit

UL 1660.

2.3 CABLE TRAYS

NEMA VE 1. Provide the following:

Submit cable tray design, including dimensional layout, load and seismic calculations, and fill calculations. Dimensional layout includes cable spacings, cable tray splices, and supports. Fill calculations include an index of cables for each section and identification of the lb/ft, cross sectional area, and insulation voltage class for each cable.

a. Cable trays: form a wireway system, with a nominal depth as indicated.

b. Cable trays: constructed of aluminum.

c. Cable trays: include splice and end plates, dropouts, and miscellaneous hardware.

d. Edges, fittings, and hardware: finished free from burrs and sharp edges.

e. Fittings: ensure not less than load-carrying ability of straight tray sections and have manufacturer's minimum standard radius.

f. Radius of bends: as indicated.

2.3.1 Basket-Type Cable Trays

Provide size as indicated with maximum wire mesh spacing of 2 by 4 inch.

2.3.2 Trough-Type Cable Trays

Provide size as indicated.

2.3.3 Ladder-Type Cable Trays

Provide size as indicated with maximum rung spacing of 12 inches.

2.3.4 Channel-Type Cable Trays

Provide size as indicated. Provide trays with one-piece construction having slots spaced not more than 4 1/2 inches on centers.

2.3.5 Solid Bottom-Type Cable Trays

Provide size as indicated.

2.4 OPEN TELECOMMUNICATIONS CABLE SUPPORT

2.4.1 Open Top Cable Supports

Provide open top cable supports in accordance with UL 2043. Provide steel

open top cable supports as indicated.

2.4.2 Closed Ring Cable Supports

Provide closed ring cable supports in accordance with UL 2043. Provide closed ring cable supports as indicated.

2.5 OUTLET BOXES AND COVERS

UL 514A, cadmium- or zinc-coated, if ferrous metal. UL 514C, if nonmetallic.

2.5.1 Floor Outlet Boxes

Provide the following:

a. Boxes: adjustable and concrete tight.

b. Each outlet: consisting of nonmetallic or cast-metal body with threaded openings, for conduits, adjustable, brass flange ring, and cover plate with 3/41 inch threaded plug.

c. Telecommunications outlets: consisting of flush, aluminum or stainless steel housing with a receptacle as specified and one inch bushed side opening 3/4 inch top opening.

d. Receptacle outlets: consisting of flush aluminum or stainless steel housing with duplex-type receptacle as specified herein.

e. Provide gaskets where necessary to ensure watertight installation.

2.5.2 Outlet Boxes for Telecommunications System

Provide the following:

a. Standard type 4 inches square by 2 1/8 inches deep.

c. Depth of boxes: large enough to allow manufacturers' recommended conductor bend radii.

d. Outlet boxes for fiber optic telecommunication outlets: include a minimum 3/8 inch deep single or two gang plaster ring as shown and installed using a minimum one inch conduit system.

2.6 CABINETS, JUNCTION BOXES, AND PULL BOXES

UL 50; volume greater than 100 cubic inches, NEMA Type 1 enclosure; sheet steel, hot-dip, zinc-coated. Where exposed to wet, damp, or corrosive environments, NEMA Type as indicated.

2.7 WIRES AND CABLES

Provide wires and cables in accordance applicable requirements of NFPA 70 and UL for type of insulation, jacket, and conductor specified or indicated. Do not use wires and cables manufactured more than 12 months prior to date of delivery to site.

2.7.1 Conductors

Provide the following:

a. Conductor sizes and capacities shown are based on copper, unless indicated otherwise.

b. Conductors No. 8 AWG and larger diameter: stranded.

c. Conductors No. 10 AWG and smaller diameter: solid.

d. Conductors for remote control, alarm, and signal circuits, classes 1, 2, and 3: stranded unless specifically indicated otherwise.

e. All conductors: copper.

2.7.1.1 Minimum Conductor Sizes

Provide minimum conductor size in accordance with the following:

a. Branch circuits: No. 12 AWG.

b. Class 1 remote-control and signal circuits: No. 14 AWG.

c. Class 2 low-energy, remote-control and signal circuits: No. 16 AWG.

d. Class 3 low-energy, remote-control, alarm and signal circuits: No. 22 AWG.

e. Digital low voltage lighting control (DLVLC) system at 24 Volts or less: Category 5 UTP cables in EMT conduit.

2.7.2 Color Coding

Provide color coding for service, feeder, branch, control, and signaling circuit conductors.

2.7.2.1 Ground and Neutral Conductors

Provide color coding of ground and neutral conductors as follows:

a. Grounding conductors: Green.

b. Neutral conductors: White.

c. Exception, where neutrals of more than one system are installed in same raceway or box, other neutrals color coding: white with a different colored (not green) stripe for each.

2.7.2.2 Ungrounded Conductors

Provide color coding of ungrounded conductors in different voltage systems as follows:

a. 208/120 volt, three-phase

(1) Phase A - black

(2) Phase B - red

(3) Phase C - blue

b. 480/277 volt, three-phase

(1) Phase A - brown

(2) Phase B - orange

(3) Phase C - yellow

c. 120/240 volt, single phase: Black and red

2.7.3 Insulation

Unless specified or indicated otherwise or required by NFPA 70, provide power and lighting wires rated for 600-volts, Type THWN/THHN conforming to UL 83, except that grounding wire may be type TW conforming to UL 83; remote-control and signal circuits: Type TW or TF, conforming to UL 83. Where equipment or devices require 90-degree Centigrade (C) conductors, provide only conductors with 90-degree C insulation or better.

2.7.4 Bonding Conductors

ASTM B1, solid bare copper wire for sizes No. 8 AWG and smaller diameter; ASTM B8, Class B, stranded bare copper wire for sizes No. 6 AWG and larger diameter.

2.8 SPLICES AND TERMINATION COMPONENTS

UL 486A-486B for wire connectors and UL 510 for insulating tapes. Connectors for No. 10 AWG and smaller diameter wires: insulated, pressure-type in accordance with UL 486A-486B or UL 486C (twist-on splicing connector). Provide solderless terminal lugs on stranded conductors.

2.9 DEVICE PLATES

Provide the following:

a. UL listed, one-piece device plates for outlets to suit the devices installed.

b. For metal outlet boxes, plates on unfinished walls: zinc-coated sheet steel or cast metal having round or beveled edges.

c. For nonmetallic boxes and fittings, other suitable plates may be provided.

d. Plates on finished walls: nylon or lexan, minimum 0.03 inch wall thickness and same color as receptacle or toggle switch with which they are mounted.

f. Screws: machine-type with countersunk heads in color to match finish of plate.

g. Sectional type device plates are not be permitted.

h. Plates installed in wet locations: gasketed and UL listed for "wet

locations."

2.10 SWITCHES

2.10.1 Toggle Switches

NEMA WD 1, UL 20, single pole, double pole, three-way, and four-way, totally enclosed with bodies of thermoplastic or thermoset plastic and mounting strap with grounding screw. Include the following:

a. Handles: white thermoplastic.

b. Wiring terminals: screw-type, side-wired.

c. Contacts: silver-cadmium and contact arm - one-piece copper alloy.

d. Switches: rated quiet-type ac only, 120/277 volts, with current rating and number of poles indicated.

2.10.2 Switch with Red Pilot Handle

NEMA WD 1. Provide the following:

a. Pilot lights that are integrally constructed as a part of the switch's handle.

b. Pilot light color: red and illuminate whenever the switch is closed or "on".

c. Pilot lighted switch: rated 20 amps and 120 volts or 277 volts as indicated.

d. The circuit's neutral conductor to each switch with a pilot light.

2.10.3 Breakers Used as Switches

For 120- and 277-Volt fluorescent fixtures, mark breakers "SWD" in accordance with UL 489.

2.10.4 Disconnect Switches

NEMA KS 1. Provide heavy duty-type switches where indicated, where switches are rated higher than 240 volts, and for double-throw switches. Utilize Class R fuseholders and fuses for fused switches, unless indicated otherwise. Provide horsepower rated for switches serving as the motor-disconnect means. Provide switches in NEMA , enclosure as indicated per NEMA ICS 6.

2.11 RECEPTACLES

Provide the following:

a. UL 498, general purpose specification grade, grounding-type. Residential grade receptacles are not acceptable.

b. Ratings and configurations: as indicated.

c. Bodies: white as per NEMA WD 1.

d. Face and body: thermoplastic supported on a metal mounting strap.

e. Dimensional requirements: per NEMA WD 6.

f. Screw-type, side-wired wiring terminals or of the solderless pressure type having suitable conductor-release arrangement.

g. Grounding pole connected to mounting strap.

h. The receptacle: containing triple-wipe power contacts and double or triple-wipe ground contacts.

i. Controlled receptacles: as required per ASHRAE 90.1. Provide marking for controlled receptacle per NFPA 70.

2.11.1 Split Duplex Receptacles

Provide separate terminals for each ungrounded pole. One receptacle must be controlled separately.

2.11.2 Weatherproof Receptacles

Provide receptacles, UL listed for use in "wet locations" with integral GFCI protection. Include cast metal box with gasketed, hinged, lockable and weatherproof while-in-use, polycarbonate, UV resistant/stabilized cover plate.

2.11.3 Ground-Fault Circuit Interrupter Receptacles

UL 943, duplex type for mounting in standard outlet box. Provide device capable of detecting current leak when the current to ground is 6 milliamperes or higher, and tripping per requirements of UL 943 for Class A ground-fault circuit interrupter devices. Provide screw-type, side-wired wiring terminals or pre-wired (pigtail) leads.

2.11.4 Tamper-Resistant Receptacles

Provide duplex receptacle with mechanical sliding shutters that prevent the insertion of small objects into its contact slots.

2.12 PANELBOARDS

Provide panelboards in accordance with the following:

a. UL 67 and UL 50.

b. Panelboards for use as service disconnecting: additionally conform to UL 869A.

c. Panelboards: circuit breaker-equipped.

d. Designed such that individual breakers can be removed without disturbing adjacent units or without loosening or removing supplemental insulation supplied as means of obtaining clearances as required by UL.

e. Where "space only" is indicated, make provisions for future installation of breaker sized as indicated.

f. Directories: indicate load served by each circuit of panelboard.

g. Directories: indicate source of service (e.g. upstream panel, switchboard, motor control center) to panelboard.

h. Type directories and mount in holder behind transparent protective covering.

i. Panelboard nameplates: provided in accordance with paragraph FIELD FABRICATED NAMEPLATES.

2.12.1 Enclosure

Provide panelboard enclosure in accordance with the following:

a. UL 50.

b. Cabinets mounted outdoors or flush-mounted: hot-dipped galvanized after fabrication .

c. Cabinets: painted in accordance with paragraph PAINTING.

d. Outdoor cabinets: NEMA 3R raintight with a removable steel plate 1/4 inch thick in the bottom for field drilling for conduit connections.

e. Front edges of cabinets: form-flanged or fitted with structural shapes welded or riveted to the sheet steel, for supporting the panelboard front.

f. All cabinets: fabricated such that no part of any surface on the finished cabinet deviates from a true plane by more than 1/8 inch.

g. Holes: provided in the back of indoor surface-mounted cabinets, with outside spacers and inside stiffeners, for mounting the cabinets with a 1/2 inch clear space between the back of the cabinet and the wall surface.

h. Flush doors: mounted on hinges that expose only the hinge roll to view when the door is closed.

i. Each door: fitted with a combined catch and lock latch.

j. Keys: two provided with each lock, with all locks keyed alike.

k. Finished-head cap screws: provided for mounting the panelboard fronts on the cabinets.

2.12.2 Panelboard Buses

Support bus bars on bases independent of circuit breakers. Design main buses and back pans so that breakers may be changed without machining, drilling, or tapping. Provide isolated neutral bus in each panel for connection of circuit neutral conductors. Provide separate ground bus identified as equipment grounding bus per UL 67 for connecting grounding conductors; bond to steel cabinet.

2.12.3 Circuit Breakers

UL 489, thermal magnetic-type having a minimum short-circuit current

rating equal to the short-circuit current rating of the panelboard in which the circuit breaker will be mounted. Breaker terminals: UL listed as suitable for type of conductor provided. Series rated circuit breakers and plug-in circuit breakers are unacceptable.

2.12.3.1 Multipole Breakers

Provide common trip-type with single operating handle. Design breaker such that overload in one pole automatically causes all poles to open. Maintain phase sequence throughout each panel so that any three adjacent breaker poles are connected to Phases A, B, and C, respectively.

2.12.3.2 Circuit Breaker With Ground-Fault Circuit Interrupter

UL 943 and NFPA 70. Provide with auto-monitoring (self-test) and lockout features, "push-to-test" button, visible indication of tripped condition, and ability to detect and trip when current imbalance is 6 milliamperes or higher per requirements of UL 943 for Class A ground-fault circuit interrupter devices.

2.13 TRANSFORMERS

Provide transformers in accordance with the following:

a. NEMA ST 20, general purpose, dry-type, self-cooled, ventilated.

b. Provide transformers in NEMA 1 enclosure.

c. Taps for transformers 15 kVA and larger: Two 2.5 percent taps Full Capacity Above Nominal (FCAN) and four 2.5 percent taps Full Capacity Below Nominal (FCBN) .

d. Transformer insulation system:

(1) 220 degrees C insulation system for transformers 15 kVA and greater, with temperature rise not exceeding 115 degrees C under full-rated load in maximum ambient of 40 degrees C.

(2) 180 degrees C insulation for transformers rated 10 kVA and less, with temperature rise not exceeding 80 degrees C under full-rated load in maximum ambient of 40 degrees C.

f. Transformer of 115 degrees C temperature rise: capable of carrying continuously 115 percent of nameplate kVA without exceeding insulation rating.

h. Transformers: quiet type with maximum sound level at least 3 decibels less than NEMA standard level for transformer ratings indicated.

2.13.1 Specified Transformer Efficiency

Transformers, indicated and specified with: 480V primary, 80 degrees C or 115 degrees C temperature rise, kVA ratings of 37.5 to 100 for single phase or 30 to 500 for three phase, energy efficient type. The transformer is not acceptable if the calculated transformer efficiency is less than the efficiency indicated in 10 CFR 431, Subpart K.

2.14 MOTORS

Provide motors in accordance with the following:

a. NEMA MG 1 FIRE PUMPS.

b. Hermetic-type sealed motor compressors: Also comply with UL 984.

c. Provide the size in terms of HP, or kVA, or full-load current, or a combination of these characteristics, and other characteristics, of each motor as indicated or specified.

d. Determine specific motor characteristics to ensure provision of correctly sized starters and overload heaters.

e. Rate motors for operation on 208-volt, 3-phase circuits with a terminal voltage rating of 200 volts, and those for operation on 480-volt, 3-phase circuits with a terminal voltage rating of 460 volts.

f. Use motors designed to operate at full capacity with voltage variation of plus or minus 10 percent of motor voltage rating.

g. Unless otherwise indicated, use continuous duty type motors if rated 1 HP and above.

h. Where fuse protection is specifically recommended by the equipment manufacturer, provide fused switches in lieu of non-fused switches indicated.

i. Use Inverter-Rated motors designed to operate with adjustable speed drive (ASD).

2.14.1 High Efficiency Single-Phase Motors

Single-phase fractional-horsepower alternating-current motors: high efficiency types are not acceptable. In exception, for special purpose motors and motor-driven equipment with a minimum seasonal or overall efficiency rating, such as a SEER rating, provide equipment with motor to meet the overall system rating indicated.

2.14.2 Premium Efficiency Polyphase and Single-Phase Motors

Select polyphase and continuous-duty single phase motors based on high efficiency characteristics relative to typical characteristics and applications as listed in NEMA MG 10 and NEMA MG 11. In addition, continuous rated, polyphase squirrel-cage medium induction motors must meet the requirements for premium efficiency electric motors in accordance with NEMA MG 1, including the NEMA full load efficiency ratings. In exception, for motor-driven equipment with a minimum seasonal or overall efficiency rating, such as a SEER rating, provide equipment with motor to meet the overall system rating indicated.

2.14.3 Motor Sizes

Provide size for duty to be performed, not exceeding the full-load nameplate current rating when driven equipment is operated at specified capacity under most severe conditions likely to be encountered. When motor size provided differs from size indicated or specified, make

adjustments to wiring, disconnect devices, and branch circuit protection to accommodate equipment actually provided. Provide controllers for motors rated 1-hp and above with electronic phase-voltage monitors designed to protect motors from phase-loss, undervoltage, and overvoltage. Provide protection for motors from immediate restart by a time adjustable restart relay.

2.14.4 Wiring and Conduit

Provide internal wiring for components of packaged equipment as an integral part of the equipment. Provide power wiring and conduit for field-installed equipment using adjustable speed drive (ASD) manufacturer required wiring type and length , and motor control equipment forming part of motor control centers or switchgear assemblies, the conduit and wiring connecting such centers, assemblies, or other power sources to equipment as specified herein. Power wiring and conduit: conform to the requirements specified herein. Control wiring: provided under, and conform to, the requirements of the section specifying the associated equipment.

2.15 MOTOR CONTROLLERS

Provide motor controllers in accordance with the following:

a. UL 508, NEMA ICS 1, and NEMA ICS 2.

b. Provide controllers with thermal overload protection in each phase, and one spare normally open auxiliary contact, and one spare normally closed auxiliary contact.

c. Provide controllers for motors rated 1-hp and above with electronic phase-voltage monitors designed to protect motors from phase-loss, undervoltage, and overvoltage.

d. Provide protection for motors from immediate restart by a time adjustable restart relay.

e. When used with pressure, float, or similar automatic-type or maintained-contact switch, provide a hand/off/automatic selector switch with the controller.

f. Connections to selector switch: wired such that only normal automatic regulatory control devices are bypassed when switch is in "hand" position.

g. Safety control devices, such as low and high pressure cutouts, high temperature cutouts, and motor overload protective devices: connected in motor control circuit in "hand" and "automatic" positions.

h. Control circuit connections to hand/off/automatic selector switch or to more than one automatic regulatory control device: made in accordance with indicated or manufacturer's approved wiring diagram.

i. Provide selector switch with the means for locking in any position.

j. Provide a disconnecting means, capable of being locked in the open position, for the motor that is located in sight from the motor location and the driven machinery location. As an alternative, provide a motor controller disconnect, capable of being locked in the

open position, to serve as the disconnecting means for the motor if it is in sight from the motor location and the driven machinery location.

k. Overload protective devices: provide adequate protection to motor windings; be thermal inverse-time-limit type; and include manual reset-type pushbutton on outside of motor controller case.

l. Cover of combination motor controller and manual switch or circuit breaker: interlocked with operating handle of switch or circuit breaker so that cover cannot be opened unless handle of switch or circuit breaker is in "off" position.

m. Minimum short circuit withstand rating of combination motor controller: 22,000 rms symmetrical amperes.

n. Provide controllers in hazardous locations with classifications as indicated.

2.15.1 Control Wiring

Provide control wiring in accordance with the following:

a. All control wire: stranded tinned copper switchboard wire with 600-volt flame-retardant insulation Type SIS meeting UL 44, or Type MTW meeting UL 1063, and passing the VW-1 flame tests included in those standards.

b. Hinge wire: Class K stranding.

c. Current transformer secondary leads: not smaller than No. 10 AWG.

d. Control wire minimum size: No. 14 AWG.

e. Power wiring for 480-volt circuits and below: the same type as control wiring with No. 12 AWG minimum size.

f. Provide wiring and terminal arrangement on the terminal blocks to permit the individual conductors of each external cable to be terminated on adjacent terminal points.

2.15.2 Control Circuit Terminal Blocks

Provide control circuit terminal blocks in accordance with the following:

a. NEMA ICS 4.

b. Control circuit terminal blocks for control wiring: molded or fabricated type with barriers, rated not less than 600 volts.

c. Provide terminals with removable binding, fillister or washer head screw type, or of the stud type with contact and locking nuts.

d. Terminals: not less than No. 10 in size with sufficient length and space for connecting at least two indented terminals for 10 AWG conductors to each terminal.

e. Terminal arrangement: subject to the approval of the Contracting Officer with not less than four spare terminals or 10 percent, whichever is greater, provided on each block or group of blocks.

f. Modular, pull apart, terminal blocks are acceptable provided they are of the channel or rail-mounted type.

g. Submit data showing that any proposed alternate will accommodate the specified number of wires, are of adequate current-carrying capacity, and are constructed to assure positive contact between current-carrying parts.

2.15.2.1 Types of Terminal Blocks

a. Short-Circuiting Type: Short-circuiting type terminal blocks: furnished for all current transformer secondary leads with provision for shorting together all leads from each current transformer without first opening any circuit. Terminal blocks: comply with the requirements of paragraph CONTROL CIRCUIT TERMINAL BLOCKS above.

b. Load Type: Load terminal blocks rated not less than 600 volts and of adequate capacity: provided for the conductors for NEMA Size 3 and smaller motor controllers and for other power circuits, except those for feeder tap units. Provide terminals of either the stud type with contact nuts and locking nuts or of the removable screw type, having length and space for at least two indented terminals of the size required on the conductors to be terminated. For conductors rated more than 50 amperes, provide screws with hexagonal heads. Conducting parts between connected terminals must have adequate contact surface and cross-section to operate without overheating. Provide each connected terminal with the circuit designation or wire number placed on or near the terminal in permanent contrasting color.

2.15.3 Control Circuits

Control circuits: maximum voltage of 120 volts derived from control transformer in same enclosure. Transformers: conform to UL 506, as applicable. Transformers, other than transformers in bridge circuits: provide primaries wound for voltage available and secondaries wound for correct control circuit voltage. Size transformers so that 80 percent of rated capacity equals connected load. Provide disconnect switch on primary side.. Provide one fused secondary lead with the other lead grounded.

2.15.4 Enclosures for Motor Controllers

NEMA ICS 6.

2.15.5 Multiple-Speed Motor Controllers and Reversible Motor Controllers

Across-the-line-type, electrically and mechanically interlocked. Multiple-speed controllers: include compelling relays and multiple-button, station-type with pilot lights for each speed.

2.15.6 Pushbutton Stations

Provide with "start/stop" momentary contacts having one normally open and one normally closed set of contacts, and red lights to indicate when motor is running. Stations: heavy duty, oil-tight design.

2.15.7 Pilot and Indicating Lights

Provide LED cluster lamps.

2.16 MANUAL MOTOR STARTERS (MOTOR RATED SWITCHES)

Single pole designed for surface mounting with overload protection and pilot lights.

2.16.1 Pilot Lights

Provide yoke-mounted, seven element LED cluster light module. Color: green.

2.17 LOCKOUT REQUIREMENTS

Provide circuit breakers, disconnecting means, and other devices that are electrical energy-isolating capable of being locked out for machines and other equipment to prevent unexpected startup or release of stored energy in accordance with 29 CFR 1910.147, NFPA 70E and 29 CFR 1910.303. Comply with requirements of Division 23, "Mechanical" for mechanical isolation of machines and other equipment.

2.18 TELECOMMUNICATIONS SYSTEM

Provide system of telecommunications wire-supporting structures (pathway), including: outlet boxes, conduits with pull wires wireways, cable trays, and other accessories for telecommunications outlets and pathway in accordance with TIA-569 and as specified herein. Additional telecommunications requirements are specified in Section 27 10 00 BUILDING TELECOMMUNICATIONS CABLING SYSTEM.

2.19 GROUNDING AND BONDING EQUIPMENT

2.19.1 Ground Rods

UL 467. Ground rods: cone pointed solid copper, with minimum diameter of 3/4 inch and minimum length 10 feet. Sectional type rods may be used for rods 20 feet or longer.

2.19.2 Ground Bus

Copper ground bus: provided in the electrical equipment rooms as indicated.

2.20 HAZARDOUS LOCATIONS

Electrical materials, equipment, and devices for installation in hazardous locations, as defined by NFPA 70: specifically approved by Underwriters' Laboratories, Inc., or Factory Mutual for particular "Class," "Division," and "Group" of hazardous locations involved. Boundaries and classifications of hazardous locations: as indicated. Equipment in hazardous locations: comply with UL 1203 for electrical equipment and industrial controls and UL 674 for motors.

2.21 MANUFACTURER'S NAMEPLATE

Provide on each item of equipment a nameplate bearing the manufacturer's name, address, model number, and serial number securely affixed in a conspicuous place; the nameplate of the distributing agent will not be

acceptable.

2.22 FIELD FABRICATED NAMEPLATES

Provide field fabricated nameplates in accordance with the following:

a. ASTM D709.

b. Provide laminated plastic nameplates for each equipment enclosure, relay, switch, and device; as specified or as indicated on the drawings.

c. Each nameplate inscription: identify the function and, when applicable, the position.

d. Nameplates: melamine plastic, 0.125 inch thick, white with black center core.

f. Surface: matte finish. Corners: square. Accurately align lettering and engrave into the core.

g. Minimum size of nameplates: one by 2.5 inches.

h. Lettering size and style: a minimum of 0.25 inch high normal block style.

2.23 WARNING SIGNS

Provide warning signs for flash protection in accordance with NFPA 70E and NEMA Z535.4 for switchboards, panelboards, industrial control panels, and motor control centers that are in other than dwelling occupancies and are likely to require examination, adjustment, servicing, or maintenance while energized. Provide field installed signs to warn qualified persons of potential electric arc flash hazards when warning signs are not provided by the manufacturer. Provide marking that is clearly visible to qualified persons before examination, adjustment, servicing, or maintenance of the equipment.

2.24 FIRESTOPPING MATERIALS

Provide firestopping around electrical penetrations in accordance with Section 07 84 00 FIRESTOPPING.

2.25 METERING

ANSI C12.1. Provide a self-contained, socket-mounted, electronic programmable outdoor watthour meter. Meter: either programmed at the factory or programmed in the field. Turn field programming device over to the Contracting Officer at completion of project. Coordinate meter to system requirements. Coordinate meter, system components, and meter location to be compatible with the Activity's central advanced metering system.

a. Design: Provide watthour meter designed for use on a single-phase, three-wire, 480/240 volt system. Include necessary KYZ pulse initiation hardware for Energy Monitoring and Control System (EMCS).

b. Class: 200; Form: 2S, accuracy: plus or minus 1.0 percent; Finish: Class II.

c. Cover: Polycarbonate and lockable to prevent tampering and unauthorized removal.

d. Kilowatt-hour Register: five digit electronic programmable type.

e. Demand Register:

(1) Provide solid state.

(2) Meter reading multiplier: Indicate multiplier on the meter face.

(3) Demand interval length: programmed for 15 minutes with rolling demand up to six subintervals per interval.

f. Socket: ANSI C12.7. Provide NEMA Type 3R, box-mounted socket, ringless, having manual circuit-closing bypass and having jaws compatible with requirements of the meter. Provide manufacturers standard enclosure color unless otherwise indicated.

2.26 SURGE PROTECTIVE DEVICES

Provide parallel type surge protective devices (SPD) which comply with UL 1449 at the service entrance , panelboards . Provide surge protectors in a NEMA 1 enclosure per NEMA ICS 6. SPD must have the same short-circuit current rating as the protected equipment and must not be installed at a point of system where the available fault current is in excess of that rating. Use Type 1 or Type 2 SPD and connect on the load side of a dedicated circuit breaker. Submit performance and characteristic curves.

Provide the following modes of protection:

FOR SINGLE PHASE AND THREE PHASE WYE CONNECTED SYSTEMS-
Phase to phase (L-L)
Each phase to neutral (L-N)
Neutral to ground (N-G)
Phase to ground (L-G)

SPDs at the service entrance: provide with a minimum surge current rating of 80,000 amperes for L-L mode minimum and 40,000 amperes for other modes (L-N, L-G, and N-G) and downstream SPDs rated 40,000 amperes for L-L mode minimum and 20,000 amperes for other modes (L-N, L-G, and N-G).

Provide SPDs. Maximum L-N, L-G, and N-G Voltage Protection Rating:

700V for 208Y/120V, three phase system
1,200V for 480Y/277V, three phase system

Maximum L-L Voltage Protection Rating:

1,200V for 208Y/120V, three phase system
2,000V for 480Y/277V, three phase system

The minimum MCOV (Maximum Continuous Operating Voltage) rating for L-N and L-G modes of operation: 120 percent of nominal voltage for 240 volts and below; 115 percent of nominal voltage above 240 volts to 480 volts.

Provide EMI/RFI filtering per UL 1283 for each mode with the capability to attenuate high frequency noise. Minimum attenuation: 20db.

2.27 FACTORY APPLIED FINISH

Provide factory-applied finish on electrical equipment in accordance with the following:

a. NEMA 250 corrosion-resistance test and the additional requirements as specified herein.

b. Interior and exterior steel surfaces of equipment enclosures: thoroughly cleaned followed by a rust-inhibitive phosphatizing or equivalent treatment prior to painting.

c. Exterior surfaces: free from holes, seams, dents, weld marks, loose scale or other imperfections.

d. Interior surfaces: receive not less than one coat of corrosion-resisting paint in accordance with the manufacturer's standard practice.

e. Exterior surfaces: primed, filled where necessary, and given not less than two coats baked enamel with semigloss finish.

f. Equipment located indoors: ANSI Light Gray, and equipment located outdoors: ANSI Light Gray.

g. Provide manufacturer's coatings for touch-up work and as specified in paragraph FIELD APPLIED PAINTING.

2.28 SOURCE QUALITY CONTROL

2.28.1 Transformer Factory Tests

Submittal: include routine NEMA ST 20 transformer test results on each transformer and also provide the results of NEMA "design" and "prototype" tests that were made on transformers electrically and mechanically equal to those specified.

2.29 COORDINATED POWER SYSTEM PROTECTION

Prepare analyses as specified in Section 26 28 01.00 10 COORDINATED POWER SYSTEM PROTECTION.

PART 3 EXECUTION

3.1 INSTALLATION

Electrical installations, including weatherproof and hazardous locations and ducts, plenums and other air-handling spaces: conform to requirements of NFPA 70 and IEEE C2 and to requirements specified herein.

3.1.1 Underground Service

Underground service conductors and associated conduit: continuous from service entrance equipment to outdoor power system connection.

3.1.2 Service Entrance Identification

Service entrance disconnect devices, switches, and enclosures: labeled and identified as such.

3.1.2.1 Labels

Wherever work results in service entrance disconnect devices in more than one enclosure, as permitted by NFPA 70, label each enclosure, new and existing, as one of several enclosures containing service entrance disconnect devices. Label, at minimum: indicate number of service disconnect devices housed by enclosure and indicate total number of enclosures that contain service disconnect devices. Provide laminated plastic labels conforming to paragraph FIELD FABRICATED NAMEPLATES. Use lettering of at least 0.25 inch in height, and engrave on black-on-white matte finish. Service entrance disconnect devices in more than one enclosure: provided only as permitted by NFPA 70.

3.1.3 Wiring Methods

Provide insulated conductors installed in rigid steel conduit, IMC, rigid nonmetallic conduit, or EMT, except where specifically indicated or specified otherwise or required by NFPA 70 to be installed otherwise. Grounding conductor: separate from electrical system neutral conductor. Provide insulated green equipment grounding conductor for circuit(s) installed in conduit and raceways. Shared neutral, or multi-wire branch circuits, are not permitted with arc-fault circuit interrupters. Minimum conduit size: 1/2 inch in diameter for low voltage lighting and power circuits. Vertical distribution in multiple story buildings: made with metal conduit in fire-rated shafts, with metal conduit extending through shafts for minimum distance of 6 inches. Firestop conduit which penetrates fire-rated walls, fire-rated partitions, or fire-rated floors in accordance with Section 07 84 00 FIRESTOPPING.

3.1.3.1 Pull Wire

Install pull wires in empty conduits. Pull wire: plastic having minimum 200-pound force tensile strength. Leave minimum 36 inches of slack at each end of pull wire.

3.1.4 Conduit Installation

Unless indicated otherwise, conceal conduit under floor slabs and within finished walls, ceilings, and floors. Keep conduit minimum 6 inches away from parallel runs of flues and steam or hot water pipes. Install conduit parallel with or at right angles to ceilings, walls, and structural members where located above accessible ceilings and where conduit will be visible after completion of project.

3.1.4.1 Restrictions Applicable to Aluminum Conduit

a. Do not install underground or encase in concrete or masonry.

b. Do not use brass or bronze fittings.

c. Do not use when the enclosed conductors must be shielded from the effects of High-altitude Electromagnetic Pulse (HEMP).

3.1.4.2 Restrictions Applicable to EMT

a. Do not install underground.

b. Do not encase in concrete, mortar, grout, or other cementitious materials.

c. Do not use in areas subject to physical damage including but not limited to equipment rooms where moving or replacing equipment could physically damage the EMT.

d. Do not use in hazardous areas.

e. Do not use outdoors.

f. Do not use in fire pump rooms.

g. Do not use when the enclosed conductors must be shielded from the effects of High-altitude Electromagnetic Pulse (HEMP).

3.1.4.3 Restrictions Applicable to Nonmetallic Conduit

a. PVC Schedule 40.

(1) Do not use where subject to physical damage, including but not limited to, mechanical equipment rooms, electrical equipment rooms, fire pump rooms, and where restrictions are applying to both PVC Schedule 40 and PVC Schedule 80.

(2) Do not use above grade, except where allowed in this section for rising through floor slab or indicated otherwise.

b. PVC Schedule 40 and Schedule 80.

(1) Do not use where subject to physical damage, including but not limited to, hospitals, power plant, missile magazines, and other such areas.

(2) Do not use in hazardous (classified) areas.

(3) Do not use in penetrating fire-rated walls or partitions, or fire-rated floors.

-

3.1.4.4 Restrictions Applicable to Flexible Conduit

Use only as specified in paragraph FLEXIBLE CONNECTIONS. Do not use when the enclosed conductors must be shielded from the effects of High-altitude Electromagnetic Pulse (HEMP).

3.1.4.5 Underground Conduit

Plastic-coated rigid steel; plastic-coated steel IMC; PVC, Type EPC-40; or fiberglass. Convert nonmetallic conduit, other than PVC Schedule 40 or 80, to plastic-coated rigid, or IMC, steel conduit before rising through floor slab. Plastic coating: extend minimum 6 inches above floor.

3.1.4.6 Conduit for Circuits Rated Greater Than 600 Volts

Rigid metal conduit or IMC only.

3.1.4.7 Conduit Installed Under Floor Slabs

Conduit run under floor slab: located a minimum of 12 inches below the vapor barrier. Seal around conduits at penetrations thru vapor barrier. Use NECA NEIS 1 Table 2a (Minimum Raceway Spacing) to determine under floor slab conduit spacing unless greater spacing is required elsewhere in this section.

3.1.4.8 Conduit Through Floor Slabs

Where conduits rise through floor slabs, do not allow curved portion of bends to be visible above finished slab. Where conduit rises through slab-on grade, seal all electrical penetrations to address radon mitigation and prevent infiltration of air, insects, and vermin.

3.1.4.9 Conduit Installed in Concrete Floor Slabs

PVC, Type EPC-40, unless indicated otherwise. Locate so as not to adversely affect structural strength of slabs. Install conduit within middle one-third of concrete slab. Do not stack conduits. Space conduits horizontally not closer than three diameters, except at cabinet locations. Curved portions of bends must not be visible above finish slab. Increase slab thickness as necessary to provide minimum one inch cover over conduit. Where embedded conduits cross building expansion joints, provide suitable watertight expansion/deflection fittings and bonding jumpers. Expansion/deflection fittings must allow horizontal and vertical movement of raceway. Conduit larger than one inch trade size: installed parallel with or at right angles to main reinforcement; when at right angles to reinforcement, install conduit close to one of supports of slab. Where nonmetallic conduit is used, convert raceway to plastic coated rigid steel or plastic coated steel IMC before rising above floor, unless specifically indicated.

3.1.4.10 Stub-Ups

Provide conduits stubbed up through concrete floor for connection to free-standing equipment with adjustable top or coupling threaded inside for plugs, set flush with finished floor. Extend conductors to equipment in rigid steel conduit, except that flexible metal conduit may be used 6 inches above floor. Where no equipment connections are made, install screwdriver-operated threaded flush plugs in conduit end.

3.1.4.11 Conduit Support

Support conduit by pipe straps, wall brackets, threaded rod conduit hangers, or ceiling trapeze. Plastic cable ties are not acceptable. Fasten by wood screws to wood; by toggle bolts on hollow masonry units; by concrete inserts or expansion bolts on concrete or brick; and by machine screws, welded threaded studs, or spring-tension clamps on steel work. Threaded C-clamps may be used on rigid steel conduit only. Do not weld conduits or pipe straps to steel structures. Do not exceed one-fourth proof test load for load applied to fasteners. Provide vibration resistant and shock-resistant fasteners attached to concrete ceiling. Do not cut main reinforcing bars for any holes cut to depth of more than 1 1/2 inches in reinforced concrete beams or to depth of more than 3/4 inch in concrete joints. Fill unused holes. In partitions of light steel construction, use sheet metal screws. In suspended-ceiling construction, run conduit above ceiling. Do not support conduit by ceiling support

system. Conduit and box systems: supported independently of both (a) tie wires supporting ceiling grid system, and (b) ceiling grid system into which ceiling panels are placed. Do not share supporting means between electrical raceways and mechanical piping or ducts. Coordinate installation with above-ceiling mechanical systems to assure maximum accessibility to all systems. Spring-steel fasteners may be used for lighting branch circuit conduit supports in suspended ceilings in dry locations. Where conduit crosses building expansion joints, provide suitable expansion fitting that maintains conduit electrical continuity by bonding jumpers or other means. For conduits greater than 2 1/2 inches inside diameter, provide supports to resist forces of 0.5 times the equipment weight in any direction and 1.5 times the equipment weight in the downward direction.

3.1.4.12 Directional Changes in Conduit Runs

Make changes in direction of runs with symmetrical bends or cast-metal fittings. Make field-made bends and offsets with hickey or conduit-bending machine. Do not install crushed or deformed conduits. Avoid trapped conduits. Prevent plaster, dirt, or trash from lodging in conduits, boxes, fittings, and equipment during construction. Free clogged conduits of obstructions.

3.1.4.13 Locknuts and Bushings

Fasten conduits to sheet metal boxes and cabinets with two locknuts where required by NFPA 70, where insulated bushings are used, and where bushings cannot be brought into firm contact with the box; otherwise, use at least minimum single locknut and bushing. Provide locknuts with sharp edges for digging into wall of metal enclosures. Install bushings on ends of conduits, and provide insulating type where required by NFPA 70.

3.1.4.14 Flexible Connections

Provide flexible steel conduit between 3 and 6 feet in length for recessed and semirecessed lighting fixtures; for equipment subject to vibration, noise transmission, or movement; and for motors. Install flexible conduit to allow 20 percent slack. Minimum flexible steel conduit size: 1/2 inch diameter. Provide liquid tight flexible nonmetallic conduit in wet and damp locations for equipment subject to vibration, noise transmission, movement or motors. Provide separate ground conductor across flexible connections. Plastic cable ties are not acceptable as a support method.

3.1.4.15 Telecommunications and Signal System Pathway

Install telecommunications pathway in accordance with TIA-569.

a. Horizontal Pathway: Telecommunications pathways from the work area to the telecommunications room: installed and cabling length requirements in accordance with TIA-568.1. Size conduits, and cable trays in accordance with TIA-569 and as indicated.

b. Backbone Pathway: Telecommunication pathways from the telecommunications entrance facility to telecommunications rooms, and, telecommunications equipment rooms (backbone cabling): installed in accordance with TIA-569. Size conduits, and cable trays for telecommunications risers in accordance with TIA-569 and as indicated.

3.1.4.16 Community Antenna Television (CATV) System Conduits

Install a system of CATV wire-supporting structures (pathway), including: outlet boxes, conduits with pull wires cable trays, and other accessories for CATV outlets and pathway in accordance with TIA-569. Provide distribution system with star topology with empty conduit and pullwire from each outlet to the headend equipment location.

3.1.5 Cable Tray Installation

Install and ground in accordance with NFPA 70. In addition, install and ground telecommunications cable tray in accordance with TIA-569, and TIA-607. Install cable trays parallel with or at right angles to ceilings, walls, and structural members. Cable tray and tray supports must not partially nor completely obstruct access to the room. Support in accordance with manufacturer recommendations but at not more than 6 foot intervals as indicated. Coat contact surfaces of aluminum connections with an antioxidant compound prior to assembly. Adjacent cable tray sections: bonded together by connector plates of an identical type as the cable tray sections. For grounding of cable tray system provide No. 2 AWG bare copper wire throughout cable tray system, and bond to each section, except use No. 1/0 aluminum wire if cable tray is aluminum. Terminate cable trays 10 inches from both sides of smoke and fire partitions. Install conductors run through smoke and fire partitions in 4 inch rigid steel conduits with grounding bushings, extending 12 inches beyond each side of partitions. Seal conduit on both ends to maintain smoke and fire ratings of partitions. Firestop penetrations in accordance with Section 07 84 00, FIRESTOPPING. Provide supports to resist forces of 0.5 times the equipment weight in any direction and 1.5 times the equipment weight in the downward direction.

Install cable trays parallel with or at right angles to ceilings, walls, and structural members. Cable tray and tray supports must not partially nor completely obstruct access to the room. Support as indicated at maximum 6 foot intervals. In addition, install and ground telecommunications cable tray in accordance with TIA-569, and TIA-607 Coat contact surfaces of aluminum connections with an antioxidant compound prior to assembly. Ensure edges, fittings, and hardware are finished free from burrs and sharp edges. Provide No. 2 AWG bare copper wire throughout cable tray system, and bond to each section. Use No. 1/0 aluminum wire if cable tray is aluminum. Install conductors that run though smoke and fire partitions in 4 inch rigid steel conduits with grounding bushing, extending 12 inches beyond each side of partitions. Seal conduit on both ends to maintain smoke and fire ratings of partitions. Provide supports to resist forces of 0.5 times the equipment weight in any direction and 1.5 times the equipment weight in the downward direction.

3.1.6 Boxes, Outlets, and Supports

Provide boxes in wiring and raceway systems wherever required for pulling of wires, making connections, and mounting of devices or fixtures. Boxes for metallic raceways: cast-metal, hub-type when located in wet locations, when surface mounted on outside of exterior surfaces, when surface mounted on interior walls exposed up to 7 feet above floors and walkways, and when specifically indicated. Boxes in other locations: sheet steel, except that aluminum boxes may be used with aluminum conduit, and nonmetallic boxes may be used with nonmetallic conduit system. Provide each box with volume required by NFPA 70 for number of conductors enclosed in box. Boxes for mounting lighting fixtures: minimum 4 inches

square, or octagonal, except that smaller boxes may be installed as required by fixture configurations, as approved. Boxes for use in masonry-block or tile walls: square-cornered, tile-type, or standard boxes having square-cornered, tile-type covers. Provide gaskets for cast-metal boxes installed in wet locations and boxes installed flush with outside of exterior surfaces. Provide separate boxes for flush or recessed fixtures when required by fixture terminal operating temperature; provide readily removable fixtures for access to boxes unless ceiling access panels are provided. Support boxes and pendants for surface-mounted fixtures on suspended ceilings independently of ceiling supports. Fasten boxes and supports with wood screws on wood, with bolts and expansion shields on concrete or brick, with toggle bolts on hollow masonry units, and with machine screws or welded studs on steel. In open overhead spaces, cast boxes threaded to raceways need not be separately supported except where used for fixture support; support sheet metal boxes directly from building structure or by bar hangers. Where bar hangers are used, attach bar to raceways on opposite sides of box, and support raceway with approved-type fastener maximum 24 inches from box. When penetrating reinforced concrete members, avoid cutting reinforcing steel.

3.1.6.1 Boxes

Boxes for use with raceway systems: minimum 1 1/2 inches deep, except where shallower boxes required by structural conditions are approved. Boxes for other than lighting fixture outlets: minimum 4 inches square, except that 4 by 2 inch boxes may be used where only one raceway enters outlet. Telecommunications outlets: a minimum of 4 inches square by 2 1/8 inches deep. Mount outlet boxes flush in finished walls.

3.1.6.2 Pull Boxes

Construct of at least minimum size required by NFPA 70 of code-gauge aluminum or galvanized sheet steel, except where cast-metal boxes are required in locations specified herein. Provide boxes with screw-fastened covers. Where several feeders pass through common pull box, tag feeders to indicate clearly electrical characteristics, circuit number, and panel designation.

3.1.7 Mounting Heights

Mount panelboards, circuit breakers, motor controller and disconnecting switches so height of center of grip of the operating handle of the switch or circuit breaker at its highest position is maximum 79 inches above floor or working platform or as allowed in Section 404.8 per NFPA 70. Mount lighting switches 48 inches above finished floor. Mount receptacles 18 inches above finished floor, unless otherwise indicated.

3.1.8 Conductor Identification

Provide conductor identification within each enclosure where tap, splice, or termination is made. For conductors No. 6 AWG and smaller diameter, provide color coding by factory-applied, color-impregnated insulation. For conductors No. 4 AWG and larger diameter, provide color coding by plastic-coated, self-sticking markers; colored nylon cable ties and plates; or heat shrink-type sleeves. Identify control circuit terminations in accordance with.

3.1.9 Splices

Make splices in accessible locations. Make splices in conductors No. 10 AWG and smaller diameter with insulated, pressure-type connector. Make splices in conductors No. 8 AWG and larger diameter with solderless connector, and cover with insulation material equivalent to conductor insulation.

3.1.10 Covers and Device Plates

Install with edges in continuous contact with finished wall surfaces without use of mats or similar devices. Plaster fillings are not permitted. Install plates with alignment tolerance of 1/16 inch. Use of sectional-type device plates are not permitted. Provide gasket for plates installed in wet locations.

3.1.11 Electrical Penetrations

Seal openings around electrical penetrations through fire resistance-rated walls, partitions, floors, or ceilings in accordance with Section 07 84 00 FIRESTOPPING.

3.1.12 Grounding and Bonding

Provide in accordance with NFPA 70 and NFPA 780. Ground exposed, non-current-carrying metallic parts of electrical equipment, metallic raceway systems, grounding conductor in metallic and nonmetallic raceways, telecommunications system grounds, and neutral conductor of wiring systems. In addition to the requirements specified herein, provide telecommunications grounding in accordance with TIA-607. Where ground fault protection is employed, ensure that connection of ground and neutral does not interfere with correct operation of fault protection.

3.1.12.1 Ground Rods

Provide ground rods and measure the resistance to ground using the fall-of-potential method described in IEEE 81. Do not exceed 25 ohms under normally dry conditions for the maximum resistance of a driven ground. If this resistance cannot be obtained with a single rod, additional rods, spaced on center. Spacing for additional rods must be a minimum of 10 feet. If the resultant resistance exceeds 25 ohms measured not less than 48 hours after rainfall, notify the Contracting Officer who will decide on the number of ground rods to add.

3.1.12.2 Grounding Connections

Make grounding connections which are buried or otherwise normally inaccessible, excepting specifically those connections for which access for periodic testing is required, by exothermic weld or high compression connector.

a. Make exothermic welds strictly in accordance with the weld manufacturer's written recommendations. Welds which are "puffed up" or which show convex surfaces indicating improper cleaning are not acceptable. Mechanical connectors are not required at exothermic welds.

b. Make high compression connections using a hydraulic or electric compression tool to provide the correct circumferential pressure.

Provide tools and dies as recommended by the manufacturer. Use an embossing die code or other standard method to provide visible indication that a connector has been adequately compressed on the ground wire.

3.1.12.3 Ground Bus

Provide a copper ground bus in the electrical equipment rooms as indicated. Noncurrent-carrying metal parts of electrical equipment: effectively grounded by bonding to the ground bus. Bond the ground bus to both the entrance ground, and to a ground rod or rods as specified above having the upper ends terminating approximately 4 inches above the floor. Make connections and splices of the brazed, welded, bolted, or pressure-connector type, except use pressure connectors or bolted connections for connections to removable equipment.

3.1.12.4 Resistance

Maximum resistance-to-ground of grounding system: do not exceed 5 ohms under dry conditions. Where resistance obtained exceeds 5 ohms, contact Contracting Officer for further instructions.

3.1.12.5 Telecommunications System

Provide telecommunications grounding in accordance with the following:

a. Telecommunications Grounding Busbars: Provide a Primary bonding busbar (PBB) in the telecommunications entrance facility. Install the PBB as close to the electrical service entrance grounding connection as practicable. Provide a Secondary bonding busbar (SBB) in all other telecommunications rooms and telecommunications equipment rooms. Install the SBB as close to the telecommunications room panelboard as practicable, when equipped. Where a panelboard for telecommunications equipment is not installed in the telecommunications room, locate the SBB near the backbone cabling and associated terminations. In addition, locate the SBB to provide for the shortest and straightest routing of the grounding conductors. Where a panelboard for telecommunications equipment is located within the same room or space as a SBB, bond that panelboard's alternating current equipment ground (ACEG) bus (when equipped) or the panelboard enclosure to the SBB. Install Secondary bonding busbars to maintain clearances as required by NFPA 70 and insulated from its support. A minimum of 2 inches separation from the wall is recommended to allow access to the rear of the busbar and adjust the mounting height to accommodate overhead or underfloor cable routing.

b. Telecommunications Bonding Conductors: Provide main telecommunications service equipment ground consisting of separate bonding conductor for telecommunications, between the PBB and readily accessible grounding connection of the electrical service. Grounding and bonding conductors should not be placed in ferrous metallic conduit. If it is necessary to place grounding and bonding conductors in ferrous metallic conduit that exceeds 3 feet in length, bond the conductors to each end of the conduit using a grounding bushing or a No. 6 AWG conductor, minimum. Provide a telecommunications bonding backbone (TBB) that originates at the PBB extends throughout the building using the telecommunications backbone pathways, and connects to the SBBs in all telecommunications rooms and equipment rooms. Install the TBB conductors such that they are protected from physical

and mechanical damage. The TBB conductors should be installed without splices and routed in the shortest possible straight-line path. Make the bonding conductor between a TBB and a SBB continuous. Where splices are necessary, the number of splices should be a minimum. Make the splices accessible and located in telecommunications spaces. Connect joined segments of a TBB using exothermic welding, irreversible compression-type connectors, or equivalent. Install all joints to be adequately supported and protected from damage. Whenever two or more TBBs are used within a multistory building, bond the TBBs together with a grounding equalizer (GE) at the top floor and at a minimum of every third floor in between. Do not connect the TBB and GE to the pathway ground, except at the PBB or the SBB.

c. Telecommunications Grounding Connections: Telecommunications grounding connections to the PBB or SBB: utilize listed compression two-hole lugs, exothermic welding, suitable and equivalent one hole non-twisting lugs, or other irreversible compression type connections. Bond all metallic pathways, cabinets, and racks for telecommunications cabling and interconnecting hardware located within the same room or space as the PBB or SBB to the PBB or SBB respectively. In a metal frame (structural steel) building, where the steel framework is readily accessible within the room; bond each PBB and SBB to the vertical steel metal frame using a minimum No. 6 AWG conductor. Where the metal frame is external to the room and readily accessible, bond the metal frame to the SBB or PBB with a minimum No. 6 AWG conductor. When practicable because of shorter distances and, where horizontal steel members are permanently electrically bonded to vertical column members, the SBB may be bonded to these horizontal members in lieu of the vertical column members. All connectors used for bonding to the metal frame of a building must be listed for the intended purpose.

3.1.13 Equipment Connections

Provide power wiring for the connection of motors and control equipment under this section of the specification. Except as otherwise specifically noted or specified, automatic control wiring, control devices, and protective devices within the control circuitry are not included in this section of the specifications and are provided under the section specifying the associated equipment.

3.1.14 Government-Furnished Equipment

Contractor make connections to Government-furnished equipment to make equipment operate as intended, including providing miscellaneous items such as plugs, receptacles, wire, cable, conduit, flexible conduit, and outlet boxes or fittings.

3.1.15 Repair of Existing Work

Perform repair of existing work, demolition, and modification of existing electrical distribution systems as follows:

3.1.15.1 Workmanship

Lay out work in advance. Exercise care where cutting, channeling, chasing, or drilling of floors, walls, partitions, ceilings, or other surfaces is necessary for proper installation, support, or anchorage of conduit, raceways, or other electrical work. Repair damage to buildings,

piping, and equipment using skilled craftsmen of trades involved.

3.1.15.2 Existing Concealed Wiring to be Removed

Disconnect existing concealed wiring to be removed from its source. Remove conductors; cut conduit flush with floor, underside of floor, and through walls; and seal openings.

3.1.15.3 Removal of Existing Electrical Distribution System

Removal of existing electrical distribution system equipment includes equipment's associated wiring, including conductors, cables, exposed conduit, surface metal raceways, boxes, and fittings, back to equipment's power source as indicated.

3.1.15.4 Continuation of Service

Maintain continuity of existing circuits of equipment to remain. Maintain existing circuits of equipment energized. Restore circuits wiring and power which are to remain but were disturbed during demolition back to original condition.

3.1.16 Watthour Meters

ANSI C12.1.

3.1.17 Surge Protective Devices

Connect the surge protective devices in parallel to the power source, keeping the conductors as short and straight as practically possible. Maximum allowed lead length is 3 feet avoiding 90 degree bends. Do not locate surge protective devices inside a panelboard or switchboard enclosure.

3.2 FIELD FABRICATED NAMEPLATE MOUNTING

Provide number, location, and letter designation of nameplates as indicated. Fasten nameplates to the device with a minimum of two sheet-metal screws or two rivets.

3.3 WARNING SIGN MOUNTING

Provide the number of signs required to be readable from each accessible side. Space the signs in accordance with NFPA 70E.

3.4 FIELD APPLIED PAINTING

Paint electrical equipment as required to match finish of adjacent surfaces or to meet the indicated or specified safety criteria. Where field painting of enclosures for panelboards, load centers or the like is specified to match adjacent surfaces, to correct damage to the manufacturer's factory applied coatings, or to meet the indicated or specified safety criteria, provide manufacturer's recommended coatings and apply in accordance to manufacturer's instructions.

3.5 FIELD QUALITY CONTROL

Furnish test equipment and personnel and submit written copies of test results. Give Contracting Officer 5 working days notice prior to each test.

Where applicable, test electrical equipment in accordance with NETA ATS.

3.5.1 Devices Subject to Manual Operation

Operate each device subject to manual operation at least five times, demonstrating satisfactory operation each time.

3.5.2 600-Volt Wiring Test

Test wiring rated 600 volt and less to verify that no short circuits or accidental grounds exist. Perform insulation resistance tests on wiring No. 6 AWG and larger diameter using instrument which applies voltage of 1,000 volts DC for 600 volt rated wiring and 500 volts DC for 300 volt rated wiring per NETA ATS to provide direct reading of resistance. All existing wiring to be reused must also be tested.

3.5.3 Transformer Tests

Perform the standard, not optional, tests in accordance with the Inspection and Test Procedures for transformers, dry type, air-cooled, 600 volt and below; as specified in NETA ATS. Measure primary and secondary voltages for proper tap settings. Tests need not be performed by a recognized independent testing firm or independent electrical consulting firm.

3.5.4 Ground-Fault Receptacle Test

Test ground-fault receptacles with a "load" (such as a plug in light) to verify that the "line" and "load" leads are not reversed. Press the TEST button and then the RESET button to verify by LED status that the device is a self-test model as specified in UL 943.

3.5.5 Arc-Fault Receptacle Test

Test arc-fault receptacles with a "load" (such as a plug in light) to verify that the "line" and "load" leads are not reversed. Press the TEST button and then the RESET button to verify by LED status that the device is a self-test model as specified in UL 1699.

3.5.6 Grounding System Test

Test grounding system to ensure continuity, and that resistance to ground is not excessive. Test each ground rod for resistance to ground before making connections to rod; tie grounding system together and test for resistance to ground. Make resistance measurements in dry weather, not earlier than 48 hours after rainfall. Submit written results of each test to Contracting Officer, and indicate location of rods as well as resistance and soil conditions at time measurements were made.

3.5.7 Watthour Meter

a. Visual and mechanical inspection

(1) Examine for broken parts, shipping damage, and tightness of connections.

(2) Verify that meter type, scales, and connections are in accordance with approved shop drawings.

b. Electrical tests

(1) Determine accuracy of meter.

(2) Calibrate watthour meters to one-half percent.

(3) Verify that correct multiplier has been placed on face of meter, where applicable.

3.5.8 Phase Rotation Test

Perform phase rotation test to ensure proper rotation of service power prior to operation of new or reinstalled equipment using a phase rotation meter. Follow the meter manual directions performing the test.

-- End of Section --

SECTION 26 24 13

SWITCHBOARDS
08/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI)

ANSI C12.1	(2014; Errata 2016) Electric Meters - Code for Electricity Metering

ASTM INTERNATIONAL (ASTM)

ASTM A780/A780M	(2020) Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings
ASTM D149	(2020) Dielectric Breakdown Voltage and Dielectric Strength of Solid Electrical Insulating Materials at Commercial Power Frequencies
ASTM D709	(2017) Standard Specification for Laminated Thermosetting Materials
ASTM D1535	(2014; R 2018) Standard Practice for Specifying Color by the Munsell System

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 81	(2012) Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System
IEEE 100	(2000; Archived) The Authoritative Dictionary of IEEE Standards Terms
IEEE C2	(2017; Errata 1-2 2017; INT 1 2017) National Electrical Safety Code
IEEE C37.90.1	(2013) Standard for Surge Withstand Capability (SWC) Tests for Relays and Relay Systems Associated with Electric Power Apparatus

INTERNATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)

NETA ATS	(2021) Standard for Acceptance Testing Specifications for Electrical Power Equipment and Systems

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI/NEMA PB 2.1	(2013) General Instructions for Proper Handling, Installation, Operation and Maintenance of Deadfront Distribution Switchboards Rated 600 V or Less
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures
NEMA PB 2	(2011) Deadfront Distribution Switchboards

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code

UNDERWRITERS LABORATORIES (UL)

UL 467	(2013; Reprint Jun 2017) UL Standard for Safety Grounding and Bonding Equipment
UL 489	(2016; Rev 2019) UL Standard for Safety Molded-Case Circuit Breakers, Molded-Case Switches and Circuit-Breaker Enclosures
UL 891	(2005; Reprint Oct 2012) Switchboards

1.2 RELATED REQUIREMENTS

Section 26 08 00 APPARATUS INSPECTION AND TESTING applies to this section, with the additions and modifications specified herein.

1.3 DEFINITIONS

Unless otherwise specified or indicated, electrical and electronics terms used in these specifications, and on the drawings, are as defined in IEEE 100.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Switchboard Drawings; G

SD-03 Product Data

Switchboard; G

SD-06 Test Reports

Switchboard Design Tests; G

Switchboard Production Tests; G

Acceptance Checks and Tests; G

SD-07 Certificates

Cybersecurity Installation Certification; G

Submit certification indicating conformance with the paragraph CYBERSECURITY INSTALLATION CERTIFICATION.

SD-10 Operation and Maintenance Data

Switchboard Operation and Maintenance, Data Package 5; G

SD-11 Closeout Submittals

Assembled Operation and Maintenance Manuals; G

Equipment Test Schedule; G

Required Settings; G

Service Entrance Available Fault Current Label; G

1.5 QUALITY ASSURANCE

1.5.1 Product Data

Include manufacturer's information on each submittal for each component, device and accessory provided with the switchboard including:

a. Circuit breaker type, interrupting rating, and trip devices, including available settings.

b. Manufacturer's instruction manuals and published time-current curves (in electronic format) of the main secondary breaker and largest secondary feeder device.

1.5.2 Switchboard Drawings

Include wiring diagrams and installation details of equipment indicating proposed location, layout and arrangement, control panels, accessories, piping, ductwork, and other items that must be shown to ensure a coordinated installation. Identify circuit terminals on wiring diagrams and indicate the internal wiring for each item of equipment and the interconnection between each item of equipment. Indicate on the drawings adequate clearance for operation, maintenance, and replacement of operating equipment devices. Include the nameplate data, size, and capacity on submittal. Also include applicable federal, military, industry, and technical society publication references on submittals. Include the following:

a. One-line diagram including breakers, current transformers, and meters.

b. Outline drawings including front elevation, section views, footprint, and overall dimensions.

c. Bus configuration including dimensions and ampere ratings of bus bars.

d. Markings and NEMA nameplate data, including fuse information (manufacturer's name, catalog number, and ratings).

e. Circuit breaker type, interrupting rating, and trip devices, including available settings.

f. Wiring diagrams and elementary diagrams with terminals identified, and indicating prewired interconnections between items of equipment and the interconnection between the items.

g. Manufacturer's instruction manuals and published time-current curves (in electronic format) of the main secondary breaker and largest secondary feeder device. Use this information (designer of record) to provide breaker settings that ensures protection and coordination are achieved.

1.5.3 Regulatory Requirements

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word, "shall" or "must" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction," or words of similar meaning, to mean the Contracting Officer. Provide equipment, materials, installation, and workmanship in accordance with the mandatory and advisory provisions of NFPA 70 unless more stringent requirements are specified or indicated.

1.5.4 Standard Products

Provide materials and equipment that are products of manufacturers regularly engaged in the production of such products which are of equal material, design and workmanship, and:

a. Have been in satisfactory commercial or industrial use for 2 years prior to bid opening including applications of equipment and materials under similar circumstances and of similar size.

b. Have been on sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the 2-year period.

c. Where two or more items of the same class of equipment are required, provide products of a single manufacturer; however, the component parts of the item need not be the products of the same manufacturer unless stated in this section.

1.5.4.1 Alternative Qualifications

Products having less than a 2-year field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturers' factory or laboratory tests, is furnished.

1.5.4.2 Material and Equipment Manufacturing Date

Products manufactured more than one year prior to date of delivery to site are not acceptable.

1.6 MAINTENANCE

1.6.1 Switchboard Operation and Maintenance Data

Submit Operation and Maintenance Manuals in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA.

1.6.2 Assembled Operation and Maintenance Manuals

Assemble and securely bind manuals in durable, hard covered, water resistant binders. Assemble and index the manuals in the following order with a table of contents:

a. Manufacturer's O&M information required by the paragraph SD-10, OPERATION AND MAINTENANCE DATA.

b. Catalog data required by the paragraph SD-03, PRODUCT DATA.

c. Drawings required by the paragraph SD-02, SHOP DRAWINGS.

d. Prices for spare parts and supply list.

e. Information on metering.

f. Design test reports.

g. Production test reports.

1.7 WARRANTY

Provide equipment items that are supported by service organizations reasonably convenient to the equipment installation in order to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

PART 2 PRODUCTS

2.1 PRODUCT COORDINATION

Products and materials not considered to be switchboards and related accessories are specified in Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION, and Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

2.2 SWITCHBOARD

NEMA PB 2 and UL 891.

2.2.1 Ratings

Provide equipment with the following ratings:

a. Voltage rating: 480Y/277 volts AC, three-phase, 4-wire.

b. Continuous current rating of the main bus: as indicated.

c. Short-circuit current rating: as indicated.

d. UL listed and labeled as service entrance equipment.

2.2.2 Construction

Provide the following:

a. Switchboard: consisting of one or more vertical sections bolted together to form a rigid assembly and rear aligned.

b. All circuit breakers: front accessible.

c. Rear aligned switchboards: front accessible load connections.

e. Where indicated, "space for future" or "space" means to include a vertical bus provided behind a blank front cover. Where indicated, "provision for future" means full hardware provided to mount a breaker suitable for the location.

f. Completely factory engineered and assembled, including protective devices and equipment indicated with necessary interconnections, instrumentation, and control wiring.

2.2.2.1 Enclosure

Provide the following:

a. Enclosure: NEMA ICS 6 Type as indicated.

b. Enclosure: bolted together with removable bolt-on side and rear covers.

c. Front doors: provided with padlockable vault handles with a three point catch.

e. Base: includes any part of enclosure that is within 3 inches of concrete pad.

g. Paint color: ASTM D1535 light gray No. 61 or No. 49 over rust inhibitor.

2.2.2.2 Bus Bars

Provide the following:

a. Bus bars: copper with silver-plated contact surfaces.

(1) Phase bus bars: insulated with a tape wrap or insulating sleeve providing a minimum breakdown voltage of 16,000 volts per ASTM D149.

(2) Neutral bus: rated 100 percent of the main bus continuous current rating.

b. Make bus connections and joints with hardened steel bolts.

c. Main-bus (through bus): rated at the full ampacity of the main throughout the switchboard.

d. Minimum one-quarter by 2 inch copper ground bus secured to each vertical section along the entire length of the switchboard.

2.2.2.3 Main Section

Provide the main section consisting ofa combination section with molded-case circuit breakers for the main and branch devices as indicated.

2.2.3 Protective Device

Provide main and branch protective devices as indicated.

2.2.3.1 Molded-Case Circuit Breaker

Provide the following:

a. UL 489. UL listed and labeled, 100 percent rated main breaker standard rated branch breakers, manually operated, low voltage molded-case circuit breaker, with a short-circuit current rating of as indicated at 480V volts.

b. Breaker frame size: as indicated.

c. Series rated circuit breakers are unacceptable.

2.2.4 Electronic Trip Units

Equip main breakers as indicated with a solid-state tripping system consisting of three current sensors and a microprocessor-based trip unit that provides true rms sensing adjustable time-current circuit protection. Include the following:

a. Current sensors ampere rating: the same as the breaker frame rating.

b. Trip unit ampere rating: as indicated.

c. Ground fault protection: zero sequence sensing.

d. Electronic trip units: provide additional features as indicated:

(2) Main breakers: include short delay pick-up and time settings and, instantaneous settings and ground fault settings.

(8) For electronic trip units that are rated for or can be adjusted to 1,200 amperes or higher, provide arc energy reduction capability with an energy-reducing maintenance switch with local status indicator.

2.2.5 Metering

2.2.5.1 Digital Meters

IEEE C37.90.1 for surge withstand. Provide true rms, plus/minus one percent accuracy, programmable, microprocessor-based meter enclosed in a sealed case with the following features.

a. Display capability:

(1) Multi-Function Meter: Display a selected phase to neutral voltage, phase to phase voltage, percent phase to neutral voltage THD, percent phase to phase voltage THD; a selected phase current, neutral current, percent phase current THD, percent neutral

current; selected total PF, kW, KVA, kVAR, FREQ, kVAh, kWh. Detected alarm conditions include over/under current, over/under voltage, over/under KVA, over/under frequency, over/under selected PF/kVAR, voltage phase reversal, voltage imbalance, reverse power, over percent THD. Include a Form C KYZ pulse output relay on the meter.

b. Design meters to accept input from standard 5A secondary instrument transformers and direct voltage monitoring range to 600 volts, phase to phase.

c. Provide programming via a front panel display and a communication interface accessible by a computer.

d. Provide password secured programming stored in non-volatile EEPROM memory.

e. Provide digital communications in a Modbus RTU protocol via a RS232C serial port and an independently addressable RS232C serial port.

f. Provide meter that calculates and stores average max/min demand values with time and date for all readings based on a user selectable sliding window averaging period.

g. Provide meter with programmable hi/low set limits with two Form C dry contact relays when exceeding alarm conditions.

h. Provide meter with a display of Total Harmonic Distortion (THD) measurement to a minimum of the thirty-first order.

i. Include historical trend logging capability with the ability to store up to 100,000 data points with intervals of 1 second to 180 minutes. Provide a unit that can store and time stamp up to 1000 programmable triggered conditions.

j. Provide event waveform recording triggered by the rms of 2 cycles of voltage or current exceeding programmable set points. Store waveforms for all 6 channels of voltage and current for a minimum of 10 cycles prior to the event and 50 cycles past the event.

2.2.6 Terminal Boards

Provide with engraved plastic terminal strips and screw type terminals for external wiring between components and for internal wiring between removable assemblies. Provide short-circuiting type terminal boards associated with current transformer. Terminate conductors for current transformers with ring-tongue lugs. Provide terminal board identification that is identical in similar units. Provide color coded external wiring that is color coded consistently for similar terminal boards.

2.2.7 Wire Marking

Mark control and metering conductors at each end. Provide factory installed, white, plastic tubing, heat stamped with black block type letters on factory-installed wiring. On field-installed wiring, provide white, preprinted, polyvinyl chloride (PVC) sleeves, heat stamped with black block type letters. Provide a single letter or number on each sleeve, elliptically shaped to securely grip the wire, and keyed in such a manner to ensure alignment with adjacent sleeves. Provide specific wire

markings using the appropriate combination of individual sleeves. Indicate on each wire marker the device or equipment, including specific terminal number to which the remote end of the wire is attached.

2.3 MANUFACTURER'S NAMEPLATE

Provide a nameplate on each item of equipment bearing the manufacturer's name, address, model number, and serial number securely affixed in a conspicuous place; the nameplate of the distributing agent is not acceptable. This nameplate and method of attachment may be the manufacturer's standard if it contains the required information.

2.4 FIELD FABRICATED NAMEPLATES

ASTM D709. Provide laminated plastic nameplates for each switchboard, equipment enclosure, relay, switch, and device; as specified in this section or as indicated on the drawings. Identify on each nameplate inscription the function and, when applicable, the position. Provide nameplates of melamine plastic, 0.125 inch thick, white with black center core. Provide red laminated plastic label with white center core where indicated. Provide matte finish surface. Provide square corners. Accurately align lettering and engrave into the core. Provide nameplates with minimum size of one by 2.5 inches. Provide lettering that is a minimum of 0.25 inch high normal block style.

2.5 SOURCE QUALITY CONTROL

2.5.1 Equipment Test Schedule

The Government reserves the right to witness tests. Provide equipment test schedules for tests to be performed at the manufacturer's test facility. Submit required test schedule and location, and notify the Contracting Officer 30 calendar days before scheduled test date. Notify Contracting Officer 15 calendar days in advance of changes to scheduled date.

Provide the following as part of test equipment calibration:

a. Provide a calibration program which assures that all applicable test instruments are maintained within rated accuracy.

b. Accuracy: Traceable to the National Institute of Standards and Technology.

c. Instrument calibration frequency schedule: less than or equal to 12 months for both test floor instruments and leased specialty equipment.

d. Dated calibration labels: visible on all test equipment.

e. Calibrating standard: higher accuracy than that of the instrument tested.

f. Keep up-to-date records that indicate dates and test results of instruments calibrated or tested. For instruments calibrated by the manufacturer on a routine basis, in lieu of third party calibration, include the following:

(1) Maintain up-to-date instrument calibration instructions and procedures for each test instrument.

(2) Identify the third party/laboratory calibrated instrument to verify that calibrating standard is met.

2.5.2 Switchboard Design Tests

NEMA PB 2 and UL 891.

2.5.2.1 Design Tests

Furnish documentation showing the results of design tests on a product of the same series and rating as that provided by this specification.

a. Short-circuit current test.

b. Enclosure tests.

c. Dielectric test.

2.5.2.2 Additional Design Tests

In addition to normal design tests, perform the following tests on the actual equipment. Furnish reports which include results of design tests performed on the actual equipment.

a. Temperature rise tests.

b. Continuous current.

2.5.3 Switchboard Production Tests

NEMA PB 2 and UL 891. Furnish reports which include results of production tests performed on the actual equipment for this project. These tests include:

a. 60-hertz dielectric tests.

b. Mechanical operation tests.

c. Electrical operation and control wiring tests.

d. Ground fault sensing equipment test.

2.6 COORDINATED POWER SYSTEM PROTECTION

Provide a power system study as specified in Section 26 28 01.00 10 COORDINATED POWER SYSTEM PROTECTION.

2.7 ARC FLASH WARNING LABEL

Provide warning label for switchboards. Locate this self-adhesive warning label on the outside of the enclosure warning of potential electrical arc flash hazards and appropriate PPE required. Provide label format as indicated.

2.8 SERVICE ENTRANCE AVAILABLE FAULT CURRENT LABEL

Provide label on exterior of switchboards used as service equipment listing the maximum available fault current at that location. Include on

the label the date that the fault calculation was performed and the contact information for the organization that completed the calculation. Locate this self-adhesive warning label on the outside of the switchboard. Provide label format as indicated.

PART 3 EXECUTION

3.1 INSTALLATION

Conform to IEEE C2, NFPA 70, and to the requirements specified herein. Provide new equipment and materials unless indicated or specified otherwise.

3.2 GROUNDING

NFPA 70 and IEEE C2, except that grounds and grounding systems with a resistance to solid earth ground not exceeding 25 ohms.

3.2.1 Grounding Electrodes

Provide driven ground rods as specified in Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION. Connect ground conductors to the upper end of the ground rods by exothermic weld or compression connector. Provide compression connectors at equipment end of ground conductors.

3.2.2 Equipment Grounding

Provide bare copper cable not smaller than No. 4/0 AWG not less than 24 inches below grade connecting to the indicated ground rods. When work in addition to that indicated or specified is directed to obtain the specified ground resistance, the provision of the contract covering "Changes" applies.

3.2.3 Connections

Make joints in grounding conductors and loops by exothermic weld or compression connector. Install exothermic welds and compression connectors as specified in Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION.

3.2.4 Grounding and Bonding Equipment

UL 467, except as indicated or specified otherwise.

3.3 INSTALLATION OF EQUIPMENT AND ASSEMBLIES

Install and connect equipment furnished under this section as indicated on project drawings, the approved shop drawings, and as specified herein.

3.3.1 Switchboard

ANSI/NEMA PB 2.1.

3.3.2 Meters and Instrument Transformers

ANSI C12.1.

3.3.3 Field Applied Painting

Where field painting of enclosures is required to correct damage to the manufacturer's factory applied coatings, provide manufacturer's recommended coatings and apply in accordance with manufacturer's instructions.

3.3.4 Galvanizing Repair

Repair damage to galvanized coatings using ASTM A780/A780M, zinc rich paint, for galvanizing damaged by handling, transporting, cutting, welding, or bolting. Do not heat surfaces that repair paint has been applied to.

3.3.5 Field Fabricated Nameplate Mounting

Provide number, location, and letter designation of nameplates as indicated. Fasten nameplates to the device with a minimum of two sheet-metal screws or two rivets.

3.4 FOUNDATION FOR EQUIPMENT AND ASSEMBLIES

3.4.1 Exterior Location

Mount switchboard on concrete slab as follows:

a. Unless otherwise indicated, provide the slab with dimensions at least 8 inches thick, reinforced with a 6 by 6 inch No. 6 mesh placed uniformly 4 inches from the top of the slab.

b. Place slab on a 6 inch thick, well-compacted gravel base.

c. Install slab such that the top of the concrete slab is approximately 4 inches above the finished grade.

d. Provide edges above grade 1/2 inch chamfer.

e. Provide slab of adequate size to project at least 8 inches beyond the equipment.

f. Provide conduit turnups and cable entrance space required by the equipment to be mounted.

g. Seal voids around conduit openings in slab with water- and oil-resistant caulking or sealant.

h. Cut off and bush conduits 3 inches above slab surface.

i. Provide concrete work as specified in Section 03 30 00 CAST-IN-PLACE CONCRETE.

3.4.2 Interior Location

Mount switchboard on concrete slab as follows:

a. Unless otherwise indicated, provide the slab with dimensions at least 4 inches thick.

b. Install slab such that the top of the concrete slab is approximately 4

inches above the finished grade.

c. Provide edges above grade 1/2 inch chamfer.

d. Provide slab of adequate size to project at least 8 inches beyond the equipment.

e. Provide conduit turnups and cable entrance space required by the equipment to be mounted.

f. Seal voids around conduit openings in slab with water- and oil-resistant caulking or sealant.

g. Cut off and bush conduits 3 inches above slab surface.

h. Provide concrete work as specified in Section 03 30 00 CAST-IN-PLACE CONCRETE.

3.5 FIELD QUALITY CONTROL

Submit Required Settings of breakers to the Contracting Officer after approval of switchboard and at least 30 days in advance of their requirement.

3.5.1 Performance of Acceptance Checks and Tests

Perform in accordance with the manufacturer's recommendations and include the following visual and mechanical inspections and electrical tests, performed in accordance with NETA ATS.

3.5.1.1 Switchboard Assemblies

a. Visual and Mechanical Inspection

(1) Compare equipment nameplate data with specifications and approved shop drawings.

(2) Inspect physical, electrical, and mechanical condition.

(3) Verify appropriate anchorage, required area clearances, and correct alignment.

(4) Clean switchboard and verify shipping bracing, loose parts, and documentation shipped inside cubicles have been removed.

(5) Inspect all doors, panels, and sections for paint, dents, scratches, fit, and missing hardware.

(6) Verify that circuit breaker sizes and types correspond to approved shop drawings as well as to the circuit breaker’s address for microprocessor-communication packages.

(7) Verify that current transformer ratios correspond to approved shop drawings.

(8) Inspect all bolted electrical connections for high resistance using low-resistance ohmmeter, verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method, or performing thermographic survey.

(9) Confirm correct operation and sequencing of electrical and mechanical interlock systems.

(10) Confirm correct application of manufacturer's recommended lubricants.

(11) Inspect insulators for evidence of physical damage or contaminated surfaces.

(12) Verify correct barrier installation and operation.

(13) Exercise all active components.

(14) Inspect all mechanical indicating devices for correct operation.

(15) Verify that filters are in place and vents are clear.

(16) Test operation, alignment, and penetration of instrument transformer withdrawal disconnects.

(17) Inspect control power transformers.

b. Electrical Tests

(1) Perform insulation-resistance tests on each bus section.

(2) Perform dielectric withstand voltage tests.

(3) Perform insulation-resistance test on control wiring; Do not perform this test on wiring connected to solid-state components.

(4) Perform control wiring performance test.

(5) Perform primary current injection tests on the entire current circuit in each section of assembly.

3.5.1.2 Circuit Breakers - Low Voltage - Power

a. Visual and Mechanical Inspection

(1) Compare nameplate data with specifications and approved shop drawings.

(2) Inspect physical and mechanical condition.

(3) Inspect anchorage, alignment, and grounding.

(4) Verify that all maintenance devices are available for servicing and operating the breaker.

(5) Inspect arc chutes.

(6) Inspect moving and stationary contacts for condition, wear, and alignment.

(7) Verify that primary and secondary contact wipe and other dimensions vital to satisfactory operation of the breaker are correct.

(8) Perform all mechanical operator and contact alignment tests on both the breaker and its operating mechanism.

(9) Inspect all bolted electrical connections for high resistance using low-resistance ohmmeter, verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method, or performing thermographic survey.

(10) Verify cell fit and element alignment.

(11) Verify racking mechanism.

(12) Confirm correct application of manufacturer's recommended lubricants.

b. Electrical Tests

(1) Perform contact-resistance tests on each breaker.

(2) Perform insulation-resistance tests.

(3) Adjust Breaker(s) for final settings in accordance with Government provided settings.

(4) Determine long-time minimum pickup current by primary current injection.

(5) Determine long-time delay by primary current injection.

(6) Determine short-time pickup and delay by primary current injection.

(7) Determine ground-fault pickup and delay by primary current injection.

(8) Determine instantaneous pickup value by primary current injection.

(9) Activate auxiliary protective devices, such as ground-fault or undervoltage relays, to ensure operation of shunt trip devices; Check the operation of electrically-operated breakers in their cubicle.

(10) Verify correct operation of any auxiliary features such as trip and pickup indicators, zone interlocking, electrical close and trip operation, trip-free, and antipump function.

(11) Verify operation of charging mechanism.

3.5.1.3 Circuit Breakers

Low Voltage - Insulated-Case and Low Voltage Molded Case with Solid State Trips

a. Visual and Mechanical Inspection

(1) Compare nameplate data with specifications and approved shop drawings.

(2) Inspect circuit breaker for correct mounting.

(3) Operate circuit breaker to ensure smooth operation.

(4) Inspect case for cracks or other defects.

(5) Inspect all bolted electrical connections for high resistance using low resistance ohmmeter, verifying tightness of accessible bolted connections and/or cable connections by calibrated torque-wrench method, or performing thermographic survey.

(6) Inspect mechanism contacts and arc chutes in unsealed units.

b. Electrical Tests

(1) Perform contact-resistance tests.

(2) Perform insulation-resistance tests.

(3) Perform Breaker adjustments for final settings in accordance with Government provided settings.

(4) Perform long-time delay time-current characteristic tests

(5) Determine short-time pickup and delay by primary current injection.

(6) Determine ground-fault pickup and time delay by primary current injection.

(7) Determine instantaneous pickup current by primary injection.

(8) Verify correct operation of any auxiliary features such as trip and pickup indicators, zone interlocking, electrical close and trip operation, trip-free, and anti-pump function.

3.5.1.4 Current Transformers

a. Visual and Mechanical Inspection

(1) Compare equipment nameplate data with specifications and approved shop drawings.

(2) Inspect physical and mechanical condition.

(3) Verify correct connection.

(4) Verify that adequate clearances exist between primary and secondary circuit.

(5) Inspect all bolted electrical connections for high resistance using low-resistance ohmmeter, verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method, or performing thermographic survey.

(6) Verify that all required grounding and shorting connections provide good contact.

b. Electrical Tests

(1) Perform resistance measurements through all bolted connections

with low-resistance ohmmeter, if applicable.

(2) Perform insulation-resistance tests.

(3) Perform polarity tests.

(4) Perform ratio-verification tests.

3.5.1.5 Metering and Instrumentation

a. Visual and Mechanical Inspection

(1) Compare equipment nameplate data with specifications and approved shop drawings.

(2) Inspect physical and mechanical condition.

(3) Verify tightness of electrical connections.

b. Electrical Tests

(1) Determine accuracy of meters at 25, 50, 75, and 100 percent of full scale.

(2) Calibrate watthour meters according to manufacturer's published data.

(3) Verify all instrument multipliers.

(4) Electrically confirm that current transformer and voltage transformer secondary circuits are intact.

3.5.1.6 Grounding System

a. Visual and Mechanical Inspection

(1) Inspect ground system for compliance with contract plans and specifications.

b. Electrical Tests

(1) IEEE 81. Perform ground-impedance measurements utilizing the fall-of-potential method. On systems consisting of interconnected ground rods, perform tests after interconnections are complete. On systems consisting of a single ground rod perform tests before any wire is connected. Take measurements in normally dry weather, not less than 48 hours after rainfall. Use a portable ground resistance tester in accordance with manufacturer's instructions to test each ground or group of grounds. Use an instrument equipped with a meter reading directly in ohms or fractions thereof to indicate the ground value of the ground rod or grounding systems under test.

(2) Submit the measured ground resistance of each ground rod and grounding system, indicating the location of the rod and grounding system. Include the test method and test setup (i.e., pin location) used to determine ground resistance and soil conditions at the time the measurements were made.

3.5.1.7 Cybersecurity Installation Certification

Furnish a certification that control systems are installed in accordance with DoD Instruction 8500.01, DoD Instruction 8510.01, and as required by individual Service Implementation Policy.

3.5.2 Follow-Up Verification

Upon completion of acceptance checks, settings, and tests, show by demonstration in service that circuits and devices are in good operating condition and properly performing the intended function. Trip circuit breakers by operation of each protective device. Test each item to perform its function not less than three times. As an exception to requirements stated elsewhere in the contract, provide the Contracting Officer five working days advance notice of the dates and times for checks, settings, and tests.

-- End of Section --

SECTION 26 28 01.00 10

COORDINATED POWER SYSTEM PROTECTION
08/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 242	(2001; Errata 2003) Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems - Buff Book
IEEE 399	(1997) Brown Book IEEE Recommended Practice for Power Systems Analysis

1.2 SYSTEM DESCRIPTION

The power system covered by this specification consists of: the complete electrical distribution system for the 350th SWW facility at Eglin AFB, Florida.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Fault Current Analysis

Protective Device Coordination Study

System Coordinator

1.4 QUALITY ASSURANCE

1.4.1 System Coordinator

System coordination, recommended ratings and settings of protective devices, and design analysis must be accomplished by a registered professional electrical power engineer with a minimum of 3 years of current experience in the coordination of electrical power systems. Submit verification of experience and license number, of a registered Professional Engineer as specified above. Provide experience data consisting of at least five references for work of a magnitude comparable

to this contract, including points of contact, addresses and telephone numbers.

PART 2 PRODUCTS

2.1 COORDINATED POWER SYSTEM PROTECTION

Prepare analyses to demonstrate that the equipment selected and system constructed meet the contract requirements for ratings, coordination, and protection. Include a load flow analysis, a fault current analysis, and a protective device coordination study. Submit the study along with protective device equipment submittals. No time extensions or similar contact modifications will be granted for work arising out of the requirements for this study. Approval of protective devices proposed will be based on recommendations of this study. The Government is not responsible for any changes to equipment, device ratings, settings, or additional labor for installation of equipment or devices ordered and/or procured prior to approval of the study. The studies must be performed by a registered professional engineer with demonstrated experience in power system coordination in the last 3 years. Provide a list of references complete with points of contact, addresses and telephone numbers. The selection of the engineer is subject to the approval of the Contracting Officer.

2.1.1 Scope of Analyses

The fault current analysis and protective device coordination study must begin at: the source bus and extend down to system buses where fault availability is 10,000 amperes (symmetrical) for building/facility 600 volt level distribution buses.

2.1.2 Determination of Facts

Determine and document the time-current characteristics, features, and nameplate data for each existing protective device. Coordinate with the commercial power company CHELCO for fault current availability at the site.

2.1.3 Single Line Diagram

Prepare a single line diagram to show the electrical system buses, devices, transformation points, and all sources of fault current (including generator and motor contributions). A fault-impedance diagram or a computer analysis diagram may be provided. Each bus, device or transformation point must have a unique identifier. If a fault-impedance diagram is provided, show impedance data. Show location of switches, breakers, and circuit interrupting devices on the diagram together with available fault data, and the device interrupting rating.

2.1.4 Fault Current Analysis

2.1.4.1 Method

Perform the fault current analysis in accordance with methods described in IEEE 242, and IEEE 399.

2.1.4.2 Data

Utilize actual data in fault calculations. Bus characteristics and transformer impedance must be those proposed. Document data in the report.

2.1.4.3 Fault Current Availability

Provide balanced three-phase fault, bolted line-to-line fault, and line-to-ground fault current values at each voltage transformation point and at each power distribution bus. Show the maximum and minimum values of fault available at each location in tabular form on the diagram or in the report.

2.1.5 Coordination Study

Demonstrate that the maximum possible degree of selectivity has been obtained between devices specified, consistent with protection of equipment and conductors from damage from overloads and fault conditions. Include a description of the coordination of the protective devices in this project. Provide a written narrative describing: which devices may operate in the event of a fault at each bus; the logic used to arrive at device ratings and settings; situations where system coordination is not achievable due to device limitations (an analysis of any device curves which overlap); coordination between upstream and downstream devices; and relay settings. Provide recommendations to improve or enhance system reliability, and detail where such changes would involve additions or modifications to the contract and cost damages (addition or reduction). Provide composite coordination plots on log-log graph paper.

2.1.6 Study report

a. Include a narrative describing: the analyses performed; the bases and methods used; and the desired method of coordinated protection of the power system.

b. Include descriptive and technical data for existing devices and new protective devices proposed. Include manufacturers published data, nameplate data, and definition of the fixed or adjustable features of the existing or new protective devices.

c. Document utility company data including system voltages, fault MVA, system X/R ratio, time-current characteristic curves, current transformer ratios, and relay device numbers and settings; .

d. The report must contain fully coordinated composite time-current characteristics curves for each bus in the system, as required to ensure coordinated power system protection between protective devices or equipment. Include recommended ratings and settings of all protective devices in tabulated form.

e. Provide the calculation performed for the analyses, including computer analysis programs utilized. Provide the name of the software package, developer, and version number.

PART 3 EXECUTION

Not Used

-- End of Section --

SECTION 26 29 23

ADJUSTABLE SPEED DRIVE (ASD) SYSTEMS UNDER 600 VOLTS
02/20, CHG 1: 05/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

EUROPEAN COMMITTEE FOR STANDARDIZATION (CEN/CENELEC)

EN 61800-3	(2017) Requirements for the Control of Electromagnetic Interference Characteristics of Subsystems and Equipment

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 519	(2014) Recommended Practices and Requirements for Harmonic Control in Electrical Power Systems
IEEE C62.41.1	(2002; R 2008) Guide on the Surges Environment in Low-Voltage (1000 V and Less) AC Power Circuits
IEEE C62.41.2	(2002) Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits

INTERNATIONAL ELECTROTECHNICAL COMMISSION (IEC)

IEC 61000-3-12	(2012) Electromagnetic Compatibility (EMC) - Part 3-12: Limits - Limits for harmonic currents produced by equipment connected to public low-voltage systems with input current >16 A and </=75 A per phase

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)
NEMA ICS 1	(2000; R 2015) Standard for Industrial Control and Systems: General Requirements
NEMA ICS 3.1	(2019) Guide for the Application, Handling, Storage, Installation and Maintenance of Medium-Voltage AC Contactors, Controllers and Control Centers
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures
NEMA ICS 7	(2020) Adjustable-Speed Drives

NEMA ICS 7.2	(2015) Application Guide for AC Adjustable Speed Drive Systems
NEMA MG 1	(2018) Motors and Generators

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

47 CFR 15	Radio Frequency Devices

UNDERWRITERS LABORATORIES (UL)

UL 489	(2016; Rev 2019) UL Standard for Safety Molded-Case Circuit Breakers, Molded-Case Switches and Circuit-Breaker Enclosures
UL 61800-5-1	(2016) Adjustable Speed Electrical Power Drive Systems - Part 5-1: Safety Requirements - Electrical, Thermal and Energy

1.2 RELATED REQUIREMENTS

Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM applies to this section with additions and modifications specified herein.

1.3 SYSTEM DESCRIPTION

1.3.1 Performance Requirements

1.3.1.1 Electromagnetic Interference Suppression

Computing devices, as defined by 47 CFR 15 and EN 61800-3 rules and regulations, must be certified to comply with the requirements for class A computing devices and labeled.

1.3.1.2 Electromechanical and Electrical Components

Ensure electrical and electromechanical components of the Adjustable Speed Drive (ASD) do not cause electromagnetic interference to adjacent electrical or electromechanical equipment while in operation.

1.3.2 Electrical Requirements

1.3.2.1 Power Line Surge Protection

IEEE C62.41.1 and IEEE C62.41.2, IEEE 519, IEC 61000-3-12 Control panel must have surge protection, included within the panel to protect the unit from damaging transient voltage surges. Surge protective device must be mounted near the incoming power source and properly wired to all three phases and ground. Fuses must not be used for surge protection.

1.3.2.2 Sensor and Control Wiring Surge Protection

I/O functions as specified must be protected against surges induced on control and sensor wiring installed outdoors and as shown. Test the inputs and outputs in both normal mode and common mode using the following two waveforms:

a. A 10 microsecond by 1000 microsecond waveform with a peak voltage of 1500 volts and a peak current of 60 amperes.

b. An 8 microsecond by 20 microsecond waveform with a peak voltage of 1000 volts and a peak current of 500 amperes.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Schematic Diagrams; G

Interconnecting Diagrams; G

Installation Drawings; G

As-Built Drawings; G

SD-03 Product Data

Adjustable Speed Drives; G

Wires and Cables

Equipment Schedule

SD-06 Test Reports

ASD Test

Performance Verification Tests

Endurance Test

SD-08 Manufacturer's Instructions

Installation instructions

SD-09 Manufacturer's Field Reports

ASD Test Plan; G

Standard Products

SD-10 Operation and Maintenance Data

Adjustable Speed Drives, Data Package 4

1.5 QUALITY ASSURANCE

1.5.1 Schematic Diagrams

Submit diagrams showing circuits and device elements for each replaceable module. Schematic diagrams of printed circuit boards are permitted to group functional assemblies as devices, provided that sufficient information is provided for government maintenance personnel to verify proper operation of the functional assemblies.

1.5.2 Interconnecting Diagrams

Show interconnections between equipment assemblies, and external interfaces, including power and signal conductors. Include for enclosures and external devices.

1.5.3 Installation Drawings

Show floor plan of each site, with ASD's and motors indicated. Indicate ventilation requirements, adequate clearances, and cable routes. Submit drawings for government approval prior to equipment construction or integration. Immediately record modifications to original drawings made during installation for inclusion into the as-built drawings.

1.5.4 Equipment Schedule

Provide schedule of equipment supplied. Schedule must provide a cross reference between manufacturer data and identifiers indicated in shop drawings. Schedule must include the total quantity of each item of equipment supplied and data indicating compatibility with motors being driven. For complete assemblies, such as ASD's, provide the serial numbers of each assembly, and a sub-schedule of components within the assembly. Provide recommended spare parts listing for each assembly or component.

1.5.5 Installation Instructions

Provide installation instructions issued by the manufacturer of the equipment, including notes and recommendations, prior to shipment to the site. Provide operation instructions prior to acceptance testing.

1.5.6 Standard Products

Provide materials and equipment that are products of manufacturers regularly engaged in the production of such products which are of equal material, design and workmanship and:

a. Have been in satisfactory commercial or industrial use for 2 years prior to bid opening including applications of equipment and materials under similar circumstances and of similar size.

b. Have been on sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the 2-year period.

c. Where two or more items of the same class of equipment are required, provide products of a single manufacturer; however, the component parts of the item need not be the products of the same manufacturer unless stated in this section.

1.6 DELIVERY AND STORAGE

Store delivered equipment to protect from the weather, humidity and temperature variations, dirt and dust, or other contaminants.

1.7 WARRANTY

The complete system must be warranted by the manufacturer for a period of one year . Repair or replace any component failing to perform its function as specified and documented at no additional cost to the Government. Items repaired or replaced must be warranted for an additional period of at least one year from the date that it becomes functional again, as specified in FAR 52.246-21 Warranty of Construction.

1.8 MAINTENANCE

1.8.1 Spare Parts

Manufacturers provide spare parts in accordance with recommended spare parts list.

1.8.2 Operation and Maintenance Data

Provide in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA. Provide service and maintenance information including preventive maintenance, assembly, and disassembly procedures. Include electrical drawings from electrical general sections. Provide additional information necessary to provide complete operation, repair, and maintenance information, detailed to the smallest replaceable unit. Include copies of as-built submittals. Provide routine preventative maintenance instructions, and equipment required. Provide instructions on how to modify program settings, and modify the control program. Provide instructions on drive adjustment, trouble-shooting, and configuration. Provide instructions on process tuning and system calibration.

1.8.3 Maintenance Support

During the warranty period, provide on-site, on-call maintenance services by drive manufacturer's personnel on the following basis: The service must be on a per-call basis with 36 hour response. Contractor is responsible for the maintenance of all hardware and software of the system during the warranty period. Various personnel of different expertise must be sent on-site depending on the nature of the maintenance service required. Costs must include travel, local transportation, living expenses, and labor rates of the service personnel while responding to the service request. The provisions of this Section are not in lieu of, nor relieve the Contractor of, warranty responsibilities covered in this specification. Should the result of the service request be the uncovering of a system defect covered under the warranty provisions, all costs for the call, including the labor necessary to identify the defect, must be borne by the Contractor.

1.8.4 Technical Support

Provide the ASDs with manufacturer's technical telephone support in English, readily available during normal working hours.

PART 2 PRODUCTS

2.1 ADJUSTABLE SPEED DRIVES (ASD)

Provide adjustable speed drive to control the speed of induction motor(s). The ASD must include the following minimum functions, features and ratings.

a. Input circuit breaker per UL 489 with a minimum of 10,000 amps symmetrical interrupting capacity and door interlocked external operator.

b. A converter stage per UL 61800-5-1 must change fixed voltage, fixed frequency, ac line power to a fixed dc voltage. The converter must utilize a full wave bridge design incorporating diode rectifiers. Silicon Controlled Rectifiers (SCR) are not acceptable. The converter must be insensitive to three phase rotation of the ac line and must not cause displacement power factor of less than .95 lagging under any speed and load condition.

c. An inverter stage must change fixed dc voltage to variable frequency, variable ac voltage for application to a standard NEMA MG 1 Part 30 motor designed for use with adjustable frequency power supplies. Switch the inverter to produce a sine coded pulse width modulated (PWM) output waveform.

d. The ASD shall be capable of supplying 110 percent of rated full load current for one minute at maximum ambient temperature.

e. The ASD must be designed to operate from a 460 volt, plus or minus 10 percent, three phase, 60 Hz supply, and control motors with a corresponding voltage rating.

h. The controllers must be capable of producing an output frequency over the range of 3 Hz to 60 Hz (20 to one speed range), without low speed cogging. Over frequency protection must be included such that a failure in the controller electronic circuitry must not cause frequency to exceed 110 percent of the maximum controller output frequency selected.

j. The controller efficiency at any speed must not be less than 96 percent.

k. The controllers must be capable of being restarted into a motor coasting in the forward direction without tripping.

l. Protection of power semiconductor components must be accomplished without the use of fast acting semiconductor output fuses. Subjecting the controllers to any of the following conditions must not result in component failure or the need for fuse replacement:

(1) Short circuit at controller output

(2) Ground fault at controller output

(3) Open circuit at controller output

(4) Input undervoltage

(5) Input overvoltage

(6) Loss of input phase

(7) AC line switching transients

(8) Instantaneous overload

(9) Sustained overload exceeding 115 percent of controller rated current

(10) Over temperature

(11) Phase reversal

m. Solid state motor overload protection must have sensor in each phase, Class 10 tripping characteristic selected to protect motor against voltage and current unbalance and single phasing, Class II ground-fault protection, with start and run delays to prevent nuisance trip on staring, analog communication module, isolated overload alarm contact, external overload, reset push button.

n. Include slip compensation circuit that will sense changing motor load conditions and adjust output frequency to provide speed regulation of NEMA MG 1 Part 30 designed for use with adjustable frequency power supplies motors to within plus or minus 0.5 percent of maximum speed without the necessity of a tachometer generator.

o. The ASD must be factory set for manual restart after the first protective circuit trip for malfunction (overcurrent, undervoltage, overvoltage or overtemperature) or an interruption of power. The ASD must be capable of being set for automatic restart after a selected time delay. If the drive faults again within a specified time period (adjustable 0-60 seconds), a manual restart will be required. Provide Bidirectional Autospeed Search capable of starting the ASD into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to drive, motor, or load.

p. The ASD must include external fault reset capability. All the necessary logic to accept an external fault reset contact must be included.

q. Provide critical speed lockout circuitry to prevent operating at frequencies with critical harmonics that cause resonant vibrations. The ASD must have a minimum of three user selectable bandwidths.

r. Provide preperly sized NEMA rated by-pass and isolation contactors to enable operation of motor in the event of ASD failure and for safety transfers motor between power converter output and bypass circuit using a field-selectable automatic and manual bypass mode. Install mechanical and electrical interlocks between the by-pass and isolation contactors. Provide a selector switch and transfer delay timer. Motor overload and short circuit protective features must remain in use during the bypass mode.

s. Each individual ASD must meet the following Total Harmonic Distortion (THD) requirements at the input terminals to the factory assembly of the ASD or at the load disconnecting means serving the ASD and filter

assembly. These measurements should be taken with the drive set at 90 percent frequency (rpms) and the motor under a minimum of 50 percent demand.

(1) The Voltage THD should not exceed 2.0 percent THD.

(2) The Current THD should not exceed 15.0 percent THD.

(3) If the standard factory ASD does not meet or exceed these requirements the factory must install appropriate equipment (Harmonic Traps, Filters, different Drive technology, etc.) to mitigate the distortion to assure performance of the VFD is within the limits.

(4) These tests should be performed at the Manufacturers Laboratory facilities and submitted as part of the Product Data Submittals, in order to prevent the necessity of adding mitigation equipment in the field. If the requirements listed above are met, IEEE 519 will also be met.

2.1.1 ASD for HVAC Application

ASDs must have the following features:

a. A local operator control providing the following functions:

(1) Remote/Local operator selection with password access.

(2) Run/Stop and manual speed commands.

(3) All programming functions.

(4) Scrolling through all display functions.

b. A local operator control panel with the following data displayed:

(1) ASD status.

(2) Frequency.

(3) Motor RPM.

(4) Phase current.

(5) Scrolling through all display functions.

(6) Fault diagnostics in descriptive text.

(7) All programmed parameters.

c. Standard PI loop controller with input terminal for controlled variable and parameter settings.

d. User interface terminals for remote control of ASD speed, speed feedback, and an isolated form C SPDT relay, which energizes on a drive fault condition.

e. An isolated form C SPDT auxiliary relay which energizes on a run command.

f. An adjustable carrier frequency with 16 KHz minimum upper limit.

h. Historical logging information and displays:

(1) Real-time clock with current time and date, if time and date stamping is not accomplished through the DDC system for HVAC.

(2) Running log of total power versus time.

(3) Total run time.

(4) Fault log, maintaining last four faults with time and data stamp for each.

i. The ASD must be capable of automatic control by a remote 0 to 10 VDC signal, by BACnet network command, or manually by the ASD control panel.

j. ASDs must include the following operator programmable parameters:

(1) Upper and lower limit frequency.

(2) Acceleration and deceleration rate.

(3) Variable torque volts per Hertz curve.

(4) Starting voltage level.

(5) Starting frequency level.

(6) Display speed scaling.

(7) Enable/disable soft stall feature.

(8) Motor overload level.

(9) Motor stall level.

(10) Jump frequency and hysteresis band.

(11) PWM carrier frequency.

k. ASD must have the following protective features:

(1) An electronic adjustable inverse time current limit with consideration for additional heating of the motor at frequencies below 45Hz, for the protection of the motor.

(2) An electronic adjustable soft stall feature, allowing the ASD to lower the frequency to a point where the motor will not exceed the full-load amperage when an overload ASD will automatically return to the requested frequency when load conditions permit.

(3) A separate electronic stall at 110 percent ASD rated current, and a separate hardware trip at 190 percent current.

(4) The ability to shut down if inadvertently started into a rotating load without damaging the ASD or the motor.

(5) The ability to keep a log of a minimum of four previous fault conditions, indicating the fault type and time of occurrence in descriptive text.

(6) The ability to sustain 110 percent rated current for 60 seconds.

(7) The ability to shutdown safely or protect against and record the following fault conditions:

(a) Over current (and an indication if the over current was during acceleration, deceleration, or running).

(b) Over current internal to the drive.

(c) Motor overload at start-up.

(d) Over voltage from utility power.

(e) Motor running overload.

(f) Over voltage during deceleration.

(g) ASD over heat.

(h) Load and ground fault.

(h) Abnormal parameters or data in ASD EEPROM.

2.2 ENCLOSURES

Provide equipment enclosures conforming to NEMA 250, NEMA ICS 7, and NEMA ICS 6, with a air conditioner and heater if located outdoors. An HMCP device shall provide the disconnecting means. The operating handle shall protrude through the door, but the disconnect shall not be mounted on the door. The handle shall indicate ON, OFF, and tripped conditions. The handle shall have provisions to accommodate a minimum of three padlocks in the OFF position. Interlocks shall prevent unauthorized opening or closing of the ASD door with the disconnect handle in the ON position. The door handle interlock should have provisions to be defeated by qualified maintenance personnel.

2.3 WIRES AND CABLES

All wires and cables must conform to NEMA 250, NEMA ICS 7, NFPA 70.

2.4 NAMEPLATES

Nameplates external to NEMA enclosures must conform with the requirements of Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Provide manufacturer's standard, permanent nameplates for internal areas of enclosures.

2.5 SOURCE QUALITY CONTROL

2.5.1 ASD Test Plan

To ensure quality, each ASD must be subject to a series of in-plant quality control inspections before approval for shipment from the manufacturer's facilities. Provide test plans.

2.5.2 ASD Test Report

To ensure quality, each ASD must be subject to a series of in-plant quality control inspections before approval for shipment from the manufacturer's facilities. Provide test reports.

PART 3 EXECUTION

3.1 INSTALLATION

Per NEMA ICS 3.1, install equipment in accordance with the approved manufacturer's printed installation drawings, instructions, wiring diagrams, and as indicated on project drawings and the approved shop drawings. A field representative of the drive manufacturer must supervise the installation of all equipment, and wiring.

3.2 GROUNDING

Per NEMA ICS 7.2, ASD must be solidly grounded to the main distribution.

3.3 FIELD QUALITY CONTROL

Specified products must be tested as a system for conformance to specification requirements prior to scheduling the acceptance tests. Conduct performance verification tests in the presence of Government representative, observing and documenting complete compliance of the system to the specifications. Submit a signed copy of the test results, certifying proper system operation before scheduling tests.

3.3.1 ASD Test

A proposed test plan must be submitted to the contracting officer at least 28 calendar days prior to proposed testing for approval. The tests must conform to NEMA ICS 1, NEMA ICS 7, and all manufacturer's safety regulations. The Government reserves the right to witness all tests and review any documentation. Inform the Government at least 14 working days prior to the dates of testing. Perform the ASD test with the assistance of a factory-authorized service representative.

3.3.2 Performance Verification Tests

"Performance Verification Test" plan must provide the step by step procedure required to establish formal verification of the performance of the ASD. Compliance with the specification requirements must be verified by inspections, review of critical data, demonstrations, and tests. The Government reserves the right to witness all tests, review data, and request other such additional inspections and repeat tests as necessary to ensure that the system and provided services conform to the stated requirements. Inform the Government 14 calendar days prior to the date the test is to be conducted.

3.3.3 Endurance Test

Immediately upon completion of the performance verification test, the endurance test must commence. The system must be operated at varying rates for not less than 192 consecutive hours, at an average effectiveness level of 0.9998, to demonstrate proper functioning of the complete PCS. Continue the test on a day-to-day basis until performance standard is

met. The contractor is not allowed in the building during the endurance test. The system must respond as designed.

3.4 DEMONSTRATION

3.4.1 Training

Coordinate training requirements with the Contracting Officer. Provide video tapes, if available, of all training provided to the Government for subsequent use in training new personnel. Provide all training aids, texts, and expendable support material for a self-sufficient presentation shall be provided, the amount of which to be determined by the contracting officer.

3.4.1.1 Instructions to Government Personnel

Provide the services of competent instructors with minimum two-year field experience with the operation and maintenance of similar ASDs who will give full instruction to designated personnel in operation, maintenance, calibration, configuration, and programming of the complete control system. Orient the training specifically to the system installed. Instructors must be thoroughly familiar with the subject matter they are to teach. The number of training days of instruction furnished must be as specified. A training day is defined as eight hours of instruction, including two 15-minute breaks and excluding lunch time; Monday through Friday. Provide a training manual for each student at each training phase which describes in detail the material included in each training program. Provide one additional copy for archiving. Provide equipment and materials required for classroom training. Provide a list of additional related courses, and offers, noting any courses recommended. List each training course individually by name, including duration, approximate cost per person, and location of course. Unused copies of training manuals must be turned over to the Government at the end of last training session.

3.4.1.2 Operating Personnel Training Program

Provide one 2-hour training session at the site at a time and place mutually agreeable between the Contractor and the Government. Provide session to train 4 operation personnel in the functional operations of the system and the procedures that personnel will follow in system operation. This training shall include:

a. System overview

b. General theory of operation

c. System operation

d. Alarm formats

e. Failure recovery procedures

f. Troubleshooting

3.4.1.3 Engineering/Maintenance Personnel Training

Accomplish the training program as specified. Training must be conducted on site at a location designated by the Government. Provide a one-day training session to train four engineering personnel in the functional

operations of the system. This training must include:

a. System overview

b. General theory of operation

c. System operation

d. System configuration

e. Alarm formats

f. Failure recovery procedures

g. Troubleshooting and repair

h. Maintenance and calibration

i. System programming and configuration

-- End of Section --

SECTION 26 32 15.00

ENGINE-GENERATOR SET STATIONARY 15-2500 KW, WITH AUXILIARIES
05/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME)

ASME B16.1	(2020) Gray Iron Pipe Flanges and Flanged Fittings Classes 25, 125, and 250
ASME B16.3	(2016) Malleable Iron Threaded Fittings, Classes 150 and 300
ASME B16.5	(2020) Pipe Flanges and Flanged Fittings NPS 1/2 Through NPS 24 Metric/Inch Standard
ASME B16.9	(2018) Factory-Made Wrought Buttwelding Fittings
ASME B16.11	(2016) Forged Fittings, Socket-Welding and Threaded
ASME B16.21	(2016) Nonmetallic Flat Gaskets for Pipe Flanges
ASME B31.1	(2020) Power Piping
ASME B31.3	(2020) Process Piping
ASME BPVC SEC IX	(2017; Errata 2018) BPVC Section IX-Welding, Brazing and Fusing Qualifications
ASME BPVC SEC VIII D1	(2019) BPVC Section VIII-Rules for Construction of Pressure Vessels Division 1

ASSOCIATION OF EDISON ILLUMINATING COMPANIES (AEIC)

AEIC CS8	(2013) Specification for Extruded Dielectric Shielded Power Cables Rated 5 Through 46 kV

ASTM INTERNATIONAL (ASTM)

ASTM A53/A53M	(2020) Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
ASTM A106/A106M	(2019a) Standard Specification for

	Seamless Carbon Steel Pipe for High-Temperature Service
ASTM A126	(2004; R 2019) Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings
ASTM A181/A181M	(2014; R 2020) Standard Specification for Carbon Steel Forgings, for General-Purpose Piping
ASTM A193/A193M	(2020) Standard Specification for Alloy-Steel and Stainless Steel Bolting Materials for High-Temperature Service and Other Special Purpose Applications
ASTM A194/A194M	(2020a) Standard Specification for Carbon Steel, Alloy Steel, and Stainless Steel Nuts for Bolts for High-Pressure or High-Temperature Service, or Both
ASTM A234/A234M	(2019) Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service
ASTM B395/B395M	(2018) Standard Specification for U-Bend Seamless Copper and Copper Alloy Heat Exchanger and Condenser Tubes
ASTM D975	(2020) Standard Specification for Diesel Fuel Oils

ELECTRICAL GENERATING SYSTEMS ASSOCIATION (EGSA)

EGSA 101P	(1995) Performance Standard for Engine Driven Generator Sets

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 1	(2000; R 2011) General Principles for Temperature Limits in the Rating of Electric Equipment and for the Evaluation of Electrical Insulation
IEEE 43	(2013) Recommended Practice for Testing Insulation Resistance of Rotating Machinery
IEEE 48	(2020) Test Procedures and Requirements for Alternating-Current Cable Terminations Used on Shielded Cables Having Laminated Insulation Rated 2.5 kV through 765 kV or Extruded Insulation Rated 2.5 kV through 500 kV
IEEE 81	(2012) Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System

IEEE 100	(2000; Archived) The Authoritative Dictionary of IEEE Standards Terms
IEEE 115	(2019) Guide for Test Procedures for Synchronous Machines: Part I Acceptance and Performance Testing; Part II Test Procedures and Parameter Determination for Dynamic Analysis
IEEE 120	(1989; R 2007) Master Test Guide for Electrical Measurements in Power Circuits
IEEE 404	(2012) Standard for Extruded and Laminated Dielectric Shielded Cable Joints Rated 2500 V to 500,000 V
IEEE 484	(2019) Recommended Practice for Installation Design and Implementation of Vented Lead-Acid Batteries for Stationary Applications
IEEE 485	(2020) Recommended Practice for Sizing Lead-Acid Batteries for Stationary Applications
IEEE 519	(2014) Recommended Practices and Requirements for Harmonic Control in Electrical Power Systems
IEEE C2	(2017; Errata 1-2 2017; INT 1 2017) National Electrical Safety Code
IEEE C50.12	(2005; R 2010) Standard for Salient Pole 50 HZ and 60 Hz Synchronous Generators and Generation/Motors for Hydraulic Turbine Applications Rated 5 MVA and above
IEEE C57.13	(2016) Standard Requirements for Instrument Transformers
IEEE C57.13.1	(2006; R 2012) Guide for Field Testing of Relaying Current Transformers

INTERNATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)

NETA ATS	(2021) Standard for Acceptance Testing Specifications for Electrical Power Equipment and Systems

INTERNATIONAL ELECTROTECHNICAL COMMISSION (IEC)

IEC 60034-2A	(1974; ED 1.0) Rotating Electrical Machines Part 2: Methods for Determining Losses and Efficiency of Rotating Electrical Machinery from Tests (Excluding Machines for Traction Vehicles) Measurement of Losses by the Calorimetric Method

INTERNATIONAL ORGANIZATION FOR STANDARDIZATION (ISO)

ISO 3046	(2002, 2006, 2009, 2001) Reciprocating Internal Combustion Engines - Performance--Part 1, 3, 4, 5, 6
ISO 8528	(1993; R 2018) Reciprocating Internal Combustion Engine Driven Alternating Current Generator Sets--Part 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 12, 13

MANUFACTURERS STANDARDIZATION SOCIETY OF THE VALVE AND FITTINGS INDUSTRY (MSS)

MSS SP-58	(2018) Pipe Hangers and Supports - Materials, Design and Manufacture, Selection, Application, and Installation
MSS SP-70	(2011) Gray Iron Gate Valves, Flanged and Threaded Ends
MSS SP-71	(2018) Gray Iron Swing Check Valves, Flanged and Threaded Ends
MSS SP-80	(2019) Bronze Gate, Globe, Angle and Check Valves
MSS SP-85	(2011) Gray Iron Globe & Angle Valves Flanged and Threaded Ends

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA ICS 2	(2000; R 2020) Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 V
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures
NEMA MG 1	(2018) Motors and Generators
NEMA PB 1	(2011) Panelboards
NEMA PB 2	(2011) Deadfront Distribution Switchboards
NEMA WC 74/ICEA S-93-639	(2012) 5-46 kV Shielded Power Cable for Use in the Transmission and Distribution of Electric Energy
NEMA/ANSI C12.11	(2006; R 2019) Instrument Transformers for Revenue Metering, 10 kV BIL through 350 kV BIL (0.6 kV NSV through 69 kV NSV)

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 30	(2021; TIA 20-1; TIA 20-2) Flammable and Combustible Liquids Code
NFPA 37	(2021) Standard for the Installation and

	Use of Stationary Combustion Engines and Gas Turbines
NFPA 54	(2021) National Fuel Gas Code
NFPA 58	(2020; TIA 20-1; TIA 20-2; TIA 20-3) Liquefied Petroleum Gas Code
NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code
NFPA 99	(2021; TIA 20-1) Health Care Facilities Code
NFPA 110	(2022) Standard for Emergency and Standby Power Systems

SOCIETY OF AUTOMOTIVE ENGINEERS INTERNATIONAL (SAE)

SAE ARP892	(1965; R 1994) DC Starter-Generator, Engine
SAE J537	(2016) Storage Batteries

U.S. DEPARTMENT OF DEFENSE (DOD)

MIL-DTL-16884	(2017; Rev P) Fuel, Naval Distillate
MIL-STD-461	(2015; Rev G) Requirements for the Control of Electromagnetic Interference Characteristics of Subsystems and Equipment

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

40 CFR 60	Standards of Performance for New Stationary Sources

UNDERWRITERS LABORATORIES (UL)

UL 142	(2006; Reprint Jan 2021) UL Standard for Safety Steel Aboveground Tanks for Flammable and Combustible Liquids
UL 429	(2013; Reprint Mar 2021) Electrically Operated Valves
UL 467	(2013; Reprint Jun 2017) UL Standard for Safety Grounding and Bonding Equipment
UL 489	(2016; Rev 2019) UL Standard for Safety Molded-Case Circuit Breakers, Molded-Case Switches and Circuit-Breaker Enclosures
UL 1236	(2015; Reprint Feb 2021) UL Standard for Safety Battery Chargers for Charging Engine-Starter Batteries
UL 1437	(2006) Electrical Analog Instruments - Panel Board Types

1.2 RELATED MATERIALS

Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM, apply to this section, except as modified herein.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Engine-Generator Set and Auxiliary Equipment; G

Auxiliary Systems; G

Detailed Drawings; G

Acceptance; G

SD-03 Product Data

Harmonic Requirements; G

Engine-Generator Set Efficiencies; G

Emissions; G

filters; G

special tools; G

Remote Alarm Annunciator; G

Engine-Generator Parameter Schedule

Heat Exchanger

Generator

Manufacturer's Catalog

Site Welding

Spare Parts

Onsite Training

Vibration-Isolation

Posted Data and Instructions; G

Instructions; G

Experience

Field Engineer

General Installation

Exciter

SD-05 Design Data

Performance Criteria

Sound Limitations; G

Integral Main Fuel Storage Tank

Day Tank

Power Factor

Heat Exchanger

Time-Delay on Alarms

Cooling System

Vibration Isolation

Battery Charger

Capacity Calculations for Engine-Generator Set; G

Brake Mean Effective Pressure (BMEP) Calculations; G

Torsional Vibration Stress Analysis Computations; G

Capacity Calculations for Batteries; G

Turbocharger Load Calculations; G

SD-06 Test Reports

Performance Tests

Factory Inspection and Tests

Factory Tests

Onsite Inspection and Tests; G

Acceptance Checks and Tests; G

Functional Acceptance Tests; G

Maintenance Procedures; G

Operation and Maintenance Manuals; G

Inspections; G

Functional Acceptance Test Procedure; G

SD-07 Certificates

Cooling System

Vibration Isolation

Prototype Test

Reliability and Durability

Fuel System Certification; G

Start-Up Engineer; G

Instructor's Qualification Resume; G

Engine Emission Limits; G

Sound Limitations

Site Visit

Current Balance

Materials and Equipment

Factory Inspection and Tests

SD-09 Manufacturer's Field Reports

Engine Tests; G

Generator Tests; G

Assembled Engine-Generator Set Tests; G

SD-10 Operation and Maintenance Data

Preliminary Assembled Operation and Maintenance Manuals; G

Submit in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA and the paragraph ASSEMBLED OPERATION AND MAINTENANCE MANUALS.

SD-11 Closeout Submittals

Posted Data and Instructions; G

Training Plan; G

1.4 QUALITY ASSURANCE

1.4.1 Conformance to Codes and Standards

Where equipment is specified to conform to requirements of any code or standard such as UL, NEMA, etc., the design, fabrication and installation

must also conform to the code.

1.4.2 Site Welding

Weld structural members in accordance with Section 05 05 23.16 STRUCTURAL WELDING. For all other welding, qualify procedures and welders in accordance with ASME BPVC SEC IX.

a. Welding procedures qualified by others, and welders and welding operators qualified by a previously qualified employer may be accepted as permitted by ASME B31.1.

b. Submit a copy of qualifying procedures and a list of names and identification symbols of qualified welders and welding operators.

c. Submit a letter listing the welder qualifying procedures for each welder, complete with supporting data such as test procedures used, what was tested to, and a list of the names of all welders and their identification symbols.

d. Perform welder qualification tests for each welder whose qualifications are not in compliance with the referenced standards. Notify the Contracting Officer 24 hours in advance of qualification tests which must be performed at the work site, if practical.

e. The welder or welding operator must apply the personally assigned symbol near each weld made as a permanent record.

1.4.3 Vibration Limitation

Limit the maximum engine-generator set vibration in the horizontal, vertical, and axial directions to 6 mils (peak-peak RMS), with an overall velocity limit of 0.95 inches/second RMS, at rated speed for all loads through 110 percent of rated speed. The engine-generator set must be provided with vibration isolation in accordance with the manufacturer's standard recommendation. Where the vibration isolation system does not secure the base to the structure floor or unit foundation, provide seismic restraints in accordance with the seismic parameters specified.

1.4.4 Torsional Analysis

Submit torsional analysis including prototype testing or calculations which certify and demonstrate that no damaging or dangerous torsional vibrations will occur when the prime mover is connected to the generator, at synchronous speeds, plus/minus 10 percent.

1.4.5 Performance Data

Submit vibration isolation system performance data for the range of frequencies generated by the engine-generator set during operation from no load to full load and the maximum vibration transmitted to the floor. Also submit a description of seismic qualification of the engine-generator mounting, base, and vibration isolation.

1.4.6 Experience

Each component manufacturer must have a minimum of 3 years' experience in the manufacture, assembly and sale of components used with stationary engine-generator sets for commercial and industrial use. The

engine-generator set manufacturer/assembler must have a minimum of 3 years' experience in the manufacture, assembly and sale of stationary engine-generator sets for commercial and industrial use. Submit a statement showing and verifying these requirements.

1.4.7 Field Engineer

The engine-generator set manufacturer or assembler must furnish a qualified field engineer to supervise the complete installation of the engine-generator set, assist in the performance of the onsite tests, and instruct personnel as to the operational and maintenance features of the equipment. The field engineer must have attended the engine generator manufacturer's training courses on installation and operation and maintenance of engine generator sets. Submit a letter listing the qualifications, schools, formal training, and experience of the field engineer.

1.4.8 Detailed Drawings

Submit detailed drawings showing the following:

a. Base-mounted equipment, complete with base and attachments, including anchor bolt template and recommended clearances for maintenance and operation.

b. Starting system.

c. Fuel system.

d. Cooling system.

e. Exhaust system.

f. Electric wiring of relays, breakers, programmable controllers, and switches including single line and wiring diagrams.

g. Lubrication system, including piping, pumps, strainers, filters, heat exchangers for lube oil and turbocharger cooling, electric heater, controls and wiring.

h. Location, type, and description of vibration isolation devices for all applications.

i. The safety system, including wiring schematics.

j. One-line schematic and wiring diagrams of the generator, exciter, regulator, governor, and instrumentation.

k. Panel layouts.

l. Mounting and support for each panel and major piece of electrical equipment.

m. Engine-generator set rigging points and lifting instructions.

1.4.9 Auxiliary Systems Engine-Generator Set and Auxiliary Equipment Drawing Requirements

Submit drawings pertaining to the engine-generator set and auxiliary

equipment, including but not limited to the following:

a. Certified outline, general arrangement (setting plan), and anchor bolt details. Show total weight and center of gravity of assembled equipment on the steel sub-base.

b. Detailed elementary, schematic wiring, and interconnection diagrams of the engine starting system, jacket coolant heating system, engine protective devices, engine alarm devices, engine speed governor system, generator and excitation system, and other integral devices.

c. Detailed elementary, schematic wiring; and interconnection diagrams of the fuel system, starting battery system, engine-generator control panel, generator circuit breaker, and remote alarm annunciator.

d. Dimensional drawings or catalog cuts of exhaust silencers, radiator, fuel day tanks, fuel oil cooler, valves and pumps, intake filters, vibration isolators, and other auxiliary equipment not integral with the engine-generator set.

1.4.10 Auxiliary Systems Drawing Requirements

Submit drawings showing floor plan arrangement of exhaust, air intake, fuel oil cooler, and jacket coolant water systems including arrangement of piping and pipe sizes.

1.4.11 Vibration Isolation System Certification

Submit certification from the manufacturer that the vibration isolation system will reduce the vibration to the limits specified in the paragraph VIBRATION ISOLATION.

1.4.12 Fuel System Certification

When the fuel system requires a fuel oil cooler as described in the paragraph FUEL OIL COOLER, submit certification from the engine manufacturer that the fuel system design is satisfactory.

1.5 DELIVERY, STORAGE, AND HANDLING

Properly protect materials and equipment, in accordance with the manufacturers recommended storage procedures,before, during, and after installation. Protect stored items from the weather and contamination. During installation, cap piping and similar openings to keep out dirt and other foreign matter.

Deliver equipment on pallets or blocking wrapped in heavy-duty plastic, sealed to protect parts and assemblies from moisture and dirt. Protect and prepare batteries for shipment as recommended by the battery manufacturer. Store auxiliary equipment at the site in covered enclosures, protected from atmospheric moisture, dirt, and ground water.

1.6 EXTRA MATERIALS

Provide two sets of special tools and two sets of filters required for maintenance. Special tools are those that only the manufacturer provides, for special purposes, or to reach otherwise inaccessible parts. One handset must be provided for each electronic governor when required to indicate and/or change governor response settings. Furnish 4 liters one

gallon of identical paint used on engine-generator set in manufacturer's sealed container with each engine-generator set.

Wrenches and tools specifically designed and required to work on the new equipment, which are not commercially available as standard mechanic's tools, must be furnished to the Contracting Officer.

Provide proposed operating instructions for the engine-generator set and auxiliary equipment laminated between matte-surface thermoplastic sheets and suitable for placement adjacent to corresponding equipment. After approval, install operating instructions where directed.

1.7 MAINTENANCE SERVICES

Submit the operation and maintenance manuals and have them approved prior to commencing onsite tests.

1.7.1 Operation Manual

Provide three copies of the operation manual in 8-1/2 by 11 inch three-ring binders. Sections must be separated by heavy plastic dividers with tabs which identify the material in the section. Fold drawings with the title block visible, and placed in 8-1/2 by 11 inch plastic pockets with reinforced holes. The manual must include:

a. Step-by-step procedures for system startup, operation, and shutdown;

b. Drawings, diagrams, and single-line schematics to illustrate and define the electrical, mechanical, and hydraulic systems with their controls, alarms, and safety systems;

c. Procedures for interface and interaction with related systems to include automatic transfer switches .

1.7.2 Maintenance Manual

Provide three copies of the manufacturers standard maintenance manual . Separate each section by a heavy plastic divider with tabs. Fold drawings with the title block visible, and placed in plastic pockets with reinforced holes. The manual must include:

a. Procedures for each routine maintenance item.Procedures for troubleshooting.Factory-service, take-down overhaul, and repair service manuals, with parts lists.

b. The manufacturer's recommended maintenance schedule.

c. A component list which includes the manufacturer's name, address, type or style, model or serial number, rating, and catalog number for the major components.

d. A list of spare parts for each piece of equipment and a complete list of materials and supplies needed for operation.

1.7.3 Assembled Operation and Maintenance Manuals

The contents of the assembled operation and maintenance manuals must include the manufacturer's O&M information required by the paragraph SD-10, OPERATION AND MAINTENANCE DATA and the manufacturer's O&M

information specified in Section 26 36 23 AUTOMATIC TRANSFER SWITCHES AND BY-PASS/ISOLATION SWITCH.

a. Manuals must be in separate books or volumes, assembled and bound securely in durable, hard covered, water resistant binder, and indexed by major assembly and components in sequential order.

b. A table of contents (index) must be made part of the assembled O&M. The manual must be assembled in the order noted in table of contents.

c. The cover sheet or binder on each volume of the manuals must be identified and marked with the words, "Operation and Maintenance Manual."

1.8 SITE CONDITIONS

Protect the components of the engine-generator set, including cooling system components, pumps, fans, and similar auxiliaries when not operating and provide components capable of the specified outputs in the following environment:

a. Site Location: Eglin AFB

b. Site Elevation: 100 feet above mean sea level.

PART 2 PRODUCTS

2.1 SYSTEM REQUIREMENTS

a. Provide and install each engine-generator set complete and totally functional, with all necessary ancillary equipment to include: air filtration; starting system; generator controls, protection, and isolation; instrumentation; lubrication; fuel system; cooling system; and engine exhaust system. Each engine-generator set must satisfy the requirements specified in the Engine-Generator Parameter Schedule. Submit certification that the engine-generator set and cooling system function properly in the ambient temperatures specified.

b. Provide each engine-generator set consisting of one engine, one generator, and one exciter mounted, assembled, and aligned on one base; and all other necessary ancillary equipment which may be mounted separately. Assemble sets having a capacity of 750 kW or smaller and attach to the base prior to shipping. Sets over 750 kW capacity may be shipped in sections. Provide set components that are environmentally suitable for the locations shown and that are the manufacturer's standard product offered in catalogs for commercial or industrial use. Provide a generator strip heater for moisture control when the generator is not operating. Identify any nonstandard products or components and the reason for their use.

2.1.1 Engine-Generator Parameter Schedule

Engine-Generator Set and Auxiliary Equipment Capacity Calculations for Engine-Generator Set

ENGINE-GENERATOR PARAMETER SCHEDULE	
Identification	Make/Model
Electrical Characteristics	
Power Rating	Emergency Standby Gross bhp rating / Net brake power rating 500 kW at 0.8 power factor
Governor Type	Type Make / Model Isochronous
Overload Capacity (Prime applications only)	110 percent of Service Load for 1 hour in 12 consecutive hours
Service Load	415 kVA (maximum) 384 kVA (continuous)
Motor Starting kVA (Max.)	332 kVA
Power Factor	0.8 lagging
Engine-Generator Applications	stand-alone
Voltage Regulation (No Load to Full Load)(Stand-alone applications)	plus or minus 2 percent (maximum)
Voltage Bandwidth (steady state)	plus or minus 2 percent
Frequency	60 Hz
Voltage	480 volts
Phases	3 Phase, Wye
Minimum Generator Sub-transient Reactance	10 percent Sub-transient
Max Step Load Increase	100 percent of Service Load at .8 PF

ENGINE-GENERATOR PARAMETER SCHEDULE					
Frequency Bandwidth (steady state)	plus or minus 0.25 percent				
Frequency Regulation (droop) (No Load to Full Load)	3 percent (maximum)				
Frequency Bandwidth (steady state)	plus or minus 0.25 percent				
Reactances	Synchronous reactance, Xd Transient reactance, X'd Sub-transient reactance, X"d Negative sequence reactance, X2 Zero sequence reactance, Xo				
Capacity Calculations					
Calculations must verify that the engine-generator set power rating is adequate for the following load conditions:					
Lighting	10 kW				
Computer	kW				
Uninterruptible Power Supplies (UPS)	5 kVA, 24 pulse				
		Size (hp)			

ENGINE-GENERATOR PARAMETER SCHEDULE	
Capacity Calculations for Batteries	
Calculation must verify that the engine starting battery capacity exceeds dc power requirements.	
Mechanical Characteristics	
Engine Description	Strokes/cycle Number of cylinders Bore and Stroke, inches
Engine Speed	1800 rpm
Heat Exchanger Type	fin-tube (radiator)
Engine Cooling Type	water/ethylene glycol
Intercooler Type	Air-to-Air / Jacket Water
Induction Method	Naturally Aspirated / Turbocharged
Turbocharger	Make / Model
Max Time to Start and be Ready to Assume Load	10 seconds

ENGINE-GENERATOR PARAMETER SCHEDULE	
Engine-Generator Set Efficiencies	
Fuel Consumption	At 0.8 power factor, Gallons / hour for: 1 / 2 load 3 / 4 load Full Load
Generator Efficiency	At 0.8 power factor,(per cent) for: 1 / 2 load 3 / 4 load Full Load
Radiator Capacity	Coolant Type gpm coolant cfm air through radiator Btu per hr of heat exchange based on optimum coolant temperature to and from engine
Engine-Generator Set Emissions Data	
Exhaust Temperature	Degrees F at full load
Weight of Exhaust Gas	lb per hr at full load
Weight of Intake Air	lb per hr at full load
Total Heat Rejected	Btu per hr, at full load to: Jacket Coolant System Fuel Oil Cooling System
Emissions	lb per hr, at full load Total Suspended Particulate Particulate Matter with an average aerodynamic diameter of 10 microns Sulfur Dioxides Nitrogen Oxides (as NO2) Carbon Monoxide Volatile Organic Compounds
Visible Emissions	Percent opacity at full load
Brake Mean Effective Pressure (BMEP) Calculations	

ENGINE-GENERATOR PARAMETER SCHEDULE

Calculation must verify that the engine meets the specified maximum BMEP, as follows:

$$BMEP \ psi = \frac{(120{,}000 \times bkW) \times (792{,}000 \times bhp)}{(rpm \times cu.\ in.)}$$

Where:

bkW bhp = bkW' + bkW" bhp' + bhp"
bkW" bhp" is the Brake kW horsepower required by engine driven fan for cooling radiator or motor driven fan for cooling radiator.
bkW' bhp' = kW/GEN.EFF. kW/(GEN.EFF. times 0.746)
GEN.EFF. = Generator efficiency
cu. in. = Total engine piston displacement in cubic inches
rpm = Engine revolutions per minute
kW = Minimum power rating

Torsional Vibration Stress Analysis Computations

Torsional vibrational stresses in the crankshaft and generator shaft of assembled engine and driven generator must not exceed 5000 psi when engine is driving generator at rated speed while assembled unit is loaded to rated engine-generator set power. Computations must be based on a mathematical model of the assembled generator set provided or based on calculations using measured values from tests on a unit identical to the one provided. Calculations based on models of, or measured data from, the unassembled engine and generator will not be acceptable. Calculations must include:

a. A description of the system relating information pertinent to analysis such as operating speed range and identification plate data.

b. A mass elastic assembly drawing, showing the arrangement of the units in the generator set and dimensions of shafting, including minimum diameters (or section moduli) of shafting in the system.

c. A labeled line diagram of the mass elastic system indicating values of masses, stiffness, equivalent lengths, and equivalent diameters including basic assumptions and definition of terms.

d. Sample computations showing procedures used to obtain resulting stress values.

e. Computations indicating assembled engine-generator speed of 1800 rpm with assembly loaded to rated generator power and the resulting computed critical torsional stress values in the assembled engine crankshaft and generator shaft.

Turbocharger Load Calculations

ENGINE-GENERATOR PARAMETER SCHEDULE
NOTE: When the engine-generator set installation includes field installed exhaust system (i.e., the engine-generator set is installed internal to a building in lieu of in a self-contained outdoor enclosure), include the following paragraph. When the proposed exhaust system layout is different from that shown on the contract drawings, submit calculations showing that the external loads from the exhaust system such as weight and thermal expansion do not exceed the engine manufacturer's maximum allowed forces and moments on the turbocharger.

2.1.2 Rated Output Capacity

Provide each engine-generator-set with power equal to the sum of service load plus the machine's efficiency loss and associated ancillary equipment loads. Rated output capacity must also consider engine and/or generator oversizing required to meet requirements in paragraph Engine-Generator Parameter Schedule.

The engine must meet the specified maximum BMEP requirements at rated speed as calculated in accordance with the calculations in the engine-generator parameter schedule. The engine capacity must be based on the following:

a. Engine burning diesel fuel conforming to MIL-DTL-16884 or at an ambient temperature of 85 degrees F. For stationary engines operated in the United States, diesel fuel requirements are found in 40 CFR 60 Subpart IIII.

b. Engine cooled by a radiator fan mechanically driven by the engine or remote with a motor driven fan.

c. Engine cooled by coolant mixture of water and ethylene glycol, 50 percent by volume of each.

Maximum BMEP, psi			
	Naturally Aspirated	Turbocharged	Turbocharged and Intercooled
Engine speed, rpm:	1800		

2.1.2.1 Engine Emission Limits

Engine must be certified by the manufacturer to meet applicable EPA emission standards found in 40 CFR 60 Subpart IIII. In addition, engine must meet any applicable state or local emission requirements (ex: California SCAQMD).

2.1.2.2 Performance Class

The voltage and frequency behavior of the generator set must be in accordance with ISO 8528 operating limit values for performance Class G3.

2.1.3 Power Ratings

Power ratings must be in accordance with EGSA 101P.

2.1.4 Transient Response

The engine-generator set governor and voltage regulator must cause the engine-generator set to respond to the maximum step load changes such that output voltage and frequency recover to and stabilize within the operational bandwidth within the transient recovery time. The engine-generator set must respond to maximum step load changes such that the maximum voltage and frequency deviations from bandwidth are not exceeded.

2.1.5 Reliability and Durability

Each standby engine-generator set must have both an engine and a generator capable of delivering the specified power on a standby basis with an anticipated mean time between overhauls of no less than 5,000 hours operating with a load factor of 70 percent. Cite two like engines and two like generators that have performed satisfactorily in a stationary power plant, independent and separate from the physical location of the manufacturer's and assembler's facilities, for standby without any failure to start, including all periodic exercise. Provide like engines and generators that have had no failures resulting in downtime for repairs in excess of 72 hours during two consecutive years of service. Provide engines that are the same model, speed, bore, stroke, number and configuration of cylinders, and rated output capacity. Provide generators that are the same model, speed, pitch, cooling, exciter, voltage regulator and rated output capacity.

Submit a reliability and durability certification letter from the manufacturer and assembler to prove that existing facilities are and have been successfully utilizing the same components proposed to meet this specification, in similar service. Certification may be based on components, i.e. engines used with different models of generators and generators used with different engines, and does not exclude annual technological improvements made by a manufacturer in the basic standard-model component on which experience was obtained, provided parts interchangeability has not been substantially affected and the current standard model meets the performance requirements specified. Provide a list with the name of the installations, completion dates, and name and telephone number of a point of contact.

2.1.6 Engine-Generator Set Enclosure

Provide engine-generator set enclosures that are corrosion resistant and fully weather resistant. The enclosure must contain all set components and provide ventilation to permit operation at Service Load under secured conditions. Provide access doors to controls and equipment requiring periodic maintenance or adjustment. Provide removable panels for access to components requiring periodic replacement. The enclosure must be capable of being removed without disassembly of the engine-generator set or removal of components other than the exhaust system. The enclosure

must reduce the noise of the generator set to within the limits specified in the paragraph SOUND LIMITATIONS.

2.1.7 Vibration Isolation

Provide an engine-generator set with a vibration isolation system in accordance with the manufacturer's standard recommendation. Submit vibration isolation system performance data for the range of frequencies generated by the engine-generator set during operation from no load to full load and the maximum vibration transmitted to the floor plus description of seismic qualification of the engine-generator mounting, base, and vibration isolation. Submit torsional analysis including prototype testing or and calculations which certify and demonstrate that no damaging or dangerous torsional vibrations will occur when the prime mover is connected to the generator, at synchronous speeds, plus 10 percent. Design and qualify vibration isolation systems as an integral part of the base and mounting system in accordance with the seismic parameters specified. Where the vibration isolation system does not secure the base to the structure floor or unit foundation, provide seismic restraints in accordance with the seismic parameters specified.

2.1.8 Harmonic Requirements

Non-linear loads to be served by each engine-generator set are as indicated. The maximum linear load demand (kVA at PF) when non-linear loads will also be in use is as indicated.

2.1.9 Starting Time Requirements

Upon receipt of a signal to start, each engine generator set will start, reach rated frequency and voltage and be ready to assume load within the time specified. For standby sets used in emergency power applications, each engine generator set will start, reach rated frequency and voltage, and power will be supplied to the load terminals of the automatic transfer switch within the starting time specified.

2.2 NAMEPLATES

Provide the manufacturer's name, type or style, model or serial number and rating on a plate secured to the equipment for each major component of this specification. Provide plates and tags sized so that inscription is readily legible to operating or maintenance personnel and securely mounted to or attached in proximity of their identified controls or equipment. Lettering must be normal block lettering, a minimum of 0.25 inch high. As a minimum, provide nameplates for:

Engines	Relays
Generators	Transformers (CT & PT)
Regulators	Day tanks
Pumps and pump motors	Governors
Generator Breaker	Air Starting System

Economizers	Heat exchangers (other than base mounted)

Where the following equipment is not provided as a standard component by the engine generator set manufacturer, the nameplate information may be provided in the maintenance manual in lieu of nameplates.

Battery charger	Heaters
Switchboards	Exhaust mufflers
Switchgear	Silencers
Battery	Exciters

2.2.1 Materials

Construct ID plates and tags of 16 gage minimum thickness bronze or stainless steel sheet metal engraved or stamped with inscription. Construct plates and tags not exposed to the weather or high operational temperature of the engine of laminated plastic, 0.125 inch thick, matte white finish with black center core, with lettering accurately aligned and engraved into the core.

2.2.2 Control Devices and Operation Indicators

Provide ID plates or tags for control devices and operation indicators, including valves, off-on switches, visual alarm annunciators, gages and thermometers, that are required for operation and maintenance of provided mechanical systems. Plates or tags must be minimum of 0.5 inch high and 2 inches long and must indicate component system and component function.

2.2.3 Equipment

Provide ID plates of a minimum size of high and 5 inches long on provided equipment indicating the following information:

a. Manufacturer's name, address, type and model number, serial number, and certificate of compliance with applicable EPA mission standards;

b. Contract number and accepted date;

c. Capacity or size;

d. System in which installed; and

e. System which it controls.

2.3 SAFETY DEVICES

Exposed moving parts, parts that produce high operating temperatures, parts which may be electrically energized, and parts that may be a hazard to operating personnel must be insulated, fully enclosed, guarded, or fitted with other types of safety devices. Install safety devices such that proper operation of the equipment is not impaired.

2.4 MATERIALS AND EQUIPMENT

Submit certification stating that where materials or equipment are specified to comply with requirements of UL, written proof of such compliance has been obtained. The label or listing of the specified agency, or a written certificate from an approved, nationally recognized testing organization equipped to perform such services, stating that the items have been tested and conform to the requirements and testing methods of the specified agency are acceptable as proof.

2.4.1 Circuit Breakers, Low Voltage

UL 489.

2.4.2 Filter Elements

Provide the manufacturer's standard fuel-oil, lubricating-oil, and combustion-air filter elements.

2.4.3 Instrument Transformers

NEMA/ANSI C12.11.

2.4.4 Revenue Metering

IEEE C57.13.

2.4.5 Pipe (Fuel/Lube-Oil, Compressed Air, Coolant, and Exhaust)

ASTM A53/A53M, or ASTM A106/A106M steel pipe. Pipe smaller than 2 inches must be Schedule 80. Pipe 2 inches and larger must be Schedule 40.

2.4.5.1 Flanges and Flanged Fittings

ASTM A181/A181M, Class 60, or ASME B16.5, Grade 1, Class 150.

2.4.5.2 Pipe Welding Fittings

ASTM A234/A234M, Grade WPB or WPC, Class 150 or ASME B16.11, 3000 lb.

2.4.5.3 Threaded Fittings

ASME B16.3, Class 150.

2.4.5.4 Valves

MSS SP-80, Class 150.

2.4.5.5 Gaskets

Manufacturer's standard.

2.4.6 Pipe Hangers

MSS SP-58.

2.4.7 Electrical Enclosures

NEMA ICS 6.

2.4.7.1 Switchboards

NEMA PB 2.

2.4.7.2 Panelboards

NEMA PB 1.

2.4.8 Electric Motors

Provide electric motors that conform to the requirements of NEMA MG 1. Motors must have sealed ball bearings and a maximum speed of 1800 rpm. Motors used indoors must have drip-proof frames; enclose those that are used outside. Alternating current motors larger than 1/2 Hp must be of the squirrel-cage induction type for operation on 208 volts or higher, 60 Hz, and three-phase power. Alternating current motors 1/2 Hp or smaller, must be suitable for operation on 120 volts, 60 Hz, and single-phase power. Direct current motors must be suitable for operation on 125 volts.

2.4.9 Motor Controllers

Provide motor controllers and starters that conform to the requirements of NFPA 70 and NEMA ICS 2.

2.5 ENGINE

Each engine must operate on No. 2-D diesel fuel conforming to ASTM D975, must be designed for stationary applications and must be complete with ancillaries. The engine must be a standard production model shown in the manufacturer's catalog describing and depicting each engine-generator set and all ancillary equipment in sufficient detail to demonstrate complete specification compliance. The engine must be naturally aspirated, supercharged, or turbocharged. The engine must be 2- or 4-stroke-cycle and compression-ignition type. The engine must be vertical in-line, V- or opposed-piston type, with a solid cast block or individually cast cylinders. The engine must have a minimum of two cylinders. Opposed-piston type engines must have more than four cylinders. Each block must have a coolant drain port. Equip each engine with an over-speed sensor.

ISO 3046. Diesel engines must be four-cycle naturally aspirated, or turbocharged, or turbocharged and intercooled; vertical in-line or vertical Vee type; designed for stationary service. Engines must be capable of immediate acceleration from rest to normal speed without intermediate idle/warm up period or pre-lubrication to provide essential electrical power. Two-cycle engines are not acceptable.

2.5.1 Sub-base Mounting

Mount each engine-generator set on a structural steel sub-base sized to support the engine, generator, and necessary accessories, auxiliaries and control equipment to produce a complete self-contained unit as standard with the manufacturer. Design the structural sub-base to properly support the equipment and maintain proper alignment of the engine-generator set in the specified seismic zone. In addition, provide sub-base with both lifting rings and jacking pads properly located to facilitate shipping and installation of the unit. Factory align engine and generator on the sub-base and securely bolt into place in accordance with the

manufacturer's standard practice. Crankshaft must have rigid coupling for connection to the generator.

2.5.2 Assembly

Completely shop assemble each engine-generator set on its structural steel sub-base. Paint entire unit with manufacturer's standard paints and colors. After factory tests and before shipping, thoroughly clean and retouch painting as necessary to provide complete protection.

2.5.3 Turbocharger

If required by the manufacturer to meet the engine-generator set rating, provide turbine type driven by exhaust gas from engine cylinders, and direct connected to the blower supplying air to the engine intake manifold.

2.5.4 Intercooler

Provide manufacturer's standard intercooler for engine size specified.

2.5.5 Crankcase Protection

2.5.6 Miscellaneous Engine Accessories

Provide the following engine accessories where the manufacturer's standard design permits:

a. Piping on engine to inlet and outlet connections, including nonstandard companion flanges.

b. Structural steel sub-base and vibration isolators, foundation bolts, nuts, and pipe sleeves.

c. Level jack screws or shims, as required.

d. Rails, chocks, and shims for installation of sub-base on the foundation.

e. Removable guard, around fan. Support guard, on engine sub-base, to suit manufacturer's standard.

2.5.7 Intercooler

Provide manufacturer's standard intercooler for engine size specified.

2.6 FUEL SYSTEM

Provide fuel system conforming to the requirements of NFPA 30 and NFPA 37 and containing the following elements.

2.6.1 Pumps

Fuel transfer pumps may be mounted on the day tank. Pumps must be duplex, horizontal, positive displacement. Direct-connect pump to motor through a flexible coupling. Equip each pump with a bypass relief valve, if not provided with an internal relief valve. Provide motor and controller in accordance with the paragraphs ELECTRIC MOTORS and MOTOR CONTROLLERS, respectively.

2.6.1.1 Main Pump

Provide engines with an engine driven pump. The pump must supply fuel at a minimum rate sufficient to provide the amount of fuel required to meet the performance indicated within the parameter schedule. Base the fuel flow rate on meeting the load requirements and all necessary recirculation.

2.6.1.2 Auxiliary Fuel Pump

Provide auxiliary fuel pumps to maintain the required engine fuel pressure, if either required by the installation or indicated on the drawings. The auxiliary pump must be driven by a dc electric motor powered by the starting/station batteries. Automatically actuate the auxiliary pump by a pressure-detecting device.

2.6.2 Fuel Filter

Provide a minimum of one full-flow fuel filter for each engine. The filter must be readily accessible and capable of being changed without disconnecting the piping or disturbing other components. Mark the inlet and outlet connections of the filter.

Provide intake filter assemblies for each engine of the oil bath or dry type, as standard with the manufacturer. Filters must be capable of removing a minimum of 92 percent of dirt and abrasive 3 microns and larger from intake air. Size filters to suit engine requirements at 100 percent of rated full load. Design unit for field access for maintenance purposes.

2.6.3 Relief/Bypass Valve

Provide a relief/bypass valve to regulate pressure in the fuel supply line, return excess fuel to a return line and prevent the build-up of excessive pressure in the fuel system.

2.6.4 Integral Main Fuel Storage Tank

Provide each engine with an integral main fuel tank. Each tank must be factory installed and provided as an integral part of the generator manufacturer's product. Provide each tank with connections for fuel supply line, fuel return line, local fuel fill port, gauge, vent line, and float switch assembly. Provide a fuel return line cooler as recommended by the manufacturer and assembler. The temperature of the fuel returning to the tank must be below the flash point of the fuel. Mount the tank within the enclosure for each engine-generator set provided with weatherproof enclosures. The fuel fill line must be accessible without opening the enclosure.

a. All Tanks: UL 142. Provide integral in skid double wall (110 percent containment) fuel tanks with a minimum capacity of 72 hours of engine-generator set operation at full-rated load . Epoxy coat day tanks inside and prime and paint outside. Construct tanks of not less than 3/16 inch steel plate with welded joints and necessary stiffeners on exterior of tank. Provide a braced structural steel framework support. Weld tank top tight. Provide 4 1/2 inch square inspection port with a 2 inch NPT fill connection and spill box. Provide proper normal and emergency venting for the primary tank and emergency venting only for the secondary tank / containment basin in accordance with UL 142 requirements. Provide an overflow or return line between the fuel day tank and storage tank in accordance with

NFPA 37.

b. Float Switches for Day Tanks: Provide tank-top mounted or external float cage, single-pole, single-throw type designed for use on fuel oil tanks. Arrange high level float switches to close on rise of liquid level, and low level float switches to close on fall of liquid level. Mount float cage units with isolating and drain valves. Contacts must be suitable for the station battery voltage.

(1) Critical low level float switch which must activate at 5 percent of normal liquid level must shut engine off.

(2) Low-low level float switch which must activate alarm at 30 percent of normal liquid level.

(3) Low level float switch which must open the fuel oil solenoid valve and start the remote fuel transfer pump at 75 percent of normal liquid level.

(4) High level float switch which must close the fuel oil solenoid valve and stop the remote fuel transfer pump at 90 percent of normal liquid level.

(5) Critical high level float switch which must activate alarm at 95 percent of normal liquid level.

c. Leak Detector Switch for All Tanks: Actuates when fuel is detected in containment basin, stops fuel transfer pump, and closes the fuel oil solenoid valve.

d. Control Panel for All Tanks: Provide NEMA ICS 6, Type 3R, enclosed control panel for each day tank. Control panel must include the following accessories.

(1) Power available LED (green).

(2) Critical low fuel alarm contacts for shut down of engine.

(3) Low-low level fuel alarm LED.

(4) Low-low level fuel alarm contracts for remote annunciator.

(5) Critical high level fuel alarm LED.

(6) Leak detecting alarm LED.

(7) Alarm horn.

e. Tank Gages for All Tanks: Provide buoyant force type gages for fuel tanks with dial indicator not less than 4 inches in size and arranged for top mounting. Calibrate each reading dial or scale for its specific tank to read from empty to full, with intermediate points of 1/4, 1/2, and 3/4.

f. Integral Base Tanks Used as Primary Tank: Provide a 2 inch opening at the tank fill port, fitted an overfill prevention valve (OPV). Additionally, the fill opening must be perpendicular to the tank in order to allow operation of the OPV. Integral base tank must be sized and configured such that the filling and venting nozzles are outside

the generator cabinet for ease of accessibility, inspection, and maintenance. Level gage must be in the line of sight from the fill port.

g. Integral Base Tanks Located Inside Buildings. The tank vents must discharge outside the building in accordance with NFPA 30 and NFPA 37. The fill pipe must terminate outside the building. The fill pipe connection point must be housed in a sealed spill box. High level alarms or level gauges used as overfill protection mechanisms must annunciate at the fill connection point. Provide an overfill prevention valve (OPV) at the tank with a check valve mounted on the fill line in the spill box. The fill connection point must be labeled with tank contents and capacity.

h. External tanks (all non-integral base tanks) are specified in Section 33 56 10 FACTORY-FABRICATED FUEL STORAGE TANKS.

2.6.4.1 Fuel Transfer Pump

Fuel transfer pumps may be mounted on the day tank. Pump must be duplex, horizontal, positive displacement. Direct-connect pump to motor through a flexible coupling. Equip each pump with a bypass relief valve, if not provided with an internal relief valve. Provide motor and controller in accordance with the paragraphs ELECTRIC MOTORS and MOTOR CONTROLLERS, respectively.

2.6.4.2 Capacity

Each tank must have capacity to supply fuel to the engine for an uninterrupted 72 period at 100 percent rated load without being refilled.

2.6.4.3 Local Fuel Fill

Each local fuel fill port on the day tank must have a screw-on cap.

2.6.4.4 Fuel Level Controls

Provide tanks with a float-switch assembly to perform the following functions:

a. Activate the "Low Fuel Level" alarm at 70 percent of the rated tank capacity.

b. Activate the "Overfill Fuel Level" alarm at 95 percent of the rated tank capacity.

2.6.4.5 Arrangement

Integral tanks may allow gravity flow into the engine. Gravity flow tanks and any tank that allows a fuel level above the fuel injectors must have an internal or external factory installed valve located as near as possible to the shell of the tank. The valve must close when the engine is not operating. Provide integral day tanks with any necessary pumps to supply fuel to the engine as recommended by the generator set manufacturer. The fuel supply line from the tank to the manufacturer's standard engine connection must be welded pipe.

2.6.5 Day Tank

Provide engine with integral day tank. Submit calculations for the capacity of each day tank, including allowances for recirculated fuel, usable tank capacity, and duration of fuel supply. Provide connections for fuel supply line, fuel return line, fuel overflow line, local fuel fill port, gauge, vent line, drain line, and float switch assembly for control for each day tank. Provide a fuel return line cooler as recommended by the manufacturer and assembler. The temperature of the fuel returning to the day tank must be below the flash point of the fuel. Install a temperature sensing device in the fuel supply line, fuel overflow line, local fuel fill port, gauge, vent line, drain line, and float switch assembly for control. Mount the day tank within the enclosure for each engine-generator set with weatherproof enclosures. The fuel fill line must be accessible without opening the enclosure.

2.6.5.1 Capacity, Prime

Provide day tank with the capacity to supply fuel to the engine for an uninterrupted 72 period at 100 percent rated load without being refilled, plus any fuel which may be returned to the main fuel storage tank. Submit calculations for the capacity of each day tank, including allowances for recirculated fuel, usable tank capacity, and duration of fuel supply. The calculation of the capacity of each day tank must incorporate the requirement to stop the supply of fuel into the day tank at a "High" level mark of 90 percent of the ultimate volume of the tank.

2.6.5.2 Capacity, Standby

Provide day tank with the capacity as shown .

2.6.5.3 Drain Line

Each day tank drain line must be accessible and equipped with a shutoff valve. Arrange self-supporting day tanks to allow drainage into a 12 inch tall bucket.

2.6.5.4 Local Fuel Fill

Each local fuel fill port on the day tank must have a screw-on cap.

2.6.5.5 Fuel Level Controls

Provide day tank with a float-switch assembly to perform the following functions:

a. When the main storage tank is located higher than the day tank, open the solenoid valve located on the fuel supply line entering the day tank and start the supply of fuel into the day tank when the fuel level is at the "Low" level mark, 75 percent of the rated tank capacity.

b. When the main storage tank is located higher than the day tank, stop the supply of fuel into the day tank and close the solenoid valve located on the fuel supply line entering the day tank when the fuel level is at 90 percent of the rated tank capacity.

c. Activate the "Overfill Fuel Level" alarm at 95 percent of the rated tank capacity.

d. Activate the "Low Fuel Level" alarm at 70 percent of the rated tank capacity.

e. Activate the automatic fuel supply shut-off valve located on the fill line of the day tank and shut down the fuel pump which supplies fuel to the day tank at 95 percent of the rated tank capacity. Stop the flow of fuel before any fuel can be forced into the fuel overflow line.

2.6.5.6 Fuel Oil Solenoid Valve

UL 429. Provide electric solenoid type control valve for each day tank. Solenoid must be rated for starting battery voltage. Valve body must have a minimum working pressure rating of 150 psig at 200 degrees F. Valve must be capable of passing 0 to 10 gpm of fuel oil. Valves must be two-way, direct acting, normally closed (open when energized, closed when de-energized), with stainless steel body and resilient seat material. Solenoid enclosures must be NEMA ICS 6, Type 1. Body connections must be same size as connecting piping. Valve must be in line before the fuel pump.

2.6.5.7 Arrangement

Integral day tanks may allow gravity flow into the engine. Provide gravity flow tanks with an internal or external valve located as near as possible to the shell of the tank. The valve must close when the engine is not operating. Provide integral day tanks with any necessary pumps to supply fuel to the engine as recommended by the generator set manufacturer. Arrange the overflow connection and the fuel supply line for integral day tanks which do not rely upon gravity flow so that the highest possible fuel level is below the fuel injectors. Arrange self-supporting day tanks so that the fuel level in the day tank remains above the suction port of the engine driven fuel pump or be provided with a transfer pump to provide fuel to the engine driven pump. Arrange the overflow connection and fuel supply line so that the highest possible fuel level is below the fuel injectors. When the main fuel storage tanks are located below the day tank, provide a check valve in the fuel supply line entering the day tank. When the main fuel storage tanks are located above the day tank, install a solenoid valve in the fuel supply line entering the day tank. The solenoid valve must be in addition to the automatic fuel shut off valve. The fuel supply line from the day tank to the manufacturer's standard engine connection must be welded pipe.

2.6.6 Fuel Oil Cooler

Provide an air cooled fuel oil cooler if the temperature of the fuel returned to the tank from the engine will cause overheating of the tank fuel above the maximum fuel temperature allowed by the engine manufacturer when operating at maximum rated generator power output and low fuel level in the tank. The fuel oil cooler must be furnished by the engine manufacturer for the application and the installation must be complete including piping and power requirements.

2.7 LUBRICATION

Provide engine with a separate lube-oil system conforming to NFPA 30 and NFPA 37. Pressurize each system by engine-driven pumps. Regulate system pressure as recommended by the engine manufacturer. Provide a pressure relief valve on the crankcase for closed systems. Vent the crankcase in

accordance with the manufacturer's recommendation. Do not vent the crankcase to the engine exhaust system. Crankcase breathers, if provided on engines installed in buildings or enclosures, must be piped to vent to the outside. The system must be readily accessible for service such as draining, refilling, etc. Each system must permit addition of oil and have oil-level indication with the set operating. The system must utilize an oil cooler as recommended by the engine manufacturer.

2.7.1 Lube-Oil Filter

Provide one full-flow filter for each pump. The filter must be readily accessible and capable of being changed without disconnecting the piping or disturbing other components. Mark inlet and outlet connections.

2.7.2 Lube-Oil Sensors

Equip each engine with lube-oil pressure sensors located downstream of the filters and provide signals for required indication and alarms. Submit two complete sets of filters, required for maintenance, supplied in a suitable storage box. Provide these filters in addition to filters replaced after testing.

2.7.3 Precirculation Pump

Provide a motor-driven precirculation pump powered by the station battery, complete with motor starter, if recommended by the engine manufacturer.

2.8 COOLING SYSTEM

Provide each engine with its own cooling system to operate automatically while its engine is running. The cooling system coolant must use a combination of water and ethylene-glycol sufficient for freeze protection at the minimum winter outdoor temperature specified. The maximum temperature rise of the coolant across each engine must not exceed that recommended below. Submit a letter which certifies that the engine-generator set and cooling system function properly in the ambient temperature specified, stating the following values:

a. The maximum allowable inlet temperature of the coolant fluid.

b. The minimum allowable inlet temperature of the coolant fluid through the engine.

c. The maximum allowable temperature rise in the coolant fluid through the engine.

d. The minimum allowable inlet fuel temperature.

2.8.1 Coolant Pumps

Provide centrifugal coolant pumps. Each engine must have an engine-driven primary pump. Provide secondary pumps that are electric motor driven and have automatic controllers. Control raw-water circulating pump by manual-off-automatic controllers and must be engine driven.

2.8.2 Heat Exchanger

Provide heat exchanger with the size and capacity to limit the maximum allowable temperature rise in the coolant across the engine to that

recommended and submitted for the maximum summer outdoor design temperature and site elevation. Submit manufacturer's data to quantify heat rejected to the space with the engine generator set at rated capacity. Provide heat exchangers that are corrosion resistant, suitable for service in ambient conditions of application.

2.8.2.1 Fin-Tube-Type Heat Exchanger (Radiator)

Heat exchanger may be factory coated with corrosion resistant film, provided that corrective measures are taken to restore the heat rejection capability of the radiator to the initial design requirement via over sizing, or other compensating methods. Provide internal surfaces that are compatible with liquid fluid coolant used. Materials and coolant are subject to approval by the Contracting Officer. Provide heat exchangers that are pressure type incorporating a pressure valve, vacuum valve and a cap. Design caps for pressure relief prior to removal. Provide heat exchanger and cooling system that is capable of withstanding a minimum pressure of 7 psi and protect with a strong grille or screen guard. Provide heat exchanger with at least two tapped holes; equip one tapped hole with a drain cock, and plug the rest.

Provide for each engine-generator set, as standard with the manufacturer.

a. Design Conditions: Each radiator unit must have ample capacity to remove not less than the total Btu per hour of heat rejected by its respective engine at 100 percent full-rated load to the jacket water, fuel oil, and lubricating oil system, and intercooler. Radiator capacity must be rated at optimum temperature of coolant leaving the engine and intercooler as recommended by the engine manufacturer Pressure drop through the radiator must not exceed 6 psi when circulating the maximum required coolant flow. Radiator air velocity must be a maximum of 1500 feet per minute.

b. Engine Mounted Radiator Construction: Radiator fan must direct airflow from the engine outward through the radiator. Fan must be V-belt driven directly from the engine crankshaft. Radiator fan must have sufficient capacity to meet design conditions . Fan static capacity must be adjusted to suit the ductwork furnished. Cooling section must have a tube and fin-type core consisting of copper or copper base alloy tubes with nonferrous fins. Select engine-driven fans for quiet vibration-free operation. Make provision for coolant expansion either by self-contained expansion tanks or separately mounted expansion tanks, as standard with the manufacturer. Provide suitable guards for each fan and drive.

c. Remote Radiator Construction: Provide radiators as described above, except radiators must be remotely piped and provided with electric motor driven fan. Drive must be multiple V-belt or reduction gears. Expansion tanks must be separately mounted. Air flow must be vertical or horizontal as indicated. Interlock fan with engine operation such that fan must operate when engine operates when recommended by engine manufacturer. Provide controls and control devices complete which must cycle fan on and off based upon coolant temperature. Provide motors and controllers in accordance with the paragraphs ELECTRIC MOTORS and MOTOR CONTROLLERS, respectively. Motors, controllers, contactors, and disconnects must conform to Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

d. Coolant solution must be a mixture of clean water and ethylene glycol,

50 percent by volume each. Provide an anti-freeze solution tester suitable for the mixture.

Field installed jacket coolant water piping must conform to the following:

a. Piping: Provide seamless steel pipe, Schedule 40, conforming to ASTM A53/A53M, Grade A.

b. Fittings and Flanges: Fittings, 1 1/2 inches or smaller, must be malleable iron conforming to ASME B16.3 for Class 300 threaded type. Fittings, 2 inches and larger, must be steel butt welding conforming to ASME B16.9. Utilize either ASME B16.1 or Class A of ASTM A126 for Class 125 cast-iron flanged fittings. Flanges must be Class 150 slip-on forged steel welding flanges in accordance with ASME B16.5, with material in accordance with ASTM A181/A181M, Grade I. Provide flat face flanges for connecting to Class 125 standard cast-iron valves, fittings, and equipment connections.

c. Valves

(1) Gate Valves: For valves, 1 1/2 inches and smaller, provide double disk, rising stem, inside screw, union bonnet type, Class 125 bronze material conforming to MSS SP-80. For valves, 2 inches and larger, provide double-disk, parallel seat type, hydraulic-rated, Class 125, outside screw and yoke type with flanged ends and bronze trim conforming to MSS SP-70. Provide stem packing of material compatible with the system coolant.

(2) Globe Valves: For valves, 1 1/2 inches and smaller, provide rising stem, inside screw, union bonnet type, Class 125 bronze valves conforming to MSS SP-80. For valves, 2 inches and larger, provide Class 125 cast iron, flanged ends, bronze trim globe valves conforming to MSS SP-85. Valves must have renewable composition or cast iron discs compatible with the system coolant.

(3) Check Valves: MSS SP-71 or MSS SP-80, swing check type.

d. Hangers and Supports: MSS SP-58.

e. Piping Sleeves: Provide where piping passes through masonry or concrete walls, floors, roofs, and partitions. Place sleeves during construction. Unless indicated otherwise, pipe sleeves must comply with following requirements: Sleeves in outside walls below and above grade, in floor, or in roof slabs, must be standard weight zinc coated steel pipe. Sleeves in partitions must be zinc coated sheet steel having a nominal weight of not less than 0.90 pound per square foot. Space between piping insulation and the sleeve must be not less than 0.25 inch. Sleeves must be held securely in proper position and location during construction. Sleeves must be of sufficient length to pass through entire thickness of walls, partitions, or slabs. Sleeves in floor slabs must extend 2 inches above the finished floor. Space between the pipe and the sleeve must be firmly packed with insulation and caulked at both ends of the sleeve with plastic waterproof cement.

2.8.2.2 Shell and U-Tube Type Heat Exchanger

Provide multiple pass shell, U-tube type heat exchanger. Exchanger must operate with low temperature water in the shell and high temperature water in the tubes. Provide exchangers that are constructed in accordance with

ASME BPVC SEC VIII D1 and certified with ASME stamp secured to the unit. Provide U-tube bundles that are completely removable for cleaning and tube replacement and free to expand with the shell. Construct shells of seamless steel pipe or welded steel. Tubes must be cupronickel or inhibited admiralty, constructed in accordance with ASTM B395/B395M, suitable for the temperatures and pressures specified. Tubes less than 3/4 inch unless otherwise indicated are not acceptable. Design shell side and tube side for 150 psig working pressure and factory tested at 300 psig. Locate high and low temperature water and pressure relief connections in accordance with the manufacturers standard practice. Water connections larger than 3 inches must be ASME Class 150 flanged. Water pressure loss through clean tubes must be as recommended by the engine manufacturer. Minimum water velocity through tubes must be 1 fps and assure turbulent flow. Provide one or more pressure relief valves for each heat exchanger in accordance with ASME BPVC SEC VIII D1. The aggregate relieving capacity of the relief valves must be not less than that required by the above code. Install discharge from the valves indicated. Install the relief valves on the heat exchanger shell. Install a drain connection with 3/4 inch hose bib at the lowest point in the system near the heat exchanger. Install additional drain connection with threaded cap or plug wherever required for thorough draining of the system.

2.8.3 Expansion Tank

The cooling system must include an air expansion tank which will accommodate the expanded water of the system generated within the normal operating temperature range, limiting the pressure increase at all components in the system to the maximum allowable pressure at those components. The tank must be suitable for operating temperature of 250 degrees F and a working pressure of 125 psi. Provide welded steel tank , tested and stamped in accordance with ASME BPVC SEC VIII D1 for the stated working pressure. Do not use a bladder type tank. Support the tank by steel legs or bases for vertical or steel saddles for horizontal installation.

2.8.4 Thermostatic Control Valve

Provide a modulating type, thermostatic control valve in the coolant system to maintain the coolant temperature range submitted in paragraph SUBMITTALS.

2.8.5 Temperature Sensors

Equip each engine with coolant temperature sensors. Provide temperature sensors with signals for pre-high and high indication and alarms.

2.9 SOUND LIMITATIONS

Submit sound power level data for the packaged unit operating at 100 percent load in a free field environment. The data should demonstrate compliance with the sound limitation requirements of this specification. Submit certification from the manufacturer stating that the sound emissions meet the specification. Do not exceed the following sound pressure levels in any of the indicated frequencies when measured in a free field at a radial distance of 22.9 feet 7 meters at 45 degrees apart in all directions when operating at 100 percent load.

Frequency Band (Hz)	Maximum Acceptable Sound Level (Decibels)
31	87
63	87
125	77
250	70
500	64
1,000	61
2,000	60
4,000	60
8,000	62

2.10 AIR INTAKE EQUIPMENT

Locate filters and silencers in locations that are convenient for servicing. Provide high-frequency filter type silencers and locate in the air intake system as recommended by the engine manufacturer. Provide silencer to reduce the noise level at the air intake so that the indicated pressure levels specified in paragraph SOUND LIMITATIONS will not be exceeded. A combined filter-silencer unit meeting requirements for the separate filter and silencer items may be provided. Provide copper expansion elements in air-intake lines.

Provide intake filter assemblies for each engine of the oil bath or dry type, as standard with the manufacturer. Filters must be capable of removing a minimum of 92 percent of dirt and abrasive 3 microns and larger from intake air. Size filters to suit engine requirements at 100 percent of rated full load. Design unit for field access for maintenance purposes.

2.11 EXHAUST SYSTEM

Provide a separate and complete system for each engine. Support piping to minimize vibration. Where a V-type engine is provided, use a V-type connector, with necessary flexible sections and hardware, to connect the engine exhaust outlets.

2.11.1 Flexible Sections and Expansion Joints

Provide a flexible section at each engine and an expansion joint at each muffler. Provide flexible sections and expansion joints that have flanged connections. Provide flexible sections made of convoluted seamless tube without joints or packing. Provide bellows type expansion joints. Provide stainless steel expansion and flexible elements suitable for engine exhaust gas at the maximum exhaust temperature that is specified by the engine manufacturer. Provide expansion and flexible elements that are capable of absorbing vibration from the engine and compensation for thermal expansion and contraction.

2.11.2 Exhaust Muffler

Provide a chamber type exhaust muffler. Provide welded steel muffler designed for outside mounting. Provide eyebolts, lugs, flanges, or other items as necessary for support in the location and position indicated. Do not exceed the engine manufacturer's recommended pressure drop. Outside mufflers must be zinc coated or painted with high temperature 400 degrees F resisting paint. The muffler and exhaust piping together must reduce the noise level to less than the maximum acceptable level listed for sound limitations in paragraph SOUND LIMITATIONS. Provide muffler with a drain valve, nipple, and cap at the low-point of the muffler.

A critical class silencer must be provided for each engine which will reduce the exhaust sound spectrum by the following listed values at a 75 foot radius from the outlet, with generator set loaded to rated capacity and clear weather. Inlet and outlet connections must be flanged.

Octave Band Center Frequency (Hertz)								
Minimum Silencer Attenuation Decibels	63	125	250	500	1000	2000	4000	8000
Critical Class	15	32	37	36	30	36	37	37

2.11.3 Exhaust Piping

Slope horizontal sections of exhaust piping downward away from the engine to a drip leg for collection of condensate with drain valve and cap. Changes in direction must be long radius. Insulate exhaust piping, mufflers and silencers installed inside any building in accordance with paragraph THERMAL INSULATION and covered to protect personnel. Provide vertical exhaust piping with a hinged, gravity-operated, self-closing, rain cover.

Field installed exhaust piping must conform to the following:

a. Exhaust Piping: Provide flanges for connections to engines, exhaust mufflers, and flexible connections. Provide steel pipe conforming to ASTM A53/A53M for each engine complete with necessary fittings, flanges, gaskets, bolts, and nuts. Exhaust piping must be Schedule 40 pipe for 12 inches and smaller, standard weight for sizes 14 inches through 24 inches, and 0.25 inch wall thickness for sizes larger than 24 inches. Flanges must be Class 150 slip-on forged steel welding flanges in accordance with ASME B16.5, with material in accordance with ASTM A181/A181M, Grade I. Fittings must be butt welding conforming to ASTM A234/A234M, with wall thickness same as adjoining piping. Fittings must be of same material and wall thickness as pipe. Built-up miter welded fittings may be used. Miter angles of each individual section must not exceed 22.5 degrees total and not more than 11.25 degrees relative to the axis of the pipe at any one cut. Gaskets for exhaust piping must be of high temperature asbestos-free material suitable for the service and must be ASME B16.21, composition ring, 0.0625 inch thick. Bolting material for exhaust flanges must be alloy-steel bolt-studs conforming to ASTM A193/A193M, Grade B7 bolts and alloy-steel nuts conforming to ASTM A194/A194M, Grade 7. Bolts must be of sufficient length to obtain full bearing on

the nuts and must project not more than two full threads beyond the nut. Provide stainless steel counterbalance type rain caps at termination of each exhaust pipe.

b. Expansion (Flexible) Joints: Provide sections of multiple corrugated stainless steel expansion joints with liners in the engine exhaust piping for each engine to absorb expansion strains and vibration transmitted to the piping. Flexible joints must be suitable for operation at 200 degrees F above normal exhaust gas temperature at 100 percent load, 10,000 cycles, minimum. Joints must be flanged and located between engine exhaust manifold and exhaust piping, must be the same size as exhaust piping size, and must be designed and constructed for engine exhaust service.

c. Hangers and Supports: MSS SP-58.

d. Piping Sleeves: Provide where piping passes through masonry or concrete walls, floors, roofs, and partitions. Sleeves must be placed during construction. Unless indicated otherwise, pipe sleeves must comply with following requirements: sleeves in outside walls below and above grade, in floor, or in roof slabs, must be standard weight zinc coated steel pipe. Sleeves in partitions must be zinc coated sheet steel having a nominal weight of not less than 0.90 pound per square foot. Space between piping insulation and the sleeve must not be less than 0.25 inch. Sleeves must be held securely in proper position and location during construction. Sleeves must be sufficient length to pass through entire thickness of walls, partitions, or slabs. Sleeves in floor slabs must extend 2 inches above the finished floor. Space between the pipe and the sleeve must be firmly packed with insulation and caulked at both ends of the sleeve with plastic waterproof cement.

e. Piping Insulation: Provide exhaust piping insulation in accordance with Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS.

2.12 PYROMETER

Provide a pyrometer, multi-point selector switch, and individual thermocouples with calibrated leads to show the temperature of the combined exhaust. For a supercharged engine, provide additional points, thermocouples and leads to show the temperature in the turbocharger exhaust gas outlet and combustion air discharge passages. Graduated scale length less than 6 inches is not acceptable. Provide double pole selector switch with an "off" position, one set of points for each thermocouple, and suitable indicating dial. Calibrate the pyrometer, thermocouples, leads and compensating devices to show true exhaust temperature within plus or minus 1 percent above the highest temperature encountered at 110 percent load conditions.

2.13 EMISSIONS

The finished installation must comply with Federal, state, and local regulations and restrictions regarding the limits of emissions, as listed here: . Submit certification from the engine manufacturer stating that the engine exhaust emissions meet the federal, state, and local regulations and restrictions specified. At a minimum this certification must include emission factors for criteria pollutants including nitrogen oxides, carbon monoxide, particulate matter, sulfur dioxide, non-methane hydrocarbon, and for hazardous air pollutants (HAPs).Contractor shall be

responsible for all generator required air quality paperwork.

2.14 STARTING SYSTEM

Provide starting system for standby engine generator sets used in emergency applications in accordance with NFPA 99 and NFPA 110and as follows.

2.14.1 Controls

Provide an engine control switch with functions including: run/start (manual), off/reset, and, automatic mode. Provide start-stop logic for adjustable cycle cranking and cool-down operation. Arrange the logic for manual starting and fully automatic starting in accordance with paragraph AUTOMATIC ENGINE-GENERATOR-SET SYSTEM OPERATION. Provide electrical starting systems with an adjustable cranking limit device to limit cranking periods from 1 second up to the maximum duration.

2.14.2 Capacity

Provide starting system with sufficient capacity, at the maximum outdoor summer temperature specified to crank the engine without damage or overheating. The system must provide a minimum of three cranking periods with 15 second intervals between cranks. Each cranking period must have a maximum duration of 15 seconds. Starting must be accomplished using an adequately sized dc starter system with a positive shift solenoid to engage the starter motor and to crank the engine continuously for 60 seconds without overheating.

2.14.3 Electrical Starting

Manufacturers recommended dc system, utilizing a negative circuit ground. Starting motors must be in accordance with SAE ARP892.

2.14.3.1 Battery

Provide a starting battery system including the battery, battery rack, intercell connectors, spacers, automatic battery charger with overcurrent protection, metering and relaying. Provide battery in accordance with SAE J537. Size critical system components (rack, protection, etc.) to withstand the seismic acceleration forces specified. Provide lead-acid battery with sufficient capacity, at the minimum outdoor and maximum outdoor temperature specified, to provide the specified cranking periods. Valve-regulated lead-acid batteries are not acceptable.

Provide maintenance free, sealed, lead-acid, SAE Type D engine starting batteries. Batteries must have sufficient capacity to provide 60 seconds of continuous cranking of the engine in an ambient temperature of 40 degrees F.

2.14.3.2 Battery Charger

Provide a current-limiting battery charger, conforming to UL 1236, that automatically recharges the batteries. Submit battery charger sizing calculations. The charger must be capable of an equalize charging rate for recharging fully depleted batteries within 24 hours and a floating charge rate for maintaining the batteries at fully charged condition. Provide an ammeter to indicate charging rate. Provide a voltmeter to indicate charging voltage. Provide a timer for the equalize charging-rate

setting. A battery is considered to be fully depleted when the output voltage falls to a value which will not operate the engine generator set and its components.

Provide 120 volt ac, enclosed, automatic equalizing, dual-rate, solid-state, constant voltage type battery charger with automatic ac line compensation. DC output must be voltage regulated and current limited. Charger must have two ranges, float and equalize, and must provide continuous taper charging. The charger must have a continuous output rating of not less than 10 amperes and must be sized to recharge the engine starting batteries in a minimum of 8 hours while providing the control power needs of the engine-generator set. Enclosure must be NEMA ICS 6, Type 1 . The following accessories must be included:

a. DC ammeter

b. DC voltmeter

c. Equalize light

d. AC on light

e. Low voltage light

f. High voltage light

g. Equalize test button/switch

h. AC circuit breaker

i. Low dc voltage alarm relay

j. High dc voltage alarm relay

k. Current failure relay

l. AC power failure relay

2.14.4 Storage Batteries

Provide storage batteries of suitable rating and capacity to supply and maintain power for the remote alarm annunciator for a period of 90 minutes minimum without the voltage applied falling below 87.5 percent of normal. Provide a 120 volt ac automatic battery charger.

2.14.5 Starting Aids

Provide one or more of other following methods to assist engine starting.

2.14.5.1 Glow Plugs

Design glow plugs to provide sufficient heat for combustion of fuel within the cylinders to guarantee starting at an ambient temperature of -25 degrees F.

2.14.5.2 Jacket-Coolant Heaters

Mount a thermostatically controlled electric heater in the engine coolant jacketing to automatically maintain the coolant within plus or minus 3

degrees F of the control temperature. The heater must operate independently of engine operation so that starting times are minimized. Power for the heaters must be 120 volts ac. Include necessary equipment, piping, controls, wiring, and accessories.

2.14.5.2.1 Prime Rated Sets

The control temperature must be the higher of the manufacturer's recommended temperature or the minimum coolant inlet temperature of the engine recommended in paragraph SUBMITTALS.

2.14.5.2.2 Standby Rated Sets

The control temperature must be the temperature recommended by the engine manufacturer to meet the starting time specified at the minimum winter outdoor temperature.

2.14.5.3 Lubricating-Oil Heaters

Mount a thermostatically controlled electric heater in the engine lubricating-oil system to automatically maintain the oil temperature within plus or minus 3 degrees F of the control temperature. The heater must operate independently of engine operation so that starting times are minimized. Power for the heaters must be 120 volts ac.

2.14.6 Exerciser

Provide exerciser in accordance with Section 26 36 23 AUTOMATIC TRANSFER SWITCH AND BY-PASS/ISOLATION SWITCH.

2.15 GOVERNOR

Provide a forward acting type engine speed governor system. Steady-state frequency band and frequency regulation (droop) must be in accordance with the operating limit values of the performance class specified in the paragraph PERFORMANCE CLASS.

Provide engine with a governor which maintains the frequency within a bandwidth of the rated frequency, over a steady-state load range of zero to 100 percent of rated output capacity. Configure the governor for safe manual adjustment of the speed/frequency during operation of the engine-generator set, without special tools, from 90 to 110 percent of the rated speed/frequency, over a steady state load range of 0 to 100 percent or rated capacity. Submit two complete sets of special tools required for maintenance (except for electronic governor handset). Special tools are those that only the manufacturer provides, for special purposes, or to reach otherwise inaccessible parts. Provide a suitable tool box for tools. Provide one handset for each electronic governor when required to indicate and/or change governor response settings. Maintain the midpoint of the frequency bandwidth at the same value for steady-state loads over the range of zero to 100 percent of rated output capacity for isochronous governors.

2.16 GENERATOR

Provide synchronous type, one or two bearing, generator conforming to the performance criteria in NEMA MG 1, equipped with winding terminal housings in accordance with NEMA MG 1, equipped with an amortisseur winding, and directly connected to the engine. Submit calculations of the engine and

generator output power capability, including efficiency and parasitic load data. Provide Class H insulation.

a. Select NEMA MG 1, Part 16, standby duty, and temperature rise of 130 degrees C for engine-generator sets which are expected to operate for less than 300 hours per year. Select NEMA MG 1, Part 22, continuous duty, and temperature rise of 105 degrees C for engine-generator sets expected to operate 300 hours or greater per year or rated 300 kW and above.

b. Select 2/3 pitch design option for engine-generator sets rated 300 kW and above.

c. Select 10-12 lead re-connectable for engine-generator sets rated 300 kW to 800 kW.

d. For applications requiring high SCR loading or in harsh environments laden with salts and chemicals, select vacuum pressure impregnation (VPI) insulated coils. When engine-generator sets are rated 800 kW and larger, also select form wound coils.

e. Provide salient-pole type, ac, brushless-excited, revolving field, air-cooled, self-ventilated, drip-proof guarded, coupled type, synchronous generator conforming to NEMA MG 1, Part 16 , and IEEE C50.12. Generator must be rated for standby duty at 100 percent of the power rating of the engine-generator set as specified in paragraph ENGINE-GENERATOR SET RATINGS AND PERFORMANCE. Temperature rise of each of the various parts of the generator must not exceed 130 degrees C as measured by resistance, based on a maximum ambient temperature of 40 degrees C. Winding insulation must be Class H.

f. Stator: Stator windings must be 2/3 pitch design , 10-12 lead re-connectable .

g. Rotor: The rotor must have connected amortisseur windings.

h. Generator Space Heater: Provide 120 volt ac heaters. Heater capacity must be as recommended by the generator manufacturer to aid in keeping the generator insulation dry.

i. Grounding: Provide non-corrosive steel grounding pads located at two opposite mounting legs.

j. Filters: Provide manufacturer's standard generator cooling air filter assembly.

k. Design generator to protect against mechanical, electrical and thermal damage due to vibration, 25 percent overspeeds, or voltages and temperatures at a rated output capacity of 110 percent for prime applications and 100 percent for standby applications.

l. Provide generator ancillary equipment meeting the short circuit requirements of NEMA MG 1. Select drip-proof guarded option for generators without weatherproof enclosures.

m. Submit manufacturer's standard data for each generator (prototype data at the specified rating or above is acceptable), listing the following information:

(1) Direct-Axis sub-transient reactance (per unit).

(2) The generator kW rating and short circuit current capacity (both symmetric and asymmetric).

2.16.1 Current Balance

At 100 percent rated output capacity, and load impedance equal for each of the 3 phases, the permissible current difference between any 2 phases must not exceed 2 percent of the largest current on either of the 2 phases. Submit certification stating that the flywheel has been statically and dynamically balanced and is capable of being rotated at 125 percent of rated speed without vibration or damage.

2.16.2 Voltage Balance

At any balanced load between 75 and 100 percent of rated output capacity, the difference in line-to-neutral voltage among the 3 phases must not exceed 1 percent of the average line-to-neutral voltage. For a single phase load condition, consisting of 25 percent load at unity power factor placed between any phase and neutral with no load on the other 2 phases, the maximum simultaneous difference in line-to-neutral voltage between the phases must not exceed 3 percent of rated line to neutral voltage. The single-phase load requirement must be valid utilizing normal exciter and regulator control. The interpretation of the 25 percent load for single phase load conditions means 25 percent of rated current at rated phase voltage and unity power factor.

2.16.3 Waveform

The deviation factor of the line-to-line voltage at zero load and at balanced rated output capacity must not exceed 10 percent. The RMS of all harmonics must be less than 5.0 percent and that of any one harmonic less than 3.0 percent of the fundamental at rated output capacity. Design and configure engine-generator to meet the total harmonic distortion limits of IEEE 519.

2.17 EXCITER

Provide brushless generator exciter. Provide semiconductor rectifiers that have a minimum safety factor of 300 percent for peak inverse voltage and forward current ratings for all operating conditions, including 110 percent generator output at 104 degrees F ambient. The exciter and regulator in combination must maintain generator-output voltage within the limits specified.

Provide a brushless excitation system consisting of an exciter and rotating rectifier assembly , and permanent magnet generator integral with the generator and a voltage regulator. Insulation class for parts integral with the generator must be as specified in paragraph GENERATOR. System must provide a minimum short circuit of 300 percent rated engine-generator set current for at least 10 seconds. Steady state voltage regulation must be in accordance with the operating limit values of the performance class specified in the paragraph PERFORMANCE CLASS.

a. Exciter and Rotating Rectifier Assembly: Rectifiers must be provided with surge voltage protection.

b. Permanent Magnet Generator: Provide a voltage spike suppression

device for permanent magnet generator (PMG) excitation systems.

c. Voltage Regulator: Voltage regulator must be solid state or digital, automatic, three-phase sensing, volts per hertz type regulator. Regulator must receive its input power from a PMG. Voltage variation for any 40 degree C change over the operating temperature range must be less than plus or minus 1.0 percent. Operating temperature must be minus 40 degree C to plus 70 degree C. Voltage adjust range must be plus to minus 5.0 percent of nominal. Inherent regulator features must include over excitation shutdown.

2.17.1 Electromagnetic Interference (EMI) Suppression

Provide as an integral part of the generator and excitation system, EMI suppression complying with MIL-STD-461.

2.18 VOLTAGE REGULATOR

Provide a solid-state voltage regulator, separate from the exciter, for each generator. Maintain the voltage within a bandwidth of the rated voltage, over a steady-state load range of zero to 100 percent of rated output capacity. Configure regulator for safe manual adjustment of the engine-generator voltage output without special tools, during operation, from 90 to 110 percent of the rated voltage over the steady state load range of 0 to 100 percent of rated output capacity. Regulation drift exceeding plus or minus 0.5 percent for an ambient temperature change of 68 degrees F is not acceptable. Reactive droop compensation or reactive differential compensation must load share the reactive load proportionally between sets during parallel operation. Provide voltage regulator with a maximum droop of 2 percent of rated voltage over a load range from 0 to 100 percent of rated output capacity and automatically maintain the generator output voltage within the specified operational bandwidth.

2.19 GENERATOR ISOLATION AND PROTECTION

Provide necessary devices for electrical protection and isolation of each engine-generator set and its ancillary equipment. The generator circuit breaker (IEEE Device 52) ratings must be consistent with the generator rated voltage and frequency, with continuous, short circuit withstand, and interrupting current ratings to match the generator capacity. Provide electrically operated generator circuit breaker. Mount a set of surge capacitors at the generator terminals. Provide monitoring and control devices as specified in paragraph GENERATOR PANEL.

The generator circuit breaker must comply with UL 489 requirements for molded case, adjustable thermal magnetic trip type circuit breaker. The circuit breaker continuous current rating must be adequate for the power rating of the engine-generator set and the circuit breaker must be rated to withstand the short circuit current provided by the generator set. Provide circuit breaker in a NEMA ICS 6, Type 1 enclosure mounted on the engine-generator set.

2.19.1 Devices

Provide switches, circuit breakers, switchgear, fuses, relays, and other protective devices as specified in Section 26 28 01.00 10 COORDINATED POWER SYSTEM PROTECTION.

Furnish with respective pieces of equipment. Motors, controllers,

contactors, and disconnects must conform to Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Provide electrical connections under Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Provide controllers and contactors with maximum of 120-volt control circuits, and auxiliary contacts for use with controls furnished. When motors and equipment furnished are larger than size indicated, the cost of providing additional electrical service and related work must be included under this section.

2.20 SAFETY SYSTEM

Provide and install devices, wiring, remote panels, and local panels, etc., as a complete system to automatically activate the appropriate signals and initiate the appropriate actions. Provide a safety system with a self-test method to verify its operability. Provide alarm signals that have manual acknowledgment and reset devices. The alarm signal systems must reactivate for new signals after acknowledgment is given to any signal. Configure the systems so that loss of any monitoring device will be dealt with as an alarm on that system element.

2.20.1 Audible Signal

Provide audible alarm signal sound at a frequency of 70 Hz at a volume of 75 dB at 10 feet. The sound must be continuously activated upon alarm and silenced upon acknowledgment. Locate signal devices as shown.

2.20.2 Visual Signal

The visual alarm signal must be a panel light. The light must be normally off, activated to be blinking upon alarm. The light must change to continuously lit upon acknowledgement. If automatic shutdown occurs, the display must maintain activated status to indicate the cause of failure and must not be reset until cause of alarm has been cleared and/or restored to normal condition. Shutdown alarms must be red; all other alarms must be amber.

2.20.3 Alarms and Action Logic

2.20.3.1 Shutdown

Accomplish simultaneous activation of the audible signal, activation of the visual signal, stopping the engine, and opening the generator main circuit breakers.

2.20.3.2 Problem

Accomplish activation of the visual signal.

2.20.4 Safety Indications and Shutdowns

Provide a local alarm panel with the following shutdown and alarm functions in accordance with NFPA 99 NFPA 110 level 1 mounted either on or adjacent to the engine generator set.

A remote alarm panel is required for audible alarms, e.g., in the control room.

Indicator Function (at battery voltage)	NFPA 99 Level 1 CV S RA	NFPA 110 Level 1 CV S RA	NFPA 110 Level 2 CV S RA
Overcrank	X X X	X X X	X X O
Low water temperature	X NA X	X NA X	X NA O
High engine temperature pre-alarm	X NA X	X NA X	O NA NA
High engine temperature	X X X	X X X	X X O
Low lube oil pressure pre-alarm	X NA X	NA NA NA	NA NA NA
Low lube oil pressure	X X X	X X X	X X O
Overspeed	X X X	X X X	X X O
Low fuel main tank	X NA X	X NA X	O NA O
Low coolant level	X O X	X O X	X O X
EPS supplying load	X NA NA	X NA NA	O NA NA
Control switch not in automatic position	X NA X	X NA X	X NA X
High battery voltage	X NA NA	X NA NA	O NA NA
Low cranking voltage	X NA X	X NA X	O NA NA
Low voltage in battery	X NA NA	X NA NA	O NA NA
Battery charger ac failure	X NA NA	X NA NA	O NA NA
Lamp test	X NA NA	X NA NA	X NA NA
Contacts for local and remote common alarm	X NA X	X NA X	X NA X
Audible alarm silencing switch	NA NA X	NA NA X	NA NA O
Low starting air pressure	X NA NA	X NA NA	O NA NA
Low starting hydraulic pressure	X NA NA	X NA NA	O NA NA
Air shutdown damper when used	X X X	X X X	X X O

Indicator Function (at battery voltage)	NFPA 99 Level 1 CV S RA	NFPA 110 Level 1 CV S RA	NFPA 110 Level 2 CV S RA
Remote emergency stop	NA X NA	NA X NA	NA X NA

Symbology:
CV: Control panel-mounted visual.
S: Shutdown of EPS indication.
RA: Remote audible.
Symbology:
CV: Control panel-mounted visual.
S: Shutdown of EPS indication.
RA: Remote audible.
X: Required.
O: Optional.
NA: Not applicable.

2.20.5 Time-Delay on Alarms

For startup of the engine-generator set, install time-delay devices bypassing the low lubricating oil pressure alarm during cranking, and the coolant-fluid outlet temperature alarm. Submit the magnitude of monitored values which define alarm or action set points, and the tolerance (plus and/or minus) at which the devices activate the alarm or action for items contained within the alarm panels. The lube-oil time-delay device must return its alarm to normal status after the engine starts. The coolant time-delay device must return its alarm to normal status 5 minutes after the engine starts.

2.21 SYNCHRONIZING PANEL

Provide panel as specified in paragraph PANELS and provide controls, gauges, meters, and displays to include:

a. Frequency meters, dial type, with a range of 90 to 110 percent of rated frequency. Do not use vibrating-reed type meters . One must monitor generator output frequency ("Generator Frequency Meter") and the other must monitor the frequency of the parallel source ("Bus Frequency Meter").

b. Voltmeters, ac, dial type, 3-phase, with 4-position selector switch for the generator output ("Generator Volt Meter") and for the parallel power source ("Bus volt meter").

c. Automatic synchronizer.

d. Manual synchronizing controls.

e. Indicating lights for supplementary indication of synchronization.

f. Synchroscope.

g. Wattmeter, indicating.

2.22 PANELS

Each panel must be of the type and kind necessary to provide specified functions. Mount panels on the engine-generator set base by vibration/shock absorbing type mountings . Mount instruments flush or semiflush. Provide convenient access to the back of panels to facilitate maintenance. Calibrate instruments using recognized industry calibration standards. Provide a panel identification plate identifying the panel function. Provide a plate identifying the device and its function for each instrument and device on the panel. Provide switch plates identifying the switch-position function.

2.22.1 Enclosures

Design enclosures for the application and environment, conforming to NEMA ICS 6. Locking mechanisms must be keyed alike.

Provide for each engine-generator set and fabricate from zinc coated or phosphatized and shop primed 16 gage minimum sheet steel in accordance with the manufacturer's standard design. Provide a complete, weatherproof enclosure for the engine, generator, and auxiliary systems and equipment. Support exhaust piping and silencer so that the turbocharger is not subjected to exhaust system weight or lateral forces generated in connecting piping that exceed the engine manufacturer's maximum allowed forces and moments. The housing must have sufficient louvered openings to allow entrance of outside air for engine and generator cooling at full load. Design louvered openings to exclude driving rain and snow. Provide properly arranged and sized, hinged panels in the enclosure to allow convenient access to the engine, generator, and control equipment for maintenance and operational procedures. Provide hinged panels with spring type latches which must hold the panels closed securely and will not allow them to vibrate. Brace the housing internally to prevent excessive vibration when the set is in operation

2.22.2 Analog

Provide analog electrical indicating instruments in accordance with UL 1437 with semi-flush mounting. Switchboard, switchgear, and control-room panel-mounted instruments must have 250 degree scales with an accuracy of not less than 99 percent. Unit-mounted instruments must be the manufacturer's standard with an accuracy of not less than 98 percent. The instrument's operating temperature range must be minus 4 to plus 158 degrees F. Distorted generator output voltage waveform of a crest factor less than 5 must not affect metering accuracy for phase voltages, hertz and amps.

2.22.3 Electronic

Electronic indicating instruments must be true RMS indicating instruments, 100 percent solid state, state-of-the-art, microprocessor controlled to provide specified functions. Provide control, logic, and function devices that are compatible as a system, sealed, dust and water tight, and that utilize modular components with metal housings and digital instrumentation. Provide an interface module to decode serial link data from the electronic panel and translate alarm, fault and status conditions to set of relay contacts. Instrument accuracy less than 98 percent for unit mounted devices and 99 percent for control room, panel mounted devices, throughout a temperature range of minus 4 to 158 degrees F is not

acceptable. Provide LED or back lit LCD data display. Additionally, the display must provide indication of cycle programming and diagnostic codes for troubleshooting. Numeral height must be 0.5 inch.

2.22.4 Parameter Display

Provide indication or readouts of the tachometer, lubricating-oil pressure, ac voltmeter, ac ammeter, frequency meter, and safety system parameters. Specify a momentary switch for other panels.

2.23 SURGE PROTECTION

Electrical and electronic components must be protected from, or designed to withstand the effects of surges from switching and lightning.

2.24 AUTOMATIC ENGINE-GENERATOR-SET SYSTEM OPERATION

Provide fully automatic operation for the following operations: engine-generator set starting and load transfer upon loss of normal source; retransfer upon restoration of the normal source; sequential starting; paralleling, and load-sharing for multiple engine-generator sets; and stopping of each engine-generator set after cool-down. Devices must automatically reset after termination of their function.

2.24.1 Automatic Transfer Switch

Provide automatic transfer switches in accordance with Section 26 36 23 AUTOMATIC TRANSFER SWITCH AND BY-PASS/ISOLATION SWITCH.

2.24.2 Monitoring and Transfer

Provide devices to monitor voltage and frequency for the normal power source and each engine-generator set, and control transfer from the normal source and retransfer upon restoration of the normal source. Describe functions, actuation, and time delays as described in Section 26 36 23 AUTOMATIC TRANSFER SWITCH AND BY-PASS/ISOLATION SWITCH.

2.24.3 Automatic Paralleling and Loading of Engine-Generator Sets

Provide an automatic loading system to load and unload engine-generator sets in the sequence indicated. Monitor the system load and cause additional engine-generator sets to start, synchronize, and be connected in parallel with the system bus with increasing load. Actuation of the additional engine-generator set start logic must occur when the load exceeds a percentage set-point of the operating set's rating for a period of approximately 10 seconds. Provide an adjustable set-point range from 50 to 100 percent. When the system load falls below the percentage set-point of the operating set's rating for a period of approximately , the controller must unload and disconnect engine-generator sets from the system, stopping each engine-generator set after cool-down.

2.25 MANUAL ENGINE-GENERATOR-SET SYSTEM OPERATION

Provide complete facilities for manual starting and testing of each set without load, loading and unloading of each set, and synchronization of each set with an energized bus.

2.26 STATION BATTERY SYSTEM

Provide a station battery system including the battery, battery rack, spacers, automatic battery charger and distribution panelboard with overcurrent protection, metering and relaying. Size components to withstand the seismic acceleration forces specified. Provide batteries that have a rated life of 20 years and a manufacturer's 5-year, no cost replacement guarantee.

2.26.1 Battery

Provide lead-acid battery sized in accordance with IEEE 485 and conforming to the requirements of IEEE 484. Valve-regulated lead-acid batteries are not acceptable.

2.26.2 Battery Charger

Furnish a current-limiting, 208-volt battery charger to automatically recharge the batteries. Provide a charger that is capable of an equalize charging rate for recharging fully depleted batteries within 8 hours and a floating-charge rate for maintaining the batteries in a fully charged condition. Equip the charger with a low-voltage alarm relay, 0- to 24-hour equalizing timer, an ammeter to indicate charging rate, and necessary circuit breakers. The charger must conform to the requirements of UL 1236. A battery is considered to be fully depleted when the voltage falls to a level incapable of operating the equipment loads served by the battery.

2.27 BASE

Provide a steel base. Design the base to rigidly support the engine-generator set, ensure permanent alignment of rotating parts, be arranged to provide easy access to allow changing of lube-oil, and ensure that alignment is maintained during shipping and normal operation. The base must permit skidding in any direction during installation and must withstand and mitigate the affects of synchronous vibration of the engine and generator. Provide base with suitable holes for anchor bolts and jacking screws for leveling.

2.28 THERMAL INSULATION

Provide thermal insulation as specified in Section 23 07 00 THERMAL INSULATION FOR MECHANICAL SYSTEMS.

2.29 PAINTING AND FINISHING

Clean, prime and paintthe engine-generator set in accordance with the manufacturer's standard color and practice.

2.30 FACTORY INSPECTION AND TESTS

Submit six complete reproducible copies of the factory inspection result on the checklist format specified below. Perform the factory tests on each engine-generator set. The component manufacturer's production line test is acceptable as noted. Run each engine-generator set for at least 1 hour at rated output capacity prior to inspections. Complete inspections and make all necessary repairs prior to testing. Use engine generator controls and protective devices that are provided by the generator set manufacturer as part of the standard package for factory tests. When

controls and switchgear are not provided as part of the generator set manufacturer's standard package, the actual controls and protective devices provided for the project are not required to be used during the factory test. The Contracting Officer may provide one or more representatives to witness inspections and tests.

2.30.1 Factory Inspection

Perform inspections prior to beginning and after completion of testing of the assembled engine-generator set. Look for leaks, looseness, defects in components, proper assembly, etc. and note any item found to be in need of correction as a necessary repair. Use the following checklist for the inspection:

INSPECTION ITEM	GOOD	BAD	NOTES
Drive belts			
Governor and adjustments			
Engine timing mark			
Starting motor			
Starting aids			
Coolant type and concentration			
Radiator drains			
Block coolant drains			
Coolant fill level			
All coolant line connections			
All coolant hoses			
Combustion air filter			
Combustion air silencer			
Lube oil type			
Lube oil sump drain			
Lube-oil filter			
Lube-oil-level indicator			
Lube-oil-fill level			
All lube-oil line connections			

INSPECTION ITEM	GOOD	BAD	NOTES
All lube-oil lines			
Fuel type and amount			
All fuel-line connections			
All fuel lines			
Fuel filter			
Coupling and shaft alignment			
Voltage regulators			
Battery-charger connections			
All wiring connections			
Instrumentation			
Hazards to personnel			
Base			
Nameplates			
Paint			
Exhaust-heat recovery unit			
Switchboard			
Switchgear			

2.30.2 Factory Tests

Submit a letter giving notice of the proposed dates of factory inspections and tests at least 14 days prior to beginning tests, including:

a. A detailed description of the manufacturer's procedures for factory tests at least 14 days prior to beginning tests.

b. Six copies of the Factory Test data described below in 8-1/2 by 11 inch binders having a minimum of 3 rings from which material may readily be removed and replaced, including a separate section for each test. Separate sections by heavy plastic dividers with tabs. Provide full size (8-1/2 by 11 inch minimum) data plots showing grid lines, with full resolution.

(1) A detailed description of the procedures for factory tests.

(2) A list of equipment used, with calibration certifications.

(3) A copy of measurements taken, with required plots and graphs.

(4) The date of testing.

(5) A list of the parameters verified.

(6) The condition specified for the parameter.

(7) The test results, signed and dated.

(8) A description of adjustments made.

On engine-generator set tests where the engine and generator are required to be connected and operated together, the load power factor must be the power factor specified in the engine generator set parameter schedule . For engine-generator set with dual-fuel operating capability, perform the following tests using the primary fuel type . Perform electrical measurements in accordance with IEEE 120. Temperature limits in the rating of electrical equipment and for the evaluation of electrical insulation must be in accordance with IEEE 1. In the following tests where measurements are to be recorded after stabilization of an engine-generator set parameter (voltage, frequency, current, temperature, etc.), stabilization is considered to have occurred when measurements are maintained within the specified bandwidths or tolerances, for a minimum of four consecutive readings. Tests specifically for the generator may be performed utilizing any prime mover.

a. Insulation Resistance for Stator and Exciter Test, IEEE 115 and IEEE 43, to the performance criteria in NEMA MG 1, Part 22. Generator manufacturer's production line test is acceptable.

b. High Potential Test, in accordance with IEEE 115 and NEMA MG 1, test voltage in accordance with NEMA MG 1. Generator manufacturer's production line test is acceptable.

c. Winding Resistance Test, Stator and Exciter, in accordance with IEEE 115. Generator manufacturer's production line test is acceptable.

d. Phase Balance Voltage Test, to the performance criteria specified in paragraph GENERATOR. This test can be performed with any prime mover. Generator manufacturer's production line test results are acceptable.

(1) Start and operate the generator at no load.

(2) Adjust a regulated phase voltage (line-to-neutral) to rated voltage.

(3) Read and record the generator frequency, line-to-neutral voltages, and the line-to-line voltages.

(4) Apply 75 percent rated load and record the generator frequency, line-to-neutral voltages, and the line-to-line voltages.

(5) Apply rated load and record the generator frequency, line-to-neutral voltages, and the line-to-line voltages.

(6) Calculate average line-neutral voltage and percent deviation of individual line-neutral voltages from average for each load condition.

e. Current Balance on Stator Winding Test, by measuring the current on each phase of the winding with the generator operating at 100 percent of Rated Output Capacity, with the load impedance equal for each of the three phases: to the performance criteria specified in paragraph GENERATOR.

f. Voltage Waveform Deviation and Distortion Test in accordance with IEEE 115 to the performance criteria specified in paragraph GENERATOR. Use high-speed recording instruments capable of recording voltage waveform deviation and all distortion, including harmonic distortion. Include appropriate scales to provide a means to measure and interpret results.

g. Voltage and Frequency Droop Test. Verify that the output voltage and frequency are within the specified parameters as follows:

(1) With the generator operating at no load, adjust voltage and frequency to rated voltage and frequency. Record the generator output frequency and line-line and line-neutral voltages.

(2) Increase load to Rated Output Capacity. Record the generator output frequency and line-line and line-neutral voltages.

(3) Calculate the percent droop for voltage and frequency with the following equations:

$$\text{Voltage droop percent} = \frac{\text{(No-Load Volts) - (Rated Capacity Volts)}}{\text{(Service-Load Volts)}} \times 100$$

$$\text{Frequency droop percent} = \frac{\text{(No-Load Hertz) - (Rated Capacity Hertz)}}{\text{(Service-Load Hertz)}} \times 100$$

(4) Repeat steps 1 through 3 two additional times without making any adjustments.

h. Frequency and Voltage Stability and Transient Response. Verify that the engine-generator set responds to addition and dropping of blocks of load in accordance with the transient response requirements. Document maximum voltage and frequency variation from bandwidth and verify that voltage and frequency return to and stabilize within the specified bandwidth, within the specified response time period. Document results in tabular form and with high resolution, high speed strip chart recorders or comparable digital recorders, as approved by the Contracting Officer. Include the following tabular data:

(1) Ambient temperature (at 15 minute intervals).

(2) Generator output current (before and after load changes).

(3) Generator output voltage (before and after load changes).

(4) Frequency (before and after load changes).

(5) Generator output power (before and after load changes).

(6) Graphic representations must include the actual instrument trace of voltage and frequency showing: charts marked at start of test; observed steady-state band; mean of observed band; momentary overshoot and undershoot (generator terminal voltage and frequency) and recovery time for each load change together with the voltage and frequency maximum and minimum trace excursions for each steady state load condition prior to and immediately following each load change. Generator terminal voltage and frequency transient recovery time for each step load increase and decrease.

(a) Perform and record engine manufacturer's recommended pre-starting checks and inspections.

(b) Start the engine, make and record engine manufacturer's after-starting checks and inspections during a reasonable warm-up period and no load. Verify stabilization of voltage and frequency within specified bandwidths.

(c) With the unit at no load, apply the Maximum Step Load Increase.

(d) Apply load in steps equal to the Maximum Step Load Increase until the addition of one more step increase will exceed the Service Load.

(e) Decrease load to the unit such that addition of the Maximum Step Load Increase will load the unit to 100 percent of Service Load.

(f) Apply the Maximum Step Load Increase.

(g) Decrease load to zero percent in steps equal to the Maximum Step Load Decrease.

(h) Repeat steps (c) through (g).

j. Test Voltage Unbalance with Unbalanced Load (Line-to-Neutral) to the performance criteria specified in paragraph GENERATOR. Prototype test data is acceptable in lieu of the actual test. Submit manufacturer's standard certification that prototype tests were performed for the generator model proposed. This test may be performed using any prime mover.

(1) Start and operate the generator set at rate voltage, no load, rated frequency, and under control of the voltage regulator. Read and record the generator frequency, line-to-neutral voltages, and the line-to-line voltages.

(2) Apply the specified load between terminals L_1-L_2, L_2-L_0, and L_3-L_0 in turn. Record all instrument readings at each line-neutral condition.

(3) Express the greatest difference between any two of the line-to-line voltages and any two of the line-to-neutral voltages as a percent of rated voltage.

(4) Compare the largest differences expressed in percent with the maximum allowable difference specified.

PART 3 EXECUTION

3.1 EXAMINATION

After becoming familiar with all details of the job, perform a Site Visit to verify the information shown on the drawings, before performing any work. Submit a letter stating the date the site was visited and listing discrepancies found. Notify the Contracting Officer in writing of any discrepancies.

3.2 GENERAL INSTALLATION

Provide clear space for operation and maintenance in accordance with NFPA 70 and IEEE C2. Submit a copy of the manufacturer's installation procedures and a detailed description of the manufacturer's recommended break-in procedure. Install pipe, duct, conduit, and ancillary equipment to facilitate easy removal and replacement of major components and parts of the engine-generator set.

3.3 PIPING INSTALLATION

Weld piping. Provide flanged valve connections. Provide flanged connections at equipment. Provide threaded connections to the engine if the manufacturers standard connection is threaded. Except where otherwise specified, use welded flanged fittings to allow for complete dismantling and removal of each piping system from the facility without disconnecting or removing any portion of any other system's equipment or piping. Make connections to equipment with vibration isolation-type flexible connectors. Support and align piping and tubing to prevent stressing of flexible hoses and connectors. Flash pipes extending through the roof. Install piping clear of windows, doors and openings, to permit thermal expansion and contraction without damage to joints or hangers, and install a 1/2 inch drain valve with cap at each low point.

The installation of gas engines must conform to the requirements of NFPA 37 and its references therein, including NFPA 54, NFPA 58, and ASME B31.3.

3.3.1 Support

Provide hangers, inserts, and supports to accommodate any insulation and conforming to MSS SP-58. Space supports no more than 7 feet on center for pipes 2 inches in diameter or less, no more than 12 feet on center for pipes larger than 2 inches but smaller than 4 inches in diameter, and not more than 17 feet on center for pipes larger than 4 inches in diameter. Provide supports at pipe bends or change of direction.

3.3.1.1 Ceiling and Roof

Support exhaust piping with appropriately sized Type 41 single pipe roll and threaded rods; support all other piping with appropriately sized Type 1 clevis and threaded rods.

3.3.1.2 Wall

Make wall supports for pipe by suspending the pipe from appropriately sized Type 33 brackets with the appropriate ceiling and roof pipe supports.

3.3.2 Flanged Joints

Provide flanges that are Class 125 type, drilled, and of the proper size and configuration to match the equipment and engine connections. Provide gasketed flanged joints that are square and tight.

3.3.3 Cleaning

After fabrication and before assembly, piping interiors must be manually wiped clean of debris.

3.3.4 Pipe Sleeves

Fit pipes passing through construction such as ceilings, floors, or walls with sleeves. Extend each sleeve through and fasten in its respective structure and cut flush with each surface. Build the structure tightly to the sleeve. The inside diameter of each sleeve must be minimum 1/2 inch, and where pipes pass through combustible materials 1 inch larger than the outside diameter of the passing pipe or pipe insulation/covering.

3.4 ELECTRICAL INSTALLATION

Perform electrical installation in compliance with NFPA 70, IEEE C2, and Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. For vibration isolation, provide flexible fittings for conduit, cable trays, and raceways attached to engine-generator sets; provide flexible stranded conductor for metallic conductor cables installed on the engine generator set and from the engine generator set to equipment not mounted on the engine generator set; and provide crimp-type terminals or lugs for terminations of conductors on the engine generator set.

3.5 FIELD PAINTING

Perform field painting as specified in Section 09 90 00 PAINTS AND COATINGS.

3.6 ONSITE INSPECTION AND TESTS

Perform and report on factory tests and inspections prior to shipment. Provide certified copies of manufacturer's test data and results. Test procedures must conform to ASME, IEEE, IEC, and ANSI standards, and to ISO requirements on testing, as appropriate and applicable. The manufacturer performing the tests must provide equipment, labor, and consumables necessary for tests and measuring and indicating devices must be certified to be within calibration. Tests must indicate satisfactory operation and attainment of specified performance. If satisfactory, equipment tested will be given a tentative approval. Equipment must not be shipped before approval of the factory test reports for the following tests.

Submit a letter giving notice of the proposed dates of onsite inspections and tests at least 14 days prior to beginning tests.

a. Submit a detailed description of the Contractor's procedures for onsite tests including the test plan and a listing of equipment necessary to perform the tests at least 14 days prior to beginning tests.

b. Submit six copies of the onsite test data described below in 8-1/2 by 11 inch binders having a minimum of 3 rings from which material may

readily be removed and replaced, including a separate section for each test. Separate sections by heavy plastic dividers with tabs. Provide full size (8-1/2 by 11 inch minimum) data plots showing grid lines, with full resolution.

(1) A detailed description of the procedures for onsite tests.

(2) A list of equipment used, with calibration certifications.

(3) A copy of measurements taken, with required plots and graphs.

(4) The date of testing.

(5) A list of the parameters verified.

(6) The condition specified for the parameter.

(7) The test results, signed and dated.

(8) A description of adjustments made.

3.6.1 Test Conditions

3.6.1.1 Data

Make and record measurements of all parameters necessary to verify that each set meets specified parameters. If the results of any test step are not satisfactory, make adjustments, replacements, or repairs and repeat the step until satisfactory results are obtained. Unless otherwise indicated, record data in 15 minute intervals during engine-generator set operation and include: readings of all engine-generator set meters and gauges for electrical and power parameters; oil pressure; ambient temperature; and engine temperatures available from meters and gauges supplied as permanent equipment on the engine-generator set. Perform electrical measurements in accordance with IEEE 120. Definitions of terms are in accordance with IEEE 100. Provide temperature limits in the rating of electrical equipment and for the evaluation of electrical insulations in accordance with IEEE 1.

3.6.1.2 Power Factor

Submit the generator capability curve showing generator kVA output capability (kW vs. kvar) for both leading and lagging power factors ranging from 0 to 1.0. For all engine-generator set operating tests the load power factor must be the power factor specified in the engine-generator set parameter schedule .

3.6.1.3 Contractor Supplied Items

Provide equipment and supplies required for inspections and tests including fuel, test instruments, and loadbanks at the specified power factors.

3.6.1.4 Instruments

Verify readings of panel gauges, meters, displays, and instruments provided as permanent equipment during test runs, using test instruments of greater precision and accuracy. Test instrument accuracy must be within the following: current plus or minus 1.5 percent, voltage plus or

minus 1.5 percent, real power plus or minus 1.5 percent, reactive power plus or minus 1.5 percent, power factor plus or minus 3 percent, frequency plus or minus 0.5 percent. Calibrate test instruments by a recognized standards laboratory within 30 days prior to testing.

3.6.1.5 Sequence

Provide the sequence of testing as specified in the approved testing plan unless variance is authorized by the Contracting Officer. Perform field testing in the presence of the Contracting Officer. Schedule and sequence tests in order to optimize run-time periods; however, follow the general order of testing: Construction Tests; Inspections; Pre-operational Tests; Safety Run Tests; Performance Tests; and Final Inspection.

3.6.2 Construction Tests

Perform individual component and equipment functional tests for fuel piping, coolant piping, and lubricating-oil piping, electrical circuit continuity, insulation resistance, circuit protective devices, and equipment not provided by the engine-generator set manufacturer prior to connection to the engine-generator set.

3.6.2.1 Piping Test

a. Flush lube-oil and fuel-oil piping with the same type of fluid intended to flow through the piping, until the outflowing fluid has no obvious sediment or emulsion.

b. Test fuel piping which is external to the engine-generator set in accordance with NFPA 30. Pressure all remaining piping which is external to the engine-generator set with air pressure at 150 percent of the maximum anticipated working pressure, but not less than 150 psi, for a period of 2 hours to prove the piping has no leaks. If piping is to be insulated, perform the test before the insulation is applied.

3.6.2.2 Electrical Equipment Tests

a. Perform low-voltage cable insulation integrity tests for cables connecting the generator breaker to the automatic transfer switch panelboard . Test low-voltage cable, complete with splices, for insulation resistance after the cables are installed, in their final configuration, ready for connection to the equipment, and prior to energization. Apply a test voltage of 500 volts dc for one minute between each conductor and ground and between all possible combinations conductors in the same trench, duct, or cable, with all other conductors in the same trench, duct, or conduit. Provide the minimum value of insulation as follows:

(1) R in meg-ohms = (rated voltage in kV plus 1) x 304.8/(length of cable in meters)

(2) R in meg-ohms = (rated voltage in kV plus 1) x 1000/(length of cable in feet)

(3) Each cable failing this test must be repaired or replaced. The repair cable must be retested until failures have been eliminated.

b. Perform medium-voltage cable insulation integrity tests for cables connecting the generator breaker to the . After installation and

before the operating test or connection to an existing system, perform a high potential test on the medium-voltage cable system. Apply direct-current voltage on each phase conductor of the system by connecting conductors as one terminal and connecting grounds of metallic shields or sheaths of the cable as the other terminal for each test. Prior to making the test, isolate the cables by opening applicable protective devices and disconnecting equipment. Conduct the test with all splices, connectors, and terminations in place. Provide the method, voltage, length of time, and other characteristics of the test for initial installation in accordance with NEMA WC 74/ICEA S-93-639 for the particular type of cable installed, except provide 28kV and 35kV insulation test voltages in accordance with either AEIC CS8 or AEIC CS8 as applicable, and do not exceed the recommendations of IEEE 404 for cable joints and IEEE 48 for cable terminations unless the cable and accessory manufacturers indicate higher voltages are acceptable for testing. Should any cable fail due to a weakness of conductor insulation or due to defects or injuries incidental to the installation or because of improper installation of cable, cable joints, terminations, or other connections, make necessary repairs or replace cables as directed. Retest repaired or replaced cables.

c. Ground-Resistance Tests. Measure the resistance of the ground ring using the fall-of-potential method defined in IEEE 81. On systems consisting of interconnected ground rods, perform tests after interconnections are complete. Take measurements in normally dry weather, not less than 48 hours after rainfall. Provide site diagram indicating location of test probes with associated distances, and provide a plot of resistance vs. distance. The combined resistance of separate systems may be used to meet the requirements resistance, but the specified number of electrodes must still be provided as follows:

(1) Single rod electrode - 25 ohms.

(2) Multiple rod electrodes - 25 ohms.

(3) Ground mat - 25 ohms.

d. Examine and test circuit breakers and switchgear in accordance with the manufacturer's published instructions for functional testing.

3.6.3 Inspections

Perform the following inspections jointly by the Contracting Officer and the Contractor, after complete installation of each engine-generator set and its associated equipment, and prior to startup of the engine-generator set. Submit a letter certifying that all facilities are complete and functional; that each system is fully functional; and that each item of equipment is complete, free from damage, adjusted, and ready for beneficial use. Perform checks applicable to the installation. Document and submit the results of those which are physical inspections (I) in accordance with paragraph SUBMITTALS. Present manufacturer's data for the inspections designated (D) at the time of inspection. Verify that equipment type, features, accessibility, installation and condition are in accordance with the contract specification. Provide manufacturer's statements to certify provision of features which cannot be verified visually.

Drive belts	I
Governor type and features	I
Engine timing mark	I
Starting motor	I
Starting aids	I
Coolant type and concentration	D
Radiator drains	I
Block coolant drains	I
Coolant fill level	I
Coolant line connections	I
Coolant hoses	I
Combustion air filter	I
Intake air silencer	I
Lube oil type	D
Lube oil sump drain	I
Lube-oil filter	I
Lube-oil level indicator	I
Lube-oil fill level	I
Lube-oil line connections	I
Lube-oil lines	I
Fuel type	D
Fuel level	I
Fuel-line connections	I
Fuel lines	I
Fuel filter	I
Access for maintenance	I
Voltage regulator	I

Battery-charger connections	I
Wiring and terminations	I
Instrumentation	I
Hazards to personnel	I
Base	I
Nameplates	I
Paint	I
Exhaust-heat system	I
Exhaust muffler	I
Switchboard	I
Switchgear	I
Access provided to controls	I
Enclosure is weather resistant	I
Engine and generator mounting bolts (application)	I

3.6.4 Engine Tests

Perform customary commercial factory tests in accordance with ISO 3046 on each engine and associated engine protective device, including, but not limited to the following:

a. Perform dynamometer test at rated power. Record horsepower at rated speed and nominal characteristics such as lubricating oil pressure, jacket water temperature, and ambient temperature.

b. Test and record the values that the low oil pressure alarm and protective shutdown devices actuate prior to assembly on the engine.

c. Test and record values that the high jacket water temperature alarm and protective shutdown devices actuate prior to assembly on the engine.

3.6.5 Generator Tests

Tests must be performed on the complete factory assembled generator prior to shipment. Conduct tests in accordance with IEEE 115, IEC 60034-2A, and NEMA MG 1.

3.6.5.1 Routine Tests

Perform the following routine tests on the generators and their exciters:

a. Resistance of armature and field windings.

b. Mechanical balance.

c. Phases sequence.

d. Open circuit saturation curve and phase (voltage) balance test.

e. Insulation resistance of armature and field windings.

f. High potential tes.t

3.6.5.2 Design Tests

Submit the following design tests made on prototype machines that are physically and electrically identical to the generators specified.

a. Temperature rise test

b. Short circuit saturation curve and current balance test

3.6.6 Assembled Engine-Generator Set Tests

Submit the following tests made on prototype machines that are physically and electrically identical to the engine-generator set specified.

3.6.6.1 Initial Stabilization Readings

Operate the engine-generator set and allow the set to stabilize at rated kW at rated power factor, rated voltage, and rated frequency. During this period record instrument readings for output power (kW), terminal voltage, line current, power factor, frequency (rpm) generator (exciter) field voltage and current, lubricating oil pressure, jacket water temperature, and ambient temperature at minimum intervals of 15 minutes. Adjust the load, voltage, and frequency to maintain rated load at rated voltage and frequency. Adjustments to load, voltage, or frequency controls must be recorded on the data sheet at the time of adjustment. Stabilization must be considered to have occurred when four consecutive voltage and current recorded readings of the generator (or exciter) field either remain unchanged or have only minor variations about an equilibrium condition with no evident continued increase or decrease in value after the last adjustment to the load, voltage, or frequency has been made.

3.6.6.2 Regulator Range Test

Remove load and record instrument readings (after transients have subsided). Adjust voltage to the maximum attainable value or to a value just prior to actuation of the overvoltage protection device. Apply rated load and adjust voltage to the minimum attainable value or a value just prior to activation of the under-voltage protection device. The data sheets must indicate the voltage regulation as a percent of rated voltage and the maximum and minimum voltages attainable. Voltage regulation must be defined as follows:

$$\text{Percent Regulation} = \frac{(\text{No-Load Voltage}) - (\text{Rated-Load Voltage})}{(\text{Rated-Load Voltage})} \times 100$$

3.6.6.3 Frequency Range Test

Adjust the engine-generator set frequency for the maximum attainable frequency at rated load. Record instrument readings. Adjust the engine-generator set frequency for the specified minimum attainable frequency at rated load. Record instrument readings. Reduce the load to zero and adjust the engine-generator set frequency for the maximum attainable frequency. Record instrument readings. Adjust the engine-generator set frequency for the minimum attainable frequency. Record instrument readings. The data sheet must show the maximum and minimum frequencies attained at rated load, and at no load.

3.6.6.4 Transient Response Test

Drop the load to no load and re-apply rated load three times to ensure that the no load and rated load voltage and frequency values are repeatable and that the frequency and voltage regulation is within the limits specified. Record generator terminal voltage and frequency using a high speed strip chart recorder. The data sheet must show the following results:

a. Frequency

(1) Stability bandwidth or deviation in percent of rated frequency.

(2) Recovery time.

(3) Overshoot and undershoot.

b. Voltage

(1) Stability bandwidth or deviation in percent of rated voltage.

(2) Recovery time.

(3) Overshoot and undershoot.

3.6.7 Pre-operational Tests

3.6.7.1 Protective Relays

Visually and mechanically inspect, adjust, test, and calibrate protective relays in accordance with the manufacturer's published instructions. Include pick-up, timing, contact action, restraint, and other aspects necessary to ensure proper calibration and operation. Implement relay settings in accordance with the installation coordination study. Manually or electrically operate relay contacts to verify that the proper breakers and alarms initiate. Field test relaying current transformers in accordance with IEEE C57.13.1.

3.6.7.2 Insulation Test

Test generator and exciter circuits insulation resistance in accordance with IEEE 43. Take stator readings including generator leads to switchboard at the circuit breaker. Record results of insulation resistance tests. Readings must be within limits specified by the manufacturer. Verify mechanical operation, insulation resistance, protective relay calibration and operation, and wiring continuity of switchboard assembly. Do not damage generator components during test.

3.6.7.3 Engine-Generator Connection Coupling Test

When the generator provided is a two-bearing machine, inspect and check the engine-generator connection coupling by dial indicator to prove that no misalignment has occurred. Use the dial indicator to measure variation in radial positioning and axial clearance between the coupling halves. Take readings at four points, spaced 90 degrees apart. Align solid couplings and pin-type flexible couplings within a total indicator reading of 0.0005 to 0.001 inch for both parallel and angular misalignment. For gear-type or grid-type couplings, 0.002 inch will be acceptable.

3.6.8 Safety Run Test

For the following tests, repeat the associated safety tests if any parts are changed, or adjustments made to the generator set, its controls, or auxiliaries.

a. Perform and record engine manufacturer's recommended prestarting checks and inspections.

b. Start the engine, record the starting time, make and record engine manufacturer's after-starting checks and inspections during a reasonable warm-up period.

c. Activate the manual emergency stop switch and verify that the engine stops.

d. Remove the high and pre-high lubricating oil temperature sensing elements from the engine and temporarily install a temperature gauge in their normal locations on the engine (required for safety, not for recorded data). Where necessary provide temporary wiring harness to connect the sensing elements to their permanent electrical leads.

e. Start the engine, record the starting time, make and record engine manufacturer's after-starting checks and inspections during a reasonable warm-up period. Operate the engine-generator set at no load until the output voltage and frequency stabilize. Monitor the temporarily installed temperature gauges. If either temperature reading exceeds the value required for an alarm condition, activate the manual emergency stop switch.

f. Immerse the elements in a vessel containing controlled-temperature hot oil and record the temperature at which the pre-high alarm activates and the temperature at which the engine shuts down. Remove the temporary temperature gauges and reinstall the temperature sensors on the engine.

g. Remove the high and pre-high coolant temperature sensing elements from the engine and temporarily install a temperature gauge in their normal locations on the engine (required for safety, not for recorded data). Where necessary provide temporary wiring harness to connect the sensing elements to their permanent electrical leads.

h. Start the engine, record the starting time, make and record engine manufacturer's after-starting checks and inspections during a reasonable warm-up period. Operate the engine generator-set at no load until the output voltage and frequency stabilize.

i. Immerse the elements in a vessel containing controlled-temperature hot oil and record the temperature at which the pre-high alarm activates and the temperature at which the engine shuts down. Remove the temporary temperature gauges and reinstall the temperature sensors on the engine.

j. Start the engine, record the starting time, make and record engine manufacturer's after-starting checks and inspections during a reasonable warm-up period.

k. Operate the engine generator-set for at least 2 hours at 75 percent of Service Load.

l. Verify proper operation and set-points of gauges and instruments.

m. Verify proper operation of ancillary equipment.

n. Manually adjust the governor to increase engine speed past the over-speed limit. Record the RPM at which the engine shuts down.

o. Start the engine, record the starting time, make and record engine manufacturer's after-starting checks and inspections and operate the engine generator-set for at least 15 minutes at 75 percent of Service Load.

p. Manually adjust the governor to increase engine speed to within 2 percent of the over-speed trip speed previously determined and operate at that point for 5 minutes. Manually adjust the governor to the rated frequency.

q. Manually fill the day tank to a level above the overfill limit. Record the level at which the overfill alarm sounds. Verify shutdown of the fuel transfer pump. Drain the day tank down below the overfill limit.

r. Shut down the engine. Remove the time-delay low lube oil pressure alarm bypass and try to start the engine.

s. Attach a manifold to the engine oil system (at the oil pressure sensor port) that contains a shutoff valve in series with a connection for the engine's oil pressure sensor followed by an oil pressure gauge ending with a bleed valve. Move the engine's oil pressure sensor from the engine to the manifold. Open the manifold shutoff valve and close the bleed valve.

t. Start the engine, record the starting time, make and record engine manufacturer's after-starting checks and inspections and operate the engine generator-set for at least 15 minutes at 75 percent of Service Load.

u. Close the manifold shutoff valve. Slowly allow the pressure in the manifold to bleed off through the bleed valve while watching the pressure gauge. Record the pressure at which the engine shuts down. Catch oil spillage from the bleed valve in a container. Add the oil from the container back to the engine, remove the manifold, and reinstall the engine's oil pressure sensor on the engine.

v. Start the engine, record the starting time, make and record engine manufacturer's after-starting checks and inspections and operate the engine generator-set for at least 15 minutes at 100 percent of Service

Load. Record the maximum sound level in each frequency band at a distance of 75 feet from the end of the exhaust and air intake piping directly along the path of intake and discharge for horizontal piping; or at a radius of75 feet from the engine at 45 degrees apart in all directions for vertical piping. If a sound limiting enclosure is provided, modify or replace the enclosure, the muffler, and intake silencer must be modified or replaced as required to meet the sound requirements contained within this specification

w. Manually drain off fuel slowly from the day tank to empty it to below the low fuel level limit and record the level at which the audible alarm sounds. Add fuel back to the day tank to fill it above low level alarm limits.

3.6.9 Performance Tests

In the following tests, where measurements are to be recorded after stabilization of an engine-generator set parameter (voltage, frequency, current, temperature, etc.), stabilization is considered to have occurred when measurements are maintained within the specified bandwidths or tolerances, for a minimum of four consecutive readings. For the following tests, repeat the associated tests if any parts are changed, or adjustments made to the generator set, its controls, or auxiliaries.

3.6.9.1 Continuous Engine Load Run Test

Test the engine-generator set and ancillary systems at service load to demonstrate durability; verify that heat of extended operation does not adversely affect or cause failure in any part of the system; and check all parts of the system. If the engine load run test is interrupted for any reason, repeat the entire test. After each change in load in the following test, measure the vibration at the end bearings (front and back of engine, outboard end of generator) in the horizontal, vertical, and axial directions. Verify that the vibration is within the allowable range. Take data taken at 15 minute intervals and include the following:

Electrical: Output amperes, voltage, real and reactive power, power factor, frequency.

Pressure: Lube-oil.

Temperature: Coolant, Lube-oil, Exhaust, Ambient.

a. Perform and record engine manufacturer's recommended prestarting checks and inspections. Include as a minimum checking of coolant fluid, fuel, and lube-oil levels.

b. Start the engine, make and record engine manufacturer's after-starting checks and inspections during a reasonable warmup period.

c. Operate the engine generator-set for 2 hours at 75 percent of Service Load.

d. Increase load to 100 percent of Service Load and operate the engine generator-set for 4 hours.

e. For prime rated units, increase load to 110 percent of Service Load and operate the engine generator-set for 2 hours.

f. Decrease load to 100 percent of Service Load and operate the engine generator-set for 2 hours or until all temperatures have stabilized.

g. Remove load from the engine-generator set.

3.6.9.2 Voltage and Frequency Droop Test

For the following steps, verify that the output voltage and frequency return to and stabilize within the specified bandwidth values following each load change. Record the generator output frequency and line-line and line-neutral voltages following each load change.

a. With the generator operating at no load, adjust voltage and frequency to rated voltage and frequency.

b. Increase load to 100 percent of Rated Output Capacity. Record the generator output frequency and line-line and line-neutral voltages.

c. Calculate the percent droop for voltage and frequency with the following equations.

$$\text{Voltage droop percent} = \frac{\text{No-load volts - rated output capacity volts}}{\text{Rated output capacity volts}} \times 100$$

$$\text{Frequency droop percent} = \frac{\text{No load hertz - rated output capacity hertz}}{\text{Rated output capacity volts}} \times 100$$

d. Repeat steps a. through c. two additional times without making any adjustments.

3.6.9.3 Voltage Regulator Range Test

a. While operating at no load, verify that the voltage regulator adjusts from 90 to 110 percent of rated voltage.

b. Increase load to 100 percent of Rated Output Capacity. Verify that the voltage regulator adjusts from 90 to 110 percent of rated voltage.

3.6.9.4 Governor Adjustment Range Test

a. While operating at no load, verify that the governor adjusts from 90 to 110 percent of rated frequency.

b. Increase load to 100 percent of Rated Output Capacity. Verify that the governor adjusts from 90 to 110 percent of rated frequency.

3.6.9.5 Frequency and Voltage Stability and Transient Response

Verify that the engine-generator set responds to addition and dropping of blocks of load in accordance with the transient response requirements. Document maximum voltage and frequency variation from bandwidth and verify that voltage and frequency return to and stabilize within the specified bandwidth, within the specified response time period. Document results in tabular form and with high resolution, high speed strip chart recorders or comparable digital recorders, as approved by the Contracting Officer. Include the following tabular data:

(1) Ambient temperature (at 15 minute intervals).

(2) Generator output current (before and after load changes).

(3) Generator output voltage (before and after load changes).

(4) Frequency (before and after load changes).

(5) Generator output power (before and after load changes.

(6) Include the actual instrument trace of voltage and frequency in graphic representations showing:

Charts marked at start of test; observed steady-state band; mean of observed band; momentary overshoot and undershoot (generator terminal voltage and frequency) and recovery time for each load change together with the voltage and frequency maximum and minimum trace excursions for each steady state load condition prior to and immediately following each load change. Generator terminal voltage and frequency transient recovery time for each step load increase and decrease.

a. Perform and record engine manufacturer's recommended prestarting checks and inspections.

b. Start the engine, make and record engine manufacturer's after-starting checks and inspections during a reasonable warm-up period and no load. Verify stabilization of voltage and frequency within specified bandwidths.

c. With the unit at no load, apply the Maximum Step Load Increase.

d. Apply load in steps equal to the Maximum Step Load Increase until the addition of one more step increase will exceed the Service Load.

e. Decrease load to the unit such that addition of the Maximum Step Load Increase will load the unit to 100 percent of Service Load.

f. Apply the Maximum Step Load Increase.

g. Decrease load to zero percent in steps equal to the Maximum Step Load Decrease.

h. Repeat steps c. through g.

3.6.10 Parallel Operation Test

Test the capability of each engine-generator set to parallel and share load with other generator sets, individually and in all combinations. This test must be performed with the voltage regulator and governor adjustment settings used for the Frequency and Voltage Stability and Transient Response test. If settings are changed during the performance of this test, a voltage and frequency stability and transient response test must be performed for each engine generator set using the setting utilized in this test. During operations record load-sharing characteristics of each set in parallel operation. Include the following data:

(1) Ambient temperature (at 15 minute intervals).

(2) Generator output current (before and after load changes).

(3) Generator output voltage (before and after load changes).

(4) Power division and exchange between generator sets.

(5) Real power (watts) and reactive power (vars) on each set.

3.6.10.1 Combinations

Connect each set, while operating at no load, parallel with one other set in the system, operating at service load, until all possible combinations have been achieved. Verify stabilization of voltage and frequency within specified bandwidths and proportional sharing of real and reactive loads. Document stabilization of voltage and frequency within specified bandwidth, the active power division, active power exchange, reactive power division, and voltage and frequency stability and transient response in the following steps for each combination.

a. Divide the load proportionally between the sets and operate in parallel for 15 minutes.

b. Increase the load, in steps equal to the Maximum Step Increase, until each set is loaded to its service load.

c. Decrease the load, in steps equal to the Maximum Step Decrease, until each set is loaded to approximately 25 percent of its service load.

d. Increase the load, in steps equal to the Maximum Step Increase, until each set is loaded to approximately 50 percent of its service load Verify stabilization of voltage and frequency within specified bandwidths and proportional sharing of real and reactive load.

e. Reduce the sum of the loads on both sets to the output rating of the smaller set.

f. Transfer a load equal to the output rating of the smaller of the 2 sets to and from each set. Verify stabilization of voltage and frequency within specified bandwidths and proportional sharing of real and reactive load.

g. Document the active power division, active power exchange, reactive power division, and voltage and frequency stability and transient response.

3.6.10.2 Multiple Combinations

Connect each set, while operating at no load, parallel with all multiple combinations of all other set in the system, while operating at service load, until all multiple combinations of parallel operations have been achieved.

3.6.11 Parallel Operation Test (Commercial Source)

Connect each set parallel with the commercial power source. Operate in parallel for 15 minutes. Verify stabilization of voltage and frequency within specified bandwidths. Record the output voltage, frequency, and loading to demonstrate ability to synchronize with the commercial power

source.

3.6.12 Automatic Operation Tests

Test the automatic operating system to demonstrate automatic starting, and paralleling of each engine-generator set. Utilize load banks at the indicated power factor for this test, and the loading sequence is the indicated sequence. Record load-sharing characteristics during all operations. Perform this test for a minimum of two successive, successful tests. Include the following data:

(1) Ambient temperature (at 15 minute intervals).

(2) Generator output current (before and after load changes).

(3) Generator output voltage (before and after load changes).

(4) Generator output frequency (before and after load changes).

(5) Power division and exchange between generator sets.

(6) Real and reactive power on each set.

a. Initiate loss of the preferred power source and verify the specified sequence of operation.

b. Verify resetting of automatic starting and transfer logic.

3.6.13 Automatic Operation Tests for Stand-Alone Operation

Test the automatic loading system to demonstrate automatic starting, and loading and unloading of each engine-generator set. Utilize the actual loads to be served for this test, and the loading sequence is the indicated sequence. Perform this test for a minimum of two successive, successful tests. Include the following data:

(1) Ambient temperature (at 15 minute intervals).

(2) Generator output current (before and after load changes).

(3) Generator output voltage (before and after load changes).

(4) Generator output frequency (before and after load changes).

a. Initiate loss of the primary power source and verify automatic sequence of operation.

b. Restore the primary power source and verify sequence of operation.

c. Verify resetting of controls to normal.

3.7 GROUNDING

NFPA 70 and IEEE C2, except that grounding systems must have a resistance to solid earth ground not exceeding 5 ohms.

3.7.1 Grounding Electrodes

Provide driven ground rods as specified in Section 26 20 00 INTERIOR

DISTRIBUTION SYSTEM. Connect ground conductors to the upper end of ground rods by exothermic weld or compression connector. Provide compression connectors at equipment end of ground conductors.

3.7.2 Engine-Generator Set Grounding

Provide separate copper grounding conductors and connect them to the ground system as indicated. When work in addition to that indicated or specified is required to obtain the specified ground resistance, the provision of the contract covering "Changes" must apply.

3.7.3 Connections

Make joints in grounding conductors by exothermic weld or compression connector. Exothermic welds and compression connectors must be installed as specified in Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION paragraph regarding GROUNDING.

3.7.4 Grounding and Bonding Equipment

UL 467, except as indicated or specified otherwise.

3.8 START-UP ENGINEER

Provide the services of a qualified factory trained start-up engineer, regularly employed by the engine-generator set manufacturer. The start-up services must include conducting preliminary operations and functional acceptance tests. The start-up engineer must be present at the engine generator set installation-site, full-time, while preliminary operations and functional acceptance tests are being conducted.

3.9 PREREQUISITES FOR FUNCTIONAL ACCEPTANCE TESTING

Completion of the following requirements is mandatory prior to scheduling functional acceptance tests for the engine-generator set and auxiliary equipment.

3.9.1 Piping Tests

Complete as specified in Section 33 52 10 SERVICE PIPING, FUEL SYSTEMS.

3.9.2 Performance of Acceptance Checks and Tests

The acceptance checks and tests must be accomplished by the testing organization as described in Section 26 08 00 APPARATUS INSPECTION AND TESTING.

3.9.3 Generator Sets

Complete as specified in the paragraph ACCEPTANCE CHECKS AND TESTS.

3.9.3.1 Automatic Transfer Switches

Complete acceptance checks and tests as specified in Section 26 36 23 AUTOMATIC TRANSFER SWITCHES AND BY-PASS/ISOLATION SWITCH.

3.9.4 Preliminary Operations

The start-up engineer must conduct manufacturer recommended start-up

procedures and tests to verify that the engine-generator set and auxiliary equipment are ready for functional acceptance tests. Give the Contracting Officer 15 days' advance notice that preliminary operations will be conducted. After preliminary operation has been successfully conducted, the start-up engineer will notify the Contracting Officer in writing stating the engine-generator set and auxiliary equipment are ready for functional acceptance tests.

3.9.5 Preliminary Assembled Operation and Maintenance Manuals

Preliminary assembled operation and maintenance manuals must have been submitted to and approved by the Contracting Officer. Manuals must be prepared as specified in the paragraph ASSEMBLED OPERATION AND MAINTENANCE MANUALS.

3.9.6 Functional Acceptance Test Procedure

Test procedure must be prepared by the start-up engineer specifically for the engine-generator set and auxiliary equipment. The test agenda must cover the requirements specified in the paragraph FUNCTIONAL ACCEPTANCE TESTS. The test procedure must indicate in detail how tests are to be conducted. A statement of the tests that are to be performed without indicating how the tests are to be performed is not acceptable. Indicate what work is planned on each workday and identify the calendar dates of the planned workdays. Specify what additional technical support personnel is needed such as factory representatives for major equipment. Specify on which testing workday each technical support personnel is needed. Data recording forms to be used to document test results are to be submitted with the proposed test procedure. A list of test equipment and instruments must also be included in the test procedure.

3.9.7 Test Equipment

Test equipment and instruments must be on hand prior to scheduling field tests or, subject to Contracting Officer approval, evidence must be provided to show that arrangements have been made to have the necessary equipment and instruments on-site prior to field testing.

3.10 FIELD QUALITY CONTROL

Give Contracting Officer 30 days' notice of dates and times scheduled for tests which require the presence of the Contracting Officer. The Contracting Officer will coordinate with the using activity and schedule a time that will eliminate or minimize interruptions and interference with the activity operations. The Contractor must be responsible for costs associated with conducting tests outside of normal working hours and with incorporating special arrangements and procedures, including temporary power conditions. The Contractor must provide labor, equipment, fuel, test load, and consumables required for the specified tests. The test load must be a cataloged product. Calibration of measuring devices and indicating devices must be certified. Refer to Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM, for requirements for a cataloged product. Perform the following field tests.

3.10.1 Acceptance Checks and Tests

Perform in accordance with the manufacturer's recommendations, and include the following visual and mechanical inspections and electrical tests, performed in accordance with NETA ATS.

3.10.1.1 Circuit Breakers - Low Voltage Insulated Case/Molded Case

a. Visual and Mechanical Inspection

(1) Compare nameplate data with specifications and approved shop drawings.

(2) Inspect circuit breaker for correct mounting.

(3) Operate circuit breaker to ensure smooth operation.

(4) Inspect case for cracks or other defects.

(5) Verify tightness of accessible bolted connections and cable connections by calibrated torque-wrench method. Thermo-graphic survey is not required.

(6) Inspect mechanism contacts and arc chutes in unsealed units.

b. Electrical Tests

(1) Perform contact-resistance tests.

(2) Perform insulation-resistance tests.

(3) Adjust breaker(s) for final settings in accordance with engine-generator set manufacturer's requirements.

3.10.1.2 Current Transformers

a. Visual and Mechanical Inspection

(1) Compare equipment nameplate data with specifications and approved shop drawings.

(2) Inspect physical and mechanical condition.

(3) Verify correct connection.

(4) Verify that adequate clearances exist between primary and secondary circuit.

(5) Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method. Thermo-graphic survey is not required.

(6) Verify that all required grounding and shorting connections provide good contact.

b. Electrical Tests

(1) Perform insulation-resistance tests.

(2) Perform polarity tests.

(3) Perform ratio-verification tests.

3.10.1.3 Metering and Instrumentation

a. Visual and Mechanical Inspection

(1) Compare equipment nameplate data with specifications and approved shop drawings.

(2) Inspect physical and mechanical condition.

(3) Verify tightness of electrical connections.

b. Electrical Tests

(1) Determine accuracy of meters at 25, 50, 75, and 100 percent of full scale.

(2) Calibrate watt-hour meters according to manufacturer's published data.

(3) Verify all instrument multipliers.

(4) Electrically confirm that current transformer secondary circuits are intact.

3.10.1.4 Battery Systems

a. Visual and Mechanical Inspection

(1) Compare equipment nameplate data with specifications and approved shop drawings.

(2) Inspect physical and mechanical condition.

(3) Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method. Thermo-graphic survey is not required.

(4) Measure electrolyte specific gravity and temperature and visually check fill level.

(5) Verify adequacy of battery support racks, mounting, anchorage, and clearances.

b. Electrical Tests

(1) Set charger float and equalizing voltage levels.

(2) Verify all charger functions and alarms.

(3) Measure each cell voltage and total battery voltage with charger energized and in float mode of operation.

(4) Perform a capacity load test.

3.10.1.5 Engine-Generator Set

a. Visual and Mechanical Inspection

(1) Compare equipment nameplate data with specifications and approved

shop drawings.

(2) Inspect physical and mechanical condition.

(3) Inspect for correct anchorage and grounding.

b. Electrical and Mechanical Tests

(1) Perform an insulation-resistance test on generator winding with respect to ground. Calculate polarization index.

(2) Perform phase rotation test to determine compatibility with load requirements.

3.10.1.6 Grounding System

a. Visual and Mechanical Inspection

(1) Inspect ground system for compliance with contract plans and specifications.

b. Electrical Tests

(1) Perform ground-impedance measurements utilizing the fall-of-potential method defined in IEEE 81. On systems consisting of interconnected ground rods, perform tests after interconnections are complete. Take measurements in normally dry weather, not less than 48 hours after rainfall. Provide site diagram indicating location of test probes with associated distances, and provide a plot of resistance vs. distance.

3.10.2 Functional Acceptance Tests

The tests must be performed by the start-up engineer. Upon successful test completion, the start-up engineer must provide the Contracting Officer with a written test report within 15 calendar days showing the tests performed and the results of each test. The report must include the completed approved test data forms and certification from the start-up engineer that the test results fall within the manufacturer's recommended limits and meet the specified requirements performance. The report must be dated and signed by the start-up engineer, and submitted for approval by the Contracting Officer. The Contracting Officer will witness final acceptance tests. Testing must include, but not be limited to, the following:

a. Verify proper functioning of each engine protective shutdown device and pre-shutdown alarm device. Testing of the devices must be accomplished by simulating device actuation and observing proper alarm and engine shutdown operation.

b. Verify proper functioning of the engine over-speed trip device. Testing of the over-speed trip device must be accomplished by raising the speed of the engine-generator set until an over-speed trip is experienced.

c. Verify proper functioning of the crank cycle/terminate relay. Testing of the relay must be accomplished by engaging the starter motor with the engine being prevented from running. Observe the complete crank/rest cycle as described in the paragraph STARTING SYSTEM.

d. Verify proper functioning of the following automatic and manual operations. Testing must include, but not be limited to, the following:

(1) Loss of Utility: Initiate a normal power failure with connected test load of rated kW at 1.0 power factor. Record time delay on start, cranking time until engine starts and runs, time to come up to operating speed, voltage and frequency overshoot, and time to achieve steady state conditions with all switches transferred to emergency position.

(2) Return of Utility: Return normal power and record time delay on retransfer for each automatic transfer switch, and time delay on engine cool-down and shutdown.

(3) Manual starting.

(4) Emergency stop.

e. Operate the engine-generator set at rated current (amperes) until the jacket water temperature stabilizes. Stabilization will be considered to have occurred when three consecutive temperature readings remain unchanged. Continue to operate the generator set for an additional 2 hours. Record instrument readings for terminal voltage, line current, frequency (Hz), engine speed rpm, lubricating oil pressure, jacket water temperature, and ambient temperature at 5 minute intervals for first 15 minutes and at 15 minute intervals thereafter.

f. Emissions Tests. Provide on-site testing by a certified testing organization of each engine-generator set. Testing must be in accordance with an EPA approved method, 40 CFR 60, (Appendix, Method 7, 7A, 7B, 7C, 7D or 7E). Emissions at rated full load must be within the limits specified in the paragraph ENGINE EMISSIONS LIMITS.

3.11 DEMONSTRATION

Upon completion of the work and at a time approved by the Contracting Officer, the Contractor must provide instructions by a qualified instructor to the Government personnel in the proper operation and maintenance of the equipment. Government personnel must receive training comparable to the equipment manufacturer's factory training. The duration of instruction must be for not less than one 8 hour working day for instruction of operating personnel and not less than one 8 hour working day for instruction of maintenance personnel.

3.11.1 Instructor's Qualification Resume

Instructors must be regular employees of the engine-generator set manufacturer. The instruction personnel provided to satisfy the requirements above must be factory certified by the related equipment manufacturer to provide instruction services. Submit the name and qualification resume of instructor to the Contracting Officer for approval.

3.11.2 Training Plan

Submit training plan 30 calendar days prior to training sessions. Training plan must include scheduling, content, outline, and training material (handouts). Content must include, but not be limited to, the

following:

3.11.2.1 Operating Personnel Training

This instruction includes operating the engine-generator set, auxiliary equipment including automatic transfer switches in all modes, and the use of all functions and features specified.

3.11.2.2 Maintenance Personnel Training

Training must include mechanical, hydraulic, electrical, and electronic instructions for the engine-generator set and auxiliary equipment including automatic transfer switches.

a. Mechanical Training: Must include at least the following:

(1) A review of mechanical diagrams and drawings.

(2) Component location and functions.

(3) Troubleshooting procedures and techniques.

(4) Repair procedures.

(5) Assembly/disassembly procedures.

(6) Adjustments (how, when, and where).

(7) Preventive maintenance procedures.

(8) Review of flow diagram.

(9) Valve locations and function.

(10) Valve and hydraulic equipment adjustment and maintenance procedures.

(11) Hydraulic system maintenance and servicing.

(12) Lubrication points, type, and recommended procedures and frequency.

b. Electrical and Electronic Maintenance Training: Must include at least the following:

(1) A review of electrical and electronic systems including wiring diagrams and drawings.

(2) Troubleshooting procedures for the machine and control systems.

(3) Electrical and electronic equipment servicing and care.

(4) Use of diagnostics to locate the causes of malfunction.

(5) Procedures for adjustments (locating components, adjustments to be made, values to be measured, and equipment required for making adjustments).

(6) Maintenance and troubleshooting procedures for microprocessor or

minicomputer where applicable.

(7) Circuit board repair procedures where applicable (with schematics provided).

(8) Use of diagnostic tapes.

(9) Recommended maintenance servicing and repair for motors, switches, relays, solenoids, and other auxiliary equipment and devices.

3.12 ONSITE TRAINING

Conduct a training course for the operating staff as designated by the Contracting Officer. The training period must consist of a total 40 hours of normal working time and must start after the system is functionally completed but prior to final acceptance.

a. Submit a letter giving the date proposed for conducting the onsite training course, the agenda of instruction, a description of the digital video recording to be provided. The course instructions must cover pertinent points involved in operating, starting, stopping, servicing the equipment, as well as major elements of the operation and maintenance manuals. Additionally, the course instructions must demonstrate routine maintenance procedures as described in the operation and maintenance manuals.

b. Submit a digital video recording of the manufacturers operating and maintenance training course.

c. One full size reproducible Mylar ach drawing must accompany the booklets. Mylars must be rolled and placed in a heavy cardboard tube with threaded caps on each end. The manual must include step-by-step procedures for system startup, operation, and shutdown; drawings, diagrams, and single-line schematics to illustrate and define the electrical, mechanical, and hydraulic systems together with their controls, alarms, and safety systems; the manufacturer's name, model number, and a description of equipment in the system. The instructions must include procedures for interface and interaction with related systems to include automatic transfer switches . Each booklet must include a CD containing an ASCII file of the procedures.

d. Provide approved operation and maintenance manuals for the training course. Post approved instructions prior to the beginning date of the training course. Coordinate the training course schedule with the using service's work schedule, and submit for approval 14 days prior to beginning date of proposed beginning date of training.

3.13 INSTALLATION

Installation must conform to the applicable requirements of IEEE C2, NFPA 30, NFPA 37, and NFPA 70.

3.14 FINAL TESTING AND INSPECTION

a. Start the engine, record the starting time, make and record all engine manufacturer's after-starting checks and inspections during a reasonable warm-up period.

b. Increase the load in steps no greater than the Maximum Step Load Increase to 100 percent of Service Load, and operate the engine-generator set for at least 30 minutes. Measure the vibration at the end bearings (front and back of engine, outboard end of generator) in the horizontal, vertical, and axial directions. Verify that the vibration is within the same range as previous measurements and is within the required range.

c. Remove load and shut down the engine-generator set after the recommended cool down period.

d. Remove the lube oil filter and have the oil and filter examined by the engine manufacturer for excessive metal, abrasive foreign particles, etc. Verify any corrective action for effectiveness by running the engine for 8 hours at Service Load, then re-examine the oil and filter.

e. Remove the fuel filter and examine the filter for trash, abrasive foreign particles, etc.

f. Visually inspect and check engine and generator mounting bolts for tightness and visible damage.

g. Replace air, oil, and fuel filters with new filters.

3.15 MANUFACTURER'S FIELD SERVICE

The engine generator-set manufacturer must furnish a qualified representative to supervise the installation of the engine generator-set, assist in the performance of the onsite tests, and instruct personnel as to the operational and maintenance features of the equipment.

3.16 POSTED DATA AND INSTRUCTIONS

Post Data and Instructions prior to field acceptance testing of the engine generator set. Provide two sets of typed instructions/data in 8-1/2 x 11 inch format, laminated in weatherproof plastic, and placed in three-ring vinyl binders. Place the binders as directed by the Contracting Officer. Provide the instructions prior to acceptance of the engine generator set installation.

b. Include a one-line diagram, wiring and control diagrams and a complete layout of the system in the first set. Include the condensed operating instructions describing manufacturer's pre-start checklist and precautions; startup procedures for test-mode, manual-start mode, and automatic-start mode (as applicable); running checks, procedures, and precautions; and shutdown procedures, checks, and precautions in the second set. Include procedures for interrelated equipment (such as heat recovery systems, co-generation, load-shedding, and automatic transfer switches).

c. Submit instructions including: the manufacturers pre-start checklist and precautions; startup procedures for test-mode, manual-start mode, and automatic-start mode (as applicable); running checks, procedures, and precautions; and shutdown procedures, checks, and precautions. Include procedures for interrelated equipment (such as heat recovery systems, co-generation, load-shedding, and automatic transfer switches). Provide weatherproof instructions, laminated in plastic, and post where directed.

3.17 ACCEPTANCE

Submit drawings which accurately depict the as-built configuration of the installation, upon acceptance of the engine-generator set installation. Revise layout drawings to reflect the as-built conditions and submit them with the as-built drawings. Final acceptance of the engine-generator set will not be given until the Contractor has successfully completed all tests and all defects in installation material or operation have been corrected.

-- End of Section --

SECTION 26 36 23

AUTOMATIC TRANSFER SWITCHES AND BY-PASS/ISOLATION SWITCH
05/20, CHG 1: 08/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM B117	(2019) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM D709	(2017) Standard Specification for Laminated Thermosetting Materials

INTERNATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)

NETA ATS	(2021) Standard for Acceptance Testing Specifications for Electrical Power Equipment and Systems

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)
NEMA ICS 2	(2000; R 2020) Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 V
NEMA ICS 4	(2015) Application Guideline for Terminal Blocks
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code
NFPA 110	(2022) Standard for Emergency and Standby Power Systems

UNDERWRITERS LABORATORIES (UL)

UL 508	(2018; Reprint Jul 2021) UL Standard for Safety Industrial Control Equipment
UL 1008	(2014) Transfer Switch Equipment

UL 1066	(2012; Reprint Mar 2017) UL Standard for Safety Low-Voltage AC and DC Power Circuit Breakers Used in Enclosures

1.2 RELATED REQUIREMENTS

Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM, , applies to this section, with the additions and modifications specified herein.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Automatic Transfer Switch Drawings; G

SD-03 Product Data

Automatic Transfer Switches; G

By-Pass/Isolation Switch (BP/IS); G

Remote Annunciator Panel; G

Remote Annunciator and Control System Panel; G

SD-06 Test Reports

Acceptance Checks and Tests; G

Functional Acceptance Tests; G

Factory Testing; G

Factory Test Reports; G

SD-07 Certificates

Proof of Listing; G

SD-10 Operation and Maintenance Data

Operation and Maintenance Manual, Submit in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA, Data Package 5; G

1.4 OPERATION AND MAINTENANCE MANUAL

Assemble and bind manuals in durable, hard-covered, water resistant binders. Assemble and index the manuals per the following table of contents:

a. Manufacturer's O&M per "SD-10 Operation and Maintenance Data".

b. Catalog data required by "SD-03 Product Data"

c. Drawings required by "SD-02 Shop Drawings".

1.4.1 Additions to Operation and Maintenance Manuals

In addition to requirements of SD-10 Data Package 5, include the followings on the actual equipment provided:

a. An outline drawing, front, top, and side views.

b. Prices for spare parts and supply list.

c. Date of Purchase.

d. Corrective maintenance procedures.

e. Operating manual outlining step-by-step procedures for system startup, operation, and shutdown.

f. Include simplified wiring and control diagrams in the manual for system as installed.

g. Provide typical contact voltage drop readings under specified conditions for use during periodic maintenance. Provide instructions for determination of contact integrity.

1.5 QUALITY ASSURANCE

1.5.1 Proof of Listing

Submit proof of listing by UL 1008.

1.5.2 Automatic Transfer Switch Drawings

Include the following as a minimum:

a. An outline drawing, including front, top, and side views.

b. Provide a nameplate of corrosion-resistant material with not less than 1/8 inch tall characters showing manufacturer's name and equipment ratings. Mount nameplate to front of enclosure and meet the nameplate requirements of NEMA ICS 2.

c. Provide detail drawings that include manufacturer's name and catalog number, electrical ratings, total system transfer statement, reduced normal supply voltage at which transfer to the alternate supply is initiated, transfer delay times, short-circuit current rating, wiring diagram, description of interconnections, testing instructions, acceptable conductor type for terminals, tightening torque for each wire connector, and other required UL 1008 markings.

d. Submit interface equipment connection diagram showing conduit and wiring between ATS and related equipment. Provide diagrams showing interlocking provisions and cautionary notes, if any.

e. Drawings are to indicate adequate clearance for operation, maintenance, and replacement of operating equipment devices.

1.5.3 Regulatory Requirements

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word "shall" or "must" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction," or words of similar meaning, to mean the Contracting Officer. Equipment, materials, installation, and workmanship must be in accordance with the mandatory and advisory provisions of NFPA 70 unless more stringent requirements are specified or indicated

1.5.4 Standard Product

Provide materials and equipment that are products of manufacturers regularly engaged in the production of such products which are of equal material, design and workmanship, and:

a. Have been in satisfactory commercial or industrial use for 2 years prior to bid opening including applications of equipment and materials under similar circumstances and of similar size.

b. Have been on sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the 2-year period.

c. Where two or more items of the same class of equipment are required, provide products of a single manufacturer; however, the component parts of the item need not be the products of the same manufacturer unless stated in this section.

1.5.4.1 Alternative Qualifications

Products having less than a 2-year field service record are acceptable if the manufacturer has been regularly engaged in the design and production of automatic transfer switches and if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturers' factory or laboratory tests, is furnished.

1.5.4.2 Material and Equipment Manufacturing Date

Products manufactured more than 1 years prior to date of delivery to site are not acceptable.

1.6 DELIVERY AND STORAGE

Protect equipment placed in storage from humidity and temperature variations, moisture, water intrusion, dirt, dust, or other contaminants. In harsh environments where temperatures exceed non-operational parameters established within this specification, provide an environmentally controlled equipment storage facility to ensure temperature parameters are within equipment specification. Provide documentation of same to the Government when storage is implemented.

1.7 ENVIRONMENTAL CONDITIONS

Provide an ATS that is suitable for prolonged performance under following service conditions:

a. Operating altitude: Sea level to 3,300 ft. (Systems applied at higher

altitudes are to be derated in accordance with the manufacturer's instructions).

b. Operating ambient temperature range: 40 to 104 degrees F.

c. Operating relative humidity: 0 to 90 percent, without condensation.

PART 2 PRODUCTS

2.1 AUTOMATIC TRANSFER SWITCHES

Each automatic transfer switch must be rated and marked for total system transfer and have the current and voltage ratings as indicated. Provide a switch operating mechanism that is electrically operated, have quick-make, quick-break, load break contacts, and be mechanically held in both positions. Switches utilizing circuit breakers are not acceptable. Provide an ATS that is UL listed. ATS must be manufactured and tested in accordance with applicable requirements of NEMA ICS 2, UL 1008 and UL 1066. ATS must conform to NFPA 110. Provide the ATS with the following characteristics:

a. Voltage: 208 volts ac.

b. Amperage: 800 amps ac. Provide an ATS with a continuous load current rating of the switch rating.

c. Number of Phases: Three.

d. Number of Wires: Four.

e. Frequency: 60 Hz.

f. Poles: Four switched. One of the poles is the neutral.

g. ATS Withstand Current Rating: ATS must be rated to close on and withstand the available RMS symmetrical short circuit current at the ATS terminals. The ATS must be listed in accordance with UL 1008 for 3 30 cycle close and withstand ratings. Minimum UL listed close and withstand ratings at 208 VAC C shall be 30 65 kA.

h. Nonwelding Contacts: Provide contacts that are nonwelding at the available fault current rating. Contacts must be suitable for repetitive power transfer switching. Switches rated 800 amps and above must have segmented, blow-on construction for high withstand and close-on capability and be protected by separate arcing contacts.

i. Phase and Neutral Contacts: Provide contacts with silver alloy composition. Provide neutral contacts with the same continuous current rating as main or phase contacts.

j. Configuration. Provide an ATS for use in optional standby systems described in NFPA 70.

k. ATS Configuration.

l.

2.1.1 Undervoltage Sensing - Normal/Preferred Source

Undervoltage Sensing - Normal Source. Provide undervoltage sensing for each phase in the normal/preferred source. Sense low phase-to-ground voltage on each phase. Provide sensing circuit with adjustable dropout, 75-98 percent of nominal value and adjustable pickup, 85-100 percent of nominal value. Factory set dropout value to 90percent. Factory set pickup value to 95percent.

2.1.2 Adjustable Time Delay - Override Transfer

Adjustable Time Delay - Override Transfer. For override of normal-source voltage sensing to delay transfer and engine starting signals. Engine starting control contacts with adjustable commit-to-start delay circuit, 0.0-6.0 seconds. Factory set at 1second.

2.1.3 Voltage/Frequency Lockout Relay - Alternate/Emergency Source

Voltage/Frequency Lockout Relay. Three-phase sensing must be provided on the normal and emergency source. Prevent premature transfer to alternate/emergency source. Provide pickup voltage that is adjustable from 85-100 percent of nominal. Factory set for pickup at 90 percent. Provide pickup frequency that is adjustable from 90-97 percent of nominal. Factor set frequency pickup for 95 percent.

2.1.4 Adjustable Time Delay - Transfer to Alternate/Emergency Power Source

Adjustable Time Delay - Transfer to Alternate Power Source. Transfer to alternate power source time delay for transfer switches as indicated, adjustable 0-5 minutes. Factory set to 0 seconds. ATS is to monitor the frequency and voltage of alternate power source and transfer when frequency and voltage are stabilized.

2.1.5 Adjustable Time Delay- Re-transfer to Normal/Preferred Source

Adjustable Time Delay- Transfer to Source. Re-transfer to normal source time delay, adjustable 0-30 minutes. Factory set at 10 minutes. Time delay is automatically defeated upon loss or sustained undervoltage of alternate power source, provided that normal source has been restored.

2.1.6 Engine-Generator Exerciser

Exerciser. Solid-state, programmable-time switch exerciser to allow automatic starting of the generator set, subsequent load transfer, retransfer of load and shuts down engine after a preset cool-down period. Initiates exercise cycle at preset intervals adjustable from on a daily, weekly, bi-weekly or monthly basis.. Running periods are adjustable from 10-30 minutes. Factory settings are for 7-day exercise cycle, 20 minute running period and 5-minute cool-down period. Exerciser features include the following:

a. Exerciser Transfer Selector Switch: Permits selection of exercise with and without load transfer or dual independent exercisers that allow for unloaded and loaded schedule testing.

b. Push-button programming control with digital display of settings.

c. Integral battery operation of time switch when normal control power is not available.

2.1.7 Unassigned Auxiliary Contacts

Provide two normally open and two normally closed, single-pole, double-throw auxiliary contacts for each switch position rated at 20 amperes at 480 volts.

2.1.8 Front Panel Devices

Provide devices mounted on cabinet front consisting of:

a. Mode selector switch with the following positions and associated functions. Selector switch can be part of the microprocessor controller consisting of an LCD screen with a graphical interface or as a stand-alone test switch.

(1) TEST - Simulates loss of normal/preferred source system operation.

(2) NORMAL - Transfers system to normal/preferred source bypassing re-transfer time delay.

b. Switch position indicating lights or graphical LCD display. Indicate source to which load is connected.

c. Source-Available Monitor. Provide source-available indicating lights or graphical LCD display monitor that is labeled to show when one or both sources of power are available. If indicating lights are used, then the preference is to have Green be normal/preferred power and Red be for alternate/emergency power; however, other color schemes are allowed if clearly marked.

d. Provide a transfer override switch. Provide automatic transfer switch microprocessor based controller, which offers field selectable/adjustable inputs and outputs for transfer switch operation. Override switch must bypass automatic transfer controls so ATS will transfer and remain connected to generator power source, regardless of condition of normal/preferred source. Provide an indicating light to show override status. If alternate source fails and normal source is available, ATS is to automatically retransfer to normal source.

e. Lamp test button.

2.1.9 Voltage Unbalance

Provide automatic transfer switch controller or control logic to include positive and negative sequence voltage detection to identify a phase loss condition that can adversely effect motor loads.

2.1.10 In-Phase Monitor

Provide an in-phase monitor that consists of a factory-wired, internal relay that controls transfer so it occurs only when the two sources are synchronized in phase. Relay compares phase relationship and frequency difference between normal and emergency sources and initiates transfer when both sources are within 5 electrical degrees, and only if transfer can be completed within 60 electrical degrees. Transfer is initiated only if both sources are within 2 Hz of nominal frequency and 70 percent or more of nominal voltage Manufacturer is to provide information regarding

what conditions a transfer cannot be accomplished.

2.2 BY-PASS/ISOLATION SWITCH (BP/IS)

Include non-load-break by-pass/isolation switches for the indicated automatic transfer switches. Designs which disconnect or interrupt the load when bypassing are not acceptable. Include the following features for each combined by-pass/isolation switch and automatic transfer switch:

a. Bypass/isolation switch (BP/IS) and associated ATS are to be made by the same manufacturer and must be completely interconnected and tested at factory and at project site as specified.

b. ATS is to be manufactured, listed and tested in accordance with paragraph AUTOMATIC TRANSFER SWITCH. BP/IS switch current, voltage, closing, and short-circuit withstand closing ratings are to be equal or exceed comparable ratings specified for ATS and have the same phase arrangement and number of poles.

c. Provide externally operated and arranged selector switch or handle so designed and constructed not to stop in an intermediate or neutral position during operation and that one person can safely bypass the ATS. Accomplish isolation of the ATS externally by one person. Bypass and isolation handles must be permanently affixed and operable without opening the enclosure door. Provide interlocks that ensure ATS is disconnected from source and load during isolation. Interlocks prevent ATS operation, except for testing and maintenance, while isolated. BP/IS operation is to be accomplished without disconnecting switch load terminal conductors. Equipment which require separate tools, keys, or other devices to operate the bypass/isolation mechanism which may not be present during an emergency is not acceptable.

d. Provide drawout transfer switch that provides physical separation from bypass switch and live parts and accessibility for testing and maintenance operation.

e. Provide contacts that have the same contact temperature that do not exceed those of the ATS contacts when carrying rated load. Provide contacts as specified for associated ATS, including provisions for inspection of contacts without disassembly of BP/IS or removal of entire contact enclosure. Provide manufacturer instructions for determining contact integrity in order To facilitate maintenance.

f. The ATS controls remain functional with the ATS isolated or in bypass mode to permit monitoring of the normal power source and automatic starting of the generator in the event of a loss of the normal power source. In the isolated mode, the bypass section is capable of functioning as a manual transfer to transfer the load to either power source for maintenane purposes or when automatic control has failed. Equipment that requires automatic controls to be functional to operate the bypass switch is not acceptable.. The ATS can be completely removed from the enclosure, if required for maintenance or repair, while the bypass section continues to power the load.

h. Construct Bypass/isolation switch for convenient removal of parts from front of switch enclosure without removal of other parts or disconnection of external power conductors.

i. Achieve load by-pass to the source with no load interruption. Bypass/isolation equipment that breaks the load is not accpetalbe.

j. Provide drawout bypass switch that provides physical separation from ATS and live parts and accessibility for testing and maintenance operation. Provide automatic shutters that closed to isolate the bus.

k. Provide a means to ensure the switch is transferred to the alternate or emergency power source when normal power source becomes unavailable.

2.2.1 Markings

Mark isolation handle positions with engraved plates or other approved means to indicate position or operating condition of associated ATS, as follows:

a. Provide an indication that shows that BP/IS section is providing power to the load.

b. Provide indication of ATS isolation/test position.

c. Provide suitable control labels and instruction signs describing operating instructions.

d. Indicating lamps or LCD screen for indicating that shows the source availability, bypass switch position, transfer switch position, and isolation handle position. If indicating lights are used, provide a lamp test button that turns the indicating lights on, but does not cause any function to take place.

2.2.2 Interconnection

Interconnect BP/IS and associated ATS with suitably sized copper bus bars silver-plated at each connection point, and braced to withstand magnetic and thermal forces created at withstand current rating specified for associated ATS.

2.3 ENCLOSURE

Provide an enclosure that meets the following:

a. Provide ATS and accessories in a free-standing, floor-mounted, ventilated NEMA 250, Type 1, smooth sheet metal enclosure constructed in accordance with applicable requirements of NEMA ICS 6, UL 508, UL 1066, and UL 1008. Provide screened and filtered intake vents. Provide screened exhaust vents. Provide at least No. 14 metal gauge.

b. Factory wiring within enclosure and field wiring terminating within enclosure must comply with NFPA 70. Provide wire that is permanently tagged or marked near terminal at each end with wire number shown on approved detail drawing, when wiring is not color coded. Conform terminal block to NEMA ICS 4. Arrange terminals for entrance of external conductors from top and bottom of enclosure as shown. Main switch terminals, including neutral terminal if used, must be pressure type suitable for termination of external copper conductors shown.

2.3.1 Construction

Construct enclosure for ease of removal and replacement of ATS components

and control devices from front without disconnection of external power conductors or removal or disassembly of major components.

2.3.2 Cleaning and Painting

Protect both the inside and outside surfaces of an enclosure, including means for fastening against corrosion by enameling, galvanizing, plating, powder coating, or other equivalent means. Protection is not required for metal parts that are inherently resistant to corrosion, bearings, sliding surfaces of hinges, or other parts where such protection is impractical. Provide manufacturer's standard finish material, process, and color that is free from runs, sags, peeling, or other defects. An enclosure marked Type 1, 3R, 4 or 12 is acceptable if there is no visible rust at the conclusion of a salt spray (fog) test using the test method in ASTM B117, employing a 5 percent by weight, salt solution for 24 hours. Type 4X enclosures are acceptable following performance of the above test with an exposure time of 200 hours.

2.3.3 Field Fabricated Nameplates

Nameplate is to comply with ASTM D709. Provide laminated plastic nameplates for each equipment enclosure as specified or as indicated on the drawings. Provide an inscription on each nameplate that identifies the name of the equipment, sources of power, calculated short circuit with date and the location e.g. 'SWB-1 Electrical Room 103'. Provide nameplates that are made of melamine plastic, 0.125 inch thick, white with black center core. Provide the nameplate with a surface that is matte finished and that has square corners.. Accurately align lettering and engrave into the core. Provide nameplates that are at least 1.0 by 2.5 inches with a minimum lettering size of 0.25 inch high normal block style.

2.4 REMOTE ANNUNCIATOR AND CONTROL SYSTEM PANEL

Provide a remote annunciator and control system that utilizes a touchscreen human machine interface (HMI) with the ability to remotely monitor and control multiple transfer switches from a single panel. Minimum screen size is 7 inches. Provide password protection and date/time stamped alarm history. The controller is to have internal battery backup. In the event of a communication link failure, the system is to automatically revert to stand-alone, self-contained operation. Automatic transfer switch sensing, controlling or operating function is not to depend on remote panel for proper operation. Provide a surface mounted cabinet. Communication is to be by a RS-485 connection. The annunciator controller is to be configured to monitor and control 1 transfer switches.

2.4.1 Monitor

Monitor the following:

a. Sources available

b. Switch position.

c. Switch in test mode.

d. Overvoltage

e. Failure of communication link.

f. Engine test or exercise.

2.4.2 Alarm Screen

Alarm for the following conditions:

a. Alternate source closed

b. Undervoltage

c. Lockout.

2.4.3 Control Functions

Provide a means to perform the following functions from the controller: an alarm silence button in addition to monitoring the following items:

a. Control of switch-test initiation.

b. Control of switch operation in either direction.

c. Control of time-delay bypass for transfer to normal source.

d. Control to perform an engine test.

e. Provide a means to remotely configure transfer switch controller setpoints. The means to perform these changes must be password protected.

2.5 FACTORY TESTING

Submit a description of proposed field test procedures, including proposed date and steps describing each test, its duration and expected results, not less than 2 weeks prior to test date. Submit certified factory and field test reports, within 14 days following completion of tests. Provide reports that are certified and dated and that demonstrate that tests were successfully completed prior to shipment of equipment.

2.5.1 Prototype Factory Testing

A prototype of specified ATS is to be factory tested in accordance with UL 1008. In addition, perform factory tests on each ATS as follows:

a. Insulation resistance test to ensure integrity and continuity of entire system

b. Main switch contact resistance test.

c. Visual inspection to verify that each ATS is as specified.

d. Mechanical test to verify that ATS sections are free of mechanical hindrances.

e. Electrical tests to verify complete system electrical operation and to set up time delays and voltage sensing settings.

2.5.2 Factory Test Reports

Provide three certified copies of factory test reports from the

manufacturer.

PART 3 EXECUTION

3.1 INSTALLATION

Installation must conform to the requirements of NFPA 70 and manufacturer's recommendation.

3.2 PREREQUISITES FOR FUNCTIONAL ACCEPTANCE TESTING

Completion of the following requirements is mandatory prior to scheduling functional acceptance tests for the automatic transfer switch.

3.2.1 Manufacturers O&M Information

The manufacturers O&M information required by the paragraph entitled "SD-10 Operation and Maintenance Data", is to be submitted to and approved by the Contracting Officer.

3.2.2 Test Equipment

Ensure all test equipment and instruments is on hand prior to scheduling field tests, or subject to Contracting Officer's approval, evidence must be provided to show that arrangements have been made to have the necessary equipment and instruments on site prior to field testing.

3.3 FIELD QUALITY CONTROL

Give Contracting Officer 15 days notice of dates and times scheduled for tests which require the presence of the Contracting Officer. The Contracting Officer will coordinate with the using activity and schedule a time that will eliminate or minimize interruptions and interference with the activity operations. The contractor is responsible for costs associated with conducting tests outside of normal working hours and with incorporating special arrangements and procedures, including temporary power conditions. The contractor provides labor, equipment, apparatus, including test load, and consumables required for the specified tests. Calibration of all measuring devices and indicating devices must be certified. Provide the services of a qualified factory-trained manufacturer's representative to assist the contractor in installation and start-up of the equipment specified under this section. The manufacturer's representative is to provide technical direction and assistance to the contractor in general assembly of the equipment, connections and adjustments, and testing of the assembly components contained herein. Provide a test load that is a cataloged product in accordance with Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Perform the following field tests in accordance with the manufacturer's recommendations and include the following visual and mechanical inspections and electrical tests, performed in accordance with NETA ATS.

3.3.1 Automatic Transfer Switch Acceptance Checks and Tests

a. Visual and Mechanical Inspection

(1) Compare equipment nameplate data with specifications and approved shop drawings.

(2) Inspect physical and mechanical condition.

(3) Confirm correct application of manufacturer's recommended lubricants.

(4) Verify that manual transfer warnings are attached and visible.

(5) Verify tightness of all control connections.

(6) Verify tightness of accessible bolted connections by calibrated torque-wrench method. Thermographic survey is not required.

(7) Perform manual transfer operation.

(8) Verify positive mechanical interlocking between normal and alternate sources.

b. Electrical Tests

(1) Measure contact-resistance. Correct values that exceed 500 microhms and values for 1 pole deviating by more than 50 percent from other poles.

(2) Perform insulation-resistance on each pole, phase-to-phase and phase-to-ground with switch closed, and across each open pole for one minute. Perform tests in both source positions.

(3) Verify settings and operations of control devices.

(4) Calibrate and set all relays and timers.

(5) Test ground-fault protective device.

3.3.2 Functional Acceptance Tests

Functional Acceptance Tests must be coordinated with Section 26 32 15.00 ENGINE-GENERATOR SET STATIONARY 15-2500 KW, WITH AUXILIARIES. Include simulating power failure and demonstrating the following operations for each automatic transfer switch. Demonstrate in service that the automatic transfer switches are in good operating condition, and function not less than five times.

a. Perform automatic transfer tests:

(1) Simulate loss of normal/preferred power.

(2) Return to normal/preferred power.

(3) Simulate loss of emergency/alternate power.

(4) Simulate all forms of single-phase conditions.

b. Verify correct operation and timing of the following functions:

(1) Normal source voltage-sensing relays.

(2) Engine start sequence.

(3) Time delay upon transfer.

(4) Alternate source voltage-sensing relays.

(5) Automatic transfer operation.

(6) Interlocks and limit switch function.

(7) Time delay and retransfer upon normal power restoration.

(8) By-pass/isolation functional modes and related automatic transfer switch operations.

3.3.3 Infrared Scanning

After Substantial Completion, but not more than 60 days after Final Acceptance, perform an infrared scan of each switch. Remove all access panels so joints and connections are accessible to portable scanner.

a. Follow-up Infrared Scanning: Perform an additional follow-up infrared scan of each switch 11 months after acceptance.

b. Instrument: Use an infrared scanning device designed to measure temperature or to detect significant deviations from normal values. Provide calibration record for device.

c. Record of Infrared Scanning: Prepare a certified report that identifies switches checked and that describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.

3.4 TRAINING

Provide 4 hours of training to maintenance personnel on the proper operation, maintenance and adjustment of the automatic transfer switch. Coordinate this training with that of the generator equipment.

-- End of Section --

SECTION 26 51 00

INTERIOR LIGHTING
05/20, CHG 2: 11/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM A580/A580M	(2018) Standard Specification for Stainless Steel Wire
ASTM A641/A641M	(2019) Standard Specification for Zinc-Coated (Galvanized) Carbon Steel Wire
ASTM A653/A653M	(2020) Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
ASTM A1008/A1008M	(2021) Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable
ASTM B164	(2003; R 2014) Standard Specification for Nickel-Copper Alloy Rod, Bar, and Wire
ASTM B633	(2019) Standard Specification for Electrodeposited Coatings of Zinc on Iron and Steel
ASTM D4674 REV A	(2002; R 2010) Standard Practice for Accelerated Testing for Color Stability of Plastics Exposed to Indoor Office Environments

EUROPEAN UNION (EU)

Directive 2011/65/EU	(2011) Restriction of the Use of Certain Hazardous Substances in Electrical and Electronic Equipment

ILLUMINATING ENGINEERING SOCIETY (IES)

ANSI/IES LM-79	(2019) Approved Method: Electrical and Photometric Measurements of Solid State Lighting Products
ANSI/IES LM-80	(2020) Approved Method: Measuring Luminous Flux and Color Maintenance of LED

	Packages, Arrays and Modules
ANSI/IES LS-1	(2020) Lighting Science: Nomenclature and Definitions for Illuminating Engineering
ANSI/IES TM-15	(2020) Technical Memorandum: Luminaire Classification System for Outdoor Luminaires
ANSI/IES TM-21	(2019) Technical Memorandum: Projecting Long-Term Lumen, Photon, and Radiant Flux Maintenance of LED Light Sources
ANSI/IES TM-30	(2020) Technical Memorandum: IES Method for Evaluating Light Source Color Rendition
IES Lighting Library	IES Lighting Library

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 100	(2000; Archived) The Authoritative Dictionary of IEEE Standards Terms
IEEE C2	(2017; Errata 1-2 2017; INT 1 2017) National Electrical Safety Code
IEEE C62.41	(1991; R 1995) Recommended Practice on Surge Voltages in Low-Voltage AC Power Circuits

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA 77	(2017) Temporal Light Artifacts: Test Methods and Guidance for Acceptance Criteria
NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)
NEMA ANSLG C78.377	(2017) Electric Lamps– Specifications for the Chromaticity of Solid State Lighting Products
NEMA C82.77-10	(2020) Harmonic Emission Limits - Related Power Quality Requirements
NEMA ICS 2	(2000; R 2020) Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 V
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures
NEMA SSL 1	(2016) Electronic Drivers for LED Devices, Arrays, or Systems
NEMA SSL 3	(2011) High-Power White LED Binning for General Illumination

NEMA SSL 7A	(2015) Phase-Cut Dimming for Solid State Lighting: Basic Compatibility
NEMA WD 1	(1999; R 2020) Standard for General Color Requirements for Wiring Devices
NEMA WD 7	(2011; R 2016) Occupancy Motion Sensors Standard

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code
NFPA 101	(2021) Life Safety Code

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

47 CFR 15	Radio Frequency Devices

UNDERWRITERS LABORATORIES (UL)

UL 20	(2018; Reprint Jan 2021) UL Standard for Safety General-Use Snap Switches
UL 94	(2013; Reprint May 2021) UL Standard for Safety Tests for Flammability of Plastic Materials for Parts in Devices and Appliances
UL 508	(2018; Reprint Jul 2021) UL Standard for Safety Industrial Control Equipment
UL 916	(2015) Standard for Energy Management Equipment
UL 917	(2006; Reprint Aug 2013) UL Standard for Safety Clock-Operated Switches
UL 924	(2016; Reprint May 2020) UL Standard for Safety Emergency Lighting and Power Equipment
UL 1472	(2015) UL Standard for Safety Solid-State Dimming Controls
UL 1598	(2021; Reprint Jun 2021) Luminaires
UL 2043	(2013) Fire Test for Heat and Visible Smoke Release for Discrete Products and Their Accessories Installed in Air-Handling Spaces
UL 8750	(2015; Reprint Jul 2021) UL Standard for Safety Light Emitting Diode (LED) Equipment for Use in Lighting Products

1.2 RELATED REQUIREMENTS

Materials not considered to be luminaires, luminaire accessories, or lighting equipment are specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Luminaires and accessories that are mounted in exterior environments and not attached to the exterior of the building are specified in Section 26 56 00 EXTERIOR LIGHTING.

1.3 DEFINITIONS

a. Unless otherwise specified or indicated, electrical and electronics terms used in these specifications and on the drawings, must be as defined in IEEE 100 and ANSI/IES LS-1.

b. For LED luminaire light sources, "Useful Life" is the operating hours before reaching 70 percent of the initial rated lumen output (L70) with no catastrophic failures under normal operating conditions. This is also known as 70 percent "Rated Lumen Maintenance Life" as defined in ANSI/IES LM-80.

c. For LED luminaires, "Luminaire Efficacy" (LE) is the appropriate measure of energy efficiency, measured in lumens/watt. This is gathered from LM-79 data for the luminaire, in which absolute photometry is used to measure the lumen output of the luminaire as one entity, not the source separately and then the source and housing together.

d. Total harmonic distortion (THD) is the root mean square (RMS) of all the harmonic components divided by the total fundamental current.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for Contractor Quality Control approval. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Luminaire Drawings; G

Occupancy/Vacancy Sensor Coverage Layout; G; S

SD-03 Product Data

Luminaires; G

Light Sources; G

LED Drivers; G

Luminaire Warranty; G

Lighting Contactor; G

Switches; G

Occupancy/Vacancy Sensors; G

Photosensors; G

Time Clocks; G

Power Packs; G

Exit Signs; G

Emergency Drivers; G

SD-05 Design Data

Luminaire Design Data; G

Photometric Plan; G

SD-06 Test Reports

ANSI/IES LM-79 Test Report; G

ANSI/IES LM-80 Test Report; G

ANSI/IES TM-21 Test Report; G

ANSI/IES TM-30 Test Report; G

Occupancy/Vacancy Sensor Verification Test; G

Photosensor Verification Test; G

SD-07 Certificates

LED Driver and Dimming Switch Compatibility Certificate; G

SD-10 Operation and Maintenance Data

Lighting System, Data Package 5; G

Maintenance Staff Training Plan; G

End-User Training Plan; G

1.5 QUALITY ASSURANCE

Data, drawings, and reports must employ the terminology, classifications and methods prescribed by the IES Lighting Library as applicable, for the lighting system specified.

1.5.1 Luminaire Drawings

Include dimensions, accessories installation details, and construction details. Photometric data, including CRI, CCT, LED driver type, aiming diagram, zonal lumen data, and candlepower distribution data must accompany shop drawings.

1.5.2 Luminaire Design Data

a. Provide safety certification and file number for the luminaire family

that must be listed, labeled, or identified in accordance with the NFPA 70. Applicable testing bodies are determined by the US Occupational Safety Health Administration (OSHA) as Nationally Recognized Testing Laboratories (NRTL) and include: CSA (Canadian Standards Association), ETL (Edison Testing Laboratory), and UL (Underwriters Laboratories).

b. Provide long term lumen maintenance projections for each LED luminaire in accordance with ANSI/IES TM-21. Data used for projections must be obtained from testing in accordance with ANSI/IES LM-80.

1.5.3 ANSI/IES LM-79 Test Report

Submit test report on manufacturer's standard production model of specified luminaire. Testing must be performed at the same operating drive current as specified luminaire. Include all applicable and required data in IES format as outlined under "14.0 Test Report" in ANSI/IES LM-79.

1.5.4 ANSI/IES LM-80 Test Report

Submit report on manufacturer's standard production LED light source (package, array, or module) of specified luminaire. Testing must be performed at the same operating drive current as specified luminaire. Include all applicable and required data as outlined under "8.0 Test Report" in ANSI/IES LM-80.

1.5.5 ANSI/IES TM-21 Test Report

Submit test report on manufacturer's standard production LED light source (package, array, or module) of specified luminaire. Testing must be performed at the same operating drive current as specified luminaire. Include all applicable and required data, as well as required interpolation information as outlined under "7.0 Report" in ANSI/IES TM-21.

1.5.6 ANSI/IES TM-30 Test Report

Submit color vector graphic in accordance with ANSI/IES TM-30 on manufacturer's standard production LED light source (package, array, or module) of specified luminaire. Include spectral distribution of test LED light source.

1.5.7 LED Driver and Dimming Switch Compatibility Certificate

Submit certification from the luminaire, driver, or dimmer switch manufacturer that ensures compatibility and operability between devices without flickering and to specified dimming levels.

1.5.8 Photometric Plan

1.5.8.1 Computer-generated Photometric Plans

Computer-generated photometric plans for each space are required to verify proposed luminaires and locations meet the required performance criteria of the design using the applicable light loss factor (LLF).

Target illumination levels are provided for each Interior Application. Depending on the application and the recommendations provided by the IES, values are given as one of the following:

a. Minimum: No values anywhere on the calculation grid may be less than this value, within a 10 percent margin of error.

b. Minimum Average: An average, taken over the entire task area for the application, may not be less than this value, within a 10 percent margin of error.

c. Maximum: No values anywhere on the calculation grid may be greater than this value, within a 10 percent margin of error.

d. Maximum Average: An average, taken over the entire task area for the application, may not be greater than this value, within a 10 percent margin of error.

e. Uniformity: Unless otherwise noted, uniformity is calculated as a ratio of the average calculated illuminance over the minimum calculated illuminance of the calculation grid.

1.5.8.2 Schematic Photometric Plan Calculations

Schematic photometric plan calculations must include:

a. Horizontal illuminance measurements at workplane or other designated height above finished floor, taken at a maximum of every one foot across the task area.

b. Average maintained illuminance level.

c. Minimum and maximum maintained illuminance levels.

d. Lighting power density (Watts per square foot).

e. LLF. Recommended LLF is 0.81 for LED luminaires but LLF varies based on environment and application.

1.5.8.3 Final Photometric Plan Calculations

Final photometric plan calculations must include:

a. Horizontal illuminance measurements at workplane or other designated height above finished floor, taken at a maximum of every one foot across the task area.

b. Where applicable, vertical illuminance measurements at designated surface, taken at a maximum of every one foot across task area.

c. Minimum and maximum maintained illuminance levels.

d. Average maintained illuminance level.

e. Average to minimum and maximum to minimum ratios for horizontal illuminance.

f. Lighting power density (Watts per square foot).

g. LLF. Recommended LLF is 0.81 for LED luminaires but LLF varies based on environment and application.

1.5.9 Occupancy/Vacancy Sensor Coverage Layout

Provide floor plans showing coverage layouts of all devices using manufacturer's product information.

1.5.10 Test Laboratories

Test laboratories for the ANSI/IES LM-79 and ANSI/IES LM-80 test reports must be one of the following:

a. National Voluntary Laboratory Accreditation Program (NVLAP) accredited for solid-state lighting testing as part of the Energy-Efficient Lighting Products laboratory accreditation program for both LM-79 and LM-80 testing.

b. One of the qualified labs listed on the Department of Energy - LED Lighting Facts Approved Testing Laboratories List for LM-79 testing.

c. One of the EPA-Recognized Laboratories listed for LM-80 testing.

1.5.11 Regulatory Requirements

Equipment, materials, installation, and workmanship must be in accordance with the mandatory and advisory provisions of NFPA 70, unless more stringent requirements are specified or indicated. Provide luminaires and assembled components that are approved by and bear the label of UL for the applicable location and conditions unless otherwise specified.

1.5.12 Standard Products

Provide materials and equipment that are products of manufacturers regularly engaged in the production of such products which are of equal material, design, and workmanship. Products must have been in satisfactory commercial or industrial use for six months prior to bid opening. The six-month period must include applications of equipment and materials under similar circumstances and of similar size. The product must have been on sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the six-month period. Where two or more items of the same class of equipment are required, these items must be products of a single manufacturer; however, the component parts of the item need not be the products of the same manufacturer unless stated in this section.

1.5.12.1 Alternative Qualifications

Products having less than a six-month field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturers' factory or laboratory tests, is furnished.

1.5.12.2 Material and Equipment Manufacturing Date

Do not use products manufactured more than six months prior to date of delivery to site, unless specified otherwise.

1.6 WARRANTY

Support all equipment items by service organizations which are reasonably convenient to the equipment installation in order to render satisfactory

service to the equipment on a regular and emergency basis during the warranty period of the contract.

1.6.1 Luminaire Warranty

Provide and transfer to the government the original LED luminaire manufacturers standard commercial warranty for each different luminaire manufacturer used in the project.

a. Provide a written five year minimum replacement warranty for material, luminaire finish, and workmanship. Provide written warranty document that contains all warranty processing information needed, including customer service point of contact, whether or not a return authorization number is required, return shipping information, and closest return location to the luminaire location.

(1) Finish warranty must include failure and substantial deterioration such as blistering, cracking, peeling, chalking, or fading.

(2) Material warranty must include:

(a) All LED drivers and integral control equipment.

(b) Replacement when more than 15 percent of LED sources in any lightbar or subassembly(s) are defective, non-starting, or operating below 70 percent of specified lumen output.

b. Warranty period must begin in accordance with the manufacturer's standard warranty starting date.

c. Provide replacements that are promptly shipped, without charge, to the using Government facility point of contact and that are identical to or an improvement upon the original equipment. All replacements must include testing of new components and assembly.

1.7 OPERATION AND MAINTENANCE MANUALS

1.7.1 Lighting System

Provide operation and maintenance manuals for the lighting system in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA that provide basic data relating to the design, operation, and maintenance of the lighting system for the building. Include the following:

a. Manufacturers' operating and maintenance manuals.

b. Luminaire shop drawings for modified and custom luminaires.

c. Luminaire Manufacturers' standard commercial warranty information as specified in paragraph LUMINAIRE WARRANTY.

PART 2 PRODUCTS

2.1 PRODUCT COORDINATION

2.2 LUMINAIRES

UL 1598, NEMA C82.77-10. Provide luminaires as indicated in the luminaire schedule and NL plates or details on project plans, complete with light

source, wattage, and lumen output indicated. All luminaires of the same type must be provided by the same manufacturer. Luminaires must be specifically designed for use with the driver and light source provided.

2.2.1 Luminaires

UL 8750, ANSI/IES LM-79, ANSI/IES LM-80. For all luminaires, provide:

a. Complete system with LED drivers and light sources.

b. Housings constructed of non-corrosive materials. All new aluminum housings must be anodized or powder-coated. All new steel housings must be treated to be corrosion resistant.

c. ANSI/IES TM-21, ANSI/IES LM-80. Minimum L70 lumen maintenance value of 50,000 hours unless otherwise indicated in the luminaire schedule. Luminaire drive current value must be identical to that provided by test data for luminaire in question.

d. Minimum efficacy as specified in the luminaire schedule. Theoretical models of initial lamp lumens per watt are not acceptable. If efficacy values are not listed in the luminaire schedule, provide luminaires that meet the following minimum values:

Luminaire Style	Minimum Luminaire Efficacy
Recessed 1 by 4, 2 by 4, and 2 by 2	100 LPW
Recessed Downlight (fixed, adjustable, wallwash)	80 LPW
Exterior Wall Sconce	50 LPW

e. UL listed for dry or damp location typical of interior installations. Any luminaire mounted on the exterior of the building must be UL listed for wet location typical of exterior installations.

f. LED driver and light source package, array, or module are accessible for service or replacement without removal or destruction of luminaire.

g. Lenses constructed of heat tempered borosilicate glass, UV-resistant acrylic, or silicone. Sandblasting, etching and polishing must be performed as indicated in the luminaire description.

h. ANSI/IES TM-15. Provide exterior building-mounted luminaires that do not exceed the BUG ratings as listed in the luminaire schedule. If BUG ratings are not listed in the luminaire schedule, provide luminaires that meet the following minimum values for each application and mounting conditions:

Lighting Application	Mounting Conditions	BUG Rating
Exterior Wall Sconce	Above 6 feet AFF	B1-U0-G2

i. For all recessed luminaires that are identified to be in contact with insulation, provide luminaires that are IC-rated.

2.3 LIGHT SOURCES

NEMA ANSLG C78.377, NEMA SSL 3. Provide type, delivered lumen output, and wattage as indicated in the luminaire schedule on project plans.

2.3.1 LED Light Sources

Provide LED light sources that meet the following requirements:

a. NEMA ANSLG C78.377. Emit white light and have a nominal CCT of 4000 Kelvin.

b. Minimum Color Rendering Index (CRI) of 80.

c. Directive 2011/65/EU. Restriction of Hazardous Substances (RoHS) compliant.

d. Light source color consistency by utilizing a binning tolerance within a 3-step McAdam ellipse.

2.4 LED DRIVERS

NEMA SSL 1, UL 8750. Provide LED drivers that are electronic, UL Class 1 or Class 2, constant-current type and that comply with the following requirements:

a. The combined driver and LED light source system does not exceed the minimum luminaire efficacy values as listed in the luminaire schedule provided.

b. Operates at a voltage of 120-277 volts at 50/60 hertz, with input voltage fluctuations of plus/minus 10 percent.

c. Power Factor (PF) greater than or equal to 0.90 at full input power and across specified dimming range.

d. Maximum Total Harmonic Distortion (THD) less than 20 percent at full input power and across specified dimming range.

e. Operates for at least 50,000 hours at maximum case temperature and 90 percent non-condensing relative humidity.

f. Withstands Category A surges of 2 kV without impairment of performance. Provide surge protection that is integral to the driver.

g. Integral thermal protection that reduces the output power to protect the driver and light source from damage if the case temperature approaches or exceeds the driver's maximum operating temperature.

h. 47 CFR 15. Complies with the requirements of the Federal Communications Commission (FCC) rules and regulations, Non-Consumer (Class A) for EMI/RFI (conducted and radiated).

i. Class A sound rating.

j. Directive 2011/65/EU. Restriction of Hazardous Substances (RoHS) compliant.

k. Provide dimming capability as indicated in the luminaire schedule on project plans. Dimmable drivers must dim down to 1 percent. Dimmable drivers must be controlled by a Class 2 low voltage 0-10VDC controller dimming signal protocol unless otherwise specified. LED drivers of the same family/series must track evenly across multiple luminaires at all light levels.

2.5 LIGHTING CONTROLS

Provide lighting control systems that do not switch off battery-operated or emergency backup luminaires or exit signs in path of egress. Provide system with override of lighting control devices controlling luminaires in path of egress with activation of fire alarm system.

2.5.1 System

Provide lighting control system that operates the lighting system as described in the lighting control strategies in the project plans. Submit Sequence of Operation for Lighting Control System describing the operation of the proposed lighting control system and devices. Sequence of Operation must provide the strategies identified in the lighting control strategies.

2.5.1.1 Centralized Control Systems

2.5.1.1.1 Lighting Contactor

NEMA ICS 2, NEMA ICS 6. Provide an electrically-held lighting contactor housed in a NEMA 1 enclosure. Provide contactor with one normally-open(NO), single pole contacts, rated 600 volts, 30 amps. Provide coil operating voltage of 277 volts.

2.5.2 Devices

2.5.2.1 Switches

Provide line-voltage toggle switches as specified in Section 26 20 00

INTERIOR DISTRIBUTION SYSTEM. When used for non-digital loads, devices must be rated at 20 Amps inductive load, and be compatible with the lighting control systems.

2.5.2.2 Wall Box Dimmers

UL 1472, UL 20, IEEE C62.41, NEMA 77, NEMA SSL 7A. Dimmers must provide flicker-free, continuously variable light output throughout the dimming range of 1 percent to 100 percent. Devices must be capable of operating at their full rated capacity regardless of being single or ganged-mounted, and be compatible with three-way and four-way switching scenarios.

Provide wall-box dimmers that meet the following requirements:

a. Device operates as an independent control device.

b. Device operates with the use of a vertical slider, paddle, rotary, button, or toggle with adjacent vertical slider.

c. Finish of device matches switches and outlets in the same area.

d. Back box in wall has sufficient depth to accommodate body of switch and wiring.

e. Dimmer is capable of controlling 0-10 volt LED drivers. Dimmers and the drivers they control must be provided from the same manufacturer or tested and certified as compatible for use together.

f. Radio frequency interference suppression is integral to device.

2.5.2.3 Occupancy/Vacancy Sensors

IEEE C62.41, NEMA WD 1, UL 94, UL 916, UL 508, ASTM D4674 REV A, NEMA WD 7. Provide occupancy/vacancy sensors with coverage patterns as indicated on manufacturer shop drawings. Provide no less quantity of sensors as shown on plans, but add additional sensors when required to fulfill coverage requirement for the specific model of sensor provided. Provide sensor types as described in the sequence of operations. Sensor locations and quantities are shown in shop drawings provided by the lighting control system manufacturer. Provide vacancy sensor operation that requires manual control to activate luminaires and turns luminaires off after a set time of inactivity. Provide ceiling or wall-mounted occupancy/vacancy sensors that meet the following requirements:

a. Operating voltage of 120-277 volts.

b. Time delay of 30 seconds to 30 minutes with at least four intermediate time delay settings.

c. Sensors are ceiling mounted and wall mounted.

d. No minimum load requirement and be capable of switching from zero to 800 W at 120 VAC, 50/60 Hz and from zero to 1200 W at 277 VAC, 50/60 Hz.

e. Shielded or controlled by internal logic to adjust sensitivity to avoid false triggering due to ambient temperature, air temperature variations or HVAC air movement.

f. Sensor is equipped to automatically energize the connected load upon loss of normal power when located in a means of egress.

g. Occupancy and vacancy operation is field-adjustable and programmable with push-button or dip switch on the sensor device.

h. No leakage current to load when in the off mode.

i. Utilize zero-crossing circuitry to prevent damage from high inrush current and to promote long life operation.

2.5.2.3.1 Passive Infrared Sensors

Provide Passive Infrared Sensors (PIR) sensors that detect occupancy by sensing heat and movement in the area of coverage. Provide sensors are constructed of a housing of high-impact, injection-molded thermoplastic. Provide PIR sensors that are temperature compensated, with a dual element sensor and a multi-element fresnel lens of POLY IR4 material.

2.5.2.3.2 Ultrasonic Sensors

Provide ultrasonic sensors that detect occupancy by sensing a change in pattern of reflected ultrasonic waves in the area of coverage. Provide sensors that are constructed of a housing of high-impact, injection-molded thermoplastic. Provide ultrasonic sensors that operate at 40 kHz.

2.5.2.3.3 Dual Technology Sensors

Provide dual technology sensors that meet the requirements for PIR sensors and ultrasonic sensors indicated above. If either the PIR or ultrasonic sensing registers occupancy, the luminaires must remain on.

2.5.2.3.4 Power Packs

UL 2043. Provide power packs to provide power to lighting control sensors as required in accordance with the manufacturer's specifications. Provide power packs that meet the following requirements:

a. Operate at an input voltage of 120-277 VAC, with an output voltage 12-24 VDC at 225 mA.

b. Constructed of plenum-rated, high-impact thermoplastic enclosure.

c. Utilizes zero-crossing circuitry to prevent damage from inrush current.

d. Maximum load rating of 16 amps for electronic lighting loads.

e. Directive 2011/65/EU. Restriction of Hazardous Substances (RoHS) compliant.

2.5.2.4 Photosensors

Provide photosensors that meet the following requirements:

a. Detect changes in ambient lighting level and enable dimming as required by sequence of operation by operating in an open-loop system.

b. Contain a detection cone, where the base of the cone may be circular or an elongated shape, and where the smallest angle between the edge

and the axis of the cone is between 20 and 50 degrees. The cone axis may be tilted to the vertical when installed to give the sensor preferred directionality.

c. Sensors are wall-box-mounted with sensitivity, filtering, range and viewing angle to meet requirements of sequence of operation, scope of work and construction documents.

d. Time delay that is adjustable from 1 to 30 seconds ON delay, and 1 to 30 minutes OFF delay to prevent cycling, with deadband adjustment of 25 percent to 100 percent above lower setpoint.

e. Output dimming signal is linear to light level with less than 1 percent variation. Cadmium sulfide photo-resistors are not acceptable.

f. Sensor is not combined in the same housing or location with occupancy or vacancy sensors if the proper location for one function compromises the successful operation of the other function, or in any way reduces the system's ability to meet the design intent.

2.5.2.5 Time Clocks

UL 917, NEMA ICS 6. House time clock in a surface-mounted, lockable, NEMA 1 enclosure constructed of painted steel or plastic polymer. Provide electronic type time clock that meets the following criteria:

a. Astronomic programming function, providing a total of 56 on/off set points.

b. 24 hour type digital clock display format.

c. Power outage back-up for time clock utilizing alkaline batteries which provides coverage for a minimum of four days.

d. Capable of controlling a minimum of 8 channels or loads.

e. Contacts are rated for 30 amps at 120-277 VAC resistive load in a SPST normally open (NO) configuration.

f. Contains manual bypass or remote override control, daylight savings time automatic adjustment, and ability for photosensor input.

2.6 EXIT AND EMERGENCY LIGHTING EQUIPMENT

2.6.1 Exit Signs

UL 924, NFPA 101. Provide wattage as indicated in the luminaire schedule on project plans. Provide LED Exit Signs that meet the following criteria:

a. Housing constructed of UV-stable, thermo-plastic finish.

b. UL listed for damp location.

c. Configured for universal mounting.

d. 6 inch high, 3/4 inch stroke red lettering on face of sign with chevrons on either side of lettering to indicate direction.

e. Single or double face as indicated in project plans and luminaire

schedule.

2.6.1.1 Exit Signs with Battery Backup

Equip with automatic power failure device, test switch, and pilot light, and fully automatic high/low trickle charger in a self-contained power pack. Battery must be sealed, maintenance free nickel-cadmium type, and must operate unattended for a period of not less than five years. Emergency run time must be a minimum of 1-1/2 hours. LEDs must have a minimum rated life of 10 years. Provide self-diagnostic circuitry integral to emergency LED driver..

2.6.2 LED Emergency Drivers

UL 924, NFPA 101. Provide LED emergency driver with automatic power failure detection, test switch and LED indicator (or combination switch/indicator) located on luminaire exterior, and fully-automatic solid-state charger, battery and inverter integral to a self-contained housing. Provide self-diagnostic function integral to emergency driver. Integral nickel-cadmium battery is required to supply a minimum of 90 minutes of emergency power at 10 watts, 10-50 VDC compatible with LED forward voltage requirements, constant output. Driver must be RoHS compliant, rated for installation in plenum-rated spaces and damp locations, and be warranted for a minimum of five years.

2.6.3 Self-Diagnostic Circuitry for LED Drivers

UL 924, NFPA 101. Provide emergency lighting unit with fully-automatic, integral self-testing/diagnostic electronic circuitry. Circuitry must provide for a one minute diagnostic test every 28 days, and a 30 minute diagnostic test every six months, minimum. Any malfunction of the unit must be indicated by LED(s) visible from the exterior of the luminaire. A manual test switch must also be provided to perform a diagnostic test at any given time.

2.7 LUMINAIRE MOUNTING ACCESSORIES

2.7.1 Suspended Luminaires

a. Provide hangers capable of supporting twice the combined weight of luminaires supported by hangers.

b. Hangers must allow luminaires to swing within an angle of 45 degrees. Brace pendents 4 feet or longer to limit swinging.

c. Single-unit suspended luminaires must have cable hangers. Multiple-unit or continuous row luminaires with a separate power supply cord must have a tubing or stem for wiring at one point and a tubing or rod suspension provided for each unit length of chassis, including one at each end.

d. Provide all linear pendent and surface mounted luminaires with two supports per four-foot section or three per eight-foot section unless otherwise recommended by manufacturer.

2.7.2 Recess and Surface Mounted Luminaires

Provide access to light source and LED driver from bottom of luminaire. Provide trim and lenses for the exposed surface of flush-mounted

luminaires as indicated on project drawings and specifications. Luminaires recessed in ceilings which have a fire resistive rating of one hour or more must be enclosed in a box which has a fire resistive rating equal to that of the ceiling. For surface mounted luminaires with brackets, provide flanged metal stem attached to outlet box, with threaded end suitable for supporting the luminaire rigidly in design position. Flanged part of luminaire stud must be of broad base type, secured to outlet box at not fewer than three points.

2.7.3 Luminaire Support Hardware

2.7.3.1 Wire

ASTM A641/A641M. Galvanized, soft tempered steel, minimum 0.11 inches in diameter, or galvanized, braided steel, minimum 0.08 inches in diameter.

2.7.3.2 Wire for Humid Spaces

ASTM A580/A580M. Composition 302 or 304, annealed stainless steel, minimum 0.11 inches in diameter.

ASTM B164. UNS NO4400, annealed nickel-copper alloy, minimum 0.11 inches in diameter.

2.7.3.3 Threaded Rods

Threaded steel rods, 3/16 inch diameter, zinc or cadmium coated.

2.7.3.4 Straps

Galvanized steel, one by 3/16 inch, conforming to ASTM A653/A653M, with a light commercial zinc coating or ASTM A1008/A1008M with an electrodeposited zinc coating conforming to ASTM B633, Type RS.

2.8 EQUIPMENT IDENTIFICATION

2.8.1 Manufacturer's Nameplate

Each item of equipment must have a nameplate bearing the manufacturer's name, address, model number, and serial number securely affixed in a conspicuous place; the nameplate of the distributing agent will not be acceptable.

2.8.2 Labels

UL 1598. All luminaires must be clearly marked for operation of specific light sources and LED drivers. The labels must be easy to read when standing next to the equipment, and durable to match the life of the equipment to which they are attached. Note the following light source characteristics in the format "Use Only _____":

a. Correlated Color Temperature (CCT) and Color Rendering Index (CRI) for all luminaires.

b. Driver and dimming protocol.

All markings related to light source type must be clear and located to be readily visible to service personnel, but unseen from normal viewing angles when light sources are in place. LED drivers must have clear

markings indicating dimming type and indicate proper terminals for the various outputs.

2.9 FACTORY APPLIED FINISH

NEMA 250. Provide all luminaires and lighting equipment with factory-applied painting system that as a minimum, meets requirements of corrosion-resistance testing.

PART 3 EXECUTION

3.1 INSTALLATION

IEEE C2, NFPA 70.

3.1.1 Light Sources

When light sources are not provided as an integral part of the luminaire, deliver light sources of the type, wattage, lumen output, color temperature (CCT), color rendering index (CRI), and voltage rating indicated to the project site and install just prior to project completion, if not already installed in the luminaires from the factory.

3.1.2 Luminaires

Set luminaires plumb, square, and level with ceiling and walls, in alignment with adjacent luminaires and secure in accordance with manufacturers' directions and approved drawings. Provide accessories as required for ceiling construction type indicated on Finish Schedule. Luminaire catalog numbers do not necessarily denote specific mounting accessories for type of ceiling in which a luminaire may be installed. Provide wires, straps, or rods for luminaire support in this section. Install luminaires with vent holes free of air blocking obstacles.

3.1.2.1 Recessed and Semi-Recessed Luminaires

a. Support recessed and semi-recessed luminaires independently from the building structure by a minimum of two wires, straps or rods per luminaire and located near opposite corners of the luminaire. Secure horizontal movement with clips provided by manufacturer. Ceiling grid clips are not allowed as an alternative to independently supported luminaires.

b. Support round luminaires or luminaires smaller in size than the ceiling grid independently from the building structure by a minimum of four wires, straps or rods per luminaire, spaced approximately equidistant around.

c. Do not support luminaires by acoustical tile ceiling panels.

d. Where luminaires of sizes less than the ceiling grid are indicated to be centered in the acoustical panel, support each independently and provide at least two 3/4 inch metal channels spanning, and secured to, the ceiling tees for centering and aligning the luminaire.

e. Luminaires installed in suspended ceilings must also comply with the requirements of Section 09 51 00 ACOUSTICAL CEILINGS.

f. Adjust aperture rings on all applicable ceiling recessed luminaires to

accommodate various ceiling material thickness. Coordinate cut-out size in ceiling to ensure aperture covers cut-out entirely. Install aperture rings such that the bottom of the ring is flush with finished ceiling or not more than 1/16 inch above. Do not install luminaires such that the aperture ring extends below the finished ceiling surface.

3.1.3 LED Drivers

Provide LED drivers integral to luminaire as constructed by the manufacturer.

3.1.4 Exit Signs

NFPA 101. Wire exit signs and emergency lighting units ahead of the local switch, to the normal lighting circuit located in the same room or area.

3.1.5 Lighting Controls

3.1.5.1 Occupancy/Vacancy Sensors

a. Provide quantity of sensor units indicated as a minimum. Provide additional units to give full coverage over controlled area. Full coverage must provide hand and arm motion detection for office and administration type areas and walking motion for industrial areas, warehouses, storage rooms and hallways.

b. Locate ceiling-mounted sensors no closer than 6 feet from the nearest HVAC supply or return diffuser.

c. Locate the sensor(s) as indicated and in accordance with the manufacturer's recommendations.

3.1.5.2 Photosensors

Locate and aim sensor as indicated and in accordance with the manufacturer's recommendations. Adjust sensor set-point in accordance with the manufacturer's recommendations and for the indicated light level of the area of coverage, measured at the work plane.

3.2 FIELD QUALITY CONTROL

3.2.1 Tests

3.2.1.1 Lighting Control Verification Tests

Verify lighting control system and devices operate according to approved sequence of operations. Verification tests are to be completed after commissioning.

a. Verify occupancy/vacancy sensors operate as described in sequence of operations. Provide testing of sensor coverage, sensitivity, and time-out settings in all spaces where sensors are placed. This is to be completed only after all furnishings have been installed. Submit occupancy/vacancy sensor verification test.

b. Verify photosensors operate as described in sequence of operations. Provide testing of sensor coverage, aiming, and calibration in all

spaces where sensors are placed. This is to be completed only after all furnishings have been installed. Submit photosensor verification test.

c. Verify wall box dimmers and scene wallstations operate as described in sequence of operations.

3.2.1.2 Emergency Lighting Test

Interrupt power supply to demonstrate proper operation of emergency lighting. If adjustments are made to the lighting system, re-test system to show compliance with standards.

3.3 CLOSEOUT ACTIVITIES

3.3.1 Commissioning

NFPA 101. Factory Trained Field Service Technician is responsible for calibration and programming sequences for input devices and systems in accordance with the requirements described in the sequence of operation.

3.3.2 Training

3.3.2.1 Maintenance Staff Training

Submit a Maintenance Staff Training Plan at least 30 calendar days prior to training session that describes training procedures for Owner's personnel in the operation and maintenance of lighting and lighting control system. Provide on-site training which demonstrates full system functionality, assigning schedules, calibration adjustments for light levels and sensor sensitivity, integration procedures for connecting to third-party devices, and manual override including information on appropriate use. Provide protocols for troubleshooting, maintenance, repair, and replacement, and literature on available system updates and process for implementing updates.

3.3.2.2 End-User Training

Submit an End-User Training Plan at least 30 calendar days prior to training session that describes training procedures for end-users on the lighting control system. Provide users with a list of control devices located within user-occupied spaces, such as photosensors and occupancy and vacancy sensors, including information on the proper operation and schedule for each device. Provide demonstration for each type of interface. Provide users with the building schedule as currently commissioned, including conditional programming based on astronomic time clock functionality. Provide users with the correct contact information for maintenance personnel who will be available to address any lighting control issues.

Provide laminated instructions to the user at each scene wallstation. Provide only instructions relevant to the functionality of the specific scene wallstation. Provide a description of each labeled scene control button. If the room utilizes occupancy/vacancy sensors or photosensors, include a description of this functionality on the instruction sheet.

-- End of Section --

SECTION 26 56 00

EXTERIOR LIGHTING
08/21

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO LTS	(2013; Errata 2013) Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals

AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE)

ASCE 7-16	(2017; Errata 2018; Supp 1 2018) Minimum Design Loads and Associated Criteria for Buildings and Other Structures

ASTM INTERNATIONAL (ASTM)

ASTM A153/A153M	(2016a) Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware
ASTM B117	(2019) Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM C1089	(2013) Standard Specification for Spun Cast Prestressed Concrete Poles

EUROPEAN UNION (EU)

Directive 2011/65/EU	(2011) Restriction of the Use of Certain Hazardous Substances in Electrical and Electronic Equipment

ILLUMINATING ENGINEERING SOCIETY (IES)

ANSI/IES LM-79	(2019) Approved Method: Electrical and Photometric Measurements of Solid State Lighting Products
ANSI/IES LM-80	(2020) Approved Method: Measuring Luminous Flux and Color Maintenance of LED Packages, Arrays and Modules
ANSI/IES LS-1	(2020) Lighting Science: Nomenclature and Definitions for Illuminating Engineering

ANSI/IES RP-8	(2018; Addenda 1 2020; Errata 1-2 2021) Recommended Practice for Design and Maintenance of Roadway and Parking Facility Lighting
ANSI/IES TM-15	(2020) Technical Memorandum: Luminaire Classification System for Outdoor Luminaires
ANSI/IES TM-21	(2019) Technical Memorandum: Projecting Long-Term Lumen, Photon, and Radiant Flux Maintenance of LED Light Sources
IES Lighting Library	IES Lighting Library

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 100	(2000; Archived) The Authoritative Dictionary of IEEE Standards Terms
IEEE C62.41.2	(2002) Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI C136.3	(2020) Roadway and Area Lighting Equipment - Luminaire Attachments
ANSI C136.13	(2020) Roadway and Area Lighting Equipment - Metal Brackets for Wood Poles
ANSI C136.21	(2014) American National Standard for Roadway and Area Lighting Equipment - Vertical Tenons Used with Post-Top-Mounted Luminaires
NEMA 250	(2020) Enclosures for Electrical Equipment (1000 Volts Maximum)
NEMA ANSLG C78.377	(2017) Electric Lamps– Specifications for the Chromaticity of Solid State Lighting Products
NEMA C82.77-10	(2020) Harmonic Emission Limits - Related Power Quality Requirements
NEMA C136.10	(2017) American National Standard for Roadway and Area Lighting Equipment-Locking-Type Photocontrol Devices and Mating Receptacles--Physical and Electrical Interchangeability and Testing
NEMA C136.31	(2018) Roadway and Area Lighting Equipment - Luminaire Vibration
NEMA ICS 2	(2000; R 2020) Industrial Control and Systems Controllers, Contactors, and

	Overload Relays Rated 600 V
NEMA ICS 6	(1993; R 2016) Industrial Control and Systems: Enclosures
NEMA IEC 60529	(2004) Degrees of Protection Provided by Enclosures (IP Code)
NEMA SSL 1	(2016) Electronic Drivers for LED Devices, Arrays, or Systems
NEMA SSL 3	(2011) High-Power White LED Binning for General Illumination

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code

UNDERWRITERS LABORATORIES (UL)

UL 773	(2016; Reprint Jul 2020) UL Standard for Safety Plug-In, Locking Type Photocontrols for Use with Area Lighting
UL 773A	(2016; Reprint Jun 2020) UL Standard for Safety Nonindustrial Photoelectric Switches for Lighting Control
UL 1310	(2018) UL Standard for Safety Class 2 Power Units
UL 1598	(2021; Reprint Jun 2021) Luminaires
UL 8750	(2015; Reprint Sep 2021) UL Standard for Safety Light Emitting Diode (LED) Equipment for Use in Lighting Products

1.2 RELATED REQUIREMENTS

Luminaires and accessories installed in interior of buildings or attached to the exterior of a building are specified in Section 26 51 00 INTERIOR LIGHTING.

1.3 DEFINITIONS

a. Unless otherwise specified or indicated, electrical and electronics terms used in these specifications and on the drawings must be as defined in IEEE 100 and ANSI/IES LS-1.

b. For LED luminaire light sources, "Useful Life" is the operating hours before reaching 70 percent of the initial rated lumen output (L70) with no catastrophic failures under normal operating conditions. This is also known as 70 percent "Rated Lumen Maintenance Life" as defined in ANSI/IES LM-80.

c. For LED luminaires, "Luminaire Efficacy" (LE) is the appropriate measure of energy efficiency, measured in lumens/watt. This is

gathered from LM-79 data for the luminaire, in which absolute photometry is used to measure the lumen output of the luminaire as one entity, not the source separately and then the source and housing together.

d. Total Harmonic Distortion (THD) is the Root Mean Square (RMS) of all the harmonic components divided by the total fundamental current.

e. The "Groundline Section" of wood poles is that portion of the pole between one foot above, and 2 feet below the groundline.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Luminaire Drawings; G

Pole Drawings; G

Control System One-Line Diagram; G

Sequence of Operation for Exterior Lighting Control System; G

SD-03 Product Data

Luminaires; G

Light Sources; G

LED Drivers; G

Luminaire Warranty; G

Lighting Controls Warranty; G

Pole Warranty; G

Photosensors; G

Lighting Contactor; G

Poles; G

Brackets

SD-05 Design Data

Luminaire Design Data; G

SD-06 Test Reports

ANSI/IES LM-79 Test Report; G

ANSI/IES LM-80 Test Report; G

ANSI/IES TM-21 Test Report; G

SD-08 Manufacturer's Instructions

Poles

SD-10 Operation and Maintenance Data

Lighting System, Data Package 5; G

Exterior Lighting Control System, Data Package 5; G

Maintenance Staff Training Plan; G

End-User Training Plan; G

1.5 QUALITY ASSURANCE

Data, drawings, and reports must employ the terminology, classifications and methods prescribed by the IES Lighting Library as applicable, for the lighting system specified.

1.5.1 Drawing Requirements

1.5.1.1 Luminaire Drawings

Include dimensions, effective projected area (EPA), weight, accessories, and installation and construction details. Photometric data, including CRI, CCT, TM-15-11 BUG rating, LED driver type, zonal lumen data, and candlepower distribution data per LM-79 must accompany shop drawings.

1.5.1.2 Pole Drawings

Include dimensions, wind load determined in accordance with , pole deflection, pole class, and other applicable information. For concrete poles, include: section and details to indicate quantities and position of prestressing steel, spiral steel, inserts, and through holes; initial prestressing steel tension; and concrete strengths at release and at 28 days.

1.5.2 Luminaire Design Data

a. Provide distribution data according to IES classification type as defined in IES Lighting Library and ANSI/IES RP-8.

b. B.U.G. rating for the installed position as defined by ANSI/IES TM-15 and shielding as defined by ANSI/IES RP-8.

c. Provide safety certification and file number for the luminaire family. Include listing, labeling and identification in accordance with NFPA 70 (NEC). Applicable testing bodies are determined by the US Occupational Safety Health Administration (OSHA) as Nationally Recognized Testing Laboratories (NRTL) and include: CSA (Canadian Standards Association), ETL (Edison Testing Laboratory), and UL (Underwriters Laboratories).

d. Provide long term lumen maintenance projections for each LED luminaire in accordance with ANSI/IES TM-21. Data used for projections must be obtained from testing in accordance with ANSI/IES LM-80.

e. Provide wind loading calculations for luminaires mounted on poles. Weight and effective projected area (EPA) of luminaires and mounting brackets must not exceed maximum rating of pole as installed in particular wind zone area.

1.5.3 ANSI/IES LM-79 Test Report

Submit test report on manufacturer's standard production model of specified luminaire. Testing must be performed at the same operating drive current as specified luminaire. Include all applicable and required data as outlined under "14.0 Test Report" in ANSI/IES LM-79.

1.5.4 ANSI/IES LM-80 Test Report

Submit report on manufacturer's standard production LED light source (package, array, or module) of specified luminaire. Testing must be performed at the same operating drive current as specified luminaire. Include all applicable and required data as outlined under "8.0 Test Report" in ANSI/IES LM-80.

1.5.5 ANSI/IES TM-21 Test Report

Submit test report on manufacturer's standard production LED light source (package, array or module) of specified luminaire. Testing must be performed at the same operating drive current as specified luminaire. Include all applicable and required data, as well as required interpolation information as outlined under "7.0 Report" in ANSI/IES TM-21.

1.5.6 Test Laboratories

Test laboratories for the ANSI/IES LM-79 and ANSI/IES LM-80 test reports must be one of the following:

a. National Voluntary Laboratory Accreditation Program (NVLAP) accredited for solid-state lighting testing as part of the Energy-Efficient Lighting Products laboratory accreditation program.

b. One of the qualified labs listed on the Department of Energy - Energy Efficiency & Renewable Energy, Solid-State Lighting web site.

c. One of the EPA-Recognized Laboratories listed at for LM-80 testing.

1.5.7 Regulatory Requirements

Equipment, materials, installation, and workmanship must be in accordance with the mandatory provisions of NFPA 70 unless more stringent requirements are specified or indicated. Provide luminaires and assembled components that are approved by and bear the label of UL for the applicable location and conditions unless otherwise specified.

1.5.8 Standard Products

Provide materials and equipment that are products of manufacturers regularly engaged in the production of such products which are of equal material, design and workmanship. Products must have been in satisfactory commercial or industrial use for six months prior to bid opening. The six-month period must include applications of equipment and materials under similar circumstances and of similar size. The product must have been on sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the six-month period. Where two or more items of the same class of equipment are required, these items must be products of a single manufacturer; however, the component parts of the item need not be the products of the same manufacturer unless stated in this section.

1.5.8.1 Alternative Qualifications

Products having less than a six-month field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturers' factory or laboratory tests, is furnished.

1.5.8.2 Material and Equipment Manufacturing Date

Do not use products manufactured more than six months prior to date of delivery to site, unless specified otherwise.

1.6 DELIVERY, STORAGE, AND HANDLING OF POLES

1.6.1 Concrete Poles

Do not store poles on ground. Support poles so they are at least one foot above ground level and growing vegetation.

1.7 WARRANTY

Support all equipment items by service organizations which are reasonably convenient to the equipment installation in order to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

1.7.1 Luminaire Warranty

Provide and transfer to the government the original LED luminaire manufacturers standard commercial warranty for each different luminaire manufacturer used in the project.

a. Provide a written five year minimum replacement warranty for material,

luminaire finish, and workmanship. Provide written warranty document that contains all warranty processing information needed, including customer service point of contact, whether or not a return authorization number is required, return shipping information, and closest return location to the luminaire location.

(1) Finish warranty must include failure and substantial deterioration such as blistering, cracking, peeling, chalking, or fading.

(2) Material warranty must include:

(a) All LED drivers and integral control equipment.

(b) Replacement when more than 15 percent of LED sources in any lightbar or subassembly(s) are defective, non-starting, or operating below 70 percent of specified lumen output.

b. Warranty period must begin in accordance with the manufacturer's standard warranty starting date.

c. Provide replacements that are promptly shipped, without charge, to the using Government facility point of contact and that are identical to or an improvement upon the original equipment. All replacements must include testing of new components and installation.

1.7.2 Lighting Controls Warranty

Provide and transfer to the government the original lighting controls manufacturers standard commercial warranty for each different lighting controls manufacturer used in the project. Warranty coverage must begin from date of final system commissioning or three months from date of delivery, whichever is the earliest. Warranty service must be performed by a factory-trained engineer or technician.

a. Unless otherwise noted, provide a written five year minimum warranty on the complete system for all systems with factory commissioning. Provide warranty that covers 100 percent of the cost of any replacement parts and services required over the five years which are directly attributable to the product failure. Failures include, but are not limited to, the following:

(1) Software: Failure of input/output to execute switching or dimming commands.

(2) Damage of electronic components due to transient voltage surges.

(3) Failure of control devices, including but not limited to photosensors and motion sensors.

b. Provide a written five year minimum warranty on all input devices against defect in workmanship or materials provided by device manufacturer.

c. Provide a written five year minimum warranty on all control components attached to luminaires against defect in workmanship or materials.

1.7.3 Pole Warranty

Provide and transfer to the government the original pole manufacturers

standard commercial warranty for each different pole manufacturer used in the project. Warranty coverage must begin from date of final system commissioning or three months from date of delivery, whichever is the earliest. Provide a written three year minimum replacement warranty for material, luminaire finish, and workmanship. Warranty service must be performed by a factory-trained engineer or technician.

1.8 OPERATION AND MAINTENANCE MANUALS

1.8.1 Lighting System

Provide operation and maintenance manuals for the lighting system in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA that provide basic data relating to the design, operation, and maintenance of the lighting system. Additional O&M Manual requirements for the Army are provided in Section 01 78 24.00 10 FACILITY DATA REQUIREMENTS. Additional requirements for the Navy are provided in Section 01 78 24.00 20 FACILITY ELECTRONIC OPERATION AND MAINTENANCE SUPPORT INFORMATION (eOMSI). Include the following:

a. Manufacturers' operating and maintenance manuals.

b. Luminaire shop drawings for modified and custom luminaires.

c. Luminaire Manufacturers' standard commercial warranty information as specified in paragraph LUMINAIRE WARRANTY.

1.8.2 Exterior Lighting Control System

Provide operation and maintenance manuals for the exterior lighting control system in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA that provide basic data relating to the design, operation, and maintenance of the exterior lighting control system. Include the following:

a. Control System One-Line Diagram

b. Product data for all devices, including installation and programming instructions.

c. Training materials, such as videos or in-depth manuals, that cover basic operation of the lighting control system and instructions on modifying the control system. Training materials must include calibration, adjustment, troubleshooting, maintenance, repair, and replacement.

PART 2 PRODUCTS

2.1 PRODUCT COORDINATION

2.2 LUMINAIRES

UL 1598, NEMA C82.77-10. Provide luminaires as indicated in the luminaire schedule and XL plates or details on project plans, complete with light source, wattage, and lumen output indicated. All luminaires of the same type must be provided by the same manufacturer. Luminaires must be specifically designed for use with the LED driver and light source provided.

2.2.1 Luminaires

UL 8750, ANSI/IES LM-79, ANSI/IES LM-80. For all luminaires, provide:

a. Complete system with LED drivers and light sources.

b. Housing constructed of non-corrosive materials. All new aluminum housings must be anodized or powder-coated. All new steel housings must be treated to be corrosion resistant.

c. ANSI/IES TM-21, ANSI/IES LM-80. Minimum L70 lumen maintenance value of 50,000 hours unless otherwise indicated in the luminaire schedule. Luminaire drive current value must be identical to that provided by test data for luminaire in question.

d. Minimum efficacy as specified in the luminaire schedule. Theoretical models of initial lamp lumens per watt are not acceptable. If efficacy values are not listed in the luminaire schedule, provide luminaires that meet the following minimum values:

Luminaire Style	Minimum Luminaire Efficacy
Area and Roadway (pole mounted, arm mounted)	119 LPW
Pedestrian Post-Top (pole mounted, arm mounted)	97 LPW
Bollard	45 LPW
Accent (adjustable landscape, sign lighting)	35 LPW
Linear Accent (facade, wallwash)	80 LPW
Exterior Wall Sconce	50 LPW
Steplight	30 LPW
Parking Garage Luminaire	113 LPW

e. Product rated for operation within an ambient temperature range of minus 22 degrees F to 122 degrees F.

f. UL listed for wet locations. Optical compartment for LED luminaires must be sealed and rated a minimum of IP65 per NEMA IEC 60529.

g. IES Lighting Library. Light distribution and NEMA field angle classifications as indicated in luminaire schedule on project plans.

h. Housing finish that is baked-on enamel, anodized, or baked-on powder coat paint. Finish must be capable of surviving ASTM B117 salt fog environment testing for 2500 hours minimum without blistering or peeling.

i. LED driver and light source package, array, or module are accessible for service or replacement without removal or destruction of luminaire.

j. ANSI/IES TM-15. Does not exceed the BUG ratings as listed in the luminaire schedule.. If BUG ratings are not listed in the luminaire

schedule, provide luminaires that meet the following minimum values for each application and mounting conditions:

Lighting Application	Mounting Conditions	BUG Rating
Area and Roadway	All	B3-U0-G3
Pedestrian Post-Top	All	B2-U1-G1
Exterior Wall Sconce	Above 4 feet AFF	B1-U0-G2
Exterior Wall Sconce	Below or at 4 feet AFF	B4-U0-G4
Steplight	Above 4 feet AFF	B1-U1-G2
Steplight	Below or at 4 feet AFF	B4-U1-G4
Parking Garage Luminaire	Ceiling mounted	B4-U4-G3

k. Fully assembled and electrically tested prior to shipment from factory.

l. Finish color is as indicated in the luminaire schedule or detail on the project plans.

m. Lenses constructed of clear tempered glass or UV-resistant acrylic.

n. All factory electrical connections are made using crimp, locking, or latching style connectors. Twist-style wire nuts are not acceptable.

o. NEMA C136.31. Comply with 3G vibration testing.

p. Luminaire arm bolts constructed from 304 stainless steel or zinc-plated steel.

q. Wiring compartment on pole-mounted, street and area luminaires is accessible without the use of hand tools to manipulate small screws, bolts, or hardware.

r. Incorporate modular electrical connections, and construct luminaires to allow replacement of all or any part of the optics, heat sinks, LED drivers, surge suppressors and other electrical components using only a simple tool, such as a manual or cordless electric screwdriver.

s. ANSI C136.3. For all roadway and area luminaires, provide products with an integral tilt adjustment of plus or minus 5 degrees to allow the unit to be leveled.

2.3 LIGHT SOURCES

NEMA ANSLG C78.377, NEMA SSL 3. Provide type, lumen rating, and wattage as indicated in luminaire schedule on project plans.

2.3.1 LED Light Sources

Provide LED light sources that meet the following requirements:

a. NEMA ANSLG C78.377. Emit white light and have a nominal Correlated

Color Temperature (CCT) of 4000 Kelvin.

b. Minimum Color Rendering Index (CRI) of 80.

c. Directive 2011/65/EU. Restriction of Hazardous Substances (RoHS) compliant.

d. Light source color consistency by utilizing a binning tolerance within a 4-step McAdam ellipse.

2.4 LED DRIVERS

NEMA SSL 1, UL 1310. Provide LED Drivers that are electronic, UL Class 1 or Class 2, constant-current type and meet the following requirements:

a. The combined LED driver and LED light source system is greater than or equal to the minimum luminaire efficacy values as listed in the luminaire schedule provided.

b. Operate at a voltage of 277 volts at 50/60 hertz, with input voltage fluctuations of plus or minus 10 percent.

c. Power Factor (PF) greater than or equal to 0.90 at full input power and across specified dimming range.

d. Maximum Total Harmonic Distortion (THD) less than or equal to 20 percent at full input power and across specified dimming range.

e. Operates for at least 50,000 hours at maximum case temperature and 90 percent non-condensing relative humidity.

f. Meets the "Elevated" (10kV/10kA) requirements per IEEE C62.41.2 -2002. Manufacturer must indicate whether failure of the electrical immunity system can possibly result in disconnect of power to luminaire. Provide surge protection that is integral to the LED driver.

g. Contains integral thermal protection that reduces the output power to protect the driver and light source from damage if the case temperature approaches or exceeds the driver's maximum operating temperature.

h. Complies with the requirements of the Federal Communications Commission (FCC) rules and regulations, Title 47 CFR part 15, Non-Consumer (Class A) for EMI/RFI (conducted and radiated).

i. Class A sound rating for all drivers mounted under a covered structure, such as a canopy, or where otherwise appropriate.

j. Directive 2011/65/EU. Restriction of Hazardous Substances (RoHS) compliant.

k. UL listed for wet locations typical of exterior installations.

l. Non-dimmable.

m. Rated to operate between ambient temperatures of minus 22 degrees F and 122 degrees F.

2.5 LIGHTING CONTROLS

2.5.1 System

Provide exterior lighting control system that operates the exterior lighting system as described in the exterior lighting control strategies in the project plans. Submit Sequence of Operation for Exterior Lighting Control System describing the operation of the proposed exterior lighting control system and devices. Sequence of Operation must provide the strategies identified in the exterior lighting control strategies.

2.5.2 Devices

2.5.2.1 Time Clock

NEMA ICS 6. House time clock in a surface-mounted, lockable NEMA 1 enclosure constructed of painted steel or plastic polymer. Provide electronic type time clock that meets the following criteria:

a. astronomic programming function, providing a total of 56 on/off set points.

b. 24 hour type digital clock display format.

c. Power outage back-up for switch utilizing lithium battery which provides coverage for a minimum of seven days.

d. Capable of controlling a minimum of 4 channels or loads.

e. Contacts are rated for 30 amps at 120-277 VAC resistive load in a normally open (NO)or normally closed (NC) configuration.

f. Contains function that allows automatic control to be skipped on certain selected days of the weekdaylight savings time automatic adjustmentability for photosensor input.

2.5.2.2 Photosensors

UL 773, UL 773A. Provide Photosensors that meet the following requirements:

a. Hermetically sealed, cadmium sulfide light sensor type, rated at 277 volts, 50/60 Hz with single-pole, single-throw contacts.

b. Turns ON at 1 to 3 footcandles and turns OFF at 3 to 15 footcandles.

c. Designed to fail to the ON position.

d. Housing is constructed of polycarbonate, rated to operate within a temperature range of minus 40 to 158 degrees F.

e. Time delay that prevents accidental switching from transient light sources.

f. Directional lens in front of the cell to prevent fixed light sources from creating a turnoff condition.

g. Designed for 20-year service to match life expectancy of long-life LED fixtures and exceed 15,000 operations at full load. Provide photosensors with zero-cross technology to withstand severe in-rush current and extend relay life.

i. NEMA C136.10. Twist-lock receptacle type. Provide with solid brass prongs and voltage markings and color coding on exterior of housing.

j. Provide photosensors with metal oxide varistor (MOV) type surge protection.

2.5.2.3 Lighting Contactor

NEMA ICS 2. Provide a mechanically-held lighting contactor housed in a NEMA 1 enclosure conforming to NEMA ICS 6. Contactor must have 4 poles, configured as normally open (NO) or normally closed (NC). Contacts must be rated 600 volts, 30 amperes for a resistive load. Coil operating voltage must be 277 volts. Contactor must have silver cadmium oxide double-break contacts and coil clearing contacts for mechanically held contactors and must require no arcing contacts. Provide contactor with hand-off-automatic on-off selector switch.

2.6 POLES

AASHTO LTSASCE 7-16. Provide round tapered poles designed for wind loading of 140 miles per hour while supporting luminaires and all other appurtenances indicated. The effective projected areas (EPA) of luminaires and appurtenances used in calculations must be specific for the actual products provided on each pole. Provide poles that are embedded -base type designed for use with underground supply conductors. Poles must have oval-shaped hand hole having a minimum clear opening of 3 by 5 inches. Secure hand hole covers by stainless steel captive screws. Provide metal poles with an internal grounding connection accessible from the hand hole near the bottom of each pole. Install a means of wire disconnection accessible from the hand hole. Do not install square poles. Provide poles from a Manufacturer with a standard provision for protecting the finish during shipment and installation. Do not install scratched, stained, chipped, or dented poles.

2.6.1 Concrete Poles

ASTM C1089. Cross-sectional shape must be round.

2.6.1.1 Steel Reinforcing

Provide prestressed concrete pole shafts that are reinforced with steel prestressing members. Provide internal longitudinal loading by either pre-tensioning or post-tensioning longitudinal reinforcing members.

2.6.1.2 Tensioned Reinforcing

Primary reinforcement steel used for a prestressed concrete pole shaft must be tensioned between 60 to 70 percent of its ultimate strength. The amount of reinforcement must be such that when reinforcement is tensioned to 70 percent of its ultimate strength, the total resultant tensile force does not exceed the minimum section compressive strength of the concrete.

2.6.1.3 Coating and Sleeves for Reinforcing Members

Where minimum internal coverage cannot be maintained next to required core opening, such as hand holes and wiring inlet, protect reinforcing with a vapor proof noncorrosive sleeve over the length without the 1/2 inch concrete coverage. Apply a nonmigrating slipper coating to each steel reinforcing member which is to be post-tensioned prior to the application of concrete to ensure uniformity of stress throughout the length of each member.

2.6.1.4 Strength Requirement

As an exception to the requirements of ASTM C1089, provide poles that are naturally cured to achieve a 28-day compressive strength of 7000 psi. Poles must not be subjected to severe temperature changes during the curing period.

2.6.1.5 Shaft Preparation

Provide completed prestressed concrete pole shaft with a hard, smooth, nonporous surface that is resistant to soil acids, road salts, and attacks of water and frost, and must be clean, smooth, and free of surface voids and internal honeycombing. Do not install poles within 15 days of manufacture.

2.6.2 Brackets and Supports

ANSI C136.3, ANSI C136.13, and ANSI C136.21. Provide pole brackets that are not less than 1 1/4 inch galvanized steel pipe secured to pole. Slip-fitter or pipe-threaded brackets may be used, but brackets must be coordinated to luminaires provided, and brackets for use with one type of luminaire must be identical. Brackets for pole-mounted street lights must correctly position luminaire no lower than mounting height indicated. Mount brackets not less than 24 feet above street. Provide special mountings or brackets as indicated and of metal which will not promote galvanic reaction with luminaire head.

2.6.3 Pole Foundations

Provide anchor bolts consisting of a steel rod with a minimum yield strength of 50,000 psi; the top 12 inches of the rod must be galvanized in accordance with ASTM A153/A153M. Concrete must be as specified in Section 03 30 00 CAST-IN-PLACE CONCRETE and Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION.

2.7 EQUIPMENT IDENTIFICATION

2.7.1 Manufacturer's Nameplate

Each item of equipment must have a nameplate bearing the manufacturer's name, address, model number, and serial number securely affixed in a conspicuous place; the nameplate of the distributing agent will not be acceptable.

2.7.2 Labels

UL 1598. Luminaires must be clearly marked for operation of specific light sources and drivers according to proper light source type. Note the following luminaire characteristics in the format "Use Only _____":

a. Correlated color temperature (CCT) and color rendering index (CRI) for all luminaires.

b. Driver and dimming protocol.

Markings related to light source type must be clear and located to be readily visible to service personnel, but unseen from normal viewing angles when light sources are in place. LED drivers must have clear markings indicating dimming type and indicate proper terminals for the various outputs.

2.8 FACTORY APPLIED FINISH

NEMA 250. Provide all luminaires and lighting equipment with factory-applied painting system that as a minimum meets requirements of corrosion-resistance testing.

PART 3 EXECUTION

3.1 INSTALLATION

3.1.1 Luminaires

Install all luminaires in accordance with the luminaire manufacturer's written instructions. Install all luminaires at locations and heights as indicated on the project plans. Level all luminaires in accordance to manufacturer's written instructions.

3.1.2 LED Drivers

Provide LED drivers integral to luminaire as constructed by the manufacturer.

3.1.3 Concrete Poles

Install according to pole manufacturer's instructions.

3.1.4 Pole Setting

Set pole to depth as indicated. Poles in straight runs must be in a straight line. Dig holes large enough to permit the proper use of tampers to the full depth of the hole. Place backfill in the hole in 6 inch maximum layers and thoroughly tamp. Place surplus earth around the pole in a conical shape and pack tightly to drain water away.

3.1.5 Lighting Controls

3.1.5.1 Photosensors

Aim photosensor according to manufacturer's recommendations. Mount sensor on or beside each luminaire when switch is provided in cast weatherproof aluminum housing with swivel arm.

3.1.5.2 Motion Sensors

Locate sensors in accordance with the manufacturer's recommendation.

Locate sensors to achieve coverage of areas as indicated on project plans. Coverage patterns must be derated as recommended by manufacturer based on mounting height of sensor and any obstructions such as trees. Do not use gross rated coverage in manufacturer's product literature.

3.1.6 Grounding

Ground noncurrent-carrying parts of equipment including metal poles, luminaires, mounting arms, brackets, and metallic enclosures . Where copper grounding conductor is connected to a metal other than copper, provide specially treated or lined connectors suitable for this purpose.

3.2 FIELD QUALITY CONTROL

3.2.1 Tests

Upon completion of installation, verify that equipment is properly installed, connected, and adjusted. Perform initial operational test, consisting of the entire system energized for 72 consecutive hours without any failures of any kind occurring in the system. All circuits must test clear of faults, grounds, and open circuits.

3.2.1.1 Lighting Control Verification Test

Verify lighting control system and devices operate according to approved sequence of operations. Verification tests are to be completed after commissioning.

3.3 CLOSEOUT ACTIVITIES

3.3.1 Training

Provide on-site training to the Owner's personnel in the operation and maintenance of lighting and lighting control system. Provide training that includes calibration, adjustment, troubleshooting, maintenance, repair, and replacement.

3.3.1.1 Maintenance Staff Training

Submit a Maintenance Staff Training Plan at least 30 calendar days prior to training session that describes training procedures for Owner's personnel in the operation and maintenance of lighting and lighting control system. Provide on-site training which demonstrate full system functionality, assigning schedules, calibration adjustments for light levels and sensor sensitivity, integration procedures for connecting to third-party devices, and manual override including information on appropriate use. Provide protocols for troubleshooting, maintenance, repair, and replacement, and literature on available system updates and process for implementing updates.

3.3.1.2 End-User Training

Submit a End-User Training Plan at least 30 calendar days prior to training session that describes training procedures for end-users on the lighting control system. Provide demonstration for each type of user interface. Provide users with the curfew schedule as currently

commissioned, including conditional programming based on astronomic time clock functionality. Provide users with the correct contact information for maintenance personnel who will be available to address any lighting control issues.

-- End of Section --

SECTION 27 10 00

BUILDING TELECOMMUNICATIONS CABLING SYSTEM
08/11

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM D709	(2017) Standard Specification for Laminated Thermosetting Materials

ELECTRONIC COMPONENTS INDUSTRY ASSOCIATION (ECIA)

ECIA EIA/ECA 310-E	(2005) Cabinets, Racks, Panels, and Associated Equipment

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 100	(2000; Archived) The Authoritative Dictionary of IEEE Standards Terms

INSULATED CABLE ENGINEERS ASSOCIATION (ICEA)

ICEA S-83-596	(2016) Indoor Optical Fiber Cables
ICEA S-90-661	(2012) Category 3, 5, & 5e Individually Unshielded Twisted Pair Indoor Cables for Use in General Purpose and LAN Communications Wiring Systems Technical Requirements

NATIONAL ELECTRICAL CONTRACTORS ASSOCIATION (NECA)

NECA/BICSI 568	(2006) Standard for Installing Building Telecommunications Cabling

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2017; ERTA 1-2 2017; TIA 17-1; TIA 17-2; TIA 17-3; TIA 17-4; TIA 17-5; TIA 17-6; TIA 17-7; TIA 17-8; TIA 17-9; TIA 17-10; TIA 17-11; TIA 17-12; TIA 17-13; TIA 17-14; TIA 17-15; TIA 17-16; TIA 17-17) National Electrical Code

TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA)

TIA-1152	(2009) Requirements for Field Test Instruments and Measurements for Balanced Twisted-Pair Cabling

TIA-455-21	(1988a; R 2012) FOTP-21 - Mating Durability of Fiber Optic Interconnecting Devices
TIA-526-14	(2015c) OFSTP-14A Optical Power Loss Measurements of Installed Multimode Fiber Cable Plant
TIA-526-7	(2015a) OFSTP-7 Measurement of Optical Power Loss of Installed Single-Mode Fiber Cable Plant
TIA-568-C.0	(2009; Add 1 2010; Add 2 2012) Generic Telecommunications Cabling for Customer Premises
TIA-568-C.1	(2009; Add 2 2011; Add 1 2012) Commercial Building Telecommunications Cabling Standard
TIA-568-C.2	(2009; Errata 2010; Add 2 2014; Add 1 2016) Balanced Twisted-Pair Telecommunications Cabling and Components Standards
TIA-568-C.3	(2008; Add 1 2011) Optical Fiber Cabling Components Standard
TIA-569	(2015d) Commercial Building Standard for Telecommunications Pathways and Spaces
TIA-606	(2017c) Administration Standard for the Telecommunications Infrastructure
TIA-607	(2015c; Addendum 1 2017) Generic Telecommunications Bonding and Grounding (Earthing) for Customer Premises
TIA/EIA-598	(2014D; Add 2 2018) Optical Fiber Cable Color Coding
TIA/EIA-604-10	(2002a) FOCIS 10 Fiber Optic Connector Intermateability Standard - Type LC

U.S. FEDERAL COMMUNICATIONS COMMISSION (FCC)

FCC Part 68	Connection of Terminal Equipment to the Telephone Network (47 CFR 68)

UNDERWRITERS LABORATORIES (UL)

UL 1286	(2008; Reprint Jan 2018) UL Standard for Safety Office Furnishings
UL 1666	(2007; Reprint Jun 2012) Test for Flame Propagation Height of Electrical and Optical-Fiber Cables Installed Vertically in Shafts

UL 1863	(2004; Reprint Sep 2016) UL Standard for Safety Communication Circuit Accessories
UL 467	(2013; Reprint Jun 2017) UL Standard for Safety Grounding and Bonding Equipment
UL 50	(2015) UL Standard for Safety Enclosures for Electrical Equipment, Non-Environmental Considerations
UL 514C	(2014; Reprint Nov 2018) UL Standard for Safety Nonmetallic Outlet Boxes, Flush-Device Boxes, and Covers
UL 723	(2018) UL Standard for Safety Test for Surface Burning Characteristics of Building Materials
UL 969	(2017; Reprint Mar 2018) UL Standard for Safety Marking and Labeling Systems

1.2 RELATED REQUIREMENTS

Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM and Section 33 82 00 TELECOMMUNICATIONS, OUTSIDE PLANT (OSP), apply to this section with additions and modifications specified herein.

1.3 DEFINITIONS

Unless otherwise specified or indicated, electrical and electronics terms used in this specification shall be as defined in TIA-568-C.1, TIA-568-C.2, TIA-568-C.3, TIA-569, TIA-606 and IEEE 100 and herein.

1.3.1 Campus Distributor (CD)

A distributor from which the campus backbone cabling emanates. (International expression for main cross-connect (MC).)

1.3.2 Building Distributor (BD)

A distributor in which the building backbone cables terminate and at which connections to the campus backbone cables may be made. (International expression for intermediate cross-connect (IC).)

1.3.3 Floor Distributor (FD)

A distributor used to connect horizontal cable and cabling subsystems or equipment. (International expression for horizontal cross-connect (HC).)

1.3.4 Telecommunications Room (TR)

An enclosed space for housing telecommunications equipment, cable, terminations, and cross-connects. The room is the recognized cross-connect between the backbone cable and the horizontal cabling.

1.3.5 Entrance Facility (EF) (Telecommunications)

An entrance to the building for both private and public network service cables (including wireless) including the entrance point at the building

wall and continuing to the equipment room.

1.3.6 Equipment Room (ER) (Telecommunications)

An environmentally controlled centralized space for telecommunications equipment that serves the occupants of a building. Equipment housed therein is considered distinct from a telecommunications room because of the nature of its complexity.

1.3.7 Open Cable

Cabling that is not run in a raceway as defined by NFPA 70. This refers to cabling that is "open" to the space in which the cable has been installed and is therefore exposed to the environmental conditions associated with that space.

1.3.8 Open Office

A floor space division provided by furniture, moveable partitions, or other means instead of by building walls.

1.3.9 Pathway

A physical infrastructure utilized for the placement and routing of telecommunications cable.

1.4 SYSTEM DESCRIPTION

The building telecommunications cabling and pathway system shall include permanently installed backbone and horizontal cabling, horizontal and backbone pathways, service entrance facilities, work area pathways, telecommunications outlet assemblies, conduit, raceway, and hardware for splicing, terminating, and interconnecting cabling necessary to transport telephone and data (including LAN) between equipment items in a building. The horizontal system shall be wired in a star topology from the telecommunications work area to the floor distributor or campus distributor at the center or hub of the star. The backbone cabling and pathway system includes intrabuilding and interbuilding interconnecting cabling, pathway, and terminal hardware. The intrabuilding backbone provides connectivity from the floor distributors to the building distributors or to the campus distributor and from the building distributors to the campus distributor as required. The backbone system shall be wired in a star topology with the campus distributor at the center or hub of the star. Provide telecommunications pathway systems referenced herein as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. The telecommunications contractor must coordinate with the NMCI/COSC/NGEN contractor concerning access to and configuration of telecommunications spaces. The telecommunications contractor may be required to coordinate work effort within the telecommunications spaces with the NMCI/COSC/NGEN contractor.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Eglin 96 CS will review submittals for communication systems prior to approval and ordering of parts. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00

SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Telecommunications drawings; G

Telecommunications Space Drawings; G

In addition to Section 01 33 00 SUBMITTAL PROCEDURES, provide shop drawings in accordance with paragraph SHOP DRAWINGS.

SD-03 Product Data

Telecommunications cabling (backbone and horizontal); G

Patch panels; G

Telecommunications outlet/connector assemblies; G

Equipment support frame; G

Connector blocks; G

Submittals shall include the manufacturer's name, trade name, place of manufacture, and catalog model or number. Include performance and characteristic curves. Submittals shall also include applicable federal, military, industry, and technical society publication references. Should manufacturer's data require supplemental information for clarification, the supplemental information shall be submitted as specified in paragraph REGULATORY REQUIREMENTS and as required in Section 01 33 00 SUBMITTAL PROCEDURES.

SD-06 Test Reports

Telecommunications cabling testing; G

SD-07 Certificates

Telecommunications Contractor Qualifications; G

Key Personnel Qualifications; G

Manufacturer Qualifications; G

Test plan; G

SD-09 Manufacturer's Field Reports

Factory reel tests; G

SD-10 Operation and Maintenance Data

Telecommunications cabling and pathway system Data Package 5; G

SD-11 Closeout Submittals

Record Documentation; G

1.6 QUALITY ASSURANCE

1.6.1 Shop Drawings

In exception to Section 01 33 00 SUBMITTAL PROCEDURES, submitted plan drawings shall be a minimum of 11 by 17 inches in size using a minimum scale of 1/8 inch per foot. Include wiring diagrams and installation details of equipment indicating proposed location, layout and arrangement, control panels, accessories, piping, ductwork, and other items that must be shown to ensure a coordinated installation. Wiring diagrams shall identify circuit terminals and indicate the internal wiring for each item of equipment and the interconnection between each item of equipment. Drawings shall indicate adequate clearance for operation, maintenance, and replacement of operating equipment devices. Submittals shall include the nameplate data, size, and capacity. Submittals shall also include applicable federal, military, industry, and technical society publication references.

1.6.1.1 Telecommunications Drawings

Provide drawings in accordance with TIA-606. The identifier for each termination and cable shall appear on the drawings. Drawings shall depict final telecommunications installed wiring system infrastructure in accordance with TIA-606. The drawings should provide details required to prove that the distribution system shall properly support connectivity from the EF telecommunications and ER telecommunications, CD's, and FD's to the telecommunications work area outlets. The following drawings shall be provided as a minimum:

a. T1 - Layout of complete building per floor - Building Area/Serving Zone Boundaries, Backbone Systems, and Horizontal Pathways. Layout of complete building per floor. The drawing indicates location of building areas, serving zones, vertical backbone diagrams, telecommunications rooms, access points, pathways, grounding system, and other systems that need to be viewed from the complete building perspective.

b. T2 - Serving Zones/Building Area Drawings - Drop Locations and Cable Identification (ID'S). Shows a building area or serving zone. These drawings show drop locations, telecommunications rooms, access points and detail call outs for common equipment rooms and other congested areas.

c. T4 - Typical Detail Drawings - Faceplate Labeling, Firestopping, Americans with Disabilities Act (ADA), Safety, Department of Transportation (DOT). Detailed drawings of symbols and typicals such as faceplate labeling, faceplate types, faceplate population installation procedures, detail racking, and raceways.

1.6.1.2 Telecommunications Space Drawings

Provide T3 drawings in accordance with TIA-606 that include telecommunications rooms plan views, pathway layout (cable tray, racks, ladder-racks, etc.), mechanical/electrical layout, and cabinet, rack, backboard and wall elevations. Drawings shall show layout of applicable equipment including incoming cable stub or connector blocks, building protector assembly, outgoing cable connector blocks, patch panels and equipment spaces and cabinet/racks. Drawings shall include a complete list of equipment and material, equipment rack details, proposed layout

and anchorage of equipment and appurtenances, and equipment relationship to other parts of the work including clearance for maintenance and operation. Drawings may also be an enlargement of a congested area of T1 or T2 drawings.

1.6.2 Telecommunications Qualifications

Work under this section shall be performed by and the equipment shall be provided by the approved telecommunications contractor and key personnel. Qualifications shall be provided for: the telecommunications system contractor, the telecommunications system installer, and the supervisor (if different from the installer). A minimum of 30 days prior to installation, submit documentation of the experience of the telecommunications contractor and of the key personnel.

1.6.2.1 Telecommunications Contractor

The telecommunications contractor shall be a firm which is regularly and professionally engaged in the business of the applications, installation, and testing of the specified telecommunications systems and equipment. The telecommunications contractor shall demonstrate experience in providing successful telecommunications systems within the past 3 years of similar scope and size. Submit documentation for a minimum of three and a maximum of five successful telecommunication system installations for the telecommunications contractor.

1.6.2.2 Key Personnel

Provide key personnel who are regularly and professionally engaged in the business of the application, installation and testing of the specified telecommunications systems and equipment. There may be one key person or more key persons proposed for this solicitation depending upon how many of the key roles each has successfully provided. Each of the key personnel shall demonstrate experience in providing successful telecommunications systems within the past 3 years.

Supervisors and installers assigned to the installation of this system or any of its components shall be Building Industry Consulting Services International (BICSI) Registered Cabling Installers, Technician Level. Submit documentation of current BICSI certification for each of the key personnel.

In lieu of BICSI certification, supervisors and installers assigned to the installation of this system or any of its components shall have a minimum of 3 years experience in the installation of the specified copper and fiber optic cable and components. They shall have factory or factory approved certification from each equipment manufacturer indicating that they are qualified to install and test the provided products. Submit documentation for a minimum of three and a maximum of five successful telecommunication system installations for each of the key personnel. Documentation for each key person shall include at least two successful system installations provided that are equivalent in system size and in construction complexity to the telecommunications system proposed for this solicitation. Include specific experience in installing and testing telecommunications systems and provide the names and locations of at least two project installations successfully completed using optical fiber and copper telecommunications cabling systems. All of the existing telecommunications system installations offered by the key persons as successful experience shall have been in successful full-time service for

at least 18 months prior to the issuance date for this solicitation. Provide the name and role of the key person, the title, location, and completed installation date of the referenced project, the referenced project owner point of contact information including name, organization, title, and telephone number, and generally, the referenced project description including system size and construction complexity.

Indicate that all key persons are currently employed by the telecommunications contractor, or have a commitment to the telecommunications contractor to work on this project. All key persons shall be employed by the telecommunications contractor at the date of issuance of this solicitation, or if not, have a commitment to the telecommunications contractor to work on this project by the date that the bid was due to the Contracting Officer.

Note that only the key personnel approved by the Contracting Officer in the successful proposal shall do work on this solicitation's telecommunications system. Key personnel shall function in the same roles in this contract, as they functioned in the offered successful experience. Any substitutions for the telecommunications contractor's key personnel requires approval from The Contracting Officer.

1.6.2.3 Minimum Manufacturer Qualifications

Cabling, equipment and hardware manufacturers shall have a minimum of 3 years experience in the manufacturing, assembly, and factory testing of components which comply with TIA-568-C.1, TIA-568-C.2 and TIA-568-C.3.

1.6.3 Test Plan

Provide a complete and detailed test plan for the telecommunications cabling system including a complete list of test equipment for the components and accessories for each cable type specified, 72 days prior to the proposed test date. Include procedures for certification, validation, and testing. The test plan shall be reviewed by the Eglin 96 CS.

1.6.4 Regulatory Requirements

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word, "shall" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction," or words of similar meaning, to mean the Contracting Officer. Equipment, materials, installation, and workmanship shall be in accordance with the mandatory and advisory provisions of NFPA 70 unless more stringent requirements are specified or indicated.

1.6.5 Standard Products

Provide materials and equipment that are products of manufacturers regularly engaged in the production of such products which are of equal material, design and workmanship. Products shall have been in satisfactory commercial or industrial use for 2 years prior to bid opening. The 2-year period shall include applications of equipment and materials under similar circumstances and of similar size. The product shall have been on sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the 2-year period. Where two or more items of the same class of equipment are required, these items shall be products of a single manufacturer; however, the component parts

of the item need not be the products of the same manufacturer unless stated in this section.

1.6.5.1 Alternative Qualifications

Products having less than a 2-year field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturers' factory or laboratory tests, is furnished.

1.6.5.2 Material and Equipment Manufacturing Date

Products manufactured more than 1 year prior to date of delivery to site shall not be used, unless specified otherwise.

1.7 DELIVERY AND STORAGE

Provide protection from weather, moisture, extreme heat and cold, dirt, dust, and other contaminants for telecommunications cabling and equipment placed in storage.

1.8 ENVIRONMENTAL REQUIREMENTS

Connecting hardware shall be rated for operation under ambient conditions of 32 to 140 degrees F and in the range of 0 to 95 percent relative humidity, noncondensing.

1.9 WARRANTY

The equipment items shall be supported by service organizations which are reasonably convenient to the equipment installation in order to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

1.10 MAINTENANCE

1.10.1 Operation and Maintenance Manuals

Commercial off the shelf manuals shall be furnished for operation, installation, configuration, and maintenance of products provided as a part of the telecommunications cabling and pathway system, Data Package 5. Submit operations and maintenance data in accordance with Section 01 78 23 OPERATION AND MAINTENANCE DATA and as specified herein not later than 2 months prior to the date of beneficial occupancy. In addition to requirements of Data Package 5, include the requirements of paragraphs TELECOMMUNICATIONS DRAWINGS, TELECOMMUNICATIONS SPACE DRAWINGS, and RECORD DOCUMENTATION. Ensure that these drawings and documents depict the as-built configuration.

1.10.2 Record Documentation

Provide As-Built drawings as indicated in Eglin's 96 CS standards. Deliverables/As-Builts for GIS data, shape files, butterflies, etc IAW Eglin Design Guide Para 3.2, 3.3, and Attch A

PART 2 PRODUCTS

2.1 COMPONENTS

Components shall be UL or third party certified. Where equipment or materials are specified to conform to industry and technical society reference standards of the organizations, submit proof of such compliance. The label or listing by the specified organization will be acceptable evidence of compliance. In lieu of the label or listing, submit a certificate from an independent testing organization, competent to perform testing, and approved by the Contracting Officer. The certificate shall state that the item has been tested in accordance with the specified organization's test methods and that the item complies with the specified organization's reference standard. Provide a complete system of telecommunications cabling and pathway components using star topology. Provide support structures and pathways, complete with outlets, cables, connecting hardware and telecommunications cabinets/racks. Cabling and interconnecting hardware and components for telecommunications systems shall be UL listed or third party independent testing laboratory certified, and shall comply with NFPA 70 and conform to the requirements specified herein. All materials shall be approved by the 96 CS.

2.2 TELECOMMUNICATIONS PATHWAY

Provide telecommunications pathways in accordance with TIA-569 and as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Provide system furniture pathways in accordance with UL 1286.

2.3 TELECOMMUNICATIONS CABLING

Cabling shall be UL listed for the application and shall comply with TIA-568-C.0, TIA-568-C.1, TIA-568-C.2, TIA-568-C.3 and NFPA 70. Provide a labeling system for cabling as required by TIA-606 and UL 969. Ship cable on reels or in boxes bearing manufacture date for for unshielded twisted pair (UTP) in accordance with ICEA S-90-661 and optical fiber cables in accordance with ICEA S-83-596 for all cable used on this project. Cabling manufactured more than 12 months prior to date of installation shall not be used.

2.3.1 Backbone Cabling

2.3.1.1 Backbone Optical Fiber

Provide in accordance with ICEA S-83-596, TIA-568-C.3, UL 1666 and NFPA 70. Cable shall be imprinted with fiber count, fiber type and aggregate length at regular intervals not to exceed 40 inches.

Provide the number of strands indicated, (but not less than 12 strands between the main telecommunication room and each of the other telecommunication rooms), of single-mode(OS1), tight buffered fiber optic cable.

Provide plenum (OFNP), riser (OFNR), or general purpose (OFN or OFNG) rated non-conductive, fiber optic cable in accordance with NFPA 70. Substitution of a higher rated cable shall be permitted in accordance with NFPA 70. The cable cordage jacket, fiber, unit, and group color shall be in accordance with TIA/EIA-598.

Provide plenum (OFNP) riser (OFNR) , or general purpose (OFN or OFNG)

rated non-conductive, fiber optic cable in accordance with NFPA 70. Substitution of a higher rated cable shall be permitted in accordance with NFPA 70. The cable cordage jacket, fiber, unit, and group color shall be in accordance with TIA/EIA-598.

2.3.2 Horizontal Cabling

Provide horizontal cable in compliance with NFPA 70 and performance characteristics in accordance with TIA-568-C.1.

2.3.2.1 Horizontal Optical Fiber

Provide optical fiber horizontal cable in accordance with ICEA S-83-596and TIA-568-C.3. Cable shall be tight buffered, multimode, 50/125-um diameter laser optimized, OM3. Cable shall be imprinted with manufacturer, flammability rating and fiber count at regular intervals not to exceed 40 inches.

Provide plenum (OFNP) rated non-conductive, fiber optic cable in accordance with NFPA 70. Substitution of a higher rated cable shall be permitted in accordance with NFPA 70.Cables installed in conduit within and under slabs be UL listed and labeled for wet locations in accordance with NFPA 70. The cable jacket shall be of single jacket construction with color coding of cordage jacket, fiber, unit, and group in accordance with TIA/EIA-598.

2.3.3 Work Area Cabling

2.3.3.1 Work Area Copper

Provide work area copper cable in accordance with TIA-568-C.2. Refer to drawings for additional requirements.

2.3.3.2 Work Area Optical Fiber

Provide optical work area cable in accordance with TIA-568-C.3.

2.4 TELECOMMUNICATIONS SPACES

Provide connecting hardware and termination equipment in the telecommunications entrance facility and telecommunication equipment rooms to facilitate installation as shown on design drawings for terminating and cross-connecting permanent cabling. Provide telecommunications interconnecting hardware color coding in accordance with TIA-606.

2.4.1 Backboards

Provide void-free, interior grade A-C plywood 3/4 inch thick as indicated. Backboards shall be fire rated by manufacturing process. Fire stamp shall be clearly visible. Paint applied over fire retardant backboard shall be UL 723 fire retardant paint. Provide label including paint manufacturer, date painted, UL listing and name of Installer. When painted, paint label and fire stamp shall be clearly visible. Backboards shall be provided on a minimum of two adjacent walls in the telecommunication spaces.

2.4.2 Equipment Support Frame

Provide in accordance with ECIA EIA/ECA 310-E and UL 50.

b. Racks, floor mounted modular type as indicated in Eglin's 96 CS design standards. Provide rack with vertical and horizontal cable management channels, top and bottom cable troughs, grounding lug and a surge protected power strip with 6 duplex 20 amp receptacles. Rack shall be compatible with 19 inches panel mounting.

c. Cabinets, freestanding modular type as indicated in Eglin's 96 CS design standards. Cabinet shall be vented in the roof and rear door. Cabinet shall have cable access in the roof and base and be compatible with 19 inches panel mounting. Provide cabinet with grounding bar roof mounted 550 CFM fan with filter and a surge protected power strip with 6 duplex 20 amp receptacles. All cabinets shall be keyed individually for the system to which they serve.

da. Cabinets, wall-mounted modular type, as indicated in Eglin's 96 CS design standards. For DDC cabinet, refer to plans for basis of design. Cabinet shall have have lockable front door, louvered side panels, 250 CFM roof mounted fan, ground lug, and top and bottom cable access. Cabinet shall be compatible with 19 inches panel mounting. All cabinets shall be keyed individually for the system to which they serve alike. A surge protected power strip with 6 duplex 20 amp receptacles shall be provided within the cabinet.

2.4.3 Connector Blocks

Provide insulation displacement connector (IDC) Type 110 for Category 6 systems. Provide blocks for the number of horizontal and backbone cables terminated on the block plus 25 percent spare.

2.4.4 Cable Guides

Provide cable guides specifically manufactured for the purpose of routing cables, wires and patch cords horizontally and vertically on19 inches equipment racks, cabinets, and telecommunications backboards. Cable guides of ring or bracket type devices for horizontal cable management and individually mounted for vertical cable management. Mount cable guides with screws, and or nuts and lockwashers.

2.4.5 Patch Panels

2.4.5.1 Fiber Optic Patch Panel

Provide panel for maintenance and cross-connecting of optical fiber cables. Panel shall be constructed of16 gauge steel or 11 gauge aluminum minimum and shall be cabinet mounted and compatible with a ECIA EIA/ECA 310-E 19 inches equipment rack. Each panel shall provide a minimum 24 multimode adapters as duplex LC in accordance with TIA/EIA-604-10 with zirconia ceramic alignment sleeves, alignment sleeves. Provide dust cover for unused adapters. The rear of each panel shall have a cable management tray a minimum of 8 inches deep with removable cover, incoming cable strain-relief and routing guides. Panels shall have each adapter factory numbered and be equipped with laminated plastic nameplates above each adapter.

2.4.6 Optical Fiber Distribution Panel

Cabinet mounted optical fiber distribution panel (OFDP) shall be constructed in accordance with ECIA EIA/ECA 310-E utilizing 18 gauge steel minimum. Panel shall be divided into two sections, distribution and

user. Distribution section shall have strain relief, routing guides, splice tray and shall be lockable, user section shall have a cover for patch cord protection. Each panel shall provide multimode and single-mode pigtails and adapters. Provide adapters as duplex LC with zirconia ceramic alignment sleeves. Provide dust covers for adapters. Provide patch cords as specified in the paragraph PATCH PANELS.

2.5 TELECOMMUNICATIONS OUTLET/CONNECTOR ASSEMBLIES

2.5.1 Outlet/Connector Copper

Outlet/connectors shall comply with FCC Part 68, TIA-568-C.1, and TIA-568-C.2. UTP outlet/connectors shall be UL 1863 listed, non-keyed, 8-pin modular, constructed of high impact rated thermoplastic housing and shall be third party verified and shall comply with TIA-568-C.2 Category 6 requirements. Outlet/connectors provided for UTP cabling shall meet or exceed the requirements for the cable provided. Outlet/connectors shall be terminated using a Type 110 IDC PC board connector, color-coded for both T568A and T568B wiring. Each outlet/connector shall be wired as indicated. UTP outlet/connectors shall comply with TIA-568-C.2 for 200 mating cycles.

2.5.2 Optical Fiber Adapters(Couplers)

Provide optical fiber adapters suitable for duplex LC in accordance with TIA/EIA-604-10 with zirconia ceramic alignment sleeves, as indicated. Provide dust cover for adapters. Optical fiber adapters shall comply with TIA-455-21 for 500 mating cycles.

2.5.3 Optical Fiber Connectors

Provide in accordance with TIA-455-21. Optical fiber connectors shall be duplex LC in accordance with TIA/EIA-604-10 with zirconia ceramic alignment sleeves, ferrule, epoxyless crimp style compatible with 8/125 single-mode fiber. The connectors shall provide a maximum attenuation of 0.3 dB at 1310 and 1550 nm with less than a 0.2 dB change after 500 mating cycles.

2.5.4 Cover Plates

Telecommunications cover plates shall comply with UL 514C, and TIA-568-C.1, TIA-568-C.2, TIA-568-C.3; flush or oversized design constructed of high impact thermoplastic material to match color of receptacle/switch cover plates specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Provide labeling in accordance with the paragraph LABELING in this section.

2.6 MULTI-USER TELECOMMUNICATIONS OUTLET ASSEMBLY (MUTOA)

Provide MUTOA(s) in accordance with TIA-568-C.1.

2.7 GROUNDING AND BONDING PRODUCTS

Provide in accordance with UL 467, TIA-607, and NFPA 70. Components shall be identified as required by TIA-606. Provide ground rods, bonding conductors, and grounding busbars as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

2.8 FIRESTOPPING MATERIAL

Provide as specified in Section 07 84 00 FIRESTOPPING.

2.9 MANUFACTURER'S NAMEPLATE

Each item of equipment shall have a nameplate bearing the manufacturer's name, address, model number, and serial number securely affixed in a conspicuous place; the nameplate of the distributing agent will not be acceptable.

2.10 FIELD FABRICATED NAMEPLATES

ASTM D709. Provide laminated plastic nameplates for each equipment enclosure, relay, switch, and device; as specified or as indicated on the drawings. Each nameplate inscription shall identify the function and, when applicable, the position. Nameplates shall be melamine plastic, 0.125 inches thick, white with black center core. Surface shall be matte finish. Corners shall be square. Accurately align lettering and engrave into the core. Minimum size of nameplates shall be one by 2.5 inches. Lettering shall be a minimum of 0.25 inches high normal block style.

2.11 TESTS, INSPECTIONS, AND VERIFICATIONS

2.11.1 Factory Reel Tests

Provide documentation of the testing and verification actions taken by manufacturer to confirm compliance with TIA-568-C.1, TIA-568-C.2, TIA-568-C.3, TIA-526-7 for single mode optical fiber , and TIA-526-14 for multimode optical fiber cables.

PART 3 EXECUTION

3.1 INSTALLATION

Install telecommunications cabling and pathway systems, including the horizontal and backbone cable, pathway systems, telecommunications outlet/connector assemblies, and associated hardware in accordance with NECA/BICSI 568, TIA-568-C.1, TIA-568-C.2, TIA-568-C.3, TIA-569, NFPA 70, and UL standards as applicable. Provide cabling in a star topology network. Pathways and outlet boxes shall be installed as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Install telecommunications cabling with copper media in accordance with the following criteria to avoid potential electromagnetic interference between power and telecommunications equipment. The interference ceiling shall not exceed 3.0 volts per meter measured over the usable bandwidth of the telecommunications cabling.

3.1.1 Cabling

Install UTP, and optical fiber telecommunications cabling system as detailed in TIA-568-C.1, TIA-568-C.2, and TIA-568-C.3. Screw terminals shall not be used except where specifically indicated on plans. Use an approved insulation displacement connection (IDC) tool kit for copper cable terminations. Do not exceed manufacturers' cable pull tensions for copper and optical fiber cables. Provide a device to monitor cable pull tensions. Do not exceed 25 pounds pull tension for four pair copper cables. Do not chafe or damage outer jacket materials. Use only lubricants approved by cable manufacturer. Do not over cinch cables, or

crush cables with staples. For UTP cable, bend radii shall not be less than four times the cable diameter. Cables shall be terminated; no cable shall contain unterminated elements. Cables shall not be spliced. Label cabling in accordance with paragraph LABELING in this section.

3.1.1.1 Open Cable

Use only where specifically indicated on plans for use in cable trays, or below raised floors. Install in accordance with TIA-568-C.1, TIA-568-C.2 and TIA-568-C.3. Do not exceed cable pull tensions recommended by the manufacturer.

Plenum cable shall be used where open cables are routed through plenum areas. Cable routed exposed under raised floors shall be plenum rated. Plenum cables shall comply with flammability plenum requirements of NFPA 70. Install cabling after the flooring system has been installed in raised floor areas.

3.1.1.2 Backbone Cable

a. Optical fiber Backbone Cable. Install intrabuilding backbone optical fiber in indicated pathways. Do not exceed manufacturer's recommended bending radii and pull tension. Prepare cable for pulling by cutting outer jacket 10 inches leaving strength members exposed for approximately 10 inches. Twist strength members together and attach to pulling eye. Vertical cable support intervals shall be in accordance with manufacturer's recommendations.

3.1.1.3 Horizontal Cabling

Install horizontal cabling as indicated on drawings Do not untwist Category 6 UTP cables more than one half inch from the point of termination to maintain cable geometry. Provide slack cable in an out and back fashion maintaining its natural lay on each end of the cable, 10 feet in the telecommunications room, and3.5 feet located above ceiling for the work area outlets.

3.1.2 Pathway Installations

Provide in accordance with TIA-569 and NFPA 70. Provide building pathway as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

3.1.3 Cable Tray Installation

Install cable tray as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM. Only CMP and OFNP type cable shall be installed in a plenum.

3.1.4 Work Area Outlets

3.1.4.1 Terminations

Terminate UTP cable in accordance with TIA-568-C.1, TIA-568-C.2 and wiring configuration as specified. Terminate fiber optic cables in accordance with TIA-568-C.3.

3.1.4.2 Cover Plates

As a minimum, each outlet/connector shall be labeled as to its function and a unique number to identify cable link in accordance with the

paragraph LABELING in this section.

3.1.4.3 Cables

Unshielded twisted pair and fiber optic cables shall have a minimum of 3.5 feet of slack cable loosely coiled located above ceiling for each of the telecommunications outlet boxes. Minimum manufacturer's bend radius for each type of cable shall not be exceeded.

3.1.4.4 Pull Cords

Pull cords shall be installed in conduit serving telecommunications outlets that do not have cable installed.

3.1.5 Telecommunications Space Termination

Install termination hardware required for Category 6 and optical fiber system. An insulation displacement tool shall be used for terminating copper cable to insulation displacement connectors.

3.1.5.1 Connector Blocks

Connector blocks shall be cabinet mounted in orderly rows and columns. Adequate vertical and horizontal wire routing areas shall be provided between groups of blocks. Install in accordance with industry standard wire routing guides in accordance with TIA-569.

3.1.5.2 Patch Panels

Patch panels shall be mounted in equipment cabinets or racks with sufficient ports to accommodate the installed cable plant plus 25 percent spares.

a. Copper Patch Panel. Copper cable entering a patch panel shall be secured to the panel as recommended by the manufacturer to prevent movement of the cable.

3.1.5.3 Equipment Support Frames

Install in accordance with TIA-569:

a. Cabinets, wall-mounted modular type. Mount cabinet to plywood backboard in accordance with manufacturer's recommendations. Mount cabinet so height of highest panel does not exceed 78 inches above floor.

3.1.6 Electrical Penetrations

Seal openings around electrical penetrations through fire resistance-rated wall, partitions, floors, or ceilings as specified in Section 07 84 00 FIRESTOPPING.

3.1.7 Grounding and Bonding

Provide in accordance with TIA-607, NFPA 70 and as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

3.2 LABELING

3.2.1 Labels

Provide labeling in accordance with TIA-606. Handwritten labeling is unacceptable. Stenciled lettering for voice and data circuits shall be provided using laser printer.

3.2.2 Cable

Cables shall be labeled using color labels on both ends with identifiers in accordance with TIA-606.

3.2.3 Termination Hardware

Workstation outlets and patch panel connections shall be labeled using color coded labels with identifiers in accordance with TIA-606.

3.3 FIELD APPLIED PAINTING

Paint electrical equipment as required to match finish of adjacent surfaces or to meet the indicated or specified safety criteria. Painting shall be as specified in Section 09 90 00 PAINTS AND COATINGS.

3.3.1 Painting Backboards

If backboards are required to be painted, then the manufactured fire retardant backboard must be painted with fire retardant paint, so as not to increase flame spread and smoke density and must be appropriately labeled. Label and fire rating stamp must be unpainted.

3.4 FIELD FABRICATED NAMEPLATE MOUNTING

Provide number, location, and letter designation of nameplates as indicated. Fasten nameplates to the device with a minimum of two sheet-metal screws or two rivets.

3.5 TESTING

3.5.1 Telecommunications Cabling Testing

Perform telecommunications cabling inspection, verification, and performance tests in accordance with TIA-568-C.1, TIA-568-C.2, TIA-568-C.3.
Test equipment shall conform to TIA-1152. Perform optical fiber field inspection tests via attenuation measurements on factory reels and provide results along with manufacturer certification for factory reel tests. Remove failed cable reels from project site upon attenuation test failure.
96 CS shall witness all tests. 96 CS/SCOW shall perform at minimum 2 in-progress inspections (25% and 75%) and a final acceptance inspection with 96 CS personnel present for all final verification and acceptance tests. Contractor shall notify 96 CS/SCXP at least 72 hours prior to each in-progress and final inspections.

3.5.1.1 Inspection

Visually inspect UTP and optical fiber jacket materials for UL or third party certification markings. Inspect cabling terminations in telecommunications rooms and at workstations to confirm color code for T568A or T568B pin assignments, and inspect cabling connections to confirm

compliance with TIA-568-C.1, TIA-568-C.2, and TIA-568-C.3. Visually confirm Category 6, marking of outlets, cover plates, outlet/connectors, and patch panels.

3.5.1.2 Verification Tests

UTP backbone copper cabling shall be tested for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors, and between conductors and shield, if cable has overall shield. Test operation of shorting bars in connection blocks. Test cables after termination but prior to being cross-connected.

For single-mode optical fiber, perform optical fiber end-to-end attenuation tests in accordance with TIA-568-C.3 and TIA-526-7 using Method B, OTDR for single-mode optical fiber. Perform verification acceptance tests.

3.5.1.3 Performance Tests

Perform testing for each outlet and MUTOA as follows:

a. Perform Category 6 link tests in accordance with TIA-568-C.1 and TIA-568-C.2. Tests shall include wire map, length, insertion loss, NEXT, PSNEXT, ELFEXT, PSELFEXT, return loss, propagation delay, and delay skew.

b. Optical fiber Links. Perform optical fiber end-to-end link tests in accordance with TIA-568-C.3.

3.5.1.4 Final Verification Tests

Perform verification tests for UTP and optical fiber systems after the complete telecommunications cabling and workstation outlet/connectors are installed. 96 CS/SCOW personnel to be on site to verify all ISP and fiber testing by the contractor prior to acceptance.

-- End of Section --

SECTION 28 31 76

INTERIOR FIRE ALARM AND MASS NOTIFICATION SYSTEM, ADDRESSABLE
08/20

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

ACOUSTICAL SOCIETY OF AMERICA (ASA)

ASA S3.2	(2020) American National Standard Method for Measuring the Intelligibility of Speech Over Communication Systems (ASA 85)

FM GLOBAL (FM)

FM APP GUIDE	(updated on-line) Approval Guide http://www.approvalguide.com/

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE C62.41.1	(2002; R 2008) Guide on the Surges Environment in Low-Voltage (1000 V and Less) AC Power Circuits
IEEE C62.41.2	(2002) Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 4	(2018) Standard for Integrated Fire Protection and Life Safety System Testing
NFPA 70	(2020; ERTA 20-1 2020; ERTA 20-2 2020; TIA 20-1; TIA 20-2; TIA 20-3; TIA 20-4) National Electrical Code
NFPA 72	(2022; ERTA 22-1) National Fire Alarm and Signaling Code
NFPA 90A	(2021) Standard for the Installation of Air Conditioning and Ventilating Systems
NFPA 170	(2021) Standard for Fire Safety and Emergency Symbols

U.S. DEPARTMENT OF DEFENSE (DOD)

UFC 3-600-01	(2016; with Change 6, 2021) Fire Protection Engineering for Facilities

UFC 3-601-02	(2021) Fire Protection Systems Inspection, Testing, and Maintenance
UFC 4-010-06	(2016; with Change 1, 2017) Cybersecurity of Facility-Related Control Systems

U.S. NATIONAL ARCHIVES AND RECORDS ADMINISTRATION (NARA)

47 CFR 15	Radio Frequency Devices
47 CFR 90	Private Land Mobile Radio Services

UNDERWRITERS LABORATORIES (UL)

UL 268	(2016; Reprint Nov 2021) UL Standard for Safety Smoke Detectors for Fire Alarm Systems
UL 268A	(2008; Reprint Oct 2014) Smoke Detectors for Duct Application
UL 464	(2016; Reprint Sep 2017) UL Standard for Safety Audible Signaling Devices for Fire Alarm and Signaling Systems, Including Accessories
UL 497A	(2001; Bul. 2019) UL Standard for Safety Secondary Protectors for Communications Circuits
UL 497B	(2004; Reprint Feb 2022) UL Standard for Safety Protectors for Data Communications and Fire Alarm Circuits
UL 864	(2014; Reprint May 2020) UL Standard for Safety Control Units and Accessories for Fire Alarm Systems
UL 1283	(2017) UL Standard for Safety Electromagnetic Interference Filters
UL 1449	(2021) UL Standard for Safety Surge Protective Devices
UL 1480	(2016; Reprint Sep 2017) UL Standard for Safety Speakers for Fire Alarm and Signaling Systems, Including Accessories
UL 1638	(2016; Reprint Sep 2017) UL Standard for Safety Visible Signaling Devices for Fire Alarm and Signaling Systems, Including Accessories
UL 1971	(2002; Reprint Oct 2008) Signaling Devices for the Hearing Impaired
UL 2017	(2008; Reprint Dec 2018) UL Standard for Safety General-Purpose Signaling Devices and Systems

UL 2034	(2017; Reprint Oct 2022) UL Standard for Safety Single and Multiple Station Carbon Monoxide Alarms
UL 2075	(2013; Bul. 2019) UL Standard for Safety Gas and Vapor Detectors and Sensors
UL 2572	(2016; Bul. 2018) UL Standard for Safety Mass Notification Systems
UL Fire Prot Dir	(2012) Fire Protection Equipment Directory

1.2 RELATED SECTIONS

Refer to the following sections for related work and coordination:

Section 21 13 13 WET PIPE SPRINKLER SYSTEM, FIRE PROTECTION

1.3 SUMMARY

1.3.1 Scope

a. This work includes designing and providing a new, complete, fire alarm and mass notification (MNS) system as described herein and on the contract drawings. Include system wiring, raceways, pull boxes, terminal cabinets, outlet and mounting boxes, control equipment, initiating devices, notification appliances, supervising station fire alarm transmitters/mass notification transceiver, and other accessories and miscellaneous items required for a complete operational system even though each item is not specifically mentioned or described. Provide systems complete and ready for operation. Design and installation must comply with UFC 4-010-06, UFC 3-600-01 and AFGM 2019-320-02.

b. Provide equipment, materials, installation, workmanship, inspection, and testing in strict accordance with NFPA 72, except as modified herein. The system layout on the drawings show the intent of coverage and suggested locations. Final quantity, system layout, and coordination are the responsibility of the Contractor.

c. Each remote fire alarm control unit must be powered from a wiring riser specifically for that use or from a local emergency power panel located on the same floor as the remote fire alarm control unit. Where remote fire control units are provided, equipment for notification appliances may be located in the remote fire alarm control units.

d. The fire alarm and mass notification system must be independent of the building security, building management, and energy/utility monitoring systems other than for control functions.

1.3.2 Qualified Fire Protection Engineer (QFPE)

Services of the QFPE must include:

a. Reviewing SD-02, SD-03, and SD-05 submittal packages for completeness and compliance with the provisions of this specification. Construction (shop) drawings and calculations must be prepared by, or

prepared under the immediate supervision of, the QFPE. The QFPE must affix their professional engineering stamp with signature to the shop drawings, calculations, and material data sheets, indicating approval prior to submitting the shop drawings to the DFPE.

b. Providing a letter documenting that the SD-02, SD-03, and SD-05 submittal package has been reviewed and noting any outstanding comments.

c. Performing in-progress construction surveillance prior to installation of ceilings (rough-in inspection).

d. Witnessing pre-Government and final Government functional performance testing and performing a final installation review.

e. Signing applicable certificates under SD-07.

1.4 DEFINITIONS

Wherever mentioned in this specification or on the drawings, the equipment, devices, and functions must be defined as follows:

1.4.1 Interface Device

An addressable device that interconnects hard wired systems or devices to an analog/addressable system.

1.4.2 Fire Alarm and Mass Notification Control Unit (FMCU)

A master control unit having the features of a fire alarm control unit (FACU) and an autonomous control unit (ACU) where these units are interconnected to function as a combined fire alarm/mass notification system. The FACU and ACU functions may be contained in a single cabinet or in independent, interconnected, and co-located cabinets.

1.4.3 Remote Fire Alarm and Mass Notification Control Unit

A control unit, physically remote from the fire alarm and mass notification control unit, that receives inputs from automatic and manual fire alarm devices; may supply power to detection devices and interface devices; may provide transfer of power to the notification appliances; may provide transfer of condition to relays or devices connected to the control unit; and reports to and receives signals from the fire alarm and mass notification control unit.

1.4.4 Local Operating Console (LOC)

A unit designed to allow emergency responders and/or building occupants to operate the MNS including delivery of recorded messages and/or live voice announcements, initiate visual, and audible appliance operation and other relayed functions.

1.4.5 Terminal Cabinet

A steel cabinet with locking, hinge-mounted door where terminal strips are securely mounted inside the cabinet.

1.4.6 Control Module and Relay Module

Terms utilized to describe emergency control function interface devices as defined by NFPA 72.

1.4.7 Designated Fire Protection Engineer (DFPE)

The DoD fire protection engineer that oversees that Area of Responsibility for that project. This is sometimes referred to as the "cognizant" fire protection engineer. Interpret reference to "authority having jurisdiction" and/or AHJ in referenced standards to mean the Designated Fire Protection Engineer (DFPE). The DFPE may be responsible for review of the contractor submittals having a "G" designation, and for witnessing final inspection and testing.

1.4.8 Qualified Fire Protection Engineer (QFPE)

A QFPE is an individual who is a licensed professional engineer (P.E.), who has passed the fire protection engineering written examination administered by the National Council of Examiners for Engineering and Surveying (NCEES) and has relevant fire protection engineering experience.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" or "S" classification. Submittals not having a "G" or "S" classification are for information only. When used, a code following the "G" classification identifies the office that will review the submittal for the Government.

Shop drawings (SD-02), product data (SD-03) and calculations (SD-05) must be prepared by the fire alarm designer and combined and submitted as one complete package. The QFPE must review the SD-02/SD-03/SD-05 submittal package for completeness and compliance with the Contract provisions prior to submission to the Government. The QFPE must provide a Letter of Confirmation that they have reviewed the submittal package for compliance with the contract provisions. This letter must include their registered professional engineer stamp and signature. Partial submittals and submittals not reviewed by the QFPE will be returned by the Government disapproved without review.

Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Qualified Fire Protection Engineer (QFPE); G

Fire alarm system designer; G

Supervisor; G

Technician; G

Installer; G

Test Technician; G

Fire Alarm System Site-Specific Software Acknowledgement; G

SD-02 Shop Drawings

Nameplates; G

Instructions; G

Wiring Diagrams; G

System Layout; G

Notification Appliances; G

Initiating devices; G

Amplifiers; G

Battery Power; G

Voltage Drop Calculations; G

SD-03 Product Data

Fire Alarm and Mass Notification Control Unit (FMCU); G

Local Operating Console (LOC); G

Amplifiers; G

Tone Generators; G

Digitalized voice generators; G

LCD Annunciator; G

Manual Stations; G

Smoke Detectors; G

Duct Smoke Detectors; G

Carbon monoxide detector; G

Addressable Interface Devices; G

Addressable Control Modules; G

Isolation Modules; G

Notification Appliances; G

Batteries; G

Battery Chargers; G

Supplemental Notification Appliance Circuit Panels; G

Auxiliary Power Supply Panels; G

Surge Protective Devices; G

Alarm Wiring; G

Back Boxes and Conduit; G

Ceiling Bridges for Ceiling-Mounted Appliances; G

Terminal Cabinets; G

Automatic Fire Alarm Transceiver (including housing); G

Radio Transceiver and Interface Panels; G

Document Storage Cabinet; G

SD-06 Test Reports

Test Procedures; G

SD-07 Certificates

Verification of Compliant Installation; G

Request for Government Final Test; G

SD-10 Operation and Maintenance Data

Operation and Maintenance (O&M) Instructions; G

Instruction of Government Employees; G

SD-11 Closeout Submittals

As-Built Drawings

Spare Parts

1.6 SYSTEM OPERATION

Fire alarm system/mass notification system including components requiring power, except for the FMCU(s) power supply, must operate on 24 volts DC unless noted otherwise in this section.

The interior fire alarm and mass notification system must be a complete, supervised, noncoded, analog/addressable fire alarm and mass notification system conforming to NFPA 72, UL 864, and UL 2572. Systems meeting UL 2017 only are not acceptable. The system must be activated into the alarm mode by actuation of an alarm initiating device. The system must remain in the alarm mode until the initiating device is reset and the control unit is reset and restored to normal. The system may be placed in the alarm mode by local microphones, LOC, FMCU, or remotely from authorized locations/users.

1.6.1 Alarm Initiating Devices and Notification Appliances (Visual, Voice)

a. Connect alarm initiating devices to initiating device circuits (IDC) Class "A", or to signaling line circuits (SLC) Class "A" and installed in accordance with NFPA 72.

b. Connect notification appliances to notification appliance circuits (NAC) Class "A.

1.6.2 Functions and Operating Features

The system must provide the following functions and operating features:

a. Power, annunciation, supervision, and control for the system. Addressable systems must be microcomputer (microprocessor or microcontroller) based with a minimum word size of eight bits with sufficient memory to perform as specified.

b. Visual alarm notification appliances must be synchronized as required by NFPA 72.

c. Electrical supervision of the primary power (AC) supply, presence of the battery, battery voltage, and placement of system modules within the control unit.

d. An audible and visual trouble signal to activate upon a single break or open condition, or ground fault. The trouble signal must also operate upon loss of primary power (AC) supply, absence of a battery supply, low battery voltage, or removal of alarm or supervisory control unit modules. After the system returns to normal operating conditions, the trouble signal must again sound until the trouble is acknowledged. A smoke detector in the process of being verified for the actual presence of smoke must not initiate a trouble condition.

e. A trouble signal silence feature that must silence the audible trouble signal, without affecting the visual indicator.

f. Program capability via switches in a locked portion of the FMCU to bypass the automatic notification appliance circuits features. Operation of this programmed action must indicate on the FMCU display as a supervisory or trouble condition.

g. Alarm functions must override trouble or supervisory functions. Supervisory functions must override trouble functions.

h. The system must be capable of being programmed from the control unit keyboard. Programmed information must be stored in non-volatile memory.

i. The system must be capable of operating, supervising, and/or monitoring non-addressable alarm and supervisory devices.

j. There must be no limit, other than maximum system capacity, as to the number of addressable devices that may be in alarm simultaneously.

k. Where the fire alarm/mass notification system is responsible for initiating an action in another emergency control device or system, such as HVAC, the addressable fire alarm relay must be located in the vicinity of the emergency control device.

l. An alarm signal must automatically initiate the following functions:

(1) Transmission of an alarm signal to the remote supervising station.

(2) Visual indication of the device operated on the FMCU, and on the

remote annunciator.

(4) Actuation of alarm notification appliances.

(5) Recording of the event electronically in the history log of the FMCU.

m. A supervisory signal must automatically initiate the following functions:

(1) Visual indication of the device operated on the FMCU, and on the remote annunciator.

(3) Transmission of a supervisory signal to a remote supervising station.

(4) Operation of a duct smoke detector must shut down the appropriate air handler in accordance with NFPA 90A in addition to other requirements of this paragraph and as allowed by NFPA 72.

(5) Recording of the event electronically in the history log of the FMCU.

n. A trouble condition must automatically initiate the following functions:

(1) Visual indication of the device operated on the FMCU, and on the remote annunciator.

(3) Transmission of a trouble signal to a remote supervising station.

(4) Recording of the event electronically in the history log of the FMCU.

p. System control equipment must be programmed to provide a 60-minute to 180-minute delay in transmission of trouble signals resulting from primary power failure.

q. Activation of a LOC pushbutton must activate the audible and visual alarms in the facility. The audible message must be the one associated with the pushbutton activated.

1.7 TECHNICAL DATA AND SITE-SPECIFIC SOFTWARE

Technical data and site-specific software (meaning technical data that relates to computer software) that are specifically identified in this project, and may be required in other specifications, must be delivered, strictly in accordance with the CONTRACT CLAUSES. The fire alarm system manufacturer must submit written confirmation of this contract provision as "Fire Alarm System Site-Specific Software Acknowledgement". Identify data delivered by reference to the specification paragraph against which it is furnished. Data to be submitted must include complete system, equipment, and software descriptions. Descriptions must show how the equipment will operate as a system to meet the performance requirements of this contract. The site-specific software data package must also include the following:

a. Items identified in NFPA 72, titled "Site-Specific Software".

b. Identification of programmable portions of the system equipment and capabilities.

c. Description of system revision and expansion capabilities and methods of implementation detailing both equipment and software requirements.

d. Provision of operational software data on all modes of programmable portions for fire alarm and mass notification.

e. Description of Fire Alarm and Mass Notification Control Unit equipment operation.

f. Description of auxiliary and remote equipment operations.

g. Library of application software.

h. Operation and maintenance manuals.

1.8 QUALITY ASSURANCE

1.8.1 Submittal Documents

1.8.1.1 Preconstruction Submittals

Within 36 days of contract award but not less than 14 days prior to commencing any work on site, the Contractor must submit the following for review and approval. SD-02, SD-03 and SD-05 submittals received prior to the review and approval of the qualifications of the fire alarm subcontractor and QFPE must be returned disapproved without review. All resultant delays must be the sole responsibility of the Contractor.

1.8.1.2 Shop Drawings

Shop drawings must not be smaller than the Contract Drawings. Drawings must comply with the requirements of NFPA 72 and NFPA 170. Minimum scale for floor plans must be 1/8"=1'.

1.8.1.3 Nameplates

Nameplate illustrations and data to obtain approval by the Contracting Officer before installation.

1.8.1.4 Wiring Diagrams

Three copies of point-to-point wiring diagrams showing the points of connection and terminals used for electrical field connections in the system, including interconnections between the equipment or systems that are supervised or controlled by the system. Diagrams must show connections from field devices to the FMCU and remote FMCU, initiating circuits, switches, relays and terminals, including pathway diagrams between the control unit and shared communications equipment within the protected premises. Point-to-point wiring diagrams must be job specific and must not indicate connections or circuits not being utilized. Provide complete riser diagrams indicating the wiring sequence of all devices and their connections to the control equipment. Include a color-code schedule for the wiring.

1.8.1.5 System Layout

Three copies of plan view drawing showing device locations, terminal cabinet locations, junction boxes, other related equipment, conduit routing, conduit sizes, wire counts, conduit fill calculations, wire color-coding, circuit identification in each conduit, and circuit layouts for all floors. Indicate candela rating of each visual notification appliance. Indicate the wattage of each speaker. Clearly identify the locations of isolation modules. Indicate the addresses of all devices, modules, relays, and similar. Show/identify all acoustically similar spaces. Indicate if the environment for the FMCU is within its environmental listing (e.g. temperature/humidity).

Provide a complete description of the system operation in matrix format similar to the "Typical Input/Output Matrix" included in the Annex of NFPA 72.

1.8.1.6 Notification Appliances

Calculations and supporting data on each circuit to indicate that there is at least 25 percent spare capacity for notification appliances. Annotate data for each circuit on the drawings.

1.8.1.7 Initiating Devices

Calculations and supporting data on each circuit to indicate that there is at least 25 percent spare capacity for initiating devices. Annotate data for each circuit on the drawings.

1.8.1.8 Amplifiers

Calculations and supporting data to indicate that amplifiers have sufficient capacity to simultaneously drive all notification speakers at tapped settings plus 25 percent spare capacity. Annotate data for each circuit on the drawings.

1.8.1.9 Battery Power

Calculations and supporting data as required in paragraph Battery Power Calculations for alarm, alert, and supervisory power requirements. Calculations including ampere-hour requirements for each system component and each control unit component, and the battery recharging period, must be included on the drawings.

1.8.1.10 Voltage Drop Calculations

Voltage drop calculations for each notification circuit indicating that sufficient voltage is available for proper operation of the system and all components, at a minimum rated voltage of the system operating on batteries. Include the calculations on the system layout drawings.

1.8.1.11 Product Data

Three copies of annotated descriptive data to show the specific model, type, and size of each item. Catalog cuts must also indicate the NRTL listing. The data must be highlighted to show model, size, and options that are intended for consideration. Data must be adequate to demonstrate compliance with all contract requirements. Product data for all equipment must be combined into a single submittal.

Provide an equipment list identifying the type, quantity, make, and model number of each piece of equipment to be provided under this submittal. The equipment list must include the type, quantity, make and model of spare equipment. Types and quantities of equipment submitted must coincide with the types and quantities of equipment used in the battery calculations and those shown on the shop drawings.

1.8.1.12 Operation and Maintenance (O&M) Instructions

Six copies of the Operation and Maintenance Instructions. The O&M Instructions must be prepared in a single volume or in multiple volumes, with each volume indexed, and may be submitted as a Technical Data Package. Manuals must be approved prior to training. The Interior Fire Alarm And Mass Notification System Operation and Maintenance Instructions must include the following:

a. "Manufacturer Data Package five" as specified in Section 01 78 23 OPERATION AND MAINTENANCE DATA.

b. Operating manual outlining step-by-step procedures required for system startup, operation, and shutdown. The manual must include the manufacturer's name, model number, service manual, parts list, and preliminary equipment list complete with description of equipment and their basic operating features.

c. Maintenance manual listing routine maintenance procedures, possible breakdowns and repairs, and troubleshooting guide. The manuals must include conduit layout, equipment layout and simplified wiring, and control diagrams of the system as installed.

d. Complete procedures for system revision and expansion, detailing both equipment and software requirements.

e. Software submitted for this project on CD/DVD media utilized.

f. Printouts of configuration settings for all devices.

g. Routine maintenance checklist. The routine maintenance checklist must be arranged in a columnar format. The first column must list all installed devices, the second column must state the maintenance activity or state no maintenance required, the third column must state the frequency of the maintenance activity, and the fourth column provided for additional comments or reference. All data (devices, testing frequencies, and similar) must comply with UFC 3-601-02.

h. A final Equipment List must be submitted with the Operating and Maintenance (O&M) manual.

1.8.1.13 As-Built Drawings

The drawings must show the system as installed, including deviations from both the project drawings and the approved shop drawings. These drawings must be submitted within two weeks after the final Government test of the system. At least one set of the as-built (marked-up) drawings must be provided at the time of, or prior to the final Government test.

1.8.2 Qualifications

1.8.2.1 Fire Alarm System Designer

The fire alarm system designer must be certified as a Level III (minimum) Technician by National Institute for Certification in Engineering Technologies (NICET) in the Fire Alarm Systems subfield of Fire Protection Engineering Technology or meet the qualifications for a QFPE.

1.8.2.2 Supervisor

A NICET Level III fire alarm technician must supervise the installation of the fire alarm/mass notification system. The fire alarm technicians supervising the installation of equipment must be factory trained in the installation, adjustment, testing, and operation of the equipment specified herein and on the drawings.

1.8.2.3 Technician

Fire alarm technicians with a minimum of four years of experience must be utilized to install and terminate fire alarm/mass notification devices, cabinets and control units. The fire alarm technicians installing the equipment must be factory trained in the installation, adjustment, testing, and operation of the equipment specified herein and on the drawings.

1.8.2.4 Installer

Fire alarm installer with a minimum of two years of experience utilized to assist in the installation of fire alarm/mass notification devices, cabinets and control units. A licensed electrician must be allowed to install wire, cable, conduit and backboxes for the fire alarm system/mass notification system. The fire alarm installer must be factory trained in the installation, adjustment, testing, and operation of the equipment specified herein and on the drawings.

1.8.2.5 Test Technician

Fire alarm technicians with a minimum of eight years of experience and NICET Level III utilized in testing and certification of the installation of the fire alarm/mass notification devices, cabinets and control units. The fire alarm technicians testing the equipment must be factory trained in the installation, adjustment, testing, and operation of the equipment installed as part of this project.

1.8.2.6 Manufacturer

Components must be of current design and must be in regular and recurrent production at the time of installation. Provide design, materials, and devices for a protected premises fire alarm system, complete, conforming to NFPA 72, except as specified herein.

1.8.3 Regulatory Requirements

Equipment and material must be listed or approved. Listed or approved, as used in this section, means listed, labeled or approved by a Nationally Recognized Testing Laboratory (NRTL) such as UL Fire Prot Dir or FM APP GUIDE. The omission of these terms under the description of any item of equipment described must not be construed as waiving this

requirement. All listings or approvals by testing laboratories must be from an existing ANSI or UL published standard. The recommended practices stated in the manufacturer's literature or documentation must be considered as mandatory requirements.

1.9 DELIVERY, STORAGE, AND HANDLING

Protect equipment delivered and placed in storage from the weather, humidity, and temperature variation, dirt and dust, and other contaminants.

1.10 MAINTENANCE

1.10.1 Spare Parts

Furnish the following spare parts in the manufacturers original unopened containers:

a. Five complete sets of system keys.

b. Two of each type of fuse required by the system.

c. One manual stations.

d. One of each type of detector installed.

e. One of each type of detector base and head installed.

f. Two of each type of audible and visual alarm device installed.

g. One of each type of addressable monitor module installed.

h. One of each type of addressable control module installed.

i. One low voltage and one 120 VAC surge protective device.

j. Two spare reams of paper for the system printer, plus sufficient paper for testing.

o. Two spare printer ribbons.

1.10.2 Special Tools

Software, connecting cables and proprietary equipment, necessary for the maintenance, testing, and reprogramming of the equipment must be furnished to the Contracting Officer, prior to the instruction of Government employees.

PART 2 PRODUCTS

2.1 GENERAL PRODUCT REQUIREMENT

All fire alarm and mass notification equipment must be listed for use under the applicable reference standards. Interfacing of UL 864 or similar approved industry listing with Mass Notification equipment listed to UL 2572 must be done in a laboratory listed configuration, if the software programming features cannot provide a listed interface control.

2.2 MATERIALS AND EQUIPMENT

2.2.1 Standard Products

Provide materials, equipment, and devices that have been tested by a nationally recognized testing laboratory and listed for fire protection service when so required by NFPA 72 or this specification. Select material from one manufacturer, where possible, and not a combination of manufacturers, for any particular classification of materials. Material and equipment must be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 2 years prior to bid opening.

2.2.2 Nameplates

Major components of equipment must have the manufacturer's name, address, type or style, model or serial number, catalog number, date of installation, installing Contractor's name and address, and the contract number provided on a new name plate permanently affixed to the item or equipment. Major components include, but are not limited to, the following:

a. FMCU

Nameplates must be etched metal or plastic, permanently attached by screws to control units or adjacent walls.

2.2.3 Keys

Keys and locks for equipment, control units and devices must be identical.

2.2.4 Instructions

Provide a typeset printed or typewritten instruction card mounted behind a Lexan plastic or glass cover in a stainless steel or aluminum frame. Install the instructions on the interior of the FMCU. The card must show those steps to be taken by an operator when a signal is received as well as the functional operation of the system under all conditions, normal, alarm, supervisory, and trouble. The instructions must also include procedures for operating live voice microphones. The instructions and their mounting location must be approved by the Contracting Officer before being posted.

2.3 FIRE ALARM AND MASS NOTIFICATION CONTROL UNIT

Provide a complete fire alarm and mass notification control unit (FMCU) fully enclosed in a lockable steel cabinet as specified herein. Operations required for testing or for normal care, maintenance, and use of the system must be performed from the front of the enclosure. If more than a single unit is required at a location to form a complete control unit, the unit cabinets must match exactly. If more than a single unit is required, and is located in the lobby/entrance, notify the Contracting Officer's Designated Representative (COR), prior to installing the equipment. The system must be capable of defining any module as an alarm module and report alarm trouble, loss of polling, or as a supervisory module, and reporting supervisory short, supervisory open or loss of polling such as waterflow switches, valve supervisory switches, fire pump monitoring, independent smoke detection systems, relays for output function actuation.

a. Each control unit must provide power, supervision, control, and logic for the entire system, utilizing solid state, modular components, internally mounted and arranged for easy access. Each control unit must be suitable for operation on a 120 volt, 60 hertz, normal building power supply. Provide each control unit with supervisory functions for power failure, internal component placement, and operation.

b. Visual indication of alarm, supervisory, or trouble initiation on the FMCU must be by liquid crystal display or similar means with a minimum of 80 characters. The mass notification control unit must have the capability of temporarily deactivate the fire alarm audible notification appliances while delivering voice messages.

c. Provide secure operator console for initiating recorded messages, strobes and displays; and for delivering live voice messages. Provide capacity for at least eight prerecorded messages. Provide the ability to automatically repeat prerecorded messages. Provide a secure microphone for delivering live messages. Provide adequate discrete outputs to temporarily deactivate fire alarm audible notification, initiate/synchronize strobes and initiate notification appliances. Provide a complete set of self-diagnostics for controller and appliance network. Provide local diagnostic information display and local diagnostic information and system event log file.

2.3.1 Cabinet

Install control unit components in cabinets large enough to accommodate all components and also to allow ample gutter space for interconnection of control units as well as field wiring. The cabinet must be a sturdy steel housing, complete with back box, hinged steel door with cylinder lock, and surface mounting provisions. The enclosure must be identified by an engraved phenolic resin nameplate. Lettering on the nameplate must say "Fire Alarm and Mass Notification control unit" and must not be less than 1-inch high. Provide prominent rigid plastic or metal identification plates for lamps, circuits, meters, fuses, and switches.

2.3.2 Silencing Switches

2.3.2.1 Alarm Silencing Switch

Provide an alarm silencing switch at the FMCU that must silence the audible and visual notification appliances. Subsequent activation of initiating devices must cause the notification appliances to re-activate.

2.3.2.2 Supervisory/Trouble Silencing Switch

Provide supervisory and trouble silencing switch(es) that must silence the audible trouble and supervisory signal(s), but not extinguish the visual indicator. This switch must be overridden upon activation of a subsequent supervisory or trouble condition. Audible trouble indication must resound automatically every 24 hours after the silencing feature has been operated if the supervisory or trouble condition still exists.

2.3.3 Non-Interfering

Power and supervise each circuit such that a signal from one device does not prevent the receipt of signals from any other device. Initiating

devices must be manually reset by switch from the FMCU after the initiating device or devices have been restored to normal.

2.3.4 Audible Notification System

The Audible Notification System must comply with the requirements of NFPA 72 for Emergency Voice/Alarm Communications System requirements, except as specified herein. The system must be a one-way, multi-channel voice notification system incorporating user selectability of a minimum eight distinct sounds for tone signaling, and the incorporation of a voice module for delivery of recorded messages. Audible appliances must produce a three-pulse temporal pattern for three cycles followed by a voice message that is repeated until the control unit is reset or silenced. Automatic messages must be broadcast through speakers throughout the building/facility but not in stairs or elevator cabs. A live voice message must override the automatic audible output through use of a microphone input at the control unit or the LOC.

a. When using the microphone, live messages must be broadcast or all call. The system must be capable of operating all speakers at the same time.

b. The microprocessor must actively interrogate circuitry, field wiring, and digital coding necessary for the immediate and accurate rebroadcasting of the stored voice data into the appropriate amplifier input. Loss of operating power, supervisory power, or any other malfunction that could render the digitalized voice module inoperative must automatically cause the three-pulse temporal pattern to take over all functions assigned to the failed unit in the event an alarm is activated.

2.3.4.1 Outputs and Operational Modules

All outputs and operational modules must be fully supervised with on-board diagnostics and trouble reporting circuits. Provide form "C" contacts for system alarm and trouble conditions. Provide circuits for operation of auxiliary appliance during trouble conditions. During a Mass Notification event, the control unit must not generate nor cause any trouble alarms to be generated with the Fire Alarm system.

2.3.4.2 Mass Notification

a. The system must have the capability of utilizing an LOC with redundant controls of the FMCU. Notification Appliance Circuits (NAC) must be provided for the activation of strobe appliances. Audio output must be selectable for line level. A hand-held microphone must be provided and, upon activation, must take priority over any tone signal, recorded message or PA microphone operation in progress, while maintaining the strobe NAC circuit activation.

b. The Mass Notification functions must override the manual or automatic fire alarm notification. Other fire alarm functions including transmission of a signal(s) to the fire department must remain operational. When a mass notification announcement is disengaged and a fire alarm condition still exists, the audible and visual notification appliances must resume activation for alarm conditions. The fire alarm message must be of lower priority that all other messages (except any "test" messages) and must not override any other messages.

c. Messages must be recorded professionally utilizing standard industry methods, in a professional male voice. Message and tone volumes must both be at the same decibel level. Messages recorded from the system microphone must not be accepted. A 1000 Hz tone (as required by NFPA 72) must precede messages

d. Auxiliary Input Module must be designed to be an outboard expansion module to either expand the number of optional LOC's, or allow a telephone interface.

2.3.5 Memory

Provide each control unit with non-volatile memory and logic for all functions. The use of long life batteries, capacitors, or other age-dependent devices must not be considered as equal to non-volatile processors, PROMS, or EPROMS.

2.3.6 Field Programmability

Provide control units and control units that are fully field programmable for both input and output of control, initiation, notification, supervisory, and trouble functions. The system program configuration must be menu driven. System changes must be password protected. Any proprietary equipment and proprietary software needed by qualified technicians to implement future changes to the fire alarm system must be provided as part of this contract.

2.3.7 Input/Output Modifications

The FMCU must contain features that allow the bypassing of input devices from the system or the modification of system outputs. These control features must consist of a control unit mounted keypad and a keyboard. Any bypass or modification to the system must indicate a trouble condition on the FMCU.

2.3.8 Resetting

Provide the necessary controls to prevent the resetting of any alarm, supervisory, or trouble signal while the alarm, supervisory or trouble condition on the system still exists.

2.3.9 Walk Test

The FMCU must have a walk test feature. When using this feature, operation of initiating devices must result in limited system outputs, so that the notification appliances operate for only a few seconds and the event is indicated in the history log, but no other outputs occur.

2.3.10 History Logging

The control unit must have the ability to store a minimum of 400 events in a log. These events must be stored in a battery-protected memory and must remain in the memory until the memory is downloaded or cleared manually. Resetting of the control unit must not clear the memory.

2.3.11 Manual Access

An operator at the control unit, having a proper access level, must have

the capability to manually access the following information for each initiating device.

a. Primary status.

b. Device type.

c. Present average value.

d. Present sensitivity selected.

e. Detector range (normal, dirty).

2.4 LOCAL OPERATING CONSOLES (LOC)

2.4.1 General

The LOC must consist of a remote microphone station incorporating a push-to-talk (PTT) hand-held microphone and system status indicators. The LOC must have the capability of being utilized to activate prerecorded messages. The unit must incorporate microphone override of any tone generation or recorded messages. The unit must be fully supervised from the FMCU. The housing for the LOC must not be lockable.

2.5 AMPLIFIERS, PREAMPLIFIERS, TONE GENERATORS

Any amplifiers, preamplifiers, tone generators, digitalized voice generators, and other hardware necessary for a complete, operational, audible circuit conforming to NFPA 72 must be housed in a remote FMCU, terminal cabinet, or in the FMCU. Individual amplifiers must be 100 watts maximum.

2.5.1 Operation

The system must automatically operate and control all building speakers.

2.5.2 Construction

Amplifiers must utilize computer grade solid state components and must be provided with output protection devices sufficient to protect the amplifier against any transient up to 10 times the highest rated voltage in the system.

2.5.3 Inputs

Equip each system with separate inputs for the tone generator, digitalized voice driver and control unit mounted microphone. Microphone inputs must be of the low impedance, balanced line type. Both microphone and tone generator input must be operational on any amplifier.

2.5.4 Tone Generator

The tone generator must produce a three-pulse temporal pattern and must be constantly repeated until interrupted by either the digitalized voice message, the microphone input, or the alarm silence mode as specified. The tone generator must be single channel with an automatic backup generator per channel such that failure of the primary tone generator causes the backup generator to automatically take over the functions of the failed unit and also causes transfer of the common trouble relay. The

tone generator must be provided with securely attached labels to identify the component as a tone generator and to identify the specific tone it produces.

2.5.5 Protection Circuits

Each amplifier must be constantly supervised for any condition that could render the amplifier inoperable at its maximum output. Failure of any component must cause illumination of a visual "amplifier trouble" indicator on the control unit, appropriate logging of the condition in the history log, and other actions for trouble conditions as specified.

2.6 REMOTE ANNUNCIATOR

2.6.1 LCD Annunciator

Provide a semi-recessed mounted annunciator that includes an LCD display. The display must indicate the device in trouble/alarm or any supervisory device. Display the device name, address, and actual building location. The remote annunciator must duplicate functions of the FMCU for message display, fire alarm, supervisory alarm, and trouble conditions, visual and audible notification, and system reset functions. Remote annunciator must require the use of a key for accessing the reset, control and other functions.

A building floor plan must be provided and mounted (behind Plexiglass or similar protective material) at the annunciator location. The floor plan must indicate all rooms by name and number including the locations of stairs and elevators. The floor plan must show all devices and their programmed address to facilitate identification of their physical location from the LCD display information.

2.7 MANUAL STATIONS

Provide metal or plastic, surface mounted, double-action, addressable manual stations, that are not subject to operation by jarring or vibration. Stations must be equipped with screw terminals for each conductor. Stations that require the replacement of any portion of the device after activation are not permitted. Stations must be finished in red with molded raised lettering operating instructions of contrasting color. The use of a key must be required to reset the station.

2.8 SMOKE DETECTORS

2.8.1 Spot Type Detectors

Provide addressable photoelectric smoke detectors as follows:

a. Provide analog/addressable photoelectric smoke detectors utilizing the photoelectric light scattering principle for operation in accordance with UL 268. Smoke detectors must be listed for use with the FMCU.

b. Provide self-restoring type detectors that do not require any readjustment after actuation at the FMCU to restore them to normal operation. The detector must have a visual indicator to show actuation.

c. Vibration must have no effect on the detector's operation. Protect the detection chamber with a fine mesh metallic screen that prevents

the entrance of insects or airborne materials. The screen must not inhibit the movement of smoke particles into the chamber.

d. The detector address must identify the particular unit, its location within the system, and its sensitivity setting. Detectors must be of the low voltage type rated for use on a 24 VDC system.

2.8.2 Duct Smoke Detectors

Duct-mounted addressable photoelectric smoke detectors must consist of a smoke detector, as specified in paragraph Spot Type Detectors, mounted in a special housing fitted with duct sampling tubes. Detector circuitry must be mounted in a metallic or plastic enclosure exterior to the duct. It is not permitted to cut the duct insulation to install the duct detector directly on the duct. Detectors must be listed for operation over the complete range of air velocities, temperature and humidity expected at the detector when the air-handling system is operating. Detectors must be powered from the FMCU.

a. Sampling tubes must run the full width of the duct. The duct detector package must conform to the requirements of NFPA 90A, UL 268A, and must be listed for use in air-handling systems. The control functions, operation, reset, and bypass must be controlled from the FMCU.

b. Lights to indicate the operation and alarm condition must be visible and accessible with the unit installed and the cover in place. Remote indicators must be provided where required by NFPA 72. Remote indicators as well as the affected fan units must be properly identified in etched plastic placards.

c. Detectors must provide for control of auxiliary contacts that provide control, interlock, and shutdown functions. Auxiliary contacts provide for this function must be located within 3 feet of the controlled circuit or appliance. The auxiliary contacts must be supplied by the fire alarm system manufacturer to ensure complete system compatibility.

2.9 CARBON MONOXIDE DETECTOR

Analog/addressable carbon monoxide (CO) detectors must be listed to UL 2075 and set to respond to the sensitivity limits of UL 2034. Carbon monoxide detectors must be listed for use with fire alarm control units. Detectors must be self-restoring. For FMCU with no listed compatible addressable CO detectors, provide listed 4-wire detectors. Do not provide CO detectors with local alarms. Detector must be provided with an LED status indicator.

a. Where 4-wire CO detectors are necessary, each 4-wire CO detector must be individually monitored via addressable interface modules for alarm and off normal/trouble conditions (including loss of power to the individual detector). Power circuits for 4-wire CO detectors must be dedicated to powering the CO detectors only. Battery powered and 120 VAC powered detectors are prohibited.

b. Wiring connections must be made by means of screw terminals and detectors must be equipped with trouble relays. Detectors must be able to mount a single-gang electrical box.

c. A trouble condition at an individual CO detector must not affect any

other CO detectors. CO detectors must be powered by the FMCU.

d. Detectors must be provided with a means to test CO gas entry into the CO sensing cell.

2.10 ADDRESSABLE INTERFACE DEVICES

The initiating device being monitored must be configured as a Class "A" initiating device circuits. The module must be listed as compatible with the control unit. The module must provide address setting means compatible with the control unit's SLC supervision and store an internal identifying code. Monitor module must contain an integral LED that flashes each time the monitor module is polled and is visible through the device cover plate. Pull stations with a monitor module in a common backbox are not required to have an LED.

2.11 ADDRESSABLE CONTROL MODULES

The control module must be capable of operating as a relay (dry contact form C) for interfacing the control unit with other systems, and to control door holders or initiate elevator fire service. The module must be listed as compatible with the control unit. The indicating device or the external load being controlled must be configured as Class A notification appliance circuits. The system must be capable of supervising, audible, visual and dry contact circuits. The control module must have both an input and output address. The supervision must detect a short on the supervised circuit and must prevent power from being applied to the circuit. The control module must provide address setting means compatible with the control unit's SLC supervision and store an internal identifying code. The control module must contain an integral LED that flashes each time the control module is polled and is visible through the device cover plate. Control Modules must be listed for the environmental conditions in which they will be installed.

2.12 ISOLATION MODULES

a. Provide isolation modules to subdivide each signaling line circuit into groups of not more than 20 addressable devices between adjacent isolation modules.

b. Isolation modules must provide short circuit isolation for signaling line circuit wiring.

c. Power and communications must be supplied by the SLC and must report faults to the FMCU.

d. After the wiring fault is repaired, the fault isolation modules must test the lines and automatically restore the connection.

2.13 NOTIFICATION APPLIANCES

2.13.1 Audible Notification Appliances

Audible appliances must conform to the applicable requirements of UL 464. Appliances must be connected into notification appliance circuits. Surface mounted audible appliances must be painted red. Recessed audible appliances must be installed with a grill that is painted red.

2.13.1.1 Speakers

a. Speakers must conform to the applicable requirements of UL 1480. Speakers must have six different sound output levels and operate with audio line input levels of 70.7 VRMs and 25 VRMs, by means of selectable tap settings. Interior speaker tap settings must include taps of 1/4, 1/2, 1, and 2 watt, at a minimum. Exterior speakers must also be multi-tapped with no more than 15 watt maximum setting. Speakers must incorporate a high efficiency speaker for maximum output at minimum power across a frequency range of 400 Hz to 4,000 Hz, and must have a sealed back construction. Speakers must be capable of installation on standard 4-inch square electrical boxes. Where speakers and strobes are provided in the same location, they may be combined into a single wall mounted unit. All inputs must be polarized for compatibility with standard reverse polarity supervision of circuit wiring via the FMCU.

b. Provide speaker mounting plates constructed of cold rolled steel having a minimum thickness of 16 gage or molded high impact plastic and equipped with mounting holes and other openings as needed for a complete installation. Fabrication marks and holes must be ground and finished to provide a smooth and neat appearance for each plate. Each plate must be primed and painted.

c. Speakers must utilize screw terminals for termination of all field wiring.

2.13.2 Visual Notification Appliances

Visual notification appliances must conform to the applicable requirements of UL 1638, UL 1971 and conform to the Architectural Barriers Act (ABA). Visual Notification Appliances must have clear high intensity optic lens, xenon flash tubes, or light emitting diode (LED) and be marked "Alert" in letters of contrasting color. The light pattern must be dispersed so that it is visible above and below the strobe and from a 90 degree angle on both sides of the strobe. Strobe flash rate must be 1 flash per second and a minimum of 15 candela based on the UL 1971 test. Strobe must be surface mounted.

2.14 ELECTRIC POWER

2.14.1 Primary Power

Power must be 120 VAC 60 Hz service for the FMCU from the AC service to the building in accordance with NFPA 72.

2.15 SECONDARY POWER SUPPLY

Provide for system operation in the event of primary power source failure. Transfer from normal to auxiliary (secondary) power or restoration from auxiliary to normal power must be automatic and must not cause transmission of a false alarm.

2.15.1 Batteries

Provide sealed, maintenance-free, sealed lead acid batteries as the source for emergency power to the FMCU. Batteries must contain suspended electrolyte. The battery system must be maintained in a fully charged condition by means of a solid state battery charger. Provide an automatic

transfer switch to transfer the load to the batteries in the event of the failure of primary power.

2.15.1.1 Capacity

Battery size must be the greater of the following two capacities. This capacity applies to every control unit associated with this system, including supplemental notification appliance circuit panels, auxiliary power supply panels, fire alarm transmitters, and Base-wide mass notification transceivers. When determining the required capacity under alarm condition, visual notification appliances must include non-textual type appliances.

a. Sufficient capacity to operate the fire alarm system under supervisory and trouble conditions, including audible trouble signal devices for 48 hours and audible and visual signal devices under alarm conditions for an additional 15 minutes.

b. Sufficient capacity to operate the mass notification for 60 minutes after loss of AC power.

2.15.1.2 Battery Power Calculations

a. Verify that battery capacity exceeds supervisory and alarm power requirements for the criteria noted in the paragraph "Capacity" above.

(1) Substantiate the battery calculations for alarm and supervisory power requirements. Include ampere-hour requirements for each system component and each control unit component, and compliance with UL 864.

(2) Provide complete battery calculations for both the alarm and supervisory power requirements. Submit ampere-hour requirements for each system component with the calculations.

(3) Provide voltage drop calculations to indicate that sufficient voltage is available for proper operation of the system and all components. Calculations must be performed using the minimum rated voltage of each component.

b. For battery calculations assume a starting voltage of 24 VDC for starting the calculations to size the batteries. Calculate the required Amp-Hours for the specified standby time, and then calculate the required Amp-Hours for the specified alarm time. Using 20.4 VDC as starting voltage, perform a voltage drop calculation for circuits containing device and/or appliances remote from the power sources.

2.15.2 Battery Chargers

Provide a solid state, fully automatic, variable charging rate battery charger. The charger must be capable of providing 120 percent of the connected system load and must maintain the batteries at full charge. In the event the batteries are fully discharged (20.4 Volts dc), the charger must recharge the batteries back to 95 percent of full charge within 48 hours after a single discharge cycle as described in paragraph CAPACITY above. Provide pilot light to indicate when batteries are manually placed on a high rate of charge as part of the unit assembly if a high rate switch is provided.

2.16 SURGE PROTECTIVE DEVICES

Surge protective devices must be provided to suppress all voltage transients which might damage fire alarm control unit components. Systems having circuits located outdoors, communications equipment must be protected against surges induced on any signaling line circuit. Cables and conductors, that serve as communications links, must have surge protection circuits installed at each end. The surge protective device must wire in series to the power supply of the protected equipment with screw terminations. Line voltage surge arrestor must be installed directly adjacent to the power panel where the FMCU breaker is located.

a. Surge protective devices for nominal 120 VAC must be UL 1449 listed with a maximum 500 volt suppression level and have a maximum response time of 5 nanoseconds. The surge protective device must also meet IEEE C62.41.1 and IEEE C62.41.2 category B tests for surge capacity. The surge protective device must feature multi-stage construction and be provided with a long-life indicator lamp (either light emitting diode or neon) which extinguishes upon failure of protected components. Any unit fusing must be externally accessible.

b. Surge protective devices for nominal 24 VAC, fire alarm telephone dialer, or ethernet connection must be UL 497B listed, meet IEEE C62.41.1 and have a maximum response time of 1-nanosecond. The surge protective device must feature multi-stage construction and be self-resetting. The surge protective device must be a base and plug style. The base assembly must have screw terminals for fire alarm wiring. The base assembly must accept "plug-in" surge protective module.

c. All surge protective devices (SPD) must be the standard product of a single manufacturer and be equal or better than the following:

(1) For 120 VAC nominal line voltage: UL 1449 and UL 1283 listed, series connected 120 VAC, 20A rated, surge protective device in a NEMA 4x enclosure. Minimum 50,000 amp surge current rating with EMI/RFI filtering and a dry contact circuit for remote monitoring of surge protection status.

(2) For 24-volt nominal line voltage: UL 497B listed, series connected low voltage, 24-volt, 5A rated, loop circuit protector, base and replaceable module.

(3) For alarm telephone dialers: UL 497A listed, series connected, 130-volt, 150 mA rated with self-resetting fuse, dialer circuit protector with modular plug and play.

(4) For IP-DACTS: UL 497B listed, series connected, 6.4-volt, 1.5A rated with 20 kA/pair surge current, data network protector with modular plug and play.

2.17 WIRING

Provide wiring materials under this section as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM with the additions and modifications specified herein.

2.17.1 Alarm Wiring

IDC and SLC wiring must be solid copper cable in accordance with the manufacturers requirements. Copper signaling line circuits and initiating device circuit field wiring must be No. 18 AWG size conductors at a minimum. Visual notification appliance circuit conductors, that contain audible alarm appliances, must be copper No. 14 AWG size conductors at a minimum. Speaker circuits must be copper No. 16 AWG size twisted and shielded conductors at a minimum. Wire size must be sufficient to prevent voltage drop problems. Circuits operating at 24 VDC must not operate at less than the listed voltages for the detectors and/or appliances. Power wiring, operating at 120 VAC minimum, must be a minimum No. 12 AWG solid copper having similar insulation. Acceptable power-limited cables are FPL, FPLR or FPLP as appropriate with red colored covering. Nonpower-limited cables must comply with NFPA 70.

2.18 AUTOMATIC FIRE ALARM TRANSCEIVER

2.18.1 Radio Transceiver and Interface Panels

Transceivers must be compatible with proprietary supervising station receiving equipment. Each radio alarm transceiver must be the manufacturer's recognized commercial product, completely assembled, wired, factory tested, and delivered ready for installation and operation. Transceivers must be provided in accordance with applicable portions of NFPA 72, Federal Communications Commission (FCC) 47 CFR 90 and Federal Communications Commission (FCC) 47 CFR 15. Transceiver electronics module must be contained within the physical housing as an integral, removable assembly. The proprietary supervising station receiving equipment is Monaco Enterprises Model D-21-M central station system and the tranceiver must be fully compatible with this equipment. At the contractors option, and if listed, the tranceiver may be housed in the same control unit as the FMCU. The transceiver must be narrowband radio, with FCC certification for narrowband operation and meets the requirements of the NTIA (National Telecommunications and Information Administration) Manual of Regulations and Procedures for Federal Frequency Management. See REQUIREMENTS FOR NEW FIRE ALARM SYSTEMS AT EGLIN AFB (August 2021) included as an appendix to these specifications for additional transceiver requirements.

2.18.1.1 Operation

Operate each transceiver from 120-volt ac power. In the event of 120-volt ac power loss, the transceiver must automatically switch to battery operation. Switchover must be accomplished with no interruption of protective service, and must automatically transmit a trouble message. Upon restoration of ac power, transfer back to normal ac power supply must also be automatic.

2.18.1.2 Battery Power

Transceivers standby battery capacity must provide sufficient power to operate the transceiver in a normal standby status for a minimum of 72 hours and be capable of transmitting alarms during that period.

2.18.1.3 Transceiver Housing

Use NEMA Type 1 for housing. The housing must contain a lock that is keyed identical to radio alarm transceiver housings on the Installation.

Radio alarm transceivers housing must be factory painted with a suitable priming coat and not less than two coats of a hard, durable weatherproof enamel.

2.18.1.4 Antenna

Antenna must be YAGI antenna for radio alarm transceivers with a driving point impedance to match transceiver output. The antenna and antenna mounts must be corrosion resistant and designed to withstand wind velocities of 100 mph. Do not mount antennas to any portion of the building roofing system. Protect the antenna from physical damage.

2.18.2 Signals to Be Transmitted to the Base Receiving Station

The following signals must be sent to the base receiving station:

a. Sprinkler waterflow

b. Manual pull stations

c. Smoke detectors

d. Duct smoke detectors

e. Carbon monoxide detectors

f. Sprinkler valve supervision

2.19 SYSTEM MONITORING

2.19.1 Valves

Each valve affecting the proper operation of a fire protection system, including automatic sprinkler control valves, sprinkler service entrance valve, isolating valves for pressure type waterflow or supervision switches, and valves at backflow preventers, whether supplied under this contract or existing, must be electrically monitored to ensure its proper position. Provide each tamper switch with a separate address, unless they are within the same room, then a maximum of five can use the same address.

PART 3 EXECUTION

3.1 VERIFYING ACTUAL FIELD CONDITIONS

Before commencing work, examine all adjoining work on which the contractor's work is in any way dependent for perfect workmanship according to the intent of this specification section, and report to the Contracting Officer's Representative any condition which prevents performance of first class work. No "waiver of responsibility" for incomplete, inadequate or defective adjoining work will be considered unless notice has been filed before submittal of a proposal.

3.2 INSTALLATION

3.2.1 Fire Alarm and Mass Notification Control Unit (FMCU)

Locate the FMCU where indicated on the drawings. Surface mount the enclosure with the top of the cabinet 6 feet above the finished floor or center the cabinet at 5 feet, whichever is lower. Conductor terminations

must be labeled and a drawing containing conductors, their labels, their circuits, and their interconnection must be permanently mounted in the FMCU. Locate the document storage cabinet adjacent to the FMCU unless the Contracting Officer directs otherwise.

3.2.2 Battery Cabinets

When batteries will not fit in the FMCU, locate battery cabinets below or adjacent to the FMCU. Battery cabinets must be installed at an accessible location when standing at floor level. Battery cabinets must not be installed lower than 12 inches above finished floor, measured to the bottom of the cabinet, nor higher than 36 inches above the floor, measured to the top of the cabinet. Installing batteries above drop ceilings or in inaccessible locations is prohibited. Battery cabinets must be large enough to accommodate batteries and also to allow ample gutter space for interconnection of control units as well as field wiring. The cabinet must be provided in a sturdy steel housing, complete with back box, hinged steel door with cylinder lock, and surface mounting provisions.The cabinet must be identified by an engraved phenolic resin nameplate. Lettering on the nameplate must indicate the control unit(s) the batteries power and must not be less than 1-inch high.

3.2.3 Manual Stations

Locate manual stations as required by NFPA 72 and as indicated on the drawings. Mount stations so they are located no farther than 5 feet from the exit door they serve, measured horizontally.

3.2.4 Notification Appliances

a. Locate notification appliance devices as required by NFPA 72 and to meet the intelligibility requirements. Where two or more visual notification appliances are located in the same room or corridor or field of view, provide synchronized operation. Devices must use screw terminals for all field wiring. Audible and visual notification appliances mounted in acoustical ceiling tiles must be centered in the tiles plus or minus 2 inches.

b. Audible and visual notification appliances mounted on the exterior of the building, within unconditioned spaces, or in the vicinity of showers must be listed weatherproof appliances installed on weatherproof backboxes.

c. Speakers must not be located in close proximity to the FMCU or LOC so as to cause feedback when the microphone is in use.

3.2.5 Smoke Detectors

Locate detectors as required by NFPA 72 and their listing on a 4-inch mounting box. Smoke detectors are permitted to be on the wall no lower than12 inches from the ceiling with no minimum distance from the ceiling. Install smoke detectors no closer than 3 feet from air handling supply diffusers. Detectors installed in acoustical ceiling tiles must be centered in the tiles plus or minus 2 inches.

3.2.6 LCD REMOTE Annunciator

Locate the LCD annunciator as shown on the drawings.

3.2.7 Local Operating Console (LOC)

Locate the LOC(s) as required by NFPA 72 and as indicated.

3.2.8 Ceiling Bridges

Provide ceiling bridges for ceiling-mounted appliances. Ceiling bridges must be as recommended/required by the manufacturer of the ceiling-mounted notification appliance.

3.3 SYSTEM FIELD WIRING

3.3.1 Wiring within Cabinets, Enclosures, and Boxes

Provide wiring installed in a neat and workmanlike manner and installed parallel with or at right angles to the sides and back of any box, enclosure, or cabinet. Conductors that are terminated, spliced, or otherwise interrupted in any enclosure, cabinet, mounting, or junction box must be connected to screw-type terminal blocks. Mark each terminal in accordance with the wiring diagrams of the system. The use of wire nuts or similar devices is prohibited. Wiring to conform with NFPA 70.

Indicate the following in the wiring diagrams:

a. Point-to-point wiring diagrams showing the points of connection and terminals used for electrical field connections in the system, including interconnections between the equipment or systems that are supervised or controlled by the system. Diagrams must show connections from field devices to the FMCU and remote fire alarm/mass notification control units, initiating circuits, switches, relays and terminals.

b. Complete riser diagrams indicating the wiring sequence of devices and their connections to the control equipment. Include a color code schedule for the wiring. Include floor plans showing the locations of devices and equipment.

3.3.2 Terminal Cabinets

Provide a terminal cabinet at the base of any circuit riser, on each floor at each riser, and where indicated on the drawings. Terminal size must be appropriate for the size of the wiring to be connected. Conductor terminations must be labeled and a drawing containing conductors, their labels, their circuits, and their interconnection must be permanently mounted in the terminal cabinet. Minimum size is 8 inches by 8 inches. Only screw-type terminals are permitted. Provide an identification label, that displays "FIRE ALARM TERMINAL CABINET" with 2-inch lettering, on the front of the terminal cabinet.

3.3.3 Alarm Wiring

a. Voltages must not be mixed in any junction box, housing or device, except those containing power supplies and control relays.

b. Utilize shielded wiring where recommended by the manufacturer. For shielded wiring, ground the shield at only one point, in or adjacent to the FMCU.

c. Pigtail or T-tap connections to signal line circuits, initiating

device circuits, supervisory alarm circuits, and notification appliance circuits are prohibited.

d. Color coding is required for circuits and must be maintained throughout the circuit. Conductors used for the same functions must be similarly color coded. Conform wiring to NFPA 70.

e. Pull all conductors splice free. The use of wire nuts, crimped connectors, or twisting of conductors is prohibited. Where splices are unavoidable, the location of the junction box or pull box where they occur must be identified on the as-built drawings. The number and location of splices must be subject to approval by the Designated Fire Protection Engineer (DFPE).

3.3.4 Back Boxes and Conduit

In addition to the requirements of Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM, provide all wiring in rigid metal conduit or intermediate metal conduit unless specifically indicated otherwise. Minimum conduit size must be 3/4-inch in diameter. Do not use electrical non-metallic tubing (ENT) or flexible non-metallic tubing and associated fittings.

a. Galvanized rigid steel (GRS) conduit must be utilized where exposed to weather, where subject to physical damage, and where exposed on exterior of buildings. Intermediate metal conduit (IMC) may be used in lieu of GRS as allowed by NFPA 70.

b. Electrical metallic tubing (EMT) is permitted above suspended ceilings or exposed where not subject to physical damage. Do not use EMT underground, encased in concrete, mortar, or grout, in hazardous locations, where exposed to physical damage, outdoors or in fire pump rooms. Use die-cast compression connectors.

c. For rigid metallic conduit (RMC), only threaded type fitting are permitted for wet or damp locations.

d. Flexible metal conduit is permitted for initiating device circuits 6 feet in length or less. Flexible metal conduit is prohibited for notification appliance circuits and signaling line circuits. Use liquid tight flexible metal conduit in damp and wet locations.

e. Schedule 40 (minimum) polyvinyl chloride (PVC) is permitted where conduit is routed underground or underground below floor slabs. Convert non-metallic conduit, other than PVC Schedule 40 or 80, to plastic-coated rigid, or IMC, steel conduit before turning up through floor slab.

f. Exterior wall penetrations must be weathertight. Conduit must be sealed to prevent the infiltration of moisture.

g. For Class "A" or "X" circuits with conductor lengths of 10 feet or less, the conductors must be permitted to be installed in the same raceway in accordance with NFPA 72.

3.3.5 Conductor Terminations

Labeling of conductors at terminal blocks in terminal cabinets, FMCU, and remote FMCU and the LOC must be provided at each conductor connection. Each conductor or cable must have a shrink-wrap label to provide a unique

and specific designation. Each terminal cabinet, FMCU, and remote FMCU must contain a laminated drawing that indicates each conductor, its label, circuit, and terminal. The laminated drawing must be neat, using 12 point lettering minimum size, and mounted within each cabinet, control unit, or unit so that it does not interfere with the wiring or terminals. Maintain existing color code scheme where connecting to existing equipment.

3.4 PAINTING

a. In unfinished areas all conduit, junction/back boxes, covers, and couplings, when provided, must be factory painted red (e.g. above ceilings, mechanical rooms, concealed spaces, etc.).

b. In finished areas, paint exposed electrical conduit (serving fire alarm equipment), fire alarm conduit, surface metal raceways, junction boxes, and electrical boxes to match adjacent finishes. The inside cover of the junction box must be identified as "Fire Alarm" and the conduit must have painted red bands 3/4-inch wide at 10-foot centers and at each side of a floor, wall, or ceiling penetration.

3.5 FIELD QUALITY CONTROL

3.5.1 Test Procedures

Submit detailed test procedures, prepared and signed by the NICET Level III Fire Alarm Technician, and the representative of the installing company, and reviewed by the QFPE 30 days prior to performing system tests. Detailed test procedures must list all components of the installed system such as initiating devices and circuits, notification appliances and circuits, signaling line devices and circuits, control devices/equipment, batteries, transmitting and receiving equipment, power sources/supply, annunciators, special hazard equipment, emergency communication equipment, interface equipment, and surge protective devices. Test procedures must include sequence of testing, time estimate for each test, and sample test data forms. The test data forms must be in a check-off format (pass/fail with space to add applicable test data; similar to the forms in NFPA 72 and NFPA 4.) The test procedures and accompanying test data forms must be used for the pre-Government testing and the Government testing. The test data forms must record the test results and must:

a. Identify the NFPA Class of all Initiating Device Circuits (IDC), and Notification Appliance Circuits (NAC), Voice Notification System Circuits (NAC Audio), and Signaling Line Circuits (SLC).

b. Identify each test required by NFPA 72 Test Methods and required test herein to be performed on each component, and describe how these tests must be performed.

c. Identify each component and circuit as to type, location within the facility, and unique identity within the installed system. Provide necessary floor plan sheets showing each component location, test location, and alphanumeric identity.

d. Identify all test equipment and personnel required to perform each test (including equipment necessary for smoke detector testing. The use of magnets is not permitted.

e. Provide space to identify the date and time of each test. Provide space to identify the names and signatures of the individuals

conducting and witnessing each test.

3.5.2 Pre-Government Testing

3.5.2.1 Verification of Compliant Installation

Conduct inspections and tests to ensure that devices and circuits are functioning properly. Tests must meet the requirements of paragraph entitled "Minimum System Tests" as required by NFPA 72. The contractor and an authorized representative from each supplier of equipment must be in attendance at the pre-Government testing to make necessary adjustments. After inspection and testing is complete, provide a signed Verification of Compliant Installation letter by the QFPE that the installation is complete, compliant with the specification and fully operable. The letter must include the names and titles of the witnesses to the pre-Government tests. Provide all completion documentation as required by NFPA 72 including all referenced annex sections and the test reports noted below.

a. NFPA 72 Record of Completion.

b. NFPA 72 Record of Inspection and Testing.

c. Fire Alarm and Emergency Communication System Inspection and Testing Form.

d. Audibility test results with marked-up test floor plans.

e. Intelligibility test results with marked-up floor plans.

f. Documentation that all tests identified in the paragraph "Minimum System Tests" are complete.

3.5.2.2 Request for Government Final Test

When the verification of compliant installation has been completed, submit a formal request for Government final test to the Contracting Officer's Representative (COR). Government final testing will not be scheduled until the DFPE has received copies of the request for Government final testing and Verification of Compliant Installation letter with all required reports. Government final testing will not be performed until after the connections to the installation-wide fire reporting system and the installation-wide mass notification system have been completed and tested to confirm communications are fully functional. Submit request for test at least 15 calendar days prior to the requested test date.

3.5.3 Correction of Deficiencies

If equipment was found to be defective or non-compliant with contract requirements, perform corrective actions and repeat the tests. Tests must be conducted and repeated if necessary until the system has been demonstrated to comply with all contract requirements.

3.5.4 Government Final Tests

The tests must be performed in accordance with the approved test procedures in the presence of the DFPE. Furnish instruments and personnel required for the tests. The following must be provided at the job site for Government Final Testing:

a. The manufacturer's technical representative.

b. The contractor's Qualified Fire Protection Engineer (QFPE).

c. Marked-up red line drawings of the system as actually installed.

d. Loop resistance test results.

e. Complete program printout including input/output addresses.

f. Copy of pre-Government Test Certificate, test procedures and completed test data forms.

g. Audibility test results with marked-up floor plans.

h. Intelligibility test results with marked-up floor plans.

Government Final Tests will be witnessed by the Contracting Officer's Representative (COR) and the Qualified Fire Protection Engineer (QFPE). At this time, any and all required tests noted in the paragraph "Minimum System Tests" must be repeated at their discretion.

3.6 MINIMUM SYSTEM TESTS

3.6.1 System Tests

Test the system in accordance with the procedures outlined in NFPA 72. The required tests are as follows:

a. Loop Resistance Tests: Measure and record the resistance of each circuit with each pair of conductors in the circuit short-circuited at the farthest point from the circuit origin. The tests must be witnessed by the Contracting Officer and test results recorded for use at the final Government test.

b. Verify the absence of unwanted voltages between circuit conductors and ground. The tests must be accomplished at the pre-Government test with results available at the final system test.

c. Verify that the control unit is in the normal condition as detailed in the manufacturer's O&M manual.

d. Test each initiating device and notification appliance and circuit for proper operation and response at the control unit. Smoke detectors must be tested in accordance with manufacturer's recommended calibrated test method. Use of magnets is prohibited. Testing of duct smoke detectors must comply with the requirements of NFPA 72 except disconnect at least 20 percent of devices. If there is a failure at these devices, then supervision must be tested at each device.

e. Test the system for specified functions in accordance with the contract drawings and specifications and the manufacturer's O&M manual.

f. Test both primary power and secondary power. Verify, by test, the secondary power system is capable of operating the system for the time period and in the manner specified.

g. Determine that the system is operable under trouble conditions as

specified.

h. Visually inspect wiring.

i. Test the battery charger and batteries.

j. Verify that software control and data files have been entered or programmed into the FMCU. Hard copy records of the software must be provided to the Contracting Officer.

k. Verify that red-line drawings are accurate.

l. Measure the current in circuits to ensure there is the calculated spare capacity for the circuits.

m. Measure voltage readings for circuits to ensure that voltage drop is not excessive.

n. Disconnect the verification feature for smoke detectors during tests to minimize the amount of smoke needed to activate the sensor. Testing of smoke detectors must be conducted using real smoke or the use of canned smoke which is permitted.

o. Measure the voltage drop at the most remote appliance (based on wire length) on each notification appliance circuit.

p. Verify the documentation cabinet is installed and contains all as-built shop drawings, product data sheets, design calculations, site-specific software data package, and all documentation required by paragraph titled "Test Reports".

3.6.2 Audibility Tests

Sound pressure levels from audible notification appliances must be a minimum of 15 dBa over ambient with a maximum of 110 dBa in any occupiable area. The provisions for audible notification (audibility and intelligibility) must be met with doors, fire shutters, movable partitions, and similar devices closed.

3.6.3 Intelligibility Tests

Intelligibility testing of the System must be accomplished in accordance with NFPA 72 for Voice Evacuation Systems, and ASA S3.2. Following are the specific requirements for intelligibility tests:

a. Intelligibility Requirements: Verify intelligibility by measurement after installation.

b. Ensure that a CIS value greater than the required minimum value is provided in each area where building occupants typically could be found. The minimum required value for CIS is .8. Rounding of values is permitted.

c. Areas of the building provided with hard wall and ceiling surfaces (such as metal or concrete) that are found to cause excessive sound reflections may be permitted to have a CIS score less than the minimum required value if approved by the DFPE, and if building occupants in these areas can determine that a voice signal is being broadcast and they must walk no more than 33 feet to find a location with at least

the minimum required CIS value within the same area.

d. Areas of the building where occupants are not expected to be normally present are permitted to have a CIS score less than the minimum required value if personnel can determine that a voice signal is being broadcast and they must walk no more than 50 feet to a location with at least the minimum required CIS value within the same area.

e. Take measurements near the head level applicable for most personnel in the space under normal conditions (e.g., standing, sitting, sleeping, as appropriate).

f. The distance the occupant must walk to the location meeting the minimum required CIS value must be measured on the floor or other walking surface as follows:

(1) Along the centerline of the natural path of travel, starting from any point subject to occupancy with less than the minimum required CIS value.

(2) Curving around any corners or obstructions, with a 12 inches clearance there from.

(3) Terminating directly below the location where the minimum required CIS value has been obtained.

Use commercially available test instrumentation to measure intelligibility as specified by NFPA 72 as applicable. Use the mean value of at least three readings to compute the intelligibility score at each test location.

3.7 SYSTEM ACCEPTANCE

Following acceptance of the system, as-built drawings and O&M manuals must be delivered to the Contracting Officer for review and acceptance. The drawings must show the system as installed, including deviations from both the project drawings and the approved shop drawings. These drawings must be submitted within two weeks after the final Government test of the system. At least one set of as-built (marked-up) drawings must be provided at the time of, or prior to the Final Government Test.

a. The drawings must be prepared electronically and sized no less than the contract drawings. Furnish one set of CDs or DVDs containing software back-up and CAD based drawings in latest version of AutoCAD and portable document formats of as-built drawings and schematics.

b. Include complete wiring diagrams showing connections between devices and equipment, both factory and field wired.

c. Include a riser diagram and drawings showing the as-built location of devices and equipment.

d. Provide Operation and Maintenance (O&M) Instructions.

3.8 INSTRUCTION OF GOVERNMENT EMPLOYEES

3.8.1 Instructor

Provide the services of an instructor, who has received specific training from the manufacturer for the training of other persons regarding the

operation, inspection, testing, and maintenance of the system provided. The instructor must train the Government employees designated by the Contracting Officer, in the care, adjustment, maintenance, and operation of the fire alarm system. The instructor must be thoroughly familiar with all parts of this installation. The instructor must be trained in operating theory as well as in practical O&M work. Submit the instructors information and qualifications including the training history.

3.8.2 Required Instruction Time

Provide 8 hours of instruction after final acceptance of the system. The instruction must be given during regular working hours on such dates and times selected by the Contracting Officer. The instruction may be divided into two or more periods at the discretion of the Contracting Officer. The training must allow for rescheduling for unforeseen maintenance and/or fire department responses.

3.8.2.1 Technical Training

Equipment manufacturer or a factory representative must provide 1 days of on site. Training must allow for classroom instruction as well as individual hands on programming, troubleshooting and diagnostics exercises. Factory training must occur within 6 months of system acceptance.

3.8.3 Technical Training Manual

Provide, in manual format, lesson plans, operating instructions, maintenance procedures, and training data for the training courses. The operations training must familiarize designated government personnel with proper operation of the installed system. The maintenance training course must provide the designated government personnel adequate knowledge required to diagnose, repair, maintain, and expand functions inherent to the system.

3.9 EXTRA MATERIALS

3.9.1 Repair Service/Replacement Parts

Repair services and replacement parts for the system must be available for a period of 10 years after the date of final acceptance of this work by the Contracting Officer. During the warranty period, the service technician must be on-site within 24 hours after notification. All repairs must be completed within 24 hours of arrival on-site.

During the warranty period, the installing fire alarm contractor is responsible for conducting all required testing and maintenance in accordance with the requirements and recommended practices of NFPA 72 and the system manufacturers. Installing fire alarm contractor is NOT responsible for any damage resulting from abuse, misuse, or neglect of equipment by the end user.

3.9.2 Spare Parts

Spare parts furnished must be directly interchangeable with the corresponding components of the installed systems. Spare parts must be suitably packaged and identified by nameplate, tagging, or stamping. Spare parts must be delivered to the Contracting Officer at the time of the Government testing and must be accompanied by an inventory list.

3.9.3 Document Storage Cabinet

Upon completion of the project, but prior to project close-out, place in the document storage cabinet copies of the following record documentation:

a. As-built shop drawings

b. Product data sheets

c. Design calculations

d. Site-specific software data package

e. All documentation required by SD-06.

-- End of Section --

SECTION 31 00 00

EARTHWORK

PART 1 GENERAL

1.1 CRITERIA FOR BIDDING

Base bids on the following criteria:

a. Surface elevations are as indicated.

b. Pipes or other artificial obstructions, except those indicated, will not be encountered.

c. Ground water elevations indicated by the boring log were those existing at the time subsurface investigations were made and do not necessarily represent ground water elevation at the time of construction.

d. Material character is indicated by the boring logs.

1.2 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only. Publications used shall be the most current issue.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO T 180	(2019) Standard Method of Test for Moisture-Density Relations of Soils Using a 4.54-kg (10-lb) Rammer and a 457-mm (18-in.) Drop
AASHTO T 224	(2010) Standard Method of Test for Correction for Coarse Particles in the Soil Compaction Test

AMERICAN WATER WORKS ASSOCIATION (AWWA)

AWWA C600	(2017) Installation of Ductile-Iron Mains and Their Appurtenances

AMERICAN WELDING SOCIETY (AWS)

AWS D1.1/D1.1M	(2020; Errata 1 2021) Structural Welding Code - Steel

ASTM INTERNATIONAL (ASTM)

ASTM A139/A139M	(2022) Standard Specification for Electric-Fusion (ARC)-Welded Steel Pipe (NPS 4 and over)

ASTM A252	(2010) Standard Specification for Welded and Seamless Steel Pipe Piles
ASTM C136	(2006) Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates
ASTM C33/C33M	(2018) Standard Specification for Concrete Aggregates
ASTM D1140	(2017) Standard Test Methods for Determining the Amount of Material Finer than 75-µm (No. 200) Sieve in Soils by Washing
ASTM D1556	(2007) Density and Unit Weight of Soil in Place by the Sand-Cone Method
ASTM D1557	(2012; E 2015) Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft3) (2700 kN-m/m3)
ASTM D2167	(2015) Density and Unit Weight of Soil in Place by the Rubber Balloon Method
ASTM D2487	(2017; E 2020) Standard Practice for Classification of Soils for Engineering Purposes (Unified Soil Classification System)
ASTM D4318	(2017; E 2018) Standard Test Methods for Liquid Limit, Plastic Limit, and Plasticity Index of Soils
ASTM D4944	(2018) Standard Test Method for Field Determination of Water (Moisture) Content of Soil by the Calcium Carbide Gas Pressure Tester Method
ASTM D6938	(2017a) Standard Test Method for In-Place Density and Water Content of Soil and Soil-Aggregate by Nuclear Methods (Shallow Depth)
ASTM D7928	(2017) Standard Test Method for Particle-Size Distribution (Gradation) of Fine-Grained Soils Using the Sedimentation (Hydrometer) Analysis

1.3 DEFINITIONS

1.3.1 Satisfactory Materials

Satisfactory materials comprise any materials classified by ASTM D2487 as GW, GP, GM, GP-GM, GW-GM, GC, GP-GC, GM-GC, SW, SP, SM, SP-SM. Satisfactory materials for grading comprise stones less than 8 inches. To be considered satisfactory, any offsite soils imported for use as backfill shall be tested and certified as meeting local, state, and federal

regulation for clean fill prior to bringing to the site. Provide at least one borrow site testing from each borrow site used.

1.3.2 Unsatisfactory Materials

Materials which do not comply with the requirements for satisfactory materials are unsatisfactory. Unsatisfactory materials also include man-made fills; trash; refuse; backfills from previous construction; and material classified as satisfactory which contains root and other organic matter or frozen material. Notify the Contracting Officer when encountering any contaminated materials.

All soils from the areas of the former housing building footprints are assumed to exceed the FDEP soil cleanup target for leachability of dieldrin and possibly other termiticides as well. As such, the Contractor shall strip the top 24" from the limits depicted on Drawing Sheet C-100. These soils shall be removed from the site as promptly as possible after testing as required by the receiving landfill. The receiving landfill shall be certified to meet all local, state, and federal requirements for acceptance of such contaminated soils.

1.3.3 Cohesionless and Cohesive Materials

Cohesionless materials include materials classified in ASTM D2487 as GW, GP, SW, and SP. Cohesive materials include materials classified as GC, SC, ML, CL, MH, and CH. Materials classified as GM and SM will be identified as cohesionless only when the fines are nonplastic. Perform testing, required for classifying materials, in accordance with ASTM D4318, ASTM C136, ASTM D1140 and ASTM D7928.

1.3.4 Degree of Compaction

Degree of compaction required, except as noted in the second sentence, is expressed as a percentage of the maximum density obtained by the test procedure presented in ASTM D1557 abbreviated as a percent of laboratory maximum density. Since ASTM D1557 applies only to soils that have 30 percent or less by weight of their particles retained on the 3/4 inch sieve, express the degree of compaction for material having more than 30 percent by weight of their particles retained on the 3/4 inch sieve as a percentage of the maximum density in accordance with AASHTO T 180 and corrected with AASHTO T 224. To maintain the same percentage of coarse material, use the "remove and replace" procedure as described in NOTE 8 of Paragraph 7.2 in AASHTO T 180.

1.3.5 Topsoil

Material suitable for topsoils obtained from offsite areas is defined as: Natural, friable soil representative of productive, well-drained soils in the area, free of subsoil, stumps, rocks larger than one inch diameter, brush, weeds, toxic substances, and other material detrimental to plant growth. Amend topsoil pH range to obtain a pH of 5.5 to 7.

1.3.6 Hard/Unyielding Materials

Hard/Unyielding materials comprise weathered rock, dense consolidated deposits, or conglomerate materials which are not included in the definition of "rock" with stones greater than 3 inch in any dimension or as defined by the pipe manufacturer, whichever is smaller. These materials usually require the use of heavy excavation equipment, ripper

teeth, or jack hammers for removal.

1.3.7 Unstable Material

Unstable materials are too wet to properly support the utility pipe, conduit, or appurtenant structure.

1.3.8 Select Granular Material

1.3.8.1 General Requirements

Select granular material consist of materials classified as GW, GP, SW, or SP, by ASTM D2487 where indicated. The liquid limit of such material must not exceed 15 percent when tested in accordance with ASTM D4318. The plasticity index must not be greater than 12 percent when tested in accordance with ASTM D4318, and not more than 30 percent by weight may be finer than No. 200 sieve, and not more than 65 percent by weight finer than a No. 40 sieve when tested in accordance with ASTM C136.

1.3.9 Initial Backfill Material

Initial backfill consists of select granular material or satisfactory materials free from rocks 3 inches or larger in any dimension or free from rocks of such size as recommended by the pipe manufacturer, whichever is smaller. When the pipe is coated or wrapped for corrosion protection, free the initial backfill material of stones larger than 1 inch in any dimension or as recommended by the pipe manufacturer, whichever is smaller.

1.4 SYSTEM DESCRIPTION

Subsurface soil boring logs are in the geotechnical report provided as an Appendix to these Specifications. These data represent the best subsurface information available; however, variations may exist in the subsurface between boring locations.

1.4.1 Classification of Excavation

No consideration will be given to the nature of the materials, and all excavation will be designated as unclassified excavation.

1.4.2 Blasting

Blasting will not be permitted.

1.4.3 Dewatering Work Plan

Submit procedures for accomplishing dewatering work.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Dewatering Work Plan
Contaminated Soil Management Plan

SD-03 Product Data

Utilization/Management of Excavated Soils

SD-06 Test Reports

Testing

Borrow Site Testing Within 24 hours of conclusion of physical tests, submit digital copies of test results, including calibration curves and results of calibration tests, and certification that imported material is free of contamination and meets all local, state, and federal regulations for clean fill.

SD-07 Certificates

Testing

Qualifications of the commercial testing laboratory or the contractor's validated testing facilities.

Landfill Certification Demonstrating Capacity to Legally Accept Contaminated Soil

PART 2 PRODUCTS

2.1 BURIED WARNING AND IDENTIFICATION TAPE

Provide metallic core or metallic-faced, acid- and alkali-resistant, polyethylene plastic warning tape manufactured specifically for warning and identification of buried utility lines. Provide tape on rolls, 3 inches minimum width, color coded as specified below for the intended utility with warning and identification imprinted in bold black letters continuously over the entire tape length. Warning and identification to read, "CAUTION, BURIED (intended service) LINE BELOW" or similar wording. Provide permanent color and printing, unaffected by moisture or soil.

Warning Tape Color Codes	
Red	Electric
Yellow	Gas
Orange	Telephone and Other Communications
Blue	Water Systems
Green	Sewer Systems

2.1.1 Warning Tape for Metallic Piping

Provide acid and alkali-resistant polyethylene plastic tape conforming to the width, color, and printing requirements specified above, with a minimum thickness of 0.003 inch and a minimum strength of 1500 psi lengthwise, and 1250 psi crosswise, with a maximum 350 percent elongation.

2.1.2 Detectable Warning Tape for Non-Metallic Piping

Provide polyethylene plastic tape conforming to the width, color, and printing requirements specified above, with a minimum thickness of 0.004 inch, and a minimum strength of 1500 psi lengthwise and 1250 psi crosswise. Manufacture tape with integral wires, foil backing, or other means of enabling detection by a metal detector when tape is buried up to 3 feet deep. Encase metallic element of the tape in a protective jacket or provide with other means of corrosion protection.

2.2 MATERIAL FOR RIP-RAP

Provide filter fabric and rock conforming to these requirements for construction indicated.

2.2.1 Rock

Provide rock fragments sufficiently durable to ensure permanence in the structure and the environment in which it is to be used. Use rock fragments free from cracks, seams, and other defects that would increase the risk of deterioration from natural causes. Provide fragments sized so that no individual fragment exceeds a weight of 150 pounds and that no more than 10 percent of the mixture, by weight, consists of fragments weighing 2 pounds or less each. Provide rock with a minimum specific gravity of 2.50.

2.3 CAPILLARY WATER BARRIER

Provide capillary water barrier of clean, poorly graded crushed rock, crushed gravel, or uncrushed gravel placed beneath a building slab with or without a vapor barrier to cut off the capillary flow of pore water to the area immediately below. Conform to ASTM C33/C33M for fine aggregate grading with a maximum of 3 percent by weight passing ASTM D1140, No. 200 sieve.

2.4 PIPE CASING

2.4.1 Casing Pipe

ASTM A139/A139M, Grade B, or ASTM A252, Grade 2, smooth wall pipe. Match casing size to the outside diameter and wall thickness as indicated. Protective coating is not required on casing pipe.

PART 3 EXECUTION

3.1 STRIPPING OF TOPSOIL

All soil from the areas of the former housing building footprints are assumed to exceed the FDEP soil cleanup target for leachability of dieldrin and possibly other termiticides as well. (See "Limited Soil Sampling Report" provided as an Appendix to these specifications.) As such, the Contractor shall strip the top 24" from the limits depicted on

Drawing Sheet C-100. These soils shall be removed from the site as promptly as possible, but no less than 30 days after excavation. They shall be tested as required by the receiving landfill prior to transport. They shall be transported to a sanitary landfill certified to meet all local, state, and federal requirements for acceptance of such contaminated soils. Prior to initiation of construction, submit a Contaminated Soil Management Plan prepared by an Environmental Scientist, Professional Geologist, or Environmental Engineer, with demonstrated competence in evaluation, testing, and management of such soils. The plan must be consistent with the "Guidelines for Preparation of Soil Management Plans, FDEP, May 2022." These guidelines are included as an Appendix to these technical specifications. Also submit a Landfill Certification Demonstrating Capacity to Legally Accept Contaminated Soil for the proposed receiving landfill.

3.2 GENERAL EXCAVATION

Perform excavation of every type of material encountered within the limits of the project to the lines, grades, and elevations indicated and as specified. Perform the grading in accordance with the typical sections shown and the tolerances specified in paragraph FINISHING. Transport satisfactory excavated materials and place in fill or embankment within the limits of the work. Excavate unsatisfactory materials encountered within the limits of the work below grade and replace with satisfactory materials as directed. Include such excavated material and the satisfactory material ordered as replacement in excavation. Dispose surplus satisfactory excavated material not required for fill or embankment in areas approved for surplus material storage or designated waste areas. Dispose unsatisfactory excavated material in designated waste or spoil areas. During construction, perform excavation and fill in a manner and sequence that will provide proper drainage at all times. Excavate material required for fill or embankment in excess of that produced by excavation within the grading limits from the borrow areas indicated or from other approved areas selected by the Contractor as specified.

3.2.1 Ditches, Gutters, and Channel Changes

Finish excavation of ditches, gutters, and channel changes by cutting accurately to the cross sections, grades, and elevations shown. Do not excavate ditches and gutters below grades shown. Backfill the excessive open ditch or gutter excavation with satisfactory, thoroughly compacted, material or with suitable stone or cobble to grades shown. Dispose excavated material as shown or as directed, except in no case allow material be deposited a maximum 4 feet from edge of a ditch. Maintain excavations free from detrimental quantities of leaves, brush, sticks, trash, and other debris until final acceptance of the work.

3.2.2 Drainage Structures

Make excavations to the lines, grades, and elevations shown, or as directed. Provide trenches and foundation pits of sufficient size to permit the placement and removal of forms for the full length and width of structure footings and foundations as shown. Clean rock or other hard foundation material of loose debris and cut to a firm, level, stepped, or serrated surface. Remove loose disintegrated rock and thin strata. Do not disturb the bottom of the excavation when concrete or masonry is to be placed in an excavated area. Do not excavate to the final grade level until just before the concrete or masonry is to be placed.

3.2.3 Drainage

Provide for the collection and disposal of surface and subsurface water encountered during construction. Completely drain construction site during periods of construction to keep soil materials sufficiently dry. Construct storm drainage features at the earliest stages of site development, and throughout construction grade the construction area to provide positive surface water runoff away from the construction activity and or provide temporary ditches, swales, and other drainage features and equipment as required to maintain dry soils. When unsuitable working platforms for equipment operation and unsuitable soil support for subsequent construction features develop, remove unsuitable material and provide new soil material as specified herein. It is the responsibility of the Contractor to assess the soil and ground water conditions presented by the plans and specifications and to employ necessary measures to permit construction to proceed.

3.2.4 Dewatering

Control groundwater flowing toward or into excavations to prevent sloughing of excavation slopes and walls, boils, uplift and heave in the excavation and to eliminate interference with orderly progress of construction. Do not permit French drains, sumps, ditches or trenches within 3 feet of the foundation of any structure, except with specific written approval, and after specific contractual provisions for restoration of the foundation area have been made. Take control measures by the time the excavation reaches the water level in order to maintain the integrity of the in situ material. While the excavation is open, maintain the water level continuously, at least 2 foot below the working level. Operate dewatering system continuously until construction work below existing water levels is complete.

3.2.5 Trench Excavation Requirements

Excavate the trench as recommended by the manufacturer of the pipe to be installed. Slope trench walls below the top of the pipe, or make vertical, and of such width as recommended in the manufacturer's printed installation manual. Provide vertical trench walls where no manufacturer's printed installation manual is available. Shore trench walls more than 5 feet high, cut back to a stable slope, or provide with equivalent means of protection for employees who may be exposed to moving ground or cave in. Shore vertical trench walls more than 4 feet high. Excavate trench walls which are cut back to at least the angle of repose of the soil. Give special attention to slopes which may be adversely affected by weather or moisture content. Do not exceed the trench width below the pipe top of 24 inches plus pipe outside diameter (O.D.) for pipes of less than 24 inches inside diameter, and do not exceed 36 inches plus pipe outside diameter for sizes larger than 24 inches inside diameter. Where recommended trench widths are exceeded, provide redesign, stronger pipe, or special installation procedures by the Contractor. The Contractor is responsible for the cost of redesign, stronger pipe, or special installation procedures without any additional cost to the Government.

3.2.5.1 Bottom Preparation

Grade the bottoms of trenches accurately to provide uniform bearing and support for the bottom quadrant of each section of the pipe. Excavate

bell holes to the necessary size at each joint or coupling to eliminate point bearing. Remove stones of 3 inch or greater in any dimension, or as recommended by the pipe manufacturer, whichever is smaller, to avoid point bearing.

3.2.5.2 Removal of Unyielding Material

Where unyielding material is encountered in the bottom of the trench, remove such material 12 inch below the required grade and replaced with suitable materials as provided in paragraph BACKFILLING AND COMPACTION.

3.2.5.3 Removal of Unstable Material

Where unstable material is encountered in the bottom of the trench, remove such material to the depth directed and replace it to the proper grade with select granular material as provided in paragraph BACKFILLING AND COMPACTION. When removal of unstable material is required due to the Contractor's fault or neglect in performing the work, the Contractor is responsible for excavating the resulting material and replacing it without additional cost to the Government.

3.2.5.4 Excavation for Appurtenances

Provide excavation for manholes, catch-basins, inlets, or similar structures sufficient to leave at least 12 inches clear between the outer structure surfaces and the face of the excavation or support members. Specify removal of unstable material. When concrete or masonry is to be placed in an excavated area, take special care not to disturb the bottom of the excavation. Do not excavate to the final grade level until just before the concrete or masonry is to be placed.

3.2.5.5 Jacking, Boring, and Tunneling

Unless otherwise indicated, provide excavation by open cut except that sections of a trench may be jacked, bored, or tunneled if, in the opinion of the Contracting Officer, the pipe, cable, or duct can be safely and properly installed and backfill can be properly compacted in such sections.

3.2.6 Underground Utilities

The Contractor is responsible for movement of construction machinery and equipment over pipes and utilities during construction. Perform work adjacent to utilities as indicated in accordance with procedures outlined by utility provider. For work immediately adjacent to or for excavations exposing a utility or other buried obstruction, excavate by hand. Start hand excavation on each side of the indicated obstruction and continue until the obstruction is uncovered or until clearance for the new grade is assured. Support uncovered lines or other existing work affected by the contract excavation until approval for backfill is granted by the Contracting Officer. Report damage to utility lines or subsurface construction immediately to the Contracting Officer.

3.2.7 Structural Excavation

Ensure that footing subgrades have been inspected and approved by the Contracting Officer prior to concrete placement.

3.3 SELECTION OF BORROW MATERIAL

Select borrow material to meet the requirements and conditions of the particular fill or embankment for which it is to be used. Obtain borrow material from approved private sources. Unless otherwise provided in the contract, the Contractor is responsible for obtaining the right to procure material, pay royalties and other charges involved, and bear the expense of developing the sources, including rights-of-way for hauling from the owners.Unless specifically provided, do not obtain borrow within the limits of the project site without prior written approval. Consider necessary clearing, grubbing, and satisfactory drainage of borrow pits and the disposal of debris thereon related operations to the borrow excavation.

3.4 SHORING

3.4.1 General Requirements

Finish shoring, including sheet piling, and install as necessary to protect workmen, banks, adjacent paving, structures, and utilities. Remove shoring, bracing, and sheeting as excavations are backfilled, in a manner to prevent caving.

3.5 FINAL GRADE OF SURFACES TO SUPPORT CONCRETE

Do not excavate to final grade until just before concrete is to be placed. Roughen the level surfaces, and cut the sloped surfaces, as indicated, into rough steps or benches to provide a satisfactory bond. Protect all surfaces from erosion resulting from ponding or water flow.

3.6 GROUND SURFACE PREPARATION

3.6.1 General Requirements

Remove and replace unsatisfactory material with satisfactory materials, as directed by the Contracting Officer, in surfaces to receive fill or in excavated areas. Scarify the surface to a depth of 6 inches before the fill is started. Plow, step, bench, or break up sloped surfaces steeper than 1 vertical to 4 horizontal so that the fill material will bond with the existing material. When subgrades are less than the specified density, break up the ground surface to a minimum depth of 6 inches, pulverizing, and compacting to the specified density. When the subgrade is part fill and part excavation or natural ground, scarify the excavated or natural ground portion to a depth of 12 inches and compact it as specified for the adjacent fill.

3.6.2 Frozen Material

Do not place material on surfaces that are muddy, frozen, or contain frost. Finish compaction by sheepsfoot rollers, pneumatic-tired rollers, steel-wheeled rollers, or other approved equipment well suited to the soil being compacted. Moisten material as necessary to provide the moisture content that will readily facilitate obtaining the specified compaction with the equipment used.

3.7 UTILIZATION/MANAGEMENT OF EXCAVATED SOILS

3.7.1 Contaminated Soil Management

All soil from the areas of the former housing building footprints is

assumed to exceed the FDEP soil cleanup target level for leachability to groundwater of Dieldrin. (See "Limited Soil Sampling Report" provided as an Appendix to these specifications.) As such, excavate and dispose the top 24" of soil as required in paragraph STRIPPING OF TOPSOIL. All soils excavated for utility installation, etc, shall remain onsite and be reused at the point of excavation unless they are unsuitable, as it relates to the physical properties, for reuse on the site or they are excess.

Unsuitable soils and soils that cannot be used at the point of excavation shall be stockpiled on sturdy, impermeable, puncture-resistant tarp for a period not to exceed 30 days, or containerized, properly sampled, tested, and disposed of as described as required in paragraph STRIPPING OF TOPSOIL. Any remaining excess soil, inclusive of soil excavated from the stormwater retention pond, shall be temporarily stockpiled onsite.

3.7.2 Soil Stockpiling

Stockpiled soil shall be placed on impermeable, puncture resistant tarps capable of bearing tracked vehicle excavators without puncture. Tarp shall be vinyl with minimum thickness of 50 mil. The stockpiled soil shall be covered with a second tarp to prevent erosion of the stockpile and to isolate the stored material from the environment. Once characterization is complete, contaminated soils shall be transported to a landfill certified to legally accept contaminated soils. Non-contaminated soils may be re-used on site.

3.7.3 Soil Sampling, Analysis, and Disposal

Sample the stockpiled soil in sufficient quantity to characterize it for disposal. Analytical methods shall be as required by the disposal facilities. All soil shall be disposed of per Specification Section 01 57 19.

3.8 BURIED TAPE AND DETECTION WIRE

3.8.1 Buried Warning and Identification Tape

Provide buried utility lines with utility identification tape. Bury tape 12 inches below finished grade; under pavements and slabs, bury tape 6 inches below top of subgrade.

3.8.2 Buried Detection Wire

Bury detection wire directly above non-metallic piping at a distance not to exceed 12 inches above the top of pipe. Extend the wire continuously and unbroken, from manhole to manhole. Terminate the ends of the wire inside the manholes at each end of the pipe, with a minimum of 3 feet of wire, coiled, remaining accessible in each manhole. Furnish insulated wire over it's entire length. Install wires at manholes between the top of the corbel and the frame, and extend up through the chimney seal between the frame and the chimney seal. For force mains, terminate the wire in the valve pit at the pump station end of the pipe.

3.9 BACKFILLING AND COMPACTION

Place backfill adjacent to any and all types of structures, and compact to at least 95 percent laboratory maximum density for cohesionless materials, to prevent wedging action or eccentric loading upon or against the structure. Prepare ground surface on which backfill is to be placed and

provide compaction requirements for backfill materials in conformance with the applicable portions of paragraphs GROUND SURFACE PREPARATION. Finish compaction by pneumatic-tired rollers, steel-wheeled rollers, vibratory compactors, or other approved equipment.

3.9.1 Trench Backfill

Backfill trenches to the grade shown.

3.9.1.1 Replacement of Unyielding Material

Replace unyielding material removed from the bottom of the trench with select granular material or initial backfill material.

3.9.1.2 Replacement of Unstable Material

Replace unstable material removed from the bottom of the trench or excavation with select granular material placed in layers not exceeding 6 inches loose thickness.

3.9.1.3 Bedding and Initial Backfill

Place initial backfill material,(in compacted lifts of 8" or less for mechanical compaction and 4" or less for manual compaction), and compact it with approved tampers to a height of at least one foot above the utility pipe or conduit. Bring up the backfill evenly on both sides of the pipe for the full length of the pipe. Take care to ensure thorough compaction of the fill under the haunches of the pipe. Except as specified otherwise in the individual piping section, provide bedding for buried piping in accordance with AWWA C600, Type 4, except as specified herein. Compact backfill to top of pipe to 95 percent of ASTM D1557 maximum density. Provide plastic piping with bedding to spring line of pipe. Provide materials as follows:

3.9.1.3.1 Class I

Angular, 0.25 to 1.5 inch, graded stone, including a number of fill materials that have regional significance such as coral, slag, cinders, crushed stone, and crushed shells.

3.9.1.3.2 Class II

Coarse sands and gravels with maximum particle size of 1.5 inch, including various graded sands and gravels containing small percentages of fines, generally granular and noncohesive, either wet or dry. Soil Types GW, GP, SW, and SP are included in this class as specified in ASTM D2487.

3.9.1.4 Final Backfill

Fill the remainder of the trench, except for special materials for roadways, railroads and airfields, with satisfactory material. Place backfill material and compact as follows:

3.9.1.4.1 Roadways

Place backfill up to the required elevation as specified. Do not permit water flooding or jetting methods of compaction.

3.9.1.4.2 Sidewalks, Turfed or Seeded Areas and Miscellaneous Areas

Deposit backfill in layers of a maximum of 12 inches loose thickness, and compact it to 90 percent maximum density for cohesionless soils.

3.9.2 Backfill for Appurtenances

After the manhole, catchbasin, inlet, or similar structure has been constructed and the concrete has been allowed to cure for 7 days, place backfill in such a manner that the structure is not be damaged by the shock of falling earth. Deposit the backfill material, compact it as specified for final backfill, and bring up the backfill evenly on all sides of the structure to prevent eccentric loading and excessive stress.

3.10 SPECIAL REQUIREMENTS

Special requirements for both excavation and backfill relating to the specific utilities are as follows:

3.10.1 Gas Distribution

Excavate trenches to a depth that will provide a minimum 24 inch of cover in other excavation.

3.10.2 Water Lines

Excavate trenches to a depth that provides a minimum cover of 3 feet from the existing ground surface, or from the indicated finished grade, whichever is lower, to the top of the pipe.

3.10.3 Electrical Distribution System

Provide a minimum cover of 24 inches from the finished grade to direct burial cable and conduit or duct line, unless otherwise indicated.

3.10.4 Pipeline Casing

Provide new smooth wall steel pipeline casing under new existing pavement by the boring and jacking method of installation. Provide each new pipeline casing, where indicated and to the lengths and dimensions shown, complete and suitable for use with the new piped utility as indicated. Install pipeline casing by dry boring and jacking method as follows:

3.10.4.1 Bore Holes

Mechanically bore holes and case through the soil with a cutting head on a continuous auger mounted inside the casing pipe. Weld lengths of pipe together in accordance with AWS D1.1/D1.1M. Do not use water or other fluids in connection with the boring operation.

3.10.4.2 Cleaning

Clean inside of the pipeline casing of dirt, weld splatters, and other foreign matter which would interfere with insertion of the piped utilities by attaching a pipe cleaning plug to the boring rig and passing it through the pipe.

3.10.4.3 End Seals

After installation of piped utilities in pipeline casing, provide watertight end seals at each end of pipeline casing between pipeline casing and piping utilities.

3.10.5 Rip-Rap Construction

Construct rip-rap on filter fabric in the areas indicated. Trim and dress indicated areas to conform to cross sections, lines and grades shown within a tolerance of 0.1 foot.

3.10.5.1 Bedding Placement

Spread filter fabric on prepared subgrade as indicated.

3.10.5.2 Stone Placement

Place rock for rip-rap on filter fabric to produce a well graded mass with the minimum practicable percentage of voids in conformance with lines and grades indicated. Distribute larger rock fragments, with dimensions extending the full depth of the rip-rap throughout the entire mass and eliminate "pockets" of small rock fragments. Rearrange individual pieces by mechanical equipment or by hand as necessary to obtain the distribution of fragment sizes specified above.

3.11 EMBANKMENTS

3.11.1 Earth Embankments

Construct earth embankments from satisfactory materials free of organic or frozen material and rocks with any dimension greater than 3 inches. Place the material in successive horizontal layers of loose material not more than 8 inches in depth. Spread each layer uniformly on a soil surface that has been moistened or aerated as necessary, and scarified or otherwise broken up so that the fill will bond with the surface on which it is placed. After spreading, plow, disk, or otherwise brake up each layer; moisten or aerate as necessary; thoroughly mix; and compact to at least 95 percent laboratory maximum density for cohesionless materials. Compaction requirements for the upper portion of earth embankments forming subgrade for pavements are identical with those requirements specified in paragraph SUBGRADE PREPARATION. Finish compaction by pneumatic-tired rollers, steel-wheeled rollers, vibratory compactors, or other approved equipment.

3.12 SUBGRADE PREPARATION

3.12.1 Proof Rolling

Finish proof rolling on an exposed subgrade free of surface water (wet conditions resulting from rainfall) which would promote degradation of an otherwise acceptable subgrade. After stripping, proof roll the existing subgrade of the roadway and parking lots with six passes of a 15 ton (min) vibratory roller. Operate the roller in a systematic manner to ensure the number of passes over all areas, and at speeds between 2-1/2 to 3-1/2 mph.
Notify the Contracting Officer a minimum of 3 days prior to proof rolling. Undercut rutting or pumping of material as directed by the Contracting Officer and replace with fill and backfill material.

3.12.2 Construction

Shape subgrade to line, grade, and cross section, and compact as specified. Include plowing, disking, and any moistening or aerating required to obtain specified compaction for this operation. Remove soft or otherwise unsatisfactory material and replace with satisfactory excavated material or other approved material as directed. Bring up low areas resulting from removal of unsatisfactory material to required grade with satisfactory materials, and shape the entire subgrade to line, grade, and cross section and compact as specified. After rolling, the surface of the subgrade for roadways shall not show deviations greater than 1/2 inch when tested with a 12-foot straightedge applied both parallel and at right angles to the centerline of the area. Do not vary the elevation of the finish subgrade more than 0.05 foot from the established grade and cross section.

3.12.3 Compaction

Finish compaction by pneumatic-tired rollers, steel-wheeled rollers, vibratory compactors, or other approved equipment. Except for paved areas compact each layer of the embankment to at least 90 percent of laboratory maximum density.

3.12.3.1 Subgrade for Pavements and Building Pads

Compact subgrade for pavements and building pads to at least 98 percentage laboratory maximum density for the depth below the surface of the pavement shown. When more than one soil classification is present in the subgrade, thoroughly blend, reshape, and compact the top 12 inch of subgrade.

3.13 FINISHING

Finish the surface of excavations, embankments, and subgrades to a smooth and compact surface in accordance with the lines, grades, and cross sections or elevations shown. Provide the degree of finish for graded areas within 0.1 foot of the grades and elevations indicated except that the degree of finish for subgrades specified in paragraph SUBGRADE PREPARATION. Finish gutters and ditches in a manner that will result in effective drainage. Finish the surface of areas to be turfed from settlement or washing to a smoothness suitable for the application of turfing materials. Repair graded, topsoiled, or backfilled areas prior to acceptance of the work, and re-established grades to the required elevations and slopes.

3.13.1 Subgrade and Embankments

During construction, keep embankments and excavations shaped and drained. Maintain ditches and drains along subgrade to drain effectively at all times. Do not disturb the finished subgrade by traffic or other operation. Protect and maintain the finished subgrade in a satisfactory condition until ballast, subbase, base, or pavement is placed. Do not permit the storage or stockpiling of materials on the finished subgrade. Do not lay subbase, base course, ballast, or pavement until the subgrade has been checked and approved, and in no case place subbase, base, surfacing, pavement, or ballast on a muddy, spongy, or frozen subgrade.

3.13.2 Grading Around Structures

Construct areas within 5 feet outside of each building and structure line

true-to-grade, shape to drain, and maintain free of trash and debris until final inspection has been completed and the work has been accepted.

3.14 PLACING TOPSOIL

On areas to receive topsoil, prepare the compacted subgrade soil to a 2 inches depth for bonding of topsoil with subsoil. Spread topsoil evenly to a thickness of 3 inch and grade to the elevations and slopes shown. Do not spread topsoil when frozen or excessively wet or dry. Obtain material required for topsoil in excess of that produced by excavation within the grading limits from offsite areas.

3.15 TESTING

Perform testing by an independent commercial testing laboratory or the Contractor's validated testing facility. Submit qualifications of the proposed commercial testing laboratory or the Contractor's validated testing facilities. If the Contractor elects to establish testing facilities, do not permit work requiring testing until the Contractor's facilities have been inspected, and approved by the Contracting Officer.

a. Determine field in-place density in accordance with ASTM D1556 ASTM D2167 or ASTM D6938. When ASTM D6938 is used, check the calibration curves and adjust using only the sand cone method as described in ASTM D1556. ASTM D6938 results in a wet unit weight of soil in determining the moisture content of the soil when using this method.

b. Check the calibration curves furnished with the moisture gauges along with density calibration checks as described in ASTM D6938; check the calibration of both the density and moisture gauges at the beginning of a job on each different type of material encountered and at intervals as directed by the Contracting Officer. When test results indicate, as determined by the Contracting Officer, that compaction is not as specified, remove the material, replace and recompact to meet specification requirements.

c. Perform tests on recompacted areas to determine conformance with specification requirements. The following number of tests, if performed at the appropriate time, will be the minimum acceptable for each type operation.

3.15.1 Fill and Backfill Material Gradation

One test per 1000 cubic yards stockpiled or in-place source material. Test each visually different material separately. Determine gradation of fill and backfill material in accordance with ASTM C136 or ASTM D1140.

3.15.2 In-Place Densities

a. One test per 2500 square feet, or fraction thereof, of each lift of fill or backfill areas compacted by other than hand-operated machines.

b. One test per 1000 square feet, or fraction thereof, of each lift of fill or backfill areas compacted by hand-operated machines.

c. Refer to Geotechnical Report for testing requirement within the limits of the building.

3.15.3 Check Tests on In-Place Densities

If ASTM D6938 is used, check in-place densities by ASTM D1556 as follows:

a. One check test per lift for each 5000 square feet, or fraction thereof, of each lift of fill or backfill compacted by other than hand-operated machines.

b. One check test per lift for each 2000 square feet, of fill or backfill areas compacted by hand-operated machines.

3.15.4 Moisture Contents

In the stockpile, excavation, or borrow areas, perform a minimum of two tests per day per type of material or source of material being placed during stable weather conditions. During unstable weather, perform tests as dictated by local conditions and approved by the Contracting Officer. Determine soil moisture per ASTM D4944.

3.15.5 Optimum Moisture and Laboratory Maximum Density

Perform tests for each type material or source of material including borrow material to determine the optimum moisture and laboratory maximum density values per ASTM D1557. One representative test per 1000 cubic yards of fill and backfill, or when any change in material occurs which may affect the optimum moisture content or laboratory maximum density.

3.15.6 Tolerance Tests for Subgrades

Perform continuous checks on the degree of finish specified in paragraph SUBGRADE PREPARATION during construction of the subgrades.

3.15.7 Displacement of Sewers

After other required tests have been performed and the trench backfill compacted to 1, foot above the top of the pipe, inspect the pipe to determine whether significant displacement has occurred. Conduct this inspection in the presence of the Contracting Officer. Inspect pipe by shining a light or laser between manholes or manhole locations, or by the use of television cameras passed through the pipe. If, in the judgment of the Contracting Officer, the interior of the pipe shows poor alignment or any other defects that would cause improper functioning of the system, replace or repair the defects as directed at no additional cost to the Government.

3.16 DISPOSITION OF SURPLUS MATERIAL

Dispose surplus soil materials off government property in a legal manner.

-- End of Section --

SECTION 31 11 00

CLEARING AND GRUBBING
11/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

U.S. DEPARTMENT OF DEFENSE (DOD)

DODI 4150.07 (2019) DOD Pest Management Program

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Herbicide Application Plan

SD-03 Product Data

Herbicide

SD-11 Closeout Submittals

Pest Management Report

1.3 QUALITY CONTROL

1.3.1 Regulatory Requirements

Comply with DODI 4150.07 for requirements on Contractor's licensing, certification, and record keeping. Maintain daily records using the Pest Management Maintenance Record, DD Form 1532-1, or a computer generated equivalent. These forms may be obtained from the main web site: http://www.dtic.mil/whs/directives/forms/eforms/dd1532-1.pdf

1.3.2 Qualifications

For the application of herbicides, use the services of an applicator who is commercially certified in the state where the work is to be performed as required by DODI 4150.07.

1.4 DELIVERY, STORAGE, AND HANDLING

Deliver materials to the site, and handle in a manner which will maintain

the materials in their original manufactured or fabricated condition until ready for use.

1.4.1 Storage

Storage of herbicides on the installation will not be permitted unless it is written into the contract.

1.4.2 Handling

Handle herbicides in accordance with the manufacturer's label and Safety Data Sheet (SDS), preventing contamination by dirt, water, and organic material. Protect herbicides from weather elements as recommended by the manufacturer's label and SDS. Spill kits must be maintained on herbicide control vehicles. Mixing of herbicides on the installation will not be permited unless it is written into the contract.

PART 2 PRODUCTS

2.1 MATERIALS

2.1.1 Tree Wound Paint

Use bituminous based paint from standard manufacture specially formulated for tree wounds.

2.1.2 Herbicide

If used, provide herbicides currently registered by the EPA or approved for such use by the appropriate agency of the host county and approved by the Contracting Officer. Select a herbicide that is suitable for the climatic conditions at the project site. Submit manufacturer's label and SDS for herbicides proposed for use.

PART 3 EXECUTION

3.1 PREPARATION

3.1.1 Herbicide Application Plan

Prior to commencing application of herbicide, submit a herbicide application plan with proposed sequence of treatment work including dates and times of application. Include the herbicide trade name, EPA registration number, chemical composition, formulation, application rate of active ingredients, method of application, area or volume treated, and amount applied. Include a copy of the pesticide applicator certificates.

3.1.2 Protection

3.1.2.1 Roads and Walks

Keep roads and walks free of dirt and debris at all times.

3.1.2.2 Trees, Shrubs, and Existing Facilities

Provide protection in accordance with Section 01 57 19 TEMPORARY ENVIRONMENTAL CONTROLS. Protect trees and vegetation to be left standing from damage incident to clearing, grubbing, and construction operations by the erection of barriers or by such other means as the circumstances

require.

3.1.2.3 Utility Lines

Protect existing utility lines that are indicated to remain from damage. Notify the Contracting Officer immediately of damage to or an encounter with an unknown existing utility line. The Contractor is responsible for the repair of damage to existing utility lines that are indicated or made known to the Contractor prior to start of clearing and grubbing operations. When utility lines which are to be removed are encountered within the area of operations, notify the Contracting Officer in ample time to minimize interruption of the service. Refer to Section 01 30 00 ADMINISTRATIVE REQUIREMENTS and Section 01 57 19 TEMPORARY ENVIRONMENTAL CONTROLS for additional utility protection.

3.2 Application

3.2.1 Herbicide Application

Adhere to safety precautions as recommended by the manufacturer concerning handling and application of the herbicide.

3.2.1.1 Clean Up, Disposal, And Protection

Once application has been completed, proceed with clean up and protection of the site without delay. Clean the site of all material associated with the treatment measures, according to label instructions, and as indicated. Remove and dispose of excess and waste material off Government property.

3.2.1.1.1 Disposal of Herbicide

Dispose of residual herbicides and containers off Government property, and in accordance with the approved disposal plan, label instructions and EPA requirements.

3.3 CLEARING

Clearing consists of the felling, trimming, and cutting of trees into sections and the satisfactory disposal of the trees and other vegetation designated for removal, including downed timber, snags, brush, and rubbish occurring within the areas to be cleared. Cut off flush with or below the original ground surface trees, stumps, roots, brush, and other vegetation in areas to be cleared, except such trees and vegetation as may be indicated or directed to be left standing. Trim dead branches 1-1/2 inches or more in diameter on trees designated to be left standing within the cleared areas and trim all branches to the heights indicated or directed. Neatly cut close to the bole of the tree or main branches, limbs and branches to be trimmed. Paint, with an approved tree-wound paint, cuts more than 1-1/2 inches in diameter. Apply herbicide in accordance with the manufacturer's label to the top surface of stumps designated not to be removed.

3.3.1 Tree Removal

Where indicated or directed, trees and stumps that are designated as trees shall be removed from areas outside those areas designated for clearing and grubbing. This work includes the felling of such trees and the removal of their stumps and roots as specified in paragraph GRUBBING.

Dispose of trees as specified in paragraph DISPOSAL OF MATERIALS.

3.3.2 PruningPrune trees designated to be left standing within the cleared areas of dead branches 1-1/2 inches or more in diameter. Neatly cut limbs and branches to be trimmed close to the bole of the tree or main branches. Paint cuts more than 1-1/4 inches in diameter with an approved tree wound paint.

3.3.3 Grubbing

Grubbing consists of the removal and disposal of stumps, roots larger than 3 inches in diameter, and matted roots from the designated grubbing areas. Remove material to be grubbed, together with logs and other organic or metallic debris not suitable for foundation purposes, to a depth of not less than 18 inches below the original surface level of the ground in areas indicated to be grubbed and in areas indicated as construction areas under this contract, such as areas for buildings, and areas to be paved. Fill depressions made by grubbing with suitable material and compact to make the surface conform with the original adjacent surface of the ground.

3.4 DISPOSAL OF MATERIALS

Dispose of excess materials in accordance with the approved solid waste management permit and include those materials in the solid waste management report.

All wood or wood like materials, except for salable timber, remaining from clearing, prunning or grubbing such as limbs, tree tops, roots, stumps, logs, rotten wood, and other similiar materials shall become the property of the Contractor and disposed of as specified. All timber and wood or wood like materials remaining from timber harvesting such as limbs, tree tops, roots, stumps, logs, rotten wood, and other similiar materials shall become the property of the Contractor and disposed as specified.

3.5 CLOSEOUT ACTIVITIES

3.5.1 Herbicides

Upon completion of this work, submit the Pest Management Report DD Form 1532, or an equivalent computer product, to the Integrated Pest Management Coordinator. This form identifies the type of operation, brand name and manufacturer of herbicide, formulation, concentration or rate of application used.

-- End of Section --

SECTION 32 11 23

AGGREGATE BASE COURSES
08/17

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO T 90	(2016) Standard Method of Test for Determining the Plastic Limit and Plasticity Index of Soils
AASHTO T 96	2002 (R2019) Method Of Test For Resistance To Degradation Of Small-Size Coarse Aggregate By Abrasion And Impact In The Los Angeles Machine
AASHTO T 104	Standard Method of Test for Soundness of Aggregate by Use of Sodium Sulfate or Magnesium Sulfate
AASHTO T 180	(2019) Standard Method of Test for Moisture-Density Relations of Soils Using a 4.54-kg (10-lb) Rammer and a 457-mm (18-in.) Drop
AASHTO T 224	(2010) Standard Method of Test for Correction for Coarse Particles in the Soil Compaction Test
AASHTO T 89	(2013) Standard Method for Determining the Liquid Limit of Soils

ASTM INTERNATIONAL (ASTM)

ASTM C117	(2017) Standard Test Method for Materials Finer than 75-um (No. 200) Sieve in Mineral Aggregates by Washing
ASTM C131/C131M	(2020) Standard Test Method for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
ASTM C136/C136M	(2019) Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates
ASTM D1556/D1556M	(2015; E 2016) Standard Test Method for Density and Unit Weight of Soil in Place

	by Sand-Cone Method
ASTM D1557	(2012; E 2015) Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft3) (2700 kN-m/m3)
ASTM D2167	(2015) Density and Unit Weight of Soil in Place by the Rubber Balloon Method
ASTM D2487	(2017; E 2020) Standard Practice for Classification of Soils for Engineering Purposes (Unified Soil Classification System)
ASTM D6938	(2017a) Standard Test Method for In-Place Density and Water Content of Soil and Soil-Aggregate by Nuclear Methods (Shallow Depth)
ASTM D75/D75M	(2019) Standard Practice for Sampling Aggregates
ASTM E11	(2020) Standard Specification for Woven Wire Test Sieve Cloth and Test Sieves

1.2 DEFINITIONS

For the purposes of this specification, the following definitions apply.

1.2.1 Aggregate Base Course

Aggregate base course (ABC) is well graded, durable aggregate uniformly moistened and mechanically stabilized by compaction.

1.2.2 Graded-Crushed Aggregate Base Course

Graded-crushed aggregate (GCA) base course is well graded, crushed, durable aggregate uniformly moistened and mechanically stabilized by compaction.

FDOT Specification 204 Graded Aggregate Base (Group 1) will be considered compliant with this material specification.

1.2.3 Degree of Compaction

Degree of compaction required, except as noted in the second sentence, is expressed as a percentage of the maximum laboratory dry density obtained by the test procedure presented in ASTM D1557 abbreviated as a percent of laboratory maximum dry density. Since ASTM D1557 applies only to soils that have 30 percent or less by weight of their particles retained on the 3/4 inch sieve, the degree of compaction for material having more than 30 percent by weight of their particles retained on the 3/4 inch sieve will be expressed as a percentage of the laboratory maximum dry density in accordance with AASHTO T 180 Method D and corrected with AASHTO T 224.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation;

submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Plant, Equipment, and Tools

SD-06 Test Reports

Initial Tests
In-Place Tests

1.4 EQUIPMENT, TOOLS, AND MACHINES

All plant, equipment, and tools used in the performance of the work will be subject to approval by the Contracting Officer before the work is started. Maintain all plant, equipment, and tools in satisfactory working condition at all times. Use equipment capable of minimizing segregation, producing the required compaction, meeting grade controls, thickness control, and smoothness requirements as set forth herein.

1.5 QUALITY ASSURANCE

Sampling and testing are the responsibility of the Contractor. Perform sampling and testing using a laboratory approved by USACE in accordance with Section 01 45 00.00 10 QUALITY CONTROL. Work requiring testing will not be permitted until the testing laboratory has been inspected and approved. Test the materials to establish compliance with the specified requirements and perform testing at the specified frequency. The Contracting Officer may specify the time and location of the tests. Furnish copies of test results to the Contracting Officer within 24 hours of completion of the tests.

1.5.1 Sampling

Take samples for laboratory testing in conformance with ASTM D75/D75M. When deemed necessary, the sampling will be observed by the Contracting Officer.

1.5.2 Tests

1.5.2.1 Sieve Analysis

Perform sieve analysis in conformance with ASTM C117 and ASTM C136/C136M using sieves conforming to ASTM E11..

1.5.2.2 Liquid Limit and Plasticity Index

Determine liquid limit and plasticity index in accordance with AASHTO T 89.

1.5.2.3 Moisture-Density Determinations

Determine the laboratory maximum dry density and optimum moisture content in accordance with paragraph DEGREE OF COMPACTION.

1.5.2.4 Field Density Tests

Measure field density in accordance with ASTM D1556/D1556M, ASTM D2167 or ASTM D6938. For the method presented in ASTM D6938 check the calibration curves and adjust them, if necessary, using only the sand cone method as described in paragraph Calibration, of the ASTM publication. Tests performed in accordance with ASTM D6938 result in a wet unit weight of soil and ASTM D6938 will be used to determine the moisture content of the soil. Also check the calibration curves furnished with the moisture gauges along with density calibration checks as described in ASTM D6938. Make the calibration checks of both the density and moisture gauges using the prepared containers of material method, as described in paragraph Calibration of ASTM D6938, on each different type of material being tested at the beginning of a job and at intervals as directed. Submit calibration curves and related test results prior to using the device or equipment being calibrated.

1.5.2.5 Wear Test

Perform wear tests on GCA course material in conformance with ASTM C131/C131M.

1.6 ENVIRONMENTAL REQUIREMENTS

Perform construction when the atmospheric temperature is above 35 degrees F. When the temperature falls below 35 degrees F, protect all completed areas by approved methods against detrimental effects of freezing. Correct completed areas damaged by freezing, rainfall, or other weather conditions to meet specified requirements.

PART 2 PRODUCTS

2.1 AGGREGATES

Provide aggregate base material complying with Florida Department of Transportation (FDOT) Standard Specifications for Road and Bridge Construction, January 2020. Base material shall be FDOT 204 Graded Aggregate Base, or Crushed Recycled Concrete.

2.1.1 204 Graded Aggregate Base

Use graded aggregate material, produced from FDOT approved sources, which yields a satisfactory mixture meeting all the requirements of these Specifications after it has been crushed and processed as a part of the mining operations. Use graded aggregate base material of uniform quality throughout, substantially free from vegetable matter, shale, lumps and clay balls, and having a Limerock Bearing Ratio value of not less than 100. Use material retained on the No. 10 sieve composed of aggregate meeting the following requirements:
Soundness Loss, Sodium, Sulfate: AASHTO T 104 ..... 15%
Percent Wear: AASHTO T 96 (Grading A)
Group 1 Aggregates 45%
Group 1: This group of aggregates is composed of limestone, marble, or dolomite.

Use graded aggregate base material meeting the following gradation: Sieve Size	Percent by Weight Passing
2 inch	100
1 1/2 inch	95 to 100
3/4 inch	65 to 90
3/8 inch	45 to 75
NO. 4	35 to 60
No. 10	25 to 45
No. 50	5 to 25
No. 200	0 to 10

For Group 1 aggregates, ensure that the fraction passing the No. 40 sieve has a Plasticity Index (AASHTO T 90) of not more than 4.0 and a Liquid Limit (AASHTO T89) of not more than 25, and contains not more than 67% of the weight passing the No. 200 sieve.

2.1.2 Recycled Concrete Aggregate (RCA)

RCA shall consist of concrete material derived from the crushing of hard portland cement concrete having a Limerock Bearing Ratio value of not less than 150, is non-plastic, . In addition to the deleterious materials noted in 911-2.2, RCA shall be asbestos free. The following limits shall not be exceeded:

Bituminous Concrete ..... 1% by weight
Bricks ..... 1% by weight
Glass and Ceramics ..... 1% by weight
Wood and other organic substances ..... 0.1% by weight
Reinforcing steel and welded wire fabric..... 0.1% by weight
Plaster and gypsum board ..... 0.1% by weight

Use RCA base material meeting the following gradation: Sieve Size	Percent by Weight Passing
2 inch	100
3/4 inch	65 to 95
3/8 inch	40 to 85
No. 4	25 to 65
No. 10	20 to 50

Use RCA base material meeting the following gradation: Sieve Size	Percent by Weight Passing
No. 50	5 to 30
No. 200	0 to 10

2.2 TESTS, INSPECTIONS, AND VERIFICATIONS

2.2.1 Initial Tests

Perform one of each of the following tests, on the proposed material prior to commencing construction, to demonstrate that the proposed material meets all specified requirements when furnished. Complete this testing for each source if materials from more than one source are proposed.

a. Sieve Analysis.

b. Liquid limit and plasticity index.

c. Moisture-density relationship.

d. Wear.

Submit certified copies of test results for approval not less than 30 days before material is required for the work.

2.2.2 Approval of Material

Tentative approval of material will be based on initial test results.

PART 3 EXECUTION

3.1 GENERAL REQUIREMENTS

When the Graded Aggregate Base (GAB) or Recycled Concrete Aggregate (RCA) is constructed in more than one layer, clean the previously constructed layer of loose and foreign matter by sweeping with power sweepers or power brooms, except that hand brooms may be used in areas where power cleaning is not practicable. Provide adequate drainage during the entire period of construction to prevent water from collecting or standing on the working area.

3.2 OPERATION OF AGGREGATE SOURCES

Condition aggregate sources on private lands in accordance with local laws or authorities.

3.3 STOCKPILING MATERIAL

Clear and level storage sites prior to stockpiling of material. Stockpile all materials, including approved material available from excavation and grading, in the manner and at the locations designated. Stockpile aggregates on the cleared and leveled areas designated by the Contracting Officer to prevent segregation. Stockpile materials obtained from different sources separately.

3.4 PREPARATION OF UNDERLYING COURSE OR SUBGRADE

Clean the underlying course or subgrade of all foreign substances prior to constructing the base course(s). Do not construct base course(s) on underlying course or subgrade that is frozen. Construct the surface of the underlying course or subgrade to meet specified compaction and surface tolerances. Correct ruts or soft yielding spots in the underlying courses, areas having inadequate compaction, and deviations of the surface from the specified requirements set forth herein by loosening and removing soft or unsatisfactory material and adding approved material, reshaping to line and grade, and recompacting to specified density requirements. For cohesionless underlying courses or subgrades containing sands or gravels, as defined in ASTM D2487, stabilize the surface prior to placement of the base course(s). Stabilize by mixing GAB or RCA into the underlying course and compacting by approved methods. Consider the stabilized material as part of the underlying course and meet all requirements of the underlying course. Do not allow traffic or other operations to disturb the finished underlying course and maintain in a satisfactory condition until the base course is placed.

3.5 GRADE CONTROL

Provide a finished and completed base course conforming to the lines, grades, and cross sections shown. Place line and grade stakes as necessary for control.

3.6 MIXING AND PLACING MATERIALS

Mix the coarse and fine aggregates in a stationary plant, or in a traveling plant or bucket loader on an approved paved working area. Make adjustments in mixing procedures or in equipment, as directed, to obtain true grades, to minimize segregation or degradation, to obtain the required water content, and to insure a satisfactory base course meeting all requirements of this specification. Place the mixed material on the prepared subgrade or subbase in layers of uniform thickness with an approved spreader. Place the layers so that when compacted they will be true to the grades or levels required with the least possible surface disturbance. Where the base course is placed in more than one layer, clean the previously constructed layers of loose and foreign matter by sweeping with power sweepers, power brooms, or hand brooms, as directed. Make adjustments in placing procedures or equipment as may be directed by the Contracting Officer to obtain true grades, to minimize segregation and degradation, to adjust the water content, and to insure an acceptable base course.

3.7 LAYER THICKNESS

Compact the completed base course to the thickness indicated. No individual layer may be thicker than 6 inches nor be thinner than 3 inches in compacted thickness. Compact the base course(s) to a total thickness that is within 1/2 inch of the thickness indicated. Where the measured thickness is more than 1/2 inch deficient, correct such areas by scarifying, adding new material of proper gradation, reblading, and recompacting as directed. Where the measured thickness is more than 1/2 inch thicker than indicated, the course will be considered as conforming to the specified thickness requirements. The average job thickness will be the average of all thickness measurements taken for the job and must be within 1/4 inch of the thickness indicated. Measure the total thickness of the base course at intervals of one measurement for each 500 square

yards of base course. Measure total thickness using 3 inch diameter test holes penetrating the base course.

3.8 COMPACTION

Compact each layer of the base course, as specified, with approved compaction equipment. Maintain water content during the compaction procedure to within plus or minus 2 percent of the optimum water content determined from laboratory tests as specified in this Section. Begin rolling at the outside edge of the surface and proceed to the center, overlapping on successive trips at least one-half the width of the roller. Slightly vary the length of alternate trips of the roller. Adjust speed of the roller as needed so that displacement of the aggregate does not occur. Compact mixture with hand-operated power tampers in all places not accessible to the rollers. Continue compaction until each layer is compacted through the full depth to at least 100 percent of laboratory maximum density. Make such adjustments in compacting or finishing procedures as may be directed by the Contracting Officer to obtain true grades, to minimize segregation and degradation, to reduce or increase water content, and to ensure a satisfactory base course. Remove any materials found to be unsatisfactory and replace with satisfactory material or rework, as directed, to meet the requirements of this specification.

3.9 EDGES OF BASE COURSE

Place the base course(s) so that the completed section will be a minimum of 1 foot wider, on all sides, than the next layer that will be placed above it. Place approved material along the outer edges of the base course in sufficient quantity to compact to the thickness of the course being constructed. When the course is being constructed in two or more layers, simultaneously roll and compact at least a 2 foot width of this shoulder material with the rolling and compacting of each layer of the base course, as directed.

3.10 FINISHING

Finish the surface of the top layer of base course after final compaction by cutting any overbuild to grade and rolling with a steel-wheeled roller. Do not add thin layers of material to the top layer of base course to meet grade. If the elevation of the top layer of base course is 1/2 inch or more below grade, scarify the top layer to a depth of at least 3 inches and blend new material in and compact to bring to grade. Make adjustments to rolling and finishing procedures as directed by the Contracting Officer to minimize segregation and degradation, obtain grades, maintain moisture content, and insure an acceptable base course. Should the surface become rough, corrugated, uneven in texture, or traffic marked prior to completion, scarify the unsatisfactory portion and rework and recompact it or replace as directed.

3.11 SMOOTHNESS TEST

Construct the top layer so that the surface shows no deviations in excess of 3/8 inch when tested with a 12 foot straightedge. Take measurements in successive positions parallel to the centerline of the area to be paved. Also take measurements perpendicular to the centerline at 50 foot intervals. Correct deviations exceeding this amount by removing material and replacing with new material, or by reworking existing material and compacting it to meet these specifications.

3.12 FIELD QUALITY CONTROL

3.12.1 In-Place Tests

Perform each of the following tests on samples taken from the placed and compacted GCA. Take samples and test at the rates indicated. Perform sampling and testing of recycled concrete aggregate at twice the specified frequency until the material uniformity is established.

a. Perform density tests on every lift of material placed and at a frequency of one set of tests for every 500 square yards, or portion thereof, of completed area.

b. Perform sieve analysis on every lift of material placed and at a frequency of one sieve analysis for every 1000 square yards, or portion thereof, of material placed.

c. Perform liquid limit and plasticity index tests at the same frequency as the sieve analysis.

d. Measure the thickness of the base course at intervals providing at least one measurement for each 500 square yards of base course or part thereof. Measure the thickness using test holes, at least 3 inch in diameter through the base course.

3.12.2 Approval of Material

Final approval of the materials will be based on tests for gradation, liquid limit, and plasticity index performed on samples taken from the completed and fully compacted course(s).

3.13 TRAFFIC

Completed portions of the base course may be opened to limited traffic, provided there is no marring or distorting of the surface by the traffic. Do not allow heavy equipment on the completed base course except when necessary for construction. When it is necessary for heavy equipment to travel on the completed base course, protect the area against marring or damage to the completed work.

3.14 MAINTENANCE

Maintain the base course in a satisfactory condition until the full pavement section is completed and accepted. Immediately repair any defects and repeat repairs as often as necessary to keep the area intact. Retest any base course that was not paved over prior to the onset of winter to verify that it still complies with the requirements of this specification. Rework or replace any area of base course that is damaged as necessary to comply with this specification.

3.15 DISPOSAL OF UNSATISFACTORY MATERIALS

Dispose of any unsuitable materials that have been removed outside the limits of Government-controlled land. No additional payments will be made for materials that have to be replaced.

-- End of Section --

SECTION 32 12 13

BITUMINOUS TACK AND PRIME COATS
05/17

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO M 140-13	(2016) Standard Specification for Emulsified Asphalt
AASHTO M 208-16	(2016) Standard Specification for Cationic Emulsified Asphalt
AASHTO M 316-16	Standard Specification for Polymer-Modified Emulsified Asphalt
AASHTO M 332-14	Standard Specification for Performance-Graded Asphalt Binder Using Multiple Stress Creep Recovery (MSCR) Test
AASHTO T 40	(2002; R 2006) Sampling Bituminous Materials

ASTM INTERNATIONAL (ASTM)

ASTM D2995	(1999; R 2009) Determining Application Rate of Bituminous Distributors

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-06 Test Reports

Sampling and Testing

1.3 QUALITY ASSURANCE

Certificates of compliance for asphalt materials delivered will be obtained and checked to ensure that specification requirements are met. Quantities of applied material will be determined. Payment will be for amount of residual asphalt applied. Tack coat materials will not be diluted. Prime coat materials when emulsions are used can be diluted on

site with potable water up to 1 part emulsion to 1 part water.

1.4 DELIVERY, STORAGE, AND HANDLING

Inspect the materials delivered to the site for contamination and damage. Unload and store the materials with a minimum of handling.

1.5 EQUIPMENT, TOOLS AND MACHINES

1.5.1 General Requirements

Equipment, tools and machines used in the work are subject to approval. Maintain in a satisfactory working condition at all times. Calibrate equipment such as asphalt distributors, scales, batching equipment, spreaders and similar equipment within 12 months of there use. If the calibration expires during project, recalibrate the equipment before work can continue.

1.5.2 Bituminous Distributor

Where feasible, provide a self propelled distributor with pneumatic tires of such size and number to prevent rutting, shoving or otherwise damaging the surface being sprayed. Calibrate the distributer in accordance with ASTM D2995. Design and equip the distributor to spray the bituminous material in a uniform coverage at the specified temperature, at readily determined and controlled total liquid rates from 0.05 to 2.0 gallons per square yard, with a pressure range of 25 to 75 psi and with an allowable variation from the specified rate of not more than plus or minus 5 percent, and at variable widths. Include with the distributor equipment a separate power unit for the bitumen pump, full-circulation spray bars, tachometer, pressure gauges, volume-measuring devices, adequate heaters for heating of materials to the proper application temperature, a thermometer for reading the temperature of tank contents, and a hand hose attachment suitable for applying bituminous material manually to areas inaccessible to the distributor. The distributor will be capable of circulating and agitating the bituminous material during the heating process.

1.5.3 Heating Equipment for Storage Tanks

Use steam, electric, or hot oil heaters for heating the bituminous material. Provide steam heaters consisting of steam coils and equipment for producing steam, so designed that the steam cannot come in contact with the bituminous material. Fix an armored thermometer to the tank with a temperature range from 40 to 400 degrees F so that the temperature of the bituminous material may be determined at all times.

1.5.4 Power Brooms and Power Blowers

Use power brooms and power blowers suitable for cleaning the surfaces to which the bituminous coat is to be applied.

1.6 ENVIRONMENTAL REQUIREMENTS

Apply bituminous coat only when the surface to receive the bituminous coat is dry. A limited amount of moisture (approximately 0.03 gallon/square yard) can be sprayed on the surface of unbound material when prime coat is used to improve coverage and penetration of asphalt material. Apply bituminous coat only when the atmospheric temperature in the shade is 50

degrees F or above and when the temperature has not been below 35 degrees F for the 12 hours prior to application, unless otherwise directed.

PART 2 PRODUCTS

2.1 PRIME COAT

Use a prime coat meeting the requirements of AASHTO M 140-13 for anionic emulsions, AASHTO M 208-16 or AASHTO M 316-16 for cationic emulsions.

2.2 TACK COAT

Use PG 52-28 meeting the requirements of AASHTO M 332-14.

PART 3 EXECUTION

3.1 PREPARATION OF SURFACE AND WEATHER LIMITATION

Immediately before applying the bituminous coat, remove all loose material, dirt, clay, or other objectionable material from the surface to be treated by means of a power broom or blower supplemented with hand brooms. Apply treatment only when the surface is dry and clean.

Do not apply prime and tack coats when temperature in the shade is less than 40 degrees F.

3.2 APPLICATION RATE

The exact quantities within the range specified, which may be varied to suit field conditions, will be determined by the Contracting Officer.

3.2.1 Tack Coat

Place a tack coat on all asphalt layers prior to constructing the next course. Apply bituminous material for the tack coat in quantities of not less than 0.05 gallons nor more than 0.15 gallons per square yard of residual asphalt onto the pavement surface as approved by the Contracting Officer.

3.2.2 Prime Coat

Place prime coat over completed base prior to placement of first lift of asphalt. Apply bituminous material for the prime coat in quantities of not less than 0.10 gallons nor more than 0.20 gallons per square yard.

3.3 APPLICATION TEMPERATURE

3.3.1 Viscosity Relationship

Apply asphalt at a temperature that will provide a viscosity between 10 and 60 seconds, Saybolt Furol, or between 20 and 120 centistokes, kinematic. Furnish the temperature viscosity relation to the Contracting Officer.

3.3.2 Temperature Ranges

The viscosity requirements determine the application temperature to be used. Abide by Manufacturer's recommendations for application temperature.

3.4 APPLICATION

3.4.1 General

Following preparation and subsequent inspection of the surface, apply the bituminous prime or tack coat with the bituminous distributor at the specified rate with uniform distribution over the surface to be treated. Properly treat all areas and spots, not capable of being sprayed with the distributor, with the hand spray. Until the succeeding layer of pavement is placed, maintain the surface by protecting the surface against damage and by repairing deficient areas at no additional cost to the Government. If required, spread clean dry sand to effectively blot up any excess bituminous material. No smoking, fires, or flames other than those from the heaters that are a part of the equipment are permitted within 25 feet of heating, distributing, and transferring operations of cutback materials. Prevent all traffic, except for paving equipment used in constructing the surfacing, from using the underlying material, whether primed or not, until the surfacing is completed. The bituminous coat requirements are described herein.

3.4.2 Prime Coat

The prime coat is required if it will be at least 7 days before the asphalt mixture is constructed on the underlying (base course, etc.) compacted material. The type of liquid asphalt and application rate will be as specified herein. Protect the underlying layer from any damage (water, traffic, etc.) until the surfacing is placed. If the Contractor places the surfacing within seven days, the choice of protection measures or actions to be taken is at the Contractor's option. Repair (recompact or replace) damage to the underlying material caused by lack of, or inadequate, protection by approved methods at no additional cost to the Government. If the Contractor opts to use the prime coat, apply as soon as possible after consolidation of the underlying material. Apply the bituminous material uniformly over the surface to be treated at a pressure range of 25 to 75 psi; the rate will be as specified above in paragraph APPLICATION RATE. To obtain uniform application of the prime coat on the surface treated at the junction of previous and subsequent applications, spread building paper on the surface for a sufficient distance back from the ends of each application to start and stop the prime coat on the paper and to ensure that all sprayers will operate at full force on the surface to be treated. Immediately after application remove and destroy the building paper.

3.4.3 Tack Coat

Apply tack coat at the locations shown on the drawings. A tack coat should be applied to every bound surface (asphalt or concrete pavement) that is being overlaid with asphalt mixture and at transverse and longitudinal joints. Apply the tack coat when the surface to be treated is clean and dry. Immediately following the preparation of the surface for treatment, apply the bituminous material by means of the bituminous distributor, within the limits of temperature specified herein and at a rate as specified above in paragraph APPLICATION RATE. Apply the bituminous material so that uniform distribution is obtained over the entire surface to be treated. Treat lightly coated areas and spots missed by the distributor by spraying with a hand wand or using other approved method. Following the application of bituminous material, allow the surface to cure without being disturbed for period of time necessary to permit setting of the tack coat. Apply the bituminous tack coat only as

far in advance of the placing of the overlying layer as required for that day's operation. Maintain and protect the treated surface from damage until the succeeding course of pavement is placed.

3.5 CURING PERIOD

Following application of the bituminous material and prior to application of the succeeding layer of asphalt mixture allow the bituminous coat to cure and water or volatiles to evaporate prior to overlaying. Maintain the tacked surface in good condition until the succeeding layer of pavement is placed, by protecting the surface against damage and by repairing and recoating deficient areas. Allow the prime coat to cure without being disturbed for a period of at least 48 hours or longer, as may be necessary to attain penetration into the treated course. Furnish and spread enough sand to effectively blot up excess bituminous material.

3.6 FIELD QUALITY CONTROL

Obtain certificates of compliance for all asphalt material delivered to the project. Obtain samples of the bituminous material under the supervision of the Contracting Officer. The sample may be retained and tested by the Government at no cost to the Contractor.

3.7 SAMPLING AND TESTING

Furnish certified copies of the manufacturer's test reports indicating temperature viscosity relationship and compliance with applicable specified requirements, not less than 5 days before the material is required in the work.

3.7.1 Sampling

Unless otherwise specified, sample bituminous material in accordance with AASHTO T 40.

3.7.2 Calibration Test

Furnish all equipment, materials, and labor necessary to calibrate the bituminous distributor. Calibrate using the approved job material and prior to applying the bituminous coat material to the prepared surface. Calibrate the bituminous distributor in accordance with ASTM D2995.

3.7.3 Trial Applications

Before applying the spray application of tack or prime coat, apply three lengths of at least 100 feet for the full width of the distributor bar to evaluate the amount of bituminous material that can be satisfactorily applied.

3.7.3.1 Tack Coat Trial Application Rate

Unless otherwise authorized, apply the trial application rate of bituminous tack coat materials in the amount of 0.05 gallons per square yard. Make other trial applications using various amounts of material as may be deemed necessary.

3.7.3.2 Prime Coat Trial Application Rate

Unless otherwise authorized, apply the trial application rate of

bituminous materials in the amount of 0.15 gallon per square yard. Make other trial applications using various amounts of material as may be deemed necessary.

3.7.4 Sampling and Testing During Construction

Perform quality control sampling and testing as required in paragraph FIELD QUALITY CONTROL.

3.8 TRAFFIC CONTROLS

Keep traffic off surfaces freshly treated with bituminous material. Provide sufficient warning signs and barricades so that traffic will not travel over freshly treated surfaces.

-- End of Section --

SECTION 32 12 16

HOT-MIX ASPHALT (HMA) FOR ROADS

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO T 104	Standard Method of Test for Soundness of Aggregate by Use of Sodium Sulfate or Magnesium Sulfate
AASHTO M 140	(2018) Standard Specification for Emulsified Asphalt
AASHTO M 208	(2016) Standard Specification for Cationic Emulsified Asphalt
AASHTO M 316	(2018) Standard Specification for Polymer Emulsified Asphalt
AASHTO M 332	(2014) Standard Specification for Performance-Graded Asphalt Binder Using Multiple Stress Creep Recovery (MSCR) Test
AASHTO T 19	(2014) Standard Method for Bulk Density ("Unit Weight") and Voids in Aggregate
AASHTO T 27	(2014) Standard Method of Test for Sieve Analysis of Fine and Coarse Aggregates
AASHTO T 112	Standard Method of Test for Clay Lumps and Friable Particles in Aggregate
AASHTO T 113	Standard Method of Test for Lightweight Particles in Aggregate
AASHTO T 194	(2018) Standard Method of Test for Determination of Organic Matter in Soils by Wet Combustion
AASHTO T 312	(2019) Standard Method of Test for Preparing and Determining the Density of Asphalt Mixture Specimens by Means of the Superpave Gyratory Compactor

STATE OF FLORIDA DEPARTMENT OF TRANSPORTATION (FDOT)

SSR&BC	(2020) FDOT Standard Specification for

	Road & Bridge Construction
FM 1-T 011	Florida Method of Test for Materials Finer than No. 200 Sieve in Mineral Aggregate by Washing
FM 1-T 030	Florida Method of Test for Mechanical Analysis of Extracted Aggregate
FM 1-T 096	Florida Method of Test for Resistance to Abrasion of Small Size Coarse Aggregate by Use of the Los Angeles Machine
FM 1-T 168	Florida Method of Test for Sampling Bituminous Paving Mixtures
FM 1-T 209	Florida Method of Test for Maximum Specific Gravity of Asphalt Paving Mixtures
FM 5-563	Florida Method of Test for Quantitative Determination of Asphalt Content from Asphalt Paving Mixtures by the Ignition Method
FM 5-584	Florida Method of Test for Resistance to Abrasion of Small Size Coarse Aggregate by Use of the Los Angeles Machine

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-01 Preconstruction Submittals

Quality Control Plan

SD-03 Product Data

Mix Design

Quality Control; G

Material Acceptance; G

Prime Coat Product; G

SD-06 Test Reports

Aggregates; G

QC Monitoring

SD-07 Certificates

Asphalt Mixing Plant

Testing Laboratory

FDOT Certification For Asphalt Mixing Plant

Corps Certification

1.3 ENVIRONMENTAL REQUIREMENTS

Do not transport asphalt mix from the plant to the roadway unless all weather conditions are suitable for the paving operations. Immediately cease transportation of asphalt mixtures from the plant when rain begins at the job site. Do not place asphalt mixtures while rain is falling, or when there is water on the surface to be covered. Once the rain has stopped, standing water has been removed from the tacked surface to the satisfaction of the Contracting Officer, the paving operation may resume. The temperature of the mixture at the plant or in any truck in transit must meet the requirements as specified below. Any truck whose load fails to meet this requirement, must be wasted.

Mix Temperature Master Range Tolerance	
Location	Acceptable Temperature Tolerance
Plant	330 +/- 30 degrees F
Roadway (mix in truck)	330 +/- 30 degrees F
Roadway (mix in windrow)	330 +30 degrees F, - 40 degrees F

Table 320-3	
Mix Temperature Tolerance From Verified Mix Design	
Any Single Measurement	+/-25 degrees F

Place asphalt only when the air temperature in the shade and away from artificial heat is 45 degrees F and rising.

1.3.1 Underlying Surface

Place the mixture only when the surface upon which it is to be placed has been previously prepared, is intact, firm, dry, clean, and the tack or prime coat, with acceptable spread rate, is properly cured. The surface temperature of the underlying course must be no less than 45 degrees F.

PART 2 PRODUCTS

2.1 SYSTEM DESCRIPTION

Perform the work consisting of pavement courses composed of mineral aggregate and asphalt material heated and mixed in a central mixing plant and placed on a prepared course. HMA designed and constructed in accordance with this section shall conform to the lines, grades, thicknesses, and typical cross sections indicated. Construct each course to the depth, section, or elevation required by the drawings and roll,

finish, and approve it before the placement of the next course.

2.1.1 Asphalt Mixing Plant

Design, manufacture, coordinate, and operate the asphalt plant in a manner that will consistently produce a mixture within the required tolerances and temperatures specified. Mixing plant shall be FDOT certified. Submit copy of FDOT certification for asphalt mixing plant.

2.1.1.1 Inspection of Plant

Provide the Contracting Officer with access at all times, to all areas of the plant for checking adequacy of equipment; inspecting operation of the plant; verifying weights, proportions, and material properties; checking the temperatures maintained in the preparation of the mixtures and for taking samples. Provide assistance as requested, for the Government to procure any desired samples.

2.1.1.2 Storage bins

Use of storage bins for temporary storage of hot-mix asphalt will be permitted as follows:

a. The asphalt mixture may be stored in non-insulated storage bins for a period of time not exceeding 3 hours.

b. The asphalt mixture may be stored in insulated storage bins for a period of time not exceeding 8 hours. The mix drawn from bins shall meet the same requirements as mix loaded directly into trucks.

2.1.2 Hauling Equipment

Transport the mix in trucks of tight construction, which prevents the loss of material and the excessive loss of heat and previously cleaned of all foreign material. After cleaning, thinly coat the inside surface of the truck bodies with soapy water or an asphalt release agent as needed to prevent the mixture from adhering to the beds. Do not allow excess liquid to pond in the truck body. Do not use a release agent that will contaminate, degrade, or alter the characteristics of the asphalt mix or is hazardous or detrimental to the environment. Petroleum derivatives (such as diesel fuel), solvents, and any product that dissolves asphalt are prohibited. Provide each truck with a tarpaulin or other waterproof cover mounted in such a manner that it can cover the entire load when required. When in place, overlap the waterproof cover on all sides so that it can be tied down. Cover each load during cool and cloudy weather and at any time it appears rain is likely during transit with a tarpaulin or waterproof cover.

2.1.3 Asphalt Pavers

Use mechanically-sound equipment capable of consistently meeting Specification requirements.

Provide a self-propelled asphalt paver that can be steered, and is equipped with a receiving and distribution hopper and a mechanical screed. Use a mechanical screed capable of adjustment to regulate the depth of material spread and to produce the desired cross-section.

2.1.3.1 Automatic Screed Control

For all asphalt courses placed with an asphalt paver, equip the paver with automatic longitudinal screed controls of either the skid type, traveling stringline type, or non-contact averaging ski type with a minimum length of 25 feet. On structural courses, and surface course, use the joint matcher instead of the skid, traveling stringline, or non-contact averaging ski on all passes after the initial pass. Equip the asphalt paver with electronic cross slope and grade controls capable of maintaining the specified screed elevation. Provide an asphalt paver with a screed width greater than 8 feet when required to pave full width lanes. Do not use extendable screed strike-off devices that do not provide preliminary compaction of the mat in place of fixed screed extensions. Use a strike-off device only on irregular areas that would normally be done by hand.

2.1.3.2 Receiving Hopper

Provide paver with a receiving hopper of sufficient capacity to permit a uniform spreading operation and equipped with a distribution system to place the mixture uniformly in front of the screed without segregation. The screed shall effectively produce a finished surface of the required evenness and texture without tearing, shoving, or gouging the mixture.

2.1.4 Rollers

Rollers shall be in good condition and shall be operated at slow speeds to avoid displacement of the asphalt mixture. The number, type, and weight of rollers shall be sufficient to compact the mixture to the required density and finish to specified slope and smoothness while it is still in a workable condition. Do not use equipment which causes excessive crushing of the aggregate.

2.2 SUPERPAVE ASHPALT CONCRETE

Construct a Superpave Asphalt Concrete pavement with the type of mixture specified in the Contract Documents. Superpave mixes are identified as Type SP-9.5, and Type SP-12.5. Obtain Superpave Asphalt Concrete from a plant that is currently on the FDOT approved Production Facility Listing.

2.2.1 Traffic Level

Design Traffic Level for this project is B.

2.2.2 Thickness

The thickness of the Type SP asphalt layers shall be per the Contract Documents.

2.2.3 Asphalt Binder

The asphalt binder shall be PG 76-22 (PMA) meeting the requirements of AASHTO M 332-14 and the FDOT SSR&BC.

2.3 AGGREGATES

2.3.1 Course Aggregate

2.3.1.1 Composition

Coarse aggregate shall consist of naturally occurring materials such as gravel, or resulting from the crushing of parent rock, to include natural rock, slags, expanded clays and shales (lightweight aggregates) and other approved inert materials with similar characteristics, having hard, strong, durable particles, conforming to the specific requirements of this Section. Materials substantially retained on the No. 4 sieve, shall be classified as coarse.

2.3.1.2 Deleterious Substances

All coarse aggregates shall be reasonably free of clay lumps, soft and friable particles, salt, alkali, organic matter, adherent coatings, and other substances not defined which may possess undesirable characteristics. The weight of deleterious substances shall not exceed the following percentages:

Coal and lignite (AASHTO T 113)	1.00
Soft and friable particles (AASHTO T 112)*	2.00
Clay lumps (AASHTO T 112)*	2.00
Plant root matter (visual inspection in AASHTO T 27)****	0.005
Wood and wood matter (visual inspection in AASHTO T 27)****	0.005
Cinders and clinkers	0.50
Free shell**	1.00
Total Material passing the No. 200 sieve (FM 1-T 011)	
At Source with Los Angeles Abrasion less than or equal to 30	2.50
At Source with Los Angeles Abrasion greater than 30	1.75
At Point of Use	3.75
Fine-Grained Organic Matter (AASHTO T 194)	0.03
Chert (less than 2.40 specific gravity SSD) (AASHTO T 113)***	3.00

* The maximum percent by weight of soft and friable particles and clay lumps together shall not exceed 3.00.

** Aggregates to be used in asphalt concrete may contain up to 5% free shell. Free shell is defined as that portion of the coarse aggregate retained on the No. 4 sieve consisting of loose, whole, or broken shell, or the external skeletal remains of other marine life, having a ratio of the maximum length of the particle to the shell wall thickness exceeding five to one. Coral, molds, or casts of other shells, and crushed clam and oyster shell indigenous to the formation will not be considered as free shell.

*** This limitation applies only to coarse aggregates in which chert appears as an impurity. It is not applicable to aggregates which are predominantly chert.

**** Plant root matter, and wood and wood matter shall be considered deleterious when any piece exceeds two inches in length or 1/2 inch in width.

The weights of deleterious substances for reclaimed Portland cement concrete aggregate shall not exceed the following percentages:

Bituminous Concrete	1.00
Bricks	1.00
Wood and other organic substances (by weight)*****	0.1
Reinforcing Steel and Welded Wire Reinforcement	0.1
Plaster and gypsum board	0.1
Joint Fillers	0.1

***** Supersedes requirement for other coarse aggregate

2.3.1.3 Physical Properties

Coarse aggregates shall meet the following physical property requirements, except as noted herein:

Los Angeles Abrasion (FM 1-T 096).....maximum loss 45%
Soundness (Sodium Sulfate) AASHTO T 104 .....maximum loss 12%*
Flat or elongated pieces**..... maximum 10%

* For source approval - aggregates exceeding soundness loss limitations will be rejected unless performance history shows that the material will not be detrimental for portland cement concrete or other intended usages.

** A flat or elongated particle is defined as one having a ratio between the maximum and the minimum dimensions of a circumscribing prism exceeding five to one.

2.3.1.4 Natural Stones

2.3.1.4.1 Gravels

Gravel shall be composed of naturally occurring quartz, free from deleterious coatings of any kind. The minimum dry-rodded weight AASHTO T 19 shall be 95 pounds per cubic foot. Crushed gravel shall consist of a minimum of 85%, by weight, of the material retained on the No. 4 sieve, having at least three fractured faces.

2.3.1.4.2 Granites

Coarse aggregate produced from the crushing of granites shall be sound and durable. Maximum loss per the Los Angeles Abrasion Test shall not exceed 50. (FM 1-T 096). Maximum amount of mica schist permitted is 5% (FM 5-584).

2.3.1.4.3 Limestones, Dolomite and Sandstone

Coarse aggregates may be produced from limestone, dolomite, sandstones, and other naturally occurring hard, durable materials meeting the requirements of this Section.

2.3.1.5 Fine Aggregate

2.3.1.5.1 Composition

Fine aggregate shall consist of natural silica sand, screenings, local materials, or subject to approval, other inert materials with similar characteristics, or combination thereof, having hard, strong, durable particles, conforming to the specific requirements of this Section.

2.3.1.5.2 Deleterious Substances

All fine aggregate shall be reasonably free of lumps of clay, soft or flaky particles, salt, alkali, organic matter, loam or other extraneous substances. The weight of deleterious substances shall not exceed the following percentages:

Shale..... 1.0
Coal and lignite..... 1.0
Cinders and clinkers..... 0.5
Clay Lumps..... 1.0

2.3.1.5.3 Silica Sand:

Silica sand shall be composed only of naturally occurring hard, strong, durable, uncoated grains of quartz, reasonably graded from coarse to fine, meeting the following requirements, in percent total weight.

Sieve Opening Size	Percent Retained	Percent Passing
No. 4	0 to 5%	95 to 100%
No. 8	0 to 15%	85 to 100%
No. 16	3 to 35%	65 to 97%
No. 30	30 to 75%	25 to 70%
No. 50	65 to 95%	5 to 35%
No. 100	93 to 100%	0 to 7%
No. 200	minimum 96%	maximum 4%

Silica sand from any one source, having a variation in Fineness Modulus greater than 0.20 either way from the Fineness Modulus of target gradations established by the producer, may be rejected.

2.3.1.6 Aggregate Grading Limitations by Mix Type

Aggregate sieve size analysis shall be within the control limitations provided below foe each mix type.

2.3.1.6.1 Gradation for SP 12.5 Traffic Level D Mix

Sieve Size	Percent Passing by Mass
3/4"	100
1/2"	90-100
3/8"	75-90

Sieve Size	Percent Passing by Mass
No. 4	60-80
No. 8	40-58
No. 16	29-45
No. 30	22-40
No. 50	16-30
No. 100	5-15
No. 200	2-10

2.3.1.6.2 Gradation for SP 9.5 Traffic Level D Mix

Sieve Size	Percent Passing by Mass
3/4"	100
1/2"	98-100
3/8"	90-100
No. 4	70-89
No. 8	48-67
No. 16	35-50
No. 30	26-40
No. 50	19-30
No. 100	5-15
No.200	2-10

2.4 MIX DESIGN

The asphalt mix design shall be an FDOT Certified mix containing no more than 30% RAP. Submit mix for SP 12.5 Traffic Level B for the first course and FDOT SP 9.5 Traffic Level B for the surface course. Ensure all mix designs are developed by individuals who are FDOT Construction Training and Qualification Program (CTQP) qualified as an Asphalt Hot Mix Designer. The mix design submittals must include certification that the mix design has been approved subject to FDOT specifications.

The mix design submittal must include at a minimum:
Mix Type

Design Traffic Level
# of Gyrations @ N_{des}
Material Source Table for asphalt components with Product Description & Production Facility
Gradation table with composite mix gradation as well as breakdown by component with applicable percentages of mix composition for each component
Total Binder Content (%)
% PG 76-22
Mixing Temp
Compaction Temp
Spread Rate
Percent binder from Recycled Materials
G_{mb} @ N_{des}
G_{mm}
V_a
VMA
VFA
Effective Date of FDOT Mix Approval
Expiration Date of FDOT Mix Approval
List of Additives

2.5 PRIME AND TACK COATS

Apply bituminous prime coats on previously prepared bases, and apply bituminous tack coats on previously prepared bases and on existing pavement surfaces.

2.5.1 Prime Coat

Use a prime coat listed on FDOT's Approved Products List (APL), meeting the requirements of AASHTO M 140 for anionic emulsions, AASHTO M 208 or AASHTO M 316 for cationic emulsions. Submit the proposed prime coat product with evidence of its presence on the FDOT APL.

2.5.2 Tack Coat

Use PG52-28 tack coat a tack coat heated to a temperature from 250 to 300ºF.

2.5.3 Pressure Distributor

Provide a pressure distributor equipped with pneumatic tires having a sufficient width of rubber in contact with the road surface to avoid breaking the bond or forming a rut in the surface. Ensure the distance between the centers of openings of the outside nozzles of the spray bar is equal to the width of the application required, plus or minus two inches. Ensure the outside nozzle at each end of the spray bar has an area of opening not less than 25% or more than 75% in excess of the other nozzles. Ensure all other nozzles have uniform openings. When the application covers less than the full width, the Contractor may allow the normal opening of the end nozzle at the junction line to remain the same as the interior nozzles. Clean the distributor tank at a minimum of every twelve months and whenever the product type in the tank is changed. Remove all emulsion and asphalt material during cleaning.

Additionally, clean the distributor tank if the quality of the tack or prime shot diminishes or buildup causes the calibration of the tank to be affected.

2.5.4 Sampling Device

Equip all pressure distributors and transport tanks with an approved spigot-type sampling device.

2.5.5 Temperature Sensing Device

Equip all pressure distributors and transport tanks with an approved dial type thermometer. Use a thermometer with a temperature range from 50 to 500ºF, no greater than 25ºF increments, and a minimum dial diameter of two inches. Locate the thermometer near the midpoint of the tank's length and within the middle third of the tank's height, or as specified by the manufacturer (if in a safe and easily accessible location). Enclose the thermometer in a well with a protective window or by other means as necessary to keep the instrument clean and in the proper working condition.

2.5.5.1 Contractor's Quality Control

Provide the necessary quality control of the prime and tack coats and application in accordance with the Contract requirements. If the application rate varies by more than 0.01 gallon per square yard from the rate specified herein, immediately make all corrections necessary to bring the application rate into the acceptable range. The COE inspector may randomly check the Contractor's measurement to verify the application rate.

PART 3 EXECUTION

3.1 PREPARATION OF THE UNDERLYING SURFACE

Immediately before placing the mixture, clean the surface of the base or underlying pavement of all loose and deleterious material by the use of power brooms or blowers, supplemented by hand brooming where necessary.

For first structural course, verify that base is graded and clipped in accordance with the requirements of Section 32 11 23 AGGREGATE BASE COURSES.

3.1.1 Prime Coat Application

Clean the surface to be primed and ensure the moisture content of the base does not exceed the optimum moisture. Heat the prime coat material to the temperature recommended by the prime coat manufacturer. Apply the material with a pressure distributor except on small jobs, if approved by the Engineer, apply it by other mechanical devices or by hand methods . Apply the Prime Coat at a rate of 0.10 gal/yd^2 +/- 0.01 gal/yd^2. Determine the application amount based on the character of the surface. Use an amount sufficient to coat the surface thoroughly and uniformly with no excess.

3.1.1.1 Tack Coat Application

Apply tack coat between each successive layer of asphaltic cement. Place a tack coat on all asphalt layers prior to constructing the next course. Heat the bituminous material to a suitable temperature as designated by the supplier. Apply the tack coat with a pressure distributor except on small jobs, if approved by the Engineer, apply it by other mechanical devices or by hand methods. Apply the Prime Coat at a rate of 0.05 gal/yd^2 +/- 0.01 gal/yd^2. Determine the application amount based on the character of the surface. Use an amount sufficient to coat the surface thoroughly and uniformly with no excess.

3.2 TEST SECTION

Prior to full production, place a test section for each JMF used. Construct a test section 250 - 500 feet long and two paver passes wide placed for two lanes, with a longitudinal cold joint. The test section shall be of the same thickness as the course which it represents. The underlying grade or pavement structure upon which the test section is to be constructed shall be the same as the remainder of the course represented by the test section. The equipment and personnel used in construction of the test section shall be the same equipment to be used on the remainder of the course represented by the test section. Place the test section as part of the project pavement, as approved by the Contracting Officer.

3.2.1 Sampling and Testing for Test Section and Subsequent Asphalt Production and Placement

3.2.1.1 Job Mixture

The mixture will be accepted at the plant with respect to gradation (P_{-8} and P_{-200}), asphalt content (P_b), and volumetrics (volumetrics is defined as air voids at Ndesign). Obtain the samples in accordance with FM 1-T 168. Obtain samples at the plant of a sufficient quantity to be split into three smaller samples; one for QC, one for Verification testing and one for Resolution testing; each sample at approximately 35 pounds. The split samples for Verification testing and Resolution testing shall be reduced in size and stored in three boxes each. The approximate size of each box must be 12 inches x 8 inches x 4 inches. Provide, label and safely store sample boxes in a manner agreed upon by the Engineer for future testing. The asphalt content of the mixture will be determined in accordance with FM 5-563. The gradation of the recovered aggregate will be determined in accordance with FM 1-T 030. Volumetric testing will be in accordance with AASHTO T 312-12 and FM 1-T 209. Prior to testing volumetric samples, condition the test-sized sample for one hour, plus or minus five minutes, at the target roadway compaction temperature in a shallow, flat pan, such that the mixture temperature at the end of the one hour conditioning period is within plus or minus 20°F of the roadway compaction temperature.

3.2.1.1.1 Roadway Density

Obtain five 6 inch diameter roadway cores within 24 hours of placement of the test section at random locations within the test area. Test these QC samples for density (G_{mb}) in accordance with FM 1-T 168. Do not obtain cores any closer than 12 inches from an unsupported edge. Patch the core holes (within three days of coring); and trim the cores to the proper hickness prior to density testing. Density for the test section shall be based on the average value for the cores cut from the test section with the target density being a percentage of the maximum specific gravity (G_{mm}) of the test section, as defined herein. Ensure proper handling and storage of all cores until the test section has been accepted.

3.2.2 Additional Test Sections

If the initial test section should prove to be unacceptable, make the necessary adjustments to the JMF, plant operation, placing procedures, and/or rolling procedures and place a second test section. Additional test sections, as required, shall be constructed and evaluated for conformance to the specifications. Full production shall not begin until

an acceptable section has been constructed and accepted.

3.3 TESTING LABORATORY

All testing of the asphalt shall be completed at the Contractor's expense by an independent testing laboratory possessing both FDOT and USACOE certification.

The laboratory shall maintain the Corps certification for the duration of the project. Submit a statement signed by the manager of the laboratory stating that it meets these requirements or clearly listing all deficiencies shall be submitted to the Contracting Officer prior to the start of construction. The statement shall contain as a minimum:

a. Qualifications of personnel; laboratory manager, supervising technician, and testing technicians.

b. A listing of equipment to be used in developing the job mix.

c. A copy of the laboratory's quality control system.

d. Evidence of participation in the AASHTO Materials Reference Laboratory (AMRL) program.

3.4 TESTING FREQUENCY

3.4.1 Asphalt Mix from Plant

Asphalt Plant - Materials Testing Frequencies		
Material	Property	Minimum Testing Frequency
Aggregate	Gradation	Once for Test Section and Once for each Lift
Asphalt Mix	Asphalt Binder Content	Once for Test Section and Once for each Lift
Asphalt Mix	Bulk Specific Gravity (G_{mb})	Once for Test Section and Once for each Lift
Asphalt Mix	Gradation	Once for Test Section and Once for each Lift
Asphalt Mix	Maximum Specific Gravity (G_{mm})	Once for Test Section and Once for each Lift
Asphalt Mix	Temperature	Each of first 5 loads, then once every 5 loads thereafter, per day per mix design.
RAP	Asphalt Binder Content	Once per 1,000 tons RAP
RAP	Gradation	Once per 1,000 tons RAP
RAP	Maximum Specific Gravity (G_{mm})	Once per 5,000 tons RAP

3.4.2 In Place Density

Five randomly placed six-inch cores from Test Section and each 2,000 SY from each lift.

3.5 CRITERIA FOR ASPHALT ACCEPTANCE

The acceptance criteria described herein apply to both the test section and each successive lift.

3.5.1 Asphalt Mix & In-Place Density

Acceptable Deviation from Specification Limits	
Property	Acceptable Range
Percent of G_{mm}	90.5 - 95.00
Asphalt Binder Content (%)	Target +/- 0.55
Passing # 200 Sieve (%)	Target +/- 1.5%
Air Voids (%)	2.30 - 6.00
Temperature	See paragraph ENVIRONMENTAL REQUIREMENTS of this specification

3.6 TRANSPORTING AND PLACING

3.6.1 Transporting

Transport the hot-mix asphalt from the mixing plant to the site in clean, tight vehicles. Schedule deliveries so that placing and compacting of mixture is uniform with minimum stopping and starting of the paver. Provide adequate artificial lighting for night placements. Hauling over freshly placed material will not be permitted until the material has been compacted as specified, and allowed to cool to 140 degrees F.

3.6.2 Placing

Place and compact the mix at a temperature suitable for obtaining density, surface smoothness, and other specified requirements. Upon arrival, place the mixture to the full width by an asphalt paver; it shall be struck off in a uniform layer of such depth that, when the work is completed, it will have the required thickness and conform to the grade and contour indicated. Regulate the speed of the paver to eliminate pulling and tearing of the asphalt mat. Unless otherwise permitted, placement of the mixture shall begin along the centerline of a crowned section or on the high side of areas with a one-way slope. Place the mixture in consecutive adjacent strips having a minimum width of 10 feet. The longitudinal joint in one course shall offset the longitudinal joint in the course immediately below by at least 1 foot; however, the joint in the surface course shall be at the centerline of the pavement. Transverse joints in one course shall be offset by at least 10 feet from transverse joints in the previous course. Transverse joints in adjacent lanes shall be offset a minimum of 10 feet. On isolated areas where irregularities or unavoidable obstacles make the use of mechanical spreading and finishing equipment impractical, the mixture may be spread and luted by hand tools.

3.7 COMPACTION OF MIXTURE

After placing, the mixture shall be thoroughly and uniformly compacted by

rolling. Compact the surface as soon as possible without causing displacement, cracking or shoving. The sequence of rolling operations and the type of rollers used shall be at the discretion of the Contractor. The speed of the roller shall, at all times, be sufficiently slow to avoid displacement of the hot mixture and be effective in compaction. Any displacement occurring as a result of reversing the direction of the roller, or from any other cause, shall be corrected at once. Furnish sufficient rollers to handle the output of the plant. Continue rolling until the surface is of uniform texture, true to grade and cross section, and the required field density is obtained. To prevent adhesion of the mixture to the roller, keep the wheels properly moistened but excessive water will not be permitted. In areas not accessible to the roller, the mixture shall be thoroughly compacted with hand tampers. Any mixture that becomes loose and broken, mixed with dirt, contains check-cracking, or is in any way defective shall be removed full depth, replaced with fresh hot mixture and immediately compacted to conform to the surrounding area. This work shall be done at the Contractor's expense. Skin patching will not be allowed.

3.8 JOINTS

The formation of joints shall be performed ensuring a continuous bond between the courses and to obtain the required density. All joints shall have the same texture as other sections of the course and meet the requirements for smoothness and grade.

3.8.1 Transverse Joints

Do not pass the roller over the unprotected end of the freshly laid mixture, except when necessary to form a transverse joint. When necessary to form a transverse joint, it shall be made by means of placing a bulkhead or by tapering the course. The tapered edge shall be cut back to its full depth and width on a straight line to expose a vertical face prior to placing material at the joint. Remove the cutback material from the project. In both methods, all contact surfaces shall be given a light tack coat of asphalt material before placing any fresh mixture against the joint.

3.8.2 Longitudinal Joints

Longitudinal joints which are irregular, damaged, uncompacted, cold (less than 175 degrees F at the time of placing adjacent lanes), or otherwise defective, shall be cut back a maximum of 3 inches from the top of the course with a cutting wheel to expose a clean, sound vertical surface for the full depth of the course. All cutback material shall be removed from the project. All contact surfaces shall be given a light tack coat of asphalt material prior to placing any fresh mixture against the joint. The Contractor will be allowed to use an alternate method if it can be demonstrated that density, smoothness, and texture can be met.

3.9 QUALITY CONTROL

3.9.1 General Quality Control Requirements

Develop and submit an approved Quality Control Plan. Submit aggregate and QC test results. Do not produce hot-mix asphalt for payment until the quality control plan has been approved addressing all elements which affect the quality of the pavement including, but not limited to:

a. Mix Design

b. Aggregate Grading

c. Quality of Materials

d. Stockpile Management

e. Proportioning

f. Mixing and Transportation

g. Mixture Volumetrics

h. Moisture Content of Mixtures

i. Placing and Finishing

j. Joints

k. Compaction

l. Surface Smoothness

3.9.2 Quality Control Testing

Perform all quality control tests applicable to these specifications and as set forth in the Quality Control Program. The testing program shall include, but shall not be limited to, tests for the control of asphalt content, aggregate gradation, temperatures, aggregate moisture, moisture in the asphalt mixture, laboratory air voids, in-place density, grade and smoothness. Develop a Quality Control Testing Plan as part of the Quality Control Program. As a minimum, the plan must include requirements for tests identified in the paragraph entitled "TESTING FREQUENCY" with acceptance criteria as identified in the paragraph "CRITERIA FOR ASPHALT ACCEPTANCE".

3.9.2.1 QC Monitoring

Submit all QC test results to the Contracting Officer on a daily basis as the tests are performed. The Contracting Officer reserves the right to monitor any of the Contractor's quality control testing and to perform duplicate testing as a check to the Contractor's quality control testing.

3.10 MATERIAL ACCEPTANCE

See paragraph "CRITERIA FOR ASPHALT ACCEPTANCE".

3.10.1 Grade

The final wearing surface of pavement shall conform to the elevations and cross sections shown and shall vary not more than 0.05 foot from the plan grade established and approved at site of work. Finished surfaces at juncture with other pavements shall coincide with finished surfaces of abutting pavements. Deviation from the plan elevation will not be permitted in areas of pavements where closer conformance with planned elevation is required for the proper functioning of drainage and other appurtenant structures involved. The grade will be determined by running lines of levels at intervals of 50 feet, or less, longitudinally and

transversely, to determine the elevation of the completed pavement surface. Within 5 working days, after the completion of a particular lot incorporating the final wearing surface, test the final wearing surface of the pavement for conformance with the specified plan grade. Diamond grinding may be used to remove high spots to meet grade requirements. Skin patching for correcting low areas or planing or milling for correcting high areas will not be permitted.

3.10.2 Surface Smoothness

Use one of the following methods to test and evaluate surface smoothness of the pavement. Perform all testing in the presence of the Contracting Officer. Keep detailed notes of the results of the testing and furnish a copy to the Government immediately after each day's testing. Where drawings show required deviations from a plane surface (crowns, drainage inlets, etc.), the surface shall be finished to meet the approval of the Contracting Officer.

3.10.2.1 Smoothness Requirements

3.10.2.1.1 Straightedge Testing

The finished surfaces of the pavements shall have no abrupt change of 1/4 inch or more, and all pavements shall be within the tolerances of 1/4 inch in both the longitudinal and transverse directions, when tested with an approved 12 feet straightedge.

3.10.2.2 Testing Method

After the final rolling, but not later than 24 hours after placement, test the surface of the pavement in each entire lot in such a manner as to reveal all surface irregularities exceeding the tolerances specified above. Separate testing of individual sublots is not required. If any pavement areas are ground, these areas shall be retested immediately after grinding. Test each lot of the pavement in both a longitudinal and a transverse direction on parallel lines. Set the transverse lines 15 feet or less apart, as directed. The longitudinal lines shall be at the centerline of each paving lane for lanes less than 20 feet wide and at the third points for lanes 20 feet or wider. Also test other areas having obvious deviations. Longitudinal testing lines shall be continuous across all joints.

3.10.2.2.1 Straightedge Testing

Hold the straightedge in contact with the surface and move it ahead one-half the length of the straightedge for each successive measurement. Determine the amount of surface irregularity by placing the freestanding (unleveled) straightedge on the pavement surface and allowing it to rest upon the two highest spots covered by its length, and measuring the maximum gap between the straightedge and the pavement surface in the area between these two high points.

-- End of Section --

SECTION 32 16 19

CONCRETE CURBS, GUTTERS AND SIDEWALKS
05/18

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO M 182	(2005; R 2017) Standard Specification for Burlap Cloth Made from Jute or Kenaf and Cotton Mats

ASTM INTERNATIONAL (ASTM)

ASTM A1064/A1064M	(2017) Standard Specification for Carbon-Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete
ASTM A615/A615M	(2020) Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement
ASTM C143/C143M	(2020) Standard Test Method for Slump of Hydraulic-Cement Concrete
ASTM C171	(2020) Standard Specification for Sheet Materials for Curing Concrete
ASTM C172/C172M	(2017) Standard Practice for Sampling Freshly Mixed Concrete
ASTM C173/C173M	(2016) Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method
ASTM C231/C231M	(2017a) Standard Test Method for Air Content of Freshly Mixed Concrete by the Pressure Method
ASTM C309	(2019) Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete
ASTM C31/C31M	(2021a) Standard Practice for Making and Curing Concrete Test Specimens in the Field
ASTM C920	(2018) Standard Specification for Elastomeric Joint Sealants

ASTM D1751	(2018) Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Nonextruding and Resilient Bituminous Types)
ASTM D1752	(2018) Standard Specification for Preformed Sponge Rubber, Cork and Recycled PVC Expansion Joint Fillers for Concrete Paving and Structural Construction
ASTM D5893/D5893M	(2016) Standard Specification for Cold Applied, Single Component, Chemically Curing Silicone Joint Sealant for Portland Cement Concrete Pavements

INTERNATIONAL CODE COUNCIL (ICC)

ICC A117.1 COMM	(2017) Standard And Commentary Accessible and Usable Buildings and Facilities

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Concrete

Biodegradable Form Release Agent

SD-06 Test Reports

Field Quality Control

1.3 EQUIPMENT, TOOLS, AND MACHINES

1.3.1 General Requirements

Plant, equipment, machines, and tools used in the work will be subject to approval and must be maintained in a satisfactory working condition at all times. Use equipment capable of producing the required product, meeting grade controls, thickness control and smoothness requirements as specified. Discontinue using equipment that produces unsatisfactory results. Allow the Contracting Officer access at all times to the plant and equipment to ensure proper operation and compliance with specifications.

1.3.2 Slip Form Equipment

Slip form paver or curb forming machines, will be approved based on trial use on the job and must be self-propelled, automatically controlled, crawler mounted, and capable of spreading, consolidating, and shaping the

plastic concrete to the desired cross section in one pass.

1.4 ENVIRONMENTAL REQUIREMENTS

1.4.1 Placing During Cold Weather

Do not place concrete when the air temperature reaches 40 degrees F and is falling, or is already below that point. Placement may begin when the air temperature reaches 35 degrees F and is rising, or is already above 40 degrees F. Make provisions to protect the concrete from freezing during the specified curing period.

1.4.2 Placing During Warm Weather

The temperature of the concrete as placed must not exceed 85 degrees F except where an approved retarder is used. Cool the mixing water and aggregates as necessary to maintain a satisfactory placing temperature. The placing temperature must not exceed 95 degrees F at any time.

PART 2 PRODUCTS

2.1 CONCRETE

Provide concrete conforming to the applicable requirements of Section 03 30 00 CAST-IN-PLACE CONCRETE except as otherwise specified. Concrete must have a minimum compressive strength of 3500 psi at 28 days. Size of aggregate must not exceed 1-1/2 inches. Submit copies of certified delivery tickets for all concrete used in the construction.

2.1.1 Air Content

Use concrete mixtures that have an air content by volume of concrete of 3 to 6 percent, based on measurements made immediately after discharge from the mixer.

2.1.2 Slump

Use concrete with a slump of 2 inches plus or minus 1 inch for hand placed concrete or 1 inch plus or minus 1/2 inch for slipformed concrete as determined in accordance with ASTM C143/C143M.

2.1.3 Reinforcement Steel

Use reinforcement bars conforming to ASTM A615/A615M. Use wire mesh reinforcement conforming to ASTM A1064/A1064M.

2.2 CONCRETE CURING MATERIALS

2.2.1 Impervious Sheet Materials

Use impervious sheet materials conforming to ASTM C171, type optional, except that polyethylene film, if used, must be white opaque.

2.2.2 Burlap

Use burlap conforming to AASHTO M 182.

2.2.3 White Pigmented Membrane-Forming Curing Compound

Use white pigmented membrane-forming curing compound conforming to ASTM C309, Type 2.

2.3 CONCRETE PROTECTION MATERIALS

Use concrete protection materials consisting of a linseed oil mixture of equal parts, by volume, of linseed oil and either mineral spirits, naphtha, or turpentine. At the option of the Contractor, commercially prepared linseed oil mixtures, formulated specifically for application to concrete to provide protection against the action of deicing chemicals may be used, except that emulsified mixtures are not acceptable.

2.4 JOINT FILLER STRIPS

2.4.1 Contraction Joint Filler for Curb and Gutter

Use hard-pressed fiberboard contraction joint filler for curb and gutter.

2.4.2 Expansion Joint Filler, Premolded

Onless otherwise indicated, use 1/2 inch thick premolded expansion joint filler conforming to ASTM D1751 or ASTM D1752.

2.5 JOINT SEALANTS

Use cold-applied joint sealant conforming to ASTM C920 or ASTM D5893/D5893M.

2.6 FORM WORK

Design and construct form work to ensure that the finished concrete will conform accurately to the indicated dimensions, lines, and elevations, and within the tolerances specified. Use wood or steel forms that are straight and of sufficient strength to resist springing during depositing and consolidating concrete.

2.6.1 Wood Forms

Use forms that are surfaced plank, 2 inches nominal thickness, straight and free from warp, twist, loose knots, splits or other defects. Use forms with a nominal length of 10 feet. Radius bends may be formed with 3/4 inch boards, laminated to the required thickness.

2.6.2 Steel Forms

Use channel-formed sections with a flat top surface and welded braces at each end and at not less than two intermediate points. Use forms with interlocking and self-aligning ends. Provide flexible forms for radius forming, corner forms, form spreaders, and fillers as needed. Use forms with a nominal length of 10 feet and that have a minimum of 3 welded stake pockets per form. Use stake pins consisting of solid steel rods with chamfered heads and pointed tips designed for use with steel forms.

2.6.3 Sidewalk Forms

Use sidewalk forms that are of a height equal to the full depth of the finished sidewalk.

2.6.4 Curb and Gutter Forms

Use curb and gutter outside forms that have a height equal to the full depth of the curb or gutter. Use rigid forms for curb returns, except that benders or thin plank forms may be used for curb or curb returns with a radius of 10 feet or more, where grade changes occur in the return, or where the central angle is such that a rigid form with a central angle of 90 degrees cannot be used. Back forms for curb returns may be made of 1-1/2 inch benders, for the full height of the curb, cleated together. In lieu of inside forms for curbs, a curb "mule" may be used for forming and finishing this surface, provided the results are approved.

2.6.5 Biodegradable Form Release Agent

Where practicable, use form release agent that is colorless and biodegradableand that is composed of at least 87 percent biobased material. Provide product that does not bond with, stain, or adversely affect concrete surfaces and does not impair subsequent treatments of concrete surfaces. Provide form release agent that does not contain diesel fuel, petroleum-based lubricating oils, waxes, or kerosene.

2.7 Detectable Warning System

Detectable Warning Systems shown on the Contract plans are to meet requirements of ICC A117.1 COMM - Section 705.

PART 3 EXECUTION

3.1 SUBGRADE PREPARATION

Construct subgrade to the specified grade and cross section prior to concrete placement.

3.1.1 Sidewalk Subgrade

Place and compact the subgrade in accordance with Section 31 00 00 EARTHWORK. Test the subgrade for grade and cross section with a template extending the full width of the sidewalk and supported between side forms.

3.1.2 Curb and Gutter Subgrade

Place and compact the subgrade in accordance with Section 31 00 00 EARTHWORK. Test the subgrade for grade and cross section by means of a template extending the full width of the curb and gutter. Use subgrade materials equal in bearing quality to the subgrade under the adjacent pavement.

3.1.3 Maintenance of Subgrade

Maintain subgrade in a smooth, compacted condition in conformity with the required section and established grade until the concrete is placed. The subgrade must be in a moist condition when concrete is placed. Prepare and protect subgrade so that it is free from frost when the concrete is deposited.

3.2 FORM SETTING

Set forms to the indicated alignment, grade and dimensions. Hold forms rigidly in place by a minimum of 3 stakes per form placed at intervals not

to exceed 4 feet. Use additional stakes and braces at corners, deep sections, and radius bends, as required. Use clamps, spreaders, and braces where required to ensure rigidity in the forms. Remove forms in a manner that will not injure the concrete. Do not use bars or heavy tools against the concrete when removing the forms. Promptly and satisfactorily repair concrete found to be defective after form removal. Clean forms and coat with form oil or biodegradable form release agent each time before concrete is placed. Wood forms may, instead, be thoroughly wetted with water before concrete is placed, except that with probable freezing temperatures, oiling is mandatory.

3.2.1 Sidewalks

Set forms for sidewalks with the upper edge true to line and grade with an allowable tolerance of 1/8 inch in any 10 foot long section. After forms are set, grade and alignment must be checked with a 10 foot straightedge. Sidewalks must have a transverse slope as indicated or of 1/4 inch per foot where not indicated as the plans. Unless otherwise indicated, construct sidewalks that are located adjacent to curbs with the low side adjacent to the curb. Do not remove side forms less than 12 hours after finishing has been completed.

3.2.2 Curbs and Gutters

Remove forms used along the front of the curb not less than 2 hours nor more than 6 hours after the concrete has been placed. Do not remove forms used along the back of curb until the face and top of the curb have been finished, as specified for concrete finishing. Do not remove gutter forms while the concrete is sufficiently plastic to slump in any direction.

3.3 SIDEWALK CONCRETE PLACEMENT AND FINISHING

3.3.1 Formed Sidewalks

Place concrete in the forms in one layer. When consolidated and finished, the sidewalks must be of the thickness indicated. Use a strike-off guided by side forms after concrete has been placed in the forms to bring the surface to proper section to be compacted. Consolidate concrete by tamping and spading or with an approved vibrator. Finish the surface to grade with a strike off.

3.3.2 Concrete Finishing

After straightedging, when most of the water sheen has disappeared, and just before the concrete hardens, finish the surface with a wood or magnesium float or darby to a smooth and uniformly fine granular or sandy texture free of waves, irregularities, or tool marks. Produce a scored surface by brooming with a fiber-bristle brush in a direction transverse to that of the traffic, followed by edging.

3.3.3 Edge and Joint Finishing

Finish all slab edges, including those at formed joints, with an edger having a radius of 1/8 inch. Edge transverse joints before brooming. Eliminate the flat surface left by the surface face of the edger with brooming. Clean and solidly fill corners and edges which have crumbled and areas which lack sufficient mortar for proper finishing with a properly proportioned mortar mixture and then finish.

3.3.4 Surface and Thickness Tolerances

Finished surfaces must not vary more than 5/16 inch from the testing edge of a 10-foot straightedge. Permissible deficiency in section thickness will be up to 1/4 inch.

3.4 CURB AND GUTTER CONCRETE PLACEMENT AND FINISHING

3.4.1 Formed Curb and Gutter

Place concrete to the required section in a single lift. Consolidate concrete using approved mechanical vibrators. Curve shaped gutters must be finished with a standard curb "mule".

3.4.2 Curb and Gutter Finishing

Approved slipformed curb and gutter machines may be used in lieu of hand placement.

3.4.3 Concrete Finishing

Float and finish exposed surfaces with a smooth wood float until true to grade and section and uniform in texture. Brush floated surfaces with a fine-hair brush using longitudinal strokes. Round the edges of the gutter and top of the curb with an edging tool to a radius of 1/2 inch. Immediately after removing the front curb form, rub the face of the curb with a wood or concrete rubbing block and water until blemishes, form marks, and tool marks have been removed. Brush the front curb surface, while still wet, in the same manner as the gutter and curb top. Finish the top surface of gutter and entrance to grade with a wood float.

3.4.4 Joint Finishing

Finish curb edges at formed joints as indicated.

3.4.5 Surface and Thickness Tolerances

Finished surfaces must not vary more than 1/4 inch from the testing edge of a 10-foot straightedge. Permissible deficiency in section thickness will be up to 1/4 inch.

3.5 SIDEWALK JOINTS

Construct sidewalk joints to divide the surface into rectangular areas. Space transverse contraction joints at a distance equal to the sidewalk width or 5 feet on centers, whichever is less, and continuous across the slab. Construct longitudinal contraction joints along the centerline of all sidewalks 10 feet or more in width. Construct transverse expansion joints at sidewalk returns and opposite expansion joints in adjoining curbs. Where the sidewalk is not in contact with the curb, install transverse expansion joints as indicated. Form expansion joints around structures and features which project through or into the sidewalk pavement, using joint filler of the type, thickness, and width indicated. Expansion joints are not required between sidewalks and curb that abut the sidewalk longitudinally.

3.5.1 Sidewalk Contraction Joints

Form contraction joints in the fresh concrete by cutting a groove in the

top portion of the slab to a depth of at least one-fourth of the sidewalk slab thickness. Unless otherwise approved or indicated, either use a jointer to cut the groove or saw a groove in the hardened concrete with a power-driven saw. Construct sawed joints by sawing a groove in the concrete with a 1/8 inch blade. Provide an ample supply of saw blades on the jobsite before concrete placement is started. Provide at least one standby sawing unit in good working order at the jobsite at all times during the sawing operations.

3.5.2 Sidewalk Expansion Joints

Form expansion joints using 1/2 inch joint filler strips. Joint filler in expansion joints surrounding structures and features within the sidewalk may consist of preformed filler material conforming to ASTM D1752 or building paper. Hold joint filler in place with steel pins or other devices to prevent warping of the filler during floating and finishing. Immediately after finishing operations are completed, round joint edges using an edging tool having a radius of 1/8 inch. Remove any concrete over the joint filler. At the end of the curing period, clean the top of expansion joints and fill with cold-applied joint sealant. Use joint sealant that is gray or stone in color. Thoroughly clean the joint opening before the sealing material is placed. Do not spill sealing material on exposed surfaces of the concrete. Apply joint sealing material only when the concrete at the joint is surface dry and atmospheric and concrete temperatures are above 50 degrees F. Immediately remove any excess material on exposed surfaces of the concrete and clean the concrete surfaces.

3.6 CURB AND GUTTER JOINTS

Construct curb and gutter joints at right angles to the line of curb and gutter.

3.6.1 Contraction Joints

Construct contraction joints directly opposite contraction joints in abutting portland cement concrete pavements and spaced so that monolithic sections between curb returns will not be less than 5 feet nor greater than 15 feet in length.

a. Construct contraction joints (except for slip forming) by means of 1/8 inch thick separators and of a section conforming to the cross section of the curb and gutter. Remove separators as soon as practicable after concrete has set sufficiently to preserve the width and shape of the joint and prior to finishing.

b. When slip forming is used, cut the contraction joints in the top portion of the gutter/curb hardened concrete in a continuous cut across the curb and gutter, using a power-driven saw. Cut the contraction joint to a depth of at least one-fourth of the gutter/curb depth using a 1/8 inch saw blade.

3.6.2 Expansion Joints

Form expansion joints by means of preformed expansion joint filler material cut and shaped to the cross section of curb and gutter. Construct expansion joints in curb and gutter directly opposite expansion joints of abutting portland cement concrete pavement using the same type and thickness of joints as joints in the pavement. Where curb and gutter

do not abut portland cement concrete pavement, provide expansion joints at least 1/2 inch in width at intervals not less than 30 feet nor greater than 120 feet. Seal expansion joints immediately following curing of the concrete or as soon thereafter as weather conditions permit. Seal expansion joints and the top 1 inch depth of curb and gutter contraction-joints with joint sealant. Thoroughly clean the joint opening before the sealing material is placed. Do not spill sealing material on exposed surfaces of the concrete. Concrete at the joint must be surface dry and atmospheric and concrete temperatures must be above 50 degrees F at the time of application of joint sealing material. Immediately remove excess material on exposed surfaces of the concrete and clean concrete surfaces.

3.7 CURING AND PROTECTION

3.7.1 General Requirements

Protect concrete against loss of moisture and rapid temperature changes for at least 7 days from the beginning of the curing operation. Protect unhardened concrete from rain and flowing water. All equipment needed for adequate curing and protection of the concrete must be on hand and ready for use before actual concrete placement begins. Protect concrete as necessary to prevent cracking of the pavement due to temperature changes during the curing period.

3.7.1.1 Mat Method

Cover the entire exposed surface with two or more layers of burlap. Overlap mats at least 6 inches. Thoroughly wet the mat with water prior to placing on concrete surface and keep the mat continuously in a saturated condition and in intimate contact with concrete for not less than 7 days.

3.7.1.2 Impervious Sheeting Method

Wet the entire exposed surface with a fine spray of water and then cover with impervious sheeting material. Lay sheets directly on the concrete surface with the light-colored side up and overlapped 12 inches when a continuous sheet is not used. Use sheeting that is not less than 18-inches wider than the concrete surface to be cured. Secure sheeting using heavy wood planks or a bank of moist earth placed along edges and laps in the sheets. Satisfactorily repair or replace sheets that are torn or otherwise damaged during curing. Sheeting must remain on the concrete surface to be cured for not less than 7 days.

3.7.1.3 Membrane Curing Method

Apply a uniform coating of white-pigmented membrane-curing compound to the entire exposed surface of the concrete as soon after finishing as the free water has disappeared from the finished surface. Coat formed surfaces immediately after the forms are removed and in no case longer than 1 hour after the removal of forms. Do not allow concrete surface to dry before application of the membrane. If drying has occurred, moisten the surface of the concrete with a fine spray of water and apply the curing compound as soon as the free water disappears. Apply curing compound in two coats by hand-operated pressure sprayers at a coverage of approximately 200 square feet/gallon for the total of both coats. Apply the second coat in a direction approximately at right angles to the direction of application of the first coat. The compound must form a uniform, continuous, coherent

film that will not check, crack, or peel and must be free from pinholes or other imperfections. If pinholes, abrasion, or other discontinuities exist, apply an additional coat to the affected areas within 30 minutes. Respray concrete surfaces that are subjected to heavy rainfall within 3 hours after the curing compound has been applied by the method and at the coverage specified above. Respray areas where the curing compound is damaged by subsequent construction operations within the curing period. Take precautions necessary to ensure that the concrete is properly cured at sawed joints, and that no curing compound enters the joints. Tightly seal the top of the joint opening and the joint groove at exposed edges before the concrete in the region of the joint is resprayed with curing compound. Use a method used for sealing the joint groove that prevents loss of moisture from the joint during the entire specified curing period. Provide approved standby facilities for curing concrete pavement at a location accessible to the jobsite for use in the event of mechanical failure of the spraying equipment or other conditions that might prevent correct application of the membrane-curing compound at the proper time. Adequately protect concrete surfaces to which membrane-curing compounds have been applied during the entire curing period from pedestrian and vehicular traffic, except as required for joint-sawing operations and surface tests, and from other possible damage to the continuity of the membrane.

3.7.2 Backfilling

After curing, remove debris and backfill, grade, and compact the area adjoining the concrete to conform to the surrounding area in accordance with lines and grades indicated.

3.7.3 Protection

Protect completed concrete from damage until accepted. Repair damaged concrete and clean concrete discolored during construction. Remove and reconstruct concrete that is damaged for the entire length between regularly scheduled joints. Refinishing the damaged portion will not be acceptable. Dispose of removed material as directed.

3.8 FIELD QUALITY CONTROL

Submit copies of all test reports within 24 hours of completion of the test.

3.8.1 General Requirements

Perform the inspection and tests described and meet the specified requirements for inspection details and frequency of testing. Based upon the results of these inspections and tests, take the action and submit reports as required below, and additional tests to ensure that the requirements of these specifications are met.

3.8.2 Concrete Testing

3.8.2.1 Strength Testing

Take concrete samples in accordance with ASTM C172/C172M not less than once a day nor less than once for every 250 cubic yards of concrete placed. Mold cylinders in accordance with ASTM C31/C31M for strength testing by an approved laboratory. Each strength test result must be the average of 2 test cylinders from the same concrete sample tested at 28

days, unless otherwise specified or approved. Concrete specified on the basis of compressive strength will be considered satisfactory if the averages of all sets of three consecutive strength test results equal or exceed the specified strength, and no individual strength test result falls below the specified strength by more than 500 psi.

3.8.2.2 Air Content

Determine air content in accordance with ASTM C173/C173M or ASTM C231/C231M. Use ASTM C231/C231M with concretes and mortars made with relatively dense natural aggregates. Make two tests for air content on randomly selected batches of each class of concrete placed during each shift. Make additional tests when excessive variation in concrete workability is reported by the placing foreman or the Government inspector. Notify the placing forman if results are out of tolerance. The placing foreman must take appropriate action to have the air content corrected at the plant. Additional tests for air content will be performed on each truckload of material until such time as the air content is within the tolerance specified.

3.8.2.3 Slump Test

Perform two slump tests on randomly selected batches of each class of concrete for every 250 cubic yards, or fraction thereof, of concrete placed during each shift. Perform additional tests when excessive variation in the workability of the concrete is noted or when excessive crumbling or slumping is noted along the edges of slip-formed concrete.

3.8.3 Thickness Evaluation

Determine the anticipated thickness of the concrete prior to placement by passing a template through the formed section or by measuring the depth of opening of the extrusion template of the curb forming machine. If a slip form paver is used for sidewalk placement, construct the subgrade true to grade prior to concrete placement. The thickness will be determined by measuring each edge of the completed slab.

3.8.4 Surface Evaluation

Provide finished surfaces for each category of the completed work that are uniform in color and free of blemishes and form or tool marks.

3.9 SURFACE DEFICIENCIES AND CORRECTIONS

3.9.1 Thickness Deficiency

When measurements indicate that the completed concrete section is deficient in thickness by more than 1/4 inch the deficient section will be removed, between regularly scheduled joints, and replaced.

3.9.2 High Areas

In areas not meeting surface smoothness and plan grade requirements, reduce high areas either by rubbing the freshly finished concrete with carborundum brick and water when the concrete is less than 36 hours old or by grinding the hardened concrete with an approved surface grinding machine after the concrete is 36 hours old or more. The area corrected by grinding the surface of the hardened concrete must not exceed 5 percent of the area of any integral slab, and the depth of grinding must not exceed

1/4 inch. Remove and replace pavement areas requiring grade or surface smoothness corrections in excess of the limits specified.

3.9.3 Appearance

Exposed surfaces of the finished work will be inspected by the Contracting Officer and deficiencies in appearance will be identified. Remove and replace areas which exhibit excessive cracking, discoloration, form marks, or tool marks or which are otherwise inconsistent with the overall appearances of the work.

3.10 DETECTABLE WARNING SYSTEM

Install Detectable Warning Systems required by Contract plans in accordance with ICC A117.1 COMM, Section 705, and by manufacturers' installation instructions.

-- End of Section --

SECTION 32 17 23

PAVEMENT MARKINGS
08/16

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM D2240	(2015; E 2017) Standard Test Method for Rubber Property - Durometer Hardness
ASTM D2621	(1987; R 2016) Standard Test Method for Infrared Identification of Vehicle Solids from Solvent-Reducible Paints
ASTM D2697	(2003; R 2014) Volume Nonvolatile Matter in Clear or Pigmented Coatings
ASTM D3335	(1985a; R 2020) Low Concentrations of Lead, Cadmium, and Cobalt in Paint by Atomic Absorption Spectroscopy
ASTM D3718	(1985a; R 2015) Low Concentrations of Chromium in Paint by Atomic Absorption Spectroscopy
ASTM D3924	(2016) Standard Specification for Environment for Conditioning and Testing Paint, Varnish, Lacquer, and Related Materials
ASTM D3960	(2005; R 2013) Determining Volatile Organic Compound (VOC) Content of Paints and Related Coatings
ASTM D4061	(2013) Standard Test Method for Retroreflectance of Horizontal Coatings
ASTM D4541	(2017) Standard Test Method for Pull-Off Strength of Coatings Using Portable Adhesion Testers
ASTM D471	(2016a) Standard Test Method for Rubber Property - Effect of Liquids
ASTM D522/D522M	(2017) Mandrel Bend Test of Attached Organic Coatings
ASTM D6628	(2003; R 2015) Standard Specification for Color of Pavement Marking Materials
ASTM D711	(2010; R 2015) No-Pick-Up Time of Traffic

Paint

ASTM D823	(2018) Standard Practices for Producing Films of Uniform Thickness of Paint, Coatings, and Related Products on Test Panels
ASTM E1710	(2011) Standard Test Method for Measurement of Retroreflective Pavement Marking Materials with CEN-Prescribed Geometry Using a Portable Retroreflectometer
ASTM E2177	(2011) Standard Test Method for Measuring the Coefficient of Retroreflected Luminance (RL) of Pavement Markings in a Standard Condition of Wetness
ASTM E2302	(2003; R 2016) Standard Test Method for Measurement of the Luminance Coefficient Under Diffuse Illumination of Pavement Marking Materials Using a Portable Reflectometer
ASTM G154	(2016) Standard Practice for Operating Fluorescent Light Apparatus for UV Exposure of Nonmetallic Materials

INTERNATIONAL CONCRETE REPAIR INSTITUTE (ICRI)

ICRI 03732	(1997) Selecting and Specifying Concrete Surface Preparation for Sealers, Coatings, and Polymer Overlays

U.S. FEDERAL HIGHWAY ADMINISTRATION (FHWA)

MUTCD	(2015) Manual on Uniform Traffic Control Devices

U.S. GENERAL SERVICES ADMINISTRATION (GSA)

FED-STD-595	(Rev C; Notice 1) Colors Used in Government Procurement
FS TT-B-1325	(Rev D; Notice 1; Notice 2 2017) Beads (Glass Spheres) Retro-Reflective (Metric)
FS TT-P-1952	(2015; Rev F; Notice 1) Paint, Traffic and Airfield Markings, Waterborne

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only or as otherwise designated. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Surface Preparation Equipment List;

Application Equipment List

Exterior Surface Preparation

Safety Data Sheets

Reflective media for roads

Waterborne Paint

SD-06 Test Reports

Reflective Media for Roads

Waterborne Paint

High Build Acrylic Coating (HBAC)

Test Reports

SD-07 Certificates

Qualifications

Reflective Media for Roads

Waterborne Paint

Volatile Organic Compound, (VOC)

SD-08 Manufacturer's Instructions

Waterborne Paint

1.3 QUALITY ASSURANCE

1.3.1 Regulatory Requirements

Submit certificate stating that the proposed pavement marking paint meets the Volatile Organic Compound, (VOC) regulations of the local Air Pollution Control District having jurisdiction over the geographical area in which the project is located. Submit Safety Data Sheets for each product.

1.3.2 Qualifications

Submit documentation certifying that pertinent personnel are qualified for equipment operation and handling of applicable chemicals. The documentation should include experience on five projects of similar size and scope with references for all personnel.

1.4 DELIVERY AND STORAGE

Deliver paint materials and reflective media in original sealed containers

that plainly show the designated name, specification number, batch number, color, date of manufacture, manufacturer's directions, and name of manufacturer.

Provide storage facilities at the job site for maintaining materials at temperatures recommended by the manufacturer.

1.5 PROJECT/SITE CONDITIONS

1.5.1 Environmental Requirements

1.5.1.1 Weather Limitations for Application

Apply pavement markings to clean, dry surfaces, and unless otherwise approved, only when the air and pavement surface temperature is at least 5 degrees F above the dew point and the air and pavement temperatures are within the limits recommended by the pavement marking manufacturer. Allow pavement surfaces to dry after water has been used for cleaning or rainfall has occurred prior to striping or marking. Test the pavement surface for moisture before beginning work each day and after cleaning. Do not commence marking until the pavement is sufficiently dry and the pavement condition has been approved by the Contracting Officer. Employ the "plastic wrap method" to test the pavement for moisture as specified in paragraph TESTING FOR MOISTURE.

1.5.1.2 Weather Limitations for Removal of Pavement Markings on Roads and Parking Areas

Pavement surface must be free of snow, ice, or slush; with a surface temperature of at least 40 degrees F and rising at the beginning of operations, except those involving grinding. Cease operation during thunderstorms, or during rainfall, except for waterblasting and removal of previously applied chemicals. Cease waterblasting where surface water accumulation alters the effectiveness of material removal.

1.5.2 Traffic Controls

Place warning signs conforming to MUTCD near the beginning of the worksite and well ahead of the worksite for alerting approaching traffic from both directions. Place small markers along newly painted lines or freshly placed raised markers to control traffic and prevent damage to newly painted surfaces or displacement of raised pavement markers. Mark painting equipment with large warning signs indicating slow-moving painting equipment in operation.

When traffic must be rerouted or controlled to accomplish the work, provide necessary warning signs, flag persons, and related equipment for the safe passage of vehicles.

PART 2 PRODUCTS

2.1 EQUIPMENT

2.1.1 Surface Preparation Equipment for Roads and Parking Areas

Submit a surface preparation equipment list by serial number, type, model, and manufacturer. Include descriptive data indicating area of coverage per pass, pressure adjustment range, tank and flow capacities, and safety precautions required for the equipment operation. Mobile equipment must

allow for removal of markings without damaging the pavement surface or joint sealant. Maintain machines, tools, and equipment used in the performance of the work in satisfactory operating condition.

2.1.1.1 Waterblasting Equipment

Use mobile waterblasting equipment capable of producing a pressurized stream of water that effectively removes paint from the pavement surface without significantly damaging the pavement. Provide equipment, tools, and machinery which are safe and in good working order at all times.

2.1.1.2 Grinding or Scarifying Equipment

Use equipment capable of removing surface contaminates, paint build-up, or extraneous markings from the pavement surface without leaving any residue. Clean the surface by hydro blast to remove surface contaminates and ash after a weed torch is used to remove paint.

2.1.2 Application Equipment

Submit application equipment list appropriate for the material(s) to be used. Include manufacturer's descriptive data and certification for the planned use that indicates area of coverage per pass, pressure adjustment range, tank and flow capacities, and all safety precautions required for operating and maintaining the equipment. Provide and maintain machines, tools, and equipment used in the performance of the work in satisfactory operating condition, or remove them from the work site. Provide mobile and maneuverable application equipment to the extent that straight lines can be followed and normal curves can be made in a true arc.

2.1.2.1 Paint Application Equipment

2.1.2.1.1 Hand-Operated, Push-Type Machines

Provide hand-operated push-type applicator machine of a type commonly used for application of water based paint or two-component, chemically curing paint, thermoplastic, or preformed tape, to pavement surfaces for small marking projects, such as legends and cross-walks, parking areas, or surface painted signs. Provide applicator machine equipped with the necessary tanks and spraying nozzles capable of applying paint uniformly at coverage specified. Hand operated spray guns may be used in areas where push-type machines cannot be used.

2.1.2.1.2 Self-Propelled or Mobile-Drawn Spraying Machines

Provide self-propelled or mobile-drawn spraying machine with suitable arrangements of atomizing nozzles and controls to obtain the specified results. Provide machine having a speed during application capable of applying the stripe widths indicated at the paint coverage rate specified herein and of even uniform thickness with clear-cut edges.

2.1.2.1.2.1 Road Marking

Provide equipment used for marking roads capable of placing the prescribed number of lines at a single pass as solid lines, intermittent lines, or a combination of solid and intermittent lines using a maximum of three different colors of paint as specified.

2.2 MATERIALS

The maximum allowable VOC content of pavement markings is 150 grams per liter. Color of markings are indicated on the drawings and must conform to ASTM D6628 for roads and parking areas. Provide materials conforming to the requirements specified herein.

2.2.1 Waterborne Paint

FS TT-P-1952, Type I or II.

2.2.2 High Build Acrylic Coating (HBAC)

Formulate High Build Acrylic Coating (HBAC) to meet the requirements of Table II.

TABLE II - REQUIREMENTS FOR HIGH BUILD ACRYLIC COATINGS (HBAC)

TEST	MINIMUM REQUIREMENT (AND MAXIMUM WHERE INDICATED)
Resin System (ASTM D2621)	Waterborne 100 percent Acrylic
Percent Volume Solids (ASTM D2697)	58 percent
Volatile Organic Compound, max. (ASTM D3960)	1.25 lbs/gal
White (FED-STD-595)	37925
Yellow (FED-STD-595)	33538
Shore D Hardness (ASTM D2240)	45
1/8 inch Mandrel Bend at 5 mils Dry Film Thickness (DFT, one-week cure (ASTM D522/D522M, Method B)	No visual defects at bend (Conditions at ASTM D3924)
Adhesion to Concrete and Asphaltic Pavements (ASTM D4541)	140 psi or 100 percent cohesive failure in pavement
Accelerated Weathering, Yellow, 2500 Hours UV Exposure (ASTM G154: see note 1)	Max. color loss to 33655 (FED-STD-595)
Water Absorption at 168 Hours Immersion Tap Water (ASTM D471)	9.0 percent max. weight increase (conditions at ASTM D3924)

TABLE II - REQUIREMENTS FOR HIGH BUILD ACRYLIC COATINGS (HBAC)	
TEST	MINIMUM REQUIREMENT (AND MAXIMUM WHERE INDICATED)
Application at 65 mils Wet,One Coat, One-week Cure, (see note 2)	No visual cracking or curling (conditions at ASTM D3924)
No Pick-Up at 25 mils (ASTM D711)	Wet 10 minutes max.
Lead (ASTM D3335)	0.06 percent max.
Cadmium (ASTM D3335)	0.06 percent max.
Chromium (ASTM D3718)	0.00 percent

Notes:

(1) Properly mix and apply yellow paint at 10 mils plus or minus 2 mils DFT over a suitably sized, clean aluminum substrate (ASTM D823), and cure for a minimum of 48 hours: four individual yellow samples shall be prepared. Expose three samples to continuous Ultraviolet (UV) light for 2500 hours, without cycles condensation, in accordance to ASTM G154: UVA-340 lamps shall be used in the testing apparatus. Following exposure, compare the three exposed samples to the "one" non-exposed sample using FED-STD-595 colors 33538 and 33655 as visual references: evaluate exposed samples for degree of visual color loss. Yellow paint shall receive a passing rating if each exposed sample appears equivalent to the non-exposed sample, and in addition, displays color loss no greater than FED-STD-595 color 33655.

TABLE II - REQUIREMENTS FOR HIGH BUILD ACRYLIC COATINGS (HBAC)	
TEST	MINIMUM REQUIREMENT (AND MAXIMUM WHERE INDICATED)
(2) Using double-stick, foam mounting tape (or equal) with a nominal thickness of 65 mils, apply a rectangular mold with inner dimensions of 3 in by 10 in to a clean aluminum sample approximately sized at 6 in by 12 in by 1/8 in. Do not remove the tape's plastic backing. Mix and apply excess paint into mold. Remove excess paint, by squeegee or other appropriate draw down technique, to a uniform thickness equal to the tape's height. Paint application and draw down shall be performed within a period of no more than 60 seconds. Approximately one to two minutes following the draw down, remove tape from sample and allow coating to cure for a minimum period of one week ASTM D3924. Using a micrometer or other appropriate device, measure cured coating thickness (less sample thickness) to confirm resulting coating application was at or above 38 mils DFT. Inspect coating for visual signs of cracking and curling. Following a one week cure, coating shall receive a passing rating if applied greater than 38 mils DFT and visually free of both cracking and curling.	

TABLE III - PREAPPROVED HBACs	
MANUFACTURER	PRODUCTS
TMT-Pathway 1021 North Mission Road Los Angeles, CA 90033 (800) 338-7680	Legend Build, #2712A9, White
	Legend Build, #2713A9, Yellow
Pervo Paints 6624 Stanford Avenue Los Angeles, CA 90001 (323) 758-1147	Pervo 6050, White
	Pervo 6053, Yellow
Vogel Traffic Services 1920 Albany Place South PO Box 140 Orange City, IA 51041 (712) 737-4016	UC-1516, White
	UC-3588, Yellow

2.2.3 Reflective Media

2.2.3.1 Reflective Media for Roads

FS TT-B-1325, Type I, Gradation A or Type IV, Gradation A or B .

PART 3 EXECUTION

3.1 EXAMINATION

3.1.1 Testing for Moisture

Test the pavement surface for moisture before beginning pavement marking after each period of rainfall, fog, high humidity, or cleaning, or when the ambient temperature has fallen below the dew point. Do not commence marking until the pavement is sufficiently dry and the pavement condition has been approved by the Contracting Officer or authorized representative.

Employ the "plastic wrap method" to test the pavement for moisture as follows: Cover the pavement with a 12 inch by 12 inch section of clear plastic wrap and seal the edges with tape. After 15 minutes, examine the plastic wrap for any visible moisture accumulation inside the plastic. Do not begin marking operations until the test can be performed with no visible moisture accumulation inside the plastic wrap. Re-test surfaces when work has been stopped due to rain.

3.1.2 Surface Preparation Demonstration

Prior to surface preparation, demonstrate the proposed procedures and equipment. Prepare areas large enough to determine, adhesion of remaining coating and rate of cleaning. Perform a demonstration removal of pavement marking in an area designated by the Contracting Officer.

3.1.3 Test Stripe Demonstration

Prior to paint application, demonstrate test stripe application within the work area using the proposed materials and equipment. Apply separate test stripes in each of the line widths and configurations required herein using the proposed equipment. Make the test stripes long enough to determine the proper speed and operating pressures for the vehicle(s) and machinery, but not less than 50 feet long.

3.1.4 Application Rate Demonstration

During the Test Stripe Demonstration, demonstrate compliance with the application rates specified herein. Document the equipment speed and operating pressures required to meet the specified rates in each configuration of the equipment and provide a copy of the documentation to the Contracting Officer prior to proceeding with the work.

3.1.5 Retroreflective Value Demonstration

After the test stripes have cured to a "no-track" condition, demonstrate compliance with the average retroreflective values specified herein. Take a minimum of ten readings on each test stripe with a Retroreflectometer with a direct readout in millicandelas per square meter per lux (mcd/m2/lx). Conform testing per ASTM D4061, ASTM E1710, ASTM E2177, and ASTM E2302.

3.1.6 Level of Performance Demonstration

The Contracting Officer will be present at the application demonstrations to observe the results obtained and to validate the operating parameters of the vehicle(s) and equipment. If accepted by the Contracting Officer, the test stripe is the measure of performance required for this project.

Do not proceed with the work until the demonstration results are satisfactory to the Contracting Officer.

3.2 EXTERIOR SURFACE PREPARATION

Allow new pavement surfaces to cure for a period of not less than 30 days before application of marking materials. Thoroughly clean surfaces to be marked before application of the paint. Remove dust, dirt, and other granular surface deposits by sweeping, blowing with compressed air, rinsing with water, or a combination of these methods as required. Remove rubber deposits, existing paint markings, residual curing compounds, and other coatings adhering to the pavement by water blasting according to the removal requirements.

a. For Portland Cement Concrete pavement, grinding, or light scarification, to a resulting profile equal to ICRI 03732 CSP 2, CSP 3, and CSP 4, respectively, can be used in addition to water blasting on most pavements, to either remove existing coatings, or for surface preparation.

3.2.1 Early Painting of Rigid Pavements

Pretreat rigid pavements that require early painting with an aqueous solution containing 3 percent phosphoric acid and 2 percent zinc chloride. Apply the solution to the areas to be marked.

3.2.2 Early Painting of Asphalt Pavements

For asphalt pavement systems requiring painting application at less than 30 days, apply the paint and beads at half the normal application rate, followed by a second application at the normal rate after 30 days.

3.3 APPLICATION

Apply pavement markings to dry pavements only.

3.3.1 Paint

Apply paint pneumatically with approved equipment at rate of coverage specified herein. Provide guidelines and templates as necessary to control paint application. Take special precautions in marking numbers, letters, and symbols. Manually paint numbers, letters, and symbols. Sharply outline all edges of markings. The maximum drying time requirements of the paint specifications will be strictly enforced, to prevent undue softening of bitumen, and pickup, displacement, or discoloration by tires of traffic. If there is a deficiency in drying of the markings, painting operations must cease until the cause of the slow drying is determined and corrected.

3.3.1.1 Waterborne Paint

3.3.1.1.1 Roads

Apply paint at a rate of 105 plus or minus 5 square feet per gallon. Apply FS TT-B-1325 Type I (Gradation A) beads at a rate of 7 plus or minus 0.5 pounds of glass spheres per gallon.

3.3.1.2 High Build Acrylic Coating

Apply High Build Acrylic Coating (HBAC) at a rate of 50 square feet per gallon. Apply Type IV (Gradation A) beads at a minimum rate of 16 pounds of glass spheres per gallon.

3.3.2 Raised Pavement Markers

Align prefabricated markers carefully at the spacing indicated on the drawings and permanently fix in place by means of epoxy adhesives. To ensure good bond prior to applying adhesive, thoroughly clean all areas where markers are to be set by water blasting and use of compressed air.

3.3.3 Preformed Tape

The pavement surface and ambient air temperature must be a minimum of 60 degrees F and rising. Place the preformed markings in accordance with the manufacturer's written instructions.

3.3.4 Cleanup and Waste Disposal

Keep the worksite clean and free of debris and waste from the removal and application operations. Dispose of debris at approved sites.

3.4 FIELD QUALITY CONTROL

3.4.1 Sampling and Testing

As soon as the paint materials and reflective media are available for sampling, obtain by random selection from the sealed containers, two quart samples of each batch in the presence of the Contracting Officer. Accomplish adequate mixing prior to sampling to ensure a uniform, representative sample. A batch is defined as that quantity of material processed by the manufacturer at one time and identified by number on the label. Clearly identify samples by designated name, specification number, batch number, project contract number, intended use, and quantity involved.

Test samples by an approved laboratory. If a sample fails to meet specification, replace the material in the area represented by the samples and retest the replacement material as specified above. Submit certified copies of the test reports, prior to the use of the materials at the jobsite. Include in the report of test results a listing of any specification requirements not verified by the test laboratory. At the discretion of the Contracting Officer, samples provided may be tested by the Government for verification.

3.4.2 Material Inspection

Examine material at the job site to determine that it is the material referenced in the report of test results or certificate of compliance. A certificate of compliance shall be accompanied by test results substantiating conformance to the specified requirements.

3.4.3 Dimensional Tolerances

Apply all markings in the standard dimensions provide in the drawings. New markings may deviate a maximum of 10 percent larger than the standard dimension. The maximum deviation allowed when painting over an old marking is up to 20 percent larger than the standard dimensions.

3.4.4 Bond Failure Verification

Inspect newly applied markings for signs of bond failure based on visual inspection and comparison to results from Test Stripe Demonstration paragraph.

3.4.5 Reflective Media and Coating Application Verification

Use a wet film thickness gauge to measure the application of wet paint. Use a microscope or magnifying glass to evaluate the embedment of glass beads in the paint. Verify the glass bead embedment with approximately 50 percent of the individual bead spheres embedded and 50 percent of the individual bead spheres exposed.

3.4.6 Retroreflective Markings

Collect and record readings for white and yellow retroreflective markings at the rate of one reading per 1000 linear feet. The minimum acceptable average for white markings is 200 millicandelas per square meter per lux (mcd/m2/lx) (measured with Retroreflectometer). The minimum acceptable average for yellow markings is 175 millicandelas per square meter per lux (mcd/m2/lx). Compute readings by averaging a minimum of 10 readings taken within the area at random locations. Re-mark areas not meeting the retroreflective requirements stated above.

-- End of Section --

SECTION 32 92 23

SODDING
04/06

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only. Publications used shall be the most current issue.

ASTM INTERNATIONAL (ASTM)

ASTM C602	(2020) Agricultural Liming Materials
ASTM D4427	(2018) Standard Classification of Peat Samples by Laboratory Testing
ASTM D4972	(2018) Standard Test Methods for pH of Soils

TURFGRASS PRODUCERS INTERNATIONAL (TPI)

TPI GSS	(1995) Guideline Specifications to Turfgrass Sodding

U.S. DEPARTMENT OF AGRICULTURE (USDA)

DOA SSIR 42	(1996) Soil Survey Investigation Report No. 42, Soil Survey Laboratory Methods Manual, Version 3.0

1.2 DEFINITIONS

1.2.1 Stand of Turf

100 percent ground cover of the established species.

1.3 RELATED REQUIREMENTS

Section 31 00 00 EARTHWORK applies to this section for pesticide use and plant establishment requirements, with additions and modifications herein.

1.4 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. The following shall be submitted in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-03 Product Data

Fertilizer

Include physical characteristics, and recommendations.

SD-06 Test Reports

Topsoil composition tests (reports and recommendations).

SD-07 Certificates

Sod farm certification for sods. Indicate type of sod in accordance with TPI GSS.

1.5 DELIVERY, STORAGE, AND HANDLING

1.5.1 Delivery

1.5.1.1 Sod Protection

Protect from drying out and from contamination during delivery, on-site storage, and handling.

1.5.1.2 Fertilizer and Lime Delivery

Deliver to the site in original, unopened containers bearing manufacturer's chemical analysis, name, trade name, trademark, and indication of conformance to state and federal laws. Instead of containers, fertilizer and lime may be furnished in bulk with certificate indicating the above information.

1.5.2 Storage

1.5.2.1 Sod Storage

Lightly sprinkle with water, cover with moist burlap, straw, or other approved covering; and protect from exposure to wind and direct sunlight until planted. Provide covering that will allow air to circulate so that internal heat will not develop. Do not store sod longer than 24 hours. Do not store directly on concrete or bituminous surfaces.

1.5.2.2 Topsoil

Clear and grub existing vegetation three to four weeks prior to stockpiling topsoil.

1.5.2.3 Handling

Do not drop or dump materials from vehicles.

1.6 TIME RESTRICTIONS AND PLANTING CONDITIONS

1.6.1 Restrictions

Do not plant when the ground is muddy, or when air temperature exceeds 90 degrees Fahrenheit.

1.7 TIME LIMITATIONS

1.7.1 Sod

Place sod a maximum of thirty six hours after initial harvesting, in

accordance with TPI GSS as modified herein.

PART 2 PRODUCTS

2.1 SODS

2.1.1 Classification

Nursery grown, certified as classified in the TPI GSS. Machine cut sod at a uniform thickness of 3/4 inch within a tolerance of 1/4 inch, excluding top growth and thatch. Each individual sod piece shall be strong enough to support its own weight when lifted by the ends. Broken pads, irregularly shaped pieces, and torn or uneven ends will be rejected.Wood pegs and wire staples for anchorage shall be as recommended by sod supplier.

2.1.2 Purity

Sod species shall be genetically pure, free of weeds, pests, and disease.

2.1.3 Planting Dates

Lay sod from February to August for warm season spring planting and from September to November for cool season fall planting.

2.1.4 Composition

2.1.4.1 Proportion

Proportion grass species as indicated on plans.

2.2 TOPSOIL

2.2.1 On-Site Topsoil

Surface soil stripped and stockpiled on site and modified as necessary to meet the requirements specified for topsoil in paragraph entitled "Composition." When available topsoil shall be existing surface soil stripped and stockpiled on-site in accordance with Section 31 00 00 EARTHWORK.

2.2.2 Off-Site Topsoil

Conform to requirements specified in paragraph entitled "Composition." Additional topsoil shall be furnished by the Contractor, if required.

2.2.3 Composition

Containing from 5 to 10 percent organic matter as determined by the topsoil composition tests of the Organic Carbon, 6A, Chemical Analysis Method described in DOA SSIR 42. Maximum particle size, 3/4 inch, with maximum 3 percent retained on 1/4 inch screen. The pH shall be tested in accordance with ASTM D4972. Topsoil shall be free of sticks, stones, roots, and other debris and objectionable materials. Other components shall conform to the following limits:

Silt	7 to 17 percent
Clay	4 to 12 percent
Sand	70 to 82 percent
pH	5.5 to 7.0
Soluble Salts	600 ppm maximum

2.3 SOIL CONDITIONERS

Add conditioners to topsoil as required to bring into compliance with "composition" standard for topsoil as specified herein.

2.3.1 Lime

Commercial grade hydrate or burnt limestone containing a calcium carbonate equivalent (C.C.E.) as specified in ASTM C602 of not less than 110 percent.

2.3.2 Iron

100 percent elemental

2.3.3 Peat

Natural product of peat moss derived from a freshwater site and conforming to ASTM D4427. Shred and granulate peat to pass a 1/2 inch mesh screen and condition in storage pile for minimum 6 months after excavation.

2.3.4 Sand

Clean and free of materials harmful to plants.

2.3.5 Perlite

Horticultural grade.

2.3.6 Composted Derivatives

Ground bark, nitrolized sawdust, humus or other green wood waste material free of stones, sticks, and soil stabilized with nitrogen and having the following properties:

2.3.6.1 Particle Size

Minimum percent by weight passing:

No. 4 mesh screen	95
No. 8 mesh screen	80

2.3.6.2 Nitrogen Content

Minimum percent based on dry weight:

Fir Sawdust	0.7
Fir or Pine Bark	1.0

2.4 FERTILIZER

2.4.1 Granular Fertilizer

Synthetic, granular controlled release fertilizer containing the following minimum percentages, by weight, of plant food nutrients:

12 percent available nitrogen
8 percent available phosphorus
8 percent available potassium

2.5 WATER

Source of water shall be approved by Contracting Officer and of suitable quality for irrigation containing no element toxic to plant life.

PART 3 EXECUTION

3.1 PREPARATION

3.1.1 Extent Of Work

Provide soil preparation (including soil conditioners), fertilizing, and sodding of all newly graded finished earth surfaces, unless indicated otherwise, and at all areas inside or outside the limits of construction that are disturbed by the Contractor's operations.

3.1.2 Soil Preparation

Provide 4 inches of topsoil to meet indicated finish grade. After areas have been brought to indicated finish grade, incorporate fertilizer pH adjusters and soil conditioners into soil a minimum depth of 3 inches by disking, harrowing, tilling or other method approved by the Contracting Officer. Remove debris and stones larger than 3/4 inch in any dimension remaining on the surface after finish grading. Correct irregularities in finish surfaces to eliminate depressions. Protect finished topsoil areas from damage by vehicular or pedestrian traffic.

3.1.2.1 Soil Conditioner and Fertilizer Application Rates

Apply soil conditioners at rates as determined by laboratory soil analysis of the soils at the job site.

3.2 SODDING

3.2.1 Finished Grade and Topsoil

Prior to the commencement of the sodding operation, the Contractor shall verify that finished grades are as indicated on drawings; the placing of topsoil, smooth grading, and compaction requirements have been completed in accordance with Section 31 00 00 EARTHWORK.

The prepared surface shall be a maximum 1 inch below the adjoining grade of any surfaced area. New surfaces shall be blended to existing areas. The prepared surface shall be completed with a light raking to remove from the surface debris and stones over a minimum 5/8 inch in any dimension.

3.2.2 Placing

Place sod a maximum of 36 hours after initial harvesting, in accordance with TPI GSS as modified herein.

3.2.3 Sodding Slopes and Ditches

For slopes 2:1 and greater, lay sod with long edge perpendicular to the contour. For V-ditches and flat bottomed ditches, lay sod with long edge perpendicular to flow of water. Anchor each piece of sod with wood pegs or wire staples maximum 2 feet on center. On slope areas, start sodding at bottom of the slope.

3.2.4 Finishing

After completing sodding, blend edges of sodded area smoothly into surrounding area. Air pockets shall be eliminated and a true and even surface shall be provided. Frayed edges shall be trimmed and holes and missing corners shall be patched with sod.

3.2.5 Rolling

Immediately after sodding, firm entire area except for slopes in excess of 3 to 1 with a roller not exceeding 90 pounds for each foot of roller width.

3.2.6 Watering

Start watering areas sodded as required by daily temperature and wind conditions. Apply water at a rate sufficient to ensure thorough wetting of soil to minimum depth of 4 inches. Run-off, puddling, and wilting shall be prevented. Unless otherwise directed, watering trucks shall not be driven over turf areas. Watering of other adjacent areas or plant material shall be prevented.

Water sufficiently to ensure that sod receives at least 2 inches of water per week (including rainfall). Continue watering until sod is well-rooted. Minimum watering time shall be sixty (60) days from placement.

3.3 PROTECTION OF TURF AREAS

Immediately after turfing, protect area against traffic and other use.

3.4 ESTABLISHMENT PERIOD

Contractor shall monitor and maintain sod until such time that all sod is well-rooted and no bare spots exist exceeding 1 square foot in dimension. All rills and areas of erosion shall be promptly repaired during the maintenance period. Monitoring period shall be a minimum of sixty (60) days following installation. -- End of Section --

SECTION 33 11 00

WATER UTILITY DISTRIBUTION PIPING

PART 1 GENERAL

American States Utility Services, Inc. (ASUS) requirements and specifications shall govern the construction of Water Utility Distribution Piping related components. See ASUS specifications.

-- End of Section --

SECTION 33 30 00

SANITARY SEWERS

PART 1 GENERAL

1.1 SUMMARY

1.1.1 Sanitary Sewer

American States Utility Services, Inc. (ASUS) requirements and specifications shall govern the construction of Sanitary Sewer related components. See ASUS specifications attached.

-- End of Section --

SECTION 33 40 00

STORM DRAINAGE UTILITIES
02/10

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO M 294	(2021) Standard Specification for Corrugated Polyethylene Pipe, 300- to 1500-mm (12- to 60-in.) Diameter

ASTM INTERNATIONAL (ASTM)

ASTM A48/A48M	(2003; R 2021) Standard Specification for Gray Iron Castings
ASTM A536	(1984; R 2019; E 2019) Standard Specification for Ductile Iron Castings
ASTM B26/B26M	(2018; E 2018) Standard Specification for Aluminum-Alloy Sand Castings
ASTM C1433	(2020) Standard Specification for Precast Reinforced Concrete Monolithic Box Sections for Culverts, Storm Drains, and Sewers
ASTM C425	(2021) Standard Specification for Compression Joints for Vitrified Clay Pipe and Fittings
ASTM C443	(2021) Standard Specification for Joints for Concrete Pipe and Manholes, Using Rubber Gaskets
ASTM C478	(2018) Standard Specification for Circular Precast Reinforced Concrete Manhole Sections
ASTM C76	(2020) Standard Specification for Reinforced Concrete Culvert, Storm Drain, and Sewer Pipe
ASTM C877	(2021) Standard Specification for External Sealing Bands for Concrete Pipe, Manholes, and Precast Box Sections
ASTM C923	(2008; R 2013; E 2016) Standard

	Specification for Resilient Connectors Between Reinforced Concrete Manhole Structures, Pipes and Laterals
ASTM C990	(2009; R 2019) Standard Specification for Joints for Concrete Pipe, Manholes, and Precast Box Sections Using Preformed Flexible Joint Sealants
ASTM D1056	(2020) Standard Specification for Flexible Cellular Materials - Sponge or Expanded Rubber
ASTM D1171	(2018) Standard Test Method for Rubber Deterioration - Surface Ozone Cracking Outdoors (Triangular Specimens)
ASTM D1557	(2012; E 2015) Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft3) (2700 kN-m/m3)
ASTM D1784	(2020) Standard Specification for Rigid Poly(Vinyl Chloride) (PVC) Compounds and Chlorinated Poly(Vinyl Chloride) (CPVC) Compounds
ASTM D2167	(2015) Density and Unit Weight of Soil in Place by the Rubber Balloon Method
ASTM D2321	(2020) Standard Practice for Underground Installation of Thermoplastic Pipe for Sewers and Other Gravity-Flow Applications
ASTM D3034	(2016) Standard Specification for Type PSM Poly(Vinyl Chloride) (PVC) Sewer Pipe and Fittings
ASTM D6938	(2017a) Standard Test Method for In-Place Density and Water Content of Soil and Soil-Aggregate by Nuclear Methods (Shallow Depth)
ASTM F477	(2014; R 2021) Standard Specification for Elastomeric Seals (Gaskets) for Joining Plastic Pipe

1.2 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for Contractor Quality Control approval. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-04 Samples

Pipe for Culverts and Storm Drains

SD-07 Certificates

Resin Certification

Oil Resistant Gasket

Determination of Density

Frame and Cover for Gratings

SD-08 Manufacturer's Instructions

Placing Pipe

1.3 DELIVERY, STORAGE, AND HANDLING

1.3.1 Delivery and Storage

Materials delivered to site shall be inspected for damage, unloaded, and stored with a minimum of handling. Materials shall not be stored directly on the ground. The inside of pipes and fittings shall be kept free of dirt and debris. Before, during, and after installation, plastic pipe and fittings shall be protected from any environment that would result in damage or deterioration to the material. Keep a copy of the manufacturer's instructions available at the construction site at all times and follow these instructions unless directed otherwise by the Contracting Officer. Solvents, solvent compounds, lubricants, elastomeric gaskets, and any similar materials required to install plastic pipe shall be stored in accordance with the manufacturer's recommendations and shall be discarded if the storage period exceeds the recommended shelf life. Solvents in use shall be discarded when the recommended pot life is exceeded.

1.3.2 Handling

Materials shall be handled in a manner that ensures delivery to the trench in sound, undamaged condition. Pipe shall be carried to the trench, not dragged.

PART 2 PRODUCTS

2.1 PIPE FOR CULVERTS AND STORM DRAINS

Pipe for culverts and storm drains shall be of the sizes indicated and shall conform to the requirements specified.

2.1.1 Concrete Pipe (If required)

Manufactured in accordance with and conforming to ASTM C76, Class III.

2.1.2 Poly Vinyl Chloride (PVC) Pipe

PVC pipe and fittings may be used for roof leader collection system. Submit the pipe manufacturer's resin certification, indicating the cell classification of PVC used to manufacture the pipe, prior to installation of the pipe.

2.1.2.1 Type PSM PVC Pipe

ASTM D3034, Type PSM, maximum SDR 35, produced from PVC certified by the Manufacturer as meeting the requirements of ASTM D1784, minimum cell class 12454-B.

2.1.3 Polyethylene (PE) Pipe

2.1.3.1 Corrugated PE Pipe (Double Wall)

AASHTO M 294, Type S. For slow crack growth resistance, acceptance of resins shall be determined by using the notched constant ligament-stress (NCLS) test meeting the requirements of AASHTO M 294. Pipe walls shall have minimum OD (inch) 22 inches for 18 inch nominal pipe and 28 inches for 24 inch nominal pipe.

2.2 DRAINAGE STRUCTURES

2.2.1 Precast Reinforced Concrete Box

Manufactured in accordance with and conforming to ASTM C1433.

2.3 MISCELLANEOUS MATERIALS

2.3.1 Precast Reinforced Concrete Manholes

Conform to ASTM C478. Joints between precast concrete risers and tops shall be made with flexible watertight, rubber-type gaskets meeting the requirements of paragraph JOINTS.

2.3.2 Frame and Cover for Gratings

Submit certification on the ability of frame and cover or gratings to carry the imposed live load. Frame and cover for gratings shall be cast gray iron, ASTM A48/A48M, Class 35B; cast ductile iron, ASTM A536, Grade 65-45-12; or cast aluminum, ASTM B26/B26M, Alloy 356.O-T6. Weight, shape, size, and waterway openings for grates and curb inlets shall be as indicated on the plans. The word "Storm Sewer" shall be stamped or cast into covers so that it is plainly visible.

2.3.3 Joints

2.3.3.1 Flexible Watertight Joints

a. Flexible watertight joints shall be made with plastic or rubber-type gaskets for concrete pipe and with factory-fabricated resilient materials for clay pipe. The design of joints and the physical requirements for preformed flexible joint sealants shall conform to ASTM C990, and rubber-type gaskets shall conform to ASTM C443. Factory-fabricated resilient joint materials shall conform to ASTM C425. Gaskets shall have not more than one factory-fabricated splice, except that two factory-fabricated splices of the rubber-type gasket are permitted if the nominal diameter of the pipe being gasketed exceeds 54 inches.

b. Rubber gaskets shall comply with the oil resistant gasket requirements of ASTM C443. Certified copies of test results shall be delivered to the Contracting Officer before gaskets or jointing materials are installed. Alternate types of watertight joint may be furnished, if

specifically approved.

2.3.3.2 External Sealing Bands

Requirements for external sealing bands shall conform to ASTM C877.

2.3.3.3 Flexible Watertight, Gasketed Joints

a. Gaskets: When infiltration or exfiltration is a concern for pipe lines, the couplings may be required to have gaskets. The closed-cell expanded rubber gaskets shall be a continuous band approximately 7 inches wide and approximately 3/8 inch thick, meeting the requirements of ASTM D1056, Type 2, and shall have a quality retention rating of not less than 70 percent when tested for weather resistance by ozone chamber exposure, Method B of ASTM D1171. Rubber O-ring gaskets shall be 13/16 inch in diameter for pipe diameters of 36 inches or smaller and 7/8 inch in diameter for larger pipe having 1/2 inch deep end corrugation. Rubber O-ring gaskets shall be 1-3/8 inches in diameter for pipe having 1 inch deep end corrugations. O-rings shall meet the requirements of ASTM C990 or ASTM C443. Preformed flexible joint sealants shall conform to ASTM C990, Type B.

2.3.3.4 PVC Plastic Pipes

Joints shall be solvent cement or elastomeric gasket type in accordance with the specification for the pipe and as recommended by the pipe manufacturer.

2.3.3.5 Corrugated PE Plastic Pipe

Pipe joints shall be water tight and shall conform to the requirements in AASHTO M 294. Water tight joints shall be made using a PE coupling and rubber gaskets as recommended by the pipe manufacturer. Rubber gaskets shall conform to ASTM F477.

2.4 RESILIENT CONNECTORS

Flexible, watertight connectors used for connecting pipe to manholes and inlets shall conform to ASTM C923.

2.5 EROSION CONTROL RIP RAP

Provide non-erodible rock not exceeding 15 inches in its greatest dimension and choked with sufficient small rocks to provide a dense mass with a minimum thickness of 8 inches.

PART 3 EXECUTION

3.1 INSTALLATION OF PIPE CULVERTS, STORM DRAINS, AND DRAINAGE STRUCTURES

Excavation of trenches, and for appurtenances and backfilling for culverts and storm drains, shall be in accordance with the applicable portions of Section 31 00 00 EARTHWORK,.

3.1.1 Trenching

The width of trenches at any point below the top of the pipe shall be not greater than the outside diameter of the pipe plus 12 inches to permit satisfactory jointing and thorough tamping of the bedding material under

and around the pipe. Sheeting and bracing, where required, shall be placed within the trench width as specified, without any overexcavation. Where trench widths are exceeded, redesign with a resultant increase in cost of stronger pipe or special installation procedures will be necessary. Cost of this redesign and increased cost of pipe or installation shall be borne by the Contractor without additional cost to the Government.

3.1.2 Removal of Rock

Rock in either ledge or boulder formation shall be replaced with suitable materials to provide a compacted earth cushion having a thickness between unremoved rock and the pipe of at least 8 inches or 1/2 inch for each foot of fill over the top of the pipe, whichever is greater, but not more than three-fourths the nominal diameter of the pipe. Where bell-and-spigot pipe is used, the cushion shall be maintained under the bell as well as under the straight portion of the pipe. Rock excavation shall be as specified and defined in Section 31 00 00 EARTHWORK.

3.1.3 Removal of Unstable Material

Where wet or otherwise unstable soil incapable of properly supporting the pipe, as determined by the Contracting Officer, is unexpectedly encountered in the bottom of a trench, such material shall be removed to the depth required and replaced to the proper grade with select granular material, compacted as provided in paragraph BACKFILLING. When removal of unstable material is due to the fault or neglect of the Contractor while performing shoring and sheeting, water removal, or other specified requirements, such removal and replacement shall be performed at no additional cost to the Government.

3.2 BEDDING

The bedding surface for the pipe shall provide a firm foundation of uniform density throughout the entire length of the pipe.

3.2.1 Concrete Pipe Requirements

When no bedding class is specified or detailed on the drawings, concrete pipe shall be bedded in granular material minimum 4 inch in depth in trenches with soil foundation. Depth of granular bedding in trenches with rock foundation shall be 1/2 inch in depth per foot of depth of fill, minimum depth of bedding shall be 8 inch up to maximum depth of 24 inches. The middle third of the granular bedding shall be loosely placed. Bell holes and depressions for joints shall be removed and formed so entire barrel of pipe is uniformly supported. The bell hole and depressions for the joints shall be not more than the length, depth, and width required for properly making the particular type of joint.

3.2.2 Plastic Pipe

Bedding for PVC and PEpipe shall meet the requirements of ASTM D2321. Use Class IB or II material for bedding, haunching, and initial backfill. Use Class I, II, or III material for PP pipe bedding, haunching and initial backfill.

3.3 PLACING PIPE

Each pipe shall be thoroughly examined before being laid; defective or

damaged pipe shall not be used. Plastic pipe, excluding SRPE pipe shall be protected from exposure to direct sunlight prior to laying, if necessary to maintain adequate pipe stiffness and meet installation deflection requirements. Pipelines shall be laid to the grades and alignment indicated. Proper facilities shall be provided for lowering sections of pipe into trenches. Lifting lugs in vertically elongated pipe shall be placed in the same vertical plane as the major axis of the pipe. Pipe shall not be laid in water, and pipe shall not be laid when trench conditions or weather are unsuitable for such work. Diversion of drainage or dewatering of trenches during construction shall be provided as necessary. Deflection of installed flexible pipe shall not exceed the following limits:

TYPE OF PIPE	MAXIMUM ALLOWABLE DEFLECTION (percent)
Plastic PVC or PE	5

Note post installation requirements of paragraph DEFLECTION TESTING in PART 3 of this specification for all pipe products including deflection testing requirements for flexible pipe.

3.3.1 Concrete, PVC, Pipe

Laying shall proceed upgrade with spigot ends of bell-and-spigot pipe and tongue ends of tongue-and-groove pipe pointing in the direction of the flow.

3.4 JOINTING

3.4.1 Concrete Pipe

3.4.1.1 Flexible Watertight Joints

Gaskets and jointing materials shall be as recommended by the particular manufacturer in regard to use of lubricants, cements, adhesives, and other special installation requirements. Surfaces to receive lubricants, cements, or adhesives shall be clean and dry. Gaskets and jointing materials shall be affixed to the pipe not more than 24 hours prior to the installation of the pipe, and shall be protected from the sun, blowing dust, and other deleterious agents at all times. Gaskets and jointing materials shall be inspected before installing the pipe; any loose or improperly affixed gaskets and jointing materials shall be removed and replaced. The pipe shall be aligned with the previously installed pipe, and the joint pushed home. If, while the joint is being made the gasket becomes visibly dislocated the pipe shall be removed and the joint remade.

3.5 DRAINAGE STRUCTURES

3.5.1 Manholes and Inlets

Construction shall be of reinforced concrete, plain concrete, brick, precast reinforced concrete, precast concrete segmental blocks, prefabricated corrugated metal, or bituminous coated corrugated metal; complete with frames and covers or gratings; and with fixed galvanized steel ladders where indicated. Pipe studs and junction chambers of prefabricated corrugated metal manholes shall be fully bituminous-coated and paved when the connecting branch lines are so treated. Pipe connections to concrete manholes and inlets shall be made with flexible,

watertight connectors.

3.5.2 Walls and Headwalls

Construction shall be as indicated.

3.6 BACKFILLING

3.6.1 Backfilling Pipe in Trenches

After the pipe has been properly bedded, selected material from excavation or borrow, at a moisture content that will facilitate compaction, shall be placed along both sides of pipe in layers not exceeding 6 inches in compacted depth. The backfill shall be brought up evenly on both sides of pipe for the full length of pipe. The fill shall be thoroughly compacted under the haunches of the pipe. Each layer shall be thoroughly compacted with mechanical tampers or rammers. This method of filling and compacting shall continue until the fill has reached an elevation equal to the midpoint (spring line) of concrete pipe or has reached an elevation of at least 12 inches above the top of the pipe for flexible pipe. The remainder of the trench shall be backfilled and compacted by spreading and rolling or compacted by mechanical rammers or tampers in layers not exceeding 12 inches. Tests for density shall be made as necessary to ensure conformance to the compaction requirements specified below. Where it is necessary, in the opinion of the Contracting Officer, that sheeting or portions of bracing used be left in place, the contract will be adjusted accordingly. Untreated sheeting shall not be left in place beneath structures or pavements.

3.6.2 Movement of Construction Machinery

When compacting by rolling or operating heavy equipment parallel with the pipe, displacement of or injury to the pipe shall be avoided. Movement of construction machinery over a culvert or storm drain at any stage of construction shall be at the Contractor's risk. Any damaged pipe shall be repaired or replaced.

3.6.3 Compaction

3.6.3.1 General Requirements

Cohesionless materials include gravels, gravel-sand mixtures, sands, and gravelly sands. Cohesive materials include clayey and silty gravels, gravel-silt mixtures, clayey and silty sands, sand-clay mixtures, clays, silts, and very fine sands. When results of compaction tests for moisture-density relations are recorded on graphs, cohesionless soils will show straight lines or reverse-shaped moisture-density curves, and cohesive soils will show normal moisture-density curves.

3.6.3.2 Minimum Density

Backfill over and around the pipe and backfill around and adjacent to drainage structures shall be compacted at the approved moisture content to the following applicable minimum density, which will be determined as specified below.

a. Under paved roads, streets, parking areas, and similar-use pavements including adjacent shoulder areas, the density shall be not less than 90 percent of maximum density for cohesive material and 95 percent of

maximum density for cohesionless material, up to the elevation where requirements for pavement subgrade materials and compaction shall control.

b. Under unpaved or turfed traffic areas, density shall not be less than 90 percent of maximum density for cohesive material and 95 percent of maximum density for cohesionless material.

c. Under nontraffic areas, density shall be not less than that of the surrounding material.

3.7 FIELD QUALITY CONTROL

3.7.1 Tests

Testing is the responsibility of the Contractor. Perform all testing and retesting at no additional cost to the Government.

3.7.1.1 Determination of Density

Testing shall be performed by an approved commercial testing laboratory or by the Contractor subject to approval. Tests shall be performed in sufficient number to ensure that specified density is being obtained. Laboratory tests for moisture-density relations shall be made in accordance with ASTM D1557 except that mechanical tampers may be used provided the results are correlated with those obtained with the specified hand tamper. Field density tests shall be determined in accordance with ASTM D2167 or ASTM D6938. When ASTM D6938 is used, the calibration curves shall be checked and adjusted, if necessary, using the sand cone method as described in paragraph Calibration of the referenced publications. ASTM D6938 results in a wet unit weight of soil and ASTM D6938 shall be used to determine the moisture content of the soil. The calibration curves furnished with the moisture gauges shall be checked along with density calibration checks as described in ASTM D6938. Test results shall be furnished the Contracting Officer. The calibration checks of both the density and moisture gauges shall be made at the beginning of a job on each different type of material encountered and at intervals as directed.

3.7.2 Inspection

3.7.2.1 Post-Installation Inspection

Visually inspect each segment of concrete pipe for alignment, settlement, joint separations, soil migration through the joint, cracks, buckling, bulging and deflection.

3.7.2.1.1 Concrete

Cracks with a width greater than 0.01 inches. An engineer must evaluate all pipes with cracks with a width greater than 0.01 inches but less than 0.10 inches to determine if any remediation or repair is required.

3.7.2.1.2 Flexible Pipe

Check each flexible pipe (PE or PVC) for rips, tears, joint separations, soil migration through the joint, cracks, localized bucking, bulges, settlement and alignment.

-- End of Section --

SECTION 33 71 02

UNDERGROUND ELECTRICAL DISTRIBUTION
02/15
(FOR UNDERGROUND TELECOMMUNICATIONS INSTALLATION ONLY)

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to within the text by the basic designation only.

AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO)

AASHTO HB-17	(2002; Errata 2003; Errata 2005, 17th Edition) Standard Specifications for Highway Bridges

AMERICAN CONCRETE INSTITUTE INTERNATIONAL (ACI)

ACI 318M	(2014; ERTA 2015) Building Code Requirements for Structural Concrete & Commentary
ACI SP-66	(2004) ACI Detailing Manual

ASTM INTERNATIONAL (ASTM)

ASTM B1	(2013) Standard Specification for Hard-Drawn Copper Wire
ASTM B8	(2011; R 2017) Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
ASTM C309	(2011) Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete
ASTM C478	(2018) Standard Specification for Circular Precast Reinforced Concrete Manhole Sections
ASTM C857	(2016) Standard Practice for Minimum Structural Design Loading for Underground Precast Concrete Utility Structures
ASTM C990	(2009; R 2014) Standard Specification for Joints for Concrete Pipe, Manholes and Precast Box Sections Using Preformed Flexible Joint Sealants

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 81	(2012) Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System
IEEE C2	(2017; Errata 1-2 2017; INT 1 2017) National Electrical Safety Code
IEEE Stds Dictionary	(2009) IEEE Standards Dictionary: Glossary of Terms & Definitions

INTERNATIONAL ELECTRICAL TESTING ASSOCIATION (NETA)

NETA ATS	(2017; Errata 2017) Standard for Acceptance Testing Specifications for Electrical Power Equipment and Systems

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

NEMA TC 2	(2013) Standard for Electrical Polyvinyl Chloride (PVC) Conduit
NEMA TC 9	(2004) Standard for Fittings for Polyvinyl Chloride (PVC) Plastic Utilities Duct for Underground Installation

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2017; ERTA 1-2 2017; TIA 17-1; TIA 17-2; TIA 17-3; TIA 17-4; TIA 17-5; TIA 17-6; TIA 17-7; TIA 17-8; TIA 17-9; TIA 17-10; TIA 17-11; TIA 17-12; TIA 17-13; TIA 17-14; TIA 17-15; TIA 17-16; TIA 17-17) National Electrical Code

TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA)

TIA-758	(2012b) Customer-Owned Outside Plant Telecommunications Infrastructure Standard

U.S. DEPARTMENT OF AGRICULTURE (USDA)

RUS Bull 1751F-644	(2002) Underground Plant Construction

U.S. GENERAL SERVICES ADMINISTRATION (GSA)

CID A-A-60005	(Basic; Notice 2) Frames, Covers, Gratings, Steps, Sump And Catch Basin, Manhole

UNDERWRITERS LABORATORIES (UL)

UL 467	(2013; Reprint Jun 2017) UL Standard for Safety Grounding and Bonding Equipment
UL 510	(2017) UL Standard for Safety Polyvinyl Chloride, Polyethylene and Rubber Insulating Tape

UL 514B	(2012; Reprint Nov 2014) Conduit, Tubing and Cable Fittings
UL 6	(2007; Reprint Nov 2014) Electrical Rigid Metal Conduit-Steel
UL 651	(2011; Reprint Jun 2016) UL Standard for Safety Schedule 40 and 80 Rigid PVC Conduit and Fittings
UL 94	(2013; Reprint Sep 2017) UL Standard for Safety Tests for Flammability of Plastic Materials for Parts in Devices and Appliances

1.2 DEFINITIONS

a. Unless otherwise specified or indicated, electrical and electronics terms used in these specifications, and on the drawings, are as defined in IEEE Stds Dictionary.

b. In the text of this section, the words conduit and duct are used interchangeably and have the same meaning.

1.3 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Precast underground structures; G

SD-03 Product Data

Precast concrete structures; G

Sealing Material

Pulling-In Irons

Manhole frames and covers; G

Handhole frames and covers; G

Cable supports (racks, arms and insulators); G

Field Acceptance Checks and Tests;

Directional Boring Certificate of Conformance;

1.4 QUALITY ASSURANCE

1.4.1 Precast Underground Structures

Submittal required for each type used. Provide calculations and drawings for precast manholes and handholes bearing the seal of a registered professional engineer including:

a. Material description (i.e., f'c and Fy)

b. Manufacturer's printed assembly and installation instructions

c. Design calculations

d. Reinforcing shop drawings in accordance with ACI SP-66

e. Plans and elevations showing opening and pulling-in iron locations and details

1.4.2 Directional Boring Certificate of Conformance

Provide certification of compliance with the registered Professional Engineer's design requirements for each directional bore, including: HDPE conduit size and type, bend radius, elevation changes, vertical and horizontal path deviations, conductor size and type and any conductor derating due to depth of conduit. Record location and depth of all directional-bore installed HDPE conduits using Global Positioning System (GPS) recording means with "resource grade" accuracy.

1.4.3 Regulatory Requirements

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word, "must" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction," or words of similar meaning, to mean the Contracting Officer. Equipment, materials, installation, and workmanship must be in accordance with the mandatory and advisory provisions of IEEE C2 and NFPA 70 unless more stringent requirements are specified or indicated.

1.4.4 Standard Products

Provide materials and equipment that are products of manufacturers regularly engaged in the production of such products which are of equal material, design and workmanship. Products must have been in satisfactory commercial or industrial use for 2 years prior to bid opening. The 2-year period must include applications of equipment and materials under similar circumstances and of similar size. The product must have been for sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the 2-year period. Where two or more items of the same class of equipment are required, these items must be products of a single manufacturer; however, the component parts of the item need not be the products of the same manufacturer unless stated in this section.

1.4.4.1 Alternative Qualifications

Products having less than a 2-year field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturers' factory or laboratory tests,

is furnished.

1.4.4.2 Material and Equipment Manufacturing Date

Products manufactured more than 3 years prior to date of delivery to site are not acceptable, unless specified otherwise.

PART 2 PRODUCTS

2.1 CONDUIT, DUCTS, AND FITTINGS

2.1.1 Rigid Metal Conduit

UL 6.

2.1.2 Plastic Conduit for Direct Burial and Riser Applications

UL 651 and NEMA TC 2, EPC-40.

2.1.3 Plastic Duct for Concrete Encasement

Provide Type EPC-40 per UL 651 and NEMA TC 2.

2.1.4 Innerduct

Provide corrugated or solid wall polyethylene (PE) or PVC innerducts, or fabric-mesh innerducts, with pullwire. Size as indicated.

2.1.5 Duct Sealant

UL 94, Class HBF. Provide high-expansion urethane foam duct sealant that expands and hardens to form a closed, chemically and water resistant, rigid structure. Sealant must be compatible with common cable and wire jackets and capable of adhering to metals, plastics and concrete. Sealant must be capable of curing in temperature ranges of 35 degrees F to 95 degrees F. Cured sealant must withstand temperature ranges of -20 degrees F to 200 degrees F without loss of function.

2.1.6 Fittings

2.1.6.1 Metal Fittings

UL 514B.

2.1.6.2 PVC Conduit Fittings

UL 514B, UL 651.

2.1.6.3 PVC Duct Fittings

NEMA TC 9.

2.2 TELECOMMUNICATIONS CABLING

Provide telecommunications cabling in accordance with Section 33 82 00 TELECOMMUNICATIONS OUTSIDE PLANT (OSP).

2.3 TAPE

2.3.1 Insulating Tape

UL 510, plastic insulating tape, capable of performing in a continuous temperature environment of 80 degrees C.

2.3.2 Buried Warning and Identification Tape

Provide detectable tape.

2.3.3 Fireproofing Tape

Provide tape composed of a flexible, conformable, unsupported intumescent elastomer. Tape must be not less than .030 inch thick, noncorrosive to cable sheath, self-extinguishing, noncombustible, adhesive-free, and must not deteriorate when subjected to oil, water, gases, salt water, sewage, and fungus.

2.4 PULL ROPE

Plastic or flat pull line (bull line) having a minimum tensile strength of 200 pounds.

2.5 GROUNDING AND BONDING

2.5.1 Driven Ground Rods

Provide copper-clad steel ground rods conforming to UL 467 not less than 3/4 inch in diameter by 60 feet in length for service entrance grounding. Sectional type rods may be used for rods 20 feet or longer.

2.5.2 Grounding Conductors

Stranded-bare copper conductors must conform to ASTM B8, Class B, soft-drawn unless otherwise indicated. Solid-bare copper conductors must conform to ASTM B1 for sizes No. 8 and smaller. Insulated conductors must be of the same material as phase conductors and green color-coded, except that conductors must be rated no more than 600 volts. Aluminum is not acceptable.

2.6 CAST-IN-PLACE CONCRETE

Provide concrete for encasement of underground ducts with 3000 psi minimum 28-day compressive strength. Concrete associated with electrical work for other than encasement of underground ducts must be 4000 psi minimum 28-day compressive strength unless specified otherwise.

2.7 UNDERGROUND STRUCTURES

Provide precast concrete underground structures or standard type cast-in-place manhole types as indicated, conforming to ASTM C857 and ASTM C478. Top, walls, and bottom must consist of reinforced concrete. Walls and bottom must be of monolithic concrete construction. Locate duct entrances and windows near the corners of structures to facilitate cable racking. Covers must fit the frames without undue play. Form steel and iron to shape and size with sharp lines and angles. Castings must be free from warp and blow holes that may impair strength or appearance. Exposed metal must have a smooth finish and sharp lines and arises. Provide

necessary lugs, rabbets, and brackets. Set pulling-in irons and other built-in items in place before depositing concrete. Install a pulling-in iron in the wall opposite each duct line entrance. Cable racks, including rack arms and insulators, must be adequate to accommodate the cable.

2.7.1 Precast Concrete Structures, Risers and Tops

Precast concrete underground structures may be provided in lieu of cast-in-place subject to the requirements specified below. Precast units must be the product of a manufacturer regularly engaged in the manufacture of precast concrete products, including precast manholes.

2.7.1.1 General

Precast concrete structures must have the same accessories and facilities as required for cast-in-place structures. Likewise, precast structures must have plan area and clear heights not less than those of cast-in-place structures. Concrete materials and methods of construction must be the same as for cast-in-place concrete construction, as modified herein. Slope in floor may be omitted provided precast sections are poured in reinforced steel forms. Concrete for precast work must have a 28-day compressive strength of not less than 4000 psi. Structures may be precast to the design and details indicated for cast-in-place construction, precast monolithically and placed as a unit, or structures may be assembled sections, designed and produced by the manufacturer in accordance with the requirements specified. Structures must be identified with the manufacturer's name embedded in or otherwise permanently attached to an interior wall face.

2.7.1.2 Design for Precast Structures

ACI 318M. In the absence of detailed on-site soil information, design for the following soil parameters/site conditions:

a. Angle of Internal Friction (phi) = 30 degrees

b. Unit Weight of Soil (Dry) = 110 pcf, (Saturated) = 130 pcf

c. Coefficient of Lateral Earth Pressure (Ka) = 0.33

d. Ground Water Level = 3 feet below ground elevation

e. Vertical design loads must include full dead, superimposed dead, and live loads including a 30 percent magnification factor for impact. Live loads must consider all types and magnitudes of vehicular (automotive, industrial, or aircraft) traffic to be encountered. The minimum design vertical load must be for H20 highway loading per AASHTO HB-17.

f. Horizontal design loads must include full geostatic and hydrostatic pressures for the soil parameters, water table, and depth of installation to be encountered. Also, horizontal loads imposed by adjacent structure foundations, and horizontal load components of vertical design loads, including impact, must be considered, along with a pulling-in iron design load of 6000 pounds.

g. Each structural component must be designed for the load combination and positioning resulting in the maximum shear and moment for

thatparticular component.

h. Design must also consider the live loads induced in the handling, installation, and backfilling of the manholes. Provide lifting devices to ensure structural integrity during handling and installation.

2.7.1.3 Construction

Structure top, bottom, and wall must be of a uniform thickness of not less than 6 inches. Thin-walled knock-out panels for designed or future duct bank entrances are not permitted. Provide quantity, size, and location of duct bank entrance windows as directed, and cast completely open by the precaster. Size of windows must exceed the nominal duct bank envelope dimensions by at least 12 inches vertically and horizontally to preclude in-field window modifications made necessary by duct bank misalignment. However, the sides of precast windows must be a minimum of 6 inches from the inside surface of adjacent walls, floors, or ceilings. Form the perimeter of precast window openings to have a keyed or inward flared surface to provide a positive interlock with the mating duct bank envelope. Provide welded wire fabric reinforcing through window openings for in-field cutting and flaring into duct bank envelopes. Provide additional reinforcing steel comprised of at least two No. 4 bars around window openings. Provide drain sumps a minimum of 12 inches in diameter and 4 inches deep for precast structures.

2.7.1.4 Joints

Provide tongue-and-groove joints on mating edges of precast components. Shiplap joints are not allowed. Design joints to firmly interlock adjoining components and to provide waterproof junctions and adequate shear transfer. Seal joints watertight using preformed plastic strip conforming to ASTM C990. Install sealing material in strict accordance with the sealant manufacturer's printed instructions. Provide waterproofing at conduit/duct entrances into structures, and where access frame meets the top slab, provide continuous grout seal.

2.7.2 Manhole Frames and Covers

Provide cast iron frames and covers for manholes conforming to CID A-A-60005. Cast the words "ELECTRIC" or "TELECOMMUNICATIONS" in the top face of power and telecommunications manhole covers, respectively.

2.7.3 Handhole Frames and Covers

Frames and covers of steel must be welded by qualified welders in accordance with standard commercial practice. Steel covers must be rolled-steel floor plate having an approved antislip surface. Hinges must be of stainless steel with bronze hinge pin, 5 by 5 inches by approximately 3/16 inch thick, without screw holes, and must be for full surface application by fillet welding. Hinges must have nonremovable pins and five knuckles. The surfaces of plates under hinges must be true after the removal of raised antislip surface, by grinding or other approved method.

2.8 CABLE SUPPORTS (RACKS, ARMS, AND INSULATORS)

The metal portion of racks and arms must be zinc-coated after fabrication.

2.8.1 Cable Rack Stanchions

The wall bracket or stanchion must be 4 inches by approximately 1-1/2 inch by 3/16 inch channel steel, or 4 inches by approximately 1 inch glass-reinforced nylon with recessed bolt mounting holes, 48 inches long (minimum) in manholes. Slots for mounting cable rack arms must be spaced at 8 inch intervals.

2.8.2 Rack Arms

Cable rack arms must be steel or malleable iron or glass reinforced nylon and must be of the removable type. Rack arm length must be a minimum of 8 inches and a maximum of 12 inches.

2.8.3 Insulators

Insulators for metal rack arms must be dry-process glazed porcelain. Insulators are not required for nylon arms.

2.9 CABLE TAGS IN MANHOLES

Provide tags for each power cable located in manholes. The tags must be polyethylene. Do not provide handwritten letters. The first position on the power cable tag must denote the voltage. The second through sixth positions on the tag must identify the circuit. The next to last position must denote the phase of the circuit and include the Greek "phi" symbol. The last position must denote the cable size. As an example, a tag could have the following designation: "11.5 NAS 1-8(Phase A)500," denoting that the tagged cable is on the 11.5kV system circuit number NAS 1-8, underground, Phase A, sized at 500 kcmil.

2.9.1 Polyethylene Cable Tags

Provide tags of polyethylene that have an average tensile strength of 3250 pounds per square inch; and that are 0.08 inch thick (minimum), non-corrosive non-conductive; resistive to acids, alkalis, organic solvents, and salt water; and distortion resistant to 170 degrees F. Provide 0.05 inch (minimum) thick black polyethylene tag holder. Provide a one-piece nylon, self-locking tie at each end of the cable tag. Ties must have a minimum loop tensile strength of 175 pounds. The cable tags must have black block letters, numbers, and symbols one inch high on a yellow background. Letters, numbers, and symbols must not fall off or change positions regardless of the cable tags' orientation.

PART 3 EXECUTION

3.1 INSTALLATION

Install equipment and devices in accordance with the manufacturer's published instructions and with the requirements and recommendations of NFPA 70 and IEEE C2 as applicable. In addition to these requirements, install telecommunications in accordance with TIA-758 and RUS Bull 1751F-644.

3.2 UNDERGROUND STRUCTURE CONSTRUCTION

Provide standard type cast-in-place construction as specified herein and as indicated, or precast construction as specified herein. Horizontal concrete surfaces of floors must have a smooth trowel finish. Cure

concrete by applying two coats of white pigmented membrane forming-curing compound in strict accordance with the manufacturer's printed instructions, except that precast concrete may be steam cured. Curing compound must conform to ASTM C309. Locate duct entrances and windows in the center of end walls (shorter) and near the corners of sidewalls (longer) to facilitate cable racking and splicing. Covers for underground structures must fit the frames without undue play. Steel and iron must be formed to shape and size with sharp lines and angles. Castings must be free from warp and blow holes that may impair strength or appearance. Exposed metal must have a smooth finish and sharp lines and arises. Provide necessary lugs, rabbets, and brackets. Set pulling-in irons and other built-in items in place before depositing concrete. Manhole locations, as indicated, are approximate. Coordinate exact manhole locations with other utilities and finished grading and paving.

3.2.1 Precast Concrete Construction

Set commercial precast structures on 6 inches of level, 90 percent compacted granular fill, 3/4 inch to 1 inch size, extending 12 inches beyond the structure on each side. Compact granular fill by a minimum of four passes with a plate type vibrator. Installation must additionally conform to the manufacturer's instructions.

3.2.2 Pulling-In Irons

Provide steel bars bent as indicated, and cast in the walls and floors. Alternatively, pipe sleeves may be precast into the walls and floors where required to accept U-bolts or other types of pulling-in devices possessing the strengths and clearances stated herein. The final installation of pulling-in devices must be made permanent. Cover and seal exterior projections of thru-wall type pulling-in devices with an appropriate protective coating. In the floor the irons must be a minimum of 6 inches from the edge of the sump, and in the walls the irons must be located within 6 inches of the projected center of the duct bank pattern or precast window in the opposite wall. However, the pulling-in iron must not be located within 6 inches of an adjacent interior surface, or duct or precast window located within the same wall as the iron. If a pulling-in iron cannot be located directly opposite the corresponding duct bank or precast window due to this clearance limitation, locate the iron directly above or below the projected center of the duct bank pattern or precast window the minimum distance required to preserve the 6 inch clearance previously stated. In the case of directly opposing precast windows, pulling-in irons consisting of a 3 foot length of No. 5 reinforcing bar, formed into a hairpin, may be cast-in-place within the precast windows simultaneously with the end of the corresponding duct bank envelope. Irons installed in this manner must be positioned directly in line with, or when not possible, directly above or below the projected center of the duct bank pattern entering the opposite wall, while maintaining a minimum clear distance of 3 inches from any edge of the cast-in-place duct bank envelope or any individual duct. Pulling-in irons must have a clear projection into the structure of approximately 4 inches and must be designed to withstand a minimum pulling-in load of 6000 pounds. Irons must be hot-dipped galvanized after fabrication.

3.2.3 Cable Racks, Arms and Insulators

Cable racks, arms and insulators must be sufficient to accommodate the cables. Space racks in power manholes not more than 3 feet apart, and provide each manhole wall with a minimum of two racks. Space racks in

signal manholes not more than 16 1/2 inches apart with the end rack being no further than 12 inches from the adjacent wall. Methods of anchoring cable racks must be as follows:

a. Provide a 5/8 inch diameter by 5 inch long anchor bolt with 3 inch foot cast in structure wall with 2 inch protrusion of threaded portion of bolt into structure. Provide 5/8 inch steel square head nut on each anchor bolt. Coat threads of anchor bolts with suitable coating immediately prior to installing nuts.

b. Provide concrete channel insert with a minimum load rating of 800 pounds per foot. Insert channel must be steel of the same length as "vertical rack channel;" channel insert must be cast flush in structure wall. Provide 5/8 inch steel nuts in channel insert to receive 5/8 inch diameter by 3 inch long steel, square head anchor bolts.

c. Provide concrete "spot insert" at each anchor bolt location, cast flush in structure wall. Each insert must have minimum 800 pound load rating. Provide 5/8 inch diameter by 3 inch long steel, square head anchor bolt at each anchor point. Coat threads of anchor bolts with suitable coating immediately prior to installing bolts.

3.2.4 Field Painting

Cast-iron frames and covers not buried in concrete or masonry must be cleaned of mortar, rust, grease, dirt and other deleterious materials, and given a coat of bituminous paint.

3.3 UNDERGROUND CONDUIT AND DUCT SYSTEMS

3.3.1 Requirements

Run conduit in straight lines except where a change of direction is necessary. Provide numbers and sizes of ducts as indicated. Bond bare copper grounding conductor to ground rings (loops) in all manholes and to ground rings (loops) at all equipment slabs (pads). Route grouding conductor into manholes with the duct bank (sleeving is not required). Ducts must have a continuous slope downward toward underground structures and away from buildings, laid with a minimum slope of3 inches per 100 feet. Depending on the contour of the finished grade, the high-point may be at a terminal, a manhole, a handhole, or between manholes or handholes. Provide ducts with end bells whenever duct lines terminate in structures.

Perform changes in ductbank direction as follows:

a. Short-radius manufactured 90-degree duct bends may be used only for pole or equipment risers, unless specifically indicated as acceptable.

b. The minimum manufactured bend radius must be 18 inches for ducts of less than 3 inch diameter, and 36 inches for ducts 3 inches or greater in diameter.

c. As an exception to the bend radius required above, provide field manufactured longsweep bends having a minimum radius of 25 feet for a change of direction of more than 5 degrees, either horizontally or vertically, using a combination of curved and straight sections. Maximum manufactured curved sections: 30 degrees.

3.3.2 Treatment

Ducts must be kept clean of concrete, dirt, or foreign substances during construction. Field cuts requiring tapers must be made with proper tools and match factory tapers. A coupling recommended by the duct manufacturer must be used whenever an existing duct is connected to a duct of different material or shape. Ducts must be stored to avoid warping and deterioration with ends sufficiently plugged to prevent entry of any water or solid substances. Ducts must be thoroughly cleaned before being laid. Plastic ducts must be stored on a flat surface and protected from the direct rays of the sun.

3.3.3 Conduit Cleaning

As each conduit run is completed, for conduit sizes 3 inches and larger, draw a flexible testing mandrel approximately 12 inches long with a diameter less than the inside diameter of the conduit through the conduit. After which, draw a stiff bristle brush through until conduit is clear of particles of earth, sand and gravel; then immediately install conduit plugs. For conduit sizes less than 3 inches, draw a stiff bristle brush through until conduit is clear of particles of earth, sand and gravel; then immediately install conduit plugs.

3.3.4 Jacking and Drilling Under Roads and Structures

Conduits to be installed under existing paved areas which are not to be disturbed, and under roads and railroad tracks, must be zinc-coated, rigid steel, jacked into place. Where ducts are jacked under existing pavement, rigid steel conduit must be installed because of its strength. To protect the corrosion-resistant conduit coating, predrilling or installing conduit inside a larger iron pipe sleeve (jack-and-sleeve) is required. For crossings of existing railroads and airfield pavements greater than 50 feet in length, the predrilling method or the jack-and-sleeve method will be used. Separators or spacing blocks must be made of steel, concrete, plastic, or a combination of these materials placed not farther apart than 4 feet on centers. Hydraulic jet method must not be used.

3.3.5 Galvanized Conduit Concrete Penetrations

Galvanized conduits which penetrate concrete (slabs, pavement, and walls) in wet locations must be PVC coated and must extend from at least 2 inches within the concrete to the first coupling or fitting outside the concrete (minimum of 6 inches from penetration).

3.3.6 Multiple Conduits

Separate multiple conduits by a minimum distance of 3 inches, except that light and power conduits must be separated from control, signal, and telephone conduits by a minimum distance of12 inches. Stagger the joints of the conduits by rows (horizontally) and layers (vertically) to strengthen the conduit assembly. Provide plastic duct spacers that interlock vertically and horizontally. Spacer assembly must consist of base spacers, intermediate spacers, ties, and locking device on top to provide a completely enclosed and locked-in conduit assembly. Install spacers per manufacturer's instructions, but provide a minimum of two spacer assemblies per 10 feet of conduit assembly.

3.3.7 Conduit Plugs and Pull Rope

New conduit indicated as being unused or empty must be provided with plugs on each end. Plugs must contain a weephole or screen to allow water drainage. Provide a plastic pull rope having 3 feet of slack at each end of unused or empty conduits.

3.3.8 Conduit and Duct Without Concrete Encasement

Depths to top of the conduit must be not less than 36 inches below finished grade. Provide not less than 3 inches clearance from the conduit to each side of the trench. Grade bottom of trench smooth; where rock, soft spots, or sharp-edged materials are encountered, excavate the bottom for an additional 3 inches, fill and tamp level with original bottom with sand or earth free from particles, that would be retained on a 1/4 inch sieve. The first 6 inch layer of backfill cover must be sand compacted as previously specified. The rest of the excavation must be backfilled and compacted in 3 to 6 inch layers.

3.3.8.1 Encasement Under Roads and Structures

Under roads, paved areas, and railroad tracks, install conduits in concrete encasement of rectangular cross-section providing a minimum of 3 inch concrete cover around ducts. Concrete encasement must extend at least 5 feet beyond the edges of paved areas and roads, and 12 feet beyond the rails on each side of railroad tracks. Depths to top of the concrete envelope must be not less than 24 inches below finished grade.

3.3.9 Duct Encased in Concrete

Construct underground duct lines of individual conduits encased in concrete. Depths to top of the concrete envelope must be not less than 18 inches below finished grade, except under roads and pavement, concrete envelope must be not less than 24 inches below finished grade. Do not mix different kinds of conduit in any one duct bank. Concrete encasement surrounding the bank must be rectangular in cross-section and must provide at least 3 inches of concrete cover for ducts. Separate conduits by a minimum concrete thickness of 3 inches. Before pouring concrete, anchor duct bank assemblies to prevent the assemblies from floating during concrete pouring. Anchoring must be done by driving reinforcing rods adjacent to duct spacer assemblies and attaching the rods to the spacer assembly. Provide steel reinforcing in the concrete envelope as indicated.

3.3.9.1 Connections to Manholes

Duct bank envelopes connecting to underground structures must be flared to have enlarged cross-section at the manhole entrance to provide additional shear strength. Dimensions of the flared cross-section must be larger than the corresponding manhole opening dimensions by no less than 12 inches in each direction. Perimeter of the duct bank opening in the underground structure must be flared toward the inside or keyed to provide a positive interlock between the duct bank and the wall of the structure. Use vibrators when this portion of the encasement is poured to assure a seal between the envelope and the wall of the structure.

3.3.9.2 Connections to Existing Underground Structures

For duct bank connections to existing structures, break the structure wall out to the dimensions required and preserve steel in the structure wall.

Cut steel and bend out to tie into the reinforcing of the duct bank envelope. Chip the perimeter surface of the duct bank opening to form a key or flared surface, providing a positive connection with the duct bank envelope.

3.3.9.3 Connections to Existing Concrete Pads

For duct bank connections to concrete pads, break an opening in the pad out to the dimensions required and preserve steel in pad. Cut the steel and extend intobend out to tie into the reinforcing of the duct bank envelope. Chip out the opening in the pad to form a key for the duct bank envelope.

3.3.9.4 Connections to Existing Ducts

Where connections to existing duct banks are indicated, excavate the banks to the maximum depth necessary. Cut off the banks and remove loose concrete from the conduits before new concrete-encased ducts are installed. Provide a reinforced concrete collar, poured monolithically with the new duct bank, to take the shear at the joint of the duct banks. Remove existing cables which constitute interference with the work.

3.3.10 Duct Sealing

Seal all electrical penetrations for radon mitigation, maintaining integrity of the vapor barrier, and to prevent infiltration of air, insects, and vermin.

3.4 CABLE PULLING

Test existing duct lines with a mandrel and thoroughly swab out to remove foreign material before pulling cables. Pull cables down grade with the feed-in point at the manhole or buildings of the highest elevation. Use flexible cable feeds to convey cables through manhole opening and into duct runs. Do not exceed the specified cable bending radii when installing cable under any conditions, including turnups into switches, transformers, switchgear, switchboards, and other enclosures. Cable with tape or wire shield must have a bending radius not less than 12 times the overall diameter of the completed cable. If basket-grip type cable-pulling devices are used to pull cable in place, cut off the section of cable under the grip before splicing and terminating.

3.4.1 Cable Lubricants

Use lubricants that are specifically recommended by the cable manufacturer for assisting in pulling jacketed cables.

3.5 CABLES IN UNDERGROUND STRUCTURES

Do not install cables utilizing the shortest path between penetrations, but route along those walls providing the longest route and the maximum spare cable lengths. Form cables to closely parallel walls, not to interfere with duct entrances, and support on brackets and cable insulators. Support cable splices in underground structures by racks on each side of the splice. Locate splices to prevent cyclic bending in the spliced sheath. Install cables at middle and bottom of cable racks, leaving top space open for future cables, except as otherwise indicated for existing installations. Provide one spare three-insulator rack arm for each cable rack in each underground structure.

3.5.1 Cable Tag Installation

Install cable tags in each manhole as specified, including each splice. Tag wire and cable provided by this contract. Install cable tags over the fireproofing, if any, and locate the tags so that they are clearly visible without disturbing any cabling or wiring in the manholes.

3.6 GROUNDING SYSTEMS

NFPA 70 and IEEE C2, except provide grounding systems with a resistance to solid earth ground not exceeding 25 ohms.

3.6.1 Grounding Electrodes

Provide cone pointed driven ground rods driven full depth plus 12 inches, installed to provide an earth ground of the appropriate value for the particular equipment being grounded.
If the specified ground resistance is not met, an additional ground rod must be provided in accordance with the requirements of NFPA 70 (placed not less than 6 feet from the first rod). Should the resultant (combined) resistance exceed the specified resistance, measured not less than 48 hours after rainfall, notify the Contracting Officer immediately.

3.6.2 Grounding Connections

Make grounding connections which are buried or otherwise normally inaccessible, by exothermic weld or compression connector.

a. Make exothermic welds strictly in accordance with the weld manufacturer's written recommendations. Welds which are "puffed up" or which show convex surfaces indicating improper cleaning are not acceptable. Mechanical connectors are not required at exothermic welds.

b. Make compression connections using a hydraulic compression tool to provide the correct circumferential pressure. Tools and dies must be as recommended by the manufacturer. An embossing die code or other standard method must provide visible indication that a connector has been adequately compressed on the ground wire.

3.6.3 Grounding Conductors

Provide bare grounding conductors, except where installed in conduit with associated phase conductors. Ground cable sheaths, cable shields, conduit, and equipment with No. 6 AWG. Ground other noncurrent-carrying metal parts and equipment frames of metal-enclosed equipment. Ground metallic frames and covers of handholes and pull boxes with a braided, copper ground strap with equivalent ampacity of No. 6 AWG.

3.6.4 Ground Cable Crossing Expansion Joints

Protect ground cables crossing expansion joints or similar separations in structures and pavements by use of approved devices or methods of installation which provide the necessary slack in the cable across the joint to permit movement. Use stranded or other approved flexible copper cable across such separations.

3.6.5 Manhole Grounding

Loop a 4/0 AWG grounding conductor around the interior perimeter, approximately 12 inches above finished floor. Secure the conductor to the manhole walls at intervals not exceeding 36 inches. Connect the conductor to the manhole grounding electrode with 4/0 AWG conductor. Connect all incoming 4/0 grounding conductors to the ground loop adjacent to the point of entry into the manhole. Bond the ground loop to all cable shields, metal cable racks, and other metal equipment with a minimum 6 AWG conductor.

3.7 EXCAVATING, BACKFILLING, AND COMPACTING

Provide in accordance with NFPA 70.

3.7.1 Reconditioning of Surfaces

3.7.1.1 Unpaved Surfaces

Restore to their original elevation and condition unpaved surfaces disturbed during installation of duct. Preserve sod and topsoil removed during excavation and reinstall after backfilling is completed. Replace sod that is damaged by sod of quality equal to that removed. When the surface is disturbed in a newly seeded area, re-seed the restored surface with the same quantity and formula of seed as that used in the original seeding, and provide topsoiling, fertilizing, liming, seeding, sodding, sprigging, or mulching.

3.7.1.2 Paving Repairs

Where trenches, pits, or other excavations are made in existing roadways and other areas of pavement where surface treatment of any kind exists, restore such surface treatment or pavement the same thickness and in the same kind as previously existed, except as otherwise specified, and to match and tie into the adjacent and surrounding existing surfaces.

3.8 FIELD QUALITY CONTROL

3.8.1 Performance of Field Acceptance Checks and Tests

Perform in accordance with the manufacturer's recommendations, and include the following visual and mechanical inspections and electrical tests, performed in accordance with NETA ATS.

3.8.1.1 Grounding System

a. Visual and mechanical inspection

Inspect ground system for compliance with contract plans and specifications.

b. Electrical tests

Perform ground-impedance measurements utilizing the fall-of-potential method in accordance with IEEE 81. On systems consisting of interconnected ground rods, perform tests after interconnections are complete. On systems consisting of a single ground rod perform tests before any wire is connected. Take measurements in normally dry weather, not less than 48 hours after rainfall. Use a portable ground

resistance tester in accordance with manufacturer's instructions to test each ground or group of grounds. The instrument must be equipped with a meter reading directly in ohms or fractions thereof to indicate the ground value of the ground rod or grounding systems under test. Provide site diagram indicating location of test probes with associated distances, and provide a plot of resistance vs. distance.

-- End of Section --

SECTION 33 82 00

TELECOMMUNICATIONS OUTSIDE PLANT (OSP)
04/06

PART 1 GENERAL

1.1 REFERENCES

The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only.

ASTM INTERNATIONAL (ASTM)

ASTM B1	(2013) Standard Specification for Hard-Drawn Copper Wire
ASTM B8	(2011; R 2017) Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
ASTM D709	(2017) Standard Specification for Laminated Thermosetting Materials
ASTM D1557	(2012; E 2015) Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft3) (2700 kN-m/m3)

INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE)

IEEE 100	(2000; Archived) The Authoritative Dictionary of IEEE Standards Terms
IEEE C2	(2017; Errata 1-2 2017; INT 1 2017) National Electrical Safety Code

INSULATED CABLE ENGINEERS ASSOCIATION (ICEA)

ICEA S-87-640	(2016) Optical Fiber Outside Plant Communications Cable; 4th Edition
ICEA S-98-688	(2012) Broadband Twisted Pair Telecommunication Cable, Aircore, Polyolefin Insulated, Copper Conductors Technical Requirements
ICEA S-99-689	(2012) Broadband Twisted Pair Telecommunication Cable Filled, Polyolefin Insulated, Copper Conductors Technical Requirements

NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA)

ANSI C62.61	(1993) American National Standard for Gas Tube Surge Arresters on Wire Line Telephone Circuits

NATIONAL FIRE PROTECTION ASSOCIATION (NFPA)

NFPA 70	(2017; ERTA 1-2 2017; TIA 17-1; TIA 17-2; TIA 17-3; TIA 17-4; TIA 17-5; TIA 17-6; TIA 17-7; TIA 17-8; TIA 17-9; TIA 17-10; TIA 17-11; TIA 17-12; TIA 17-13; TIA 17-14; TIA 17-15; TIA 17-16; TIA 17-17) National Electrical Code

SOCIETY FOR PROTECTIVE COATINGS (SSPC)

SSPC SP 6/NACE No.3	(2007) Commercial Blast Cleaning

TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA)

TIA-455-78-B	(2002) FOTP-78 Optical Fibres - Part 1-40: Measurement Methods and Test Procedures - Attenuation
TIA-455-107	(1999a) FOTP-107 Determination of Component Reflectance or Link/System Return Loss using a Loss Test Set
TIA-472D000	(2007b) Fiber Optic Communications Cable for Outside Plant Use
TIA-492CAAA	(1998; R 2002) Detail Specification for Class IVa Dispersion-Unshifted Single-Mode Optical Fibers
TIA-526-7	(2015a) OFSTP-7 Measurement of Optical Power Loss of Installed Single-Mode Fiber Cable Plant
TIA-526-14	(2015c) OFSTP-14A Optical Power Loss Measurements of Installed Multimode Fiber Cable Plant
TIA-568-C.1	(2009; Add 2 2011; Add 1 2012) Commercial Building Telecommunications Cabling Standard
TIA-568-C.2	(2009; Errata 2010; Add 2 2014; Add 1 2016) Balanced Twisted-Pair Telecommunications Cabling and Components Standards
TIA-568-C.3	(2008; Add 1 2011) Optical Fiber Cabling Components Standard
TIA-569	(2015d) Commercial Building Standard for Telecommunications Pathways and Spaces
TIA-590	(1997a) Standard for Physical Location and Protection of Below Ground Fiber Optic Cable Plant
TIA-606	(2017c) Administration Standard for the

	Telecommunications Infrastructure
TIA-607	(2015c; Addendum 1 2017) Generic Telecommunications Bonding and Grounding (Earthing) for Customer Premises
TIA-758	(2012b) Customer-Owned Outside Plant Telecommunications Infrastructure Standard
TIA/EIA-455	(1998b) Standard Test Procedure for Fiber Optic Fibers, Cables, Transducers, Sensors, Connecting and Terminating Devices, and Other Fiber Optic Components
TIA/EIA-455-204	(2000) Standard for Measurement of Bandwidth on Multimode Fiber
TIA/EIA-598	(2014D; Add 2 2018) Optical Fiber Cable Color Coding

U.S. DEPARTMENT OF AGRICULTURE (USDA)

RUS 1755	Telecommunications Standards and Specifications for Materials, Equipment and Construction
RUS Bull 345-65	(1985) Shield Bonding Connectors (PE-65)
RUS Bull 345-72	(1985) Filled Splice Closures (PE-74)
RUS Bull 345-83	(1979; Rev Oct 1982) Gas Tube Surge Arrestors (PE-80)
RUS Bull 1751F-630	(1996) Design of Aerial Plant
RUS Bull 1751F-643	(2002) Underground Plant Design
RUS Bull 1751F-815	(1979) Electrical Protection of Outside Plant
RUS Bull 1753F-201	(1997) Acceptance Tests of Telecommunications Plant (PC-4)
RUS Bull 1753F-401	(1995) Splicing Copper and Fiber Optic Cables (PC-2)

UNDERWRITERS LABORATORIES (UL)

UL 83	(2017) UL Standard for Safety Thermoplastic-Insulated Wires and Cables
UL 497	(2001; Reprint Jul 2013) Protectors for Paired Conductor Communication Circuits
UL 510	(2017) UL Standard for Safety Polyvinyl Chloride, Polyethylene and Rubber Insulating Tape

1.2 RELATED REQUIREMENTS

Section 27 10 00, BUILDING TELECOMMUNICATIONS CABLING SYSTEM. 1.3 DEFINITIONS

Unless otherwise specified or indicated, electrical and electronics terms used in this specification shall be as defined in TIA-568-C.1, TIA-568-C.2, TIA-568-C.3, TIA-569, TIA-606, and IEEE 100 and herein.

1.3.1 Campus Distributor (CD)

A distributor from which the campus backbone cabling emanates. (International expression for main cross-connect - (MC).)

1.3.2 Entrance Facility (EF) (Telecommunications)

An entrance to the building for both private and public network service cables (including antennae) including the entrance point at the building wall and continuing to the entrance room or space.

1.3.3 Entrance Room (ER) (Telecommunications)

A centralized space for telecommunications equipment that serves the occupants of a building. Equipment housed therein is considered distinct from a telecommunications room because of the nature of its complexity.

1.3.4 Building Distributor (BD)

A distributor in which the building backbone cables terminate and at which connections to the campus backbone cables may be made. (International expression for intermediate cross-connect - (IC).)

1.3.5 Pathway

A physical infrastructure utilized for the placement and routing of telecommunications cable.

1.4 SYSTEM DESCRIPTION

The telecommunications outside plant consists of cable, conduit, manholes, poles, etc. required to provide signal paths from the closest point of presence to the new facility, including free standing frames or backboards, interconnecting hardware, terminating cables, lightning and surge protection modules at the entrance facility. The work consists of providing, testing and making operational cabling, interconnecting hardware and lightning and surge protection necessary to form a complete outside plant telecommunications system for continuous use. Coordinate all work with 96 CS prior to ordering materials.

1.5 SUBMITTALS

Government approval is required for submittals with a "G" designation; submittals not having a "G" designation are for information only. When used, a designation following the "G" designation identifies the office that will review the submittal for the Government. Submit the following in accordance with Section 01 33 00 SUBMITTAL PROCEDURES:

SD-02 Shop Drawings

Telecommunications Outside Plant; G

Telecommunications Entrance Facility Drawings; G

In addition to Section 01 33 00 SUBMITTAL PROCEDURES, provide shop drawings in accordance with paragraph SHOP DRAWINGS.

SD-03 Product Data

Wire and cable; G

Cable splices, and connectors; G

Closures; G

Building protector assemblies; G

Protector modules; G

Cross-connect terminal cabinets; G

Submittals shall include the manufacturer's name, trade name, place of manufacture, and catalog model or number. Submittals shall also include applicable federal, military, industry, and technical society publication references. Should manufacturer's data require supplemental information for clarification, the supplemental information shall be submitted as specified in paragraph REGULATORY REQUIREMENTS and as required for certificates in Section 01 33 00 SUBMITTAL PROCEDURES.

SD-06 Test Reports

Pre-installation tests; G

Acceptance tests; G

Outside Plant Test Plan; G

SD-07 Certificates

Telecommunications Contractor Qualifications; G

Key Personnel Qualifications; G

Minimum Manufacturer's Qualifications; G

SD-08 Manufacturer's Instructions

Building protector assembly installation; G

Cable tensions; G

Fiber Optic Splices; G

Submit instructions prior to installation.

SD-09 Manufacturer's Field Reports

Factory Reel Test Data; G

SD-10 Operation and Maintenance Data

Telecommunications outside plant (OSP), Data Package 5; G

Commercial off-the-shelf manuals shall be provided for operation, installation, configuration, and maintenance of products provided as a part of the telecommunications outside plant (OSP). Submit operations and maintenance data in accordance with Section 01 78 23, OPERATION AND MAINTENANCE DATA and as specified herein not later than 2 months prior to the date of beneficial occupancy. In addition to requirements of Data package 5, include the requirements of paragraphs TELECOMMUNICATIONS OUTSIDE PLANT SHOP DRAWINGS and TELECOMMUNICATIONS ENTRANCE FACILITY DRAWINGS.

SD-11 Closeout Submittals

Record Documentation; G

In addition to other requirements, provide in accordance with paragraph RECORD DOCUMENTATION.

1.6 QUALITY ASSURANCE

1.6.1 Shop Drawings

Include wiring diagrams and installation details of equipment indicating proposed location, layout and arrangement, control panels, accessories, piping, ductwork, and other items that must be shown to ensure a coordinated installation. Wiring diagrams shall identify circuit terminals and indicate the internal wiring for each item of equipment and the interconnection between each item of equipment. Drawings shall indicate adequate clearance for operation, maintenance, and replacement of operating equipment devices. Submittals shall include the nameplate data, size, and capacity. Submittals shall also include applicable federal, military, industry, and technical society publication references.

1.6.1.1 Telecommunications Outside Plant Shop Drawings

Provide Outside Plant Design in accordance with TIA-758, RUS Bull 1751F-630 for aerial system design, and RUS Bull 1751F-643 for underground system design. Provide T0 shop drawings that show the physical and logical connections from the perspective of an entire campus, such as actual building locations, exterior pathways and campus backbone cabling on plan view drawings, major system nodes, and related connections on the logical system drawings in accordance with TIA-606. Drawings shall include wiring and schematic diagrams for fiber optic and copper cabling and splices, copper conductor gauge and pair count, fiber pair count and type, pathway duct and innerduct arrangement, associated construction materials, and any details required to demonstrate that cable system has been coordinated and will properly support the switching and transmission system identified in specification and drawings. The telecommunications outside plant (OSP) shop drawings shall be included in the operation and maintenance manuals.

1.6.1.2 Telecommunications Entrance Facility Drawings

Provide T3 drawings for EF Telecommunications in accordance with TIA-606 that include telecommunications entrance facility plan views, pathway

layout (cable tray, racks, ladder-racks, etc.), mechanical/electrical layout, and cabinet, rack and wall elevations. Drawings shall show layout of applicable equipment including incoming cable stub or connector blocks, building protector assembly, outgoing cable connector blocks, patch panels and equipment spaces and cabinet/racks. Drawings shall include a complete list of equipment and material, equipment rack details, proposed layout and anchorage of equipment and appurtenances, and equipment relationship to other parts of the work including clearance for maintenance and operation. Drawings may also be an enlargement of a congested area of T1 or T2 drawings.Provide T3 drawings for EF Telecommunications as specified in the paragraph TELECOMMUNICATIONS SPACE DRAWINGS of Section 27 10 00 BUILDING TELECOMMUNICATIONS CABLING SYSTEMS. The telecommunications entrance facility shop drawings shall be included in the operation and maintenance manuals.

1.6.2 Telecommunications Qualifications

Work under this section shall be performed by and the equipment shall be provided by the approved telecommunications contractor and key personnel. Qualifications shall be provided for: the telecommunications system contractor, the telecommunications system installer, the supervisor (if different from the installer), and the cable splicing and terminating personnel. A minimum of 30 days prior to installation, submit documentation of the experience of the telecommunications contractor and of the key personnel.

1.6.2.1 Telecommunications Contractor Qualifications

The telecommunications contractor shall be a firm which is regularly and professionally engaged in the business of the applications, installation, and testing of the specified telecommunications systems and equipment. The telecommunications contractor shall demonstrate experience in providing successful telecommunications systems that include outside plant and broadband cabling within the past 3 years. Submit documentation for a minimum of three and a maximum of five successful telecommunication system installations for the telecommunications contractor. Each of the key personnel shall demonstrate experience in providing successful telecommunications systems in accordance with TIA-758 within the past 3 years.

1.6.2.2 Key Personnel Qualifications

Provide key personnel who are regularly and professionally engaged in the business of the application, installation and testing of the specified telecommunications systems and equipment. There may be one key person or more key persons proposed for this solicitation depending upon how many of the key roles each has successfully provided. Each of the key personnel shall demonstrate experience in providing successful telecommunications systems within the past 3 years.

Cable splicing and terminating personnel assigned to the installation of this system or any of its components shall have training in the proper techniques and have a minimum of 3 years experience in splicing and terminating the specified cables. Modular splices shall be performed by factory certified personnel or under direct supervision of factory trained personnel for products used.

Supervisors and installers assigned to the installation of this system or any of its components shall have factory or factory approved certification

from each equipment manufacturer indicating that they are qualified to install and test the provided products.

Submit documentation for a minimum of three and a maximum of five successful telecommunication system installations for each of the key personnel. Documentation for each key person shall include at least two successful system installations provided that are equivalent in system size and in construction complexity to the telecommunications system proposed for this solicitation. Include specific experience in installing and testing telecommunications outside plant systems, including broadband cabling, and provide the names and locations of at least two project installations successfully completed using optical fiber and copper telecommunications cabling systems. All of the existing telecommunications system installations offered by the key persons as successful experience shall have been in successful full-time service for at least 18 months prior to the issuance date for this solicitation. Provide the name and role of the key person, the title, location, and completed installation date of the referenced project, the referenced project owner point of contact information including name, organization, title, and telephone number, and generally, the referenced project description including system size and construction complexity.

Indicate that all key persons are currently employed by the telecommunications contractor, or have a commitment to the telecommunications contractor to work on this project. All key persons shall be employed by the telecommunications contractor at the date of issuance of this solicitation, or if not, have a commitment to the telecommunications contractor to work on this project by the date that the bid was due to the Contracting Officer.

Note that only the key personnel approved by the Contracting Officer in the successful proposal shall do work on this solicitation's telecommunications system. Key personnel shall function in the same roles in this contract, as they functioned in the offered successful experience. Any substitutions for the telecommunications contractor's key personnel requires approval from The Contracting Officer.

1.6.2.3 Minimum Manufacturer's Qualifications

Cabling, equipment and hardware manufacturers shall have a minimum of 3 years experience in the manufacturing, assembly, and factory testing of components which comply with, TIA-568-C.1, TIA-568-C.2 and TIA-568-C.3. In addition, cabling manufacturers shall have a minimum of 3 years experience in the manufacturing and factory testing of cabling which comply with ICEA S-87-640, ICEA S-98-688, and ICEA S-99-689.

1.6.3 Outside Plant Test Plan

Prepare and provide a complete and detailed test plan for field tests of the outside plant including a complete list of test equipment for the copper conductor and optical fiber cables, components, and accessories for approval by the Contracting Officer. Include a cut-over plan with procedures and schedules for relocation of facility station numbers without interrupting service to any active location. Submit the plan at least 30 days prior to tests for Contracting Officer approval. Provide outside plant testing and performance measurement criteria in accordance with TIA-568-C.1 and RUS Bull 1753F-201. Include procedures for certification, validation, and testing that includes fiber optic link performance criteria.

1.6.4 Standard Products

Provide materials and equipment that are standard products of manufacturers regularly engaged in the production of such products which are of equal material, design and workmanship and shall be the manufacturer's latest standard design that has been in satisfactory commercial or industrial use for at least 2 years prior to bid opening. The 2-year period shall include applications of equipment and materials under similar circumstances and of similar size. The product shall have been on sale on the commercial market through advertisements, manufacturers' catalogs, or brochures during the 2-year period. Products supplied shall be specifically designed and manufactured for use with outside plant telecommunications systems. Where two or more items of the same class of equipment are required, these items shall be products of a single manufacturer; however, the component parts of the item need not be the products of the same manufacturer unless stated in this section.

1.6.4.1 Alternative Qualifications

Products having less than a 2-year field service record will be acceptable if a certified record of satisfactory field operation for not less than 6000 hours, exclusive of the manufacturers' factory or laboratory tests, is provided.

1.6.4.2 Material and Equipment Manufacturing Date

Products manufactured more than 3 years prior to date of delivery to site shall not be used, unless specified otherwise.

1.6.5 Regulatory Requirements

In each of the publications referred to herein, consider the advisory provisions to be mandatory, as though the word, "shall" had been substituted for "should" wherever it appears. Interpret references in these publications to the "authority having jurisdiction," or words of similar meaning, to mean the Contracting Officer. Equipment, materials, installation, and workmanship shall be in accordance with the mandatory and advisory provisions of NFPA 70 unless more stringent requirements are specified or indicated.

1.6.5.1 Independent Testing Organization Certificate

In lieu of the label or listing, submit a certificate from an independent testing organization, competent to perform testing, and approved by the Contracting Officer. The certificate shall state that the item has been tested in accordance with the specified organization's test methods and that the item complies with the specified organization's reference standard.

1.7 DELIVERY, STORAGE, AND HANDLING

Ship cable on reels in500 feet length with a minimum overage of 10 percent. Radius of the reel drum shall not be smaller than the minimum bend radius of the cable. Wind cable on the reel so that unwinding can be done without kinking the cable. Two meters of cable at both ends of the cable shall be accessible for testing. Attach permanent label on each reel showing length, cable identification number, cable size, cable type, and date of manufacture. Provide water resistant label and the indelible

writing on the labels. Apply end seals to each end of the cables to prevent moisture from entering the cable. Reels with cable shall be suitable for outside storage conditions when temperature ranges from minus 40 degrees C to plus 65 degrees C, with relative humidity from 0 to 100 percent. Equipment, other than cable, delivered and placed in storage shall be stored with protection from weather, humidity and temperature variation, dirt and dust, or other contaminants in accordance with manufacturer's requirements.

1.8 MAINTENANCE

1.8.1 Record Documentation

Provide the activity responsible for telecommunications system maintenance and administration a single complete and accurate set of record documentation for the entire telecommunications system with respect to this project.

Provide T5 drawings including documentation on cables and termination hardware in accordance with TIA-606. T5 drawings shall include schedules to show information for cut-overs and cable plant management, patch panel layouts, cross-connect information and connecting terminal layout as a minimum. T5 drawings shall be provided in hard copy format on electronic media using Windows based computer cable management software. Provide the following T5 drawing documentation as a minimum:

a. Cables - A record of installed cable shall be provided in accordance with TIA-606. The cable records shall include the required data fields for each cable and complete end-to-end circuit report for each complete circuit from the assigned outlet to the entry facility in accordance with TIA-606. Include manufacture date of cable with submittal.

b. Termination Hardware - Provide a record of installed patch panels, cross-connect points, campus distributor and terminating block arrangements and type in accordance with TIA-606. Documentation shall include the required data fields as a minimum in accordance with TIA-606.

Provide record documentation as specified in Section 27 10 00 BUILDING TELECOMMUNICATIONS CABLING SYSTEM.

1.9 WARRANTY

The equipment items shall be supported by service organizations which are reasonably convenient to the equipment installation in order to render satisfactory service to the equipment on a regular and emergency basis during the warranty period of the contract.

PART 2 PRODUCTS

2.1 MATERIALS AND EQUIPMENT

Products supplied shall be specifically designed and manufactured for use with outside plant telecommunications systems.

2.2 TELECOMMUNICATIONS ENTRANCE FACILITY

2.2.1 Building Protector Assemblies

Provide self-contained 5 pin unit supplied with a field cable stub factory connected to protector socket blocks to terminate and accept protector modules for pairs of outside cable. Building protector assembly shall have interconnecting hardware for connection to interior cabling at full capacity. Provide manufacturers instructions for building protector assembly installation. Provide copper cable interconnecting hardware as specified in Section 27 10 00 BUILDING TELECOMMUNICATIONS CABLING SYSTEM.

2.2.2 Protector Modules

Provide in accordance with UL 497 three-electrode gas tube or solid state type 5 pin rated for the application. Provide gas tube protection modules in accordance with RUS Bull 345-83 and shall be maximum duty, A>20kA, B>1000, C>200A where A is the maximum single impulse discharge current, B is the impulse life and C is the AC discharge current in accordance with ANSI C62.61. The gas modules shall shunt high voltage to ground, fail short, and be equipped with an external spark gap and heat coils in accordance with UL 497. Provide the number of surge protection modules equal to the number of pairs of exterior cable of the building protector assembly.

2.2.3 Fiber Optic Terminations

Provide fiber optic cable terminations as specified in 27 10 00 BUILDING TELECOMMUNICATIONS CABLING SYSTEM.

2.3 CLOSURES

2.3.1 Copper Conductor Closures

2.3.1.1 Underground Cable Closures

a. In vault or manhole: Provide underground closure suitable to house a straight, butt, and branch splice in a protective housing into which can be poured an encapsulating compound. Closure shall be of suitable thermoplastic, thermoset, or stainless steel material supplying structural strength necessary to pass the mechanical and electrical requirements in a vault or manhole environment. Encapsulating compound shall be reenterable and shall not alter the chemical stability of the closure. Provide filled splice cases in accordance with RUS Bull 345-72.

2.3.2 Fiber Optic Closures

2.3.2.1 In Vault or Manhole

Provide underground closure suitable to house splice organizer in a protective housing into which can be poured an encapsulating compound. Closure shall be of thermoplastic, thermoset, or stainless steel material supplying structural strength necessary to pass the mechanical and electrical requirements in a vault or manhole environment. Encapsulating compound shall be reenterable and shall not alter the chemical stability of the closure.

2.4 CABLE SPLICES, AND CONNECTORS

2.4.1 Copper Cable Splices

Provide splices of a moisture resistant,-wire connector held rigidly in place to assure maximum continuity in accordance with RUS Bull 1753F-401. Cables greater than 25 pairs shall be spliced using multipair splicing connectors, which accommodate 25 pairs of conductors at a time. Provide correct connector size to accommodate the cable gauge of the supplied cable.

2.4.2 Copper Cable Splice Connector

Provide splice connectors with a polycarbonate body and cap and a tin-plated brass contact element. Connector shall accommodate 22 to 26 AWG solid wire with a maximum insulation diameter of 0.065 inch. Fill connector with sealant grease to make a moisture resistant connection, in accordance with RUS Bull 1753F-401.

2.4.3 Fiber Optic Cable Splices

Provide fiber optic cable splices and splicing materials for fusion methods at locations shown on the construction drawings. The splice insertion loss shall be 0.3 dB maximum when measured in accordance with TIA-455-78-B using an Optical Time Domain Reflectometer (OTDR). Splices shall be designed for a return loss of 40.0 db max for single mode fiber when tested in accordance with TIA-455-107. Physically protect each fiber optic splice by a splice kit specially designed for the splice.

2.4.4 Fiber Optic Splice Organizer

Provide splice organizer suitable for housing fiber optic splices in a neat and orderly fashion. Splice organizer shall allow for a minimum of 3 feet of fiber for each fiber within the cable to be neatly stored without kinks or twists. Splice organizer shall accommodate individual strain relief for each splice and allow for future maintenance or modification, without damage to the cable or splices. Provide splice organizer hardware, such as splice trays, protective glass shelves, and shield bond connectors in a splice organizer kit.

2.4.5 Shield Connectors

Provide connectors with a stable, low-impedance electrical connection between the cable shield and the bonding conductor in accordance with RUS Bull 345-65.

2.5 CONDUIT

Provide conduit as specified in Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION. Refer to plans for additional requirements.

2.6 PLASTIC INSULATING TAPE

UL 510.

2.7 WIRE AND CABLE

2.7.1 Copper Conductor Cable

Solid copper conductors, covered with an extruded solid insulating compound. Insulated conductors shall be twisted into pairs which are then stranded or oscillated to form a cylindrical core. For special high frequency applications, the cable core shall be separated into compartments. Cable shall be completed by the application of a suitable core wrapping material, a corrugated copper or plastic coated aluminum shield, and an overall extruded jacket. Telecommunications contractor shall verify distances between splice points prior to ordering cable in specific cut lengths. Gauge of conductor shall determine the range of numbers of pairs specified; 19 gauge (6 to 400 pairs), 22 gauge (6 to 1200 pairs), 24 gauge (6 to 2100 pairs), and 26 gauge (6 to 3000 pairs). Copper conductor shall conform to the following:

2.7.1.1 Underground

Provide filled cable meeting the requirements of ICEA S-99-689 and RUS 1755.890.

2.7.1.2 Screen

Provide screen-compartmental core cable filled cable meeting the requirements of ICEA S-99-689 and RUS 1755.390.

2.7.2 Fiber Optic Cable

Provide single-mode, 8/125-um, 0.10 aperture 1310 nm fiber optic cable in accordance with TIA-492CAAA, TIA-472D000, and ICEA S-87-640 including any special requirements made necessary by a specialized design. Provide optical fibers as indicated. Fiber optic cable shall be specifically designed for outside use with loose buffer construction. Provide fiber optic color code in accordance with TIA/EIA-598

2.7.2.1 Strength Members

Provide, non-metallic strength members with sufficient tensile strength for installation and residual rated loads to meet the applicable performance requirements in accordance with ICEA S-87-640. The strength member is included to serve as a cable core foundation to reduce strain on the fibers, and shall not serve as a pulling strength member.

2.7.2.2 Performance Requirements

Provide fiber optic cable with optical and mechanical performance requirements in accordance with ICEA S-87-640.

2.7.3 Grounding and Bonding Conductors

Provide grounding and bonding conductors in accordance with RUS 1755.200, TIA-607, IEEE C2, and NFPA 70. Solid bare copper wire meeting the requirements of ASTM B1 for sizes No. 8 AWG and smaller and stranded bare copper wire meeting the requirements of ASTM B8, for sizes No. 6 AWG and larger. Insulated conductors shall have 600-volt, Type TW insulation meeting the requirements of UL 83.

2.8 CABLE TAGS IN MANHOLES, HANDHOLES, AND VAULTS

Provide tags for each telecommunications cable or wire located in manholes, handholes, and vaults. Cable tags shall be stainless steel or polyethylene and labeled as indicated in accordance with TIA-606. Handwritten labeling is unacceptable.

2.8.1 Stainless Steel

Provide stainless steel, cable tags 1 5/8 inches in diameter 1/16 inch thick minimum, and circular in shape. Tags shall be die stamped with numbers, letters, and symbols not less than 0.25 inch high and approximately 0.015 inch deep in normal block style.

2.8.2 Polyethylene Cable Tags

Provide tags of polyethylene that have an average tensile strength of 3250 pounds per square inch; and that are 0.08 inch thick (minimum), non-corrosive non-conductive; resistive to acids, alkalis, organic solvents, and salt water; and distortion resistant to 170 degrees F. Provide 0.05 inch (minimum) thick black polyethylene tag holder. Provide a one-piece nylon, self-locking tie at each end of the cable tag. Ties shall have a minimum loop tensile strength of 175 pounds. The cable tags shall have black block letters, numbers, and symbols one inch high on a yellow background. Letters, numbers, and symbols shall not fall off or change positions regardless of the cable tags' orientation.

2.9 BURIED WARNING AND IDENTIFICATION TAPE

Provide fiber optic media marking and protection in accordance with TIA-590.

2.10 GROUNDING BRAID

Provide grounding braid that provides low electrical impedance connections for dependable shield bonding in accordance with RUS 1755.200. Braid shall be made from flat tin-plated copper.

2.11 MANUFACTURER'S NAMEPLATE

Each item of equipment shall have a nameplate bearing the manufacturer's name, address, model number, and serial number securely affixed in a conspicuous place; the nameplate of the distributing agent will not be acceptable.

2.12 FIELD FABRICATED NAMEPLATES

Provide laminated plastic nameplates in accordance with ASTM D709 for each patch panel, protector assembly, rack, cabinet and other equipment or as indicated on the drawings. Each nameplate inscription shall identify the function and, when applicable, the position. Nameplates shall be melamine plastic, 0.125 inch thick, white with black center core. Surface shall be matte finish. Corners shall be square. Accurately align lettering and engrave into the core. Minimum size of nameplates shall be one by 2.5 inches. Lettering shall be a minimum of 0.25 inch high normal block style.

2.13 TESTS, INSPECTIONS, AND VERIFICATIONS

2.13.1 Factory Reel Test Data

Test 100 percent OTDR test of FO media at the factory in accordance with TIA-568-C.1 and TIA-568-C.3. Use TIA-526-7 for single mode fiber and TIA-526-14 Method B for multi mode fiber measurements. Calibrate OTDR to show anomalies of 0.2 dB minimum. Enhanced performance filled OSP copper cables, referred to as Broadband Outside Plant (BBOSP), shall meet the requirements of ICEA S-99-689. Enhanced performance air core OSP copper cables shall meet the requirements of ICEA S-98-688. Submit test reports, including manufacture date for each cable reel and receive approval before delivery of cable to the project site.

PART 3 EXECUTION

3.1 INSTALLATION

Install all system components and appurtenances in accordance with manufacturer's instructions IEEE C2, NFPA 70, and as indicated. Provide all necessary interconnections, services, and adjustments required for a complete and operable telecommunications system.

3.1.1 Contractor Damage

Promptly repair indicated utility lines or systems damaged during site preparation and construction. Damages to lines or systems not indicated, which are caused by Contractor operations, shall be treated as "Changes" under the terms of the Contract Clauses. When Contractor is advised in writing of the location of a nonindicated line or system, such notice shall provide that portion of the line or system with "indicated" status in determining liability for damages. In every event, immediately notify the Contracting Officer of damage.

3.1.2 Cable Inspection and Repair

Handle cable and wire provided in the construction of this project with care. Inspect cable reels for cuts, nicks or other damage. Damaged cable shall be replaced or repaired to the satisfaction of the Contracting Officer. Reel wraps shall remain intact on the reel until the cable is ready for placement.

3.1.3 Cable Protection

Provide direct burial cable protection in accordance with NFPA 70 and as specified in Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION. Galvanized conduits which penetrate concrete (slabs, pavement, and walls) shall be PVC coated and shall extend from the first coupling or fitting outside either side of the concrete minimum of 6 inches per 12 inches burial depth beyond the edge of the surface where cable protection is required; all conduits shall be sealed on each end. Where additional protection is required, cable may be placed in galvanized iron pipe (GIP) sized on a maximum fill of 40 percent of cross-sectional area, or in concrete encased 4 inches PVC pipe. Conduit may be installed by jacking or trenching. Trenches shall be backfilled with earth and mechanically tamped at 6 inches lift so that the earth is restored to the same density, grade and vegetation as adjacent undisturbed material.

3.1.3.1 Cable End Caps

Cable ends shall be sealed at all times with coated heat shrinkable end caps. Cables ends shall be sealed when the cable is delivered to the job site, while the cable is stored and during installation of the cable. The caps shall remain in place until the cable is spliced or terminated. Sealing compounds and tape are not acceptable substitutes for heat shrinkable end caps. Cable which is not sealed in the specified manner at all times will be rejected.

3.1.4 Underground Duct

Provide underground duct and connections to existing manholes, handholes, and existing ducts as specified in Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION with any additional requirements as specified herein.

3.1.5 Reconditioning of Surfaces

Provide reconditioning of surfaces as specified in Section 33 71 02 UNDERGROUND ELECTRICAL DISTRIBUTION.

3.1.6 Penetrations

Caulk and seal cable access penetrations in walls, ceilings and other parts of the building. Seal openings around electrical penetrations through fire resistance-rated wall, partitions, floors, or ceilings in accordance with Section 07 84 00 FIRESTOPPING.

3.1.7 Cable Pulling

Test duct lines with a mandrel and swab out to remove foreign material before the pulling of cables. Avoid damage to cables in setting up pulling apparatus or in placing tools or hardware. Do not step on cables when entering or leaving the manhole. Do not place cables in ducts other than those shown without prior written approval of the Contracting Officer. Roll cable reels in the direction indicated by the arrows painted on the reel flanges. Set up cable reels on the same side of the manhole as the conduit section in which the cable is to be placed. Level the reel and bring into proper alignment with the conduit section so that the cable pays off from the top of the reel in a long smooth bend into the duct without twisting. Under no circumstances shall the cable be paid off from the bottom of a reel. Check the equipment set up prior to beginning the cable pulling to avoid an interruption once pulling has started. Use a cable feeder guide of suitable dimensions between cable reel and face of duct to protect cable and guide cable into the duct as it is paid off the reel. As cable is paid off the reel, lubricate and inspect cable for sheath defects. When defects are noticed, stop pulling operations and notify the Contracting Officer to determine required corrective action. Cable pulling shall also be stopped when reel binds or does not pay off freely. Rectify cause of binding before resuming pulling operations. Provide cable lubricants recommended by the cable manufacturer. Avoid bends in cables of small radii and twists that might cause damage. Do not bend cable and wire in a radius less than 10 times the outside diameter of the cable or wire.

3.1.7.1 Cable Tensions

Obtain from the cable manufacturer and provide to the Contracting Officer, the maximum allowable pulling tension. This tension shall not be exceeded.

3.1.7.2 Pulling Eyes

Equip cables 1.25 inches in diameter and larger with cable manufacturer's factory installed pulling-in eyes. Provide cables with diameter smaller than 1.25 inches with heat shrinkable type end caps or seals on cable ends when using cable pulling grips. Rings to prevent grip from slipping shall not be beaten into the cable sheath. Use a swivel of 3/4 inch links between pulling-in eyes or grips and pulling strand.

3.1.7.3 Installation of Cables in Manholes, Handholes, and Vaults

Do not install cables utilizing the shortest route, but route along those walls providing the longest route and the maximum spare cable lengths. Form cables to closely parallel walls, not to interfere with duct entrances, and support cables on brackets and cable insulators at a maximum of 4 feet. In existing manholes, handholes, and vaults where new ducts are to be terminated, or where new cables are to be installed, modify the existing installation of cables, cable supports, and grounding as required with cables arranged and supported as specified for new cables. Identify each cable with corrosion-resistant embossed metal tags.

3.1.8 Cable Splicing

3.1.8.1 Copper Conductor Splices

Perform splicing in accordance with requirements of RUS Bull 1753F-401 except that direct buried splices and twisted and soldered splices are not allowed. Exception does not apply for pairs assigned for carrier application.

3.1.8.2 Fiber Optic Splices

Fiber optic splicing shall be in accordance with manufacturer's recommendation and shall exhibit an insertion loss not greater than 0.2 dB for fusion splices.

3.1.9 Surge Protection

All cables and conductors, except fiber optic cable, which serve as communication lines through off-premise lines, shall have surge protection installed at each end which meet the requirements of RUS Bull 1751F-815.

3.1.10 Grounding

Provide grounding and bonding in accordance with RUS 1755.200, TIA-607, IEEE C2, and NFPA 70. Ground exposed noncurrent carrying metallic parts of telephone equipment, cable sheaths, cable splices, and terminals.

3.1.10.1 Telecommunications Master Ground Bar (TMGB)

The TMGB is the hub of the basic telecommunications grounding system providing a common point of connection for ground from outside cable, CD, and equipment. Establish a TMGB for connection point for cable stub shields to connector blocks and CD protector assemblies as specified in Section 26 20 00 INTERIOR DISTRIBUTION SYSTEM.

3.1.10.2 Incoming Cable Shields

Shields shall not be bonded across the splice to the cable stubs. Ground shields of incoming cables in the EF Telecommunications to the TMGB.

3.2 LABELING

3.2.1 Labels

Provide labeling for new cabling and termination hardware located within the facility in accordance with TIA-606. Handwritten labeling is unacceptable. Stenciled lettering for cable and termination hardware shall be provided using thermal ink transfer process.

3.2.2 Cable Tag Installation

Install cable tags for each telecommunications cable or wire located in manholes, handholes, and vaults including each splice. Tag only new wire and cable provided by this contract. The labeling of telecommunications cable tag identifiers shall be in accordance with TIA-606. Do not provide handwritten letters. Install cable tags so that they are clearly visible without disturbing any cabling or wiring in the manholes, handholes, and vaults.

3.2.3 Termination Hardware

Label patch panels, distribution panels, connector blocks and protection modules using color coded labels with identifiers in accordance with TIA-606.

3.3 FIELD APPLIED PAINTING

Provide ferrous metallic enclosure finishes in accordance with the following procedures. Ensure that surfaces are dry and clean when the coating is applied. Coat joints and crevices. Prior to assembly, paint surfaces which will be concealed or inaccessible after assembly. Apply primer and finish coat in accordance with the manufacturer's recommendations.Provide ferrous metallic enclosure finishes as specified in Section 09 90 00 PAINTS AND COATINGS.

3.3.1 Cleaning

Clean surfaces in accordance with SSPC SP 6/NACE No.3.

3.3.2 Priming

Prime with a two component polyamide epoxy primer which has a bisphenol-A base, a minimum of 60 percent solids by volume, and an ability to build up a minimum dry film thickness on a vertical surface of 5.0 mils. Apply in two coats to a total dry film thickness of 5 to 8 mils.

3.3.3 Finish Coat

Finish with a two component urethane consisting of saturated polyester polyol resin mixed with aliphatic isocyanate which has a minimum of 50 percent solids by volume. Apply to a minimum dry film thickness of 2 to 3 mils. Color shall be the manufacturer's standard.

3.4 FIELD FABRICATED NAMEPLATE MOUNTING

Provide number, location, and letter designation of nameplates as indicated. Fasten nameplates to the device with a minimum of two sheet-metal screws or two rivets.

3.5 FIELD QUALITY CONTROL

Provide the Contracting Officer 10 working days notice prior to each test. Provide labor, equipment, and incidentals required for testing. Correct defective material and workmanship disclosed as the results of the tests. Furnish a signed copy of the test results to the Contracting Officer within 3 working days after the tests for each segment of construction are completed. Perform testing as construction progresses and do not wait until all construction is complete before starting field tests.

3.5.1 Pre-Installation Tests

Perform the following tests on cable at the job site before it is removed from the cable reel. For cables with factory installed pulling eyes, these tests shall be performed at the factory and certified test results shall accompany the cable.

3.5.1.1 Cable Capacitance

Perform capacitance tests on at least 10 percent of the pairs within a cable to determine if cable capacitance is within the limits specified.

3.5.1.2 Loop Resistance

Perform DC-loop resistance on at least 10 percent of the pairs within a cable to determine if DC-loop resistance is within the manufacturer's calculated resistance.

3.5.1.3 Pre-Installation Test Results

Provide results of pre-installation tests to the Contracting Officer at least 5 working days before installation is to start. Results shall indicate reel number of the cable, manufacturer, size of cable, pairs tested, and recorded readings. When pre-installation tests indicate that cable does not meet specifications, remove cable from the job site.

3.5.2 Acceptance Tests

Perform acceptance testing in accordance with RUS Bull 1753F-201 and as further specified in this section. Provide personnel, equipment, instrumentation, and supplies necessary to perform required testing. Notification of any planned testing shall be given to the Contracting Officer at least 14 days prior to any test unless specified otherwise. Testing shall not proceed until after the Contractor has received written Contracting Officer's approval of the test plans as specified. Test plans shall define the tests required to ensure that the system meets technical, operational, and performance specifications. The test plans shall define milestones for the tests, equipment, personnel, facilities, and supplies required. The test plans shall identify the capabilities and functions to be tested. Provide test reports in booklet form showing all field tests performed, upon completion and testing of the installed system. Measurements shall be tabulated on a pair by pair or strand by strand

basis. The contractor shall coordinate with 96 CS/SCOW personnel to ensure they are on site to verify all acceptance tests.

3.5.2.1 Copper Conductor Cable

Perform the following acceptance tests in accordance with TIA-758:

a. Wire map (pin to pin continuity)

b. Continuity to remote end

c. Crossed pairs

d. Reversed pairs

e. Split pairs

f. Shorts between two or more conductors

3.5.2.2 Fiber Optic Cable

Test fiber optic cable in accordance with TIA/EIA-455 and as further specified in this section. Two optical tests shall be performed on all optical fibers: Optical Time Domain Reflectometry (OTDR) Test, and Attenuation Test. In addition, a Bandwidth Test shall be performed on all multimode optical fibers. These tests shall be performed on the completed end-to-end spans which include the near-end pre-connectorized single fiber cable assembly, outside plant as specified, and the far-end pre-connectorized single fiber cable assembly.

a. OTDR Test: The OTDR test shall be used to determine the adequacy of the cable installations by showing any irregularities, such as discontinuities, micro-bendings or improper splices for the cable span under test. Hard copy fiber signature records shall be obtained from the OTDR for each fiber in each span and shall be included in the test results. The OTDR test shall be measured in both directions. A reference length of fiber, 66 feet minimum, used as the delay line shall be placed before the new end connector and after the far end patch panel connectors for inspection of connector signature. Conduct OTDR test and provide calculation or interpretation of results in accordance with TIA-526-7 for single-mode fiber and TIA-526-14 for multimode fiber. Splice losses shall not exceed 0.3 db.

b. Attenuation Test: End-to-end attenuation measurements shall be made on all fibers, in both directions, using a 1310 nanometer light source at one end and the optical power meter on the other end to verify that the cable system attenuation requirements are met in accordance with TIA-526-7 for single-mode fiber optic cables. The measurement method shall be in accordance with TIA-455-78-B. Attenuation losses shall not exceed 0.5 db/km at 1310 nm and 1550 nm for single-mode fiber. Attenuation losses shall not exceed 5.0 db/km at 850 nm and 1.5 db/km at 1300 nm for multimode fiber.

c. Bandwidth Test: The end-to-end bandwidth of all multimode fiber span links shall be measured by the frequency domain method. The bandwidth shall be measured in both directions on all fibers. The bandwidth

measurements shall be in accordance with TIA/EIA-455-204.

3.5.3 Soil Density Tests

a. Determine soil-density relationships for compaction of backfill material in accordance with ASTM D1557, Method D.

-- End of Section --

APPENDIX A

SID

Project Number: FTFA 21-JR05

Temporary Facility for 350th SWW
Eglin AFB, Florida

SID

STRUCTURAL INTERIOR DESIGN
FINAL SUBMITTAL

APRIL 14, 2023

HEFFERNAN HOLLAND MORGAN
ARCHITECTURE

JANEL FOWLER DESIGN
Interior Design • Space Planning

SECTION 1
SID TABLE OF CONTENTS


SECTION 1	TABLE OF CONTENTS		
SECTION 2	SID/FF&E NARRATIVE		
SECTION 3	SID Color Boards:	FLOOR FINISHES	BOARD #1
		RESTROOM FINISHES	BOARD #2
		WALL, TRIM & CEILING FINISHES	BOARD #3
	Documentation to support the Structural Interior Design Package:		
DRAWINGS:	I-101	Overall Furniture Plan	
	I-102	Partial Furniture Plan - West	
	I-103	Partial Furniture Plan - East	
	I-104	Overall Floor Finish Plan	
	I-105	Partial Signage & Wall Details - West	
	I-106	Partial Signage & Wall Details - East	
	I-107	Enlarged Systems Furniture Panel, Voice, Data & Power Plan - West	
	I-108	Enlarged Systems Furniture Panel, Voice, Data & Power Plan - East	
	I-601	Finish Schedule	
	I-602	Finish Legend and Wall Tile Elevation	
	I-603	Signage Schedule & Types	
SPECIFICATIONS:	09 06 00	SCHEDULE OF FINISHES	

The main objective of the Structural Interior Design (SID) shall be to provide a durable, easily maintained facility, with a high appearance retention factor. The majority of the flooring shall be modular carpet tiles in a multi-loop, graphic, large-scale pattern which is in the open and private offices and Conference/Team Rooms. The Communication, IT Workroom and Server Rooms shall have a no-wax, static dissipative tile floor. The Lobby, Storage Room, Corridors and Break Room shall have a woodgrain, luxury vinyl plank tile. A heavy duty, walk off carpet tile shall be installed in the Lobby. Porcelain tile shall be used on the floors in the Restrooms and Janitors Room. The walls shall be painted with impact resistant outside corner guards used in the corridors. Acoustical wall panels shall be used in the Training Room as indicated on the drawings. The restroom walls shall be full height ceramic tile to the floor with a coved metal, sanitary trim between the floor and wall tile. Metal trim shall also be used on any vertical outside corners. All counter/vanity tops shall be solid surface material. The toilet partitions shall be high-density polyethylene for durability and shall coordinate with the color scheme. The wood doors will be stained a color to coordinate with the wood grain furniture and woodgrain plank flooring. The permanent signage will consist of a painted acrylic face. For non-permanent rooms, the painted acrylic sign header is above a clear acrylic space for paper inserts. Exterior signs shall be painted metal to match the base standard. Use of low-emitting and recycled materials shall be considered. Materials shall be selected for their long-life span and warranty periods. Applicable codes and guidelines shall be considered in selection of materials and furnishings.

The Furniture, Fixtures & Equipment (FF&E) finishes shall be coordinated with the interior finishes. The open office systems furniture shall have 3” painted panel frames with stack on capabilities and acoustical, tackable tiles in a neutral panel fabric. The system shall have non-sequential tiles that are removable from the front and allow several pathways internally, in addition to the bottom and top raceways, for running cables. An 8-wire electrical system shall be provided with a circuit configuration to be determined by the next submittal. The furniture vendor shall install the factory provided power poles or base feeds to the junction boxes. The general contractor is responsible for hardwiring the feeds to the junction boxes. All the worksurfaces are fixed at 29” high to accept the users existing Versa desk top units for a sit/stand work environment.

The Conference and Team Room tables shall have laminate tops and bases and flush, data/power modules in the top except for the table in the team Room within the secured space. The multi-purpose tables in the Break Room shall have laminate tops with painted metal bases. The task chairs are multi-functional in the private and open offices and have less features for the Conference/Team Rooms. The executive guest seating in the private offices shall have wood frames and in other offices and Conference Room the chairs shall be metal frame with a wall saver feature. Both chair types shall have upholstered seats and backs. The Break Room shall have a polypropylene, plastic shell, armless, stack chair with a metal frame. The Training Room shall have armless chairs with a cushioned, upholstered seat and neutral mesh back with ganging brackets. An ESD stool shall be used in the IT Workroom and a standard task stool for the built-in, raised counter in the Control Room and at the workbench in the Facility Manager Office.

Other support furniture includes file cabinets, storage cabinets, marker boards, bulletin boards, and trash cans. Any audio-visual, security, video teleconference, printers, copiers, fax machines, specialty equipment, safes, recycle/shredder bins or computer equipment will be government furnished and government installed.

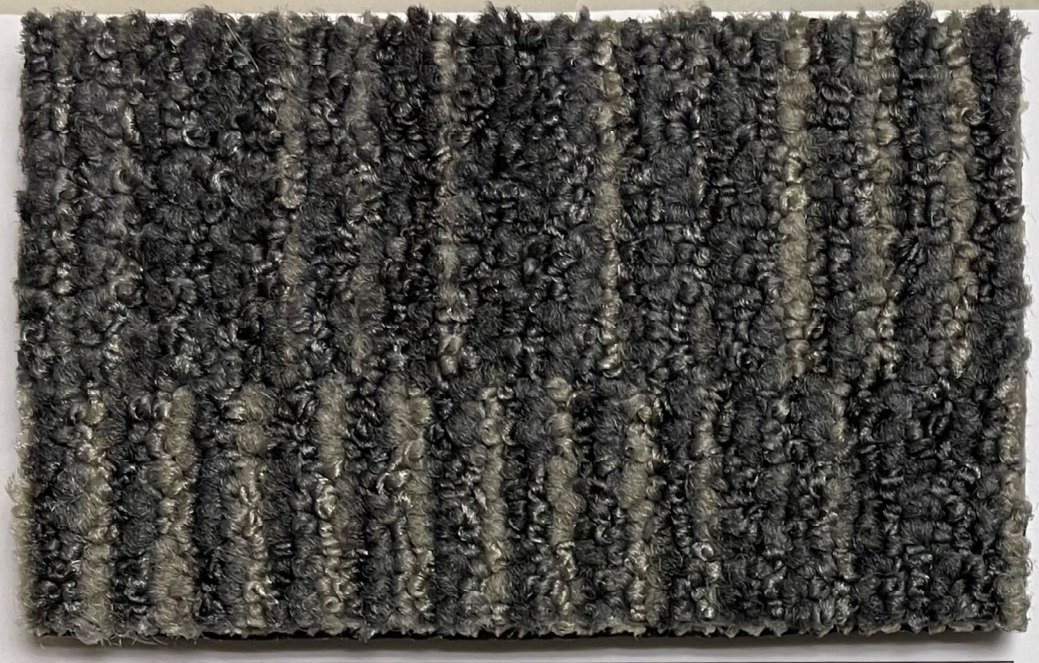

CPT-1 Carpet Tile



RB-1 Wall Base



LVT-1 Vinyl Plank Flooring



SDT-1 Static Dissipative Tile



WOT-1 Entrance Carpet Tile

HEFFERNAN HOLLAND MORGAN
ARCHITECTURE

JANEL
FOWLER
DESIGN

Floor Finishes


TEMPORARY FACILITY FOR 350TH SWW
PN FTFA 21-JR05
EGLIN AFB, FLORIDA



PT-1 & 2/PTB-1 Floor & Wall Base Tile



GR-1 Floor Tile Grout

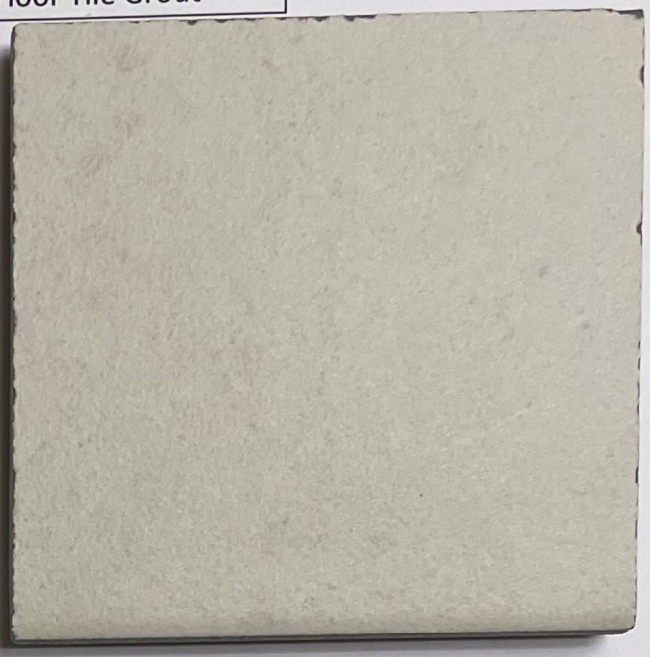


PWT-1 Field and Accent Wall Tile



SSM-1 Vanity top




PL-1 Vanity Skirt



GR-2 Wall Tile Grout



TP-1 HDPE Toilet Partitions & Screens

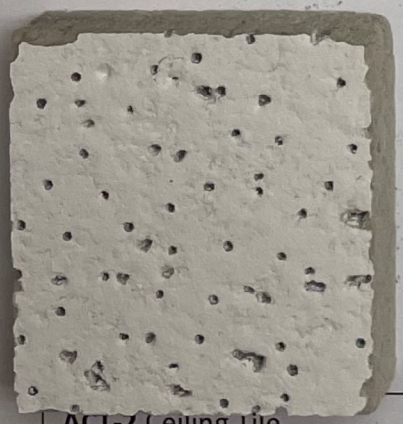

ACT-2 Ceiling Tile



Shower Wall/Floor

HEFFERNAN HOLLAND MORGAN
ARCHITECTURE
JANEL
FOWLER
DESIGN

Restroom Finishes

TEMPORARY FACILITY FOR 350TH SWW
PN FTFA 21-JR05
EGLIN AFB, FLORIDA




CG-1 Corner Guard and
SWC-1 Wall Protection



P-1 General Wall & Trim Paint



P-3 Accent Wall Paint

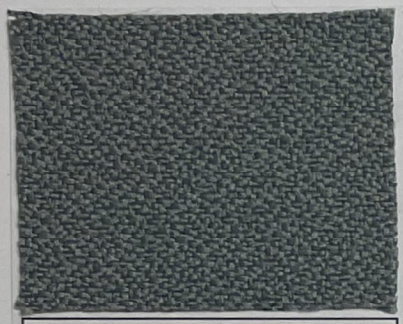

AWP-1 Acoustical Panels



WD-1 Wood Doors




SG-1 Signage Background



FRP-1 Wainscot in Janitor's Room



ACT-1 Ceiling Tile

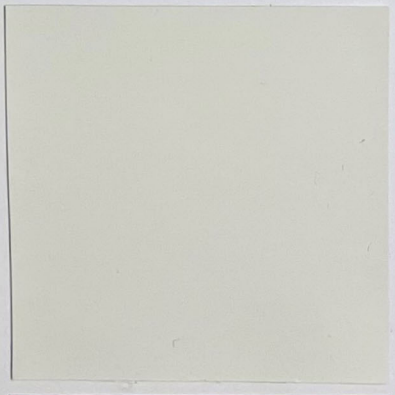


P-4 Ceiling Paint

HEFFERNAN HOLLAND MORGAN
ARCHITECTURE

JANEL
FOWLER
DESIGN

Wall, Trim & Ceiling Finishes

TEMPORARY FACILITY FOR 350TH SWW
PN FTFA 21-JR05
EGLIN AFB, FLORIDA

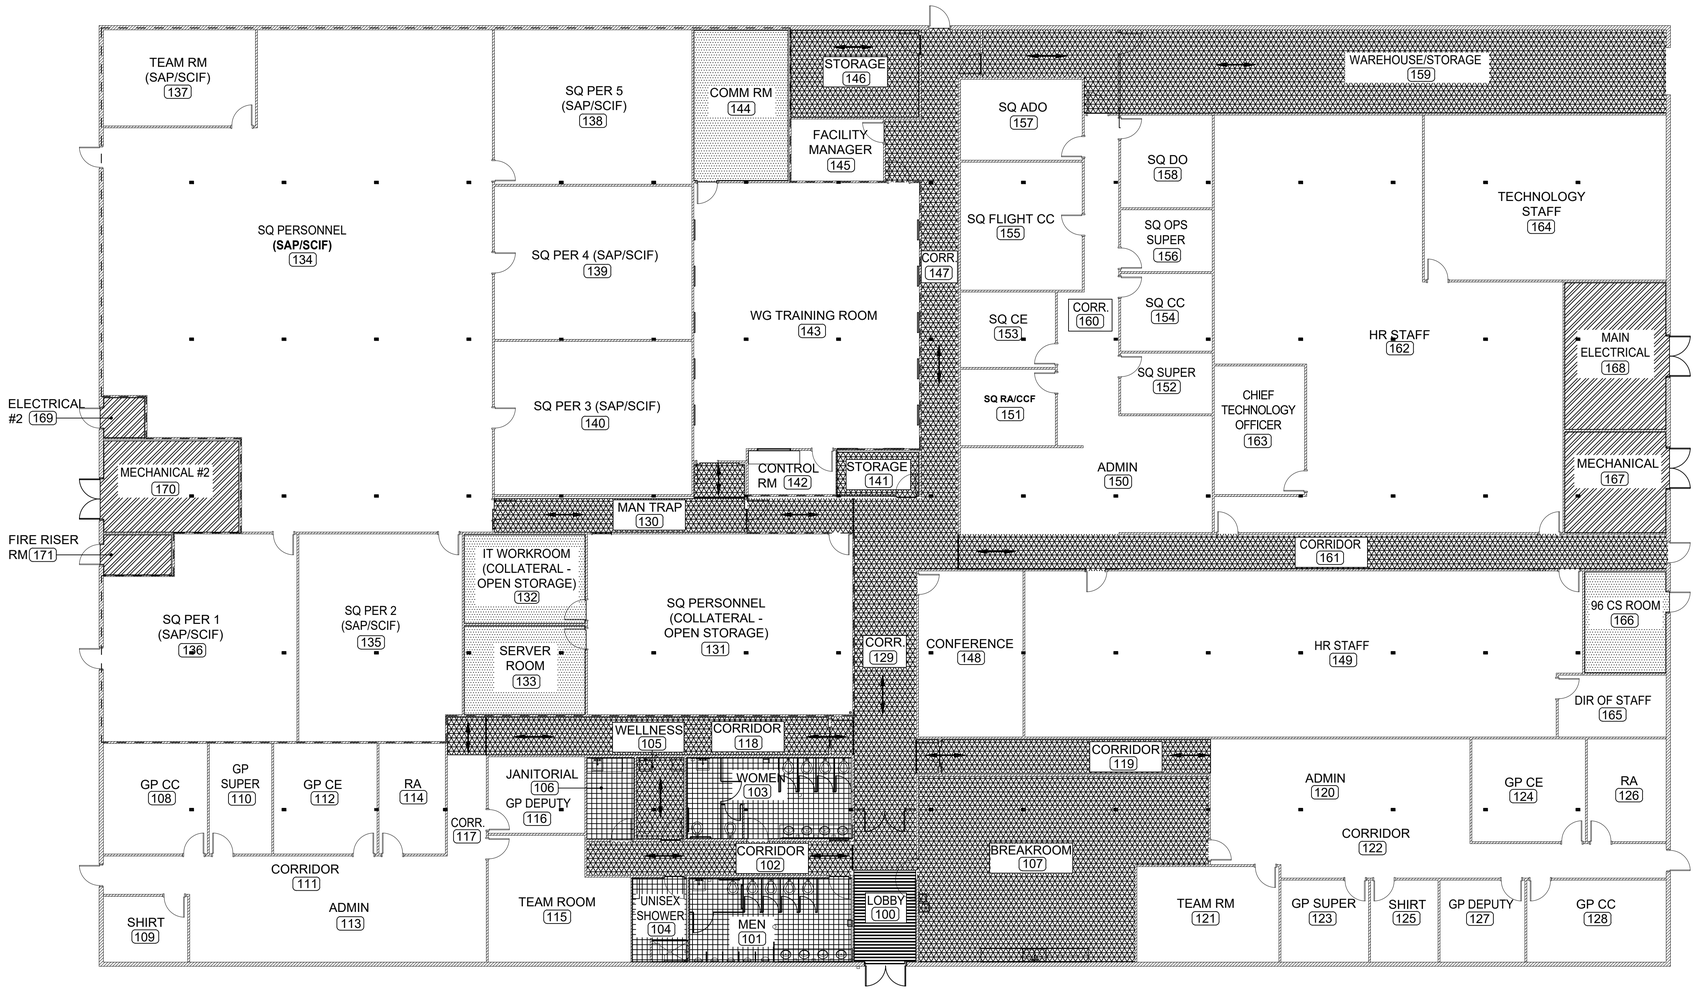

N

1 I-104

OVERALL FLOOR FINISH PLAN

3/32" = 1'-0"

10' 0' 10' 20'


SCALE: 3/32"=1'-0"

FLOOR FINISH & PATTERN LEGEND:

CPT1 LVT1 LVT2 PT1 WOT1 SDT1

NOTES:

1. REFER TO I-601 FINISH SCHEDULE AND I-602 FINISH LEGEND AND UFGS 09 06 00 SCHEDULE OF FINISHES FOR FINISH SPECIFICATIONS.
2. ALUMINUM TRANSITION STRIPS BY SCHLUTER OR EQUIVALENT SHALL BE INSTALLED AT ALL FLOORING TRANSITIONS.
3. LVT-1 SHALL BE INSTALLED IN A RANDOM PATTERN IN THE DIRECTION SHOWN BY ARROWS ON THE PLAN.
4. LVT-2 SHALL BE INSTALLED QUARTER TURNED AND SQUARE IN THE ROOMS.
5. CPT-1 CARPET TILES SHALL BE INSTALLED VERTICAL ASHLAR IN A HALFDROP.
6. INSTALL PT-1 WITH A ONE THIRD OFFSET.
7. INSTALL SDT-1 WITH GRAIN IN THE SAME DIRECTION AND SQUARE TO THE ROOM.
8. INSTALL WOT-1 WALK OFF TILES MONOLITHIC.
9. THE MANUFACTURERS RECOMMENDED ADHESIVE FOR LVT-1 IS TARKETT 959HM AND DUE TO THE POTENTIAL DIFFICULTY TO MAINTAIN A CONSISTENT TEMPERATURE IN THE ROOMS WITH LVT-2, THE ADHESIVE SHALL BE TARKETT 975 WHICH IS A TWO-PART URETHANE.



KEYPLAN

STATE of ALABAMA REGISTRATION NUMBER 70 Janel Fowler Janel N. Fowler 04/14/23 REGISTERED INTERIOR DESIGNER

JANEL FOWLER DESIGN
Interior Design • Space Planning

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT
DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J FOWLER
PROJ. ENGR J ECCLES

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
OVERALL FLOOR FINISH PLAN

APPROVED
96 CEG / CEN


DATE
14 APRIL 2023

APPROVED
BASE CIVIL ENGINEER

SCALE
AS SHOWN

INDEX NO.
I-104

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET 51 OF 143
23AE	FTFA 21-JR05	23AE		

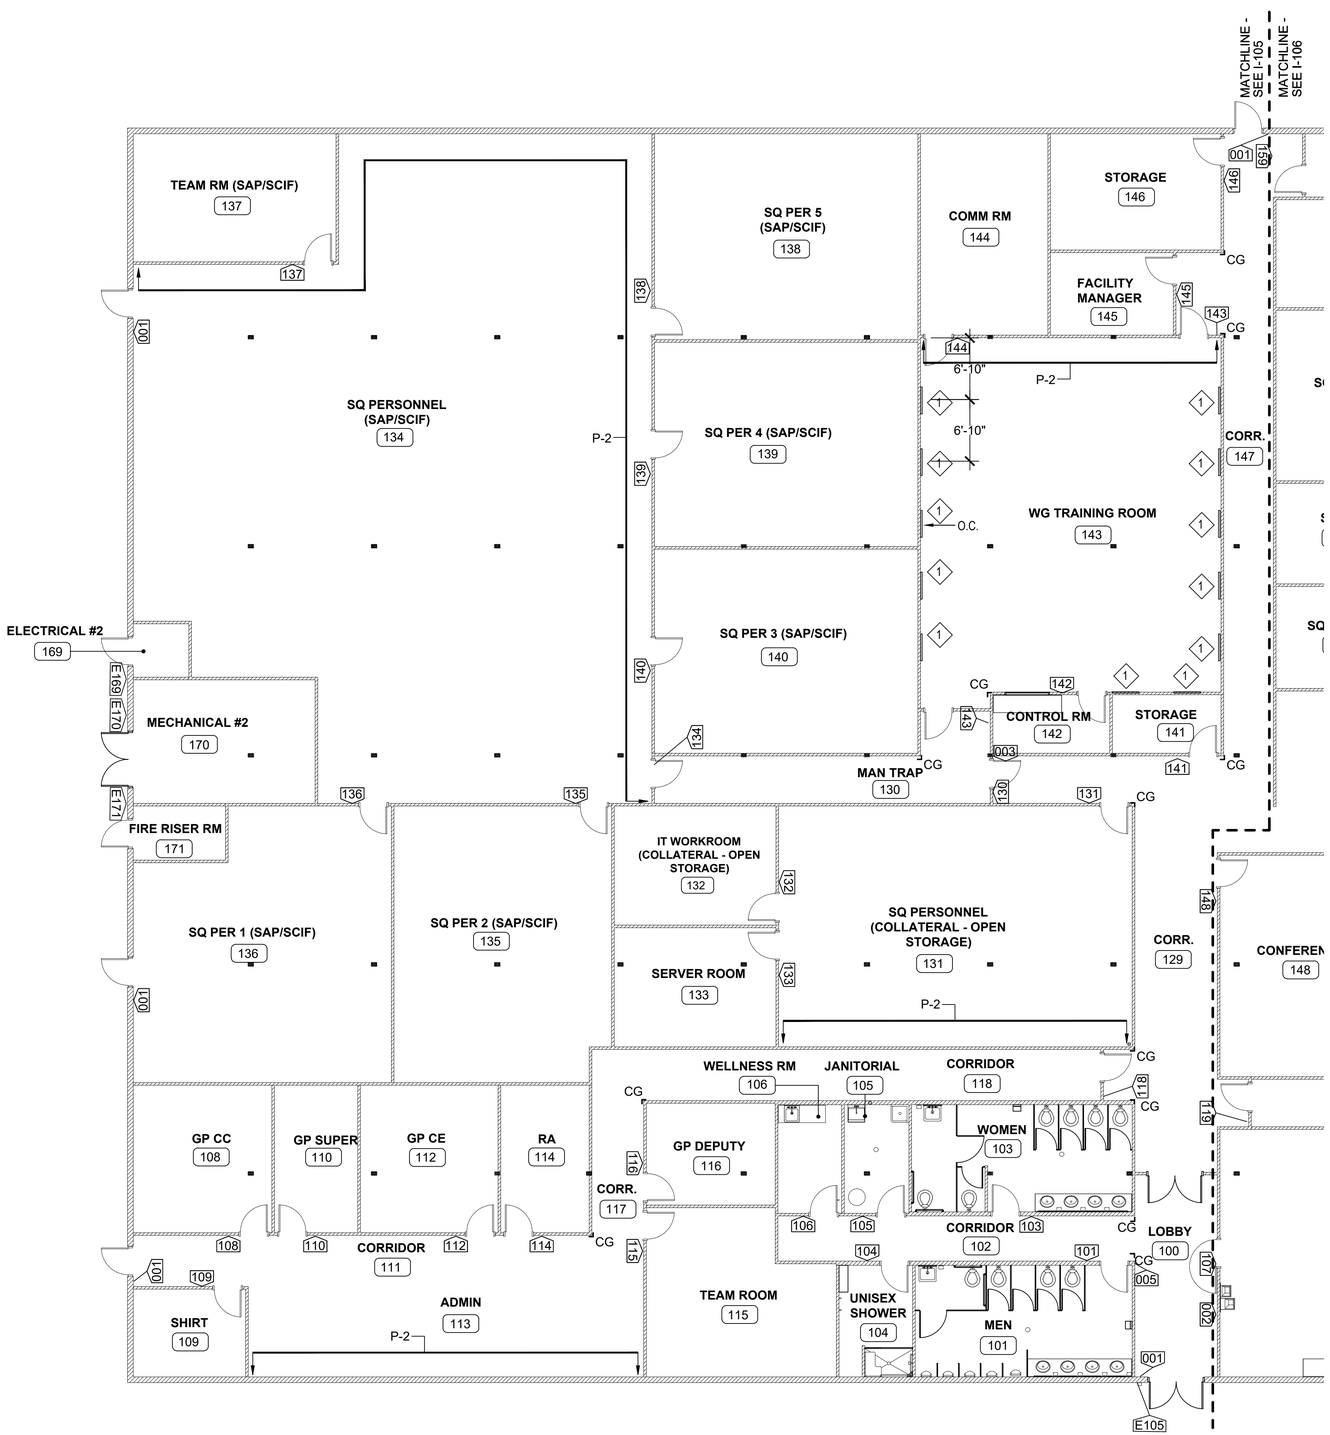


N

1 / I-105 PARTIAL SIGNAGE & WALL DETAILS-WEST

1/8" = 1'-0"

8' 0' 8' 16

SCALE: 1/8"=1'-0"



KEYPLAN

LEGEND:

XXX	ROOM SIGN SYMBOL - SEE SHEET I-602 FOR SIGNAGE SCHEDULE AND SIGN TYPES
⌐	WALL CORNER GUARDS
1	AWP -1 REFER TO NOTE 5.

NOTES:

1. REFER TO I-603 SIGNAGE SCHEDULE & TYPES.
2. REFER TO I-601 FINISH SCHEDULE & I-602 FINISH LEGEND AND UFGS 09 06 00 SCHEDULE OF FINISHES.
3. COORDINATE WALL DEVICES SUCH AS WALL MOUNTED PHONES, KEY PADS & SWITCHES WITH SIGNAGE PLACEMENT.
4. ACCENT WALL PAINT (P-2) LOCATIONS ARE SHOWN FOR CLARIFICATION.
5. 36" X 36" ACOUSTICAL WALL PANELS SHALL BE INSTALLED 6" FROM THE CEILING IN THE LOCATIONS AS SHOWN IN 143 WG TRAINING ROOM. SPACING AS DIMENSIONED.

STATE of ALABAMA REGISTRATION NUMBER 70 Janel Fowler 04/14/23 REGISTERED INTERIOR DESIGNER

JANEL FOWLER DESIGN
Interior Design • Space Planning

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT
DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J FOWLER
PROJ. ENGR J ECCLES

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
PARTIAL SIGNAGE & WALL DETAILS-WEST

APPROVED
96 CEG / CEN


APPROVED
BASE CIVIL ENGINEER

DATE
14 APRIL 2023

SCALE
AS SHOWN

INDEX NO.
I-105

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET
23AE	FTFA 21-JR05	23AE		52 OF 143

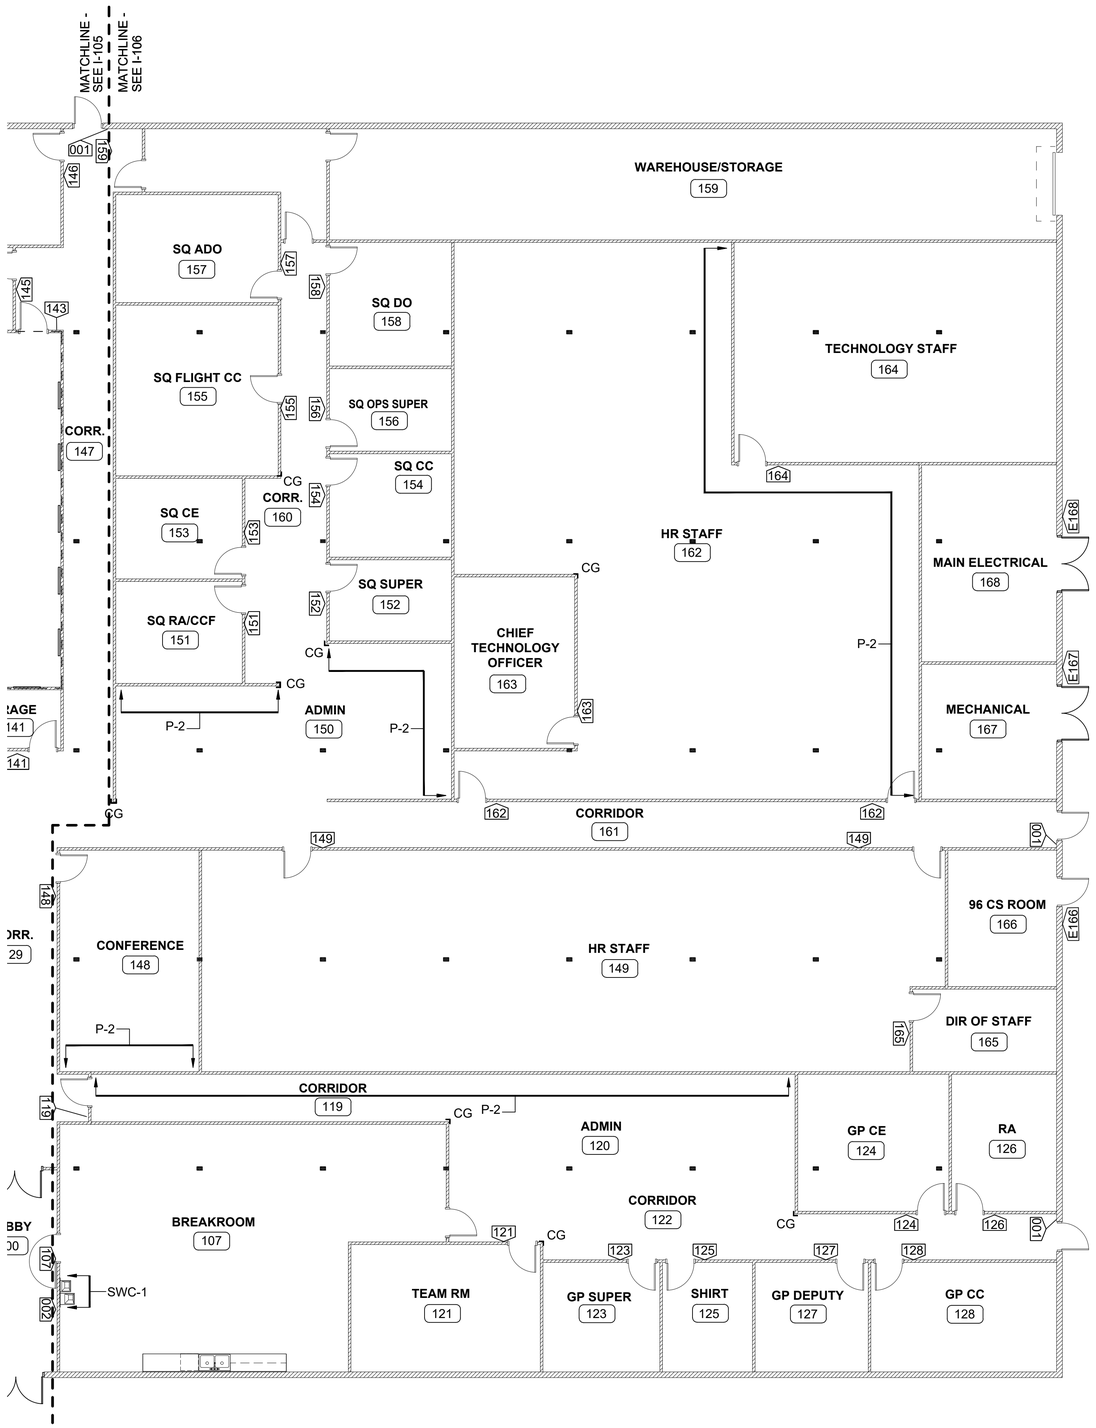

N


1 I-106

1/8" = 1'-0"

8' 0' 8' 16

SCALE: 1/8"=1'-0"

PARTIAL SIGNAGE & WALL DETAILS-WEST



KEYPLAN

LEGEND:

XXX — ROOM SIGN SYMBOL - SEE SHEET I-602 FOR SIGNAGE SCHEDULE AND SIGN TYPES

WALL CORNER GUARDS

NOTES:

1. REFER TO I-603 SIGNAGE SCHEDULE & TYPES.
2. REFER TO I-601 FINISH SCHEDULE & I-602 FINISH LEGEND AND UFGS 09 06 00 SCHEDULE OF FINISHES.
3. COORDINATE WALL DEVICES SUCH AS WALL MOUNTED PHONES, KEY PADS & SWITCHES WITH SIGNAGE PLACEMENT.
4. ACCENT WALL PAINT (P-2) LOCATIONS ARE SHOWN FOR CLARIFICATION.

REVISION	DATE	DESCRIPTION	BY	APPR'D

STATE of ALABAMA REGISTRATION NUMBER 70 Janel N. Fowler 04/14/23 REGISTERED INTERIOR DESIGNER

JANEL FOWLER DESIGN
Interior Design • Space Planning

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT
DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J.FOWLER
PROJ. ENGR J.ECCLES

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
PARTIAL SIGNAGE & WALL DETAILS-WEST

APPROVED
96 CEG / CEN


DATE
14 APRIL 2023

APPROVED
BASE CIVIL ENGINEER

SCALE
AS SHOWN

INDEX NO.
I-106

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET
23AE	FTFA 21-JR05	23AE		53 OF 143

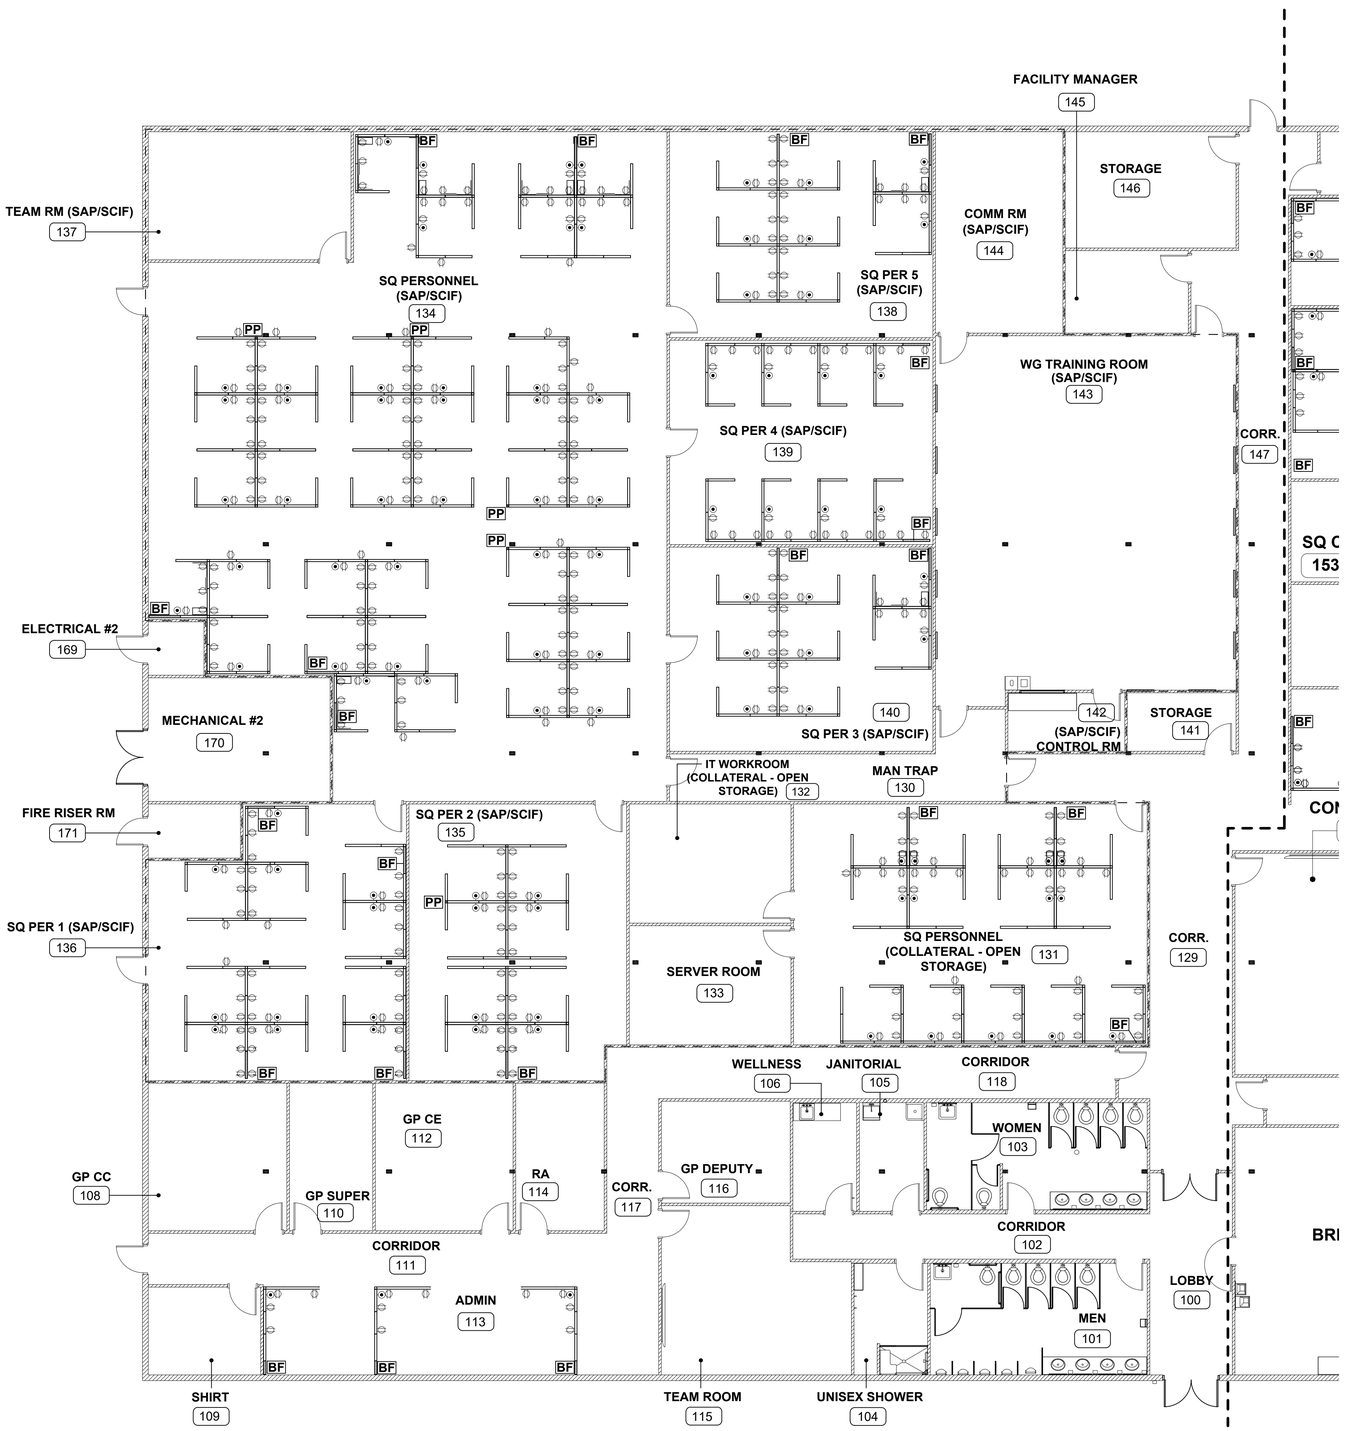

SYMBOL LEGEND:

- DUPLEX RECEPTACLE, 20 AMP
- OPENING FOR DATA
- BF — BASE FEED
- PP — POWER POLE

NOTES:

1. THE EXPOSED "L" & "T" INTERSECTIONS OF THE PANEL RUNS SHOULD HAVE A PREFORMED METAL FILLER COVER AND TOP CAP UNLESS INDICATED OTHERWISE.
2. THE PRE-WIRED, DUPLEX POWER OUTLETS SHALL BE IN THE BOTTOM, METAL RACEWAY. A THREE CIRCUIT POWER SYSTEM SHALL BE USED WITH TWO CIRCUITS SHARING A GROUND BUT WITH SEPARATE NEUTRALS AND ONE CIRCUIT WITH A SEPARATE NEUTRAL AND GROUND. (2) CIRCUIT #1 & (2) CIRCUIT #2 SHALL BE USED IN EACH WORKSTATION. REFER TO THE ELECTRICAL DRAWINGS FOR COORDINATION. TWO WORKSTATIONS PER CIRCUIT IN THE SECURED AREA AND EIGHT WORKSTATIONS PER CIRCUIT IN ALL OTHER AREAS.
3. THE MINIMUM NUMBER OF POWER RECEPTACLES PER WORKSTATION IS EIGHT.
4. REFER TO THE TELECOMMUNICATION PLANS AND SPECIFICATIONS FOR LOCATION AND INFORMATION OF THE FREESTANDING CEILING POLES.
5. THE SYSTEMS PANELS SHALL HAVE A FACTORY PROVIDED CEILING POLE WITH A POWER FEED WHICH SHALL BE CONNECTED TO THE BASE RACEWAY. THE WHIP SHALL BE HARDWIRED BY THE GENERAL CONTRACTORS ELECTRICIAN TO THE JUNCTION BOX ABOVE THE CEILING.
6. BASE FEEDS SHALL CONNECT TO THE JUNCTION BOX IN THE WALL AT THE END OF THE WORKSTATIONS WITH EXTRA CONDUIT COILED AND CONCEALED ON THE SIDE WITHIN THE 2' WORKSURFACE AREA OR PANEL WIDTH. THE OBJECTIVE IS TO NOT HAVE EXPOSED CONDUIT FROM THE BASE FEED BEYOND THE SYSTEM COMPONENTS. CONNECTION TO THE BUILIDNG SOURCE SHALL BE MADE BY THE GC'S ELECTRICIAN.

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT

DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J.FOWLER
PROJ. ENGR. J.ECCLES

STATE of ALABAMA REGISTRATION NUMBER 70 Janel Fowler Janel N. Fowler 04/14/23 REGISTERED INTERIOR DESIGNER

JANEL FOWLER DESIGN
Interior Design • Space Planning

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
ENLARGED SYSTEMS FURNITURE VOICE, DATA AND POWER PLAN - WEST

APPROVED
96 CEG / CEN


DATE
14 APRIL 2023

APPROVED
BASE CIVIL ENGINEER

SCALE
AS SHOWN

INDEX NO.
I-107

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET
23AE	FTFA 21-JR05	23AE		54 OF 143

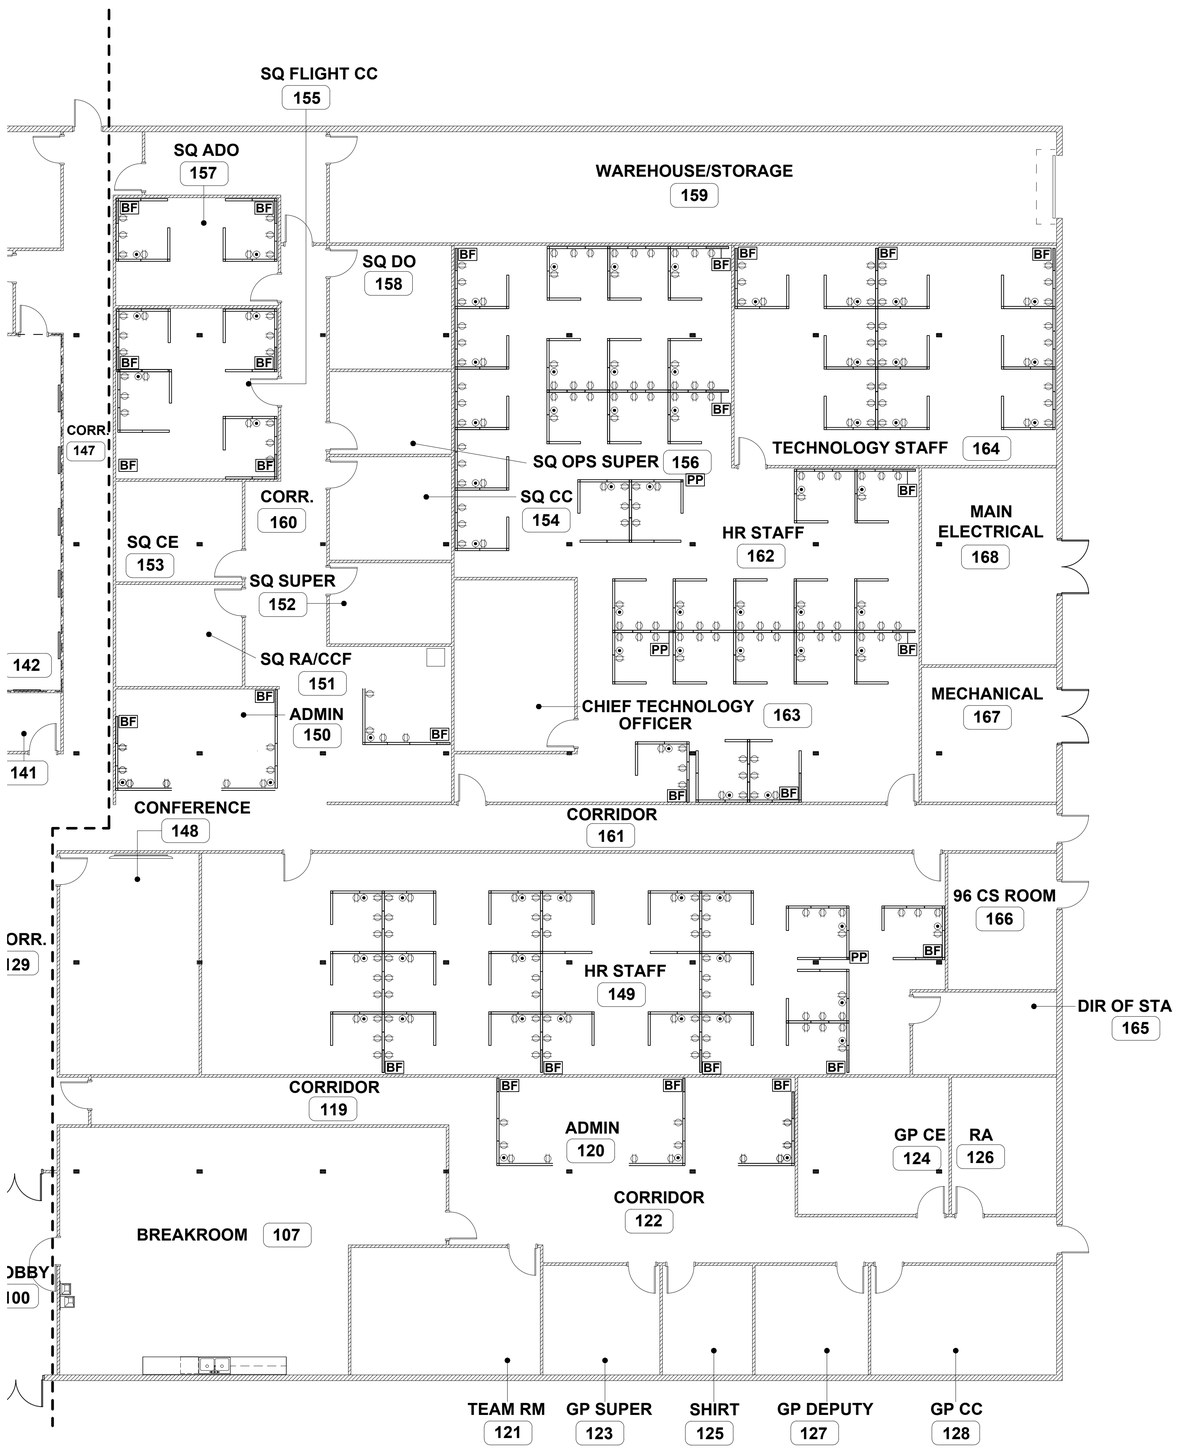

N


1
I-108

ENLARGED SYSTEMS FURNITURE VOICE, DATA AND POWER PLAN - EAST

1/8" = 1'-0"

8' 0' 8' 16

SCALE: 1/8"=1'-0"



KEYPLAN

SYMBOL LEGEND:

- DUPLEX RECEPTACLE, 20 AMP
- OPENING FOR DATA
- BF BASE FEED
- PP POWER POLE

NOTES:

1. THE EXPOSED "L" & "T" INTERSECTIONS OF THE PANEL RUNS SHOULD HAVE A PREFORMED METAL FILLER COVER AND TOP CAP UNLESS INDICATED OTHERWISE.
2. THE PRE-WIRED, DUPLEX POWER OUTLETS SHALL BE IN THE BOTTOM, METAL RACEWAY. A THREE CIRCUIT POWER SYSTEM SHALL BE USED WITH TWO CIRCUITS SHARING A GROUND BUT WITH SEPARATE NEUTRALS AND ONE CIRCUIT WITH A SEPARATE NEUTRAL AND GROUND. (2) CIRCUIT #1 & (2) CIRCUIT #2 SHALL BE USED IN EACH WORKSTATION. REFER TO THE ELECTRICAL DRAWINGS FOR COORDINATION. TWO WORKSTATIONS PER CIRCUIT IN THE SECURED AREA AND EIGHT WORKSTATIONS PER CIRCUIT IN ALL OTHER AREAS.
3. THE MINIMUM NUMBER OF POWER RECEPTACLES PER WORKSTATION IS EIGHT.
4. REFER TO THE TELECOMMUNICATION PLANS AND SPECIFICATIONS FOR LOCATION AND INFORMATION OF THE FREESTANDING CEILING POLES.
5. THE SYSTEMS PANELS SHALL HAVE A FACTORY PROVIDED CEILING POLE WITH A POWER FEED WHICH SHALL BE CONNECTED TO THE BASE RACEWAY. THE WHIP SHALL BE HARDWIRED BY THE GENERAL CONTRACTORS ELECTRICIAN TO THE JUNCTION BOX ABOVE THE CEILING.
6. BASE FEEDS SHALL CONNECT TO THE JUNCTION BOX IN THE WALL AT THE END OF THE WORKSTATIONS WITH EXTRA CONDUIT COILED AND CONCEALED ON THE SIDE WITHIN THE 2' WORKSURFACE AREA OR PANEL WIDTH. THE OBJECTIVE IS TO NOT HAVE EXPOSED CONDUIT FROM THE BASE FEED BEYOND THE SYSTEM COMPONENTS. CONNECTION TO THE BUILDNG SOURCE SHALL BE MADE BY THE GC'S ELECTRICIAN.

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT
DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J FOWLER
PROJ. ENGR J ECCLES

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
ENLARGED SYSTEMS FURNITURE VOICE, DATA AND POWER PLAN - EAST

STATE of ALABAMA REGISTRATION NUMBER 70 Janel Fowler Janel N. Fowler 04/14/23 REGISTERED INTERIOR DESIGNER

JANEL FOWLER DESIGN
Interior Design • Space Planning

APPROVED
96 CEG / CEN
DATE
14 APRIL 2023

APPROVED
BASE CIVIL ENGINEER
SCALE
AS SHOWN

INDEX NO.
I-108

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET 55 OF 143
23AE	FTFA 21-JR05	23AE		

FINISH SCHEDULE

ROOM NO.	ROOM NAME	FLOOR		BASE	NORTH WALLS		SOUTH WALLS		EAST WALLS		WEST WALLS		CEILING		REMARKS
		MATERIAL	FINISH		MATERIAL	FINISH	MATERIAL	FINISH	MATERIAL	FINISH	MATERIAL	FINISH	MATERIAL	FINISH	
100	LOBBY	PLY	LVT-1/WOT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
101	MEN	PLY	PT-1	-	GB	CWT-1	GB	CWT-1	GB	CWT-1	GB	CWT-1	ACT	ACT-2	1, 3
102	CORRIDOR	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
103	WOMEN	PLY	PT-1	-	MRGB	CWT-1	MRGB	CWT-1	MRGB	CWT-1	MRGB	CWT-1	ACT	ACT-2	1, 3
104	UNISEX SHOWER	PLY	PT-1	-	MRGB	P-1, CWT-1	MRGB	P-1, CWT-1	MRGB	P-1, CWT-1	MRGB	P-1, CWT-1	ACT	ACT-2	4
105	JANITOR	PLY	PT-1	PTB-1	MRGB	P-1, FRP-1	MRGB	P-1, FRP-1	MRGB	P-1, FRP-1	MRGB	P-1, FRP-1	ACT	ACT-2	5
106	WELLNESS	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	2
107	BREAK ROOM	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	2, 6, 7
108	GP CC	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
109	SHIRT	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
110	GP SUPER	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
111	CORRIDOR	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
112	GP CE	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
113	ADMIN	PLY	CPT-1	RB-1	GB	P-1	GB	P-2	GB	P-1	GB	P-1	ACT	ACT-1	
114	RA	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
115	TEAM ROOM	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
116	GP DEPUTY	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
117	CORRIDOR	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
118	CORRIDOR	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
119	CORRIDOR	PLY	LVT-1	RB-1	GB	P-2	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
120	ADMIN	PLY	CPT-1	RB-1	GB	P-2	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
121	TEAM ROOM	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
122	CORRIDOR	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
123	GP SUPER	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
124	GP CE	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
125	SHIRT	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
126	RA	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
127	GP DEPUTY	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
128	GP CC	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
129	CORRIDOR	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
130	MAN TRAP	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
131	SQ PERSONNEL	PLY	CPT-1	RB-1	GB	P-2	GB	P-2	GB	P-2	GB	P-1	ACT	ACT-1	
132	IT WORKROOM	PLY	SDT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
133	SERVER ROOM	PLY	SDT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
134	SQ PERSONNEL	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
135	SQ PER 2	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
136	SQ PER 1	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
137	TEAM ROOM	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
138	SQ PER 5	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
139	SQ PER 4	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
140	SQ PER 3	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
141	STORAGE	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
142	CONTROL ROOM	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
143	WG TRAINING ROOM	PLY	CPT-1	RB-1	GB	P-2	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	8
144	COMM	PLY	SDT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	GB	P-3	
145	FACILITY MANAGER	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
146	STORAGE	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
147	CORRIDOR	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
148	CONFERENCE	PLY	CPT-1	RB-1	GB	P-1	GB	P-2	GB	P-1	GB	P-1	ACT	ACT-1	
149	HR STAFF	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
150	ADMIN	PLY	CPT-1	RB-1	GB	P-2	GB	P-1	GB	P-2	GB	P-1	ACT	ACT-1	
151	SQ RA/CCF	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
152	SQ SUPER	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
153	SQ CE	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
154	SQ CC	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
155	SQ FLIGHT CC	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
156	SQ OPS SUPER	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
157	SQ ADO	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
158	SQ DO	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
159	WAREHOUSE / STORAGE	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
160	CORRIDOR	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
161	CORRIDOR	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
162	HR STAFF	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-2	GB	P-1	ACT	ACT-1	
163	CHIEF TECH OFFICER	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
164	TECHNOLOGY STAFF	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
165	DIRECTOR OF STAFF	PLY	CPT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	ACT	ACT-1	
166	96 CS ROOM	PLY	SDT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	GB	P-3	
167	MECHANICAL	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	EXP	P-3	
168	MAIN ELECTRICAL	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	GB	P-3	
169	ELECTRICAL #2	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	GB	P-3	
170	MECHANICAL #2	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	EXP	P-3	
171	FIRE RISER	PLY	LVT-1	RB-1	GB	P-1	GB	P-1	GB	P-1	GB	P-1	EXP	P-3	

KEY ABBREVIATIONS:

ACT	ACOUSTICAL CEILING TILE
AWP	ACOUSTICAL WALL PANEL
CG	CORNER GUARD
CONC	CONCRETE
CPT	CARPET TILE
CWT	CERAMIC WALL TILE
EXP	EXPOSED TO STRUCTURE
FRP	FIBERGLASS REINFORCED PANEL
GR	GROUT
GB	GYPSUM BOARD
LVT	LUXURY VINYL TILE
MRGB	MOISTURE RESISTANT GYPSUM BOARD
P	PAINT
PL	PLASTIC LAMINATE
PLY	PLYWOOD
PT	PORCELAIN TILE
PTB	PORCELAIN TILE BASE
RB	RUBBER BASE
TP	TOILET PARTITIONS
SDT	STATIC DISSIPATIVE TILE
SSM	SOLID SURFACE MATERIAL
SWC	SPECIALTY WALLCOVERING
WD	WOOD DOOR
WOT	WALK OFF TILE

REMARKS:

1. VANITY SKIRT SHALL BE PL-1 WITH SSM-1 TOP.
2. CABINETS SHALL BE PL-1 WITH SSM-1 COUNTER TOP.
3. TOILET PARTITIONS AND SCREENS SHALL BE TP-1.
4. SHOWERS SHALL BE SOLID SURFACE WALLS WITH MOSAIC TILE FLOOR.
5. WALLS SHALL BE PAINTED WITH A 48" HIGH, WAINSCOT (FRP-1) INSTALLED ABOVE THE WALL BASE.
6. SWC-1 SHALL BE INSTALLED ABOVE THE WALL BASE (RB-1) AND TO THE CEILING BEHIND THE WATER FOUNTAINS.
7. SWC-1 SHALL ALSO BE INSTALLED ABOVE THE SSM-1 BACKSPLASH IN THE BREAK ROOM. SHOULD BE INSTALLED HORIZONTALLY BETWEEN THE TOP AND OVERHEAD CABINET TO MINIMIZE SEAMS. THE AREA OVER THE SINK SHOULD BE INSTALLED VERTICALLY. TRIM PIECES SHOULD MATCH.
8. AWP-1 SHALL BE INSTALLED 6" FROM THE CEILING IN LOCATIONS WERE SHOWN ON I-105.

NOTES:

1. INTERIOR WOOD DOORS SHALL BE WD-1.
2. DOOR FRAMES SHALL BE PAINTED P-1.
3. CG-1 SHALL BE ON THE OUTSIDE CORNERS IN THE CORRIDOR.
4. REFER TO 1-104 FLOOR FINISH PLAN FOR DETAILS.
5. REFER TO I-105 & I-106 SIGNAGE & WALL DETAIL PLANS AND I-603 SIGNAGE SCHEDULE & TYPES.
6. REFER TO UFGS 09 06 00 SCHEDULE OF FINISHES FOR FURTHER DOCUMENTATION OF FINISHES.
7. PRODUCT DESCRIPTION AND DISCLAIMER; MANUFACTURER, STOCK NUMBER & SALIENT PRODUCT CHARACTERISTICS ARE LISTED FOR REFERENCE AND COLOR IDENTIFICATION PURPOSES ONLY. THE LISTING OF MANUFACTURER INFORMATION IS NOT INTENDED TO LIMIT THE SELECTION OF MATCHING

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT

DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J FOWLER
PROJ. ENGR. J ECCLES

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
FINISH SCHEDULE

JANEL FOWLER DESIGN
Interior Design • Space Planning

APPROVED
96 CEG / CEN

DATE
07 JULY 2022

APPROVED
BASE CIVIL ENGINEER

SCALE
AS SHOWN


INDEX NO.
I-601

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET
XXXX	FTFA21-JR05	XXXX		OF XX

95% SUBMITTAL - NOT FOR CONSTRUCTION

FINISH LEGEND

CODE	DESCRIPTION	REMARKS
ACT-1	MANU: ARMSTRONG, STYLE: ULTIMA #1941, TEGULAR EDGE, SIZE: 2' X 2' X 7/8", COLOR: WHITE, GRID: 15/16" WHITE	-
ACT-2	MANU: ARMSTRONG, STYLE: CERMAGUARD #607, PERFORATED, SQUARE EDGE, SIZE: 2' X 2' X 5/8", COLOR: WHITE, GRID: 15/16" WHITE	-
AWP-1	MANU: AVL, STYLE: ACOUSTECH WALL PANELS, BEVELED EDGE, SIZE: 3' X 3' X 1", FABRIC: GUILFORD /ANCHORAGE 2335 /SLATE 2017	-
CG-1	MANU: CS GROUP, STYLE: IMPACT RESISTANT PLASTIC, SURFACE MOUNTED, SIZE: 3" X 6' HIGH, COLOR: 934 PEARL	-
CPT-1	MANU: MILLIKEN, COLLECTION: STRAIGHT TALK 2.0, STYLE: EYE CONTACT EC520, COLOR: GRAVEL, SOLUTION DYED, SIZE: 19.7" X 19.7"	INSTALL VERTICAL ASHLAR WITH HALF DROP
FRP-1	MANU: CRANE COMPOSITES, STYLE: SEQUENTIA, TEXTURE: EMBOSSED, COLOR: WHITE	-
GR-1	MANU: CUSTOM BLDG. PRODUCTS, TYPE: FUSION PRO, COLOR: 183 CHATEAU	FLOOR TILE
GR-2	MANU: CUSTOM BLDG. PRODUCTS, TYPE: FUSION PRO, COLOR: 11 SNOW WHITE	WALL TILE
LVT-1	MANU: TARKETT, COLLECTION: ID LATITUDE, STYLE: WOOD , COLOR: PLWD 5136WW ACADIA PINE, SQUARE EDGE, 20 MIL, SIZE: 6" X 48" X 3 MM	UNIDIRECTIONAL
P-1	MANU: SHERWIN WILLIAMS, COLOR: SW7035 AESTHETIC WHITE	WALL & TRIM PAINT
P-2	MANU: SHERWIN WILLIAMS, COLOR: SW7649 SILVERPLATE	ACCENT WALL PAINT
P-3	MANU: SHERWIN WILLIAMS, COLOR: SW7005 PURE WHITE	CEILING PAINT
PL-1	MANU: FORMICA, PATTERN: WHITE TWILL 9285, FINISH: 58 MATTE	CABINETS
PT-1	MANU: DAL TILE, PATTERN: REMINISCENT, COLOR: RM21 AGED BEIGE, SIZE: 12" X 24" X 5/16"	FLOOR TILE
PT-2	MANU: DAL TILE, PATTERN: REMINISCENT, COLOR: RM21 AGED BEIGE SIZE: 2" X 2" X 1/4" , MOUNTED ON A 12" X 24" SHEET	TILE AROUND FLOOR DRAIN
PWT-1	MANU: DAL TILE, PATTERN: COVE CREEK, COLOR: CC08 OFF WHITE, SIZE: 12" X 24" X 5/16"	WALL TILE - FIELD
PWT-2	MANU: DAL TILE, PATTERN: COVE CREEK, COLOR: CC08 OFF WHITE, SIZE: 10" X 14" X 5/16"	WALL TILE - ACCENT
PTB-1	MANU: DAL TILE, PATTERN: REMINISCENT COVE BASE, COLOR: RM21 AGED BEIGE, SIZE: 6" X 12"	-
RB-1	MANU: TARKETT, SERIES: TRADITIONAL DURACOVE, STYLE: COVE BASE, SIZE: 4"H, COLOR: 27 MIST WG	-
SDT-1	MANU: TARKETT, STYLE: iQ GRANIT SD, COLOR: 0726 SIDEWALK, SIZE: 24" X 24" X .080"	-
SG-1	MANU: 2/90 SIGNS, STYLE: KLIKLESS, FACE: 703 COOL GREY, PERMANENT COPY: 208 WHITE, PAPER INSERT: WHITE, PRINT: BLACK	-
SSM-1	MANU: WILSONART, PATTERN/COLOR: 9208CS WHITE STONE	VANITY & COUNTER TOPS
SWC-1	MANU: CS GROUP, COLLECTION: IMPACT RESISTANT, SOLID COLOR: 934 PEARL, SIZE: 4' X 8' SHEET	BREAK RM BACKSPLASH
TP-1	MANU: SCRANTON, TYPE: HDPE, COLOR: SANDCASTLE	PARITIONS AND SCREENS
WD-1	MANU: MASONITE ARCHITECTURAL, STYLE: ASPIRO, TYPE: PLAIN SLICED SELECT WHITE BIRCH, COLOR: NUTMEG	-
WOT-1	MANU: MILLIKEN, COLLECTION: OBEX LOOP, STYLE: STACK, COLOR: SKL153-133 GREY, SIZE: 19.7" X 19.7" X .255" PILE HEIGHT	INSTALL MONOLITHIC

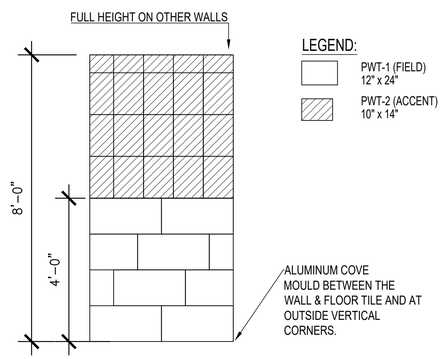

1 / I-602 WALL TILE ELEVATION FOR RESTROOMS

1/2" = 1'-0"

5' 2' 1'

SCALE: 1/2"=1'-0"

95% SUBMITTAL - NOT FOR CONSTRUCTION

KEY ABBREVIATIONS:

ACT	ACOUSTICAL CEILING TILE
AWP	ACOUSTICAL WALL PANEL
CG	CORNER GUARD
CONC	CONCRETE
CPT	CARPET TILE
CWT	CERAMIC WALL TILE
EXP	EXPOSED TO STRUCTURE
FRP	FIBERGLASS REINFORCED PANEL
GR	GROUT
GB	GYPSUM BOARD
LVT	LUXURY VINYL TILE
MRGB	MOISTURE RESISTANT GYPSUM BOARD
P	PAINT
PL	PLASTIC LAMINATE
PLY	PLYWOOD
PT	PORCELAIN TILE
PTB	PORCELAIN TILE BASE
RB	RUBBER BASE
TP	TOILET PARTITIONS
SDT	STATIC DISSIPATIVE TILE
SSM	SOLID SURFACE MATERIAL
SWC	SPECIALTY WALLCOVERING
WD	WOOD DOOR
WOT	WALK OFF TILE

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT

DATE

SIGNATURE

APPROVED

CENM

DRAWN BY J FOWLER

PROJ. ENGR. J ECCLES

TITLE

PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS

FINISH LEGEND & WALL ELEVATION

APPROVED
96 CEG / CEN

DATE
07 JULY 2022

APPROVED
BASE CIVIL ENGINEER

SCALE
AS SHOWN


JANEL FOWLER DESIGN
Interior Design • Space Planning

INDEX NO.
I-602


SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET OF
XXXX	FTFA21-JR05	XXXX		XX

SIGNAGE SCHEDULE


MARK	HEADER - PERMANENT COPY	INSERT COPY - INITIAL LINE(S)	INSERT COPY - ADDITIONAL LINE(S)	SIGN TYPE	QTY.	REMARKS
001	EXIT	-	-	B	8	
002	NO SMOKING			C	1	MOUNT 5'0" TO TOP
003	NO PERSONAL ELECTRONIC DEVICES ALLOWED IN THE BUILDING			G	1	MOUNT ON DOOR WITH ADHESIVE STRIPS
005	PZIOCB	(MISCELLANEOUS ROOM NAMES - TBD)		E	1	
E100	BLDG. NAME AND NUMBER		-	-	-	REFER TO A-201 FOR DETAILS
101	(SYMBOL)	MEN	-	D	1	
102	-	NOT USED	-	-	-	
103	(SYMBOL)	WOMEN	-	D	1	
104	104	UNISEX SHOWER	-	D	1	
105	105	JANITOR	-	H	1	
106	106	WELLNESS	-	A	1	
107	107	BREAK ROOM	-	A	1	
108	108	GP CC	-	A	1	
109	109	SHIRT	-	A	1	
110	110	GP SHIRT	-	A	1	
111	111	NOT USED	-	-	-	
112	112	GP CE	-	A	1	
113	113	IT / IA LEAD	-	A	1	
114	114	RA	-	A	1	
115	115	TEAM ROOM	-	F	1	
116	116	GP DEPUTY	-	A	1	
117	-	NOT USED	-	-	-	
118	118	350th SWG	-	A	1	
119	119	850th SWG	-	A	1	
120	-	NOT USED	-	-	-	
121	121	TEAM ROOM	-	F	1	
122	-	NOT USED	-	-	-	
123	123	GP SUPER	-	A	1	
124	124	GP CE	-	A	1	
125	125	SHIRT	-	A	1	
126	126	RA	-	F	1	
127	127	GP DEPUTY	-	A	1	
128	128	GP CC	-	A	1	
129	-	NOT USED	-	-	-	
130	130	XX EWS	SECURED ENTRANCE	A	1	
131	131	SQ PERSONNEL	-	A	1	
132	132	IT WORKROOM	-	A	1	
133	133	SERVER ROOM	-	A	1	
134	134	SQ PERSONNEL	-	A	1	
135	135	SQ PERSONNEL 2	-	A	1	
136	136	SQ PERSONNEL 1	-	A	1	
137	137	TEAM ROOM	-	F	1	
138	138	SQ PERSONNEL 5	-	A	1	
139	139	SQ PERSONNEL 4	-	A	1	
140	140	SQ PERSONNEL 3	-	A	1	
141	141	STORAGE	-	A	1	
142	142	CONTROL ROOM	-	A	1	
143	143	WG	TRAINING ROOM	F	2	
144	144	COMMUNICATIONS ROOM	-	G	1	
145	145	FACILITY MANAGER	-	A	1	
146	146	STORAGE	-	A	1	
147	-	NOT USED	-	-	-	
148	148	CONFERENCE	-	F	1	
149	149	HR STAFF	-	A	2	
150	-	NOT USED	-	-	-	
151	151	SQ RA/CCF	-	A	1	
152	152	SQ SUPER	-	A	1	
153	153	SQ CE	-	A	1	
154	154	SQ CC	-	A	1	
155	155	SQ FLIGHT CC	-	A	1	
156	156	SQ OPS SUPER	-	A	1	
157	157	SQ ADO	-	A	1	
158	158	SQ DO	-	A	1	
159	159	WAREHOUSE	-	A	1	
160	-	NOT USED	-	-	-	
161	-	NOT USED	-	-	-	
162	162	HR STAFF	-	A	2	
163	163	CHIEF TECHNOLOGY	OFFICER	A	1	
164	164	TECHNOLOGY STAFF	-	A	1	
165	165	DIRECTOR OF STAFF	-	A	1	
E166	-	96 CS ROOM	-	-	-	REFER TO A-201 FOR DETAILS
E167	-	MECHANICAL	-	-	-	REFER TO A-201 FOR DETAILS
E168	-	MAIN ELECTRICAL	-	-	-	REFER TO A-201 FOR DETAILS
E169	-	ELECTRICAL #2	-	-	-	REFER TO A-201 FOR DETAILS
E170	-	MECHANICAL 32	-	-	-	REFER TO A-201 FOR DETAILS
E171	-	FIRE RISER	-	-	-	REFER TO A-201 FOR DETAILS




SIGN TYPE A
3" = 1'-0"




SIGN TYPE B
3" = 1'-0"

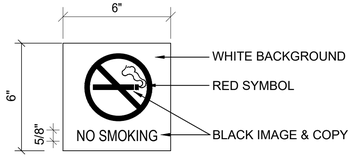


SIGN TYPE C
3" = 1'-0"




SIGN TYPE D
3" = 1'-0"

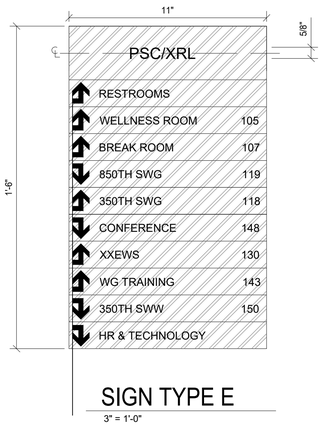


SIGN TYPE E
3" = 1'-0"




SIGN TYPE F
3" = 1'-0"

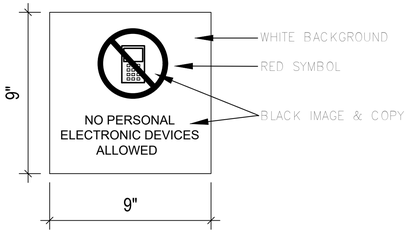

SIGN TYPE G
3" = 1'-0"



SIGN TYPE H
3" = 1'-0"

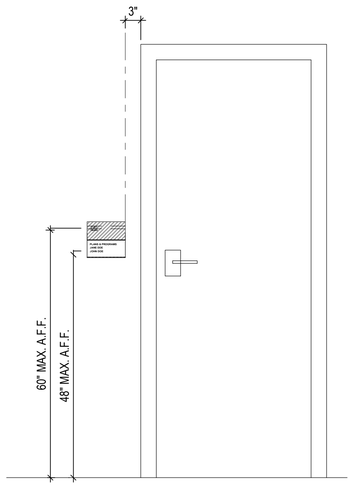

SIGN MOUNTING - TYPICAL
3/4" = 1'-0"

GENERAL NOTES :

1. REFER TO IG-101H, 102H, 103H & 104H SIGNAGE PLANS FOR LOCATION.
2. REFER TO IN-602H ROOM FINISH SCHEDULE AND UFGS 09 06 00 SCHEDULE OF FINISHES FOR FINISH SPECIFICATIONS.
3. ALL WORKSTATIONS SHALL HAVE SIGN TYPE B.
4. ALL SIGNS MOUNTED ON GLASS SHALL HAVE A SOLID COLOR BACKER PANEL ON THE OPPOSITE SIDE TO CONCEAL ADHESIVE STRIPS.
5. SIGNS SHOULD BE LOCATED ON THE LATCH SIDE OF THE DOOR AND MOUNTED ON THE ADJACENT SURFACE AS SHOWN IN THE SIGN MOUNTING TYPICAL ON THIS SHEET. SIGNS AT DOUBLE DOORS WITH TWO ACTIVE LEAFS SHALL BE LOCATED TO THE RIGHT OF THE RIGHT HAND DOOR. IF ONE LEAF IS INACTIVE THEN THE SIGN SHOULD BE MOUNTED ON THE DOOR.
6. SIGNAGE VENDOR SHOULD PROVIDE THE USER WITH A TEMPLATE IN MICROSOFT WORD OR EXCEL WITH THE FONT TYPE, SPACING, COLOR, ETC., FOR REPLACEMENT OF PAPER INSERTS. THE INITIAL INSERTS AND COPY SHOULD BE PROVIDED BY THE SIGNAGE VENDOR.
7. SIGNAGE SHALL COMPLY WITH UFC 3-120-01 DESIGN: SIGN STANDARDS AND ABA/ADA GUIDELINES.

1 SIGNAGE TYPES
12" 9" 6" 3" 0
SCALE: 3"=1'-0"

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT
DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J FOWLER
PROJ. ENGR. J ECCLES

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
SIGNAGE SCHEDULE & TYPES

JANEL FOWLER DESIGN
Interior Design • Space Planning

APPROVED
96 CEG / CEN
APPROVED
BASE CIVIL ENGINEER
DATE
07 JULY 2022
SCALE
AS SHOWN

INDEX NO.
I-603

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET OF XX
XXXX	FTFA21-JR05	XXXX		

95% SUBMITTAL - NOT FOR CONSTRUCTION

APPENDIX B

FF&E





Project Number: FTFA 21-JR05

Temporary Facility for 350th SWW
Eglin AFB, Florida

FF&E

FURNITURE, FIXTURES & EQUIPMENT
FINAL SUBMITTAL

APRIL 14, 2023

HEFFERNAN HOLLAND MORGAN
ARCHITECTURE

JANEL FOWLER DESIGN
Interior Design • Space Planning

SECTION 1
FF&E TABLE OF CONTENTS

SECTION 1	TABLE OF CONTENTS	
SECTION 2	SID / FF&E NARRATIVE	
SECTION 3	NOT USED	
SECTION 4	NOT USED	
SECTION 5	COST ESTIMATE	
SECTION 6	FURNITURE PLANS - SUBMITTED SEPARATELY	
	FF&E ORDER DATA SHEETS:	
SECTION 7	ACCESSORIES	
SECTION 8	CHAIRS & SEATING	
SECTION 9	DESKS	
SECTION 10	FILES & STORAGE	
SECTION 11	TABLES	
SECTION 12	SYSTEMS FURNITURE	
SECTION 13	FINISH COLOR BOARDS:	
	CHAIRS & SEATING FINISHES PRIVATE OFFICE 1 & 2 AND CONFERENCE FINISHES PRIVATE OFFICE 3 AND WORKSTATION FINISHES	BOARD #1 BOARD #2 BOARD #3

The main objective of the Structural Interior Design (SID) shall be to provide a durable, easily maintained facility, with a high appearance retention factor. The majority of the flooring shall be modular carpet tiles in a multi-loop, graphic, large-scale pattern which is in the open and private offices and Conference/Team Rooms. The Communication, IT Workroom and Server Rooms shall have a no-wax, static dissipative tile floor. The Lobby, Storage Room, Corridors and Break Room shall have a woodgrain, luxury vinyl plank tile. A heavy duty, walk off carpet tile shall be installed in the Lobby. Porcelain tile shall be used on the floors in the Restrooms and Janitors Room. The walls shall be painted with impact resistant outside corner guards used in the corridors. Acoustical wall panels shall be used in the Training Room as indicated on the drawings. The restroom walls shall be full height ceramic tile to the floor with a coved metal, sanitary trim between the floor and wall tile. Metal trim shall also be used on any vertical outside corners. All counter/vanity tops shall be solid surface material. The toilet partitions shall be high-density polyethylene for durability and shall coordinate with the color scheme. The wood doors will be stained a color to coordinate with the wood grain furniture and woodgrain plank flooring. The permanent signage will consist of a painted acrylic face. For non-permanent rooms, the painted acrylic sign header is above a clear acrylic space for paper inserts. Exterior signs shall be painted metal to match the base standard. Use of low-emitting and recycled materials shall be considered. Materials shall be selected for their long-life span and warranty periods. Applicable codes and guidelines shall be considered in selection of materials and furnishings.

The Furniture, Fixtures & Equipment (FF&E) finishes shall be coordinated with the interior finishes. The open office systems furniture shall have 3” painted panel frames with stack on capabilities and acoustical, tackable tiles in a neutral panel fabric. The system shall have non-sequential tiles that are removable from the front and allow several pathways internally, in addition to the bottom and top raceways, for running cables. An 8-wire electrical system shall be provided with a circuit configuration to be determined by the next submittal. The furniture vendor shall install the factory provided power poles or base feeds to the junction boxes. The general contractor is responsible for hardwiring the feeds to the junction boxes. All the worksurfaces are fixed at 29” high to accept the users existing Versa desk top units for a sit/stand work environment.

The Conference and Team Room tables shall have laminate tops and bases and flush, data/power modules in the top except for the table in the team Room within the secured space. The multi-purpose tables in the Break Room shall have laminate tops with painted metal bases. The task chairs are multi-functional in the private and open offices and have less features for the Conference/Team Rooms. The executive guest seating in the private offices shall have wood frames and in other offices and Conference Room the chairs shall be metal frame with a wall saver feature. Both chair types shall have upholstered seats and backs. The Break Room shall have a polypropylene, plastic shell, armless, stack chair with a metal frame. The Training Room shall have armless chairs with a cushioned, upholstered seat and neutral mesh back with ganging brackets. An ESD stool shall be used in the IT Workroom and a standard task stool for the built-in, raised counter in the Control Room and at the workbench in the Facility Manager Office.

Other support furniture includes file cabinets, storage cabinets, marker boards, bulletin boards, and trash cans. Any audio-visual, security, video teleconference, printers, copiers, fax machines, specialty equipment, safes, recycle/shredder bins or computer equipment will be government furnished and government installed.

SECTION 5


COST ESTIMATE

Code	Series	Description	Vendor/Manu	Qty	Cost Ea.	Ext Cost
ACCESSORIES						
A1	Glass	Glass markerboard with magnetic surface, 8'W x 4'H	Claridge	5	1,048.46	5,242.30
A2	800	Bulletin Board, colored cork, aluminum frame, 4'W x 4'H	Claridge	1	229.77	229.77
A3	Custom	Cell phone locker unit with 36 openings	Amcase	3	1,398.99	4,196.97
A4	Wastebasket	Rubbermaid, large, square wastebasket with lid	Alle	2	290.18	580.36
A5	Waste	Rubbermaid, 28 Qt. fire resistant wastebasket (at each desk/workstation)	Alle	209	7.30	1,525.70
A6	Slim Jim	Rubbermaid, tall waste can with a lid	Alle	3	114.05	342.15
A7	Recycle	Rubbermaid, paper recycle attachment	Alle	100	7.30	730.00
CHAIRS and SEATING						
C1	Amplify	Task chair; adjustable T arm; mesh back, upholstered seat, casters	Sit On It	24	333.74	8,009.76
C2	Timberlane	Guest chair, wood frame, upholstered seat and back	Nat'l Office Furn.	42	357.12	14,999.04
C3	Prava	Executive, high back, leather desk chair	Sit On It	5	625.67	3,128.35
C4	Amplify	Mid-back, fixed arm, mesh back, upholstered seat chair with casters	Sit On It	40	288.23	11,529.20
C5	Amplify	Task chair; adjustable T arm; mesh back, upholstered seat, casters	Sit On It	168	291.93	49,044.24
C6	Focus	Armless, stack chair with upholstered seat and back, plastic shell, ganging brackets	Sit On It	103	169.09	17,416.27
C7	Lumin	Armless, stack chair, plastic shell	Sit On It	41	122.84	5,036.44
C8	Amplify	Task chair; armless; mesh back, upholstered seat, casters	Sit On It	4	303.03	1,212.12
C9	Amplify	Task stool; adjustable T-arms; mesh back, upholstered seat, casters, for 36"-42" tops	Sit On It	2	338.92	677.84
C10	Weli	Lounge chair and ottoman, fully upholstered, metal feet	National Office	1	1,347.48	1,347.48
C11	Fusion ESD	Armless task stool, ESD, upholstered seat and back	Cramer	2	666.00	1,332.00
C12	Freelance	Side chair with arms, upholstered seat and back	Sit On It	29	190.92	5,536.68
C13	Freelance	Side stool with arms, upholstered seat and back, 24" seat height	Sit On It	3	246.42	739.26
DESKS						
D1	Waveworks	U-shaped, laminate desk w/ overhead hutch on credenza	Nat'l Office Furn.	5	3,153.24	15,766.20
D2	Central Park	Executive U-shaped, arc top desk, wood, credenza with hutch, two door storage	Dar Ran	5	6,379.66	31,898.30
D3	Dividends/Horizon	U-shaped desk w/overhead hutch on credenza, metal with laminate top	Knoll	10	1,951.70	19,517.00
D4	Antenna	Straight, computer desk, 24"D x 48"W, laminate	Knoll	4	319.62	1,278.48
D5	Lista Technical	Workbench, static dissipative top, overhead shelf, tool storage, outlet strip, 30"D x 72"W	WW Grainger	2	3,977.78	7,955.56
D6	Lista Technical	Workbench, tool storage, outlet strip, 30"D x 72"W	WW Grainger	1	2,877.78	2,877.78
D7	Antenna	Straight desk, laminate top, metal support, 30"D x 72"W	Knoll	3	357.63	1,072.89
FILES & STORAGE						
S1	Calibre	3 high, two door, metal storage cabinet, laminate top, 18"D x 36"W	Knoll	5	1,741.00	8,705.00
S2	Dividends/Horizon	Metal storage, laminate top, 2 high, storage cabinet with doors; 24" x 92"x29"H	Knoll	3	1,437.68	4,313.04
S3	Dividends/Horizon	2 drawer, metal lateral file, laminate top, metal bookcase on top 36"W	Knoll	10	736.45	7,364.50
S4	Q-Line	Open metal shelving, 12"D x 36"W	Tennsco	5	174.62	873.10
S5	Q-Line	Open metal shelving, 18"D x 36"W	Tennsco	4	192.53	770.12
S6	File Harbor	Metal cabinet with recessed sliding door, 18"D x 48"W x 83"H	Safco	4	2,450.61	9,802.44
S7	Key Cabinet	Metal, single hinged door cabinet, 60 keys max.	WW Grainger	1	214.74	214.74

SECTION 5

COST ESTIMATE

TABLES						
T1	Eloquence	End table, wood with laminate top, 24" x 21" x 20"H	Nat'l Office Furn.	4	413.28	1,653.12
T2	Central Park	Round, wood top and cylinder base, 42" diameter	Dar Ran	5	1,449.45	7,247.25
T3	Conference	Boat shaped laminate top & panel base, power modules, 36-48"W x 144"L	Nat'l Office Furn.	3	3,518.64	10,555.92
T3.1	Conference	Boat shaped laminate top & panel base, 36-48"W x 144"L	Nat'l Office Furn.	1	2,903.76	2,903.76
T4	Dividends/Horizon	Table with laminate top; metal base; 30"D x 84"L	Knoll	5	588.63	2,943.15
SYSTEMS FURNITURE						
WS1	Dividends	Systems furniture panels and components with a 42" high transaction counter	Knoll	7	3,417.18	23,920.26
WS1.1	Dividends	Systems furniture panels and components with a 42" high transaction counter	Knoll	2	3,449.25	6,898.50
WS2	Dividends	Systems furniture panels and components; 5'-6" x 6'-6"	Knoll	69	2,513.02	173,398.38
WS3	Dividends	Systems furniture panels and components; 6'-0" x 6'-6"	Knoll	95	1,925.89	182,959.55
	NOTE:		PRODUCT TOTAL:			657,744.97
			ESTIMATED FREIGHT:			3,198.59
			SUBTOTAL:			660,943.56
			INSTALLATION:		12%	78,929.40
			CONTINGENCY:		8%	52,875.48
			ESTIMATED GC HAR:		6%	39,656.61
			SUBTOTAL:			832,405.05
			TAX:		7.0%	58,268.35
			GRAND TOTAL:			890,673.41

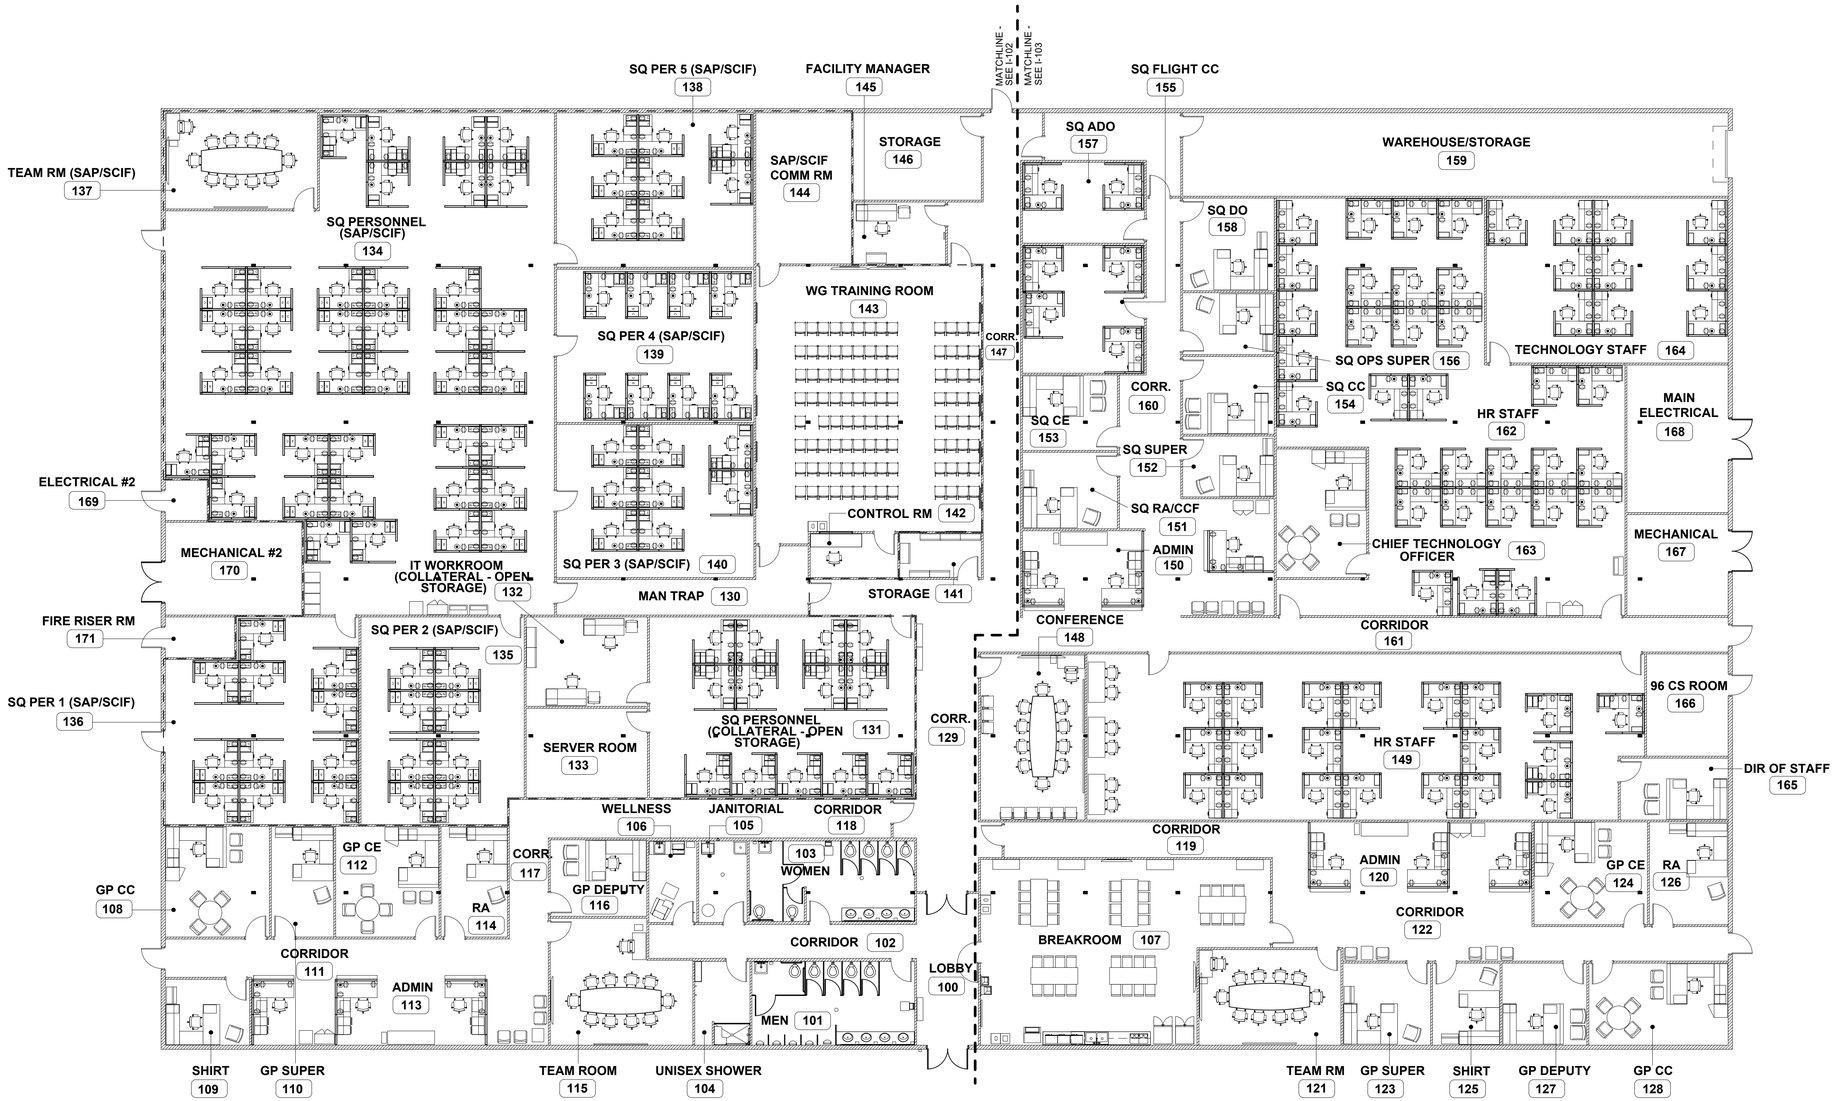

N


1 I-101

OVERALL FURNITURE PLAN

3/32" = 1'-0"

10' 0' 10' 20'

SCALE: 3/32"=1'-0"



KEYPLAN

STATE of ALABAMA REGISTRATION NUMBER 70 Janel Fowler Janel N. Fowler 04/14/23 REGISTERED INTERIOR DESIGNER

JANEL FOWLER DESIGN
Interior Design • Space Planning

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT

DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J FOWLER
PROJ. ENGR. J ECCLES

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
OVERALL FURNITURE PLAN

APPROVED
96 CEG / CEN


DATE
14 APRIL 2023

APPROVED
BASE CIVIL ENGINEER

SCALE
AS SHOWN

INDEX NO.
I-101

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET
23AE	FTFA 21-JR05	23AE		48 OF 143

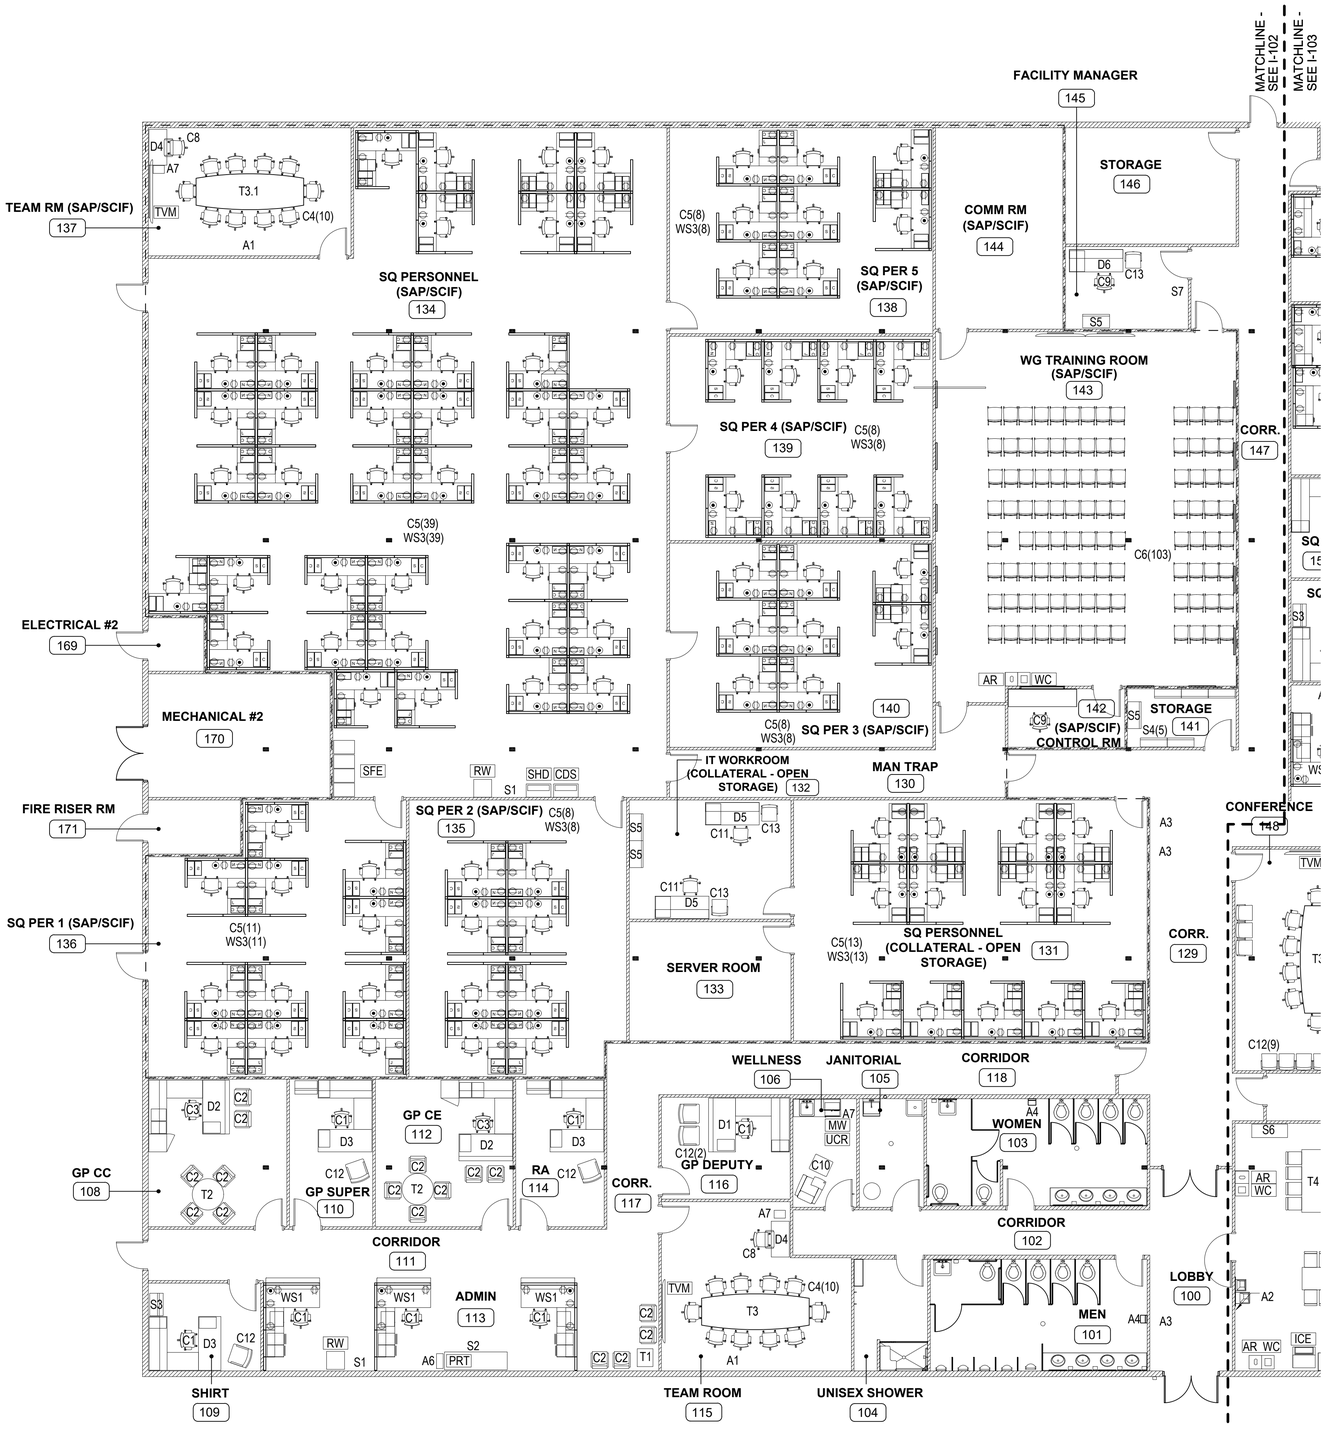

N

1 I-102

PARTIAL FURNITURE PLAN-WEST

1/8" = 1'-0"

8' 0' 8' 16

SCALE: 1/8"=1'-0"



KEYPLAN

GFGI EQUIPMENT LEGEND:

AR	ALUMINUM RECYCLING CAN
CDS	CD SHREDDER
CM	COFFEE MACHINE
MW	MICROWAVE
PRT	PRINTER
REF	REFRIGERATOR
RW	REFRIGERTOR/MICROWAVE UNIT
SFE	GSA APPROVED SAFE
SHD	SHREDDER
TVM	TV MONITOR
UCR	UNDERCOUNTER REFRIGERATOR
WC	WASTE CAN

FF&E LEGEND:

A	ACCESSORIES/AUDIO VISUAL
C	CHAIRS AND SEATING
D	DESKS
S	FILES & STORAGE
T	TABLES
WS	SYSTEMS FURNITURE WORKSTATIONS

NOTES:

1. IT IS THE INTENT OF THE GOVERNMENT FOR THE FF&E TO BE CONTRACTOR FURNISHED AND INSTALLED AS A BID OPTION. REFER TO THE APPENDIX B FF&E PACKAGE FOR MORE INFORMATION.
2. ALL FF&E AND SID SHALL BE COORDINATED BY THE GENERAL CONTRACTOR TO ENSURE ADEQUATE BLOCKING FOR WALL SUPPORTED ITEMS AND ELECTRICAL, COMMUNICATIONS, AUDIO VISUAL OR SECURITY INFRASTRUCTURE NEEDED TO INTERFACE WITH THE FURNITURE.
3. THE GC SHOULD CONFIRM THE FURNITURE LAYOUT AND TYPES IN THE EVENT THE BEST VALUE PRODUCT IS OTHER THAN THE MANUFACTURER USED FOR THE BASIS OF DESIGN. CRITICAL ITEMS, SUCH AS BASE FEEDS FOR POWER AND FLOOR GROMMETS AT THE CONFERENCE TABLE FOR COMM & POWER SHALL BE VERIFIED AND COORDINATED WITH THE FURNITURE VENDOR PRIOR TO ROUGH-IN OF ANY DEVICES.
4. THE SUCCESSFUL FF&E VENDOR SHALL BE RESPONSIBLE FOR COORDINATION WITH THE CONSTRUCTION DOCUMENTS, INCLUDING BUT NOT LIMITED TO ANY ELECTRICAL OR COMMUNICATION DEVICES AND SUPPORT NECESSARY TO HANG ANY WALL MOUNTED ITEMS.
5. WORKSURFACES DESIGNATED WITH NO MODESTY INTERFERENCE ON FREESTANDING DESKS SHALL PROVIDE CLEAR ACCESS TO WALL OUTLETS. THE GENERAL CONTRACTOR SHALL VERIFY AND COORDINATE THE WALL OUTLETS WITH THE FURNITURE VENDOR PRIOR TO ROUGH-IN OF DEVICES TO ENSURE THEY ARE ACCESSIBLE WITHIN THE CLEAR OPENING.
6. THE FACTORY PROVIDED POWER IN THE BASE OF THE SYSTEMS PANELS SHALL RUN DOWN THE SPINE OF EACH GROUPING WITH SOME OF THE ADJOINING PANELS ALSO HAVING POWER. THE VOICE AND DATA CABLES WILL BE TERMINATED BY OTHERS WHERE INDICATED.

WS3


24"D x 78"W worksurface with a mobile box/box/file pedestal

24"D x 48"W worksurface with a mobile box/box/file pedestal

3" thick x 64" high, tackable, acoustical panels with a metal frame and base with (4) duplex receptacles-below the worksurface &(1) data opening

Data Port

Duplex Receptacle

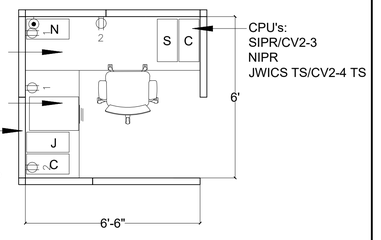

CPU's:
SIPR/CV2-3
NIPR
JWICS TS/CV2-4 TS

REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT

DATE

SIGNATURE

APPROVED

CENM

DRAWN BY J FOWLER

PROJ. ENGR J ECCLES

STATE of ALABAMA REGISTRATION NUMBER 70 Janel Fowler 04/14/23 REGISTERED INTERIOR DESIGNER

JANEL FOWLER DESIGN
Interior Design • Space Planning

TITLE

PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS

PARTIAL FURNITURE PLAN - WEST

APPROVED
96 CEG / CEN


DATE
14 APRIL 2023

APPROVED
BASE CIVIL ENGINEER

SCALE
AS SHOWN

INDEX NO.
I-102

SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET
23AE	FTFA 21-JR05	23AE		49 OF 143

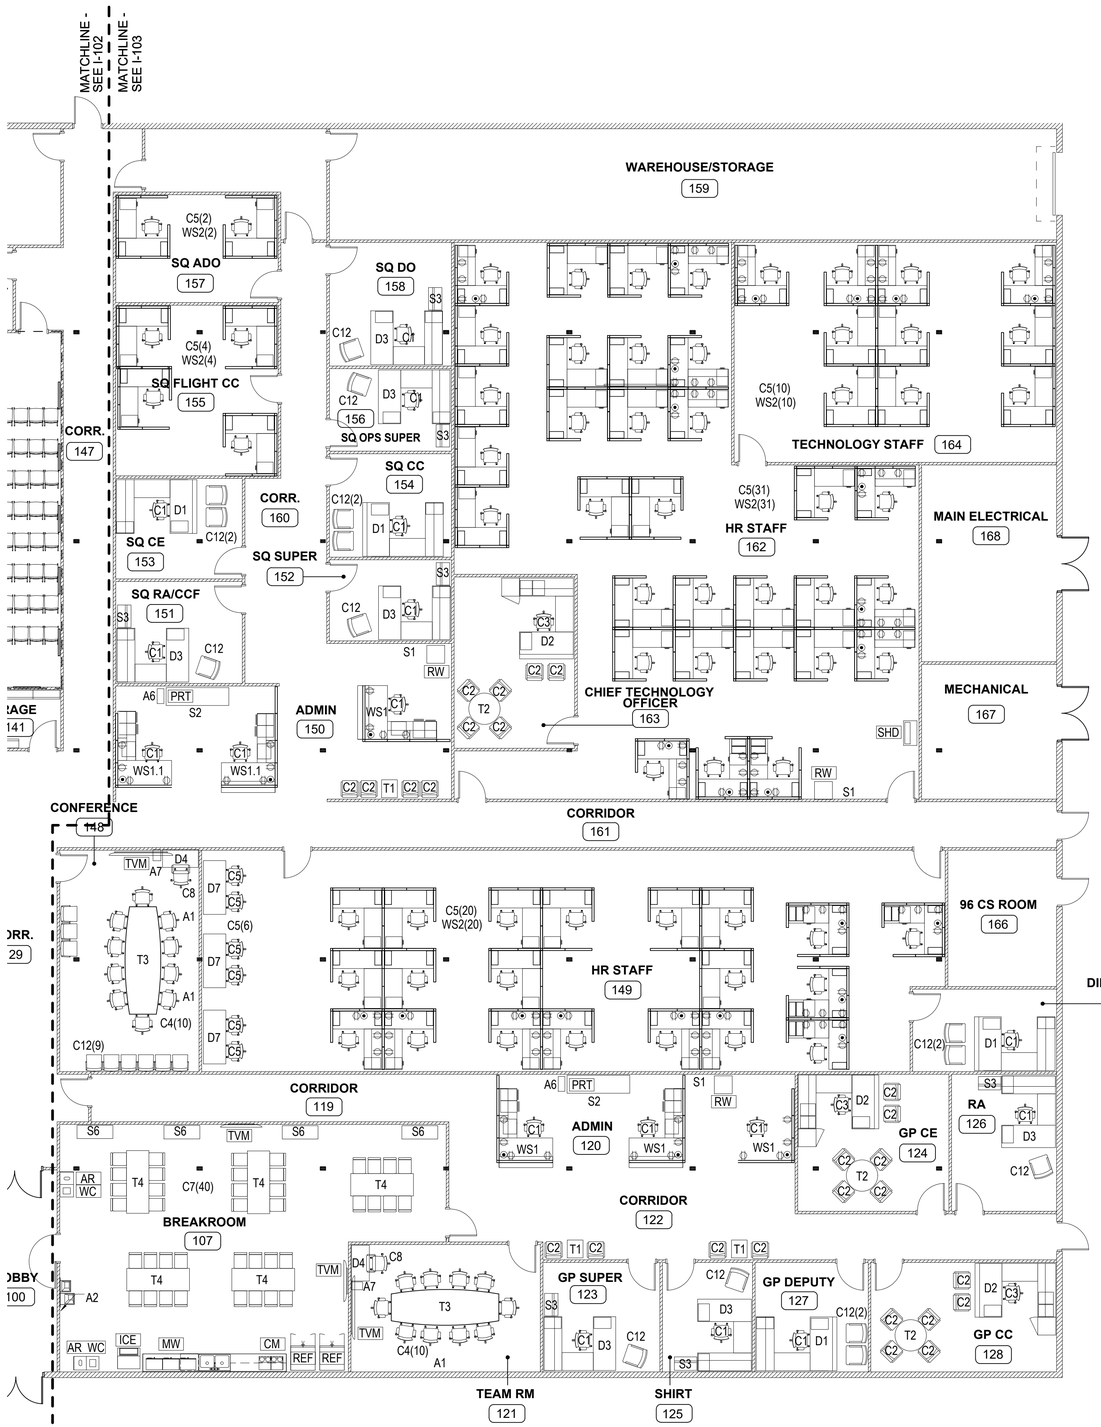

N


1 I-103

PARTIAL FURNITURE PLAN - EAST

1/8" = 1'-0"

8' 0' 8' 16

SCALE: 1/8"=1'-0"



KEYPLAN

GFGI EQUIPMENT LEGEND:

AR	ALUMINUM RECYCLING CAN
CDS	CD SHREDDER
CM	COFFEE MACHINE
MW	MICROWAVE
PRT	PRINTER
REF	REFRIGERATOR
RW	REFRIGERTOR/MICROWAVE UNIT
SFE	GSA APPROVED SAFE
SHD	SHREDDER
TVM	TV MONITOR
UCR	UNDERCOUNTER REFRIGERATOR
WC	WASTE CAN

FF&E LEGEND:

A	ACCESSORIES/AUDIO VISUAL
C	CHAIRS AND SEATING
D	DESKS
S	FILES & STORAGE
T	TABLES
WS	SYSTEMS FURNITURE WORKSTATIONS

NOTES:

1. IT IS THE INTENT OF THE GOVERNMENT FOR THE FF&E TO BE CONTRACTOR FURNISHED AND INSTALLED AS A BID OPTION. REFER TO THE APPENDIX B FF&E PACKAGE FOR MORE INFORMATION.
2. ALL FF&E AND SID SHALL BE COORDINATED BY THE GENERAL CONTRACTOR TO ENSURE ADEQUATE BLOCKING FOR WALL SUPPORTED ITEMS AND ELECTRICAL, COMMUNICATIONS, AUDIO VISUAL OR SECURITY INFRASTRUCTURE NEEDED TO INTERFACE WITH THE FURNITURE.
3. THE GC SHOULD CONFIRM THE FURNITURE LAYOUT AND TYPES IN THE EVENT THE BEST VALUE PRODUCT IS OTHER THAN THE MANUFACTURER USED FOR THE BASIS OF DESIGN. CRITICAL ITEMS, SUCH AS BASE FEEDS FOR POWER AND FLOOR GROMMETS AT THE CONFERENCE TABLE FOR COMM & POWER SHALL BE VERIFIED AND COORDINATED WITH THE FURNITURE VENDOR PRIOR TO ROUGH-IN OF ANY DEVICES.
4. THE SUCCESSFUL FF&E VENDOR SHALL BE RESPONSIBLE FOR COORDINATION WITH THE CONSTRUCTION DOCUMENTS, INCLUDING BUT NOT LIMITED TO ANY ELECTRICAL OR COMMUNICATION DEVICES AND SUPPORT NECESSARY TO HANG ANY WALL MOUNTED ITEMS.
5. WORKSURFACES DESIGNATED WITH NO MODESTY INTERFERENCE ON FREESTANDING DESKS SHALL PROVIDE CLEAR ACCESS TO WALL OUTLETS. THE GENERAL CONTRACTOR SHALL VERIFY AND COORDINATE THE WALL OUTLETS WITH THE FURNITURE VENDOR PRIOR TO ROUGH-IN OF DEVICES TO ENSURE THEY ARE ACCESSIBLE WITHIN THE CLEAR OPENING.
6. THE FACTORY PROVIDED POWER IN THE BASE OF THE SYSTEMS PANELS SHALL RUN DOWN THE SPINE OF EACH GROUPING WITH SOME OF THE ADJOINING PANELS ALSO HAVING POWER. THE VOICE AND DATA CABLES WILL BE TERMINATED BY OTHERS WHERE INDICATED.

WS2


24"D x 66"W worksurface with a mobile box/box/file pedestal

24"D x 54"W worksurface with a mobile box/box/file pedestal

3" thick x 64" high, tackable, acoustical panels with a metal frame and base with (4) duplex receptacles-below the worksurface &(1) data opening

Data Port

Duplex Receptacle



REVISION	DATE	DESCRIPTION	BY	APPR'D

BASE CIVIL ENGINEER
EGLIN AIR FORCE BASE, FLORIDA

AS - BUILT

DATE
SIGNATURE
APPROVED
CENM
DRAWN BY J FOWLER
PROJ. ENGR. J ECCLES

STATE of ALABAMA REGISTRATION NUMBER 70 Janel Fowler Janel N. Fowler 04/14/23 REGISTERED INTERIOR DESIGNER

JANEL FOWLER DESIGN
Interior Design • Space Planning

TITLE
PZIOCB / DSN - TEMPORARY FACILITY FOR 350TH SWW

CONTENTS
PARTIAL FURNITURE PLAN - EAST

APPROVED
96 CEG / CEN

DATE
14 APRIL 2023

APPROVED
BASE CIVIL ENGINEER

SCALE
AS SHOWN

INDEX NO.
I-103


SPEC. NO.	PROJ. NO.	DRAWING NO.	FILE NO.	SHEET
23AE	FTFA 21-JR05	23AE		50 OF 143

SECTION 7
ACCESSORIES

1.	Location Code	**A-1**
2.	FSC Group	71, PART I
3.	GSA Contract Number	GS-28F-0042U; SIN 711-20
4.	Expiration Date	9/2/2023
5.	Contractor	Claridge Products and Equipment 601 Hwy 62 65S Harrison, AR 72601-6148 410-721-8803
6.	Catalog Name:	**Glass Dry Erase Whiteboard**
7.	Catalog Number:	MGM-48
8.	Catalog Description:	Wall mounted, magnetic dry erase marker board; 1/4" low-iron, ultra clear glass; frameless with standoff mount; magnetic slim marker tray, 8 grey, rare earth magnets; magnetic eraser and dry erase markers.
9.	Dimensions:	8' wide x 4' high
10.	Finish:	Porcelain: Calm White



Calm White



Standoff Edge Mount

Note: Install Glass Board Landscaped at 36" Above Finished Floor to Underside of Board.


11. Room Name		Quantity
Team Room	115	1
Conference	121	1
Conference	148	2
Team Room	137	1

12. Total Quantity	5
13. Unit Cost	$1,048.46
14. Extended Cost	$5,242.30

end of order

SECTION 7
ACCESSORIES

1.	Location Code	**A-2**
2.	FSC Group	71, PART I
3.	GSA Contract Number	GS-28F-0042U; SIN 711-20
4.	Expiration Date	9/2/2018
5.	Contractor	Claridge Products and Equipment 601 Hwy 62 65S Harrison, AR 72601-6148 410-721-8803
6.	Catalog Name:	**Tackboard - 800 Series**
7.	Catalog Number:	C-852CC
8.	Catalog Description:	Tackboard - Type CO; smooth resilient colored cork surface; 5/8" faced aluminum frame; angle clip hangers. Manufacturers Standard 1 Year Warranty.
9.	Dimensions:	48"H x 72" L
10.	Finish:	Designer Cork Color: 1111 Smoke Frame: Anodized Aluminum

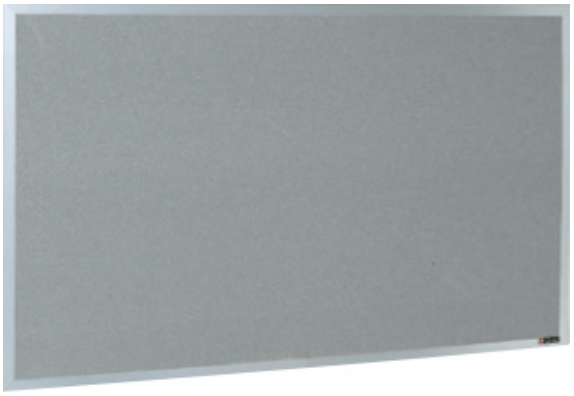



Cork Color



Perimeter Trim image


Note: Install White Board 36" Above Finished Floor to Underside of Board.


11.	Room Name		Quantity
	Break Room	107	1

12.	Total Quantity	1
13.	Unit Cost	$229.77
14.	Extended Cost	$229.77
15.	Freight:	Included

end of order

1.	Location Code	**A-3**
2.	FSC Group	71
3.	GSA Contract Number	47QSMA20D08PJ
4.	Expiration Date	3/4/2025
5.	Contractor	Amcase, Inc. 839-F Quince Orchard Blvd. Gaithersburg, MD 20878 301.591.1480
6.	Catalog Name:	**Cell Phone Lockers - Custom**
7.	Catalog Number:	AMM06X36
8.	Catalog Description:	High pressure laminate, open cubbies, 36 total, interior dimensions 6" wide x 6" high x 9" deep, self edges in matching laminate, overhead hanging rail, 1-1/2" round, stainless steel number plates.
9.	Dimensions:	Each: 41-1/4"W x 10-1/2"D x 41-1/4""H
10.	Finish:	133 Sheer Mesh

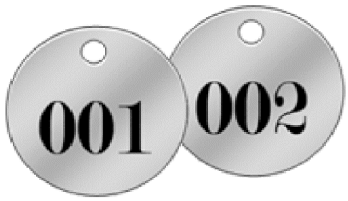

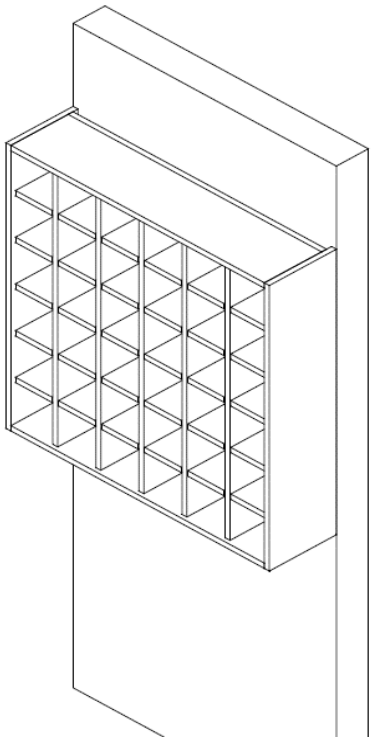

NOTE: Install cell phone locker units 34" above the finished floor.

11.	Room Name	Rm. No.	Quantity
	Lobby	101	1
	Corridor	129	2

12.	Total Quantity	3
13.	Unit Cost	$1,398.99
14.	Extended Cost	$4,196.97
15.	Freight (FOB Destination)	see Cost Estimate

end of order

SECTION 7
ACCESSORIES

1.	Location Code		**A-4**
2.	FSC Group	73	
3.	GSA Contract Number	GS-07F-0026T	
4.	Expiration Date	9/30/2021	
5.	Contractor	Alle Designs LLC 27 Ruskin Road Amherst, NY 14226 Ph: 716.446.5538	
6.	Catalog Name:	**Slim Jim Wastebasket - Rubbermaid**	
7.	Catalog Number:	3958 / 2664 top	
8.	Catalog Description:	Square waste container consisting of durable, all-plastic construction. Convenient and easy to clean with long lasting durability. Swing top provides easy access for trash disposal and then swings back to hide trash from the public view.	
9.	Dimensions:	Can:	19.5"W x 19.5"L x 27.625"H
		Lid:	20.125"W x 20.125"L x 6.25"H
10.	Finish:		Beige





11.	Room Name	Rm. No.	Quantity
	Men	101	1
	Women	103	1

12.	Total Quantity	2
13.	Unit Cost	$290.18
14.	Extended Cost	$580.36
15.	Freight (FOB Destination)	see Cost Estimate

end of order

SECTION 7
ACCESSORIES

1.	Location Code	**A-5**
2.	FSC Group	73
3.	GSA Contract Number	GS-07F-0026T
4.	Expiration Date	9/30/2021
5.	Contractor	Alle Designs LLC 27 Ruskin Road Amherst, NY 14226 Ph: 716.446.5538
6.	Catalog Name:	**Wastebasket**
7.	Catalog Number:	8128
8.	Catalog Description:	28 1/2 Quart Personal Wastebasket with soft radius corners; rolled edges; dent and crush resistant; leak proof; 20% recycled content.
9.	Dimensions:	14.5"L X 10.25"W X 15"H
10.	Finish:	Beige



11.	Room Name	Rm. No.	Quantity
	All desks		35
	All workstations		170
	Conf/Team Rooms		4

12.	Total Quantity	209
13.	Unit Cost	$7.30
14.	Extended Cost	$1,525.70
15.	Freight (FOB Destination)	see Cost Estimate

end of order

SECTION 7
ACCESSORIES

1.	Location Code	**A-6**
2.	FSC Group	73
3.	GSA Contract Number	GS-07F-0026T
4.	Expiration Date	9/30/2021
5.	Contractor	Alle Designs LLC 27 Ruskin Road Amherst, NY 14226 Ph: 716.446.5538
6.	Catalog Name:	**Slim Jim Wastebasket - Rubbermaid**
7.	Catalog Number:	SMFG354000BEIG, SMFG267360BEIG
8.	Catalog Description:	3540 - 23 Gallon Slim Jim waste container consisting of durable, all-plastic construction. Convenient and easy to clean with long lasting durability. Swing top provides easy access for trash disposal and then swings back to hide trash from the public view.
9.	Dimensions:	11"W x 20"L x 30"H
10.	Finish:	Beige





11.	Room Name	Rm. No.	Quantity
	Admin	113	1
	Admin	120	1
	Admin	150	1

12.	Total Quantity	3
13.	Unit Cost	$114.05
14.	Extended Cost	$342.15
15.	Freight (FOB Destination)	see Cost Estimate

end of order

SECTION 7
ACCESSORIES

1.	Location Code	**A-7**
2.	FSC Group	73
3.	GSA Contract Number	GS-07F-0026T
4.	Expiration Date	9/30/2021
5.	Contractor	Alle Designs LLC 27 Ruskin Road Amherst, NY 14226 Ph: 716.446.5538
6.	Catalog Name:	**Wastebasket Saddle**
7.	Catalog Number:	SPSB1011
8.	Catalog Description:	Saddle that firs on the A5 waste basket; used for recyling; 13.62 qt. capacity; sits on rim inside ot outside of wastebasket.
9.	Dimensions:	7.19"L X 11.5"H
10.	Finish:	Beige



11.	Room Name	Rm. No.	Quantity
	Non-secured desks		22
	Non-secured workstations		78

12.	Total Quantity	100
13.	Unit Cost	$7.30
14.	Extended Cost	$730.00
15.	Freight (FOB Destination)	see Cost Estimate

end of order

SECTION 8
CHAIRS & SEATING

1.	Location Code		**C-1**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Task Chair - Amplify Series**	
7.	Catalog Number:	2723.B1.Y.FC13.A141.Y.B21.C16 (T.UU)	
8.	Catalog Description:	Ergonomic task chair with upholstered seat and mesh back; high-back; enhanced synchro tilt; adjustable lumbar support;waterfall seat edge; height adjustable arms; carpet casters; 300 lb capacity.	
9.	Dimensions:	27.75-28.25" W x 24.5" D x 40" H Arm Height: 23.5" - 26.875" Seat height: 16.88"-20.50"	
10.	Finish:	Mesh Back: Black Seat Uph: Dynamic / Chalk Frame/Arms: Black Base: Blcak	



Photo does not show actual finishes

11.

Room Name	Rm. No.	Quantity	Room Name (continued)	Rm. No.	Quantity
GP Deputy	116	1	SQ CC	154	1
Admin	113	3	SQ OPS Super	156	1
Shirt	109	1	SQ DO	158	1
GP Super	110	1	Director of Staff	165	1
RA	114	1	RA	125	1
SQ CE	153	1	GP Deputy	127	1
SQ RA/CCF	151	1	Shirt	125	1
Admin	150	3	GP Super	123	1
SQ Super	152	1	Admin	120	3

12.	Total Quantity	24
13.	Unit Cost	$333.74
14.	Extended Cost	$8,009.76
15.	Freight (FOB Destination)	included

end of order

SECTION 8
CHAIRS & SEATING

1.	Location Code		**C-2**
2.	FSC Group	71	
3.	Navy BPA Contract No.	N00189-17-A-0108	
4.	Expiration Date	9/30/2022	
5.	Contractor	Kimball International 1600 Royal Street Jasper, IN 47546-1022 800.482.1213	
6.	Catalog Name:	**Guest Chair - Timberlane Series (National Office Furniture)**	
7.	Catalog Number:	39U-GWXXT	
8.	Catalog Description:	Wood frame guest chair; upholstered seat and back; 1" frame at arms with black polyurethane arm caps; nylon glides; 2" high polyurethane foam covers solid seat panel and corner blocks are screwed and glued; catalyzed top coat finish on hard maple.	
9.	Dimensions:	22" W x 24" D x 35" H Arm Height: 25.75" Seat height: 18.5"	
10.	Finish:	Upholstery: Vessel / 11509 Stone Frame: Truffle on Cherry	



Photo does not show actual finishes

11. Room Name	Rm. No.	Quantity	Room Name	Rm. No.	Quantity
Admin	113	4			
GP CC	108	6			
GP CE	112	6			
Admin	150	4			
Chief Tech	163	6			
GP CE	124	6			
GP CC	128	6			
Corridor	122	4			

12.	Total Quantity	42
13.	Unit Cost	$357.12
14.	Extended Cost	$14,999.04
15.	Freight (FOB Destination)	included

end of order

SECTION 8
CHAIRS & SEATING

1.	Location Code		**C-3**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Executive Chair - Prava Series**	
7.	Catalog Number:	6423.HR1CO.Y.AR8.B8.C21.LG2 (EX.LL)	
8.	Catalog Description:	Highback, executive chair with leather upholstered seat & back; waterfall seat; double-stitch detailing; enhanced synchro tilt; height adjustable arms; carpet casters; brushed aluminum base.	
9.	Dimensions:	26.75" W x 26.3" D x 46.125" OH Seat height: 19" - 22"	
10.	Finish:	Upholstery: Green Hides / Sierra Color: Ash Arms: Black Base: Brushed Aluminum	



Photo does not show actual finishes

11.

Room Name	Rm. No.	Quantity
GP CE	112	1
GP CC	108	1
GP CC	128	1
GP CE	124	1
Chief Tech Officer	163	1

12.	Total Quantity	5
13.	Unit Cost	$625.67
14.	Extended Cost	$3,128.35
15.	Freight (FOB Destination)	included

end of order

1.	Location Code		**C-4**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Task Chair - Amplify Series**	
7.	Catalog Number:	2722.B1.T.FC1.A140.B17.C16	
8.	Catalog Description:	Ergonomic task chair with upholstered seat and mesh back; mid-back; swivel-tilt; waterfall seat edge; fixed loop arms; carpet casters; 300 lb capacity.	
9.	Dimensions:	27.75-28.25" W x 24.5" D x 40" H Arm Height: 23.5" - 26.875" Seat height: 16.88"-20.50"	
10.	Finish:	Mesh Back: Black Seat Uph: Venice/Carbon Frame/Arms: Black Base: Black	



Photo does not show actual finishes

11.	Room Name	Rm. No.	Quantity
	Team Room	115	10
	Team Room	121	10
	Conference	148	10
	Team Room	137	10

12.	Total Quantity	40
13.	Unit Cost	$288.23
14.	Extended Cost	$11,529.20
15.	Freight (FOB Destination)	included

end of order

1.	Location Code		**C-5**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Task Chair - Amplify Series**	
7.	Catalog Number:	2723.B1.FC1.A141.Y.B17.C16	
8.	Catalog Description:	Ergonomic task chair with upholstered seat and mesh back; high-back; enhanced synchro tilt; adjustable lumbar support;waterfall seat edge; height adjustable arms; carpet casters; 300 lb capacity.	
9.	Dimensions:	27.75-28.25" W x 24.5" D x 40" H Arm Height: 23.5" - 26.875" Seat height: 16.88"-20.50"	
10.	Finish:	Back: Black Seat: Monterey / Flint Frame/Arms: Black Base: Black	



Photo does not show actual finishes

11.	Room Name	Rm. No.	Quantity			
	SQ Personnel	131	13	Tech Staff	164	10
	SQ Personnel 2	135	8	HR Staff	162	31
	SQ Personnel 1	136	11	HR Staff	149	26
	SQ Personnel	134	39			
	SQ Personnel 5	138	8			
	SQ Personnel 4	139	8			
	SQ Personnel 3	140	8			
	SQ ADO	157	2			
	SQ Flt CC	155	4			

12.	Total Quantity	168
13.	Unit Cost	$291.93
14.	Extended Cost	$49,044.24
15.	Freight (FOB Destination)	included

end of order

1.	Location Code		**C-6**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Task Chair - Focus Series**	
7.	Catalog Number:	5652.B1.A0.G5.GG11	
8.	Catalog Description:	Armless side chair; mesh back; upholstered, waterfall edge seat, four legs; painted, metal frame in a metallic finish; ganging brackets; stacks four on the floor and five on the optional cart.	
9.	Dimensions:	20.5"W x 26"D x 34"H Seat height: 18"	
10.	Finish:	Back: Mesh: Sand MC3 with black frame Seat: Monterey / Flint Frame: Silver Metallic	



Photo does not show actual finishes

11.	Room Name	Rm. No.	Quantity
	WG Training	133	103

12.	Total Quantity	103
13.	Unit Cost	$169.09
14.	Extended Cost	$17,416.27
15.	Freight (FOB Destination)	included

end of order

SECTION 8
CHAIRS & SEATING

1.	Location Code		**C-7**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Task Chair - Lumin Series**	
7.	Catalog Number:	1011.FT1.PS.FC2.SC5.A0.GL3	
8.	Catalog Description:	Armless side chair; plastic shell with perforated back design; four legs; painted, metal frame in a metallic finish; floor saver glides; stacks eight on the floor and fifteen on the optional cart.	
9.	Dimensions:	21.2"W x 21.6"D x 33.4"H Seat height: 17.9"	
10.	Finish: Shell	SC18 Sterling	
	Frame:	Silver Metallic	



11.	Room Name	Rm. No.	Quantity
	Unisex	104	1
	Break Room	107	40

12.	Total Quantity	41
13.	Unit Cost	$122.84
14.	Extended Cost	$5,036.44
15.	Freight (FOB Destination)	included

end of order

SECTION 8
CHAIRS & SEATING

1.	Location Code		**C-8**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Task Chair - Amplify Series**	
7.	Catalog Number:	2723.B1.FC1.A0.Y.B17.C16	
8.	Catalog Description:	Ergonomic task chair with upholstered seat and mesh back; high-back; armless; adjustable lumbar support;waterfall seat edge; carpet casters; 300 lb capacity.	
9.	Dimensions:	27.75-28.25" W x 24.5" D x 40" H Seat height: 16.88"-20.50"	
10.	Finish:	Back: Black Seat: Venice / Carbon Frame: Black Base: Black	



11.	Room Name	Rm. No.	Quantity
	Team Room	115	1
	Team Room	121	1
	Team Room	137	1
	Conference	148	1

12.	Total Quantity	4
13.	Unit Cost	$303.03
14.	Extended Cost	$1,212.12
15.	Freight (FOB Destination)	included

end of order

1.	Location Code		**C-9**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Task Stool - Amplify Series**	
7.	Catalog Number:	2722.B.FC1.A141.B17.S1.C16	
8.	Catalog Description:	Ergonomic task chair with upholstered seat and mesh back; mid-back; basic stool; adjustable lumbar support; waterfall seat edge; height adjustable arms; black nylon base with stool kit ring; carpet casters; 300 lb capacity.	
9.	Dimensions:	27.75-28.25" W x 24.5" D x 39-46.5" H Seat height: 21.5-29.5"	
10.	Finish:	Back: Black Seat: Dice / Onyx Frame/Arms: Black Base: Black	



Photo does not show actual finishes

11.	Room Name	Rm. No.	Quantity
	Control Room	142	1
	Facilty Manager	145	1

12.	Total Quantity	2
13.	Unit Cost	$338.92
14.	Extended Cost	$677.84
15.	Freight (FOB Destination)	included

end of order

SECTION 8
CHAIRS & SEATING

1.	Location Code		**C-10**
2.	FSC Group		71
3.	Navy Contract No.		N00189-17-A-0108
4.	Expiration Date		9/30/2022
5.	Manufacturer		Kimball International (National Office Furniture) c/o Servicing Dealer 1600 Royal Street, Mail Code KO-222 Jasper, IN 47546-1022 Ph: 800.482.1213
6.	Catalog Name:		**Lounge Chair & Ottoman - Weli Series**
7.	Catalog Number:		N81L1AAY & N81D1A
8.	Catalog Description:		Lounge chair and ottoman; fully upholstered; polyurethane arm caps; four legs in a metallic finish; C66 soft glides.
9.	Dimensions:		29"W x 29.25"D x 35.5"H Seat height: 19"
10.	Finish:	Upholstery:	Strand Color: 20112 Stone
		Arm Caps:	423 Concrete
		Frame:	Silver Metallic



11.	Room Name	Rm. No.	Quantity
	Wellness	110	1

12.	Total Quantity	1
13.	Unit Cost	$1,347.48
14.	Extended Cost	$1,347.48
15.	Freight (FOB Destination)	included

end of order

1.	Location Code		**C-11**
2.	FSC Group	71	
3.	GSA Contract No.	GS-27F-012GA	
4.	Expiration Date	1/31/2037	
5.	Manufacturer	Cramer, LLC 1523 Grand Blvd. Kansas City, MO 64108-1403 800.366.6700	
6.	Catalog Name:	**Task Stool - ESD Fusion Series**	
7.	Catalog Number:	FSMI4 FUSION	
8.	Catalog Description:	Heavy duty, 16 gauge steel seat with 3" thick high resiliency foam; contoured molded seat with waterfall edge; medium back; polished aluminum base with 2" diameter chrome footring; armless; pneumatic cylinder; multisurface dual wheel casters; supports up to 350 lbs.; 10 year-3 shift warranty.	
9.	Dimensions:	19.5"W x 27.5"D x 37.5"H Seat height: 17.25"-22.5"	
10.	Finish:	Upholstery: X-Static 5520 Color: 805 Graphite Frame: Polished Aluminum Ring: Polished Chrome	



11.	Room Name	Rm. No.	Quantity
	IT Workroom	132	2

12.	Total Quantity	2
13.	Unit Cost	$666.00
14.	Extended Cost	$1,332.00
15.	Freight (FOB Destination)	included

end of order

1.	Location Code		**C-12**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Side Chair - Freelance Series**	
7.	Catalog Number:	5214.UP.AC4.G5	
8.	Catalog Description:	Arm side chair; upholstered Seat & back; waterfall edge seat; four legs; painted, metal frame in a metallic finish; polyurethane arms; wall-saver design.	
9.	Dimensions:	25"W x 24"D x 33.25"H Seat height: 17.5"	
10.	Finish:	Upholstery: Momentum / Slice / Charcoal Arm pads: Fog Frame: Silver Metallic	



Photo does not show actual finishes

11.

Room Name	Rm. No.	Quantity	Room Name	Rm. No.	Quantity
GP Deputy	116	2	SQ DO	158	1
Shirt	109	1	Director of Staff	165	2
GP Super	110	1	RA	125	1
RA	114	1	GP Deputy	127	2
SQ CE	153	2	Shirt	125	1
SQ RA/CCF	151	1	GP Super	123	1
SQ Super	152	1	Conference	148	9
SQ CC	154	2			
SQ OPS SUPER	156	1			

12.	Total Quantity	29
13.	Unit Cost	$190.92
14.	Extended Cost	$5,536.68
15.	Freight (FOB Destination)	included

end of order

1.	Location Code		**C-13**
2.	FSC Group	71	
3.	AFBPA Contract No.	FA8003-20A-0007 Workplace Solutions	
4.	Expiration Date	12/19/2022	
5.	Manufacturer	Exemplis, LLC 6415 Katella Avenue Cypress, CA 90630 714.995.4800	GSA Contract No.: 47QSMA18D08NQ
6.	Catalog Name:	**Side Stool - Freelance Series**	
7.	Catalog Number:	5214.UP.S9.AC4.G5	
8.	Catalog Description:	Arm side stool; upholstered Seat & back; waterfall edge seat; four legs with foot rests; painted, metal frame in a metallic finish; polyurethane arms; wall-saver design.	
9.	Dimensions:	25"W x 24"D x 39"H Seat height: 24"	
10.	Finish:	Upholstery: Strive / Ebony Frame: Silver Metallic	



Photo does not show actual finishes

11.	Room Name	Rm. No.	Quantity
	IT Workroom	132	2
	Facility Manager	145	1


12.	Total Quantity	3
13.	Unit Cost	$246.42
14.	Extended Cost	$739.26
15.	Freight (FOB Destination)	included

end of order

1.	Location Code		**D-1**
2.	FSC Group	71	
3.	Navy BPA Contract No.	N00189-17-A-0108	
4.	Expiration Date	9/30/2022	
5.	Contractor	National Office Furniture dba Kimball International 1600 Royal Street Jasper, IN 47546-1022 800.482.1213	
6.	Catalog Name:	**Executive Desk - Waveworks Series**	
7.	Catalog Number:	Miscellaneous	
8.	Catalog Description:	U-shaped, all laminate desk; top with a matching softened edge; Box/Box/File pedestal on desk, Lateral file on credenza with hanging frames in file drawers for letter or legal folders; pull style: Malibu; keyed locks; black grommets on the desk at corner near return, center of bridge & credenza-right & left; all with full modesty and bridge and credenza with grommet; laminate hutch with tack board & task lights underneath. Note: All storage within shared areas should be keyed alike but different from other areas. A minimum of four master keys should be provided for all National products.	
9.	Dimensions:	Desk:	36"D x 72"W x 29"H
		Return:	24"D x 48"W x 29+"H
		Credenza:	24"D x 72"W x 29"H
10.	Finish:	Laminate:	TF Truffle
		Tackboard	Fabric: Dune / 8600 Drift
		Pulls:	Platinum Metallic



Photo represents style only

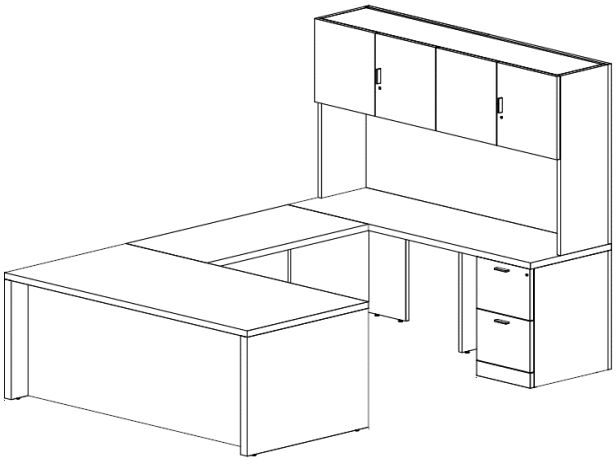

11.

Room Name	Rm. No.	Quantity
GP Deputy	116	1
GP Deputy	127	1
SQ CE	153	1
SQ CC	154	1
Director of Staff	165	1



Pull Style




Edge Detail


12.	Total Quantity	5
13.	Unit Cost	$3,153.24
14.	Extended Cost	$15,766.20
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code		**D-2**
2.	FSC Group	71	
3.	GSA Contract Number	GS-27F-001DA	
4.	Expiration Date	11/2/2020	
5.	Contractor	Dar-Ran Furniture Industries 2402 Shore Street Highpoint, NC 27263 Ph: 366-861-2428	
6.	Catalog Name:	**"U" Desk - Central Park Series**	
7.	Catalog Number:	See Attached BOM	
8.	Catalog Description:	L shaped, wood desk with a modesty panel; Box/Box/File and two File/File pedestals with hanging frames for letter or legal folders on the credenza; Classic edge detail; hutch on credenza with overhead cabinets, task light and tackboard(s); keyed locks on all storage except overhead doors; grommet- inside corner of desk, center of the return & right/left on credenza; no modesty on return for access to wall outlets; PL116 Pulls; wardrobe with single hinged door and 4 adjustable and 1 fixed shelf. Note: All storage should be keyed alike but different from other areas. A minimum of two master keys should be provided for all Dar Ran products.	
9.	Dimensions:	Desk: 36"D x 72"W x 29"H Return: 24"D x 48"W x 29"H Credenza: 24"D x 72"W x 29"- 71"H Wardrobe: 16"W x 24"D x 71"H	
10.	Finish:	Top & Casework: WNW Natural Walnut Grommet: Silver Pulls: Matte nickel Tackboard: Guilford / Spinel / 080 Perlite	

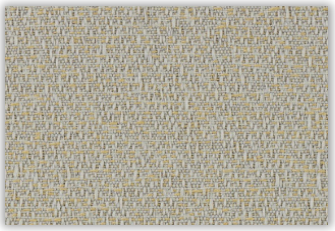

Tackboard

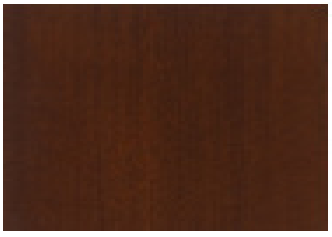

Top & Casework

11.	Room Name	Rm. No.	Quantity
	GP CC	108	1
	GP CE	112	1
	GP CE	124	1
	GP CC	127	1
	Chief Tech Officer	163	1

12.	Total Quantity	5
13.	Unit Cost	$6,379.66
14.	Extended Cost	$31,898.30
15.	Freight (FOB Destination)	


order continued
D-2



Photo represents style only




Pull Style





Edge

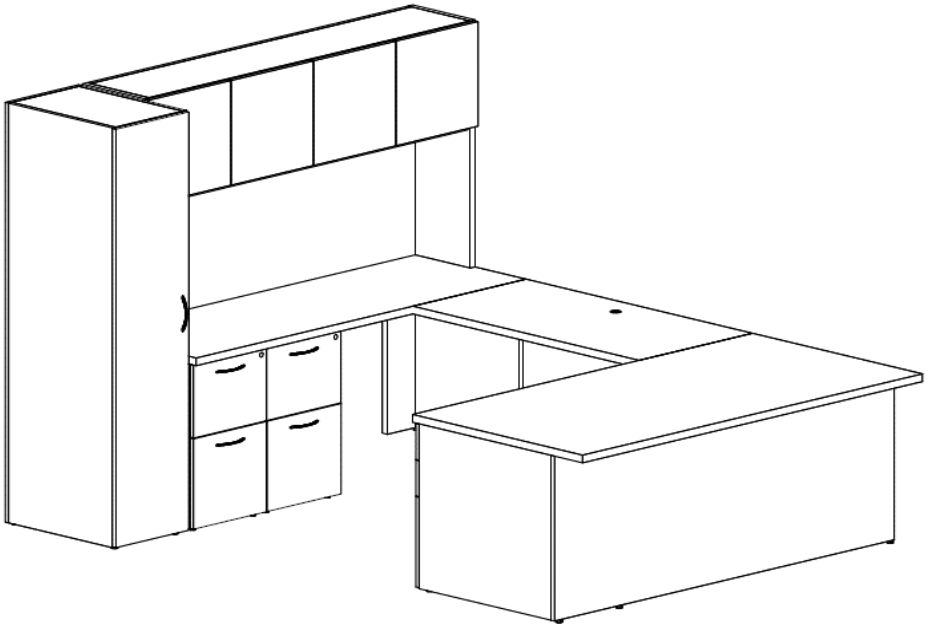

Actual Arrangement


end of order

D-3

1. Location Code
2. FSC Group: 71
3. Navy Contract Number: N0018917A0091
4. Expiration Date: 9/30/2022
5. Contractor: Knoll, Inc.
   1235 Water Street
   East Greenville, PA 18041-2202
   Ph: 215.519.9109 Contact: Karen Bastian
6. Catalog Name: **Executive Desk - Dividends/Horizon Series**
7. Catalog Number: Miscellaneous
8. Catalog Description: U-shaped, painted metal desk; laminate top with a matching PVC edge; Box/Box/File on desk and File/File pedestal on the credenza with hanging frames for letter or legal folders; Intergral Pulls, keyed locks; plastic pencil tray inside box drawer; laminate top; metal end panels; full modesty on desk and no modesty on the credenza or bridge unit; grommets on the desk at corner near return & credenza-right & left; metal hutch with flipper doors, tack board & task lights underneath - cord should be concealed behind the unit. Note: All storage within shared areas should be keyed alike but different from other areas. A minimum of four master keys should be provided for all Knoll products.
9. Dimensions:
   Desk: 30"D x 72"W x 29"H
   Return: 24"D x 42"W x 29"H
   Credenza 24"D x 72"W x 29"H
10. Finish:
    Top: 127 Walnut
    Paint: 115 Medium Grey
    Fabric: Criss Cross W305 /4 Aluminum



Photo represents style only

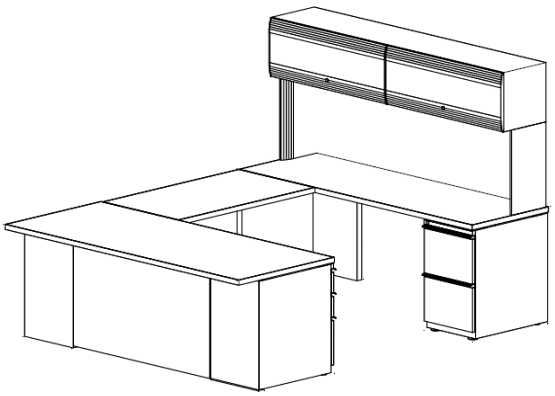


11.

Room Name	Rm. No.	Quantity	Room Name	Rm. No.	Quantity
Shirt	109	1	RA	126	1
GP Super	110	1	SQ RA/CCF	151	1
RA	114	1	SQ Super	152	1
GP Super	123	1	SQ OPS Super	156	1
Shirt	125	1	SQ DO	158	1

12. Total Quantity: 10
13. Unit Cost: $1,951.70
14. Extended Cost: $19,517.00
15. Freight (FOB Destination): Included

end of order

1.	Location Code		**D-4**
2.	FSC Group	71	
3.	Navy Contract Number	N0018917A0091	
4.	Expiration Date	9/30/2022	
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian	
6.	Catalog Name:	**Executive Desk - Antenna Series**	
7.	Catalog Number:	YKTS4824DL	
8.	Catalog Description:	Straight, table desk with painted legs; laminate top with a matching PVC edge.	
9.	Dimensions:	Desk: 24"D x 48"W x 28.5"H	
10.	Finish:	Top: 127 Walnut Legs: 613 Smooth Silver	

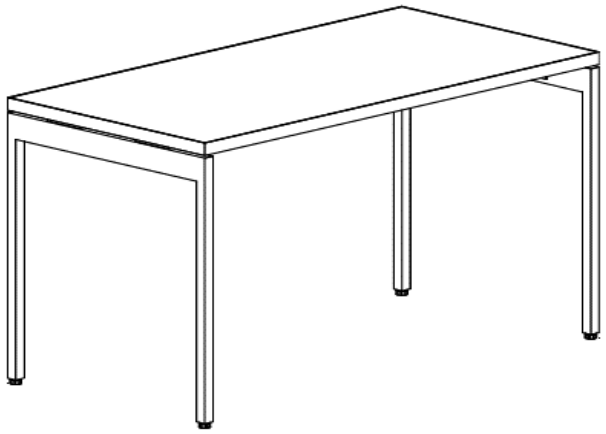

11.	Room Name	Rm. No.	Quantity
	Team Room	115	1
	Team Room	121	1
	Team Room	137	1
	Conference	148	1
12.	Total Quantity		4
13.	Unit Cost		$319.62
14.	Extended Cost		$1,278.48
15.	Freight (FOB Destination)		Included

end of order

SECTION 9
DESKS

1.	Location Code		**D-5**
2.	FSC Group	71	
3.	GSA Contract Number	47QSMA21D08QM (D-Mark Corporation)	
4.	Expiration Date	7/12/2041	
5.	Contractor	Lista International Corporation 106 Lowland Street Holliston, MA 01746 Ph: 877.465.4782	
6.	Catalog Name:	**Workbench - Technical Series**	
7.	Catalog Number:	TB3202-SDB-7230-GR / NW0600-0402NA-F6RG	
8.	Catalog Description:	ESD workbench, painted metal frame; drawer unit consisitng of 22.20" wide cabinet with (1) 3", (2) 5" & (1) 7" high drawers without inserts, and frame base; leg and stringer; static dissippative kit includes10' ground cord, hardware and 1-9/16" thick plastic laminate top and riser shelf; open riser with back stop & power leg with receptacles; 400 lb. drawer capaicty.	
9.	Dimensions:	Bench: Riser:	30"D x 72"W x 35.25"H 12"D x 72"W x 16"H (12" clearance)
10.	Finish:	Top: Legs:	Dove Gray GR Dark Gray



11.	Room Name	Rm. No.	Quantity
	IT Workroom	132	2

12.	Total Quantity	2
13.	Unit Cost	$3,977.78
14.	Extended Cost	$7,955.56
15.	Freight (FOB Destination)	Included

end of order

SECTION 9
DESKS

1.	Location Code		**D-6**
2.	FSC Group	71	
3.	GSA Contract Number	47QSMA21D08QM (D-Mark Corporation)	
4.	Expiration Date	7/12/2041	
5.	Contractor	Lista International Corporation 106 Lowland Street Holliston, MA 01746 Ph: 877.465.4782	
6.	Catalog Name:	**Workbench - Technical Series**	
7.	Catalog Number:	TB32020-PLB-7230-GR / NW0600-0402NA-F6RG	
8.	Catalog Description:	Workbench, painted metal frame; drawer unit consisitng of 22.20" wide cabinet with (1) 3", (2) 5" & (1) 7" high drawers without inserts, and frame base; leg and stringer; 1-9/16" thick plastic laminate top; power strip with receptacles on rear.	
9.	Dimensions:	Bench: 30"D x 72"W x 35.25"H	
10.	Finish:	Top: Dove Gray Legs: GR Dark Gray	




11.	Room Name	Rm. No.	Quantity
	Facility Manager	132	1

12.	Total Quantity	1
13.	Unit Cost	$2,877.78
14.	Extended Cost	$2,877.78
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code		**D-7**
2.	FSC Group	71	
3.	Navy Contract Number	N0018917A0091	
4.	Expiration Date	9/30/2022	
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian	
6.	Catalog Name:	**Table Desk - Antenna Series**	
7.	Catalog Number:	YKTS7230SDLN	
8.	Catalog Description:	Straight, table desk with painted legs; laminate top with a matching PVC edge.	
9.	Dimensions:	Desk: 30"D x 72"W x 28.5"H	
10.	Finish:	Top: 121 Micro Grey Legs: 117 Soft Grey	

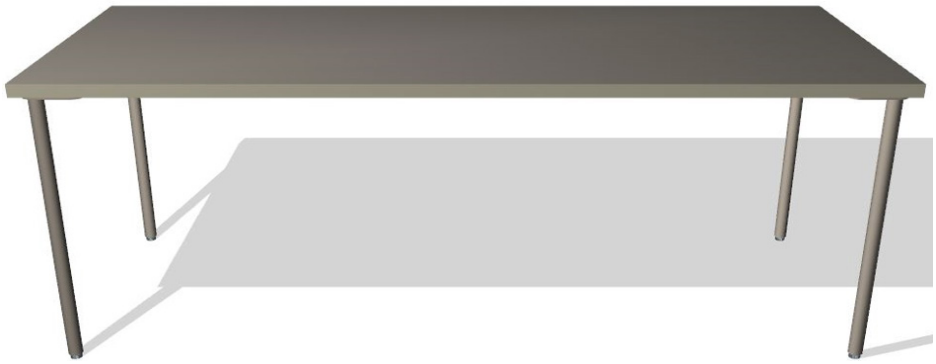


11.	Room Name	Rm. No.	Quantity
	HR Staff	149	3

12.	Total Quantity	3
13.	Unit Cost	$357.63
14.	Extended Cost	$1,072.89
15.	Freight (FOB Destination)	Included

end of order

SECTION 10
FILES & STORAGE

1.	Location Code		**S-1**
2.	FSC Group	71	
3.	Navy Contract Number	N0018917A0091	
4.	Expiration Date	9/30/2022	
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian	
6.	Catalog Name:	**Storage Cabinet - Calibre Series**	
7.	Catalog Number:	C2C3936C / CE3618	
8.	Catalog Description:	3 high, painted, metal cabinet; laminate top with self edge; two doors; continuous pulls; two adjustable shelves; one fixed shelf on bottom; and keyed lock. NOTE: All storage within an open, shared area should be keyed alike but different from other areas. A minimium of two master keys should be provided for all Knoll products.	
9.	Dimensions:	18"D x 36"W x 40.5"H	
10.	Finish:	Top: 121 Micro Grey Case: 117 Soft Grey	

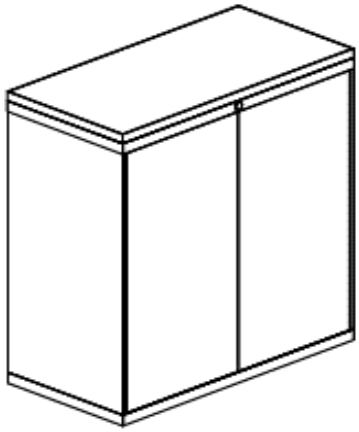


11.	Room Name	Rm. No.	Quantity
	Admin	113	1
	Admin	120	1
	SQ Personnel	134	1
	Admin	150	1
	HR Staff	162	1

12.	Total Quantity	5
13.	Unit Cost	$1,741.00
14.	Extended Cost	$8,705.00
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code		**S-2**
2.	FSC Group	71	
3.	Navy Contract Number	N0018917A0091	
4.	Expiration Date	9/30/2022	
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian	
6.	Catalog Name:	**Storage Cabinet - Calibre Series**	
7.	Catalog Number:	C2C2730C / DD1EU24 / D1R9224N	
8.	Catalog Description:	2 high, painted, metal cabinet consisitng of three 30" wide cabinets with two doors, integrated pulls, one adjustable and one fixed shelf in each; one laminate top; and keyed lock. NOTE: All storage within an open, shared area should be keyed alike but different from other areas. A minimium of two master keys should be provided for all Knoll products.	
9.	Dimensions:	24"D x 92"W x 29"H	
10.	Finish:	Top: 127 Walnut Paint: 117 Soft Grey	

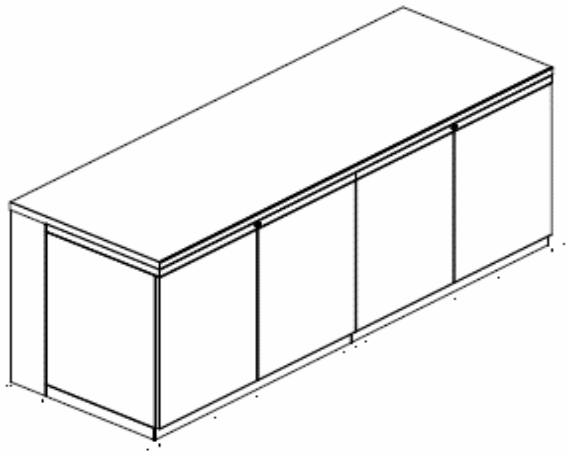


11.	Room Name	Rm. No.	Quantity
	Admin	113	1
	Admin	120	1
	Admin	150	1

12.	Total Quantity	3
13.	Unit Cost	$1,437.68
14.	Extended Cost	$4,313.04
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code	**S-3**
2.	FSC Group	71
3.	Navy Contract Number	N0018917A0091
4.	Expiration Date	9/30/2022
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian
6.	Catalog Name:	**Storage Cabinet - Calibre Series**
7.	Catalog Number:	CE3618 / C4B3936 / C2F2736CCC
8.	Catalog Description:	2 high, painted, metal lateral file with a laminate top and metal bookcase on top; laminate top with self edge; continuous pulls; and keyed lock. NOTE: All storage within an open, shared area should be keyed alike but different from other areas. A minimium of two master keys should be provided for all Knoll products.
9.	Dimensions:	24"D x 92"W x 29"H
10.	Finish:	Top: 127 Walnut Base: 115 Medium Grey

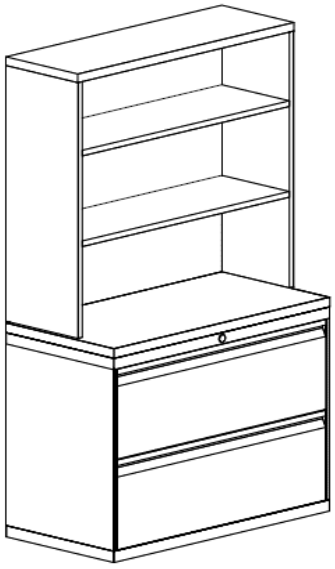


11.	Room Name	Rm. No.	Quantity	Room Name	Rm. No.	Quantity
	Shirt	109	1	SQ RA/CCF	151	1
	GP Super	110	1	SQ Super	152	1
	RA	114	1	SQ OPS Super	156	1
	GP Super	123	1	SQ DO	158	1
	Shirt	125	1			
	RA	126	1			

12.	Total Quantity	10
13.	Unit Cost	$736.45
14.	Extended Cost	$7,364.50
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code		**S-4**
2.	FSC Group	71	
3.	GSA Contract Number	GS-29F-0010P	
4.	Expiration Date	3/8/2019	
5.	Contractor	Safco 619 North Commerce Street Sheboygan, WI 53081 Ph: 800.822.8037	
6.	Catalog Name:	**Storage Cabinet - Industrial Series**	
7.	Catalog Number:	6250 / 6256	
8.	Catalog Description:	Metal shelving; box beam design with double-sided compression clips; slotted posts kit; 1" increments; six shelves; 20 gauge; corner brackets and hat channel; rated up to 1250 lbs. per shelf.	
9.	Dimensions:	36"W X 12"D X 85"H	
10.	Finish:	Standard Gray	



Finish






11.	Room Name	Rm. No.	Quantity
	Storage	141	5

12.	Total Quantity	5
13.	Unit Cost	$174.62
14.	Extended Cost	$873.10
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code		**S-5**
2.	FSC Group	71	
3.	GSA Contract Number	GS-29F-0010P	
4.	Expiration Date	3/8/2019	
5.	Contractor	Safco 619 North Commerce Street Sheboygan, WI 53081 Ph: 800.822.8037	
6.	Catalog Name:	**Storage Cabinet - Industrial Series**	
7.	Catalog Number:	6252 / 6256	
8.	Catalog Description:	Metal shelving; box beam design with double-sided compression clips; slotted posts kit; 1" increments; six shelves; 20 gauge; corner brackets and hat channel; rated up to 1250 lbs. per shelf.	
9.	Dimensions:	36"W X 18"D X 85"H	
10.	Finish:	Standard Gray	



Finish







11.	Room Name	Rm. No.	Quantity
	IT Workroom	132	2
	Storage	141	1
	Facility Manager	145	1

12.	Total Quantity	4
13.	Unit Cost	$192.53
14.	Extended Cost	$770.12
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code	**S-6**
2.	FSC Group	71
3.	GSA Contract Number	GS-29F-0010P
4.	Expiration Date	3/8/2024
5.	Contractor	Safco Products Co. 9300 West Research Center Road Minneapolis, MN 55428-3626 Ph: 888.971.6225, ext. 66
6.	Catalog Name:	**Storage Cabinet - File Harbor Series**
7.	Catalog Number:	83423.MS4802.MS4203.MFD42(5)
8.	Catalog Description:	Metal cabinet with horizontally sliding tambour doors - doors recess into concealed inner pockets; five 37" wide slotted shelves; three dividers per shelf at 6"h x 13" d; dividers adjusts in 2.5" increments; shelves adjust in 1" increments; interior components are standard in graphite color; and keyed lock.
9.	Dimensions:	Overall: 48"W X 17-3/4"D X 83"H (76" interior height) Interior: 16.5"D Shelf Depth: 14.75"
10.	Finish: Paint:	Pebble Grey







11.	Room Name	Rm. No.	Quantity
	Break Room	107	4

12.	Total Quantity	4
13.	Unit Cost	$2,450.61
14.	Extended Cost	$9,802.44
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code	**S-7**
2.	FSC Group	71
3.	GSA Contract Number	47QSHA19A000D
4.	Expiration Date	11/9/2022
5.	Contractor	W.W.Grainger 100 Grainger Parkway Lake Forest, IL 60045-5202 Ph: 800.468.8326
6.	Catalog Name:	**Key Cabinet**
7.	Catalog Number:	33J857
8.	Catalog Description:	Painted metal, 2 tag key cabinet; heavy-duty steel; baked on powder coated finish; includes different numbered key tags and lock location charts; hook style key tags are numbered consecutively; each hokk holds 1 control key with a red permanent tag and 1 duplicate loaner key with a white reusable tag. In case the loner key is lost, the control key remains in the cabinet. An "out key" tag is hing in the same position as the loaned key. Date, key number and recipient can be recorded on receipt sheet.Holds 60 keys. Wall mounted.
9.	Dimensions:	14"W x 3-5/32"D x 17"H
10.	Finish:	Beige



11.	Room Name	Rm. No.	Quantity
	Facility Manager	145	1

12.	Total Quantity	1
13.	Unit Cost	$214.74
14.	Extended Cost	$214.74
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code		**T-1**
2.	FSC Group	71	
3.	Navy BPA Contract No.	N00189-17-A-0108	
4.	Expiration Date	9/30/2022	
5.	Contractor	National Office Furniture dba Kimball International 1600 Royal Street Jasper, IN 47546-1022 800.482.1213	
6.	Catalog Name:	**Occasional Tables - Eloquence Series**	
7.	Catalog Number:	85N2024ENLW	
8.	Catalog Description:	Wood corner table with a matching laminate top.	
9.	Dimensions:	24"D x 21"W x 20"H	
10.	Finish:	Laminate: TF Truffle Wood: TF Truffle on Cherry	



11.	Room Name	Rm. No.	Quantity
	Admin	113	1
	Corridor	122	2
	Admin	150	1


12.	Total Quantity	4
13.	Unit Cost	$413.28
14.	Extended Cost	$1,653.12
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code	**T-2**
2.	FSC Group	71
3.	GSA Contract Number	GS-27F-001DA
4.	Expiration Date	11/2/2020
5.	Contractor	Dar-Ran Furniture Industries 2402 Shore Street Highpoint, NC 27263 Ph: 366-861-2428
6.	Catalog Name:	**Table - Conference Series**
7.	Catalog Number:	TBT4242RD500W / TBB1818PX966W
8.	Catalog Description:	Round,1-1/2" wood table top in standard veneer with classic "W" edge; wood X base with 1.3125 thick panels with 3mm edge bands.

9.	Dimensions:	Top:	42" diamter x 1.5"H
		Base:	Base: 18" x 18" x 28.75"H
		Overall:	30.25"H

10. Finish: WNW Natural Walnut

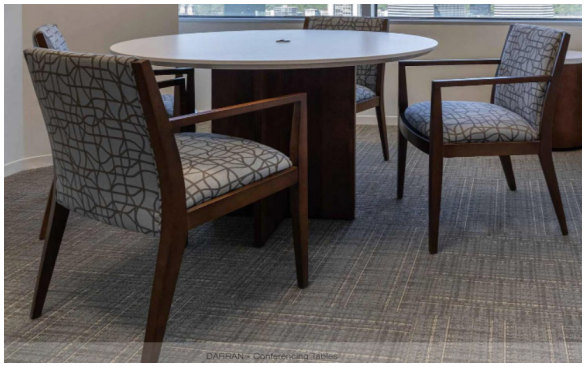



Edge


11.	Room Name	Rm. No.	Quantity
	GP CC	108	1
	GP CE	112	1
	GP CE	124	1
	GP CC	127	1
	Chief Tech Officer	163	1


12.	Total Quantity	5
13.	Unit Cost	$1,449.45
14.	Extended Cost	$7,247.25
15.	Freight (FOB Destination)	end of order

1.	Location Code		**T-3**
2.	FSC Group	71	
3.	Navy BPA Contract No.	N00189-17-A-0108	
4.	Expiration Date	9/30/2022	
5.	Contractor	National Office Furniture dba Kimball International 1600 Royal Street Jasper, IN 47546-1022 800.482.1213	
6.	Catalog Name:	**Conference Table - Conference Solution Series**	
7.	Catalog Number:	Miscellaneous	
8.	Catalog Description:	Boat shaped conference top in a woodgrain laminate with softened matching pvc edge; 2 one touch, clear anodized aluminum, double pivoting power grommet each with 6 power receptacles, 1-72" long hardwire conduit pigtail cable on one end which carries 2-20 AMP 120 V circuits to power two sides of the power/data oasis and two charging USB (2.1); one HDMI; one VGA with mini stereo and one RJ45 data jack. Panel base kit with wire management channels and removable access door for plugging cords into the electrical floor outlets and for routing data and voice cables; only one power outlet in the floor will require longer cords or daisy chaining two modules with one cord used to plug into the floor outlet.	
9.	Dimensions:	Table: 36-48"W x 144"L x 30"H Module: 9.75"W x 8"Dx 1.5"H	
10.	Finish:	Top/Base: TF Truffle Module: Clear Anodized Aluminum	







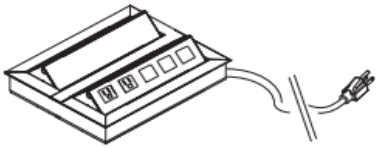

11.	Room Name	Rm. No.	Quantity
	Team Room	115	1
	Team Room	121	1
	Conference	148	1


12.	Total Quantity	3
13.	Unit Cost	$3,518.64
14.	Extended Cost	$10,555.92
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code		**T-3.1**
2.	FSC Group	71	
3.	Navy BPA Contract No.	N00189-17-A-0108	
4.	Expiration Date	9/30/2022	
5.	Contractor	National Office Furniture dba Kimball International 1600 Royal Street Jasper, IN 47546-1022 800.482.1213	
6.	Catalog Name:	**Conference Table - Conference Solution Series**	
7.	Catalog Number:	Miscellaneous	
8.	Catalog Description:	Boat shaped conference top in a woodgrain laminate with softened matching pvc edge; Panel base kit with wire management channels and removable access door for plugging cords into the electrical floor outlets and for routing data and voice cables; only one power outlet in the floor will require longer cords or daisy chaining two modules with one cord used to plug into the floor outlet.	
9.	Dimensions:	Table:	36-48"W x 144"L x 30"H
		Module:	9.75"W x 8"Dx 1.5"H
10.	Finish:	Top/Base:	TF Truffle
		Module:	Clear Anodized Aluminum







11.	Room Name	Rm. No.	Quantity
	Team Room	137	1

12.	Total Quantity	1
13.	Unit Cost	$2,903.76
14.	Extended Cost	$2,903.76
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code		**T-4**
2.	FSC Group	71	
3.	Navy Contract Number	N0018917A0091	
4.	Expiration Date	9/30/2022	
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian	
6.	Catalog Name:	**Multipurpose Table - Dividends Horizon Series**	
7.	Catalog Number:	DT1ARY8430NS	
8.	Catalog Description:	Rectangular, 1-1/4" laminate top; self edge; base: painted metal stretcher with Y legs.	
9.	Dimensions:	Table:	30"W x 84"L x 28.5"H
10.	Finish:	Top/Edge: Legs:	121 Micro Grey 613 Smooth Silver



11.	Room Name	Rm. No.	Quantity
	Break Room	107	5

12.	Total Quantity	5
13.	Unit Cost	$588.63
14.	Extended Cost	$2,943.15
15.	Freight (FOB Destination)	Included

end of order

1.	Location Code	**WS-1**
2.	FSC Group	71
3.	Navy Contract Number	N0018917A0091
4.	Expiration Date	9/30/2022
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian
6.	Catalog Name:	**Systems Furniture - Dividends Series**
6.	Catalog Number:	Miscellaneous
9.	Catalog Description:	Typical workstation components includes 3" thick panels, 42" and 64" high, tackable acoustical fabric tiles, stack on capabilities & removeable tile below the worksurface for future re-configuration; two fixed, laminate worksurfaces with a matching PVC edge; raised, laminate transaction top; File/File and Box/File/File pedestals with a pencil tray in box drawer, hanging frames for filing letter or legal folders; pencil drawer; full width integrated pulls; overhead bins with flipper doors and task lights underneath. Keyed lock on pedestal in each workstation should be keyed different. A minimum of four master keys should be provided for all Knoll products.
10.	Dimensions:	Approximate Overall: 6'0" x 9'6" x 64.5" H
11.	Finish:	Front Panels & Tops: 127 Walnut Panel Fabric: Criss Cross W305 /4 Aluminum Paint: 117 Soft Grey


12.


Room Name	Rm. No.	Quantity
Admin	113	3
Admin	120	3
Admin	150	1

13.	Total Quantity	7
14.	Unit Cost	$3,417.18
15.	Extended Cost	$23,920.26
16.	Freight (FOB Destination)	Included

order continued

WS-1 (Continued)

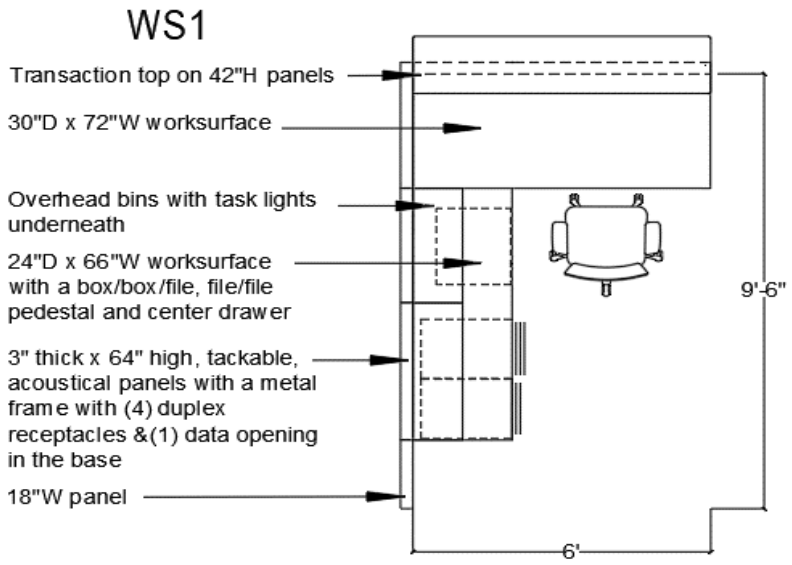

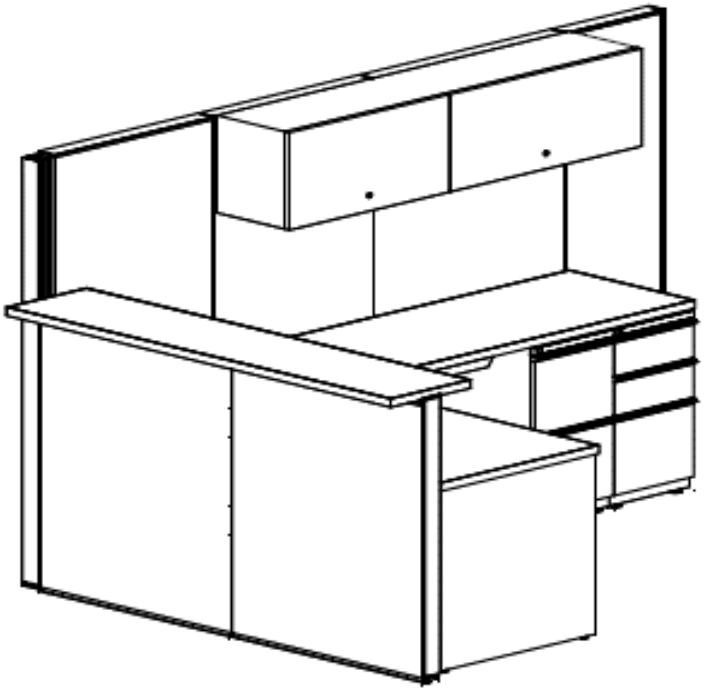

end of order


1.	Location Code	**WS-1.1**
2.	FSC Group	71
3.	Navy Contract Number	N0018917A0091
4.	Expiration Date	9/30/2022
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian
6.	Catalog Name:	**Systems Furniture - Dividends Series**
6.	Catalog Number:	Miscellaneous
9.	Catalog Description:	Typical workstation components includes 3" thick panels, 42" and 64" high, tackable acoustical fabric tiles, stack on capabilities & removeable tile below the worksurface for future re-configuration; two fixed, laminate worksurfaces with a matching PVC edge; raised, laminate transaction top; File/File and Box/File/File pedestals with a pencil tray in box drawer, hanging frames for filing letter or legal folders; pencil drawer; full width integrated pulls; overhead bins with flipper doors and task lights underneath. Keyed lock on pedestal in each workstation should be keyed different. A minimum of four master keys should be provided for all Knoll products.
10.	Dimensions:	Approximate Overall: 6'0" x 11'0" x 64.5" H
11.	Finish:	Front Panels & Tops: 127 Walnut Panel Fabric: Criss Cross W305 /4 Aluminum Paint: 117 Soft Grey


12.	Room Name	Rm. No.	Quantity
	Admin	150	2

13.	Total Quantity	2
14.	Unit Cost	$3,449.25
15.	Extended Cost	$6,898.50
16.	Freight (FOB Destination)	Included

order continued

WS-1.1(Continued)

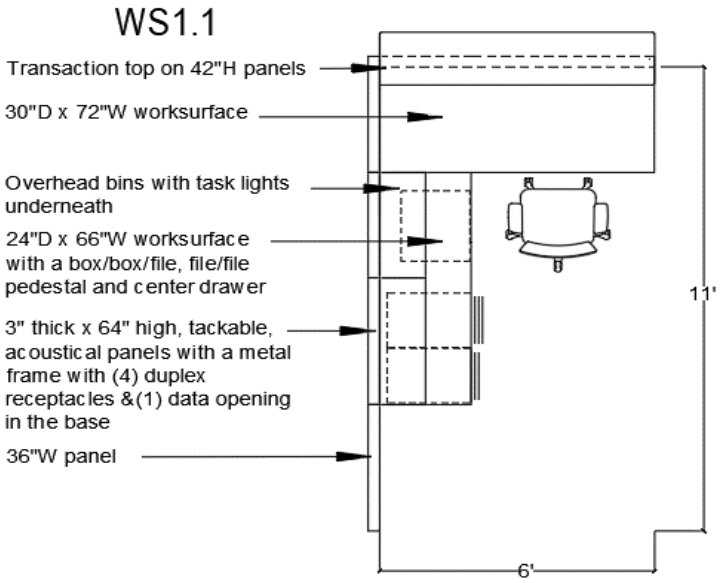

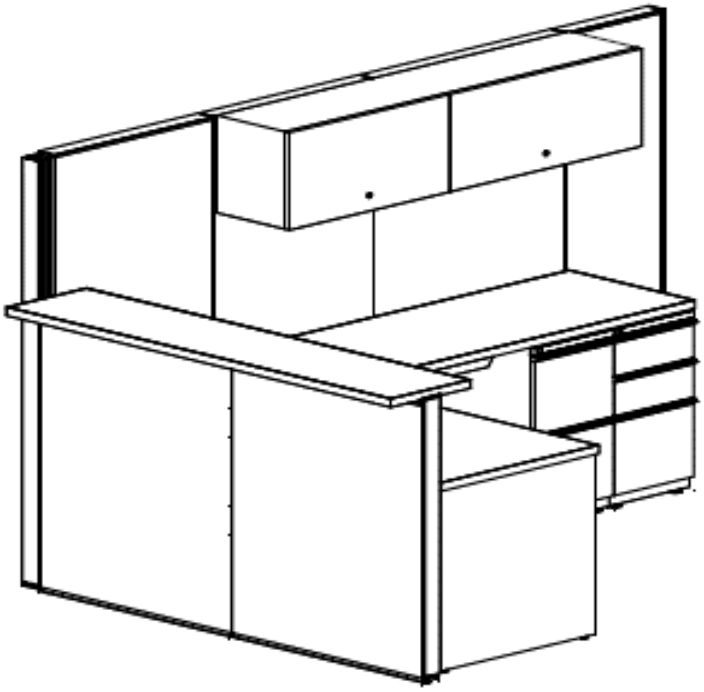

end of order

1.	Location Code	**WS-2**
2.	FSC Group	71
3.	Navy Contract Number	N0018917A0091
4.	Expiration Date	9/30/2022
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian
6.	Catalog Name:	**Systems Furniture - Dividends Series**
6.	Catalog Number:	Miscellaneous
9.	Catalog Description:	Typical workstation components includes 3" thick panels, 64" high, tackable acoustical fabric tiles, stack on capabilities & removeable tile below the worksurface for future re-configuration; two fixed, laminate worksurfaces with a matching PVC edge; Box/File/File fixed pedestal with a pencil tray in box drawer, hanging frames for filing letter or legal folders; full width integrated pulls; overhead bins with flipper doors and task lights underneath. Keyed lock on pedestal in each workstation should be keyed different. A minimum of four master keys should be provided for all Knoll products.
10.	Dimensions:	Approximate Overall: 5'6" x 6'6" x 64.5" H
11.	Finish:	Top: 121 Micro Grey Panel Fabric: Criss Cross W305 /4 Aluminum Paint: 117 Soft Grey


12.


Room Name	Rm. No.	Quantity
HR Staff	149	20
SQ Flight CC	155	4
SQ ADO	157	2
HR Staff	162	31
Technology Staff	164	10

13.	Total Quantity	67
14.	Unit Cost	$2,513.02
15.	Extended Cost	$168,372.34
16.	Freight (FOB Destination)	Included

order continued

WS-2 (Continued)

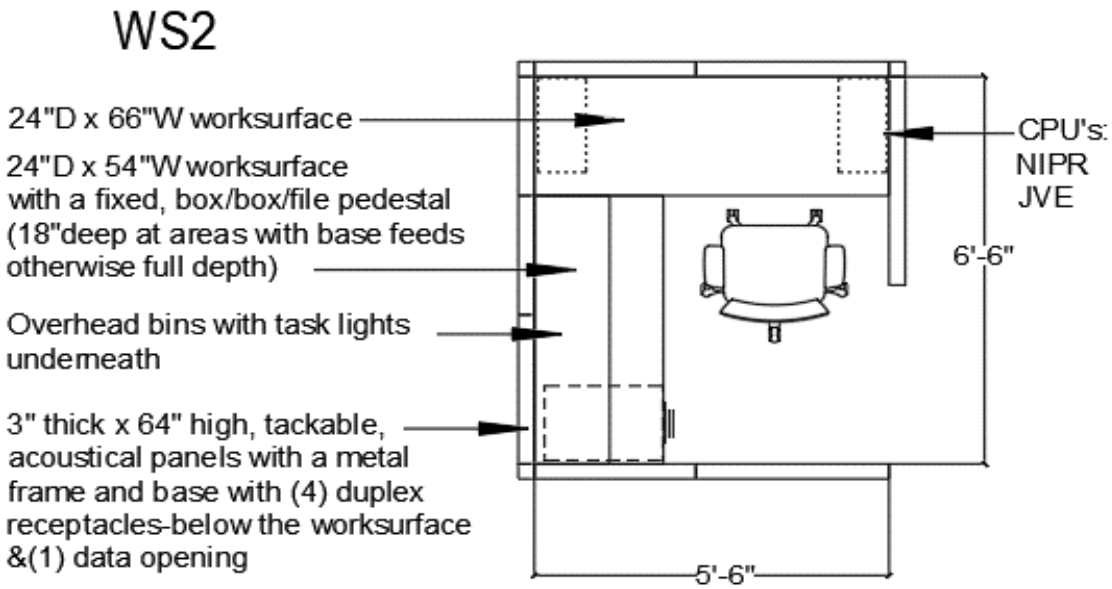

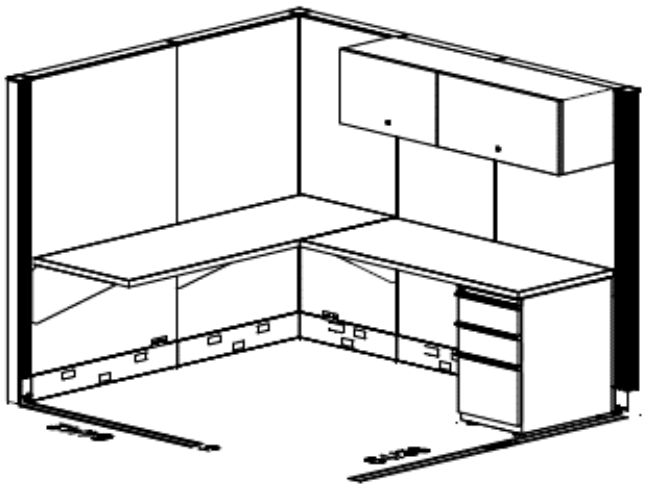

end of order

1.	Location Code	**WS-3**
2.	FSC Group	71
3.	Navy Contract Number	N0018917A0091
4.	Expiration Date	9/30/2022
5.	Contractor	Knoll, Inc. 1235 Water Street East Greenville, PA 18041-2202 Ph: 215.519.9109 Contact: Karen Bastian
6.	Catalog Name:	**Systems Furniture - Dividends Series**
6.	Catalog Number:	Miscellaneous
9.	Catalog Description:	Typical workstation components includes 3" thick panels, 64" high, tackable acoustical fabric tiles, stack on capabilities & removeable tile below the worksurface for future re-configuration; two fixed, laminate worksurfaces with a matching PVC edge; Box/File/File mobile pedestal with a pencil tray in box drawer, hanging frames for filing letter or legal folders; full width integrated pulls. Keyed lock on pedestal in each workstation should be keyed different. A minimum of four master keys should be provided for all Knoll products.
10.	Dimensions:	Approximate Overall: 6'0" x 6'6" x 64.5" H
11.	Finish:	Top: 121 Micro Grey Panel Fabric: Criss Cross W305 /4 Aluminum Paint: 117 Soft Grey


12.


Room Name	Rm. No.	Quantity
SQ Personnel	131	13
SQ Personnel	134	39
SQ Personnel 2	135	8
SQ Personnel 1	136	11
SQ Personnel 5	138	8
SQ Personnel 4	139	8
SQ Personnel 3	140	8

13.	Total Quantity	95
14.	Unit Cost	$1,925.89
15.	Extended Cost	$182,959.55
16.	Freight (FOB Destination)	Included

order continued

WS-3 (Continued)

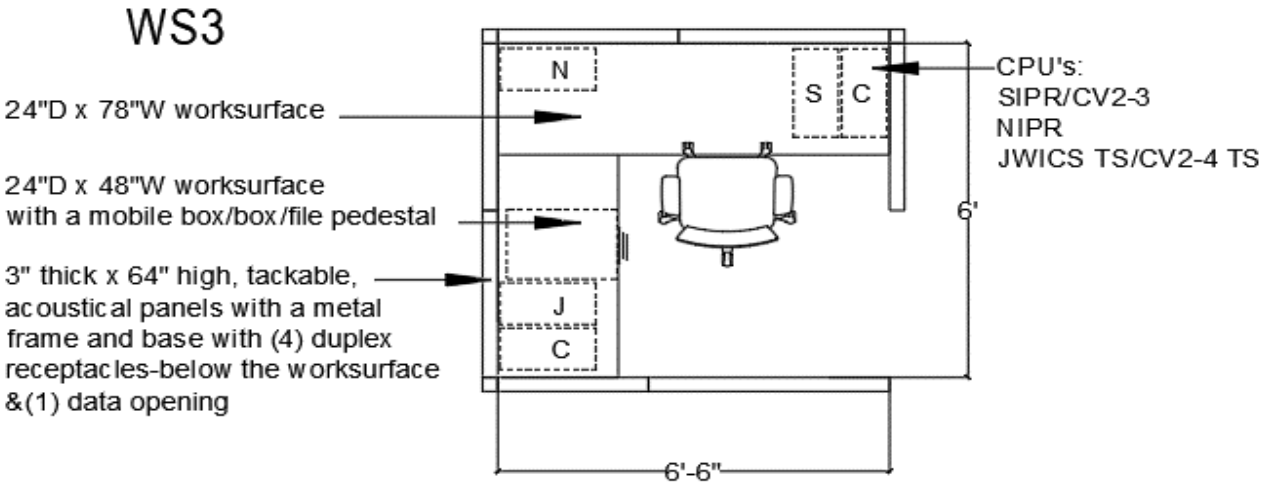

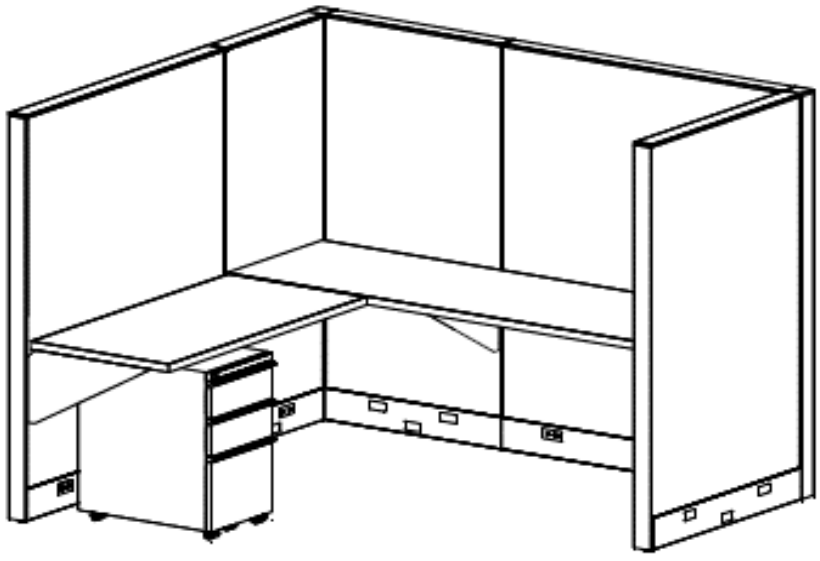

end of order

APPENDIX C

MEMORANDUM FOR RECORD SECURITY DOOR

MEMORANDUM FOR RECORD 26 October 2016

TO: ALCON

FROM: Eglin AFB Locksmith

SUBJECT: SECURITY and LIFE SAFETY … Now we can have both!
(Taken from DOD Lock Program "Security Facts" Issue 29)

BACKGROUND:
Federal Specification FF-L-2890 (Pedestrian Door Lock Assembly Preassembled, Panic and Auxiliary Deadbolts) was originally written to identify security/operational requirements for door locking system hardware for use on doors that protect classified areas. For many years, the locking system hardware used on these doors to secure classified areas has not met the fire and life safety requirements of the local fire marshal and other Authorities Having Jurisdiction (AHJs) for occupant egress capability. These specialized locking systems meeting government security requirements provided security only – not fire and life safety.

SOLVING THE PROBLEM:
The specification was revised in April of 2012 (FF-L-2890B) to address these issues. Revision B requires that before hardware is submitted to the government for testing, it must meet all the necessary approvals for fire, life safety, emergency egress and the Americans with Disabilities Act (ADA). This means that a FF-L-2890B product approved by GSA will satisfy security, fire, life safety and ADA compliance. The federal specification (FF-L-2890B) defines six different Types of products to accommodate a wide variety of door applications.

APPLICATIONS:
The current FF-L-2890B, with Amendment 2 (Feb 25, 2016) describes the intended use of the six Types of Products:
6.1.1 Type I and Type II.
For use on standard egress doors, right and left hand interchangeable, standard and reverse bevel capable, that require one-hand, single-motion egress with no panic requirements. This lock extension is meant to be used on rooms/facilities where the occupancy is less than what the authority Having Jurisdiction (AHJ) considers meeting assembly requirements. (Use is subject to AHJ approval.)

6.1.2 Type III and Type IV.
For use on fire exit doors, right and left hand interchangeable, standard and reverse bevel capable, that require one-handed, single-motion egress with panic requirements. This lock extension is meant to be used on rooms/facilities where the occupancy is equal to or greater than what the AHJ considers meeting assembly requirements. (Use is subject to AHJ approval.)

6.1.3 Type V and Type VI.

For use on standard pedestrian doors, right and left hand interchangeable, standard and reverse bevel capable, that are not a required egress route and are not required to have a single motion egress. This lock extension is meant for use on rooms/facilities where there is no regular occupancy. An example of this would be a telecommunications closet. Use is subject to AHJ Approval.

The qualified products list (QPL) for FF-L-2890B, dated 1 Sept, 2015, lists products made by Sargent and Greenleaf (S&G) that meet Types I through VI, and a product made by Kaba Mas that meets Type VI.


Product lines from other manufactures are not authorized/approved for use under this Federal Specification.

AVAILABILITY/PROCUREMENT:
Availabile on DOD Emall now!

NSN	Description	Type	Lock Included	Exit Type	Access Control (AC) Options	Price
5340-01-649-7936	S&G Pedestrian Door Preassembled Lock (PDPL) P/N: 2890-515 (Application: Office)	I	S&G 2740B (Style 2)	Lever	Rim cylinder	$2,987.02
5340-01-652-8191	S&G Pedestrian Door Preassembled Lock (PDPL) P/N: 2890-513 (Application: Office)	I	Kaba X-10 (Style 1)	Lever	Rim cylinder	$3,818.02
5340-01-652-8192	S&G Pedestrian Door Preassembled Lock (PDPL) P/N: 2890-522 (Application: Office)	II	S&G 2740B (Style 2)	Lever	Electronic with keyed bypass	$3,249.74
5340-01-651-9488	S&G Pedestrian Door Preassembled Lock (PDPL) P/N:2890-523 (Application: Office)	II	Kaba X-10 (Style 1)	Lever	Electronic with keyed bypass	$4,080.74
5340-01-650-1200	S&G Pedestrian Door Lock Assembly Panic(PDLAP) P/N: 2890-532 (Application: Conference Rm)	III	S&G 2740B (Style 2)	Panic Bar	Rim cylinder	$3,336.85
5340-01-652-8194	S&G Pedestrian Door Lock Assembly Panic (PDLAP) P/N: 2890-533 (Application: Conference Rm)	III	Kaba X-10 (Style 1)	Panic Bar	Rim cylinder	$4,167.85
5340-01-650-1207	S&G Pedestrian Door Lock Assembly Panic (PDLAP) P/N: 2890-542 (Application: Conference Rm)	IV	S&G 2740B (Style 2)	Panic Bar	Electronic with keyed bypass	$3,599.56
5340-01-652-8188	S&G Pedestrian Door Lock Assembly Panic (PDLAP) P/N: 2890-543 (Application: Conference Rm)	IV	Kaba X-10 (Style 1)	Panic Bar	Electronic with keyed bypass	$4,430.56
5340-01-650-1108	S&G Auxiliary Deadbolt (ADB) P/N: 2890-552 (Application: Closet)	V	S&G 2740B (Style 2)	Lever	No AC	$2,724.31

5340-01-652-8195	S&G Auxiliary Deadbolt (ADB) P/N: 2890-553 (Application: Closet/Storage)	V	Kaba X-10 (Style 1)	Lever	No AC	$3,555.30
5340-01-651-9491	S&G Auxiliary Deadbolt (ADB) P/N: 2890-562 (Application: Closet/Storage)	VI	S&G 2740B (Style 2)	Lever	No AC	$3,206.90
5340-01-626-0087 (**CDX-10**)	KABA Auxiliary Deadbolt (ADB) (Application: Closet/Storage)	VI	Kaba X-10 (Style 1)	N/A	No AC	$945.28

For more information contact Eglin AFB Locksmith.

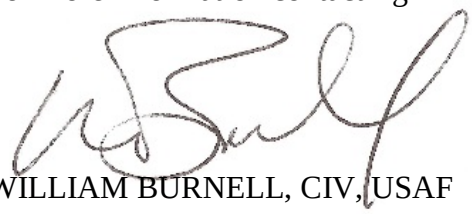

WILLIAM BURNELL, CIV, USAF
Eglin Locksmith
796 CES/CEOHS
501 Deleon Dr Ste 100
Eglin AFB, FL 32542
(850) 882-1766

APPENDIX D

EGLIN SPECIFIC AS-BUILT DRAWING REQUIREMENTS

1.1 PROJECT RECORD DOCUMENTS

1.1.1 Record Drawings

Drawings showing final as-built conditions of the project. This paragraph covers record drawings complete, as a requirement of the contract. The terms "drawings," "contract drawings," "drawing files," "working record drawings" and "final record drawings" refer to contract drawings which are revised to be used for final record drawings showing as-built conditions. The final record drawings shall consist of as-built construction drawings on an ARCH D sheet mylar size and 2 CD ROMs in AutoCAD and PDF for Air Force review and approval. Each drawing shall be its own separate file in both AutoCAD and PDF format. Appendix drawings shall meet same requirements.

1.1.1.1 Government Furnished Materials

One set of electronic CADD files in .dwg format in the specified software and format revised to reflect all bid amendments will be provided by the Government at the preconstruction conference for projects requiring CADD file record drawings.

1.1.1.2 Working Record and Final Record Drawings

Revise 2 sets of paper drawings by red-line process to show the as-built conditions during the prosecution of the project. Keep these working as-built marked drawings current on a weekly basis and at least one set available on the jobsite at all times. Changes from the contract plans which are made in the work or additional information which might be uncovered in the course of construction must be accurately and neatly recorded as they occur by means of details and notes. Prepare final electronic record (as-built) drawings after the completion of each definable feature of work as listed in the Contractor Quality Control Plan (Foundations, Utilities, Structural Steel, etc., as appropriate for the project). Show on the working and final record drawings, but not limited to, the following information:

a. The actual location, kinds and sizes of all sub-surface utility lines. In order that the location of these lines and appurtenances may be determined in the event the surface openings or indicators become covered over or obscured, show by offset dimensions to two permanently fixed surface features the end of each run including each change in direction on the record drawings. Locate valves, splice boxes and similar appurtenances by dimensioning along the utility run from a reference point. Also record the average depth below the surface of each run.

b. The location and dimensions of any changes within the building structure.

c. Correct grade, elevations, cross section, or alignment of roads, earthwork, structures or utilities if any changes were made from contract plans.

d. Changes in details of design or additional information obtained from working drawings specified to be prepared and/or furnished by the Contractor; including but not limited to fabrication, erection, installation plans and placing details, pipe sizes, insulation material, dimensions of equipment foundations, etc.

e. The topography, invert elevations and grades of drainage installed or affected as part of the project construction.

f. Changes or modifications which result from the final inspection.

g. Where contract drawings or specifications present options, show only the option selected for construction on the final as-built prints.

h. If borrow material for this project is from sources on Government property, or if Government property is used as a spoil area, furnish a contour map of the final borrow pit/spoil area elevations.

i. Systems designed or enhanced by the Contractor, such as HVAC controls, fire alarm, fire sprinkler, and irrigation systems.

j. Modifications (include within change order price the cost to change working and final record drawings to reflect modifications) and compliance with the following procedures.

(1) Follow directions in the modification for posting descriptive changes.

(2) Place a Modification Delta at the location of each deletion.

(3) For new details or sections which are added to a drawing, place a Modification Delta by the detail or section title.

(4) For minor changes, place a Modification Delta by the area changed on the drawing (each location).

(5) For major changes to a drawing, place a Modification Delta by the title of the affected plan, section, or detail at each location.

(6) For changes to schedules or drawings, place a Modification Delta either by the schedule heading or by the change in the schedule.

(7) The Modification Delta size shall be 1/2 inch diameter unless the area where the circle is to be placed is crowded. Smaller size circle shall be used for crowded areas.

1.1.1.3 Drawing Preparation

Modify the record drawings as may be necessary to correctly show the features of the project as it has been constructed by bringing the contract set into agreement with approved working as-built prints, and adding such additional drawings as may be necessary. These working as-built marked prints must be neat, legible and accurate. These drawings are part of the permanent records of this project and must be returned to the Contracting Officer after approval by the Government. Any drawings damaged or lost by the Contractor must be satisfactorily replaced by the Contractor at no expense to the Government.

(1) Extensions of Design: Although Fire suppression and fire alarmsystems shall be added to the BIM model and subject to all of the submission requirements below (including native file submission on CD-ROM),shop Drawings such as structural fabrication and erection drawings and firealarm systems that will require extensive redrafting effort in order to create an electronic set will not be required to be incorporated into the electronic BIM-only set. They will be included as an Appendix to the paper copy and later

mylar set and scanned into both AutoCAD and PDF format for inclusion on the same CD-ROM as the other electronically submitted set of drawings. The Contractor shall participate in monthly review meetings with the Contracting Officer's Representative to show the progress made the preceding month and make all required changes. Prior to final construction inspection, the Contractor shall submit one copy of the red lined as-built drawings to the Contracting Officer's Representative for review and approval. The as-built drawings shall be certified as to their correctness by the signature of an authorized representative of the Contractor.

1.1.1.4 Computer Aided Design and Drafting (CADD) Drawings

Only employ personnel proficient in the preparation of CADD drawings in BIM and .dwgformat to modify the contract drawings or prepare additional new drawings. Additions and corrections to the contract drawings must be equal in qualityand detail to that of the originals. Line colors, line weights, lettering,layering conventions, and symbols must be the same as the original line colors, line weights, lettering, layering conventions, and symbols. If additional drawings are required, prepare them using the specified electronic file .dwg format applying the same graphic standards specified for original drawings. The title block and drawing border to be used for any new final record drawings must be identical to that used on the contract drawings. Accomplish additions and corrections to the contract drawings using CADD files. The Contractor will be furnished "as-designed"drawings in AutoCAD 2020 .dwg format compatible with a Windows 10 operatingsystem. The electronic files will be supplied on compact disc, read-only memory (CD-ROM). Provide all program files and hardware necessary to prepare final electronic record drawings. Eglin Engineering will review final record drawings for accuracy and return them to the Contractor for required corrections, changes, additions, and deletions.

a. Provide CADD "base" colors of red, green, and blue. Color code for changes as follows:

   (1) Deletions (Red) - Over-strike deleted graphic items (lines), lettering in notes and leaders.

   (2) Additions (Green) - Added items, lettering in notes and leaders.

   (3) Special (Blue) - Items requiring special information, coordination, or special detailing or detailing notes.

b. Within 10 days for contracts less than $5 million after Government approval of all of the working record drawings for a phase of work, prepare the final CADD record drawings for that phase of work and submit two sets of prints of these drawings for Government review and approval. The Government will promptly return one set of prints annotated with any necessary corrections. Within 7 days for contracts less than $5 million revise the CADD files accordingly at no additionalcost and submit one set of final prints on mylar media for the completed phase of work to the Government. Within 10 days for contracts less than $5 million of substantial completion of all phases of work, submit the final record drawing package for the entire project. Submit two sets of electronic files on compact disc, read-onlymemory (CD-ROM), one set of mylars, and one set of the approved workingrecord drawings. They must be complete in all details and identical inform and function to the contract drawing files supplied by the Government. Any transactions or adjustments necessary to accomplish this is the responsibility of the Contractor. The Government reserves the right to reject any drawing files it deems incompatible with the customer's CADD system. Paper prints, drawing

files and storage media submitted will become the property of the Government upon final approval. Failure to submit final record drawing files and marked prints as specified will be cause for withholding any payment due the Contractor under this contract. Contractor shall have all corrections resulting from Government review completed in order to have the final as-built record drawings submitted and approved within 120 calendar days after project completion date. Failure to meet Final As-Built submission will result in negative statement in CPARS. Approval and acceptance of final record drawings must be accomplished before final payment is made to the Contractor.

1.1.1.5 General

1. As-built drawings shall be submitted in a version of AutoCAD that is coordinated with 96 CEG drafting section at time of submission.

2. The as-built DWG files shall have no reference files attached as all shall be bound into the file to make one AutoCAD DWG file, which also shall be purged and created with standard AutoCAD pen table.

3. Scaled drawings should provide a bar scale and shall be in feet not meters. Contractor shall provide 1 hard copy of as-built on Mylar on an Arch D sheet size and 2 CD's in AutoCAD and PDF.

4. Final As-builts shall include the assigned building number in the title block and Air Force FTFA number.

1.1.1.6 Other Requirements

1. AutoCAD drawings shall have correct geometry:

   a. Segmented lines and arcs are to be made continuous and free of self overlapping sections, thus decreasing files size and increasing efficiency within the AutoCAD platform.

   b. All AutoCAD data shall be free of topological errors such as slivers, undershoots, overshoots dangles, overlaps, intersections, etc.

   c. Area features such as building footprints, parking lots, roadways, and airfield pavements shall be true polyline polygons. Adjacent polygons shall not have gaps or overlaps.

2. All native AutoCAD drawings (Civil) shall be checked for correct spatial projection to one of the following:

   a. North American Datum 1983 Florida State Plane North FIPS 0903 Feet (AutoCAD Code FL83-NF)

   b. Universal Transverse Mercator 1984, Zone 16 North (AutoCAD Code UTM84-16N)

3. Any Building Information Models (BIM) developed for a project shall be supplied in accordance with section I.5&6 of the U.S. Air Force Building Information Modeling Minimum Requirements (current version): http://wbdg.org in a Model Archive as part of the final as-built submittal consisting of two sets of files:

   a. The first set shall be a collection of individual Models as received from the Model Element Author(s).

b. The second set of files shall consist of the aggregate of those individual Models in a format suitable for archiving and viewing. The aggregate model shall also be submitted in a DWG file format.

4. Drawings submitted for approval as as-builts shall have all changes incorporated into the final drawings.

a. Drawings shall be free of revision clouds, hand-written notes, scanned in change orders, etc.

b. Revision symbols shall be accompanied with an entry in the sheet's revision block. Revision block entries shall consist of a brief description of the change along with the change order number.

c. Each sheet shall be annotated in bold letters near the title block with the date the as-builts were accepted (i.e. AS-BUILT DRAWING 12 APR 2012). AND signed by contractor's engineer certifying asbuilt conditions.

1.1.1.7 Payment

Contracting Officer to withhold three percent of contract amount pending completion and approval of all requirements specified in this section. No separate payment will be made for record drawings required under this contract, and all costs accrued in connection with such drawings are considered a subsidiary obligation of the Contractor.

APPENDIX E

EGLIN STANDARD TOILET ACCESSORIES

MERCHANTS PAPER COMPANY, INC.

Dispenser Price List


Gojo Soap Dispensers

5155-06	Foaming Soap Dispenser	$5.95 / each



Roll Towel Dispensers


3467	Roll Towel Dispenser	$39.95 / each



Item #3467

JRT Dispensers

3253	Twin JRT Dispenser	$23.25 / each

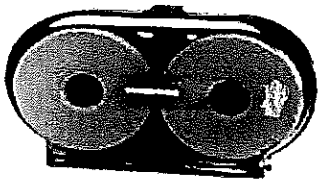

Item #3253

1800 Barrancas Avenue
Pensacola, Florida 32501
(850) 433-0006 * Fax: (850) 433-8783
www.merchantsppr.com

AFFLINK

APPENDIX F

BASIS OF DESIGN FOR MODULAR UNITS

General Specification

Frame Construction:

Frame Type 1 **Outrigger**

Type: Outrigger and crossmember @ 48 in. O.C.
Main beams to 99 1/2 in. O.C.

Beam Size: 12 in. Jr. I-beam

Axles: Five-eight 6000# rated with (3-4) brake remainder tag as required per wts.

Hitch: Detachable underslung

Tires: 8x14.5 14 ply rated std (35-60 tires at heavy modules)

Additional Frame Items

Item No. 1 1 Lot 20' sister beams and pental eye couplers

Floor Construction:

Floor Type No. 1

Floor Joist: 2x8 #2 SYP equal or better

Framing Type: Transverse

Joist Spacing: 12 in. O.C. (8" O.C. @ special conditions)

Floor Decking: Double layer 3/4 in. Sturd-I-Floor. Bottom layer to be stapled and glued and top layer to be applied with glue and to be screwed.

Insulation: R-30 Unfaced (2-layers of R-15 HD)

Bottom Board: Mobilflex

Floor Covering Type No. 1

Item No. 1 Ceramic tile in restrooms and housekeeping over ¼" Hardi-backer or equal at Restrooms only. Shower area to be treated with hydro-bond coating for water seepage alleviation.

Item No. 2 1 Balance of floor covering to be 24 x 24 Carpet Tile with Powder bond vinyl cushion Or 12x12 VCT per room finish schedule

Item No. 3 1 EA Belco floor hatch

Base Trim Type No. Rubber Wall base

Exterior Wall Construction:

Framing: 2x6 #2 SYP equal or better @ 16 in. O.C. w/double 2x6 #2 SYP equal or better top plate and single 2x6 #2 SYP or better bottom plate

Wall Sheathing Type 1 5/8 in. DensGlass Fire guard.

Insulation: R-21 Kraft back fiberglass batt.

Siding Type No. 1 Exterior finish and Insulation system(EFIS)-

Siding Type No. 2 Slit Face CMU Block applied as Wainscot per elevation detail

Wall Covering Type No. 1 5/8 in. Gyp. Taped, bedded, med. orange peal texture & paint (over 1/4

in. luan backer w/ staggered seams)
Covering Length 244 ft.
Covering Height 9 ft.

Wall Covering Type No. 2 5/8 in. Unfinished Type-X gypsum [above the T-grid]
Covering Length 308 ft.
Covering Height 3 ft.

Wall Covering Type No. 3 5/8 in. Unfinished Type-X gypsum
Covering Length 384 ft.
Covering Height 13 ft.

Wall Covering Type No. 4 FRP over MR Board at Janitors closet
Covering Length 7 ft.
Covering Height 9 ft.

Additional Exterior Wall Items

Item No. 1 Ceramic tile at 6'-0 w/ top trim in the restrooms over Glass matt MR

Item No. 2 full height FRP in the janitors closet

Item No. 3 Wall assembly for the Secure Area
Siding, 5/8 DensGlass fire guard, 2x6 stud w/ R-21, (2) layers of 5/8-X raw Gyp. Med and taped edges and (1) layer of tape, texture and paint

Item No. 4 Assembly of NON STC walls- Exterior siding, DensGlass fire guard, 2x6 stud w/ R-21 and (1) layer of 5/8-x Tape, texture and paint

Item No. 5 Wall area above the T-grid on the exterior wall is to be panted white

Item No. 6 2-beads of acoustic caulk at the top and bottom of the STC rated wall

Interior Wall Construction:

Wall Framing Type 1

Framing: 2x4 #2 SYP equal or better @ 16 in. o.c. w/double 2x4 #2 SYP equal or better top plate and single 2x4 #2 SYP or better bottom plate

Insulation: R-11 unfaced battens for sound attenuation

Wall Covering Type No. 1 5/8 in. Gyp. Taped, bedded, med. orange peal texture & paint (over 1/4in. luan backer w/ staggered seams)
Covering Length 331 ft.
Covering Height 9 ft.

Wall Covering Type No. 2 5/8 in. Gyp. Taped, bedded, med. orange peal texture & paint (over 1/4in. luan backer w/ staggered seams)
Covering Length 331 ft.
Covering Height 3 ft.

Wall Covering Type No. 3 FRP over MR Board At janitor's closet
Covering Length 18 ft.
Covering Height 9 ft.

Wall Covering Type No. 4 5/8 in. Unfinished Type-X gypsum
Covering Length 504ft. [above the T-grid]
Covering Height 3 ft.

Wall Covering Type No. 5 3/8 in. CDX plywood [mateline side of Dbl. wall between mod's F&G]
Covering Length 128 ft.
Covering Height 13 ft.

Wall Covering Type No. 6 Ceramic tile
Covering Length 155 ft.
Covering Height 6 ft.

Additional Interior Wall Items

Item No. 1 Ceramic tile at 6'-0 w/ top trim over Glass MR Board at RR, 5/8" Cementious backer board w/ Hydro Ban full ht. at showers

Item No. 2 All walls are extended to the bottom of the rafters and insulated

Item No. 3 STC rated wall is full height to the bottom of the rafters, STC 52 rated w/ 4 layers of 5/8-X gyp. [2-layers each side]

Item No. 4 Clear Plastic corner guards -4'

Item No. 5 Server Room - 16 L/F of 4' tall A-C plywood w/ 2 coats of white fire retardant paint

Roof Construction:

Design Load: 20 p.s.f live load

Roof Type No. 1
Rafter: Flat solid rafter

Rafter size: 2x8 #2 SYP equal or better
Spacing: 24 in. O.C.

Mate Beam Type 1
Mate beam: Pre-engineered wood truss
Height: 24in. – Tapered (Transverse)
Length: 70 ft.

Ceiling Type No. 1
Ceiling: 5/8 in. type-X-gypsum (Raw)

Ceiling Type No. 2
Ceiling: Acoustical ceiling panels,24 x 24 Square Edge Lay in Tegular
Hot Dip galvanized metal suspension system

Insulation: R-30 compressed, unfaced fiberglass batt
Sheathing: 3/4 in. CDX plywood w/ ¼" Densdeck
Roofing: 80 mil white single ply PVC

Additional Roof Items

Item No. 1 Double layer of 5/8- X Gyp at the bottom of the raters. Top layer mud and taped at edges and bottom layer taped and painted.

Item No. 2 80 mil PVC roofing fully adhered w/ 1/4 in. Densdeck sheathing. Polyester Scrim reinforced

Exterior Doors:

Door Type No. 1 72in. Dbl Storefront.w/ sidelite
Quantity: 1

Door Type No. 2 36in. Commercial steel blank, 18 ga. door, 16 ga. frame.
Quantity: 1
Closer: Hydraulic closer

Additional Exterior Door Items

Item No. 1 Emergency exit doors are STC-52, w/ LCN4040 closers and panic device is Detex ECL600

Interior

Door Type No. 1 36in. X 84in. prefinished white birch solid core w/ metal jamb.
Hardware: Lever lockset, Best brand. Construction core(s)
Closer: Hydraulic closer.

Door Type No. 2 36in. X 84in. prefinished white birch solid core w/ metal jamb.
Hardware: Lever lockset, Best brand. Construction core(s)

Door Type No. 3 36in. X 84in. prefinished white birch solid core w/ metal jamb.
Hardware: Push-Pull hardware
Closer: Hydraulic closer.
Kickplates: Kick plate, 10 in. x 34 in., Stainless steel, one side only

Door Type No. 4 36in. X 84in. prefinished white birch solid core w/ metal jamb.
Hardware: Lever passage, Best brand.

Additional Interior Door Items

Item No. 1 Dbl. Blank, insulated, STC 52 rated doors w/ astragal & locking hasp

Item No. 2 The wood doors are 3' x 7' w/ pre-finished white birch doors and pre-finished white jambs. Closers are LCN4040

Item No. 3 STC 52 rated doors, LCN 4040 closers and LKM7003X10 Combo lock w/ remote release and key override as noted. Best keyed lever as noted. Panic as noted

Windows: 36” x 18” Aluminum Fixed window, Dual glazed Low E,

Electrical:

Service:	480/277 v. 60 Hz. Three phase Primary, 208/120 v 60 Hz. Secondary
Scif MDP	480Y/277 v, 60 Hz.. 3 phase, 2000 amp 100% Rated Main Breaker, 65k AIC fully rated, Copper busses/ground bars, Service Entrance Rated, Square D QED-2 Switchboard.
Conference MDP	480Y/277 v, 60 Hz.. 3 phase, 600 amp, 65k AIC fully rated, Copper busses/ground bars, Bolt on breakers.
Panel Type 1	(5) 208/1280v, 3 Ph W/ MCB, 100 – 800 amp frames as required per load, Interior mount NEMA 1. Bolt on breakers, copper busing/ground bars, 22k AIC fully rated
Panel Type 2	(13) 208/1280v, 3 Ph W/ MLO, 60 – 250 amp frames as required per load Interior mount NEMA 1. Bolt on breakers, copper busing/ground bars, 22k AIC fully rated
Panel Type 3	(5) 480/277 v,. 3 Ph, 400 amp MLO Intetrior mount NEMA 1. Bolt on Copper busing/ground bars, 65k AIC fully rated
Raceway:	E.M.T. thin wall conduit (w/ separate green ground and neutrals) (All conductors are copper)
Light Type No. 1	48 in. 4-tube diffused fluorescent recessed lay-in with electronic ballast and T-8 Bulbs
Light Type No. 2	None
Light Type No. 3	48 in. 2-tube diffused fluorescent recessed lay-in with electronic ballast and T-8 Bulbs
Light Type No. 4	48 in. twin tube diffused fluorescent with electronic ballast & T8 bulbs
Light Type No. 5	48 in. 2-tube diffused fluorescent recessed lay-in with electronic ballast and T-8 Bulbs
Light Type No. 6	48 in. 3-tube diffused fluorescent recessed lay-in with electronic ballast and T-8 Bulbs
Light Type No. 7	48 in. 3-tube diffused fluorescent recessed lay-in with electronic ballast and T-e Bulbs
Light Type No. 8	24 in. x 24 in. U-bent diffused fluorescent lay-in with electronic ballast and T-8 Bulbs
Exit Light Type No. 1	115v w/battery back up
Exit Light Type No. 2	Combo dual emergency light / exit sign w/battery backup, remote

Emerg. Light Type No. 1 Exterior double head battery pack

Emerg. Light Type No. 2 Interior remote head(s)

Emerg. Light Type No. 3 Exterior remote head(s)

Emerg. Light Type No. 4 Emergency ballast for above fluorescent fixtures where required for emergency egress

Emerg. Light Type No. 5 Provide lights on generator power to provide path to server rooms during outages

Receptacle Type 1 125v GFCI protected

Receptacle Type 2 20a Heat tape receptacle under unit

Receptacle Type 3 125v Waterproof exterior with in-use cover

Receptacle Type 4 20a/125v Duplex

Receptacle Type 5 20a/125v Dedicated duplex receptacle as noted on plans

Phone/Comm 4x4 Stubbed with 3/4 in. EMT conduit

Additional Electrical Items

Item No. 1 Surface mounted 2300 BAC wire mold and boxes as required at surface mounted switches and receptacles, and 4x4 powered standard pull boxes above T-grid w/ 2310A connector and pull string for surface mounted equipment.

Item No. 2 Surface mounted 2300 BAC wire mold and extra deep two gang boxes as required at surface mounted data.

Item No. 3 Powered 4 in. octagonal box w/ LED lights, mounted at the bottom of the floor w/ 1/2 in. EMT for onsite crawl space lighting w/ switch in the janitors closet

Item No. 4 4x4 extra deep empty J-boxes w/ blank covers and single gang mud rings stubbed above ceiling w/ 1" EMT for data

Item No. 5 Occupancy wall switches

Item No. 6 Wall switch indicator light for crawlspace lights

Item No. 7 Ceiling mounted occupancy sensor switches

Item No. 8 1 lot 50 amp and 60 amp HD fused disconcerts, for air handlers

Item No. 9 Switched powered J-boxes only for lights and chases at the exterior matelines

Item No. 10 Dedicated recepts at NIPR / SIPR and AV room

Plumbing:

Supply: Type L Hard Copper

D.W.V. System: Poly vinyl chloride Schedule 40

Water Closet Type No. 1 Elongated commercial flush valve

Water Closet Type No. 2 Elongated commercial flush valve

Urinal: Wall hung white vitreous with commercial grade flush valve

Lavatory Type 1 20 in. x 17 in. china in solid surface top w/ADA handles

Lavatory Type 2 White vitreous wall hung w/ADA handles

Water Heater Type 1 20 gallon electric w/vacuum relief and drain pan

Paper Holder:	Chrome single roll wall mount
Towel Dispenser:	Surface wall mounted
Soap Dispenser:	Wall mount
Grab Bars:	Sets
Mirrors:	24 in. x 36 in. with stainless steel frame
Modesty Partitions:	Poly.
Urinal Screens:	Poly.
Water Cooler Type No. 1	Wall hung split-level handicap refrigerated
Sink Type No. 1	Molded mop basin with wall-mounted faucet
Sink Type No. 2	Floor drain, 2 in. with trap primer or trap guard
Sink Type No. 3	33 in. x 22 in. Dbl bowl stainless steel sink with single lever faucet w/ADA

Additional Plumbing Items

Item No. 1	Thermostatic mixing valves
Item No. 2	Dbl. roll T.P holders
Item No. 3	Solid HDPE Plastic Mosaic partitions and urinal blinds
Item No. 4	Banjo strainer
Item No. 5	Water hammer arrestor
Item No. 6	Large copper pipe
Item No. 7	PVC condensate line ran just above the ceiling to below the building only. For manifold and pipe from air handlers by others on site

Cabinets:

Base Cabinets:	Stained wood w/ solid surface top.
Wall Cabinets:	Stained wood

Fire Protection: Design Fabricate and Install fire sprinkler system in accordance with NFPA 13.

APPENDIX G

GEOTECHNICAL ENGINEERING REPORT

GEOTECHNICAL ENGINEERING REPORT



Temporary Facility for 350th SWW

Eglin Air Force Base, Okaloosa County, Florida

PREPARED FOR:

Heffernan Holland Morgan Architecture
312 South Alcaniz Street
Pensacola, Florida 32502

NOVA Project Number: 10116-2022143

June 16, 2022

NOVA

PROFESSIONAL | PRACTICAL | PROVEN

June 16, 2022

Heffernan Holland Morgan Architecture
312 South Alcaniz Street
Pensacola, Florida 32502

Attention: Mr. Phillip Morgan, AIA

Subject: Geotechnical Engineering Report
TEMPORARY FACILITY FOR 350TH SWW
Eglin Air Force Base, Okaloosa County, Florida
NOVA Project Number 10116-2022143

Dear Mr. Morgan:

NOVA Engineering and Environmental LLC (NOVA) has completed the authorized Geotechnical Engineering Report for the planned facility to be located within Eglin Air Force Base in Okaloosa County, Florida. This report briefly discusses our understanding of the project at the time of the subsurface exploration, describes the geotechnical consulting services provided by NOVA, and presents our findings, conclusions, and recommendations.

We appreciate your selection of NOVA and the opportunity to be of service on this project. If you have any questions, or if we may be of further assistance, please do not hesitate to contact us.

Sincerely,
NOVA Engineering and Environmental LLC

.

William L. Lawrence, P.E.
Senior Regional Engineer
Florida Registration No. 60147

Copies Submitted:
via electronic mail service

TABLE OF CONTENTS

1.0 SUMMARY 1
1.1 GENERAL 1
1.2 SITE PREPARATION 1
1.3 GROUNDWATER CONTROL 2
1.4 FOUNDATIONS 2
1.5 PAVEMENTS 2
1.6 STORMWATER MANAGEMENT SYSTEM 2
2.0 INTRODUCTION 3
2.1 PROJECT INFORMATION 3
2.2 SCOPE OF WORK 3
3.0 SITE DESCRIPTION 5
3.1 LOCATION AND LEGAL DESCRIPTION 5
3.2 SUBJECT PROPERTY AND VICINITY GENERAL CHARACTERISTICS 5
3.3 CURRENT USE OF THE PROPERTY 5
4.0 FIELD EXPLORATION 6
5.0 LABORATORY TESTING 7
5.1 SOIL CLASSIFICATION 7
5.2 MOISTURE CONTENT 7
5.3 SIEVE ANALYSIS 7
5.4 FALLING-HEAD LABORATORY PERMEABILITY TEST 8
6.0 SUBSURFACE CONDITIONS 9
6.1 GEOLOGY 9
6.2 SOIL CONDITIONS 9
6.3 GROUNDWATER CONDITIONS 10
7.0 CONCLUSIONS AND RECOMMENDATIONS 11
7.1 SITE PREPARATION 11
7.2 GROUNDWATER CONTROL 13
7.3 FOUNDATIONS 13
7.4 PAVEMENT SECTION 16
7.5 STORMWATER MANAGEMENT SYSTEM 17
8.0 CONSTRUCTION OBSERVATIONS 18
8.1 SUBGRADE 18
8.2 SHALLOW FOUNDATIONS 18

APPENDICES

Appendix A – Figures and Maps
Appendix B – Subsurface Data
Appendix C – Laboratory Data
Appendix D – Qualifications of Recommendations

1.0 SUMMARY

A brief summary of pertinent findings, conclusions, and recommendations are presented below. This information should not be utilized in design or construction without reading the report in its entirety and paying particular attention to the recommendations presented in the text and Appendix.

1.1 GENERAL

The proposed facility will be located northeast of the intersection of Foster Drive and Gaffney Road within Eglin Air Force Base in Okaloosa County, Florida. We understand that the project will include constructing a new single-story slab-on-grade structure with associated asphalt paved parking areas and a stormwater management system (SMS) consisting of a shallow dry retention basin to treat and dispose of stormwater runoff associated with the planned site improvements.

Our field exploration at the subject site included performing three (3) Standard Penetration Test (SPT) borings within the proposed structure footprint, two (2) auger borings within the proposed pavement areas, and two (2) auger borings within the proposed SMS basin. Drilling, testing, and sampling operations were performed in general accordance with ASTM designations and other industry standards.

Beneath a thin stratum of topsoil, the test borings generally encountered mixed strata of very loose to medium dense fine-grained slightly silty sands and sands (USCS classifications of SP-SM and SP) to the maximum depth explored of about 25 feet below existing grade (BEG).

1.2 SITE PREPARATION

We recommend stripping and grubbing the proposed construction areas to remove all surficial vegetation and topsoil, trees and/or associated root systems, and any other deleterious non-soil materials that are found to be present. The soils exposed at the stripped grade elevation, as well as subsequent fill lifts and footing excavations, should be compacted to a minimum soil density of at least 98 percent of the maximum dry density as determined by the Modified Proctor test (ASTM D-1557).

We recommend densifying (compacting) the upper zone of very loose to loose sands to slightly silty sands (SP and SP-SM, N-values of concern varying between 3 and 7) that were encountered in the upper 10 feet of the soil horizon in the SPT borings. This can most likely be accomplished by compacting the exposed subgrade within the proposed structure footprint from the stripped grade elevation with a heavy weight vibratory roller (i.e., a minimum 10-ton roller, static weight, with a minimum 5-foot drum diameter), as

equipment of this size can typically impact sandy soil profiles above groundwater to depths of 5+ feet. Verification of the improvement of the loose subgrade soils to a depth of at least 4 feet below the lowest bottom-of-footing elevation for the proposed structure should be achieved via Dynamic Cone Penetrometer testing, and additional recommendations (i.e., further compaction effort, possible undercutting, etc.) can be rendered in the field as these tests are performed. We note that vibratory compaction operations should not be performed within a clear distance of 50 feet from any adjacent structures.

A geotechnical engineer should carefully evaluate all subgrades prior to foundation, slab-on-grade, and pavement section construction to confirm compliance with this report; evaluate geotechnical sections of the plans and specifications for the overall project; and provide additional recommendations that may be required.

1.3 GROUNDWATER CONTROL

Groundwater was not encountered in the test borings within the maximum depth explored of about 25 feet BEG at the time of our field exploration and is not expected to adversely impact the planned improvements to this property.

1.4 FOUNDATIONS

After the recommended site/subgrade preparation and fill placement, we recommend that the proposed structure be supported on a conventional shallow foundation system bearing upon compacted structural fill. The building foundation may be designed for a maximum soil bearing pressure of **2,000 pounds per square foot (psf)**.

1.5 PAVEMENTS

We understand that a flexible (asphalt) pavement section will be employed for this development. Based on the results of our test borings, the subsurface conditions encountered are generally adaptable for providing adequate support of these pavement sections. Pavement section recommendations are provided in the *Conclusions and Recommendations* section of this report using assumed traffic loading, design life, and estimated soil subgrade strength parameters based on published data and our experience with similar subsurface profiles.

1.6 STORMWATER MANAGEMENT SYSTEM

Based on the results of the SMS borings and limited laboratory testing, the subsurface conditions encountered beneath the proposed SMS footprint appear to be adaptable for the treatment and disposal of stormwater runoff via the desired conventional shallow dry retention basin.

2.0 INTRODUCTION

2.1 PROJECT INFORMATION

Our understanding of this project is based on discussions with the project team, review of the provided site plans, a site reconnaissance performed during the boring layout, review of aerial photography of the site via internet-based GIS software, and our experience with similar geotechnical conditions in the near vicinity to this project site

2.1.1 Proposed Construction

We understand that the project will include constructing a new single-story slab-on-grade structure with associated asphalt paved parking areas and a stormwater management system (SMS) consisting of a shallow dry retention basin to treat and dispose of stormwater runoff associated with the planned site improvements.

2.1.2 Maximum Loads

Foundation support for the proposed structure is anticipated to be accomplished via conventional shallow footings and a slab-on-grade system. Final structural loadings were not available from the design team at the time of the issuance of this report; we have therefore assumed that maximum isolated interior column and exterior load bearing wall loads will not exceed 50 kips per column and 4 kips per lineal foot, respectively.

2.1.3 Floor Elevations / Site Grading

Site grading details were not available from the design team at the time of the issuance of this report; we have therefore assumed that 2 feet or less of fill, and no cut, will be required to achieve the desired finished subgrade elevations within the proposed structure footprint and pavement areas. The proposed retention basin has also been assumed to be relatively shallow (i.e., on the order of 5 feet or less in depth, relative to existing site grade elevations).

2.2 SCOPE OF WORK

Heffernan Holland Morgan Architecture engaged NOVA to provide geotechnical engineering consulting services for the proposed **Temporary Facility for 350th SWW** project. This report briefly discusses our understanding of the project, describes our exploratory procedures, and presents our findings, conclusions, and recommendations.

The primary objectives of this study were to perform a geotechnical exploration within the areas of the proposed construction and to assess these findings as they relate to geotechnical aspects of the planned site development.

The authorized geotechnical engineering services included a site reconnaissance, a soil test boring and sampling program, laboratory testing, engineering evaluation of the field and laboratory data, and the preparation of this report. This completed geotechnical report includes:

- A description of the site, fieldwork, laboratory testing and general soil conditions encountered, including a Boring Location Plan and individual Test Boring Records.
- Site preparation considerations that include geotechnical discussions regarding site stripping and subgrade preparation, recommended cut or fill slopes, and engineered fill/backfill placement.
- Recommendations for controlling ground water during construction and the need for a permanent de-watering system based on the expected post construction groundwater levels.
- Foundation system recommendations for the proposed building, including an allowable bearing capacity, a recommended bearing depth, and installation considerations.
- Slab-on-grade construction considerations based on the geotechnical findings, including the need for a sub-slab vapor barrier or a capillary barrier.
- Suitability of on-site soils for re-use as structural fill and backfill. Additionally, the criteria for suitable fill materials will be provided.
- Flexible (asphalt) pavement section design recommendations.
- SMS design parameters including hydraulic conductivity values, a void ratio estimate, and apparent and normal permanent seasonal high groundwater levels in the proposed SMS area.
- Recommended quality control measures (i.e., sampling, testing, and inspection requirements) for site grading and foundation construction.

The assessment of site environmental conditions, including the presence of wetlands or detection of pollutants in the soil, rock or groundwater, laboratory testing of samples, or a site-specific seismic study was beyond the scope of this geotechnical study. If requested, NOVA can provide these services.

3.0 SITE DESCRIPTION

3.1 LOCATION AND LEGAL DESCRIPTION

The Subject Property is located northeast of the intersection of Foster Drive and Gaffney Road within Eglin Air Force Base in Okaloosa County, Florida. A Site Location Map is included in Appendix A.

3.2 SUBJECT PROPERTY AND VICINITY GENERAL CHARACTERISTICS

At the time of our field exploration, the vicinity of the project area was observed to be generally developed with military uses and was surrounded by various structures with associated parking lots.

3.3 CURRENT USE OF THE PROPERTY

At the time of our field exploration, the Subject Property was observed to be vacant land vegetated with short grasses.

4.0 FIELD EXPLORATION

Boring locations were established in the field by NOVA personnel using the provided site plan, and by estimating/taping distances and angles from existing site landmarks. The approximate locations are shown in Appendix B and should be considered approximate. If increased accuracy is desired by the client, NOVA recommends that the boring locations and elevations be surveyed.

Our field exploration was conducted on June 7, 2022, and included:

- Three (3), 25-foot-deep Standard Penetration Test (SPT) borings (designated B-1, B-2 and B-3) drilled within the proposed structure footprint,
- Two (2), 5-foot-deep auger borings (designated P-1 and P-2) within the proposed pavement areas.
- Two (2), 15-foot-deep auger borings (designated R-1 and R-2) drilled within the proposed retention basin.

Soil Test Borings: The structure borings were performed using the guidelines of ASTM Designation D-1586, "Penetration Test and Split-Barrel Sampling of Soils". An auger drilling process was used to advance the borings. At regular intervals, soil samples were obtained with a standard 1.4-inch I.D., 2.0-inch O.D., split-tube sampler. The sampler was first seated six inches and then driven an additional foot with blows of a 140-pound hammer falling 30 inches. The number of hammer blows required to drive the sampler the final foot is designated the "Penetration Resistance". The penetration resistance, when properly interpreted, is an index to the soil strength and density. Representative portions of the soil samples, obtained from the sampler, were placed in sealed containers and transported to our laboratory for further evaluation and laboratory testing.

Test Boring Records in Appendix B show the standard penetration test (SPT) resistances, or “N-values”, for the SPT borings and present the soil conditions encountered in all of the borings. These records represent our interpretation of the subsurface conditions based on the field exploration data, visual examination of the split-barrel samples, laboratory test data, and generally accepted geotechnical engineering practices. The stratification lines and depth designations represent approximate boundaries between various subsurface strata. Actual transitions between materials may be gradual.

5.0 LABORATORY TESTING

A laboratory testing program was conducted to characterize materials which exist at the site using the recovered split-barrel samples. Selected test data are presented on the Test Boring Records attached in the Appendix. The specific tests are briefly described on the following page. All soil samples will be properly disposed of 30 days following the submittal of this NOVA subsurface exploration report unless you request otherwise.

5.1 SOIL CLASSIFICATION

Soil classification provides a general guide to the engineering properties of various soil types and enable the engineer to apply past experience to current problems. In our explorations, samples obtained during drilling operations are observed in our laboratory and visually classified by an engineer. The soils are classified according to consistency (based on number of blows from standard penetration tests), color and texture. These classification descriptions are included on our Test Boring Records. The classification system discussed above is primarily qualitative; laboratory testing is generally performed for detailed soil classification. Using the test results, the soils were classified using the Unified Soil Classification System. This classification system and the in-place physical soil properties provide an index for estimating the soil's behavior. The soil classification and physical properties obtained are presented in this report.

5.2 MOISTURE CONTENT

The moisture content is the ratio expressed as a percentage of the weight of water in a given mass of soil to the weight of the solid particles. This test was conducted in general accordance with ASTM D-2216.

5.3 SIEVE ANALYSIS

The sieve analysis consists of passing a soil sample through a series of standard sieve openings. The percentage of soil, by weight, passing the individual sieves is then recorded and generally presented in a graphical format. The percentage of fines passing through the No. 200 sieve is generally considered to represent the amount of silt and clay of the tested soil sample. The sieve analysis test was conducted in general accordance with ASTM Designation D-1140.

5.4 FALLING-HEAD LABORATORY PERMEABILITY TEST

A remolded falling head permeability test (ASTM D-5084) is a common laboratory test used to determine the hydraulic conductivity of fine-grained soils. The test involves the flow of water through a re-molded, fully saturated soil sample inside a rigid-wall permeameter connected to a standpipe of constant diameter.

Before beginning the flow measurements, the soil sample is saturated and the standpipe is filled with water to a given level. The test then starts by allowing the water to flow through the sample until the water in the standpipe reaches a lower limit. The time required for the water to flow from the upper to lower limit is recorded.

6.0 SUBSURFACE CONDITIONS

6.1 GEOLOGY

The site is located in the Okaloosa County, Florida area and according to the United States Geological Survey (USGS), is situated within the greater Gulf Coastal Plain region. The site is generally covered with Alluvium sediments of the Pleistocene/Holocene periods underlain by the Citronelle formation of the Pliocene/Pleistocene periods. The alluvial sediments typically consist of siliciclastics that are fine to coarse quartz sand containing clay lenses and gravel in places. Sands consists primarily of very fine to very coarse poorly sorted quartz grains; gravel is composed of quartz, quartzite, and chert pebbles. In areas of the Valley and Ridge province gravels are generally composed of angular to sub-rounded chert, quartz, and quartzite pebbles. Coastal deposits in the Okaloosa County area include fine to medium quartz sand with shell fragments and accessory heavy minerals along Gulf beaches and fine to medium quartz sand, silt, clay, peat, mud and ooze in the Mississippi Sound, Little Lagoon, bays, lakes, streams, and estuaries. The Citronelle formation consists primarily of varicolored/mottled lenticular beds of poorly sorted sand, clayey sand, clay, and clayey gravel. Limonite pebbles and lenses of limonite cemented sand occur locally in weathered Miocene exposures.

Surficial soils in the region are primarily siliciclastic sediments deposited in response to the renewed uplift and erosion in the Appalachian highlands to the north and sea-level fluctuations. The extent and type of deposit is influenced by numerous factors, including mineral composition of the parent rock and meteorological events.

6.2 SOIL CONDITIONS

The following paragraph provides a generalized description of the subsurface profiles and soil conditions encountered in the borings conducted during this study. The Test Boring Records in the Appendix should be reviewed to provide detailed descriptions of the conditions encountered at each boring location. Conditions may vary at other locations and times.

Beneath a thin stratum of topsoil, the test borings generally encountered mixed strata of very loose to medium dense fine-grained slightly silty sands and sands (USCS classifications of SP-SM and SP) to the maximum depth explored of about 25 feet below existing grade (BEG).

6.3 GROUNDWATER CONDITIONS

6.3.1 General

Groundwater in the Gulf Coastal Plain typically occurs as an unconfined aquifer condition. Recharge is provided by the infiltration of rainfall and surface water through the soil overburden. More permeable zones in the soil matrix can affect groundwater conditions. The groundwater table is expected to be a subdued replica of the original surface topography. Based on a review of topographic maps and our visual site observations, we anticipate the groundwater flow at the site to be towards the east.

Groundwater levels vary with changes in season and rainfall, construction activity, surface water runoff and other site-specific factors. Groundwater levels in the Okaloosa County area are typically lowest in the late fall to winter and highest in the early spring to mid-summer with annual groundwater fluctuations by seasonal rainfall; consequently, the water table may vary at times.

6.3.2 Soil Test Boring Groundwater Conditions

Groundwater was not encountered within the maximum depth explored of about 25 feet BEG at the time of the soil exploration, which occurred during a period of relatively normal seasonal rainfall.

Based on comparisons of current annual monthly rainfall data to historical rainfall data extending back 50+ years in time, we estimate that the normal permanent seasonal high groundwater (SHGW) table for this site will remain at a depth greater than 25 feet BEG, during the wet season.

7.0 CONCLUSIONS AND RECOMMENDATIONS

The following conclusions and recommendations are based on our understanding of the proposed construction, our site observations, our evaluation and interpretation of the field and laboratory data obtained during this exploration, our experience with similar subsurface conditions, and generally accepted geotechnical engineering principles and practices.

Subsurface conditions in unexplored locations or at other times may vary from those encountered at specific boring locations. If such variations are noted during construction, or if project development plans are changed, we request the opportunity to review the changes and amend our recommendations, if necessary.

As previously noted, boring locations were established in the field by estimating distances and angles from existing site landmarks. If increased accuracy is desired by the client, we recommend that the boring locations and elevations be surveyed.

7.1 SITE PREPARATION

We anticipate that up to 2 feet of fill, and no cut, will be required to achieve the desired finished subgrade elevations within the proposed structure footprint and pavement areas. The proposed retention basin has also been assumed to be relatively shallow (i.e., on the order of 5 feet or less in depth, relative to existing site grade elevations).

Prior to proceeding with construction, all topsoil and vegetation, trees and associated root systems, and any other deleterious non-soil materials found to be present should be stripped from the proposed construction areas. Clean topsoil may be stockpiled and subsequently re-used in landscaped areas. Debris-laden materials should be excavated, transported, and disposed of off-site in accordance with appropriate solid waste rules and regulations. All existing utility locations should be reviewed to assess their impact on the proposed construction and relocated/grouted in-place as appropriate.

We recommend densifying (compacting) the upper zone of loose fine-grained sands and slightly silty sands (SP and SP-SM, N-values of concern varying between 3 and 7) that were encountered in the upper 10 feet of the soil horizon in the building SPT borings. This can most likely be accomplished by compacting the exposed subgrade within the proposed structure footprint from the stripped grade elevation with a heavy weight vibratory roller (i.e., a minimum 10-ton roller, static weight, with a minimum 5-foot drum diameter), as equipment of this size can typically impact sandy profiles above groundwater to depths of 5+ feet.

We note that vibratory compaction operations should not be performed within a clear distance of 50 feet from any adjacent structures. Verification of the improvement of the loose subgrade soils to a depth of 4 feet below the lowest bottom-of-footing elevation for the proposed structure should be achieved via Dynamic Cone Penetrometer testing, and additional recommendations (i.e., further compaction effort, possible undercutting, etc.) can be rendered in the field as these tests are performed.

The soils exposed at the stripped grade elevation(s) should be compacted to a minimum soil density of at least 98 percent of the maximum dry density as determined by the Modified Proctor test method (ASTM D-1557). NOVA should observe the compaction of the subgrade to locate soft, weak, or excessively wet fill or existing soils present at the time of construction. Any unstable materials observed during the evaluation and compaction operations should be undercut and replaced with structural fill or stabilized in-place by scarifying and re-densifying.

7.1.1 Soil Suitability

The majority of the on-site near surface soils can be categorized as SP and SP-SM, or fine-grained relatively clean sands and slightly silty sands based on the Unified Soil Classification System (USCS). These relatively sandy soil types are considered suitable for re-use as structural fill within the proposed construction areas.

All materials to be used for backfill or compacted fill construction should be evaluated and, if necessary, tested by NOVA prior to placement to determine if they are suitable for their intended use. In general, based upon the boring results, the near surface sands and slightly silty sands such as those encountered in the borings can be used as structural fill as well as general subgrade fill and backfill, provided that the fill material is free of rubble, clay, rock, roots and organics. Any off-site materials used as fill should be approved by NOVA prior to acquisition.

Organic and/or debris-laden material is not suitable for re-use as structural fill. Topsoil, mulch, and similar organic materials can be wasted in architectural areas. Debris-laden materials should be excavated, transported, and disposed of off-site in accordance with appropriate solid waste rules and regulations.

7.1.2 Soil Compaction

Fill should be placed in thin, horizontal loose lifts (maximum 12-inch) and compacted to a minimum soil density of at least 98 percent of the Modified Proctor maximum dry density (ASTM D-1557). The upper 12 inches of soil

beneath the bottoms of all foundation footing excavations should also be compacted to at least 98 percent.
In confined areas, such as utility trenches or behind retaining walls, portable compaction equipment and thinner fill lifts (3 to 4 inches) may be necessary.

Fill materials used in structural areas should have a target maximum dry density of at least 95 pounds per cubic foot (pcf). If lighter weight fill materials are used, the NOVA geotechnical engineer should be consulted to assess the impact on design recommendations.

Soil moisture content should be maintained within 3 percent of the optimum moisture content. We recommend that the grading contractor have equipment on site during earthwork for both drying and wetting fill soils. Moisture control may be difficult during rainy weather.

Filling operations should be observed by a NOVA soils technician, who can confirm suitability of material used and uniformity and appropriateness of compaction efforts. He/she can also document compliance with the specifications by performing field density tests using thin-walled tube, nuclear, or sand cone testing methods (ASTM D-2937, D-6938, or D-1556, respectively). One test per 400 cubic yards or fraction thereof in every 12-inch lift of placed fill is recommended, with test locations to be well distributed throughout the fill mass. When filling in small areas, at least one test per day per lift should be performed.

7.2 GROUNDWATER CONTROL

As was noted previously, groundwater was not encountered within the maximum depth explored of about 25 feet BEG at the time of our field exploration, which occurred during a period of relatively normal seasonal rainfall. Groundwater is therefore not expected to adversely impact the planned near surface construction.

As previously noted, groundwater levels are subject to seasonal, climatic, and other variations and may be different at other times and locations.

7.3 FOUNDATIONS

NOVA understands the project will include the construction of a new single-story structure. Foundation support for the proposed structure is anticipated to be accomplished via conventional shallow footings and a slab-on-grade system.

Final structural loadings were not available from the design team at the time of the issuance of this report; we have therefore assumed that maximum isolated interior column and exterior load bearing wall loads will not exceed 50 kips per column and 4 kips per lineal foot, respectively.

7.3.1 Shallow Foundations

Design: After the recommended site and subgrade preparation and fill placement, we recommend that a conventional shallow foundation system consisting of isolated spread footings and/or turn-down slab-on-grade construction be used to support the proposed structure.

Foundations bearing on densified existing soils and/or compacted structural fill, as recommended in this report, may be designed for a maximum allowable bearing pressure of **2,000 pounds per square foot (psf).**

We recommend minimum footing widths of 24 inches for ease of construction and to reduce the possibility of localized shear failures. Exterior and interior footing bottoms should be established at least 18 inches below finished surrounding exterior grades.

Settlement: Settlements for spread foundations bearing on the higher consistency residual materials were assessed using SPT values to estimate elastic modulus, based on published correlations and previous NOVA experience. We note that the settlements presented are based on the SPT boring results. Conditions may be better or worse in other areas; however, we believe the estimated settlements are reasonably conservative.

Based on column loadings, soil bearing capacities and the presumed foundation elevations as discussed above, we expect primary total settlement beneath individual foundations to be on the order of 1 inch or less.

The amount of differential settlement is difficult to predict because the subsurface and foundation loading conditions can vary considerably across the site. However, we anticipate differential settlement between adjacent foundations will be less than ½ inch. The final deflected shape of the structure will be dependent on actual foundation locations and loading.

Foundation support conditions are highly erratic and may vary dramatically in short horizontal distances. It is anticipated that the geotechnical engineer may recommend a different bearing capacity upon examination of the actual foundation subgrade at numerous locations. To reduce the differential settlement if lower consistency materials are encountered, a lower bearing

capacity should be used or the foundations should be extended to more competent materials. We anticipate that timely communication between the geotechnical engineer and the structural engineer, as well as other design and construction team members, will be required.

Construction: Foundation excavations should be evaluated by the NOVA geotechnical engineer prior to reinforcing steel placement to observe foundation subgrade preparation and confirm bearing pressure capacity.

Foundation excavations should be level and free of debris, ponded water, mud, and loose, frozen, or water-softened soils. Concrete should be placed as soon as is practical after the foundation is excavated and the subgrade evaluated. Foundation concrete should not be placed on frozen or saturated soil. If a foundation excavation remains open overnight, or if rain or snow is imminent, a 3 to 4-inch thick "mud mat" of lean concrete should be placed in the bottom of the excavation to protect the bearing soils until reinforcing steel and concrete can be placed.

7.3.2 SLAB-ON-GRADE

General: The conditions exposed at subgrade levels will vary across the site and may include structural fill. The slab-on-grade may be adequately supported on these subgrade conditions subject to the recommendations in this report. The slab-on-grade should be jointed around columns and along walls to reduce cracking due to differential movement. An underdrain system is not necessary beneath the slab, provided that the slab is at least 2 feet above the high groundwater level. An impermeable vapor barrier is recommended beneath finished spaces to reduce dampness.

Once grading is completed, the subgrade is usually exposed to adverse construction activities and weather conditions during the period of sub-slab utility installation. The subgrade should be well-drained to prevent the accumulation of water. If the exposed subgrade becomes saturated or frozen, the geotechnical engineer should be consulted.

After utilities have been installed and backfilled, a final subgrade evaluation should be performed by the geotechnical engineer immediately prior to slab-on-grade placement. If practical, proofrolling may be used to redensify the surface and to detect any soil that has become excessively wet or otherwise loosened.

7.4 PAVEMENT SECTION

We understand that a flexible (asphalt) pavement section could potentially be employed for this development. A recommended light duty pavement section has been developed for this project based on our understanding of the existing subsurface conditions, review of applicable FDOT specifications, and the assumed pavement design parameters of a 20-year pavement design life with traffic loadings appropriate to an office facility of this size.
Based on the results of our test borings, the subsurface conditions encountered appear to be adaptable for providing adequate subgrade support of a flexible pavement section.

We recommend employing the thicknesses shown in the Table 1 below for a flexible (asphalt) pavement section.

Table 1 – Recommended Flexible Pavement Section	
Asphaltic surface course (SuperPave SP-Fine)	1½ inches
FDOT Approved Graded Aggregate Base (GAB) or Limerock Base	6 inches
Stabilized Subgrade Course (min. LBR 40)	12 inches

We recommend specifying a minimum compaction requirement of 98 percent of the maximum dry density for the stabilized subgrade and base courses as determined by the Modified Proctor compaction test (ASTM D-1557).

The stabilized subgrade and base materials selected should conform to applicable sections of the State of Florida Department of Transportation Standard Specifications for Road and Bridge Construction (Current Edition).

We note that the existing fine-grained slightly silty sands (SP-SM) will require improvement in order to meet the specified LBR of 40, as these soils can be expected to have an in-situ LBR value on the order of 20 to 30. The means and methods of improvement of the subgrade is the responsibility of the contractor, however typical recommendations would include blending with aggregate or another suitable stabilizing material to produce a composite Stabilized Subgrade Course to meet the specified LBR value.

All asphalt material and paving operations should meet applicable specifications of the Florida Department of Transportation. A NOVA technician should observe placement and perform density testing of the base course material and asphalt.

7.5 STORMWATER MANAGEMENT SYSTEM

We understand that the SMS for this development is proposed to consist of a conventional shallow dry retention basin to treat and dispose of stormwater runoff associated with the planned site improvements. Based on the results of the SMS test borings, the subsurface conditions encountered on the project site appear to be adaptable for treatment and disposal of stormwater runoff via the desired SMS.

SMS design parameters provided below in Table 2. We note that the provided rates are unfactored.

Table 2 –SMS Soil Design Parameters	
Corresponding Soil Boring Test Locations	R-1, R-2
Approximate Depth to Confining Layer, feet BEG	Below 15 feet
Measured Vertical Hydraulic Conductivity (Kv)	25 feet/day
Calculated Horizontal Hydraulic Conductivity (Kh)	39 feet/day
Estimated Infiltration Rate (DRI)	8 in/hr.
Estimated Fillable Porosity of Soil	25%
Estimated Depth to Normal Permanent SHGW table, feet BEG	Below 15 feet

The estimated normal permanent seasonal high groundwater level provided in the design table above is based on our experience with projects in this locale; the soil strata encountered in the test borings; the groundwater levels measured at the site; and the published information by the "Web Soil Survey" National database, NRCS division of the United States Department of Agriculture (USDA). Please note that the provided hydraulic conductivity rates could be adversely impacted if siltation of the pond bottom is allowed after construction.

Additionally, the permeability measured by such tests may not be representative of the total effective aquifer thickness. Factors of safety can compensate for part of the inherent test limitations, but the designer must exercise judgment regarding final selection and applicability of provided soil design input parameters.

Should the modeling analysis indicate marginally acceptable compliance with Water Management District design criteria, it may be advisable to perform more extensive and representative in-situ permeability testing by collecting "undisturbed" horizontal and vertical soil samples and/or installing grouted piezometers or wells for slug testing. NOVA can perform these field tests if desired.

8.0 CONSTRUCTION OBSERVATIONS

8.1 SUBGRADE

Once site grading is completed, the subgrade may be exposed to adverse construction activities and weather conditions. The subgrade should be well-drained to prevent the accumulation of water. If the exposed subgrade becomes saturated or frozen, the NOVA geotechnical engineer should be consulted.

A final subgrade evaluation should be performed by the NOVA geotechnical engineer immediately prior to slab-on-grade placement. If practical, proofrolling may be used to re-densify the surface and to detect any soil, which has become excessively wet or otherwise loosened.

8.2 SHALLOW FOUNDATIONS

Foundation excavations should be level and free of debris, ponded water, mud, and loose, frozen or water-softened soils. All foundation excavations should be evaluated by the NOVA geotechnical engineer prior to reinforcing steel placement to observe foundation subgrade preparation and confirm bearing pressure capacity. Due to variable site subsurface and construction conditions, some adjustments in isolated foundation bearing pressures, depth of foundations or undercutting and replacement with controlled structural fill may be necessary.

APPENDIX A
Figures and Maps



Scale: Not To Scale	
Date Drawn: June 9, 2022	
Drawn By: N. Turan	
Checked By: W. Lawrence	

NOVA
140-A Lurton Street
Pensacola, Florida 32505
850.607.7782 ♦ 850.249.6683

PROJECT LOCATION MAP

Temporary Facility for 350th SWW

Eglin Air Force Base, Okaloosa County, Florida

NOVA Project Number 10116-2022143

Soil Map—Okaloosa County, Florida
(TEMP FACILITY)



Map Scale: 1:2,090 if printed on A landscape (11" x 8.5") sheet.

N

Meters
0 30 60 120 180

Feet
0 100 200 400 600

Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 16N WGS84

MAP LEGEND

Area of Interest (AOI)
- Area of Interest (AOI)

Soils
- Soil Map Unit Polygons
- Soil Map Unit Lines
- Soil Map Unit Points

Special Point Features
- Blowout
- Borrow Pit
- Clay Spot
- Closed Depression
- Gravel Pit
- Gravelly Spot
- Landfill
- Lava Flow
- Marsh or swamp
- Mine or Quarry
- Miscellaneous Water
- Perennial Water
- Rock Outcrop
- Saline Spot
- Sandy Spot
- Severely Eroded Spot
- Sinkhole
- Slide or Slip
- Sodic Spot
- Spoil Area
- Stony Spot
- Very Stony Spot
- Wet Spot
- Other
- Special Line Features

Water Features
- Streams and Canals

Transportation
- Rails
- Interstate Highways
- US Routes
- Major Roads
- Local Roads

Background
- Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:20,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Okaloosa County, Florida
Survey Area Data: Version 20, Sep 7, 2021

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.


Date(s) aerial images were photographed: Dec 31, 2009—Nov 2, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
12	Lakeland sand, 0 to 5 percent slopes	9.0	100.0%
Totals for Area of Interest		**9.0**	**100.0%**

APPENDIX B
Subsurface Data

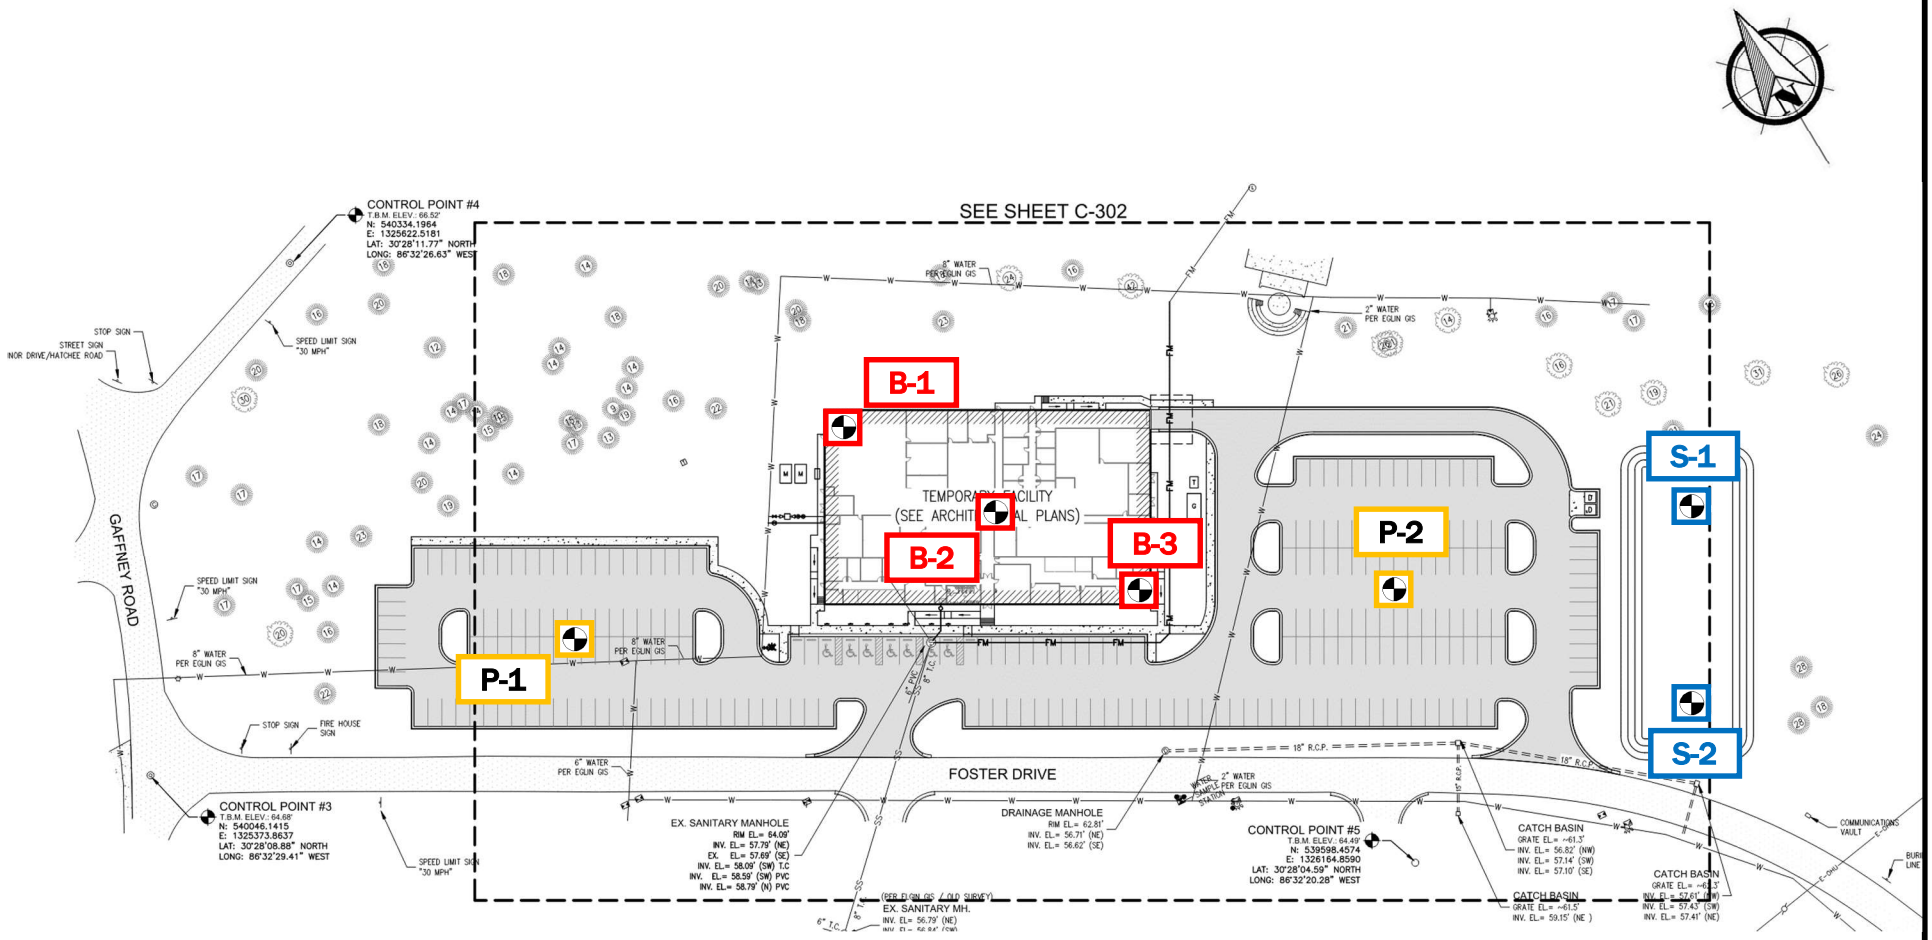

LEGEND

B-x = 25-ft. Structural SPT Boring

P-x = 5-ft. Pavement Auger Boring

S-x = 15-ft. SMS Auger Boring

Scale: Not To Scale **Date Drawn:** June 9, 2022 **Drawn By:** N. Turan **Checked By:** W. Lawrence	NOVA 140-A Lurton Street Pensacola, Florida 32505 850.607.7782 ♦ 850.249.6683	**BORING LOCATION PLAN** **Temporary Facility for 350th SWW** Eglin Air Force Base, Okaloosa County, Florida *NOVA Project Number 10116-2022143*

KEY TO BORING LOGS

SYMBOLS AND ABBREVIATIONS

SYMBOL	DESCRIPTION
N-Value	No. of Blows of a 140-lb. Weight Falling 30 Inches Required to Drive a Standard Spoon 1 Foot
WOR	Weight of Drill Rods
WOH	Weight of Drill Rods and Hammer
	Sample from Auger Cuttings
	Standard Penetration Test Sample
	Thin-wall Shelby Tube Sample (Undisturbed Sampler Used)
% REC	Percent Core Recovery from Rock Core Drilling
RQD	Rock Quality Designation
	Stabilized Groundwater Level
	Seasonal High Groundwater Level (also referred to as the W.S.W.T.)
NE	Not Encountered
GNE	Groundwater Not Encountered
BT	Boring Terminated
-200 (%)	Fines Content or % Passing No. 200 Sieve
MC (%)	Moisture Content
LL	Liquid Limit (Atterberg Limits Test)
PI	Plasticity Index (Atterberg Limits Test)
K	Coefficient of Permeability
Org. Cont.	Organic Content
G.S. Elevation	Ground Surface Elevation

UNIFIED SOIL CLASSIFICATION SYSTEM

MAJOR DIVISIONS			GROUP SYMBOLS	TYPICAL NAMES
COARSE-GRAINED SOILS More than 50% retained on the No. 200 sieve*	GRAVELS 50% or more of coarse fraction retained on No. 4 sieve	CLEAN GRAVELS	GW	Well-graded gravels and gravel-sand mixtures, little or no fines
			GP	Poorly graded gravels and gravel-sand mixtures, little or no fines
		GRAVELS WITH FINES	GM	Silty gravels and gravel-sand-silt mixtures
			GC	Clayey gravels and gravel-sand-clay mixtures
	SANDS More than 50% of coarse fraction passes No. 4 sieve	CLEAN SANDS 5% or less passing No. 200 sieve	SW**	Well-graded sands and gravelly sands, little or no fines
			SP**	Poorly graded sands and gravelly sands, little or no fines
		SANDS with 12% or more passing No. 200 sieve	SM**	Silty sands, sand-silt mixtures
			SC**	Clayey sands, sand-clay mixtures
FINE-GRAINED SOILS 50% or more passes the No. 200 sieve*	SILTS AND CLAYS Liquid limit 50% or less		ML	Inorganic silts, very fine sands, rock flour, silty or clayey fine sands
			CL	Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, lean clays
			OL	Organic silts and organic silty clays of low plasticity
	SILTS AND CLAYS Liquid limit greater than 50%		MH	Inorganic silts, micaceous or diamicaceous fine sands or silts, elastic silts
			CH	Inorganic clays or clays of high plasticity, fat clays
			OH	Organic clays of medium to high plasticity
			PT	Peat, muck and other highly organic soils

*Based on the material passing the 3-inch (75 mm) sieve
** Use dual symbol (such as SP-SM and SP-SC) for soils with more than 5% but less than 12% passing the No. 200 sieve

RELATIVE DENSITY
(Sands and Gravels)
Very loose – Less than 4 Blow/Foot
Loose – 4 to 10 Blows/Foot
Medium Dense – 11 to 30 Blows/Foot
Dense – 31 to 50 Blows/Foot
Very Dense – More than 50 Blows/Foot

CONSISTENCY
(Silts and Clays)
Very Soft – Less than 2 Blows/Foot
Soft – 2 to 4 Blows/Foot
Medium Stiff – 5 to 8 Blows/Foot
Stiff – 9 to 15 Blows/Foot
Very Stiff – 16 to 30 Blows/Foot
Hard – More than 30 Blows/Foot

RELATIVE HARDNESS
(Limestone)
Soft – 100 Blows for more than 2 Inches
Hard – 100 Blows for less than 2 Inches

MODIFIERS

These modifiers Provide Our Estimate of the Amount of Minor Constituents (Silt or Clay Size Particles) in the Soil Sample
Trace – 5% or less
With Silt or With Clay – 6% to 11%
Silty or Clayey – 12% to 30%
Very Silty or Very Clayey – 31% to 50%

These Modifiers Provide Our Estimate of the Amount of Organic Components in the Soil Sample
Trace – Less than 3%
Few – 3% to 4%
Some – 5% to 8%
Many – Greater than 8%

These Modifiers Provide Our Estimate of the Amount of Other Components (Shell, Gravel, Etc.) in the Soil Sample
Trace – 5% or less
Few – 6% to 12%
Some – 13% to 30%
Many – 31% to 50%

NOVA

TEST BORING RECORD B-1

PROJECT: Temporary Facility for 350th SWW PROJECT NO.: 10116-2022143
CLIENT: HHM Architecture
PROJECT LOCATION: Eglin Air Force Base, Okaloosa County, Florida
LOCATION: Per Boring Location Plan ELEVATION: Existing Grade
DRILLER: American Drilling Inc. LOGGED BY: N. Turan
DRILLING METHOD: SPT Boring DATE: June 7, 2022
DEPTH TO - WATER> INITIAL: GNE AFTER 24 HOURS: CAVING>

Depth (feet)	Description	N-Value
0	Brown loose fine-grained SAND with shell fragments and roots (SP)	7
	Light brown loose fine-grained SAND (SP)	5
5		4
		4
		5
10		10
15	Brown medium dense fine-grained SAND with organic staining (SP)	13
20		
	Grey medium dense fine-grained SAND (SP)	14
25	Boring Terminated at 25 ft.	
30		
35		

%<#200
BLOW COUNT
NATURAL MOISTURE
PLASTIC LIMIT — LIQUID LIMIT
10 20 30 40 50 70 90

This information pertains only to this boring and should not be interpreted as being indicative of the site.

NOVA


TEST BORING RECORD B-2

PROJECT: Temporary Facility for 350th SWW PROJECT NO.: 10116-2022143
CLIENT: HHM Architecture
PROJECT LOCATION: Eglin Air Force Base, Okaloosa County, Florida
LOCATION: Per Boring Location Plan ELEVATION: Existing Grade
DRILLER: American Drilling Inc. LOGGED BY: N. Turan
DRILLING METHOD: SPT Boring DATE: June 7, 2022
DEPTH TO - WATER> INITIAL: GNE AFTER 24 HOURS: CAVING> C

Depth (feet)	Description	N-Value
0	Brown loose fine-grained SAND with roots (SP)	
	Light brown loose to very loose fine-grained SAND (SP)	5
5		4
		3
		4
		4
10	Brown loose fine-grained SAND (SP)	10
15		
	Brown medium dense fine-grained SAND with organic staining (SP)	13
20		
		14
25	Boring Terminated at 25 ft.	
30		
35		

Graphic | Groundwater | Sample Type

%<#200
BLOW COUNT
NATURAL MOISTURE
PLASTIC LIMIT — LIQUID LIMIT
10 20 30 40 50 70 90

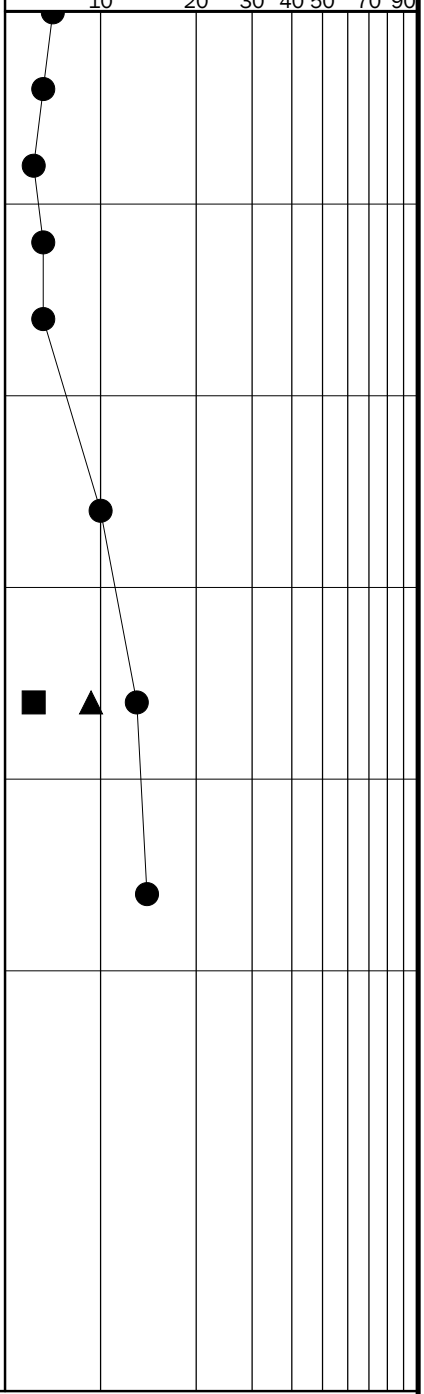

This information pertains only to this boring and should not be interpreted as being indicative of the site.

NOVA

TEST BORING RECORD B-3

PROJECT: Temporary Facility for 350th SWW | PROJECT NO.: 10116-2022143
CLIENT: HHM Architecture
PROJECT LOCATION: Eglin Air Force Base, Okaloosa County, Florida
LOCATION: Per Boring Location Plan | ELEVATION: Existing Grade
DRILLER: American Drilling Inc. | LOGGED BY: N. Turan
DRILLING METHOD: SPT Boring | DATE: June 7, 2022
DEPTH TO - WATER> INITIAL: GNE | AFTER 24 HOURS: | CAVING>

Depth (feet)	Description	N-Value
0		
	Brown loose fine-grained SAND with roots (SP)	6
	Light brown loose fine-grained SAND (SP)	4
5		5
		6
		6
10		
		9
15		
	Grey/brown medium dense fine-grained SAND (SP)	13
20		
	Brown medium dense fine-grained SAND (SP)	17
25		
	Boring Terminated at 25 ft.	
30		
35		

%<#200
BLOW COUNT
NATURAL MOISTURE
PLASTIC LIMIT — LIQUID LIMIT
10 20 30 40 50 70 90

This information pertains only to this boring and should not be interpreted as being indicative of the site.

NOVA

TEST BORING RECORD P-1

PROJECT: Temporary Facility for 350th SWW PROJECT NO.: 10116-2022143
CLIENT: HHM Architecture
PROJECT LOCATION: Eglin Air Force Base, Okaloosa County, Florida
LOCATION: Per Boring Location Plan ELEVATION: Existing Grade
DRILLER: American Drilling Inc. LOGGED BY: N. Turan
DRILLING METHOD: Auger Boring DATE: June 7, 2022
DEPTH TO - WATER> INITIAL: GNE AFTER 24 HOURS: CAVING>

Depth (feet)	Elevation (ft-MSL)	Description	Graphic	Groundwater	Sample Type	N-Value
0		TOPSOIL (Approx. 6 inches)				
		Light brown fine-grained SAND (SP)				
5		Boring Terminated at 5 ft.				
10						
15						
20						
25						
30						
35						

■ %<#200
● BLOW COUNT
▲ NATURAL MOISTURE
PLASTIC LIMIT — LIQUID LIMIT
10 20 30 40 50 70 90

This information pertains only to this boring and should not be interpreted as being indicative of the site.

NOVA

TEST BORING RECORD P-2

PROJECT: Temporary Facility for 350th SWW PROJECT NO.: 10116-2022143
CLIENT: HHM Architecture
PROJECT LOCATION: Eglin Air Force Base, Okaloosa County, Florida
LOCATION: Per Boring Location Plan ELEVATION: Existing Grade
DRILLER: American Drilling Inc. LOGGED BY: N. Turan
DRILLING METHOD: Auger Boring DATE: June 7, 2022
DEPTH TO - WATER> INITIAL: GNE AFTER 24 HOURS: CAVING> C

Depth (feet)	Elevation (ft-MSL)	Description	Graphic	Groundwater	Sample Type	N-Value
0		TOPSOIL (Approx. 6 inches)				
		Light brown fine-grained SAND (SP)				
5		Boring Terminated at 5 ft.				
10						
15						
20						
25						
30						
35						

■ %<#200
● BLOW COUNT
▲ NATURAL MOISTURE
PLASTIC LIMIT — LIQUID LIMIT
10 20 30 40 50 70 90

This information pertains only to this boring and should not be interpreted as being indicative of the site.

NOVA

TEST BORING RECORD S-1

PROJECT: Temporary Facility for 350th SWW PROJECT NO.: 10116-2022143
CLIENT: HHM Architecture
PROJECT LOCATION: Eglin Air Force Base, Okaloosa County, Florida
LOCATION: Per Boring Location Plan ELEVATION: Existing Grade
DRILLER: American Drilling Inc. LOGGED BY: N. Turan
DRILLING METHOD: Auger Boring DATE: June 7, 2022
DEPTH TO - WATER> INITIAL: GNE AFTER 24 HOURS: CAVING>

Depth (feet)	Elevation (ft-MSL)	Description	Graphic	Groundwater	Sample Type	N-Value
0		TOPSOIL (Approx. 6 inches)				
		Light brown fine-grained SAND (SP)				
5						
10						
15		Boring Terminated at 15 ft.				
20						
25						
30						
35						

■ %<#200
● BLOW COUNT
▲ NATURAL MOISTURE
PLASTIC LIMIT — LIQUID LIMIT
10 20 30 40 50 70 90

This information pertains only to this boring and should not be interpreted as being indicative of the site.

NOVA

TEST BORING RECORD S-2

PROJECT: Temporary Facility for 350th SWW PROJECT NO.: 10116-2022143
CLIENT: HHM Architecture
PROJECT LOCATION: Eglin Air Force Base, Okaloosa County, Florida
LOCATION: Per Boring Location Plan ELEVATION: Existing Grade
DRILLER: American Drilling Inc. LOGGED BY: N. Turan
DRILLING METHOD: Auger Boring DATE: June 7, 2022
DEPTH TO - WATER> INITIAL: GNE AFTER 24 HOURS: CAVING> C

Depth (feet)	Elevation (ft-MSL)	Description	Graphic	Groundwater	Sample Type	N-Value
0						
		TOPSOIL (Approx. 6 inches)				
		Light brown fine-grained SAND (SP)				
5						
10						
15		Grey/brown fine-grained SAND (SP)				
		Boring Terminated at 15 ft.				
20						
25						
30						
35						

■ %<#200
● BLOW COUNT
▲ NATURAL MOISTURE
PLASTIC LIMIT ⊢——⊣ LIQUID LIMIT
10 20 30 40 50 70 90

This information pertains only to this boring and should not be interpreted as being indicative of the site.

APPENDIX C
Laboratory Data

SUMMARY OF CLASSIFICATION & INDEX TESTING

Temporary Facility for 350th SWW
Eglin Air Force Base, Okaloosa County, Florida
NOVA Project No. 10116-2022143

SUMMARY OF CLASSIFICATION AND INDEX TESTING						
Boring No.	Sample Depth (ft. BEG)	Natural Moisture (%)	Percent Fines (- #200)	Hydraulic Conductivity		USCS Soil Classification
				K_{vs} (ft/day)	Unit Weight of Sample (pcf)	
B-1	0-2	4	8	---	---	SP-SM
B-1	23-25	4	1	---	---	SP
B-2	18-20	9	3	---	---	SP
S-1	1-15	6	6	25	106	SP-SM
S-2	1-8	5	7	---	---	SP-SM

REMOLDED LABORATORY PERMEABILITY TEST DATA SHEET

PROJECT: Temporary Facility for 350th SWW **NOVA PROJECT #:** 10116-2022143

DATE: 6/10/2022 **ASSIGNED BY:** JAJ **TESTED BY:** NPT

Sample LOCATION / BORING NO.	S-1
Sample NUMBER / DEPTH	1 ft - 15 ft

PERMEABILITY TESTING SUMMARY			
PERMEABILITY (K_V)	→	25	ft/day
Corresponding K_h	→	37	ft/day
DRY DENSITY	→	106	lbs/ft^3
MOISTURE CONTENT	→	6	%
-200 FINES CONTENT	→	6	%

FALLING HEAD PERMEABILITY (ASTM D 5084)

No. of LAYERS:	3	Wt. of MOLD (lbs):	4.48
BLOWS/LAYER:	15	Wt. of MOLD/SOIL (lbs):	8.23

HEIGHT (FT)	TRIAL #1 (SEC)	PERMEABILITY
7	0.0	9.11E-03
6	2.0	8.69E-03
5	4.3	8.56E-03
4	6.9	8.09E-03
3	10.2	9.60E-03
2	14.6	
1	21.3	
	8.8E-03	cm/sec

MOISTURE CONTENT (ASTM D 2216)

Pan NUMBER	Q
Wt. of WET SOIL & PAN (g)	280.9
Wt. of DRY SOIL & PAN (g)	269.4
Wt. of PAN (g)	66.5
Wt. of Water (g)	11.5
Wt. of Dry Soil (g)	202.9
MOISTURE CONTENT (%)	5.7

-200 SIEVE WASH (ASTM D 1140)

Pan NUMBER	Q
Wt. of DRY SOIL & PAN (g)	269.4
Wt. of WASH SOIL & PAN (g)	256.3
Wt. of PAN (g)	66.5
Wt. of Original Dry Sample (g)	202.9
Wt. of -200 Material (g)	13.1
Wt. of Washed Dry Sample (g)	189.8
-200 FINES CONTENT (%)	6.5

NUMBER OF INCHES MOLD WAS SHORT? 0.000 INCHES (ZERO INCHES IS DEFAULT)

PERMEABILITY CONSTANT USED WAS → 0.23 (Includes 3/8"ID tubing)

NOVA

APPENDIX D
Qualifications of Recommendations

QUALIFICATIONS OF RECOMMENDATIONS

The findings, conclusions and recommendations presented in this report represent our professional opinions concerning subsurface conditions at the site. The opinions presented are relative to the dates of our site work and should not be relied on to represent conditions at later dates or at locations not explored. The opinions included herein are based on information provided to us, the data obtained at specific locations during the study, and our previous experience. If additional information becomes available which might impact our geotechnical opinions, it will be necessary for NOVA to review the information, re-assess the potential concerns, and re-evaluate our conclusions and recommendations.

Regardless of the thoroughness of a geotechnical exploration, there is the possibility that conditions between borings may differ from those encountered at specific boring locations, that conditions are not as anticipated by the designers and/or the contractors, or that either natural events or the construction process has altered the subsurface conditions. These variations are an inherent risk associated with subsurface conditions in this region and the approximate methods used to obtain the data. These variations may not be apparent until construction.

The professional opinions presented in this report are not final. Field observations and foundation installation monitoring by the geotechnical engineer, as well as soil density testing and other quality assurance functions associated with site earthwork and foundation construction, are an extension of this report. Therefore, NOVA should be retained by the owner to observe all earthwork and foundation construction to confirm that the conditions anticipated in this study actually exist, and to finalize or amend our conclusions and recommendations. NOVA is not responsible or liable for the conclusions and recommendations presented in this report if NOVA does not perform these observations and testing services.

This report is intended for the sole use of **Heffernan Holland Morgan Architecture** only. The scope of work performed during this study was developed for purposes specifically intended by of **Heffernan Holland Morgan Architecture** only and may not satisfy other users' requirements. Use of this report or the findings, conclusions or recommendations by others will be at the sole risk of the user. NOVA is not responsible or liable for the interpretation by others of the data in this report, nor their conclusions, recommendations or opinions.

Our professional services have been performed, our findings obtained, our conclusions derived and our recommendations prepared in accordance with generally accepted geotechnical engineering principles and practices in the State of Florida. This warranty is in lieu of all other statements or warranties, either expressed or implied.

Important Information about This

Geotechnical-Engineering Report

Subsurface problems are a principal cause of construction delays, cost overruns, claims, and disputes.

While you cannot eliminate all such risks, you can manage them. The following information is provided to help.

Geotechnical Services Are Performed for Specific Purposes, Persons, and Projects

Geotechnical engineers structure their services to meet the specific needs of their clients. A geotechnical-engineering study conducted for a civil engineer may not fulfill the needs of a constructor — a construction contractor — or even another civil engineer. Because each geotechnical- engineering study is unique, each geotechnical-engineering report is unique, prepared *solely* for the client. No one except you should rely on this geotechnical-engineering report without first conferring with the geotechnical engineer who prepared it. *And no one — not even you* — should apply this report for any purpose or project except the one originally contemplated.

Read the Full Report

Serious problems have occurred because those relying on a geotechnical-engineering report did not read it all. Do not rely on an executive summary. Do not read selected elements only.

Geotechnical Engineers Base Each Report on a Unique Set of Project-Specific Factors

Geotechnical engineers consider many unique, project-specific factors when establishing the scope of a study. Typical factors include: the client's goals, objectives, and risk-management preferences; the general nature of the structure involved, its size, and configuration; the location of the structure on the site; and other planned or existing site improvements, such as access roads, parking lots, and underground utilities. Unless the geotechnical engineer who conducted the study specifically indicates otherwise, do not rely on a geotechnical-engineering report that was:

- not prepared for you;
- not prepared for your project;
- not prepared for the specific site explored; or
- completed before important project changes were made.

Typical changes that can erode the reliability of an existing geotechnical-engineering report include those that affect:

- the function of the proposed structure, as when it's changed from a parking garage to an office building, or from a light-industrial plant to a refrigerated warehouse;
- the elevation, configuration, location, orientation, or weight of the proposed structure;
- the composition of the design team; or
- project ownership.

As a general rule, *always* inform your geotechnical engineer of project changes—even minor ones—and request an assessment of their impact. *Geotechnical engineers cannot accept responsibility or liability for problems that occur because their reports do not consider developments of which they were not informed.*

Subsurface Conditions Can Change

A geotechnical-engineering report is based on conditions that existed at the time the geotechnical engineer performed the study. *Do not rely on a geotechnical-engineering report whose adequacy may have been affected by*: the passage of time; man-made events, such as construction on or adjacent to the site; or natural events, such as floods, droughts, earthquakes, or groundwater fluctuations. *Contact the geotechnical engineer before applying this report to determine if it is still reliable.* A minor amount of additional testing or analysis could prevent major problems.

Most Geotechnical Findings Are Professional Opinions

Site exploration identifies subsurface conditions only at those points where subsurface tests are conducted or samples are taken. Geotechnical engineers review field and laboratory data and then apply their professional judgment to render an opinion about subsurface conditions throughout the site. Actual subsurface conditions may differ — sometimes significantly — from those indicated in your report. Retaining the geotechnical engineer who developed your report to provide geotechnical-construction observation is the most effective method of managing the risks associated with unanticipated conditions.

A Report's Recommendations Are Not Final

Do not overrely on the confirmation-dependent recommendations included in your report. *Confirmation-dependent recommendations are not final,* because geotechnical engineers develop them principally from judgment and opinion. Geotechnical engineers can finalize their recommendations *only* by observing actual subsurface conditions revealed during construction. *The geotechnical engineer who developed your report cannot assume responsibility or liability for the report's confirmation-dependent recommendations if that engineer does not perform the geotechnical-construction observation required to confirm the recommendations' applicability.*

A Geotechnical-Engineering Report Is Subject to Misinterpretation

Other design-team members' misinterpretation of geotechnical-engineering reports has resulted in costly

problems. Confront that risk by having your geotechnical engineer confer with appropriate members of the design team after submitting the report. Also retain your geotechnical engineer to review pertinent elements of the design team's plans and specifications. Constructors can also misinterpret a geotechnical-engineering report. Confront that risk by having your geotechnical engineer participate in prebid and preconstruction conferences, and by providing geotechnical construction observation.

Do Not Redraw the Engineer's Logs

Geotechnical engineers prepare final boring and testing logs based upon their interpretation of field logs and laboratory data. To prevent errors or omissions, the logs included in a geotechnical-engineering report should *never* be redrawn for inclusion in architectural or other design drawings. Only photographic or electronic reproduction is acceptable, *but recognize that separating logs from the report can elevate risk.*

Give Constructors a Complete Report and Guidance

Some owners and design professionals mistakenly believe they can make constructors liable for unanticipated subsurface conditions by limiting what they provide for bid preparation. To help prevent costly problems, give constructors the complete geotechnical-engineering report, *but* preface it with a clearly written letter of transmittal. In that letter, advise constructors that the report was not prepared for purposes of bid development and that the report's accuracy is limited; encourage them to confer with the geotechnical engineer who prepared the report (a modest fee may be required) and/or to conduct additional study to obtain the specific types of information they need or prefer. A prebid conference can also be valuable. *Be sure constructors have sufficient time* to perform additional study. Only then might you be in a position to give constructors the best information available to you, while requiring them to at least share some of the financial responsibilities stemming from unanticipated conditions.

Read Responsibility Provisions Closely

Some clients, design professionals, and constructors fail to recognize that geotechnical engineering is far less exact than other engineering disciplines. This lack of understanding has created unrealistic expectations that have led to disappointments, claims, and disputes. To help reduce the risk of such outcomes, geotechnical engineers commonly include a variety of explanatory provisions in their reports. Sometimes labeled "limitations," many of these provisions indicate where geotechnical engineers' responsibilities begin and end, to help others recognize their own responsibilities and risks. *Read these provisions closely.* Ask questions. Your geotechnical engineer should respond fully and frankly.

Environmental Concerns Are Not Covered

The equipment, techniques, and personnel used to perform an *environmental* study differ significantly from those used to perform a *geotechnical* study. For that reason, a geotechnical-engineering report does not usually relate any environmental findings, conclusions, or recommendations; e.g., about the likelihood of encountering underground storage tanks or regulated contaminants. *Unanticipated environmental problems have led to numerous project failures.* If you have not yet obtained your own environmental information, ask your geotechnical consultant for risk-management guidance. *Do not rely on an environmental report prepared for someone else.*

Obtain Professional Assistance To Deal with Mold

Diverse strategies can be applied during building design, construction, operation, and maintenance to prevent significant amounts of mold from growing on indoor surfaces. To be effective, all such strategies should be devised for the *express purpose* of mold prevention, integrated into a comprehensive plan, and executed with diligent oversight by a professional mold-prevention consultant. Because just a small amount of water or moisture can lead to the development of severe mold infestations, many mold- prevention strategies focus on keeping building surfaces dry. While groundwater, water infiltration, and similar issues may have been addressed as part of the geotechnical- engineering study whose findings are conveyed in this report, the geotechnical engineer in charge of this project is not a mold prevention consultant; *none of the services performed in connection with the geotechnical engineer's study were designed or conducted for the purpose of mold prevention. Proper implementation of the recommendations conveyed in this report will not of itself be sufficient to prevent mold from growing in or on the structure involved.*

Rely, on Your GBC-Member Geotechnical Engineer for Additional Assistance

Membership in the Geotechnical Business Council of the Geoprofessional Business Association exposes geotechnical engineers to a wide array of risk-confrontation techniques that can be of genuine benefit for everyone involved with a construction project. Confer with you GBC-Member geotechnical engineer for more information.

GEOTECHNICAL BUSINESS COUNCIL
of the Geoprofessional Business Association

8811 Colesville Road/Suite G106, Silver Spring, MD 20910
Telephone: 301/565-2733 Facsimile: 301/589-2017
e-mail: info@geoprofessional.org www.geoprofessional.org

Copyright 2015 by Geoprofessional Business Association (GBA). Duplication, reproduction, or copying of this document, or its contents, in whole or in part, by any means whatsoever, is strictly prohibited, except with GBA's specific written permission. Excerpting, quoting, or otherwise extracting wording from this document is permitted only with the express written permission of GBA, and only for purposes of scholarly research or book review. Only members of GBA may use this document as a complement to or as an element of a geotechnical-engineering report. Any other firm, individual, or other entity that so uses this document without being a GBA member could be commiting negligent or intentional (fraudulent) misrepresentation.

APPENDIX H

EGLIN AFB FIRE ALARM AND FIRE SUPPRESSION CRITERIA (FEBRUARY 2023)

- REQUIREMENTS FOR NEW FIRE ALARM SYSTEMS AT EGLIN AFB (LAST UPDATED DEC. 2022)

- REQUIREMENTS FOR NEW FIRE SUPPRESSION SYSTEMS AT EGLIN AFB (LAST UPDATED JAN. 2023)

- MEMORANDUM FOR RECORD – FIRE ALARM PANEL STANDARDIZATION (JAN 2023)

February 2023

REQUIREMENTS FOR NEW FIRE ALARM SYSTEMS

AT EGLIN AFB – (LAST UPDATED DEC. 2022)

ELECTRONIC FIRE ALARM AND SUPPRESSION SECTION

The Electronic/Alarm and Fire Suppression section of Civil Engineers are technical support to the Authority Having Jurisdiction (AHJ) only. They are here to review, inspect, observe tests, and will not take part in the execution of any section of an awarded project on this installation (Examples; disable, safe, or shut down a complete system or a part of one; bring systems back online, etc.).

Before any Technician will program the fire alarm transceiver for any project, the Electronic/Alarm Section require the following items to be in their possession; NFPA 72 Record of Completion, a test plan, a copy of all test results (meggar, smoke sensitivity, resistance, intelligibility, and any device and panel), a set of working drawings, sized 12 X 18, the box of spare parts, the technician interface tool (laptop, if required) plus any special connecting cables or devices to interface with all systems to include VESDA, fire pump controllers, and flame detectors, a copy of all data bases on a thumb drive, and (1) copy of all manuals (installation, programming, & operation), which now can be electronic.

FIRE ALARM TRANSCEIVERS

All Fire Alarm transceivers shall be standalone units (BT-XFs) and completely compatible with the existing Monaco Enterprises Model D-21-M central station system.

Transceivers shall have the appropriate number of zones to interface with the Fire Alarm Control Panel and other required equipment. The authority having jurisdiction shall approve the fire alarm zones. Transceivers shall operate on a frequency of 141.3625 MHZ. Transceivers shall not be mounted higher than 60 inches from floor level.

**Notes:

Monaco Audio Board and Relay Board (BT-XMs) are not required and shall not be installed.

External activation (WIDE AREA CONTROL) of in-building live voice MNS will be the function of Command Post/ATHOC. A connection point or D-mark location shall be installed for future live voice input.

Lightning arrestors shall be mounted IAW installation manuals from the manufacturer and in a location easily accessible for maintenance with reasonable effort and without removal of additional facility finishes (sheet rock, ceiling grid, etc.).

The installer is responsible to determine the proper location and type of antenna to be utilized. When it is determined that the use of a directional (YAGI) antenna is required, the following shall apply. YAGI antennas installed on buildings shall be mounted on 1-inch heavy wall galvanized rigid conduit, utilizing positive means to prevent the antenna and/or mast from twisting by wind.

In cases where it is determined that an "Omni" antenna will be sufficient, the antenna may be mounted on ¾ inch rigid electrical conduit or a mast of proved equal strength.

Both antenna types require good line of sight clearance for proper transmission and the Omni's grounding plane requires 3 feet of clearance over roofs and other objects.

Coaxial cable shall be enclosed in metal conduit from the transceiver to the antenna. In cases where overhead outdoor routing is necessary, the cable shall be installed in accordance with all codes and directives. Coaxial cables running overhead shall be approved for the purpose and installed accordingly. Cable length will be used to determine if low loss coaxial cable is necessary. Follow manufacturer's recommendation on cable length and type. Measures shall be taken to avoid sharp bends or "kinking" of coaxial cables.

The installer shall demonstrate the forward and the reflected power of installed antenna systems prior to acceptance in accordance with manufacturer's specifications.

AC power sources for the transceiver shall be protected by surge/lightning suppressors. Suppressors shall not be installed within the enclosure of the transceiver.

FIRE ALARM AND MASS NOTIFICATION SYSTEMS

Control units (FACUs) must be located in office/administrative space or other rooms with similar temperature/humidity controls — control panels shall not be located in the aircraft servicing areas or mechanical/utility spaces without both temperature and humidity controls. Simple heating (i.e., for freeze protection) and/or ventilation is not sufficient for these electronic systems. FACU's shall be mounted in accordance with NFPA 72 and Eglin Specific Requirements. Manufacturers are referenced in paragraph 2.3.

The following is an excerpt from one manufacturer's literature for their most current control system and clearly demonstrates this sensitivity. While the literature indicates compliance with NFPA 72 requirements, it clearly recommends much narrower environmental limits for locating the control panel.

Temperature and Humidity Ranges are as follows; This system meets NFPA requirements for operation at 0-49°C/32–120°F and at a relative humidity 93% ± 2% RH (non-condensing) at 32°C ± 2°C (90°F ± 3°F). However, the useful life of the system's standby batteries and the electronic components may be adversely affected by extreme temperature ranges and humidity. Therefore, it is recommended that–this system and its peripherals be installed in an environment with a normal room temperature of 15-27°C/60–80°F.

The following technician interface tool (laptop) requirements shall apply for intelligent fire alarm systems. One laptop shall be turned over to the Electronic/Alarm (E/A) section with the latest approved operating system required for the programming the fire alarm software, the latest manufacturer's software required to program the FACU, a disc drive (to conform to Air Force security) and any associated systems or devices, to include; Vesda smoke detection, electrical/electronic fire pump controllers, etc. It should also contain software associated with developing documents (i.e., Microsoft Excel in order to perform load calculations and develop points lists) as required by the programming software. All original manufacturers' software for each interface tool when addressable fire alarm systems are installed shall be provided to the Eglin AFB's E/A section. The following requirements shall apply: all software, hardware, passwords, cables, adapters, security keys (hasps and dongles) etc., required for the maintenance, testing, and reprogramming of the fire alarm system, support systems, and devices shall be unconditionally turned over to the E/A section, and the above noted software,

hardware, passwords, etc., will become the unconditional property of the government. Software turned over to Gov't shall be the original manufacturer's licensed software on cd (or DVD) with jeweled case; copies of software shall not be acceptable. Software and cd, or DVD, shall be brand new and unused.

The contractor shall provide the manufacturer technician's recommended/required level of training on all the installed equipment and software, regarding installation, operation, maintenance, testing, future expansion, and programming of the fire alarm system for two (2) personnel. This training shall meet or exceed NFPA 72 National F/A and Signaling Code 10.4.2.2 for System Installers, 10.4.3.1 (1) for Inspection, Testing and Maintenance Personnel as well as the manufacturer technician's required level of training and shall guarantee the unconditional operation and future purchase of additional and/or replacement equipment. The training shall take place at one of the locations normally used by the manufacturer and/or distributor to conduct factory training for their in-house employees. The government employees shall be trained alongside technicians employed by the installed equipment manufacturer and/or distributer. Upon successful completion of all curriculum requirements the government personnel shall be awarded a certification, security keys, and provided full access to all available technical support resources, to include at a minimum, on-line and telephone support provided to manufacture and/or distributer personnel. This goes for all systems being installed, to include: the main fire alarm system, subordinate releasing panels, VESDA systems, mass notification textual sign systems, and electrical/electronic fire pump controllers. The Electronic/Alarm section will also require 8 hours, minimum, of familiarization training at the facility on the new panel, all new equipment, and the software installed.

Provide as-built drawings and a final testing points list of the fire alarm system, as follows: floor plans shall show all fire alarm system components and their addresses. Fire alarm riser diagram shall show all fire alarm components. Two copies of the program and any drawings will be provided to the Eglin Electronic/Alarm Maintenance section on compact disc or thumb drive and left in the panel or document box, under lock and key. Drawings need to accessible and viewable with the laptop. Points list can be a paper or electronic list showing all points (description and address) to be tested for final acceptance. All requirements shall be accomplished prior to final acceptance.

PROVIDE AS-BUILT DRAWINGS OF FIRE ALARM SYSTEM, AS FOLLOWS

1. FLOOR PLAN/S SHOWING ALL FIRE ALARM SYSTEM COMPONENTS and their addresses
2. FIRE ALARM RISER DIAGRAM SHOWING ALL FIRE ALARM COMPONENTS
3. FIRE ALARM LEGEND
4. FIRE ALARM NOTES
5. ABOVE NOTED ITEMS "1" THRU "4", SHALL BE PROVIDED ELECTRONICALLY ON A CD OR THUMB DRIVE AND PAPER COPY, A TRUE HALF SIZE (12 X 18).

SECTION 1.0

1.1 DESCRIPTION:

A. The fire alarm system shall comply with requirements of NFPA Standard No. 72 for Auxiliary Protected Premises Signaling Systems except as modified and supplemented by this specification. The system field wiring shall be supervised either electrically or by software-directed polling of field devices.

B. The fire alarm system shall comply with requirements of NFPA Standard No. 72 for Remote Station Protected Premises Signaling Systems except as modified and supplemented by this specification. The system field wiring shall be supervised either electrically or by software-directed polling of field devices.

C. The fire alarm system shall be manufactured by an ISO 9001 certified company and meet the requirements of BS EN9001: ANSI/ASQC Q9001-1994.

D. The installing company shall employ NICET (minimum Level III Fire Alarm Technology) technicians on site to guide the final check-out and to ensure the systems integrity.

1.2 SCOPE:

Basic Performance for Intelligent Systems:

1. Alarm, trouble and supervisory signals from all intelligent reporting devices shall be encoded on NFPA Class B, A, or X only on the Signaling Line Circuits (SLC). Class B circuitry must be installed in series and T-taps are not allowed.

2. Notification Appliance Circuits (NAC) shall be wired Class A circuit, to ensure the circuit will operate as designed with only one fault.

3. All circuits shall be power-limited, UL864 9th edition requirements.

4. A single ground fault on the system Signaling Line Circuit shall not cause system malfunction, loss of operating power or the ability to report an alarm.

5. All AC power to the fire systems shall be protected by the use of surge/lightning protectors. All circuits of the fire systems that enter or exit the protected facility shall have surge/lightning protectors installed. **NOTE:** DO NOT install AC power surge suppressors inside the FACP cabinet.

6. All elevators shall have both recall and alternate recall emergency actions, initiated by smoke detectors installed on each landing, NFPA 72, chapter 21.

1.3 SUBMITTALS

A. General:

1. Two copies of all submittals shall be submitted to the CE SABER PM/CE Engineer for review.

2. All references to manufacturer's model numbers and other pertinent information herein is intended to establish minimum standards of performance, function and quality. Equivalent compatible UL-listed equipment from other manufacturers may be substituted for the specified equipment as long as the minimum standards are met.

3. For equipment other than that specified, the contractor shall supply proof that such substitute equipment equals or exceeds the features, functions, performance, and quality of the specified equipment.

B. Shop Drawings:

1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.

2. Include manufacturer's name(s), model numbers, ratings, power requirements, equipment layout, device arrangement, complete wiring point-to-point diagrams, and conduit layouts.

3. Wiring diagrams shall indicate internal wiring for each device and the interconnections between the items of equipment.

4. Show annunciator layout, configurations, and terminations.

C. Manuals:

1. Submit simultaneously with the shop drawings, installation, programming, operating, and maintenance manuals listed for the manufacturer's panel and product(s), including technical data sheets. This applies to panels installed; main, sub, releasing, etc.

2. Provide a clear and concise description of operation that gives, in detail, the information required to properly operate the equipment and system.

3. Provide one complete sets of manuals to Civil Engineering Electronic/Alarm maintenance section at acceptance (can be on a compact disc or thumb drive).

D. Software Modifications:

Provide all hardware, software, programming tools and documentation necessary to modify the fire alarm system and all other sub-systems on site. Modification includes addition and deletion of devices, circuits, zones and changes to system operation and custom label changes for devices or zones. The system structure and software shall place no limit on the type or extent of software modifications on-site. Modification of software shall not require power-down of the system or loss of system fire protection while modifications are being made.

1.4 GUARANTY:

All work performed and all material and equipment furnished under this contract shall be free from defects and shall remain so for a period of at least one (1) year from the date of final acceptance. The full cost of maintenance, labor and materials required to correct any defect during this one-year period shall be included in the submittal bid.

1.5 APPLICABLE STANDARDS AND SPECIFICATIONS:

The specifications and standards listed below form a part of this specification. The system shall fully comply with the latest issue of these standards, if applicable.

A. National Fire Protection Association (NFPA) - USA:

No. 13 Sprinkler Systems
No. 70 National Electric Code (NEC)
No. 72 National Fire Alarm Code
No. 101 Life Safety Code

B. All Unified Facilities Criteria (UFC)

C. The system and its components shall be Underwriters Laboratories, Inc. listed under the appropriate UL testing standard as listed herein for fire alarm applications and the installation shall be in compliance with the UL listing.

D. Local and State Building Codes

E. All requirements of the Authority Having Jurisdiction (AHJ)

1.8 APPROVALS:

A. The system shall have proper listing and/or approval from the following nationally recognized agencies:

UL - Underwriters Laboratories Inc.

ULC - Underwriters Laboratories Canada

FM - Factory Mutual

MEA - Material Equipment Acceptance (NYC)

CSFM - California State Fire Marshal

SECTION 2.0 - PRODUCTS

2.1 EQUIPMENT AND MATERIAL, GENERAL:

A. All equipment and components shall be new, the manufacturer's current model and version. The materials, appliances, equipment and devices shall be tested and listed by a nationally recognized approvals agency for use as part of a fire protective signaling system, meeting the National Fire Alarm Code.

B. All equipment and components shall be installed in strict compliance with manufacturers' recommendations. Consult the manufacturer's installation manuals for all wiring diagrams, schematics, physical equipment sizes, etc., before beginning system installation.

C. All equipment shall be attached to walls and ceiling/floor assemblies and shall be held firmly in place (e.g., detectors shall not be supported solely by suspended ceilings) and accessible for maintenance and testing. Fasteners and supports shall be adequate to support the required load.

2.2 CONDUIT AND WIRE:

A. Conduit:

1. Conduit shall be in accordance with The National Electrical Code (NEC), local and state requirements.

2. All wiring shall be installed in conduit or raceway. Conduit fill shall not exceed 40 percent of interior cross-sectional area where three or more cables are contained within a single conduit.

3. Conduit shall not enter the fire alarm control panel or any other remotely mounted control panel equipment or back boxes, except where conduit entry is specified by the FACP manufacturer.

4. Conduit shall be 3/4-inch (19.1 mm) minimum, red in color.

B. Wire:

1. All fire alarm system wiring shall be new.

2. Wiring shall be in accordance with local, state and national codes (e.g., NEC Article 760) and as recommended by the manufacturer of the fire alarm system. Number and size of conductors shall be as recommended by the fire alarm system manufacturer.

3. Wiring for 24-volt DC control, alarm notification, emergency communication and similar power-limited auxiliary functions may be run in the same conduit as initiating and signaling line circuits. All circuits shall be provided with transient suppression devices and the system shall be designed to permit simultaneous operation of all circuits without interference or loss of signals.

4. Wiring installation — practices in ANSI/NECA 305-2001 shall be followed. Cable must be separated from any open conductors of power, or Class 1 circuits, and shall not be placed in any conduit, junction box or raceway containing these conductors, per NEC Article 760-136. Power wiring and limited power wiring shall not be co-located in the same conduit, raceway, or enclosure. Such wiring may only be located together within the listed control panel and shall be installed in accordance with the manufacturer's guidance. There should be no stray detectable voltages, no ground faults, open circuits, or short circuits when tested IAW NEC 305.

5. All wire and cable shall be listed and/or approved by a recognized testing agency for use with a protective signaling system.

6. Wire and cable not installed in conduit shall have a fire resistance rating suitable for the installation as indicated in NEC 760 (e.g., FPLR).

7. All field wiring shall be electrically supervised for open circuits and ground faults. UFC 3-600-01 states that wiring between devices shall be splice free.

C. Terminal Boxes, Junction Boxes and Cabinets: All boxes and cabinets shall be UL listed for their use and purpose. They shall be installed to have a working clearance that is unobstructed and be readily accessible.

D. The fire alarm control panel shall be connected to a separate dedicated 120-VAC branch circuit, maximum 20 amperes. This circuit shall be labeled at the main power distribution panel as FIRE ALARM. Fire alarm control panel primary power wiring shall be 12 AWG. The control panel cabinet shall be grounded securely to facility ground. The control panel enclosure shall feature a quick removal chassis to facilitate rapid replacement of the FACP electronics.

1. The FACP shall be capable of coding Notification Appliance Circuits in March Time Code (120 PPM), Temporal (NFPA 72 A-2-2.2.2), and California Code. Main panel notification circuits (NACs 1 & 2) shall also automatically synchronize any of the following manufacturer's notification appliances connected to them: System Sensor, Wheelock, or Gentex with no need for additional synchronization modules.

2.3 MAIN FIRE ALARM CONTROL UNIT:

A. The fire alarm control unit (FACU) shall be one of two manufacturers: Notifier or Fire-Lite. A third manufacturer, Det-Tronics panels, are currently the only AFCEC approved releasing type panel for use in Air Force hangars. This falls under AFCEC's category of "Management Initiative" to reduce excessive maintenance, training, and support costs. It shall be intelligent and contain a microprocessor-based Central Processing Unit (CPU). The CPU shall communicate with and control the following types of equipment used to make up the system: intelligent initiating devices, addressable modules, printer, annunciators, and other system-controlled devices.

1. It should contain all correct modules and printed circuit boards required for the designed system.

2.4 SYSTEM COMPONENTS:

A. Fire Alarm Initiating Devices:

1. Shall be compatible with the installed FACU
2. Shall be addressable and use rotary dials to set the addresses, UL listed, and of a new condition.
   a. Manual Stations: shall be non-glass break, shall have a visual indication that it has been set off, have a key lock for reset and testing, the word FIRE shall be on it, (manual discharge or agent release stations shall not be located within 5 feet of a manual fire alarm pull station. When a manual foam discharge station and a manual fire alarm station are both located at a doorway the stations shall be located on opposite sides of the doorway. Manual discharge or agent release stations shall be housed under a clear plastic tamper proof cover. They shall comply with the signage and color coding in ETL 02-15 UFC 4-211-01).
   b. Heat Detectors: shall have a fixed temperature rating for the area/s of installation (135 degrees Fahrenheit (57.2 Celsius) for areas where ambient temperatures do not exceed 100 degrees (37.7 Celsius), and 200 degrees (93.33 Celsius) for areas where the temperature does not exceed 150 degrees (65.5 Celsius), shall be of low profile, shall fit the environment (paint booth, fuel vapors, etc.).
   c. Smoke Detectors: shall use the photoelectric (light-scattering) principal to measure smoke density and on command from the control panel, send data to the panel representing the analog level of smoke density.
   d. Laser Smoke Detectors: shall have nine sensitivity levels and be sensitive to a minimum obscuration of 0.03 percent per foot, shall support standard, relay, isolator and sounder detector bases, shall not require other cleaning requirements than those listed in NFPA 72,

shall include two bicolor LEDs that flash green in normal operation and turn on steady red in alarm.

e. Duct Smoke Detectors: shall be installed upon the composite supply/return air ducts, be installed with properly sized air sampling tubes that visually extend through the air duct, activation shall shut down units and close dampers, etc. as designed by the FPE, shall be resettable at the FACP. They shall be reset using the FACP's reset switch and/or a key operated test/reset switch located near the detector.

f. Multi-Criteria Detectors: shall monitor a minimum of photoelectric and thermal technologies in a single sensing device, shall be able to adapt to its environment, shall allow a wide sensitivity window, no less than 1 to 4% per foot obscuration, design shall be capable of selecting the appropriate sensitivity levels based on the environment type it is in (office, manufacturing, kitchen etc.), it shall also include the inherent ability to distinguish between a fire condition and a false alarm condition by examining the characteristics of the thermal and smoke sensing chambers and comparing them to a database of actual fire and deceptive phenomena.

g. Flow, Pressure, and Tamper Switches (mechanical switching devices); shall be installed on suppression systems and monitored by the appropriate electronic modules connected to the FACP.

h. Very Early Warning Fire Detection (VEWFD); shall only be installed per UFC 3-600-01 and NFPA 76 or where RF (radio frequency) signals might interfere with equipment and generate false alarms.

B. Notification Appliances:

1. Shall be compatible with the installed FACU.
2. Shall be UL listed, and of a new condition.
3. Shall have an audible sound level of 84-90 dB measured at 10 feet from the device
    a) Horn/Strobes and Sounder Bases: shall operate on 24 VDC nominal, shall be field programmable without the use of special tools, shall be flush or surface mounted as shown on plans.
    b) Speakers: shall operate on 25 or 70 VRMS or with field selectable output taps from 0.5 to 2.0 Watts, shall produce a nominal sound output of 84 dB at 10 feet (3m), shall have a frequency response at a minimum of 400 HZ to 4000 HZ, the back of each speaker shall be sealed to protect the speaker cone from damage and dust.
    c) Strobe Lights: shall meet the requirements of the ADA, UL Standard 1971, be fully synchronized, shall have a maximum pulse duration of 2/10 of one second, intensity and flash rate shall meet the requirements of UL 1971. They shall have a clear lens and the device shall be marked "ALERT", when installed along with mass notification.
    d) Textual Signs: IAW UFC 4-021-01, 4-3.4.2.2 textual signs are optional and at the discretion of the DOD installation for Army and Air Force installations. Textual signs shall not be installed on Eglin AFB.

C. Monitor/Control/Isolation Modules:

1. Shall be compatible with the installed FACU.
2. Shall be addressable and use rotary dials to set the addresses, UL listed, and of a new condition
    a) Zone/Monitor Modules; shall be provided to connect one supervised IDC zone of conventional alarm initiating devices (any N.O. dry contact device) to one of the fire

alarm control panel SLCs, shall have a LED flash under normal conditions and a distinctive indication for an alarm condition, for difficult to reach areas, the monitor module shall be available in a miniature package and shall be no larger than 2-3/4 inch (70 mm) x 1-1/4 inch (31.7 mm) x 1/2 inch (12.7 mm), shall be capable of addresses 1 thru 159, IDC zone modules shall be wired for Class A operation.

b) Control/Relay Modules; shall be provided to supervise and control the operation of one conventional NACs of compatible, 24 VDC powered polarized audio/visual notification appliances, NAC audio/visual power shall be provided by a separate supervised power circuit from the main fire alarm control unit or from a supervised UL listed remote power supply, control module shall be suitable for pilot duty applications and rated for a minimum of 0.6 amps at 30 VDC, shall be capable of addresses 1 thru 159, relay modules shall be available for HVAC control, Elevator Recall, and other building functions, relay module contacts shall be form C and rated for a minimum of 2.0 Amps resistive or 1.0 Amps inductive

c) Isolator Modules; shall be provided to automatically isolate wire-to-wire short circuits on an SLC Class A or Class B branch, shall automatically open-circuit (disconnect) the SLC during a short condition and shall automatically reconnect the isolated section, shall provide a single LED that shall flash to indicate that the isolator is operational and shall illuminate steadily to indicate that a short circuit condition has been detected and isolated, shall not be necessary to replace or reset an isolator module to its normal operation, at least one isolator module shall be provided for each floor or protected zone of the building.

d) Alphanumeric LCD Type Annunciator; shall be a supervised, remotely located back-lit LCD display containing a minimum of eighty (80) characters for alarm annunciation in clear English text, shall display all alarm and trouble conditions in the system, shall be possible to connect up to 32 LCD displays and be capable of wiring distances up to 6,000 feet, shall connect to a separate dedicated "terminal mode" EIA-485 interface, shall be capable of the following system functions: Acknowledge, Signal Silence and Reset and will be protected from unauthorized use by a key switch or password, shall be UL listed.

D. Interface and Equipment Protection:

1. All interfaces and associated equipment are to be protected so that they will not be affected by voltage surges or line transients consistent with UL standard 864.

2.5 BATTERIES:

A. The battery shall have sufficient capacity to power the fire alarm system for not less than 48 hours of supervision, plus 15 minutes of alarm notification upon a normal AC power failure.

B. The batteries are to be completely maintenance free and not larger than 55 amp-hour. If a larger capacity is figured, parallel sets of batteries, 55 A/H and smaller together. The handling of larger batteries has produced an inherent safety hazard. Fluid level checks for refilling, spills, and leakage shall not be required.

C. If necessary to meet standby requirements, external battery and charger systems may be used.

D. All batteries shall be labeled with the date of installation.

SECTION 3.0 - EXECUTION

3.1 INSTALLATIONS:

A. Installation shall be in accordance with the NEC, NFPA 72, local and state codes, UFC criteria, as shown on the drawings, and as recommended by the major equipment manufacturer.

B. All Fire Alarm Control Units and BT-XF transceivers shall be mounted in conditioned air space and no higher than 60 inches from the finished floor to top of the enclosure.

C. All fire detection and alarm system devices, control panels and remote annunciators shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas.

D. Manual fire alarm boxes shall be suitable for surface mounting or semi-flush mounting as shown on the plans and shall be installed not less than 42 inches (1067 mm), nor more than 48 inches (122 mm) above the finished floor.

3.2 TESTING:

The service of a competent, factory-trained engineer or technician authorized by the manufacturer of the fire alarm equipment shall be provided to technically supervise and participate during all of the adjustments and tests for the system. They must provide a points list of devices (a test plan) to be tested prior the final test. All testing shall be in accordance with NFPA 72 and IAW UFC 3-601-02.

A. Each of the alarm conditions that the system is required to detect should be introduced on the system. Verify the proper receipt and the proper processing of the signal at the FACU and the correct activation of the control points.

B. When the system is equipped with optional features, the manufacturer's manual shall be consulted to determine the proper testing procedures. This is intended to address such items as verifying controls performed by individually addressed or grouped devices, sensitivity monitoring, verification functionality and similar.

3.3 FINAL INSPECTIONS:

A. At the final inspection, a factory-trained representative of the manufacturer of the major equipment shall demonstrate that the system functions properly in every respect, including connection to with the technician interface tool (laptop), if required. Also, provide a box of spare components (smoke detectors, pull stations, etc.), at least two of each device installed on the system. This does not include spare panels, NAC power supplies, or transceivers. At least (2) representatives shall be on site for the final inspections.

3.4 INSTRUCTION (Training):

A. Instruction shall be provided as required for operating the system. Hands-on demonstrations of the operation of all system components and the entire system including program changes and functions shall be provided.

B. The contractor and/or the systems manufacturer's representatives shall provide a typewritten documents, to include; NFPA 72 report (listing all devices installed), a system narrative/description (a sequence of operation), a set of working drawings to include a riser diagram, equipment technical data sheets, battery and voltage drop calculations, a written record of completion (NFPA 72), a service directory; to include a list of names who's providing service during the warrantee period, and As- built drawings in a true half size (12 X 18).

C. Provide the manufacturer's recommended/required level of factory training on all the installed equipment and software, regarding installation, operation, maintenance, testing, future expansion, and programming of the fire alarm system for two (2) personnel. This training shall meet or exceed NFPA 72 National F/A and Signaling Code 10.5.3 for System Installers, Inspection, Testing and Maintenance Personnel as well as the manufacturer's required level of training and shall guarantee the unconditional operation and future purchase of additional and/or replacement equipment. The training shall take place at one of the locations normally used by the manufacturer and/or distributor to conduct factory training for their in-house employees. The government employees shall be trained alongside technicians employed by the installed equipment manufacture and/or distributer. This goes for all systems being installed, to include, but not limited to the main fire alarm system, subordinate releasing panels, VESDA systems, mass notification, textual sign systems, electrical/electronic fire pump controller, and clean agent systems. Upon successful completion of all curriculum requirements, the government personnel shall be awarded full access to all available technical support resources, to include at a minimum, on-line and telephone support provided to manufacture and/or distributer personnel.

REQUIREMENTS FOR NEW FIRE SUPPRESSION SYSTEMS AT EGLIN AFB – (LAST UPDATED JAN. 2023)

CLEAN AGENT SUPPRESSION SYSTEMS

1.0 Clean agent fire suppression systems shall use non-hydrofluorocarbon gaseous fire suppressant.

SUPPRESSION SYSTEM SIGNAGE/INFORMATION

1.0 All general information signs shall be permanently etched on weatherproof metal or rigid plastic, secured with corrosion-resistant wire, chain, or other acceptable means.

1.1 Signage shall be placed at each system riser and include the following applicable information:

- Name, building number and/or location of the facility protected
- Location of inspector's test valves, auxiliary drains, and air relief valves
- Flow test data
- Original results of main drain flow test
- Name of the designer/installer, including contact information
- Additional NFPA/UFC required information

2.0 Fire Suppression drawings, O&M (operation and maintenance) sheets shall be posted in a wall mounted document box.

3.0 Fire department connections and test headers shall be clearly identifiable to fire and maintenance personnel.

BACKFLOW PREVENTION DEVICES

1.0 Backflow prevention devices shall be installed/tested by a certified craftsman and provide AHJ with current certification/test results prior to acceptance.

2.0 Backflow prevention devices shall be installed down stream of the PIV (post indicator valve).

3.0 Backflow prevention devices shall be installed upstream of the fire pump.

4.0 Backflow prevention devices shall include indicating type valves.

5.0 Water meters/detector check assemblies shall not be installed on backflow prevention devices installed on fire suppression systems.

FIRE WATER STORAGE TANKS

1.0 Fire water storage tanks shall be constructed of steel with welded joints, bolted type tanks are not permitted on Eglin AFB.

2.0 Fire water storage tanks shall use an approved air gap as backflow prevention.

3.0 Fire water storage tank inlet control valves shall utilize slow closing solenoid valves or controlled by solenoid valves only.

3.1 Fire water storage tank inlet control valves shall have a means of manual operation.
4.0 Fire water storage tank fill valves that use electrical means to operate a control valve shall use separate sensors from the high and low water level alarms to operate the level control valve within the high- and low-level alarms.

5.0 The water level sensors that control the fire water storage inlet fill valve shall be the probe type and have the following functions –

- The valve shall tell the inlet fill valve to open before the low water level supervisory signal activates
- The fill valve shall shut off before the high-water level supervisory signal activates
- Additional NFPA/UFC requirements

5.1 All other types of water level sensors are prohibited on Eglin AFB.

FIRE/JOCKEY PUMPS AND HYDRANTS

1.0 City water bypass loops shall be omitted on fire pumps supplied by a non-elevated fire water storage tank.

2.0 Premanufactured fire pump houses shall have the entire floor area between the beams filled solid with concrete.

3.0 Jockey pump/jockey pump controllers shall be variable frequency drive.

4.0 Both fire/jockey fire pumps and controllers shall be connected to emergency power when available.

5.0 796 CEOFA shop personnel shall receive all hardware/software and special tools (cables, laptops, etc.) required to program/maintain all fire/jockey pump controllers. Manufacture training that meets or exceeds NFPA 72 10.5.3 shall be provided for (2) shop personnel.

6.0 Fire hydrants shall be painted IAW UFC 3-600-01 and NFPA 291. The paint will be enamel and color matched as follows:

- Fire Hydrant Red #MD-43827
- Safety Yellow #MD-43828
- Safety Orange #MD-43829
- Safety Blue #MD-43830
- Green #MD-43831

INSTALLATION OF SYSTEMS

1.0 Antifreeze fire suppression systems shall not be installed on Eglin AFB.

2.0 All-thread shall not be used in floor-based pipe stands.

3.0 CPVC shall not be used. Install SCIF transitions IAW UFC 4-010-05, 3-5.8.2 for sprinkler pipe penetrations.

4.0 All mechanical joints shall be tightened with a calibrated torque wrench to the manufacture's specifications.

5.0 PIV (post indicator valves) shall not be electronically supervised but secured with a lock provided by 96 CEG.

6.0 Sprinkler system piping shall be schedule 40 black iron steel.

7.0 Hydraulic gongs and alarm check valves shall be installed on all sprinkler systems.

8.0 Valves requiring electronic supervision shall utilize rope type tampers.

9.0 An electronically supervised isolation valve shall be installed on pre-existing systems to separate new work of more than (20) heads.

10. All inspectors/elevators' tests, auxiliary/main drain, pressure relief valves shall be installed per the following requirements:

- Readily accessible as defined per the following –
    - Accessible without the use of a ladder, work platform, or special tools
    - Accessible outside of areas requiring additional security requirements within the facility, i.e., secured/special success areas within the facility.
- Below finished ceilings
- Not installed higher than 72" from the finished floor
- Discharge to the exterior of facility

11. Inspectors test valves shall be provided with a sight glass and relief valve.

12. Inspectors test valve may be installed at the riser if an auxiliary drain is installed at the furthest point in the system.

13. Valves 3" and larger shall be resilient seat OS&Y type.

14. Alarm valves shall be installed in a dedicated riser room or unoccupied area, be readily accessible, and located 30" – 60" above the finished floor.

15. Concrete splash blocks large enough to prevent ground erosion shall be placed to displace discharge from all inspector's test, auxiliary drains, and main drain outlets.

16. A minimum of (1) air relief valve shall be installed after the control valve at the systems highest point and areas susceptible to trapped air.

17. All check valves over 2” shall have a cover plate for maintenance without removing the check valve assembly from the piping system.

18. Test headers shall be installed on exterior of building, utilizing 2 ½” gate valves with a fire hose threaded outlet, and include a drain valve at the lowest point.

February 2023

DEPARTMENT OF THE AIR FORCE
AIR FORCE CIVIL ENGINEER CENTER
TYNDALL AIR FORCE BASE FLORIDA

5 Jan 2023

MEMORANDUM FOR RECORD

FROM: AFCEC/CO
139 Barnes Drive, STE 1
Tyndall AFB, FL 32403-5319

SUBJECT: Fire Alarm Panel Standardization, Up to 3 Manufacturer Brands can be selected

1. This memorandum serves as AFCEC/CO's official communication approving the selection of 2 manufacturers for Fire Alarm Panels respective to the following installation:

Installation:	**Unit:**	**Manufacturers:**
Eglin AFB	796 CES	Notifier Onyx, Firelite

2. The comprehensive inventory analysis is to be repeated after five years from the date of this memorandum. The purpose of this secondary analysis is to document the installation's progress in standardizing fire alarm panels, consider any changes in the decision facts, and confirm no external factors exist that may drive a reconsideration of the approved single manufacturer. Should the BCE determine that a change in the approved manufacturers is required, a new Memorandum of Request (MOR) and analysis will be accomplished.

3. Please direct any questions and/or concerns regarding implementation of this guidance to my POC, Mr. Efrem Rivers, DSN 523-6764, efrem.rivers.1@us.af.mil or to the AFCEC Reachback Center at AFCEC.RBC@us.af.mil.

KLEIN.JEFFREY.ROBERT.1266032575 Digitally signed by KLEIN.JEFFREY.ROBERT.1266032575 Date: 2023.01.06 08:34:00 -06'00'

JEFFREY R. KLEIN, Lt Col, USAF
Deputy Director, Operations Directorate

APPENDIX I

EGLIN AFB EMCS (DDC) SYSTEM REQUIREMENTS (NOVEMBER 2021)

Eglin AFB

EMCS (DDC) System Requirements for New Facilities: 16 Nov 2021

1. Provide building level supervisory controllers based on Eglin's existing Niagara 4.0 Framework or later. The building level supervisory controllers shall include point-2-point (P2P), Secure Socket Layer SSL, Web server and embedded WorkBench (WB). The building level supervisory controllers shall contain all building logic, graphics and local controller backups. The JACE shall be mounted in the Mechanical room.
2. All graphics and points shall be duplicated in the existing Niagara 4.0 Framework ENS (Enterprise Network Server) using existing workbench software located in building 696 which shall serve as the Web Server for the system. All trended points shall be transferred via P2P to the server for history trending of points.
3. One - laptop with the latest operating system, cpu, and technology as it relates to laptops. Provide software and usb adapters for each type of ddc field controllers, to include factory installed ddc controllers. (This laptop will be used/verified during the training).
4. The system shall allow CE technicians to connect to all controllers with all available software in all modes available from the manufacturer from Bldg 696 via the local area network (LAN) to program, backup, download, configure and perform all functions necessary to maintain the system as if onsite and direct connected to the device.
5. All hardware and software administrator level passwords shall be provided to the government to access all levels of all controllers including the new Niagara Framework controllers as well as copies of the system's topology, hardware/ software inventory, and configuration. The password shall allow complete access to everything the manufacture has access to. Leave the default factory Platform User Name and Password installed.
6. All field controllers shall use Bacnet **IP** protocol. Put Field Controller file backups in the JACE.
7. Contact the DDC shop for assignment of IP address, network #s & device ID's.]
8. Provide a Lan drop within three feet of each building level supervisory controller and provide a patch cable between the Lan drop and the building level supervisory controller.
9. When the bacnet comm buss leaves and enters a building, use fiber optic cable and provide media converter pairs (ie between buildings or out to chillers) and provide DB testing results.
10. The bacnet comm buss shall be daisy chained to the JACE. No additional switches or routers shall be used.

IAW AFGM2019-32-02 CE Control Systems Cybersecurity
Para 3.3.8 requires the vendor(s) to perform an initial security assessment, a scan of vulnerabilities, to provide a copy of the scan results, and to mitigate the identified vulnerabilities **prior to final acceptance by the Air Force**. After acceptance, only government-owned assets (e.g., computer, tablet) may be connected to the network for CS maintenance.

Eglin AFB

EMCS (DDC) System Requirements for Current Facility Remods: 16 Nov 2021

1. Modifications to an existing Building's Control System (CS) **must** be compatible with the current CS in that facility if the new controls are connecting to existing JACE. (Whenever possible, the same brand controls should be used.) If a new JACE is to be installed, the requirements for (New Facilities) will apply.
2. All graphics (including floor plans) must be updated in the existing ENS (Enterprise Network Server) located in building 696 which shall serve as the Web Server for the system, as well as in the JACE.
3. The system shall allow CE technicians to connect to all controllers with all available software in all modes available from the manufacturer from Bldg 696 via the local area network (LAN) to program, backup, download, configure and perform all functions necessary to maintain the system as if onsite and direct connected to the device.
4. Provide all Controls software necessary for project (to be loaded onto an AF provided Laptop with current SDC). Provide latest software and usb adapters for each type of DDC field controllers, to include factory installed DDC controllers. (This laptop will be used/verified during the training).
5. All hardware and software administrator level passwords shall be provided to the government to access all levels of all controllers including the new Niagara Framework controllers as well as copies of the system's topology, hardware/ software inventory, and configuration. The password shall allow complete access to everything the manufacture has access to.
6. All field controllers shall use Bacnet **IP** protocol.
7. The bacnet comm buss shall be daisy chained to the JACE. No additional switches or routers shall be used. Ensure not to damage/cut existing Buss Line for the remainder of the Facility.

IAW AFGM2019-32-02 CE Control Systems Cybersecurity
Para 3.3.8 requires the vendor(s) to perform an initial security assessment, a scan of vulnerabilities, to provide a copy of the scan results, and to mitigate the identified vulnerabilities **prior to final acceptance by the Air Force**. After acceptance, only government-owned assets (e.g., computer, tablet) may be connected to the network for CS maintenance.

*Graphics sh*all be in the existing ENS (Enterprise Network Server) located in building 696 which shall serve as the Web Server for the system, as well as in the JACE.

Include date and time on all graphic screens.

Main Map Graphic- This screen will have a list and link to all of the buildings on the entire Eglin complex.

Building Graphic- This screen will have a 3d graphic of the front of the building and a building number.
The following links are required on this page: Back to Main Map, floor plans, alarms, reports, schedules, history, and user service.

Floor Plan Graphic
The floor plan will be 3D with color coded zones, room numbers, and as- built sensor and equipment locations.
The following points are required on this page: room temp, room humidity, occupancy status
The following links are required on this page: back to building graphic, all equipment (Click on sensor or equipment shown on the floor plan and the link will go to the corresponding equipment).

Typical VAV Table Graphic
The VAV table should include the following info:
Box #, Zone Temp, Set Points (Heat & Cool), SP Source, Flow SP, Flow, Damper position, Heating %, SAT

Typical Equipment Graphic
Include a header with equipment type and number, room numbers and area served.
Include all points on the equipment graphic.
The following points will be animated: fans, dampers, coils, pumps, boilers.
All set points will have the capability of being changed from the graphic.
The following links are required on this page: back to floor, provide a hidden link over each point to show an hourly 3 day trend, provide a hidden link over each point to override all outputs. Provide a link to a spread sheet with manufacture and part numbers and warranty dates for all parts on the equipment graphic.


Communication Bus Graphic
Include an as-built wiring diagram of the communication buss between all controllers.

Provide a printed copy of each graphics page prior to project training.

Eglin AFB
Energy Management Control System (EMCS) Network Requirements for New Facilities

1. Comm Squadron shall Install/Identify 2 fiber strands dedicated for DDC connectivity.
2. Contractor installs a wall mounted lockable network enclosure (LNE) with surge protector [for an 8 port switch--**provided by AF** (see attached LNE Detail) in the main Communications room mounted on the fire rated backer board.
3. Contractor installs a 20A/125V duplex receptacle within 3' of the LNE for connection of the surge protector. This receptacle shall be connected to the emergency power panel if the building is, or will be, equipped with an emergency generator.
4. Contractor installs a single port LAN connection inside the LNE and inside each building level supervisory controller.
5. Contractor installs a 2" EMT conduit from the LNE to each building level supervisory controller in the building.
6. Contractor installs a 1 ¼" pliable raceway, w/pull string, from the LNE to a height approximately 12" above the Communications room rack. [DDC shop personnel shall install a fiber jumper from the LNE to the installed fiber patch panel].
7. Contractor installs purple Cat 5E cable from the LNE to each building level supervisory controller. **Note**: If the distance exceeds 100 meters between the LNE and the building level supervisory controller, the building level supervisory controller shall be moved or fiber w/media converters must be used.
8. [Provide a fiber jumper-**provided by customer**--for the Complex node that connects the end building to the backbone network switch].
9. The following items are to be "purchased and provided to the DDC shop by facility owner (or user)", programmed 8 port switch, 2-fiber jumpers (switch model and jumper lengths to be provided by the DDC shop).

Typical Drawing of Lockable Network Enclosures

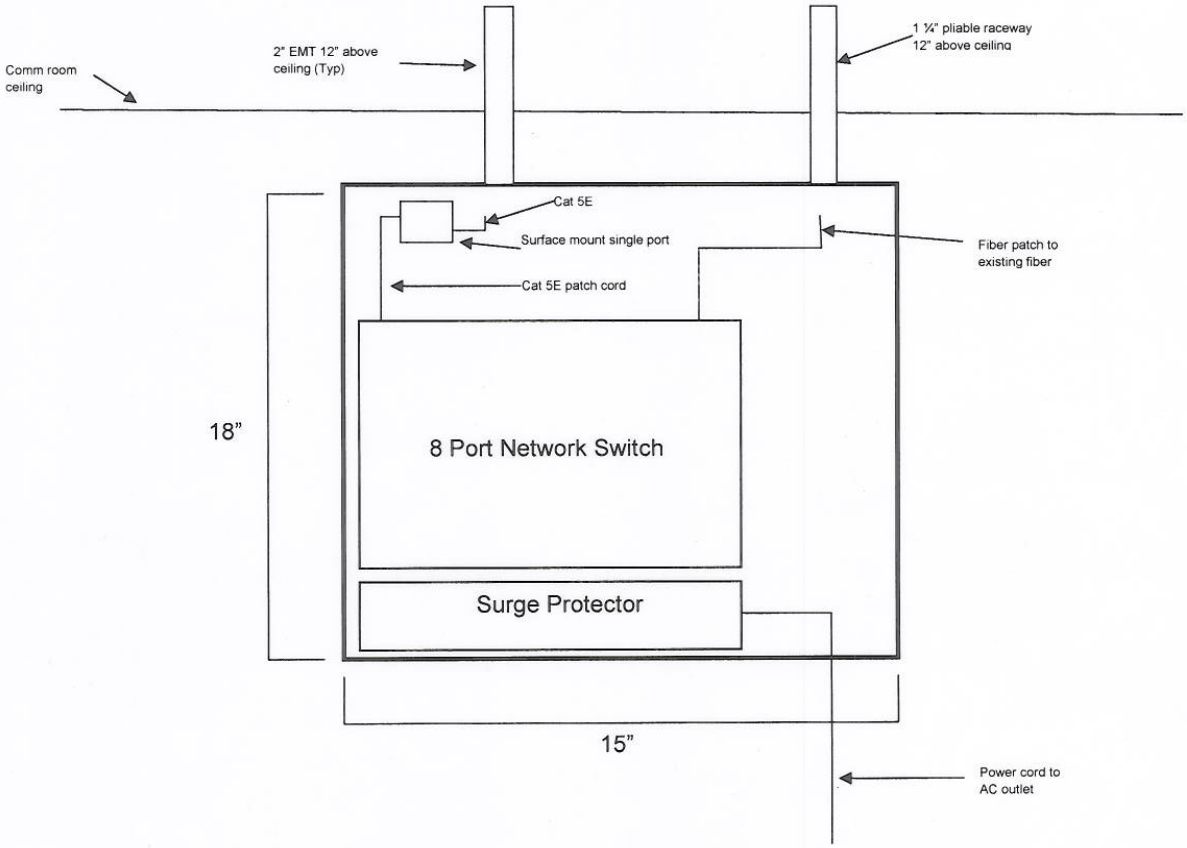

APPENDIX J

Guidance for Preparation of Soil Management Plans, FDEP, May 2022

Guidance for Preparation of Soil Management Plans

Florida Department of Environmental Protection
Division of Waste Management
District and Business Support Program
Tallahassee, FL
May 2022

Disclaimer:
This document is guidance for preparing a Soil Management Plan (SMP) that may be a stand-alone document or a subsection of the Interim Source Removal Proposal (ISRP) or Remedial Action Plan (RAP). The guidance provides suggested topics to be included in the SMP. There are a range of situations where a SMP is required and therefore not all topics in this guidance may be applicable to a particular project. The SMP will be evaluated for completeness as it relates to managing site soil activities that will enable an ISRP approval or a RAP Approval Order to be issued by Florida Department of Environmental Protection (FDEP). Soil activities to be managed include removal, reuse, or importing soils and all associated activity. Nothing in this guidance supersedes any Federal, State, or Local requirements; nor, as guidance, does it create any new requirements under Chapter 62-780, Florida Administrative Code (F.A.C.). All applicable Department rules must still be adhered to.

ACRONYMS

ASCTL	Alternative Soil Cleanup Target Level
COC	Contaminant of Concern
DU	Decision Unit
EU	Exposure Unit
F.A.C.	Florida Administrative Code
FDEP	Florida Department of Environmental Protection
ISM	Incremental Sampling Methodology
ISRP	Interim Source Removal Proposal
PRSR	Person Responsible for Site Rehabilitation
RAP	Remedial Action Plan
SCTL	Soil Cleanup Target Level
SMP	Soil Management Plan
XRF	X-Ray Fluorescence

PURPOSE

This document provides guidance on what content should be included in an SMP. SMPs should document all contaminated soil excavation, handling, reuse (blending) and disposal activities. The expectation is that these topics will be discussed in appropriate detail either in a stand-alone SMP or as a section in a RAP/ISRP. In an effort to promote consistency and standardize rule interpretation, when a release at a site occurred many years prior to initiating rehabilitation, it is recommended that these sites follow the standard Chapter 62-780, F.A.C., process (as applicable) of completing assessment, preparing a RAP/SMP, implementing remedial actions, performing groundwater monitoring, and soliciting no further action when Chapter 62-780.680, F.A.C., criteria are satisfied.

It is recommended that an SMP included in a RAP/ISRP be approved prior to any removal actions to minimize the risk of additional assessment and/or remediation.

DEVELOPING A SOIL MANAGEMENT PLAN

The SMP should be comprehensive and cover all soil management activities involving contaminated soils. An SMP should be developed any time contaminated soils are excavated, stockpiled, blended with other site soils, soil is imported for use in blending, or soils are reused on a site. An SMP is intended to document how contaminated site soils are managed to prevent contamination of soils that were not found to be impacted by a release as part of the initial site assessment. The SMP should include, as applicable: figures of locations where removal actions are planned; the depth of removal actions; if groundwater will be encountered; where stockpiles and soil mixing activity are planned; how excavated contaminated soil will be moved to the stockpile area; how stockpiles will be managed (including what impervious surface(s) the stockpiled material will be placed on, as required by Chapter 62-780.525(5)(a)7, F.A.C.); what stormwater/erosion safeguards will be put in place; how stockpiles will be managed to prevent

dust issues; how soils will be mixed; any proposed sampling plans; and, how mixed soils will be transported on site.

Per Chapter 62-780.525(7), F.A.C., documentation needs to be provided for all contaminated soils disposed of off-site (name of facility, address, volume, what site contaminant(s) of concern (COC) caused the soils to be disposed off-site). The SMP should describe if clean fill will be imported for the purpose of mixing with impacted site soils and subsequently be reused on site. The proposed source of the clean fill and proposed volume imported for blending purposes should be documented, and any analysis that was performed should be provided.

RECOMMENDED ELEMENTS OF A SOIL MANAGEMENT PLAN

1) Summarize the history of the site.
2) If this is a redevelopment project, provide a summary of all properties proposed in the redevelopment plan, and discuss land use before and after (if known). Will the redevelopment occur in phases? What kinds of property use are proposed in each phase?
3) Provide a figure depicting the Remedial Units (i.e., source removal areas and/or soil blending areas) and designated Exposure Units (EUs)/Decision Units (DUs) (see Guidance for Soil Reuse Involving Soil Blending Activities at Chapter 62-780, F.A.C., Sites). Discuss any variations in procedures and methodology for the different units.
4) Initial Assessment Summary
    a) A summary of soil COCs and target soil cleanup target levels (SCTLs) or justification of alternative SCTLs (ASCTLs) should be provided. Generally, on-site soil assessment should be complete for the entire site or development phase prior to preparation of the SMP. However, for source removal areas, delineation may be completed post-excavation using sidewall and bottom samples. Further, recognizing the potential constraints with obtaining approval to collect off-site samples, the SMP may be developed prior to completion of off-site delineation.
    b) Description of depth to water table, leaching potential, and any groundwater impacts prior to soil excavation activities.
    c) When contaminated soil reuse is planned, identify if the soil concentrations are suitable for achieving the applicable SCTL(s) after blending soil and identify what post-reuse verification sampling will be conducted.
5) Soil Remedial Action Summary
    a) Contaminated Soil Excavation:
        i) Pre-excavation delineation sampling (laterally & vertically), excavation area locations (sampling type, increments, number, and locations), cut line decisions, step out process, sampling methodology, sampling locations, and soil sample intervals should be documented.

ii) Describe the earthwork approach for contaminated soils, including cut and fill analysis, areas of soil stockpile generation, areas that will receive contaminated soils, and areas that will receive clean soils. Provide an estimate of the volume of contaminated soils to be taken off-site.

iii) Summarize transportation (on and off site) plans for moving excavated contaminated soils to stockpile areas. Describe safeguards employed to prevent cross contamination from the stockpile(s).

iv) Describe all applicable stormwater, dust, sediment, erosion, and odor controls.

v) Will clean fill be imported to the site to fill the excavation? If so, provide the source facility name and address. Sampling of the imported soil to ensure that it is not contaminated is not required but is recommended. The analysis is recommended to include site COCs and potential COCs associated with the source of the imported fill. Additionally, the site locations where the soil is placed should be documented.

b) Stockpiling Procedures:

i) Stockpile site locations should be documented; describe wet soil handling procedures.

ii) Describe stormwater, dust, sediment, erosion, and odor controls to prevent impacted soil from contaminating non-impacted portions of the site.

iii) If conducted, summarize stockpile sampling methodology and procedures, including the number and collection depth of samples. Typically, FDEP does not make site decisions based on stockpile sampling results (see Guidance for Soil Reuse Involving Soil Blending Activities at Chapter 62-780, F.A.C., Sites)

iv) Off-Site Disposal – If impacted soils will be removed from the site and disposed of at a permitted facility, include the name of the facility, address, and permit number, if applicable. Also, the volume will need to be tracked and documented. Note: all off-site disposal is the responsibility of the Person Responsible for Site Rehabilitation (PRSR), including arrangements with the disposal facility to meet the requirements for sampling and analyses.

c) Soil Reuse – Soil blending (see Guidance for Soil Reuse Involving Soil Blending Activities at Chapter 62-780, F.A.C., Sites)

i) Reuse feasibility should be evaluated. For example, wide-spread impacts of elevated soil concentrations must be evaluated to determine if the soil is suitable for reuse. Pilot test results and blending ratio calculations may be provided as part of this evaluation. Areas with the highest impacts should be included when determining the suitability of soil reuse.

ii) Soil blending shall be conducted within the contaminated site. However, if the verification testing documents that the applicable SCTL(s)/ASCTL(s) were not achieved during the initial blending, then subsequent blending may occur in place, followed by subsequent verification testing. Sampling of stockpiled blended soil is at

the discretion of the PRSR and stockpile soil samples are generally not usable for decision making purposes unless Incremental Sampling Methodology (ISM) is applied. Refer to the *White Paper – Stockpile Sampling for Soil Reuse at a Site* (Stuchal and Roberts, December 2020) for ISM stockpile soil sampling recommendations and the Interstate Technology & Regulatory Council for guidance on the proper implementation of ISM.

iii) Describe all applicable stormwater, dust, sediment, erosion, and odor controls.

iv) If sampling is conducted, summarize the blending confirmation procedures and the decision process for re-blending.

v) If the 95% Upper Confidence Limit process is used, provide detailed calculations in a submittal to FDEP.

vi) If ISM is used for any aspect of collecting soil samples, provide a detailed description of the process to be used, including sample locations. Note: methodology should follow accepted ISM guidance.

d) Placement of Blended Soils:

i) Describe how blended soils will be transported from stockpile areas to placement areas.

ii) If soil is reused on-site, verification sampling should be conducted within the EUs/DUs where the blended soil was placed. See Guidance for Soil Reuse Involving Soil Blending Activities at Chapter 62-780, F.A.C., Sites for additional details on guidance for verification sampling of blended soils. Note: X-ray Fluorescence (XRF) is an acceptable field sampling methodology but generally cannot achieve the detection limits necessary to demonstrate the applicable cleanup target levels have been achieved. If the XRF is intended to be used for verification sampling, a site-specific demonstration that the XRF can reliably measure the applicable CTLs, including acceptable correlation with laboratory data, should be provided as part of the SMP. XRF may be used as a screening method for selecting sample locations in conjunction with an established correlation with laboratory results.

iii) All areas of the site where reuse will occur should be thoroughly documented.

iv) Describe the final cover, including any proposed engineering controls.

6) Summarize excavation dewatering procedures if the excavation will extend below the water table and dewatering may affect groundwater plume stability.

7) Describe current or proposed institutional and/or engineering controls, including the type and location, as applicable.

8) Provide any contingency plans, if applicable - for example, air monitoring and dust control or mitigation.